


Directorate of Enforcement, Vigilance & Disaster Management  
Greater Hyderabad Municipal Corporation

From  
The Director  
Enforcement Vigilance &  
Disaster Management,  
GHMC Hyderabad.

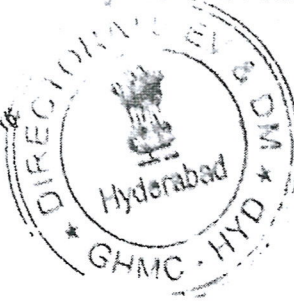

To  
The Management  
"Good Shepherd High School",  
Sy. No. 65 & 72 Part,  
Logos Bhavan, Suchitra Junction,  
Medchal Road, Qutbullapur(M),  
Medchal-Malkajgiri District.

Rc. No. DM/0266/2022, Dated: 26.07.2022.

Sub :- Directorate of EV&DM - GHMC - Existing Non High Rise Educational Building of "Good Shepherd High School" consisting Ground + 2 Upper Floors situated at Sy. No. 65 & 72 Part, Logos Bhavan, Suchitra Junction, Medchal Road, Qutbullapur(M), Medchal-Malkajgiri District - Fire No Objection Certificate - Issued - Regarding.

- Ref :-
- 1) Proceeding Rc. No. 5041/B2/97, Dated: 12.03.2010 of the Director General of the State Disaster Response and Fire Services, A.P., Hyd.
  - 2) Proceedings No. DM/0011/2018/D(VK) EVDM/2018, dt. 29.06.2018 of the Commissioner, GHMC
  - 3) Application of the Management, Dated: 17.05.2022.
  - 4) E-office No. 303593 & File No.DM/0266/2022 of Director, EV&DM.
  - 5) Inspection report dated: 26.07.2022

\*\*\* \*\*

Vide reference 5<sup>th</sup> cited, the team has inspected and submitted the following report of the Existing Non High Rise Educational Building of "Good Shepherd High School" consisting Ground + 2 Upper Floors situated at Sy. No. 65 & 72 Part, Logos Bhavan, Suchitra Junction, Medchal Road, Qutbullapur(M), Medchal-Malkajgiri District.

2. Particulars of the Building:

a)	Name & Address of the building	"Good Shepherd High School", Sy. No. 65 & 72 Part, Logos Bhavan, Suchitra Junction, Medchal Road, Qutbullapur(M), Medchal-Malkajgiri District
b)	Plot Area/Height	42.714.80 Sq. Meters/ 10.20 Meters
c)	No of floors	Ground + 2 Upper Floors
d)	Name of the Owner with mobile no.	Good Shepherd High School Management 9440667661

### 3. Floor wise details

Sl. No.	Floor	Area in Sq. Meters	Type of Occupancy	Maximum Occupant Load as per Floor Area
1	Ground Floor	761.00	Educational (B-1)	190
2	First Floor	761.00	Educational (B-1)	190
3	Second Floor	761.00	Educational (B-1)	190
Total		2283.00		

### 4. Open Spaces all Round Building

Sl. No.	Directions	Required as per NBC	Provided	Deficit
1	FRONT (West)	6.00 Meters	6.00 Meters	Nil
2	SIDE I (North)	6.00 Meters	6.00 Meters	Nil
3	SIDE II (South)	6.00 Meters	6.00 Meters	Nil
4	REAR (East)	6.00 Meters	6.00 Meters	Nil

### 5. Means of escape:

Sl. No.	Staircases	Nos.	Required Width	Nos.	Provided Width	Deficit
1	Internal	01	1.50 Meters	02	2 X 1.50 Meters	Nil
2	External	01	1.50 Meters	01	1 X 1.50 Meters	Nil

### 6. The Minimum Fire Safety Installations required & provided by the builder as per the Table 7 of Part-4 of N.B.C of India 2016.

Sl. No.	Fire Safety Installations	Required	Provided	Deficit
1	Fire Extinguishers	24 Nos.	24 Nos.	Nil
2	First Aid Hose Reel	06 Nos.	09 Nos.	Nil
3	Terrace Tank over Respective Tower Terrace	10,000 Liters	25,000 Liters	Nil
4	Manually Operated Electronic Fire Alarm Systems	NR	06 Nos.	Nil
5	Pump at the Terrace Tank level with Minimum Pressure of 3.5 Kg/Cm <sup>2</sup>	1 No. Booster Pump of 450 LPM	1 No. Booster Pump of 900 LPM	Nil

### Terms & Conditions: -


1. The NOC issued is confined to the Fire Safety measures installed in the building and does not confer any Legal right for claiming of Ownership of property or Conversion of land use / Occupancy or Building Regularization. The Owner / Occupier shall comply the Building Rules / Govt. Orders as applicable.
2. Fixed and first-aid Fire Fighting equipment, alarm etc shall be tested and maintained regularly as per applicable standards and Fire-Drills conducted quarterly for first two years and half yearly after two Years. Also expired equipment should be replaced immediately.



:: 3 ::

3. No temporary structure such as tents or with thatched construction should be allowed for educational institutions.
4. Emergency power generator etc., and associated equipment should be tested periodically, verified as per NBC, and IS-1646.
5. Every room with a capacity of 45 students (for educational building) shall be provided with two doorways.
6. Every vertical opening between the floors of the building shall be suitably enclosed or protected to prevent spread of fire, smoke and fumes from one floor to other.
7. Evacuation plan at showing exit routes and recommended action plan be displayed at conspicuous locations and shall be exhibited all times, all escape /exit routes shall not be blocked or encroached.
8. Fresh NOC would be required for any change in occupancy or additions/ alterations in the building structure as per NBC of India and building bye/laws.
9. The Management has to maintain the Fire Fighting systems at all times in good working Condition, as seen during the inspection.
10. Any Loss of life or property due to Non - functioning of Fire Safety Measures and other installations shall be the responsibility of the management/owner.
11. All the Occupants must know the correct method of operation of the First Aid Fire Fighting System installed.
12. All Security personnel shall be trained to operate the Fire Safety Equipment during the Emergency.
13. This Order will be without any prejudice to take action against the Unauthorized construction if any made.
14. This Fire No Objection Certificate is valid for one year from the date of issue and it the responsibility of the builder/occupier to apply for the Renewal, two months before expiry of this Fire NOC.

In view of the above, the Fire No Objection Certificate is issued to the Existing Non High Rise Educational Building of "Good Shepherd High School" consisting Ground + 2 Upper Floors situated at Sy. No. 65 & 72 Part, Logos Bhavan, Suchitra Junction, Medchal Road, Qutbullapur(M), Medchal-Malkajgiri District.



DIRECTOR,  
EV & DM, GHMC

Principal  
**Good Shepherd High School**  
Jeedimetla Village, Suchitra Po.  
Malkajgiri Dist. -500 067.