

# Air Cleaner Assessment Report: Rensair Model Q01B

---

Client:  
Rensair LLC

Indoor Science Project ID: 4200738

**Date:** October 12, 2022

Prepared by:  
Indoor Science  
75 Executive Drive  
Suite 202  
Aurora, IL 60504  
(312) 920-9393  
[www.IndoorScience.com](http://www.IndoorScience.com)

## **Table of Contents**

---

<b>Table of Contents .....</b>	<b>2</b>
<b>Executive Summary .....</b>	<b>3</b>
<b>Background .....</b>	<b>4</b>
<b>CADR – Clean Air Deliver Rates .....</b>	<b>4</b>
<b>HEPA tests on Filter Media and Full Unit .....</b>	<b>5</b>
<b>UV Kill Rate for Viruses and Mold .....</b>	<b>5</b>
<b>Conclusions and Recommendations .....</b>	<b>7</b>
<b>Limitations .....</b>	<b>8</b>
<b>Appendix A: CADR Laboratory Results.....</b>	<b>9</b>
<b>Appendix B: HEPA Laboratory Results .....</b>	<b>10</b>
<b>Appendix C: UV Kill Rate Laboratory Results.....</b>	<b>11</b>

## Executive Summary

---

Indoor Science determined that the clean air delivery rate (CADR) for the the Rensair Model Q01B exceeded the guideline of 300 cfm for all three particle sizes (smoke, dust, and pollen). Indoor Science recommends a minimum CADR of 300 cfm for classrooms and other similarly-sized areas to mitigate COVID risks.

Indoor Science confirmed that the Rensair Model Q01B meets the criteria to be considered a high efficiency particulate air (HEPA) filter. Both the filter media and the full unit met the HEPA standard, which requires a minimum of 99.97% efficiency at removing particles at 0.3  $\mu\text{m}$  in aerodynamic diameter.

Indoor Science tested the ability of the Rensair's UV light to deactivate microorganisms on the filter surface. At 30 minutes of UV exposure, all test viruses and mold spores were deactivated. Furthermore, a test did not detect any *Stachybotrys* proteins on the filter surface following 60 minutes of UV light irradiation.

## Background

---

Indoor Science was retained by Rensair to conduct an independent evaluation of the Rensair Q01B air cleaner. The goal was to evaluate the air cleaner for particle removal efficiency and the ability of the embedded UV light to deactivate viruses and mold on the filter surface.

The following tests were conducted:

- CADR test following AHAM methodology for all three sizes: smoke, dust and pollen
- HEPA test on the filter media to determine efficiency at 0.3 microns
- HEPA test on the full unit to determine efficiency at 0.3 microns
- MS2 surface test on filter to determine viability with UV light on vs. off
- Stachybotrys surface test on filter to determine viability with UV light on vs. off

Testing was conducted at Indoor Science's partner laboratory LMS Technologies in Bloomington, MN.

## CADR – Clean Air Deliver Rates

---

The Rensair Q01B clean air delivery rate (CADR) was determined following methods adapted from the ANSI/AHAM AC-1 Standard, Method for Measuring Performance of Portable Household Electric Room Air Cleaners from the Association of Home Appliance Manufacturers (AHAM). CADR incorporates filter efficiency and fan capacity to inform customers of the total amount of clean air provided by the portable air cleaner every minute. CADR is measured in cubic feet per minute (cfm). The CADR is useful when determining the size of space to be used by an air cleaner. AHAM uses a rule of thumb which multiplies the CADR by 1.5 to determine the maximum room size for an air cleaner. For example, AHAM would recommend an air cleaner with a CADR of 300 to be used in a room no larger than 450 square feet. Indoor Science recommends air cleaners with a CADR greater than 300 for classrooms to mitigate COVID-19 risks.

The test method evaluates air cleaner performance against three different particle sizes: tobacco smoke, dust and pollen. The test method calls for particle sizes as follows:

- Tobacco smoke: 0.09 to 1.0 microns ( $\mu\text{m}$ )
- Dust: 0.5 to 3.0  $\mu\text{m}$
- Pollen: 0.5 to 11.0  $\mu\text{m}$

## Results

The table below summarizes the Rensair Q01B CADRs for all three particle sizes using the fan's high setting:

Particle Size	Clean Air Delivery Rate (CADR)
Tobacco smoke	314.7
Dust	320.0
Pollen	316.2

The total flow rates of air cleaner on different settings were as follows:

- Low: 185.7 cubic feet per minute (cfm)
- Medium: 286.5 cfm

- High: 346.6 cfm

The full CADR laboratory results are included in Appendix A.

## HEPA tests on Filter Media and Full Unit

High efficiency particulate air (HEPA) filters are defined as those removing at least 99.97% of particles at 0.3 microns in aerodynamic diameter (other definitions use the most penetrating particle size). Both filter media and the full unit can be tested for HEPA performance. If a portable air cleaner does not have a tight seal on the HEPA filter media, bypass can reduce performance. Therefore, it is possible to have HEPA filter media without HEPA performance of the full unit.

Testing was conducted using methods adapted from the Institute of Environmental Sciences and Technology (IEST) Recommended Practice CC001: HEPA and ULPA Filters.

### Results

The table below summarizes the Rensair Q01B HEPA performance for both the filter media and the full unit:

	Efficiency at 0.1-0.2 $\mu\text{m}$	Efficiency at 0.2-0.3 $\mu\text{m}$	Does it meet HEPA (99.97%)?
Filter media	99.989%	99.991%	Yes
Full unit	99.974%	99.976%	Yes

The full HEPA laboratory results are included in Appendix B.

## UV Kill Rate for Viruses and Mold

The Rensair Model Q01B includes an ultraviolet (UV) light for the purpose of deactivating (“killing”) microorganisms that accumulate on the filter surface. The test method for evaluating the kill rate of the air cleaner utilized MS-2 virus as surrogate for SARS-CoV-2 and other similar viruses. The method used *Stachybotrys* as a surrogate for fungi/molds that grow indoors. By achieving a high kill rate, the UV can reduce risks associated with changing filters.

Organisms were grown on appropriate media, harvested, and placed on clean media test strips. The strips were attached to the inside of the air cleaner’s HEPA filter. Samples were taken at 0 time. The UV was activated, and the highest speed fan was used. The remaining test strips were timed for 5, 15, 30, and 60 minutes of exposure. Rinsates of the test strips were prepared and an aliquot was placed on agar media. Plates were incubated and counted.

An additional test was conducted on the filter media for the presence of proteins associated with *Stachybotrys*. Deactivating mold does not necessarily remove the allergenic proteins found on the outside of the non-viable spores. Indoor Science conducted a lateral flow immunoassay specific to *Stachybotrys* proteins, manufactured by Alexeter Technologies.

### Results

Three test runs were conducted and the mean concentrations are reported in the summary table below:

MS2 Virus, measured in plaque-forming units (PFU)

	0 time	5 min	15 min	30 min	60 min
UV Light On	216	0	0	0	0
UV Light Off	216	170	91	63	50

Stachybotrys, measured in colony-forming units (CFU)

	0 time	5 min	15 min	30 min	60 min
UV Light On	180	4	1	0	0
UV Light Off	180	130	130	85	45

The UV light demonstrated that at 30 minutes it killed 100% of the virus and mold test organisms. The full surface kill rate laboratory results are included in Appendix C.

The lateral flow assay showed that Stachybotrys proteins were not still present on the filter surface. The results of the assay collected on 10 different locations of the filter all resulted in a negative result, as pictured below.



## Conclusions and Recommendations

---

Indoor Science determined that the clean air delivery rate (CADR) for the the Rensair Model Q01B was 314.7, 320.0, and 316.2 for tobacco smoke, dust, and pollen respectively. Indoor Science recommends a minimum CADR of 300 cfm for classrooms and other similarly-sized areas to mitigate COVID risks.

Indoor Science confirmed that the Rensair Model Q01B meets the criteria to be considered a high efficiency particulate air (HEPA) filter. Both the filter media and the full unit met the HEPA standard, which requires a minimum of 99.97% efficiency at removing particles at 0.3  $\mu\text{m}$  in aerodynamic diameter. The minimum efficiency for the filter media and full unit were 99.989% and 99.974% respectively.

Indoor Science tested the ability of the Rensair's UV light to deactivate microorganisms on the filter surface. At 30 minutes of UV exposure, all test viruses and mold spores were deactivated. Furthermore, a test did not detect any Stachybotrys proteins on the filter surface following 60 minutes of UV light irradiation.

## Limitations

---

Indoor Science used all reasonable care to diligently assess the potential for hazardous conditions at the subject project site related to the scope of work. However, the absence of a hazardous condition being found in this assessment does not constitute a guarantee from Indoor Science that no other hazardous conditions are present, nor does the identification of hazardous conditions imply that all potentially hazardous conditions have been identified.

Indoor Science conducted this assessment following industry best practices and performed assessment protocols that are consistent with those exercised by other reputable consultants, based on current industry standards of practice for projects of similar scope and scale. No warranty, representation, or guarantee, express or implied, is included or intended in this assessment report.

As with all environmental consulting services, this assessment was limited to the defined scope and does not purport to set forth all hazards, nor indicate that other hazards do not exist.

Respectfully submitted by:



Ian Cull  
Founder and Chief Science Officer  
Indoor Science  
lcull@indoorscience.com

Enclosed:

- Floor Plan
- Laboratory Analytical Reports



## **Appendix A: CADR Laboratory Results**

---

# Clean Air Delivery Rate REPORT



## LMS TECHNOLOGIES, INC.

6423 Cecilia Circle  
Bloomington, MN 55439 USA

Tel: 952-918-9060  
Fax: 952-918-9061

Date: September 11, 2022  
Test Requested By: Indoor Science  
Test Type: CADR (Clean Air Delivery Rate)

### Scope

Indoor Science provided an air purifier (Rensair, Model Q01B) for Clean Air Delivery Rate (CADR) test for dust, smoke, and pollen as challenge aerosols. Testing was performed in a large (1007 ft<sup>3</sup>) stainless-steel chamber.

### Method

Chamber test was carried out once with and once without the unit. Smoke, Dust and Pollen were fed into chamber and the reduction was measured by particle counters for one hour for both scenarios.

### Air Cleaner Information

Manufacturer:

**Rensair**

Product Name:

**Model Q01B**



Figure 1 Rensair Q01B

### Test Conditions

Environmental Conditions: 72 °F and 50% RH

### Equipment

1007 ft<sup>3</sup> Stainless-Steel Test Chamber

TSI Model 3330 particle counter

TSI SMPS



Figure 2. Test chamber

## CADR Smoke

### INFORMATION FOR REPORT

These results are plotted in Figure 1. Particle decay follow the exponential decay function:

$$C_{t_i} = C_i e^{-kt_i} \quad (\text{Equation 2})$$


where  $C_{t_i}$  is the PFU at time  $t_i$ ,  $C_i$  is the PFU at time = 0 minutes,  $k$  is the decay rate constant, and  $t_i$  is the time. The decay rate constant is then found from the slope of the  $\ln[C_{t_i}/C_i]$  vs.  $t_i$  curve:

$$\ln \frac{C_{t_i}}{C_i} = -kt_i + b \quad (\text{Equation 3})$$

The following formula, modeled on the AHAM test CADR, was used to determine the  $CADR_{smoke}$  of the device with a test chamber volume ( $V$ ) of 944.6 ft<sup>3</sup>:

$$CADR_{smoke} = V(k_{device} - k_{natural\_decay}) \quad (\text{Equation 4})$$

P-36: **EXAMPLE CALCULATION FOR EACH DEVICE IN REPORT**

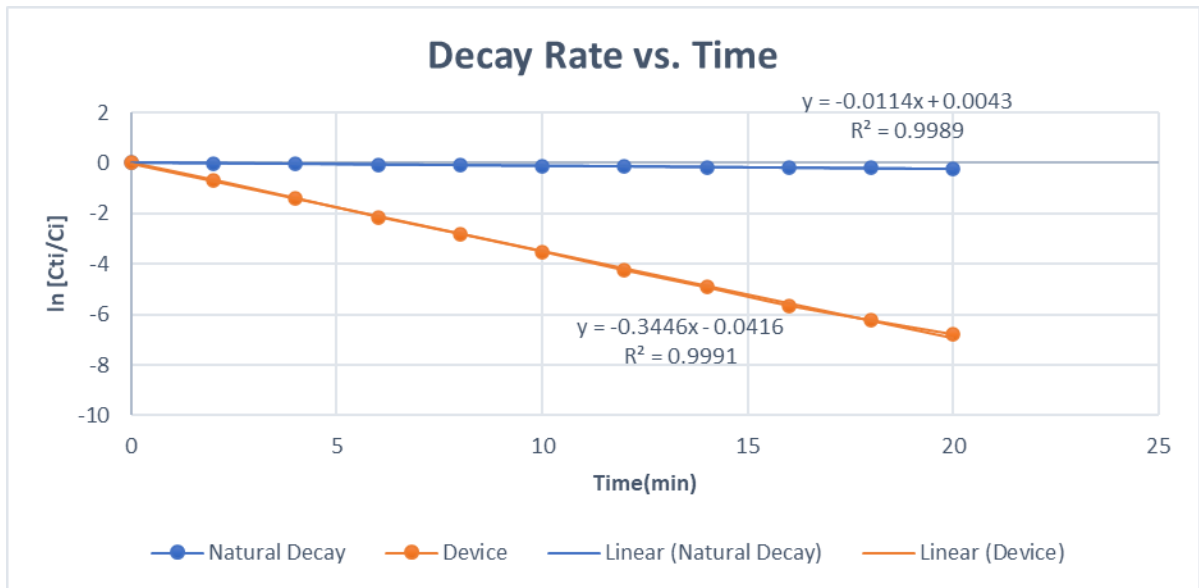

k_device	k_natural decay
<b>0.3446</b>	<b>0.0114</b>
<b>CADR=</b>	<b>314.7</b>

## CADR Dust

### INFORMATION FOR REPORT

These results are plotted in Figure 1. Particle decay follow the exponential decay function:

$$C_{t_i} = C_i e^{-kt_i} \quad (\text{Equation 2})$$


where  $C_{t_i}$  is the PFU at time  $t_i$ ,  $C_i$  is the PFU at time = 0 minutes,  $k$  is the decay rate constant, and  $t_i$  is the time. The decay rate constant is then found from the slope of the  $\ln[C_{t_i}/C_i]$  vs.  $t_i$  curve:

$$\ln \frac{C_{t_i}}{C_i} = -kt_i + b \quad (\text{Equation 3})$$

The following formula, modeled on the AHAM test CADR, was used to determine the  $CADR_{dust}$  of the device with a test chamber volume ( $V$ ) of 944.6 ft<sup>3</sup>:

$$CADR_{dust} = V(k_{device} - k_{natural\_decay}) \quad (\text{Equation 4})$$

P-14: **EXAMPLE CALCULATION FOR EACH DEVICE IN REPORT**

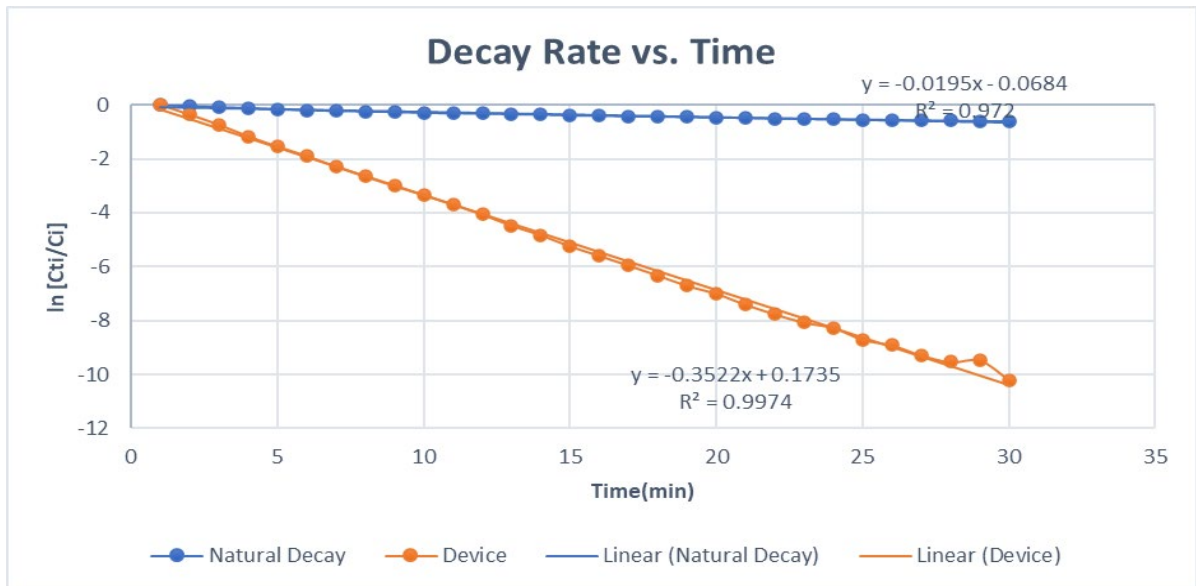

k_device	k_natural decay
0.35822	0.0195
<b>CAR=</b>	<b>320.0</b>

## CADR Pollen

### INFORMATION FOR REPORT

These results are plotted in Figure 1. Particle decay follow the exponential decay function:

$$C_{t_i} = C_i e^{-kt_i} \quad (\text{Equation 2})$$


where  $C_{t_i}$  is the PFU at time  $t_i$ ,  $C_i$  is the PFU at time = 0 minutes,  $k$  is the decay rate constant, and  $t_i$  is the time. The decay rate constant is then found from the slope of the  $\ln[C_{t_i}/C_i]$  vs.  $t_i$  curve:

$$\ln \frac{C_{t_i}}{C_i} = -kt_i + b \quad (\text{Equation 3})$$

The following formula, modeled on the AHAM test CADR, was used to determine the  $CADR_{\text{pollen}}$  of the device with a test chamber volume ( $V$ ) of 944.6 ft<sup>3</sup>:

$$CADR_{\text{pollen}} = V(k_{\text{device}} - k_{\text{natural\_decay}}) \quad (\text{Equation 4})$$

P-14: **EXAMPLE CALCULATION FOR EACH DEVICE IN REPORT**

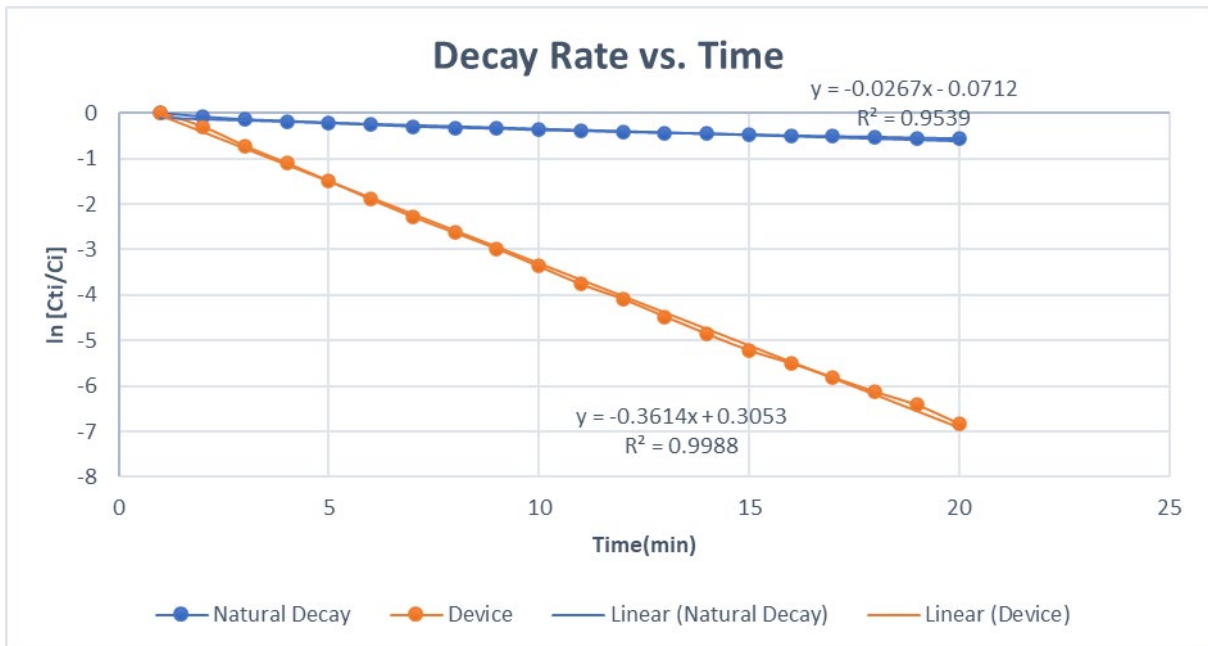

k_device	k_natural decay
0.3614	0.0267
<b>CADR=</b>	<b>316.2</b>

September 28, 2022

LMS#7992

## **Flow Rate Test Report** **LMS Technologies, Inc.**

6423 Cecilia Circle  
Bloomington, MN 55439

Tel.: (952) 918-9060

Fax: (952) 918-9061

**Test Type:** Flow Rate Measurement

**Requested By:** Indoor Science

**Unit Model:** Q01B


**Manufacturer:** Rensair

**Description:** Air Purifier Unit

**Temp and Humidity:** 70° F and 35%



Device Setting	Airflow Rate (cfm)
Low	185.7
Med	286.5
High	346.6

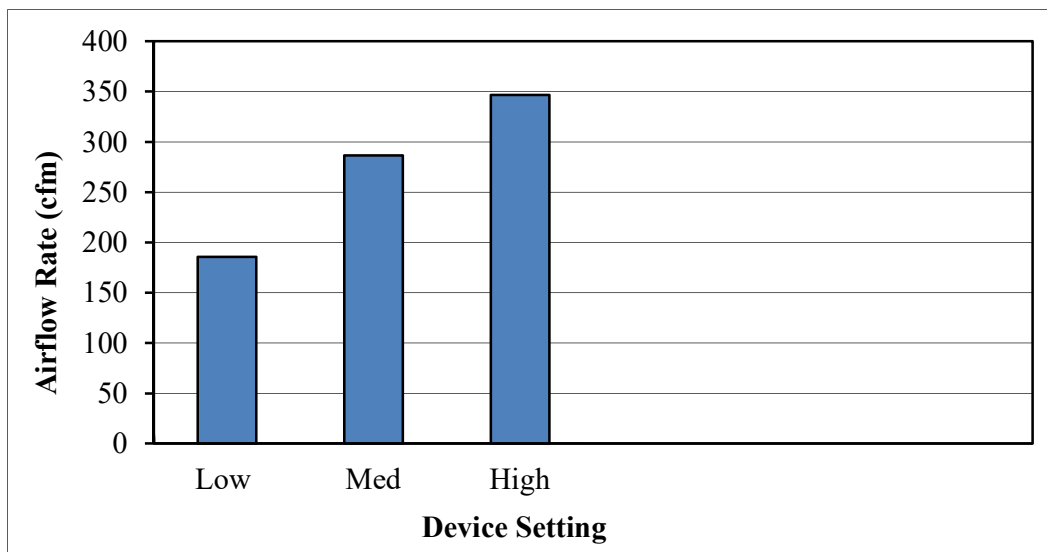

Test Supervisor  
Emile Tadros

Engineering Approval  
K.C. Kwok, PH. D.

**Appendix B: HEPA Laboratory Results**

---



# IEST-RP-CC001.6 TEST REPORT

## LMS Technologies, Inc.

6423 Cecilia Circle  
Bloomington, MN 55439



Tel.: (952) 918-9060  
Fax: (952) 918-9061

<b>Test Type :</b>	IEST-RP-CC001.6	<b>Test Requested by:</b>	Indoor Science
<b>Test Number:</b>	T092822A	<b>Filter Manufacturer:</b>	Rensair
<b>Flow Rate/Velocity:</b>	346.6 cfm	<b>Filter ID:</b>	HEPA Filter
<b>Test Aerosol:</b>	Latex beads, Neutralized	<b>Description:</b>	Small Cylindrical Filter
<b>Temp and Humidity: 70°F and 35%</b>			

Flow Rate (cfm)	DP "H <sub>2</sub> O	Size Range (μm)	Initial Fractional Efficiency (%)
346.6	0.720	0.1-0.2	99.989
		0.2-0.3	99.991
		0.3-0.5	99.997
		0.5-0.7	100.000
		0.7-1.0	100.000
		1.0-2.0	100.000
		2.0-3.0	100.000
		3.0-5.0	100.000



Data verified by LMS Calibration Filter\* Patent Pending

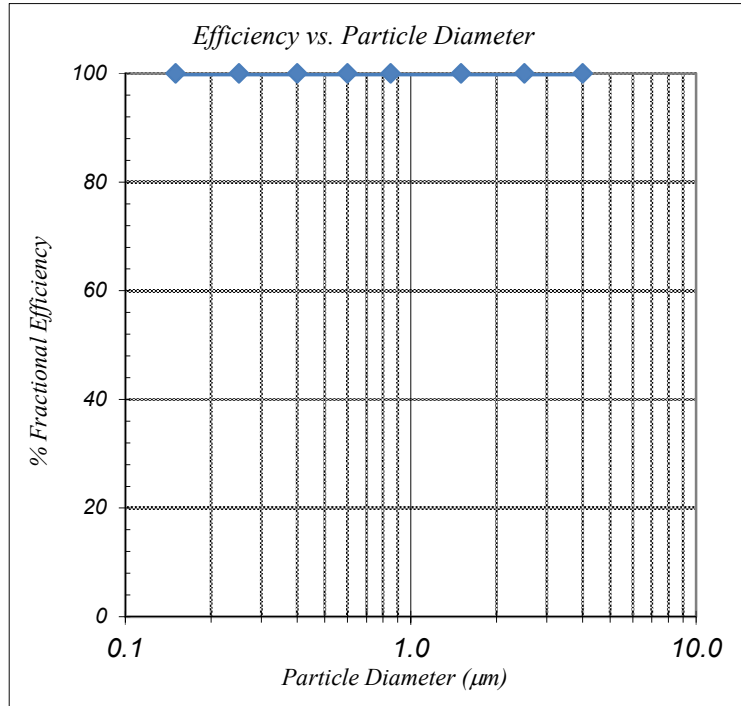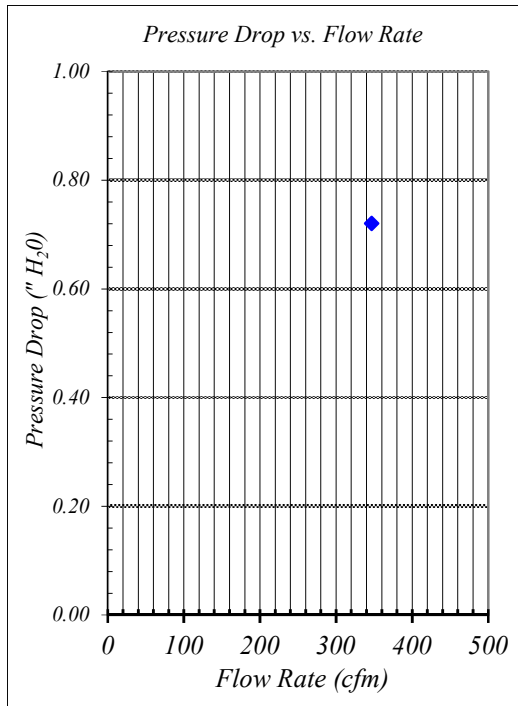

# IEST-RP-CC001.6 TEST REPORT

## LMS Technologies, Inc.

6423 Cecilia Circle  
Bloomington, MN 55439



Tel.: (952) 918-9060  
Fax: (952) 918-9061

<b>Test Type :</b>	IEST-RP-CC001.6	<b>Test Requested by:</b>	Indoor Science
<b>Test Number:</b>	T092822B	<b>Filter Manufacturer:</b>	Rensair
<b>Flow Rate/Velocity:</b>	In-Situ	<b>Filter ID:</b>	Whole unit
<b>Test Aerosol:</b>	Latex beads, Neutralized	<b>Description:</b>	with Small Cylindrical Filter
<b>Temp and Humidity: 70°F and 35%</b>			

Flow Rate (cfm)	DP "H <sub>2</sub> O	Size Range (μm)	Initial Fractional Efficiency(%)
346.6	0.000	0.1-0.2	99.974
		0.2-0.3	99.976
		0.3-0.5	99.983
		0.5-0.7	99.988
		0.7-1.0	99.992
		1.0-2.0	99.995
		2.0-3.0	99.999
		3.0-5.0	100.000



Data verified by LMS Calibration Filter\* Patent Pending

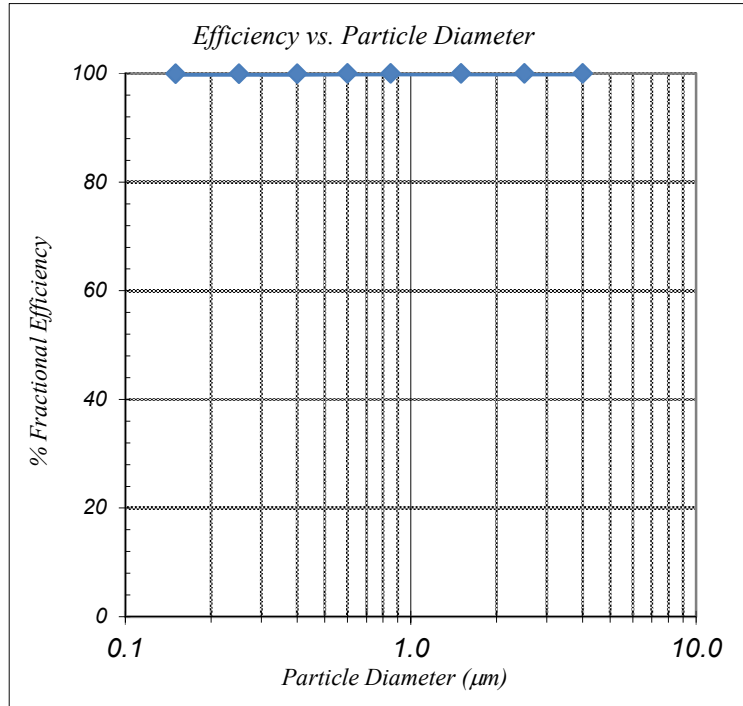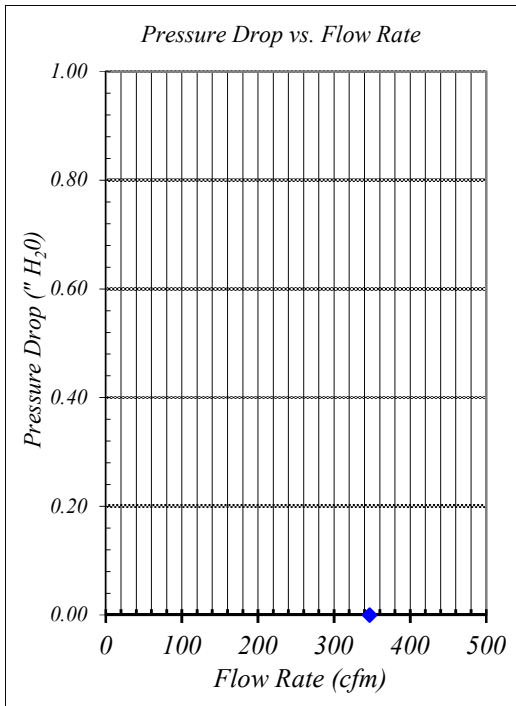

**Appendix C: UV Kill Rate Laboratory Results**

---

# MICROBIOLOGY REPORT



## LMS TECHNOLOGIES, INC.

6423 Cecilia Circle  
Bloomington, MN 55439 USA

Tel: 952-918-9060  
Fax: 952-918-9061

Date: October 3, 2022  
Test Type: Surface Efficacy  
Test Requested by: Indoor Science  
LMS#7992

**Scope:** Test Rensair Q01B air cleaner provided by customer for surface testing with MS-2 bacteriophage (ATCC 15597-B1) and *Stachybotrys Chartarum* (ATCC 9182) as the challenge organisms.

### **Method:**


Organisms were grown on appropriate media, harvested, and placed on clean media test strips. The strips were attached to the inside of the air cleaner's heap filter. Samples were taken at 0 time. The UV was activated, and the highest speed fan was used. The remaining test strips were timed for 5, 15, 30, and 60 minutes of exposure. Rinsates of the test strips were prepared and an aliquot was placed on agar media. Plates were incubated and counted.

The collection plates were incubated for 24-48 hours. After incubation, the recovered organisms were enumerated. The efficiency was calculated using the formula:

$$Efficiency = 1 - \left( \frac{FilterPFU_{time=5min}}{FilterPminFU_{time=0}} * \frac{Control PFU_{time=0}}{Control PFU_{time 5 min}} \right)$$

Microbiologists:  
John Cherne  
Autumn Stivers-Biscuso  
KoKoe Noutepe

Testing Approval  
Al Vatine, CEO

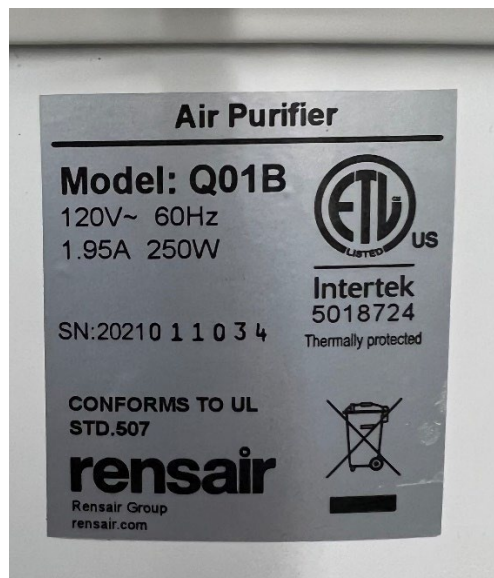

Microbiologists:  
John Cherne  
Autumn Stivers-Biscuso  
KoKoe Noutepe

Testing Approval  
Al Vatine, CEO

Data 1: MS-2

		MS-2 Pfu				
		0 time	5 minutes	15 minutes	30 minutes	60 minutes
Light on	Mean of 3	216	0	0	0	0
Light off	Mean of 3	216	170	91	63	50

Efficiency  $\geq 99.4\%$

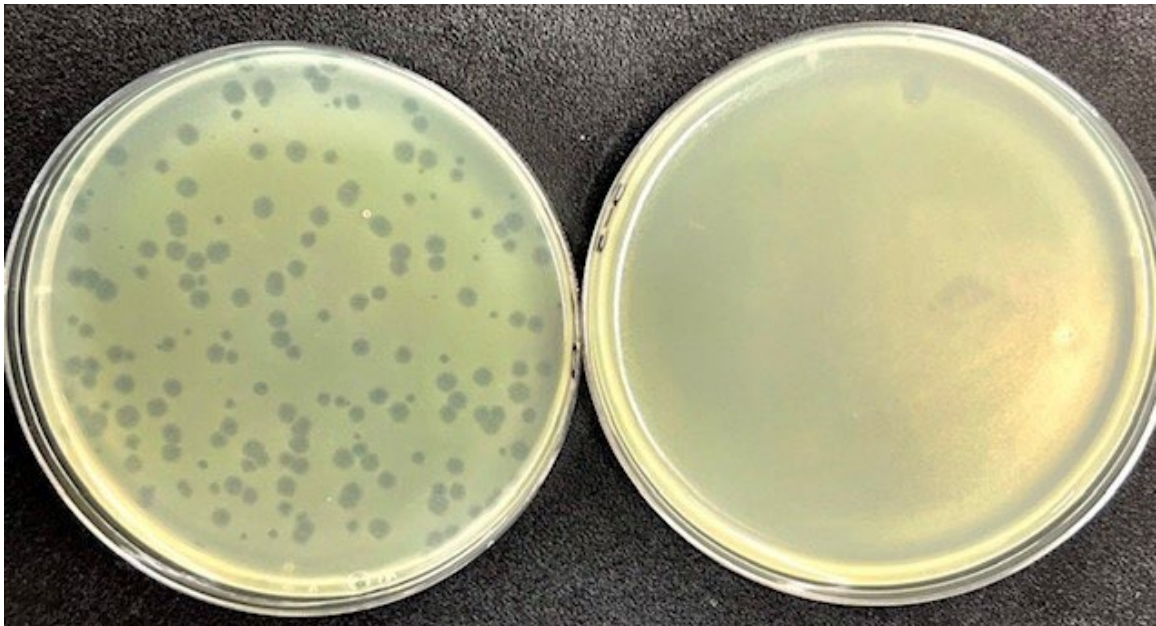


Figure 1: MS-2 Pfu at 0 min and 5 min

Data 2: Stachybotrys Chartarum

		Stachybotrys Chartarum				
		0 min	5 min	15 min	30 min	60 min
Light on	Mean of 3 runs	180	4	1	0	0
Light off	Mean of 3 runs	180	130	130	85	45
	Efficiency		96.92%	99.23%	100%	100%

Microbiologists:  
 John Cherne  
 Autumn Stivers-Biscuso  
 KoKoe Noutepe

Testing Approval  
 Al Vatine, CEO