



TOP SEAM DETAIL

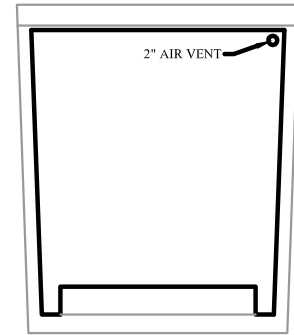

BAFFLE VIEW

NOTES:


1. ROANOKE COUNTY BAFFLE REQUIRMENTS SHOWN IN ABOVE DRAWING.
2. BAFFLES VARY IN ACCORDANCE TO LOCALITIES.

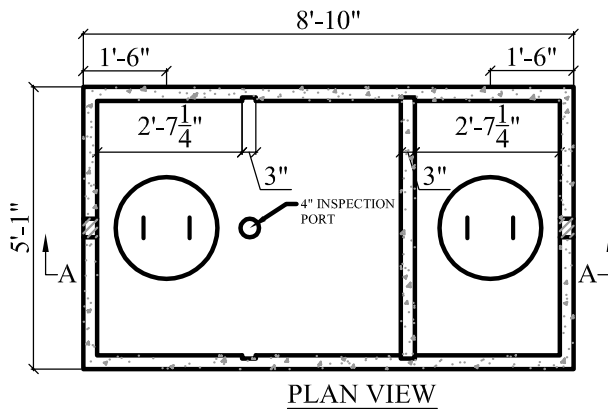

PLAN VIEW

NOTES:


1. CONCRETE STRENGTH = MIN. 4500 PSI
2. #3 REBAR(BOTTOM) #4 REBAR(LID) 1' ON CENTER
3. "POLYLOK" PIPE SEALS CAST IN TANK
4. MASTIC SEALANT IN TANK JOINT
5. TANKS CAN BE MODIFIED UPON REQUEST
6. DROP IN BAFFLES MADE TO SPECIFICATIONS

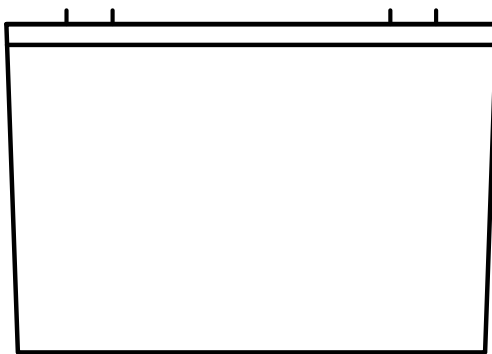

FRONT VIEW

APPROX. WEIGHT:

TOP = 3,000 lb  
 BOTTOM = 5,426 lb  
 TOTAL = 8,426 lb

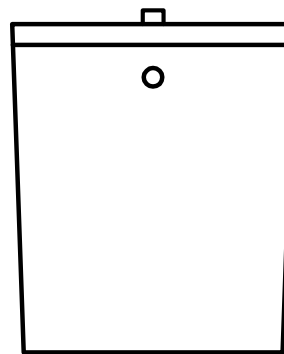

SIDE VIEW

GAL. PER IN = 23.8  
 ACTUAL GAL. TO OUTLET = 1,142  
 FULL CAPACITY = 1,428



CTJAMISON.COM  
 PH: 540-483-5944

1,000 Gal. TS OWS 2 COMP.

OIL/WATER SEPARATOR

Scale  
 Not To Scale

Date  
 Feb 2016