



TOP SEAM DETAIL

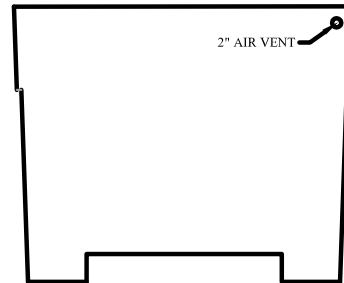

SIDE VIEW OF  
DROP IN BAFFLE

NOTES:  
ROANOKE COUNTY REQUIRED SHOWN IN  
ABOVE DRAWING.

BAFFLES MAY VARY ACCORDING TO  
LOCALITIES.

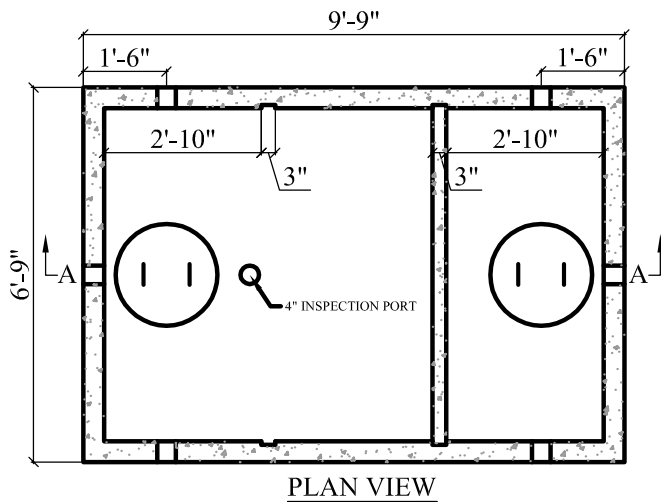


PLAN VIEW

NOTES:  
1. CONCRETE STRENGTH = MIN. 4500 PSI  
2. #4 REBAR ON 1' CENTER  
3. "POLYLOK" PIPE SEALS CAST IN TANK  
4. MASTIC SEALANT IN TANK JOINT  
5. TANKS CAN BE MODIFIED UPON  
REQUEST  
6. DROP IN BAFFLES MADE TO  
SPECIFICATIONS



FRONT VIEW

APPROX. WEIGHT:  
TOP = 3,745 lb  
BOTTOM = 11,235 lb  
TOTAL = 14,980 lb

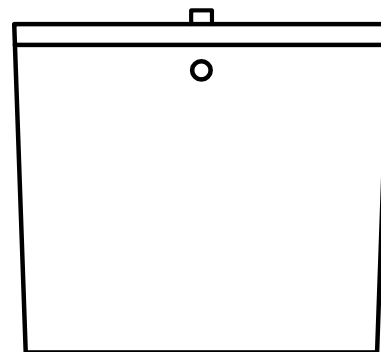

SIDE VIEW

GAL. PER IN = 33.5  
ACTUAL GAL. TO OUTLET = 1,642  
FULL CAPACITY = 2,043



CTJAMISON.COM  
PH: 540-483-5944

1,500 Gal. TS OWS 2 COMP

OIL/WATER SEPARATOR

Scale  
Not To Scale

Date  
Feb 2016