


TOP SEAM DETAIL

INLET END
 GAL. PER IN = 23.8
 ACTUAL GAL. TO OUTLET = 1,142


OUTLET END
 GAL. PER IN = 10.35
 ACTUAL GAL. TO OUTLET = 507

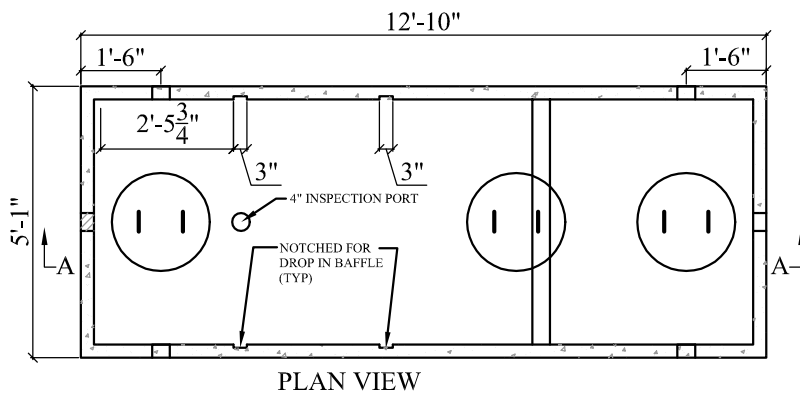


PLAN VIEW

NOTES:

1. CONCRETE STRENGTH = MIN. 4500 PSI
2. #3 REBAR(BOTTOM) #4 REBAR(LID) 1' ON CENTER
3. "POLYLOK" PIPE SEALS CAST IN TANK
4. MASTIC SEALANT IN TANK JOINT
5. TANKS CAN BE MODIFIED UPON REQUEST
6. DROP IN BAFFLES MADE TO SPECIFICATIONS
7. 1" OF FALL FROM INLET TO BAFFLE, 1" OF FALL FROM BAFFLE TO OUTLET

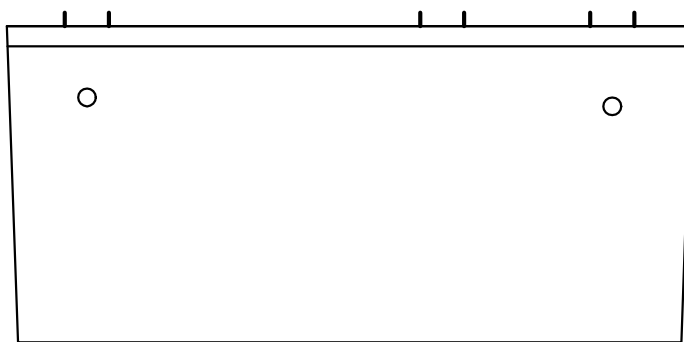

FRONT VIEW

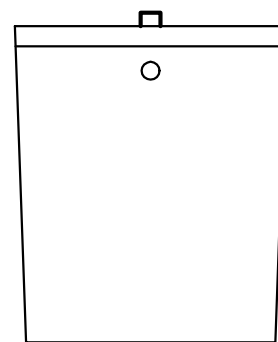

SIDE VIEW

APPROX. WEIGHT:

TOP = 4,000 lb
 BOTTOM = 7,240 lb
 TOTAL = 11,240 lb

CT JAMISON SEPTIC

CALLAWAY, VIRGINIA

PH: 540-483-5944

1,500 Gal. Top Seam Reduced Maintenance Tank

Date
 Dec. 12, 2018

Scale
 Not To Scale

Sheet