

***FOR PUBLIC RELEASE***

# **Source Water Protection Plan Charles Town Utilities**

PWSID: WV3301905

Jefferson County

October 2021

Prepared By:

Jane Arnett  
Utility Manager

In cooperation with Charles Town Utilities

WV Bureau for Public Health, Source Water Assessment and Protection Program

This page is intentionally blank.

Jane Arnett

---

Preparer's Name

Utility Manager

---

Title of Preparer

---

Name of Contractor(s)/Consultant(s)

I Certify the information in the source water protection plan is complete and accurate to the best of my knowledge.

Responsible party of designee authorized to sign for water utility is on file:

Peter Kubic

---

Name of Authorizing Signatory:

Vice Chairman, Charles Town Utility Board

---

Title of Authorizing Signatory:

7/7/2021

---

Date of Submission (mm/dd/yyyy):

This page is intentionally blank.

# TABLE OF CONTENTS

---

|  |           |
|--|-----------|
| <b>1.0 Purpose</b>   | <b>1</b>  |
| 1.1. What are the benefits of preparing a Source Water Protection Plan?  | 1         |
| <b>2.0 Background: WV Source Water Assessment and Protection Program</b> | <b>2</b>  |
| <b>3.0 State Regulatory Requirements</b>                                 | <b>3</b>  |
| <b>4.0 System Information</b>  | <b>4</b>  |
| <b>5.0 Water Treatment and Storage</b>                                   | <b>5</b>  |
| <b>6.0 Delineations</b>  | <b>7</b>  |
| <b>7.0 Protection Team</b>   | <b>9</b>  |
| <b>8.0 Potential Sources of Significant Contamination</b>                | <b>12</b> |
| 8.1. Confidentiality of PSSCs  | 12        |
| 8.2. Local and Regional PSSCs  | 12        |
| 8.3. Prioritization of Threats and Management Strategies                 | 15        |
| <b>9.0 Implementation Plan for Management Strategies</b>                 | <b>16</b> |
| <b>10.0 Education and Outreach Strategies</b>                            | <b>21</b> |
| <b>11.0 Contingency Plan</b>   | <b>25</b> |
| 11.1. Response Networks and Communication                                | 25        |
| 11.2. Operation During Loss of Power                                     | 26        |
| 11.3. Future Water Supply Needs  | 27        |
| 11.4. Water Loss Calculation   | 28        |
| 11.5. Early Warning Monitoring System                                    | 29        |
| <b>12.0 Single Source Feasibility Study</b>                              | <b>31</b> |
| <b>13.0 Communication Plan</b>   | <b>32</b> |
| <b>14.0 Emergency Response</b>   | <b>33</b> |
| <b>15.0 Conclusion</b>   | <b>34</b> |

## LIST OF TABLES

---

|  |    |
|--|----|
| Table 1. Population Served by CHARLES TOWN UTILITIES                       | 4  |
| Table 2. Charles Town Utilities Water Treatment Information                | 5  |
| Table 3. Charles Town Utilities Surface Water Sources                      | 6  |
| Table 4. Charles Town Utilities Ground Water Sources                       | 6  |
| Table 5. Watershed Delineation Information                                 | 8  |
| Table 6. Protection Team Member and Contact Information                    | 10 |
| Table 7. Locally Identified potential Sources of Significant Contamination | 14 |
| Table 8. Priority PSSCs or Critical Areas                                  | 17 |
| Table 9. Priority PSSC Management Strategies                               | 17 |
| Table 10. Education and Outreach Implementation Plan                       | 22 |
| Table 11. Charles Town Utilities Water Shortage Response Capacity          | 26 |
| Table 12. Generator Capacity   | 26 |
| Table 13. Future Water Supply Needs for Charles Town Utilities             | 28 |
| Table 14. Water Loss Information   | 28 |
| Table 15. Early Warning Monitoring System Capabilities                     | 29 |

## APPENDICES

---

|   |
|---|
| Appendix A. Figures and Tables                    |
| Appendix B. Early Warning Monitoring System Forms |
| Appendix C. Communication Plan Template           |
| Appendix D. Single Source Feasibility             |
| Appendix E. Supporting Documentation              |

## SOURCE WATER PROGRAM ACRONYMS

---

|         |  |
|---------|--|
| AST     | Aboveground Storage Tank   |
| BMP     | Best Management Practices  |
| ERP     | Emergency Response Plan  |
| GWUDI   | Ground Water Under the Direct Influence of Surface Water                       |
| LEPC    | Local Emergency Planning Committee   |
| OEHS    | EED Office of Environmental Health Services/Environmental Engineering Division |
| PE      | Professional Engineer  |
| PSSCs   | Potential Source of Significant Contamination                                  |
| PWSU    | Public Water System Utility  |
| RAIN    | River Alert Information Network  |
| RPDC    | Regional Planning and Development Council                                      |
| SDWA    | Safe Drinking Water Act  |
| SWAP    | Source Water Assessment and Protection   |
| SWAPP   | Source Water Assessment and Protection Program                                 |
| SWP     | Source Water Protection  |
| SWPA    | Source Water Protection Area   |
| SWPP    | Source Water Protection Plan   |
| WARN    | Water/Wastewater Agency Response Network                                       |
| WHPA    | Wellhead Protection Area   |
| WHPP    | Wellhead Protection Program  |
| WSDA    | Watershed Delineation Area   |
| WVBPH   | West Virginia Bureau for Public Health   |
| WVDEP   | West Virginia Department of Environmental Protection                           |
| WVDHHR  | West Virginia Department of Health and Human Resources                         |
| WVDHSEM | West Virginia Division of Homeland Security and Emergency Management           |
| ZCC     | Zone of Critical Concern   |
| ZPC     | Zone of Peripheral Concern   |

## 1.0 PURPOSE

The goal of the West Virginia Bureau of Public Health (WVBPH) source water assessment and protection (SWAP) program is to prevent degradation of source waters which may preclude present and future uses of drinking water supplies to provide safe water in sufficient quantity to users. The most efficient way to accomplish this goal is to encourage and oversee source water protection on a local level. Many aspects of source water protection may be best addressed by engaging local stakeholders.

The intent of this document is to describe what Charles Town Utilities has done, is currently doing, and plans to do to protect its source of drinking water. Although this water system treats the water to meet federal and state drinking water standards, conventional treatment does not fully eradicate all potential contaminants and treatment that goes beyond conventional methods is often very expensive. By completing this plan, Charles Town Utilities acknowledges that implementing measures to minimize and mitigate contamination can be a relatively economical way to help ensure the safety of the drinking water.

### 1.1. WHAT ARE THE BENEFITS OF PREPARING A SOURCE WATER PROTECTION PLAN?

- Fulfilling the requirement for the public water utilities to complete or update their source water protection plan.
- Identifying and prioritizing potential threats to the source of drinking water; and establishing strategies to minimize the threats.
- Planning for emergency response to incidents that compromise the water supply by contamination or depletion, including how the public, state, and local agencies will be informed.
- Planning for future expansion and development, including establishing secondary sources of water.
- Ensuring conditions to provide the safest and highest quality drinking water to customers at the lowest possible cost.
- Providing more opportunities for funding to improve infrastructure, purchase land in the protection area, and other improvements to the intake or source water protection areas.



## 2.0 BACKGROUND: WV SOURCE WATER ASSESSMENT AND PROTECTION PROGRAM

Since 1974, the federal Safe Drinking Water Act (SDWA) has set minimum standards on the construction, operation, and quality of water provided by public water systems. In 1986, Congress amended the SDWA. A portion of those amendments were designed to protect the source water contribution areas around ground water supply wells. This program eventually became known as the Wellhead Protection Program (WHPP). The purpose of the WHPP is to prevent pollution of the source water supplying the wells.

The Safe Drinking Water Act Amendments of 1996 expanded the concept of wellhead protection to include surface water sources under the umbrella term of Source Water Protection. The amendments encourage states to establish SWAP programs to protect all public drinking water supplies. As part of this initiative states must explain how protection areas for each public water system will be delineated, how potential contaminant sources will be inventoried, and how susceptibility ratings will be established.

In 1999, the WVBPH published the West Virginia Source Water Assessment and Protection Program, which was endorsed by the United States Environmental Protection Agency. Over the next few years, WVBPH staff completed an assessment (i.e., delineation, inventory and susceptibility analysis) for all of West Virginia's public water systems. Each public water system was sent a copy of its assessment report. Information regarding assessment reports for Charles Town Utilities can be found in **Table 1**.

## 3.0 STATE REGULATORY REQUIREMENTS

On June 6, 2014, §16 1 2 and §16 1 9a of the Code of West Virginia, 1931, was reenacted and amended by adding three new sections, designated §16 1 9c, §16 1 9d and §16-1-9e. The changes to the code outlines specific requirements for public water utilities that draw water from a surface water source or a surface water influenced groundwater source.

Under the amended and new codes each existing public water utility using surface water or ground water influenced by surface water as a source must have completed or updated a source water protection plan by July 1, 2016, and must continue to update their plan every three years. Existing source water protection plans have been developed for many public water utilities in the past. If available, these plans were reviewed and considered in the development of this updated plan. Any new water system established after July 1, 2016 must submit a source water protection plan before they start to operate. A new plan is also required when there is a significant change in the potential sources of significant contamination (PSSC) within the zone of critical concern (ZCC).

The code also requires that public water utilities include details regarding PSSCs, protection measures, system capacities, contingency plans, and communication plans. Before a plan can be approved, the local health department and public will be invited to contribute information for consideration. In some instances, public water utilities may be asked to conduct independent studies of the source water protection area and specific threats to gain additional information.

## 4.0 SYSTEM INFORMATION

CHARLES TOWN UTILITIES is classified as a state regulated public utility and operates a community public water system. A community public water system is a system that regularly supplies drinking water from its own sources to at least 15 service connections used by year round residents of the area or regularly serves 25 or more people throughout the entire year. For purposes of this source water protection plan, community public water systems are also referred to as public water utilities. Information on the population served by this utility is presented in **Table 1** below.

**Table 1. Population Served by CHARLES TOWN UTILITIES**

|  |             |  |            |
|--|-------------|--|------------|
| Administrative office location:  |             | 661 S George Street, Suite 101, Charles Town, JEFFERSON, WV, 25414 |            |
| Is the system a public utility, according to the Public Service Commission rule? |             | Yes  |            |
| Date of Most Recent Source Water Assessment Report:                              |             | 7/1/2004   |            |
| Date of Most Recent Source Water Protection Plan:                                |             | 7/1/2019   |            |
| Population served directly:  |             | 14488  |            |
| Bulk Water Purchaser Systems:  | System Name | PWSID Number   | Population |
| Total Population Served by the Utility:  |             | 14488  |            |
| Does utility have multiple Source Water Protection Areas(SWPAs)?                 |             | No   |            |
| How many SWPAs does the utility have?  |             | 1  |            |

## 5.0 WATER TREATMENT AND STORAGE

As required, Charles Town Utilities has assessed their system (e.g., treatment capacity, storage capacity, unaccounted for water, contingency plans) to evaluate their ability to provide drinking water and protect public health. **Table 2** contains information on the water treatment methods and capacity of the utility. Information about the surface sources from which Charles Town Utilities draws water can be found in **Table 3**. If the utility draws water from any groundwater sources to blend with the surface water the information about these ground water sources can be found in **Table 4**.

**Table 2. Charles Town Utilities Water Treatment Information**

| Charles Town Utilities   |  |
|--|--|
| Water treatment processes (in order of occurrence) includes:                                     | COAGULATION, FILTRATION, DISINFECTION (CHLORINATION), FLUORIDATION |
| The treatment capacity is approximately (GPD):   | 3,000,000  |
| Current average production is approximately (GPD):   | 1,656,000  |
| Maximum gallons of water treated and produced at that plant in one day during the past year was: | 2,420,000  |
| Minimum gallons of water treated and produced at that plant in one day during the past year was: | 1,171,000  |
| Plant is operated an average of hours a day:   | 14   |
| Maximum number of hours of operation in one day at that plant during the past year was:          | 18   |
| Minimum number of hours of operation in one day at that plant during the past year was:          | 10   |
| How many storage tank(s) are maintained on systems distribution system:                          | 1  |
| Total gallons of treated water storage:  | 3,572,000  |
| Total gallons of raw water storage (GALs):   | 0  |

**Table 3. Charles Town Utilities Surface Water Sources**

| Intake Name             | Facility # | Local Name | Describe Intake   | State Id Code | Date Constructed / Modified | Frequency of Use (Primary / Backup / Emergency) | Activity Status (Active/Inactive) |
|-------------------------|------------|------------|---|---------------|-----------------------------|---|-----------------------------------|
| SHENANDOAH RIVER INTAKE | 3490888    | INTAKE #1  | Standard Johnson Screen - 24 inch (Stainless Steel).<br>T-Shaped Intake | IN001         | 1/1/1989                    | Permanent                                       | Active                            |

**Table 4. Charles Town Utilities Ground Water Sources**

| Well/Spring Name | Facility # | Local Name | Date Constructed / Modified | Completion Report Available (Yes/No) | Well Depth (ft) | Casting Depth (ft) | Grout (Yes/No) | Frequency of Use (Primary / Backup / Emergency) | Activity Status (Active/Inactive) |
|------------------|------------|------------|-----------------------------|--------------------------------------|-----------------|--------------------|----------------|---|-----------------------------------|
|------------------|------------|------------|-----------------------------|--------------------------------------|-----------------|--------------------|----------------|---|-----------------------------------|

## 6.0 DELINEATIONS

For surface water systems, delineation is the process used to identify and map the drainage basin that supplies water to a surface water intake. This area is generally referred to as the source water protection area (SWPA). All surface waters are susceptible to contamination because they are exposed at the surface and lack a protective barrier from contamination. Accidental spills, releases, sudden precipitation events that result in overland runoff, or storm sewer discharges can allow pollutants to readily enter the source water and potentially contaminate the drinking water at the intake. The SWPA for surface water is distinguished as a Watershed Delineation Area (WSDA) for planning purposes; and the Zone of Peripheral Concern (ZPC) and Zone of Critical Concern (ZCC) are defined for regulatory purposes.

The WSDA includes the entire watershed area upstream of the intake to the boundary of the State of West Virginia border, or a topographic boundary. The ZCC for a public surface water supply is a corridor along streams within the watershed that warrant more detailed scrutiny due to its proximity to the surface water intake and the intake's susceptibility to potential contaminants within that corridor. The ZCC is determined using a mathematical model that accounts for stream flows, gradient and area topography. The length of the ZCC is based on a five-hour time-of-travel of water in the streams to the water intake, plus an additional one-quarter mile below the water intake. The width of the zone of critical concern is 1,000 feet measured horizontally from each bank of the principal stream, and five hundred feet measured horizontally from each bank of the tributaries draining into the principal stream. Ohio River ZCC delineations are based on ORSANCO guidance and extend 25 miles above the intake. The Ohio River ZCC delineations include 1,320 feet (1/4 mile) measured from the bank of the main stem of the Ohio River and 500 feet on a tributary.

The ZPC for a public surface water supply source and for a public surface water influenced groundwater supply source is a corridor along streams within a watershed that warrants scrutiny due to its proximity to the surface water intake and the intake's susceptibility to potential contaminants within that corridor. The ZPC is determined using a mathematical model that accounts for stream flows, gradient and area topography. The length of the zone of peripheral concern is based on an additional five-hour time-of-travel of water in the streams beyond the perimeter of the zone of critical concern, which creates a protection zone of ten hours above the water intake. The width of the zone of peripheral concern is one thousand feet measured horizontally from each bank of the principal stream and five hundred feet measured horizontally from each bank of the tributaries draining into the principal stream.

For groundwater supplies there are two types of SWPA delineations: 1) wellhead delineations and 2) conjunctive delineations, which are developed for supplies identified as groundwater under the direct influence of surface water, or GWUDIs. A wellhead protection area is determined to be the area contributing to the recharge of the groundwater source (well or spring), within a five year time of travel. A conjunctive delineation combines a wellhead protection area for the hydrogeologic recharge and a connected surface area contributing to the wellhead.

Information and maps of the WSDA, ZCC, ZPC and Wellhead Protection Area for this public water supply were provided to the utility and are attached to this report. See **Appendix A. Figures**. Other information about the WSDA is shown in **Table 5**.

**Table 5. Watershed Delineation Information**

|   |                       |
|---|-----------------------|
| Intake Name   | Shenandoah River      |
| Size of WSDA (Square Miles)                                   | 3009                  |
| River Watershed Name (8-digit HUC)                            | Shenandoah - 02070007 |
| Size of Zone of Critical Concern (Acres)                      | 8691                  |
| Size of Zone of Peripheral Concern (Acres) (Include ZCC area) | 13807                 |
| Do you blend with ground water                                | No                    |
| Do you have an intake or well/spring missing from the list?   | No                    |

## 7.0 PROTECTION TEAM

One important step in preparing a source water protection plan is to organize a source water protection team who will help develop and implement the plan. The legislative rule requires that water utilities make every effort to inform and engage the public, local government, local emergency planners, the local health department and affected residents at all levels of the development of the protection plan. WVBPH recommends that the water utility invite representatives from these organizations to join the protection team, which will ensure that they are given an opportunity to contribute in all aspects of source water protection plan development. Public water utilities should document their efforts to engage representatives and provide an explanation if any local stakeholder is unable to participate. In addition, other local stakeholders may be invited to participate on the team or contribute information to be considered. These individuals may be emergency response personnel, local decision makers, business and industry representatives, land owners (of land in the protection area), and additional concerned citizens.

The administrative contact for Charles Town Utilities is responsible for assembling the protection team and ensuring that members are provided the opportunity to contribute to the development of the plan. The acting members of the Protection Team are listed in **Table 6**.

The role of the protection team members will be to contribute information to the development of the source water protection plan, review draft plans and make recommendations to ensure accuracy and completeness, and when possible contribute to implementation and maintenance of the protection plan. The protection team members are chosen as trusted representatives of the community served by the water utility and may be designated to access confidential data that contains details about the local PSSCs. The input of the protection team will be carefully considered by the water utility when making final decisions relative to the documentation and implementation of the source water protection plan.

Charles Town Utilities will be responsible for updating the source water protection plan and rely upon input from the protection team and the public to better inform their decisions. To find out how you can become involved as a participant or contributor, visit the utility website or call the utility phone number, which are provided in **Table 6**.



**Table 6. Protection Team Member and Contact Information**

| Name              | Representing  | Title                           | Phone Number  | Email                              |
|-------------------|---|---------------------------------|---------------|------------------------------------|
| Kristin Stolipher | Charles Town Utilities  | Utility Manager                 | (304)724-3280 | kstolipher@ctubwv.com              |
| Chris Hutzler     | Charles Town Utilities  | Chief Operator                  | (304)725-3761 | chutzler@ctubwv.com                |
| Bill Zaleski      | Charles Town Utilities  | Sanitarian Supervisor           | (304)728-8416 | bill.h.zaleski@wv.gov              |
|                   | Charles Town Utilities  |                                 |               |                                    |
| Dennis Pouget     | Charles Town Utilities  | Director                        | (304)728-3287 | dpouget@jcesa.org                  |
|                   | Charles Town Utilities  |                                 |               |                                    |
| Stephen Allen     | Jefferson County Office of Homeland Security and Emergency Services | Director                        | (304)728-3329 | sallen@jeffersoncountywv.org       |
| Ed Hannon         | Jefferson County Emergency Services Agency                          | Deputy Director                 | (304)728-3287 | ehannon@jcesa.org                  |
| John Mills        | LEPC  | President                       |               | lepc@jeffersoncountywv.org         |
| Jeff Polczynski   | Jefferson County Emergency Communications Center                    | Director                        | (304)728-3317 | jpoczynski@jeffersoncountywv.org   |
| Chris Cross       | Jefferson County Emergency Communications Center                    | Deputy Director                 | (304)728-3372 | ccross@jeffersoncountywv.org       |
| Todd Fagan        | Jefferson County GIS Department                                     | GIS Technician                  |               | tfagan@jeffersoncountywv.org       |
| Mason Carter      | Jefferson County Floodplain Ordinance Coordinator                   | Floodplain Coordinator          |               | mcarter@jeffersoncountywv.org      |
| Chief             | Citizens Fire Department  | Chief                           | (304)725-2814 |                                    |
| Chief             | Independent Fire Department   | Chief                           | (304)725-2514 | ifc@independantfirecompa.ny.n<br>e |
| Alana Hartman     | WVDEP Div of Water & Waste Management (Nonpoint Section)            | Environmental Resources Analyst | (304)822-7266 | alana.c.hartman@wv.gov             |
| Alan Marchun      | WVDHHR Kearneysville District Office                                | Representative                  | (304)725-9453 | alan.f.marchun@wv.gov              |

|  |   |   |               |                       |
|--|---|---|---------------|-----------------------|
| John Cole  | RK&K Engineers  | Consultant for Charles Town Utilities   | (304)788-3370 | jcole@rkk.com         |
| Lew Baker  | WV Rural Water Association                                | FSA Sourcewater Specialist  | (304)638-9883 | lew baker@wvrwa.org   |
| Jennifer O'Brien   | Eastern Panhandle Regional Planning & Development Council | Assistant Director  | (304)263-1743 | jobrien@region9wv.com |
| Tanner Haid  | WV Rivers Coalition                                       | Representative  | (304)886-2665 | thaid@wvrivers.org    |
| Karen Andersen   | Friends of the Shenandoah                                 | Representative  |               | kandersen@fors.org    |
| Karen Bencala  | ICPRB   | Senior Water Resources Planner  | (301)984-1908 | kbencala@icprb.org    |
| Date of First Protection Team Meeting:   |   | Protection Team Meeting was held Thursday, May 12, 2016 at Charles Town Utilities. Meeting minutes attached in Appendix E.  |               |                       |
| Efforts made to inform and engage local stakeholders (public, local government, local emergency planners, local health department, and affected residents) and explain absence of recommended stakeholders |   | Email invitations to attend Protection Team Meeting were sent on May 2 and May 9, follow p phone calls were also placed on May 9. The meeting minutes and attendance sheet are in Appendix E. |               |                       |

## 8.0 POTENTIAL SOURCES OF SIGNIFICANT CONTAMINATION

Source water protection plans should provide a complete and comprehensive list of the PSSCs contained within the ZCC, based upon information obtained from the WVBPH, working in cooperation with the West Virginia Department of Environmental Protection (WVDEP) and the West Virginia Division of Homeland Security and Emergency Management (WVDHSEM). A facility or activity is listed as a PSSC if it has the potential to release a contaminant that could potentially impact a nearby public water supply, and it does not necessarily indicate that any release has occurred.

The list of PSSCs located in the SWPA is organized into two types: 1) SWAP PSSCs, and 2) Regulated Data. SWAP PSSCs are those that have been collected and verified by the WVBPH SWAP program during previous field investigations to form source water assessment reports and source water protection plans. Regulated PSSCs are derived from federal and state regulated databases, and may include data from WVDEP, US Environmental Protection Agency, WVDHSEM, and from state data sources.

### 8.1. CONFIDENTIALITY OF PSSCS

A list of the PSSCs contained within the ZCC should be included in the source water protection plan. In the event of a chemical spill, release or other related emergency, information pertaining to the contaminant shall be immediately disseminated to any emergency responders reporting to the site. The designees for Charles Town Utilities are identified in the communication planning section of the source water protection plan.

PSSC data from some agencies (ex. WVDHSEM, WVDEP, etc.) may be restricted due to the sensitive nature of the data. Locational data will be provided to the public water utility. However, to obtain specific details regarding contaminants, (such as information included in Tier II reports), water utilities should contact the local emergency planning commission (LEPC) or agencies, directly. While the maps and lists of the PSSCs and regulated sites are to be maintained in a confidential manner, these data are provided in **Appendix A. Figures** for internal review and planning uses only.

### 8.2. LOCAL AND REGIONAL PSSCS

For the purposes of this source water protection plan, local PSSCs are those that are identified by local stakeholders in addition to the PSSCs lists distributed by the WVBPH and other agencies. Local stakeholders may identify local PSSCs for two main reasons. The first is that it is possible that threats exist from unregulated sources and land uses that have not already been inventoried and do not appear in regulated databases. For this reason each public water utility should investigate their protection area for local PSSCs. A PSSC inventory should identify all contaminant sources and land uses in the delineated ZCC. The second reason local PSSCs are identified is because public water utilities may consider expanding the PSSC inventory effort outside of the ZCC into the ZPC and WSDA if necessary to properly identify all threats that could impact the drinking water source. As the utility considers threats in the watershed they may consider collaborating with upstream communities to identify and manage regional PSSCs.

When conducting local and regional PSSC inventories, utilities should consider that some sources may be obvious like above ground storage tanks, landfills, livestock confinement areas, highway or railroad right of ways, and sewage treatment facilities. Others are harder to locate like abandoned cesspools, underground tanks, French

drains, dry wells, or old dumps and mines.

The Charles Town Utilities reviewed intake locations and the delineated SWPAs to verify the existence of PSSCs provided by the WVBPH and identify new PSSCs. If possible, locations of regulated sites within the SWPA were confirmed. Information on any new or updated PSSCs identified by Charles Town Utilities and not already appearing in datasets from the WVBPH can be found in **.Table 7**.

**Table 7. Locally Identified potential Sources of Significant Contamination**

Please see Appendix A to view this information.

### 8.3. PRIORITIZATION OF THREATS AND MANAGEMENT STRATEGIES

---

Once the utility has identified local concerns, they must develop a management plan that identifies specific activities that will be pursued by the public water utility in cooperation and concert with the WVBPH, local health departments, local emergency responders, LEPC and other agencies and organizations to protect the source water from contamination threats.

Depending on the number identified, it may not be feasible to develop management strategies for all of the PSSCs in the SWPA. The identified PSSCs can be prioritized by potential threat to water quality, proximity to the intake(s), and local concern. The highest priority PSSCs can be addressed first in the initial management plan. Lower ranked PSSCs can be addressed in the future as time and resources allow. To assess the threat to the source water, water systems should consider confidential information about each PSSC. This information may be obtained from state or local emergency planning agencies, Tier II reports, facility owner, facility groundwater protection plans, spill prevention response plans, results of field investigations, etc.

In addition to identifying and prioritizing PSSCs within the SWPA, local source water concerns may also focus on critical areas. For the purposes of this source water protection plan, a critical area is defined as an area that is identified by local stakeholders and can lie within or outside of the ZCC. Critical areas may contain one or more PSSCs which would require immediate response to address a potential incident that could impact the source water.

A list of these priority PSSCs was selected and ranked by the Charles Town Utilities Protection Team. This list reflects the concerns of this specific utility and may contain PSSCs not previously identified and not within the ZCC or ZPC. **Table 8** contains a description of why each critical area or PSSC is considered a threat and what management strategies the utility is either currently using or could use in the future to address each threat.

## 9.0 IMPLEMENTATION PLAN FOR MANAGEMENT STRATEGIES

Charles Town Utilities reviewed the recommended strategies listed in their previous source water protection plan, to consider if any of them should be adopted and incorporated in this updated plan. **Table 9** provides a brief statement summarizing the status of the recommended strategies. **Table 9** also lists strategies from a previous plan that are being incorporated in this plan update.

When considering source management strategies and education and outreach strategies, this utility has considered how and when the strategies will be implemented. The initial step in implementation is to establish responsible parties and timelines to implement the strategies. The water utility, working in conjunction with the Protection Team members, can determine the best process for completing activities within the projected time periods. Additional meetings may be needed during the initial effort to complete activities, after which the Protection Team should consider meeting annually to review and update the Source Water Protection Plan. A system of regular updates should be included in every implementation plan.

Proposed commitments and schedules may change but should be well documented and reported to the local stakeholders. If possible, utilities should include cost estimates for strategies to better plan for implementation and possible funding opportunities. Charles Town Utilities has developed an implementation plan for priority concerns listed in **Table 8**. The responsible team member, timeline, and potential cost of each strategy are presented in **Table 9**. Note: Because timelines may change, future plan updates should describe the status of each strategy and explain the lack of progress.

**Table 8. Priority PSSCs or Critical Areas**

| PSSC or Critical Area                   | Priority Number | Reason for Concern   |
|---|-----------------|--|
| Agricultural Landuses                   | 1               | Pesticides and other chemicals used for farm operations can migrate into the water supply. Areas used for disposal of animal waste or burying dead livestock can also cause contamination of the source water. Increased nutrient load from these sources in surface water may result in algal growth. Algal presence may result in taste and odor issues. If stressed some algae also releases toxic chemicals that could cause a threat to human health. |
| Industrial & Commercial Activity        | 2               | Facilities such as gas stations, auto repair shops, and dry cleaners are located within the SWPA and pose a threat due to the potential for accidental spills, leaks, improper disposal of hazardous waste or improperly managed storm water runoff.   |
| Boat Ramp                               | 3               | The WV Division of Natural Resources (WVDNR) Shannondale Springs Wildlife Management Area (WMA) has a boat ramp within the ZCC on a tributary upstream of the intake. Petroleum products from boats may contaminate the surface waters.  |
| Railroad Traffic                        | 4               | The railroad tracks run through the protection watershed and cross 2 tributaries within the ZCC. A spill or leak could contaminate the source water.   |
| On-Site Septic Systems                  | 5               | Failing septic systems or untreated sewage from on-site septic systems could infiltrate to the surface water source, raising concentrations of total coliform, particularly fecal coliform.  |
| New Development Construction            | 6               | Construction runoff from new development can increase turbidity, total dissolved solids, and total suspended solids in the surface waters. Petroleum products from construction equipment could migrate into surface waters should a spill or leak occur.  |
| Land Conservation within the Watershed. | 7               | Land conservation is critical to the over health of the Shenandoah River and its tributaries. Forests lands and wetlands are vital along the routes of waterways. Restoring areas along the river to native habitats acts to filter water, stops siltation and recharges aquifers. Also, land conservation increases aquatic wildlife and access for recreation.   |

**Table 9. Priority PSSC Management Strategies**

| PSSC or Critical Area | Management Activity   | Responsible Protection Team Member | Status / Schedule | Comments | Estimated Cost |
|-----------------------|---|------------------------------------|-------------------|----------|----------------|
| Boat Ramp             | Contact personnel of the WVDNR Shannondale Springs WMA to identify any measures that the water system can assist to promote keeping the water free of petroleum products associated with boats. | Charles Town Utility Board         | Not Started       |          | Personnel Time |



**Table 9. Priority PSSC Management Strategies**

| PSSC or Critical Area                   | Management Activity   | Responsible Protection Team Member                          | Status / Schedule | Comments   | Estimated Cost                         |
|---|---|---|-------------------|--|--|
| Land Conservation within the Watershed. | Charles Town Utilities will focus on the connection between land conservation and source water protection. We will collaborate with conservation organizations like WV Rivers Coalition, WV Land Trust, the Farmland Protection Board, Land Trust of the Eastern Panhandle, Historic Landmark Commissions, and others to explore strategies to accelerate conservation easements that benefit our public drinking water source. The resulting management strategy will be a collaborative effort to identify priority conservation areas. | Lead: WV Rivers Coalition<br><br>Charles Town Utility Board | Ongoing           | Meet with WV Rivers Coalition to discuss opportunities | Minimal, staff time to attend meetings |
| Industrial & Commercial Activity        | Charles Town will request Groundwater Protection Plans (GPPs) and/or stormwater management plans from WVDEP for commercial facilities located within the SWPA. Review and investigate what (if any) preventative pollution measures are already in place for these facilities. This will permit the utility to better understand protection strategies already in place at these facilities and more accurately determine the threat posed by specific facilities.  | Charles Town Utility Board                                  | Ongoing           |  | Personnel Time                         |
| Agricultural Landuses                   | Pesticides, herbicides and nutrients used for farm operations can migrate through surface waters into the water supply. Non-point source runoff from the livestock areas may introduce pathogens, particularly if the runoff occurs from confined spaces, such as feedlots. Overgrazing can create erosion issues. Areas used for disposal of animal waste or burying dead livestock can also cause contamination of the source water.  | Charles Town Utility Board                                  | Ongoing           |  | Personnel Time                         |

**Table 9. Priority PSSC Management Strategies**

| PSSC or Critical Area | Management Activity  | Responsible Protection Team Member  | Status / Schedule | Comments | Estimated Cost |
|-----------------------|--|---|-------------------|----------|----------------|
| Agricultural Landuses | Consider working with the local Future Farmers of America members to distribute educational materials and best management practices information.   | n/a   | Not Started       |          |                |
| Agricultural Landuses | Work with the local livestock owners to determine the placement of animal waste disposal areas and/or areas for burying dead livestock.  | n/a   | Not Started       |          |                |
| Railroad Traffic      | When CSX railways offers or provides training materials, planning guides, trainings, exercises, etc., to the LEPC, Jefferson County LEPC will make the information available to local emergency response agencies so that they may choose to utilize them. CSX has made their Rail Respond internet-based program available to HSEM, LEPC, and emergency responders that can document to CSX a need to know, which provides access to critical information about response to accidents involving the CSX rails. Emergency personnel have also expressed interest to CSX in performing routine Emergency Response drills for Highway and Railroad spills. Charles Town Utilities will work with WVDEP of BPH to perform a Hazmat Re-route request to prevent specific potential contaminants from being transported through system source water protection areas. These entities will work with railroad companies to discuss safety measures, emergency plans and inspection routine(s). | Charles Town Utility Board,<br>Jefferson County Homeland Security and Emergency Management,<br>WVDEP, WVBPH | Ongoing           |          | Personnel Time |
| Railroad Traffic      | Work with the railroad company to create an emergency response plan in case a hazardous materials spill would occur to prevent or cleanup contamination of the source water.   | n/a   | Not Started       |          |                |

**Table 9. Priority PSSC Management Strategies**

| PSSC or Critical Area        | Management Activity   | Responsible Protection Team Member   | Status / Schedule | Comments | Estimated Cost |
|------------------------------|---|--|-------------------|----------|----------------|
| New Development Construction | Ensure sediment and erosion control measures are being instituted at construction sites. Monitor compliance with existing regulations through inspections and/or contact with regulatory agencies (WVDEP).  | Charles Town Utility Board   | Ongoing           |          | Personnel Time |
| On-Site Septic Systems       | Charles Town Utilities will work with the Health Department to the degree feasible to encourage homeowners to maintain and routinely inspect their septic systems or replace old or failing septic systems with Best Available Technologies (BATs). Outreach materials will encourage them to have their septic system inspected regularly and pumped every 5-10 years as needed. Also, the USEPA provides a complete guide for residents to maintain their septic systems, for the guide, visit: <a href="http://epa.gov/own/septic/pubs/homeownerguidelong.pdf">http://epa.gov/own/septic/pubs/homeownerguidelong.pdf</a> . | Charles Town Utility Board,<br>Jefferson County Health Department,<br>WVDEP-DWWM | Ongoing           |          | Personnel Time |

## 10.0 EDUCATION AND OUTREACH STRATEGIES

The goal of education and outreach is to raise awareness of the need to protect drinking water supplies and build support for implementation strategies. Education and outreach activities will also ensure that affected citizens and other local stakeholders are kept informed and provided an opportunity to contribute to the development of the source water protection plan. Charles Town Utilities has created an Education and Outreach plan that describes activities it has either already implemented or could implement in the future to keep the local community involved in protecting their source of drinking water. This information can be found in **Table 10**.

**Table 10. Education and Outreach Implementation Plan**

| Education and Outreach Strategy                         | Description of Activity   | Responsible Protection Team Member   | Status / Schedule | Comments  | Estimated Cost                          |
|---|---|--|-------------------|---|---|
| Jefferson County Water Advisory Committee Participation | A representative from Charles Town Utilities will participate in the Jefferson County Water Advisory Committee. County Cleanup days, outreach, Shepherdstown day, 7 watershed groups coordinated  | Charles Town Utilities   | Ongoing           | The Jefferson County Water Advisory Committee meets the 3rd Wednesday of each month at the County Commission meeting room located at 200 E. Washington Street, Charles Town, WV |   |
| Emergency Planning and Coordination                     | Participate with local fire departments and County Emergency Services on a regular basis. This will ensure that all the agencies are in constant communication with one another and prepared in the event of an emergency.              | Jefferson County Office of Homeland Security and Emergency Management<br><br>Citizens and Independent Fire Departments<br><br>Charles Town Utilities | Ongoing           | On-going training exercises by emergency services.  | Minimal, staff time to attend meetings. |
| Clean Up Events   | Coordinate with local Clean Up efforts and publicize projects. Work closely with Watershed Associations in this regard.   | Charles Town Utilities   | Not Started       | Coordinate with local organizations and publish information on web page   |   |
| General Information Dissemination                       | Include educational information on the following topics on website for public use: Source water protection, water conservation, household hazardous materials disposal, pharmaceuticals disposal, observing and reporting spills/leaks. | Charles Town Utilities   | Not Started       | Annual CCR  |   |
| Best Management Practices (BMP) lists                   | Distribute lists of industry specific BMPs to the owners of (1) Gas Stations, (2) Car Repair Shops, (3) Agricultural Lands/Facilities within the SWPA (Future Farmers, etc.) Provide SWPP education materials.                          | WVDEP and WVDHHR Charles Town Utilities  | Not Started       | Charles Town can make this information available via web links on their web page  |   |

**Table 10. Education and Outreach Implementation Plan**

| Education and Outreach Strategy | Description of Activity  | Responsible Protection Team Member  | Status / Schedule | Comments  | Estimated Cost |
|---------------------------------|--|---|-------------------|---|----------------|
| Display Information             | (1) Include information materials (i.e. brochures, maps, etc.) in County and City Government offices and other public places (i.e. local fairs). Work with DOT for protection area sign expansion/coverage. (2) Host non-confidential SWPP online for public review and comment.   | Jefferson County Office of Homeland Security and Emergency Management.<br>Citizens and Independent Fire Departments<br>Charles Town Utilities | Ongoing           | On-going training exercises by emergency services                       |                |
| School Curricula                | Work with area schools to include source water protection information into the curriculum, or present information at assemblies or in classroom events (e.g. environmental science class). Consider implementing in conjunction with City and County MS4 requirements.   | WVDEP/WVDHHR<br>Charles Town Utilities  | Not Started       | Coordinate with local organizations and publish information on web page |                |
| School Curricula                | In addition, the USEPA offers free educational materials for teachers and students, including classroom lessons, fact sheets, and interactive games and activities, for grades K-12. These materials can be accessed at the following websites. For general source water protection:<br><a href="http://www.epa.gov/safewater/kids/index.html">http://www.epa.gov/safewater/kids/index.html</a> . For water conservation:<br><a href="http://www.epa.gov/watersense/resources/educational_materials.html">http://www.epa.gov/watersense/resources/educational_materials.html</a> Similar protection and conservation related resources can be found at the Groundwater Foundation website;<br><a href="http://www.groundwater.org/kc/kc.html">http://www.groundwater.org/kc/kc.html</a> ." | n/a   | Not Started       |   |                |
| School Curricula                | Visit school or invite students for a plant tour to tie in with school curricula.  | n/a   | Not Started       |   |                |

**Table 10. Education and Outreach Implementation Plan**

| Education and Outreach Strategy | Description of Activity   | Responsible Protection Team Member | Status / Schedule | Comments   | Estimated Cost                          |
|---------------------------------|---|------------------------------------|-------------------|--|---|
| School Curricula                | Ask the school to include message in school newsletter to raise awareness about source water protection and conservation.   | n/a                                | Not Started       |  |   |
| Public-Private Partnerships     | Work in concert with private partnerships such as WV Rivers Coalition to implement programs like Safe Water for West Virginia. This program would include outreach to landowners to promote land conservation within the ZCC, ZPC and water shed to better improve overall water quality. | West Virginia Rivers Coalition     | Ongoing           | WV Rivers should take the lead on this item and implement a schedule moving forward. | Minimal, staff time to attend meetings. |

## 11.0 CONTINGENCY PLAN

The goal of contingency planning is to identify and document how the utility will prepare for and respond to any drinking water shortages or emergencies that may occur due to short and long term water interruption, or incidents of spill or contamination. During contingency planning, utilities should examine their capacity to protect their intake, treatment, and distribution system from contamination. They should also review their ability to use alternative sources and minimize water loss, as well as their ability to operate during power outages. In addition, utilities should report the feasibility of establishing an early warning monitoring system and meeting future water demands.

Isolating or diverting any possible contaminant from the intake for a public water system is an important strategy in the event of an emergency. One commonly used method of diverting contaminants from an intake is establishing booms around the intake. This can be effective, but only for contaminants that float on the surface of the water. Alternatively, utilities can choose to pump floating contaminants from the water or chemically neutralize the contaminant before it enters the treatment facility.

Public utilities using surface sources should be able to close the intake by one means or another. However, depending upon the system, methods for doing so could vary greatly and include closing valves, lowering hatches or gates, raising the intake piping out of the water, or shutting down pumps. Systems should have plans in place in advance as to the best method to protect the intake and treatment facility. Utilities may benefit from turning off pumps and, if possible, closing the intake opening to prevent contaminants from entering the piping leading to the pumps. Utilities should also have a plan in place to sample raw water to identify the movement of a contaminant plume and allow for maximum pumping time before shutting down an intake (See Early Warning Monitoring System). The amount of time that an intake can remain closed depends on the water infrastructure and should be determined by the utility before an emergency occurs. The longer an intake can remain closed in such a case, the better.

Raw and treated water storage capacity also becomes extremely important in the event of such an emergency. Storage capacity can directly determine how effectively a water system can respond to a contamination event and how long an intake can remain closed. Information regarding the water shortage response capability of Charles Town Utilities is provided in **Table 11**.

### 11.1. RESPONSE NETWORKS AND COMMUNICATION

PSSC data from some agencies (ex. WVDHSEM, WVDEP, etc.) may be restricted due to the sensitive nature of the data. Locational data will be provided to the public water utility. However, to obtain specific details regarding contaminants, (such as information included in Tier II reports), water utilities should contact the local emergency planning commission (LEPC) or agencies, directly. While the maps and lists of the PSSCs and regulated sites are to be maintained in a confidential manner, these data are provided in **Appendix A. Figures** for internal review and planning uses only.



**Table 11. Charles Town Utilities Water Shortage Response Capacity**

|   |   |
|---|---|
| Can the water utility isolate or divert contamination from the intake and groundwater supply?   | Yes   |
| Describe the results of an examination and analysis of the public water system's ability to isolate or divert contaminated waters from its surface water intake or groundwater supply:                          | Isolation by electronically closing the drop gate of the intake to the wet well. Using the ICPRB real time tool, Charles Town is informed of contaminant migration from upstream via real time modeling. The ICPRB is capable of determining time of travel of contaminants to the Charles Town intake. This will allow them to plan when to shut down the drop gate of the intake to isolate and keep the system from taking in potential contaminants. In addition, they have an 1800 gpm trash pump that can be manually placed into the Shenandoah River with the suction approximately 20 feet from shore if the contaminants are not near the shore line. |
| Describe the results of an examination and analysis of the public water system's existing ability to switch to an alternative water source or intake in the event of contamination of its primary water source: | Potentially. Using the 1800 gpm portable trash pump the Utility can establish a temporary intake in the Shenandoah Rover close to the shoreline near the wet well. The utility currently has this capability, and exercises it during periods of frazil ice or heavy organic leaf buildup on the intake structure.  |
| Is the Utility able to close the water intake in the event of a spill?  | Yes   |
| How long can the Utility keep the intake closed?  | Approximately 2.16 days (1,656,898 gpd average production, with current storage capacity of 3,572,000 gallons of treated water.   |
| Describe the process to close the intake:   | The intake pumps can be shut down and the intake structure has a drop gate that can be closed electronically from the treatment plant.  |
| Describe the treated water system's storage capacity of the water system:   | [REDACTED]  |
| Gallons of storage capacity (raw water)   | 0   |
| Gallons of storage capacity (treated water)   | 0   |
| Is the Utility a member of WVRWA Emergency Response Team?:  | No  |
| Is the Utility a member of WV-WARN?:  | Yes   |
| List other agreements to provide receive assistance in case of emergency:   | N/A   |

## 11.2. OPERATION DURING LOSS OF POWER

Charles Town Utilities analyzed its ability to operate effectively during a loss of power. This involved ensuring a means to supply water through treatment, storage, and distribution without creating a public health emergency. Information regarding the utility’s capacity for operation during power outages is summarized in **Table 12**.

**Table 12. Generator Capacity**

|  |  |                                |               |
|--|--|--------------------------------|---------------|
| Can you connect to a generator at the intake/wellhead?:  | Yes  |                                |               |
| Please provide a scenario that best describes your system:   | Has standby generator, hard-wired and read to turn on. 3 phase Cummins 250 KW Model DQAC 1403873 Serial # D140667237 (Spec H)  |                                |               |
| What do you have (KW)?   | 250.00   |                                |               |
| What do you need (KW)?   | 250.00   |                                |               |
| Can you connect to a generator at the treatment facility?:   | Yes  |                                |               |
| Please provide a scenario that best describes your system:   | Has standby generator, hard-wired and read to turn on. 3 phase Cummins 300 KW Model DQDAC 1344640 Serial# A140620402 (Spec G)  |                                |               |
| What do you have (KW)?   | 300.00   |                                |               |
| What do you need (KW)?   | 300.00   |                                |               |
| Can you connect to a generator at the distribution system?:  | Yes  |                                |               |
| Please provide a scenario that best describes your system:   | Has standby generator, hard-wired and read to turn on. Huntfield Booster Station 3 phase Cummins 100 KW, Northern High Zone Booster Station (Ranson) 3 phase Cummins 200 KW, Model DFGC2784250 Serial #L060003643 (Spec N), 1800 gpm trash pump (emergency pump)   |                                |               |
| What do you have (KW)?   | 100.00   |                                |               |
| What do you need (KW)?   | 100.00   |                                |               |
| Does the utility have fuel on hand for generator?:   | Yes  |                                |               |
| Hours:   | 179  |                                |               |
| Gallons:   | 550  |                                |               |
| Provide a list of suppliers and alternate suppliers that could provide fuel in the event of an emergency:                    |  | Supplier                       | Phone Number  |
|  | Fuel   | Roach Oil                      | (304)263-3329 |
|  | Fuel   | Griffith Energy Services, Inc. | (240)416-2830 |
|  | Generator  | WV National Guard              | (304)267-2772 |
| Does the utility test the generator(s) periodically?:  | Yes  |                                |               |
| Does the utility routinely maintain the generator(s)?:   | Yes  |                                |               |
| If the Utility does not have generator or the ability to connect to a generator, describe plans to respond to power outages: | In the event of a mechanical failure to the existing generators during an emergency, the system would need to obtain a Cummins Repair Technician, or obtain an equivalent emergency generator from a rental vendor or the National Guard, In the event another generator would be needed, an electrician would need to wire a the replacement generator into the system. |                                |               |

## 11.3. FUTURE WATER SUPPLY NEEDS

When planning for potential emergencies and developing contingency plans, a utility needs to not only consider their current demands for treated water but also account for likely future needs. This could mean expanding current intake sources or developing new ones in the near future. This can be an expensive and time consuming process, and any

water utility should take this into account when determining emergency preparedness. Charles Town Utilities has analyzed its ability to meet future water demands at current capacity, and this information is included in **Table 13**.

**Table 13. Future Water Supply Needs for Charles Town Utilities**

|  |   |
|--|---|
| Is the Utility able to meet water demands with the current capacity for the next five years? | Yes   |
| Explain how you plan to do so:   | <p>Yes, there is enough capacity to support more residential, commercial and industrial development within the service area. The following explains how this can be achieved:</p> <ol style="list-style-type: none"> <li>1. The water plant can increase daily production hours (currently running at approximately 13.50 hours/day) to increase total water production for near future expansion needs.</li> <li>2. With capital improvements to the water delivery system, the total amount of fresh water on hand will increase as the replacement piping projects continue. Thus, increasing available fresh water and future expansion.</li> </ol> |

## 11.4. WATER LOSS CALCULATION

In any public water system there is a certain percentage of the total treated water that does not reach the customer. Some of this water is used in treatment plant processes such as back washing filters or flushing piping, but there is usually at least a small percentage that goes unaccounted for. To measure and report on this unaccounted for water, a public utility must use the method described in the Public Service Commission's rule, Rules for the Government of Water Utilities, 150CSR7, section 5.6. The rule defines unaccounted for water as the volume of water introduced into the distribution system less all metered usage and all known non-metered usage which can be estimated with reasonable accuracy.

To further clarify, metered usages are most often those that are distributed to customers. Non-metered usages that are being estimated include usage by fire departments for fires or training, un-metered bulk sells, flushing to maintain the distribution system, and water used for backwashing filters and cleaning settling basins. By totaling the known metered and non-metered uses the utility calculates unaccounted for water. Note: To complete annual reports submitted to the PSC, utilities typically account for known water main breaks by estimating the amount of water lost. However, for the purposes of the source water protection plan, any water lost due to leaks, even if the system is aware of how much water is lost at a main break, is not considered a use. Water lost through leaks and main breaks cannot be controlled during a water shortages or other emergencies and should be included in the calculation of percentage of water loss for purposes of the source water protection plan. The data in **Table 13** is taken from the most recently submitted Charles Town Utilities PSC Annual Report.

**Table 14. Water Loss Information**

|  |   |            |
|--|---|------------|
| Water pumped - Total Gallons:                                | 604,768,000   |            |
| *Water purchased - Total Gallons:                            | 0   |            |
| Total gallons of water pumped and purchased:                 | 604,768,000   |            |
| Total gallons of water loss accounted for except main leaks: | Mains, plant, filters, flushing, etc - Total Gallons: | 16,500,000 |
|  | Fire department - Total Gallons:                      | 7,500,000  |
|  | Back washing - Total Gallons:                         | 0          |

|   |  |             |
|---|--|-------------|
|   | Blowing settling basins - Total Gallons:   | 10,500,000  |
| Total Accounted for Water Loss  |  | 34,500,000  |
| Unaccounted for lost water - Total Gallons:                                 |  | 200,408,000 |
| Water sold - Gallons:   |  | 354,360,000 |
| Water Lost From Main Leaks:   |  | 15,500,000  |
| Total Gallons of Unaccounted for Lost Water and Water Lost from Main Leaks: |  | 215,908,000 |
| Total percent unaccounted for water   |  | 36          |
| Describe the measures to correct water loss greater than 15%:               | The utility is continuing with planned capital improvements of approximately \$7,000,000. The improvements consist of replacing known 2-inch galvanized piping in the older sections of the water system around Ranson. Also, 1,100 feet older ACP (Transite) piping was replaced along Fairfax Boulevard, Ranson. Additionally, all Transite piping mains used in Ranson will eventually be replaced as needed. |             |

## 11.5. EARLY WARNING MONITORING SYSTEM

Public water utilities are required to provide an examination of the technical and economic feasibility of implementing an early warning monitoring system. Implementing an early warning monitoring system may be approached in different ways depending upon the water utility's resources and threats to the source water. A utility may install a continuous monitoring system that will provide real time information regarding water quality conditions. This would require utilities to analyze the data to establish what condition is indicative of a contamination event. Continuous monitoring will provide results for a predetermined set of parameters. The more parameters that are being monitored, the more sophisticated the monitoring equipment will need to be. When establishing a continuous monitoring system, the utility should consider the logistics of placing and maintaining the equipment, and receiving output data from the equipment.

Alternately, or in addition, a utility may also pull periodic grab samples on a regular basis, or in case of a reported incident. The grab samples may be analyzed for specific contaminants. A utility should examine their PSSCs to determine what chemical contaminants could pose a threat to the water source. If possible, the utility should plan in advance how those contaminants will be detected. Consideration should be given to where samples will be collected, the preservations and hold times for samples, available laboratories to analyze samples, and costs associated with the sampling event. Regardless of the type of monitoring (continuous or grab), utilities should collect samples for their source throughout the year to better understand the baseline water quality conditions and natural seasonal fluctuations. Establishing a baseline will help determine if changes in the water quality are indicative of a contamination event and inform the needed response.

Every utility should establish a system or process for receiving or detecting chemical threats with sufficient time to respond to protect the treatment facility and public health. All approaches to receiving and responding to an early warning should incorporate communication with facility owners and operators that pose a threat to the water quality, with state and local emergency response agencies, with surrounding water utilities, and with the public. Communication plays an important role in knowing how to interpret data and how to respond.

Charles Town Utilities has analyzed its ability to monitor for and detect potential contaminants that could impact its source water. Information regarding this utility's early warning monitoring system capabilities is provided in **Table 15** and in **Appendix B**.

**Table 15. Early Warning Monitoring System Capabilities**

|   |  |  |
|---|--|--|
| Does your system currently receive spill notifications from a state agency, neighboring water system, local emergency responders, or other facilities?  |  | Yes  |
| From whom do you receive notices?   |  | Notifications are received from the WVDEP, WVDHHR and the WV Office of Homeland Security and Emergency Management. In addition the state of Virginia provides notifications as well as the Interstate Commission on the Potomac River Basin (ICPRB).   |
| Are you aware of any facilities, land uses, or critical areas within your protection areas where chemical contaminants could be released or spilled?  |  | Yes  |
| Are you prepared to detect potential contaminants if notified of a spill?   |  | Yes  |
| List laboratories (and contact information) on whom you would rely to analyze water samples in case of a reported spill.  | Laboratories                                   |  |
|   | Name   | Phone Number   |
|   | Pace Analytical Services - Rapid Response Line | (877)859-7778  |
|   | HydroChem Laboratories                         | (304)725-6174  |
| Do you have an understanding of baseline or normal conditions for your source water quality that accounts for seasonal fluctuations?  |  | Yes  |
| Does your utility (aside from turbidity monitoring) currently monitor your raw water through continuous monitoring at the surface water intake or groundwater source to detect changes in water quality that could indicate contamination?                  |  | No   |
| Does your utility collect periodic grab samples (ex. possess reserved sample bottles, on-call laboratory services, and trained personnel) in response to a spill notification or to investigate changes in water quality that could indicate contamination? |  | Yes  |
| Please explain:   |  | Continuously test for turbidity in raw water and chlorine levels in finished water with HACH equipment. Daily grab samples for pH, turbidity, temperature, total organic carbon, alkalinity and hardness; monthly grab samples for cryptosporidium and E. Coli are being collected, yearly periodic grab for nitrate, nitrite, VOCs, SVOCs and Metals. |
| Provide or estimate the capital and O&M costs for your current or proposed early warning system or upgraded system.   | Capital Cost:                                  | 15,000   |
|   | O&M Cost:                                      | 3,000  |
| Do you serve more than 100,000 customers?   |  | No   |
| Does your system currently receive spill notifications from a state agency, neighboring water system, local emergency responders, or other facilities?  |  | Yes  |
| Are you prepared to detect potential contaminants if notified of a spill?   |  | Yes  |
| Please describe the methods you use to monitor at the same technical levels utilized by ORSANCO:  |  |  |

## 12.0 SINGLE SOURCE FEASIBILITY STUDY

If a public water utility's water supply plant is served by a single-source intake to a surface water source of supply or a surface water influenced source of supply, the submitted source water protection plan must also include an examination and analysis of the technical and economic feasibility of alternative sources of water to provide continued safe and reliable public water service in the event that its primary source of supply is detrimentally affected by contamination, release, spill event or other reason. These alternatives may include a secondary intake, two days of additional raw or treated water storage, an interconnection with neighboring systems, or other options identified on a local level. Note: a suitable secondary intake would draw water supplies from a substantially different location or water source.

To accomplish this requirement, utilities should examine all existing or possible alternatives and rank them by their technical, economic, and environmental feasibility. To have a consistent and complete method for ranking alternatives, WVBPB has developed a feasibility study guide. This guide provides several criteria to consider for each category, organized in a Feasibility Study Matrix. By completing the Feasibility Study Matrix, utilities will demonstrate the process used to examine the feasibility of each alternative and document scores that compare the alternatives. The Feasibility Study matrix and summary of the results are presented in an alternatives feasibility study attached as **Appendix D**.

## 13.0 COMMUNICATION PLAN

Charles Town Utilities has also developed a Communication Plan that documents the manner in which the public water utility, working in concert with state and local emergency response agencies, shall notify the local health agencies and the public of the initial spill or contamination event and provide updated information related to any contamination or impairment of the system's drinking water supply. The initial notification to the public will occur in any event no later than thirty minutes after the public water system becomes aware of the spill, release, or potential contamination of the public water system. A copy of the source water protection plan and the Communication Plan has been provided to the local fire department. Charles Town Utilities will update the Communication Plan as needed to ensure contact information is up to date.

Procedures should be in place to effectively react to the kinds of catastrophic spills that can reasonably be predicted at the source location or within the SWPA. The chain-of-command, notification procedures and response actions should be known by all water system employees.

The WVBPH has developed a recommended communication plan template that provides a tiered incident communication process to provide a universal system of alert levels to utilities and water system managers. The comprehensive Communication Plan for Charles Town Utilities is attached as **Appendix C** for internal review and planning purposes only.

The West Virginia Department of Environmental Protection is capable of providing expertise and assistance related to prevention, containment, and clean-up of chemical spills. The West Virginia Department of Environmental Protection Emergency Response 24-hour Phone is 1-800-642-3074. The West Virginia Department of Environmental Protection also operates an upstream distance estimator that can be used to determine the distance from a spill site to the closest public water supply surface water intake.

## 14.0 EMERGENCY RESPONSE

A public water utility must be prepared for any number of emergency scenarios and events that would require immediate response. It is imperative that information about key contacts, emergency services, and downstream water systems be posted and readily available in the event of an emergency. Elements of this source water protection plan, such as the contingency planning and communication plan, may contain similar information to the utility's emergency response plan. However, the emergency response plan is to be kept confidential and is not included in this source water protection plan. An Emergency Short Form is included in **Appendix C** to support the Communicate Plan by providing quick access to important information about emergency response and are to be used for internal review and planning purposes only.



## 15.0 CONCLUSION

This report represents a detailed explanation of the required elements of Charles Town Utilities's Source Water Protection Plan. Any supporting documentation or other materials that the utility considers relevant to their plan can be found in **Appendix E**.

This source water protection plan is intended to help prepare community public water systems all over West Virginia to properly handle any emergencies that might compromise the quality of the system's source water supply. It is imperative that this plan is updated as often as necessary to reflect the changing circumstances within the water system. The protection team should continue to meet regularly and continue to engage the public whenever possible. Communities taking local responsibility for the quality of their source water is the most effective way to prevent contamination and protect a water system against contaminated drinking water. Community cooperation, sufficient preparation, and accurate monitoring are all critical components of this source water protection plan, and a multi-faceted approach is the only way to ensure that a system is as protected as possible against source water degradation.


## APPENDIX A. FIGURES AND TABLES

## Water Source / Delineation


---

### Surface Water Sources

Intake: Shenandoah River

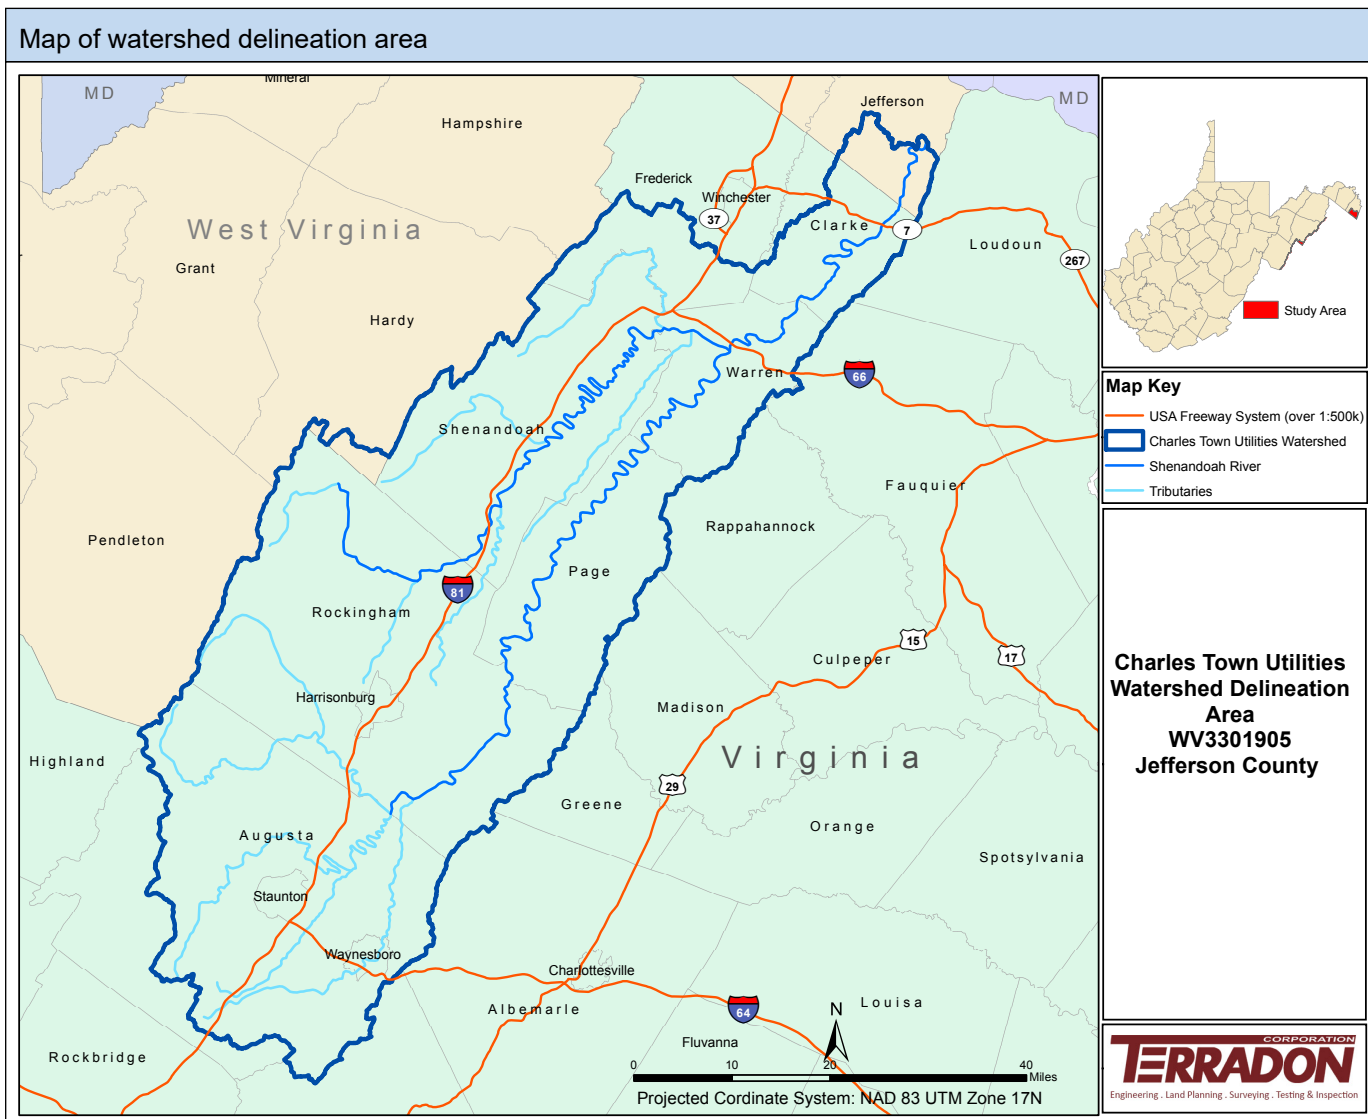

Map of zone of critical Concerns

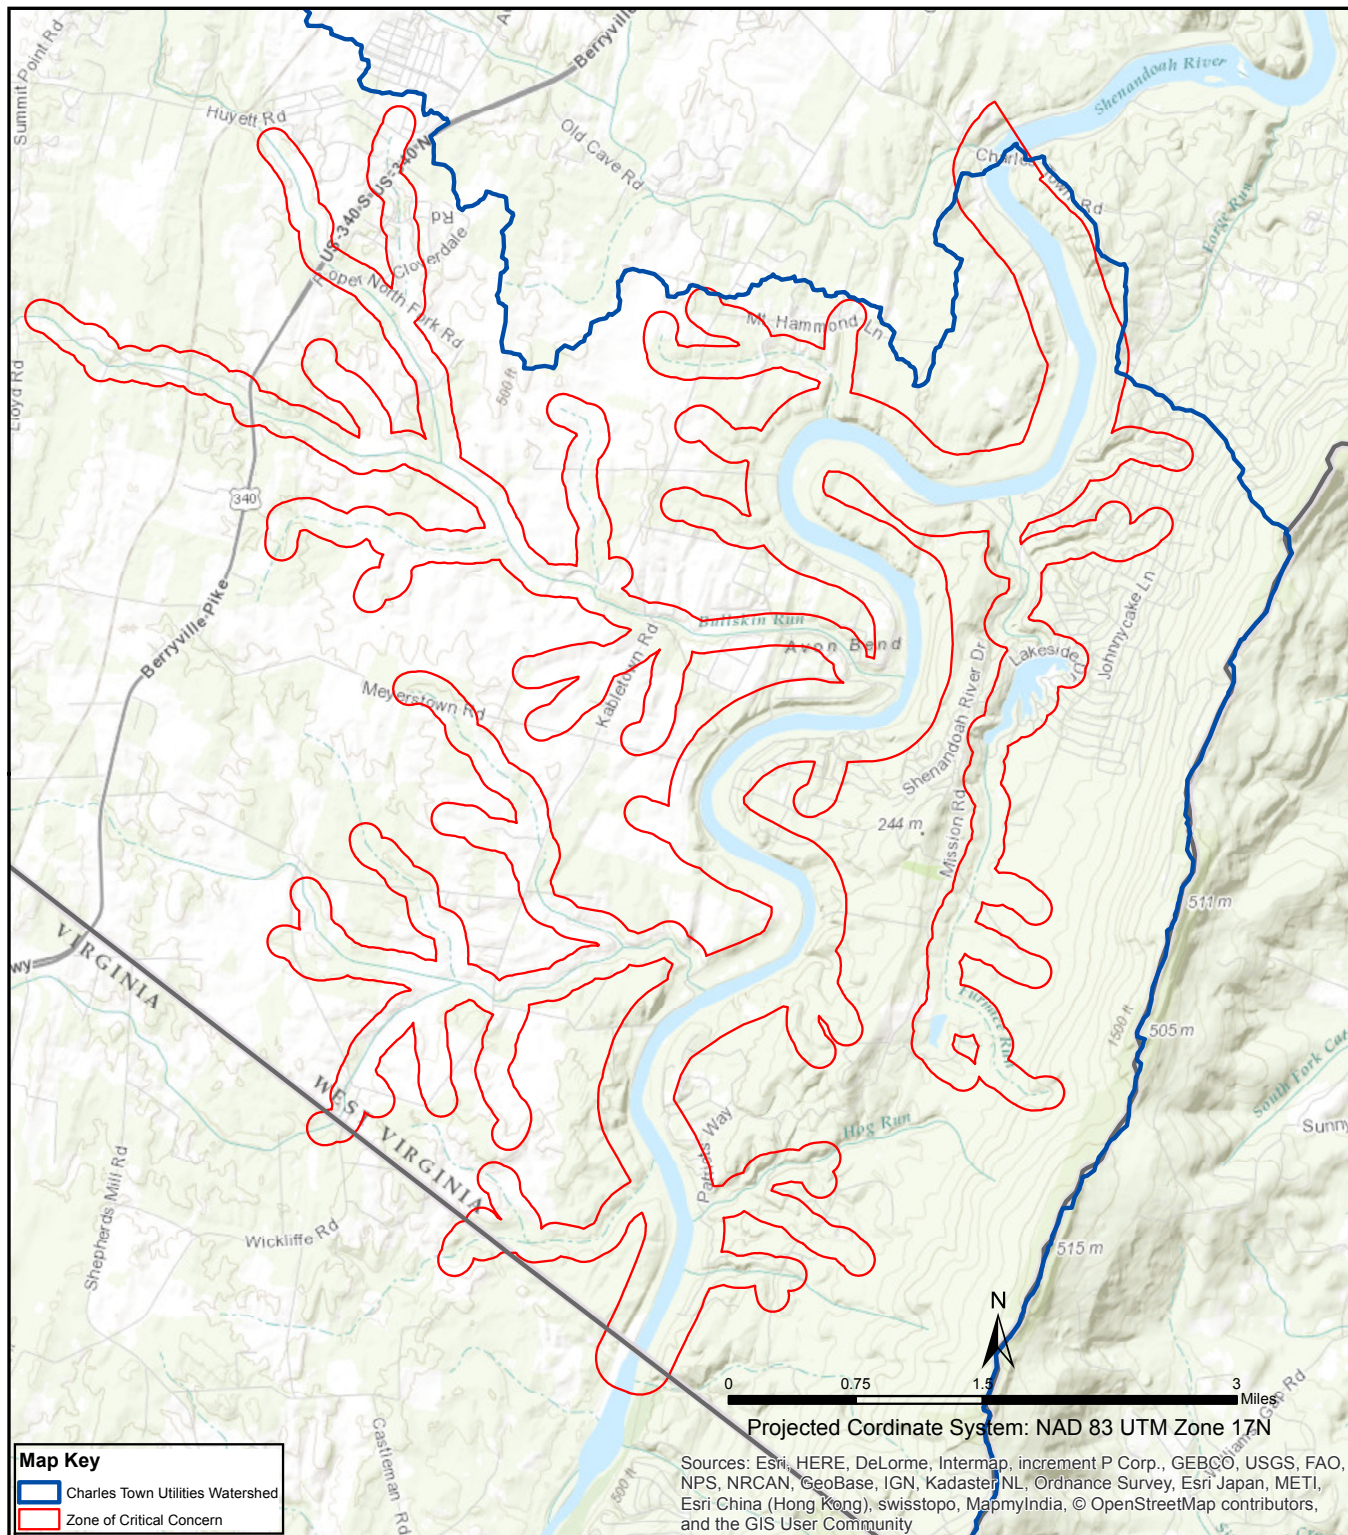



**Charles Town Utilities Zone of Critical Concern**

**WV3301905**

**Jefferson County**



Map of zone of peripheral Concerns

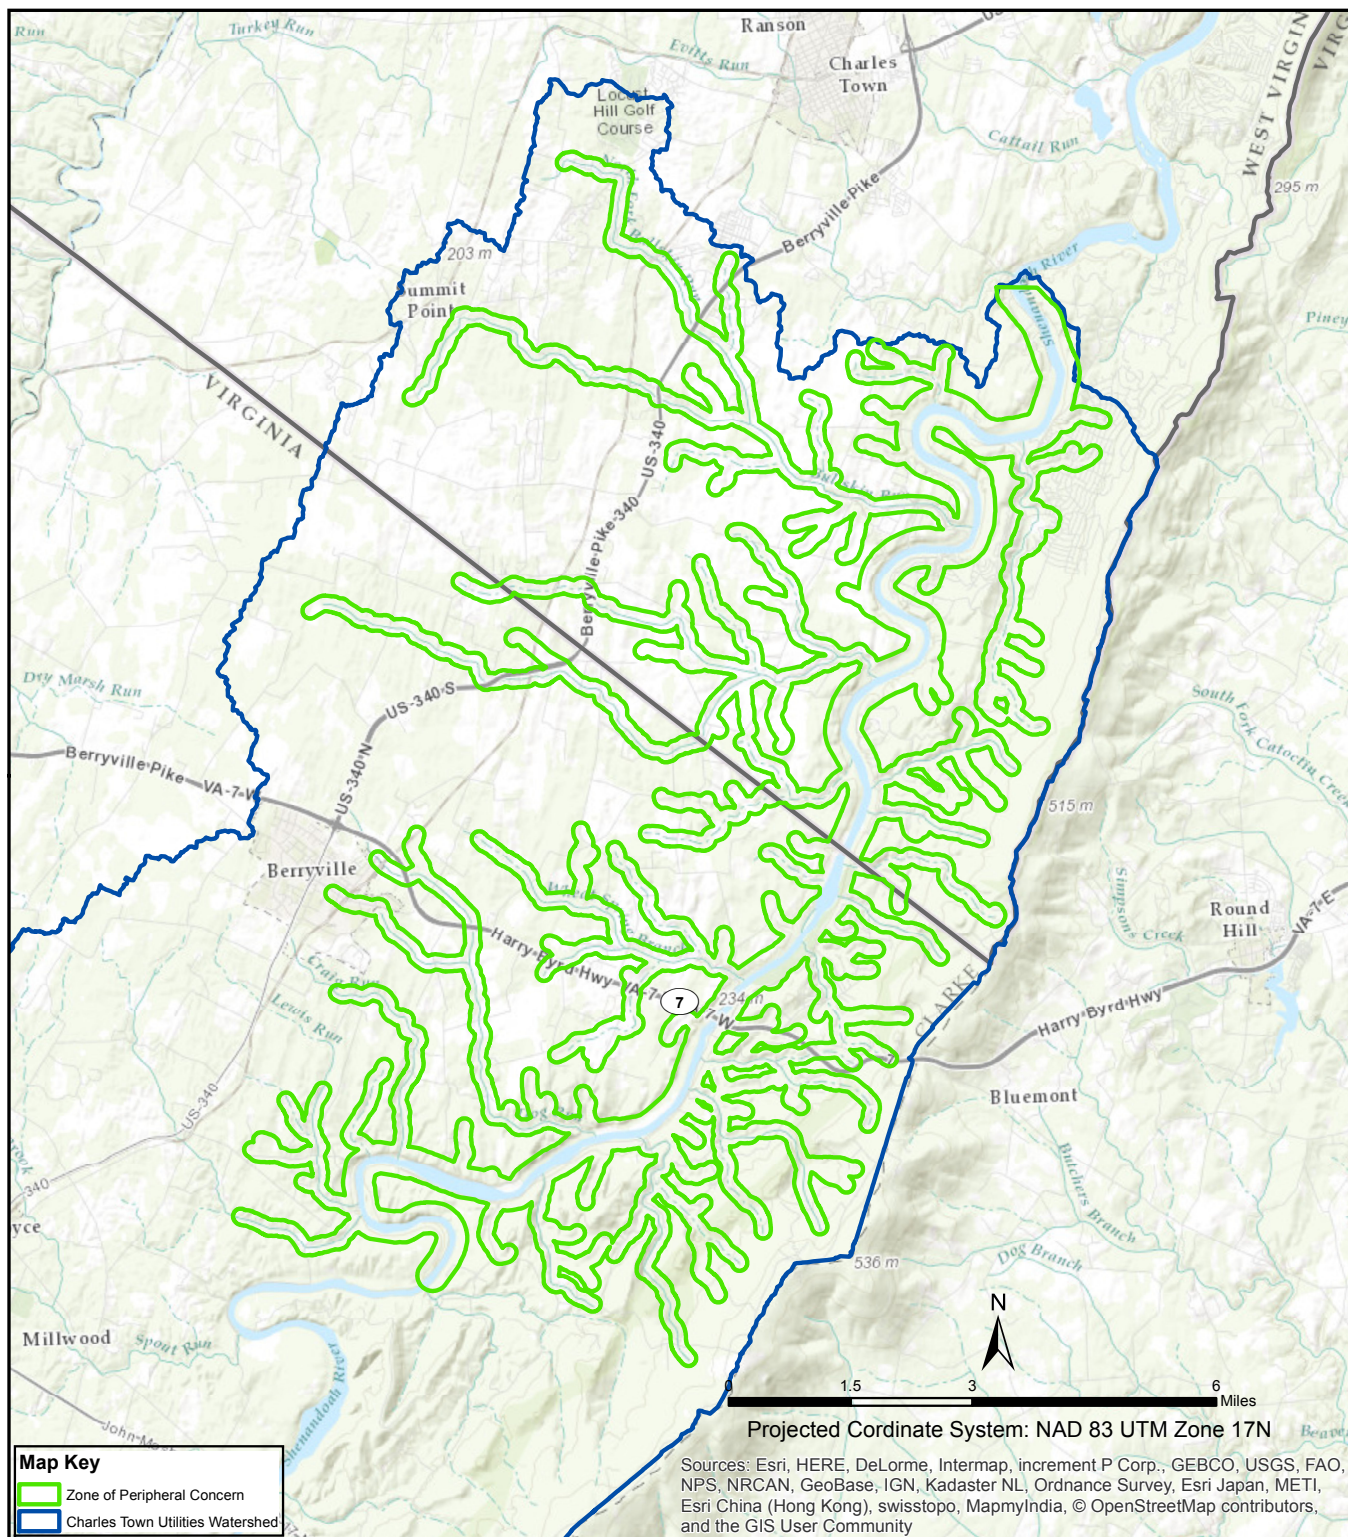

**Charles Town Utilities Zone of Peripheral Concern**

**WV3301905**


**Jefferson County**



## PSSC Maps

---

Local and Regional PSSC Map

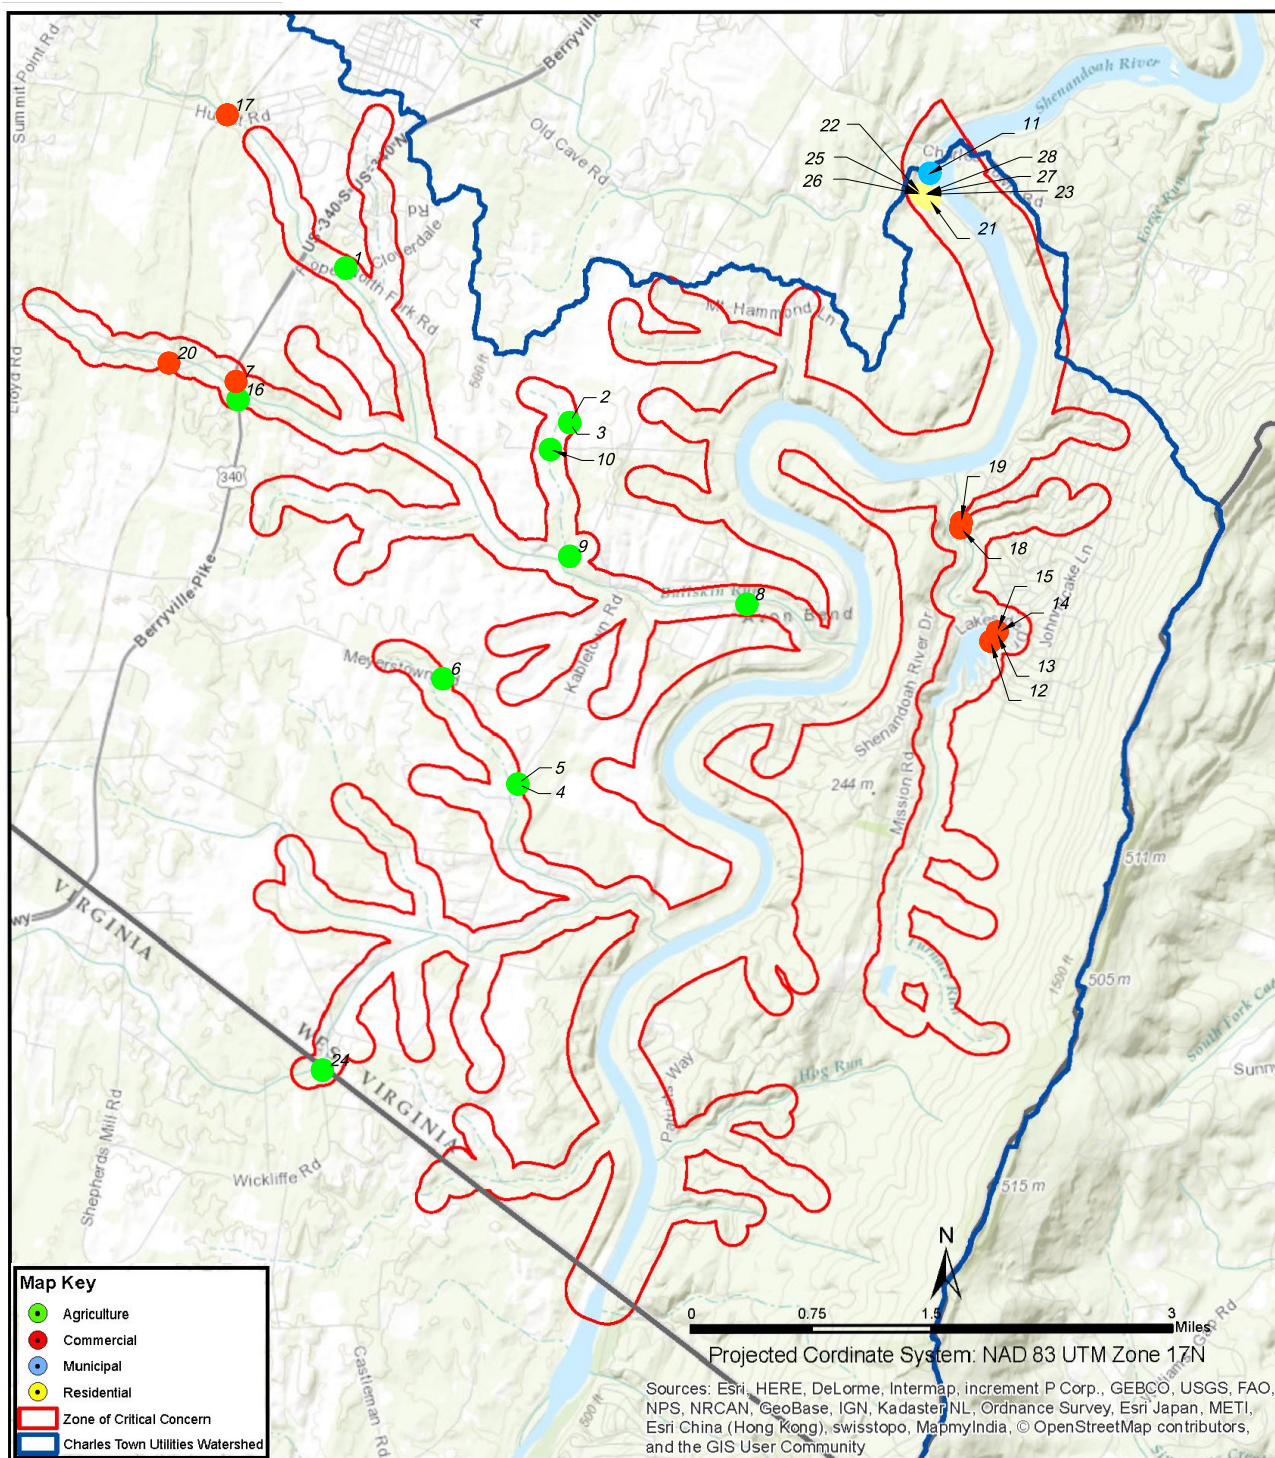

Unregulated Potential Sources of Significant Contamination

**WV3301905**

**Jefferson County**







## PSSC Lists

---

Local and Regional PSSC List

| PSSC Number | Site Name  | Site Description                                  | SOURCE CATEGORY | ASSOCIATED CHEMICALS | THREAT TO GW | THREAT TO SW |
|-------------|--|---|-----------------|----------------------|--------------|--------------|
| 1           | Pasture  | Animal Feedlots                                   | Agriculture     | MP, SOC              | H            | H            |
| 2           | Crop fields and feed lot                             | Animal Feedlots                                   | Agriculture     | MP, SOC              | H            | H            |
| 3           | Crops and Feed Lot                                   | Crops, corn, soybean, wheat                       | Agriculture     | NN, SOC, MP          | H            | H            |
| 4           | Cattle pasture and small feed lot with barn          | Animal Feedlots                                   | Agriculture     | MP, SOC              | H            | H            |
| 5           | Soybean field  | Animal Feedlots                                   | Agriculture     | MP, SOC              | H            | H            |
| 6           | Corn field   | Crops, corn, soybean, wheat                       | Agriculture     | NN, SOC, MP          | L            | L            |
| 7           | Dave's Auto and RV Sales                             | Car dealerships                                   | Commercial      | PH, VOC              | H            | L            |
| 8           | Avon Bend Farm                                       | Drainage canals (agricultural)                    | Agriculture     | T                    | L            | L            |
| 9           | Silos and storage area on private property           | Pesticide/fertilizer/petroleum storage and Trans. | Agriculture     | PH, NN, SOC, VOC     | L            | L            |
| 10          | Oakwood Farm Dairy and Taylor Mountain Farm          | Pasture   | Agriculture     | MP, SOC              | L            | L            |
| 11          | Water supply intake                                  | Other   | Municipal       | Null                 | Null         | Null         |
| 12          | Lakeshore Grille restaurant                          | Other   | Commercial      | Null                 | Null         | Null         |
| 13          | Old Lake Lodge at Shannondale - Closed               | Other   | Commercial      | Null                 | Null         | Null         |
| 14          | Old Lake Lodge at Shannondale - Closed               | Other   | Commercial      | Null                 | Null         | Null         |
| 15          | Old Lake Lodge at Shannondale - Closed               | Other   | Commercial      | Null                 | Null         | Null         |
| 16          | Wheatland Horse farm                                 | Pasture   | Agriculture     | MP, SOC              | L            | L            |
| 17          | Railroad tracks crossing stream                      | Railroad Tracks and Yards                         | Commercial      | PH, M, VOC, HM, SOC  | H            | H            |
| 18          | Shannondale Springs Wildlife Management Area         | Marina/boat docks                                 | Commercial      | PH                   | L            | H            |
| 19          | Grammy's Place day care center - Closed              | Other   | Commercial      | Null                 | Null         | Null         |
| 20          | Railroad tracks crossing Bullskin Run near Wheatland | Railroad Tracks and Yards                         | Commercial      | PH, M, VOC, HM, SOC  | H            | H            |
| 21          | Trailer Community                                    | Residential (single family homes)                 | Residential     | VOC, SOC, NN         | H            | H            |
| 22          | House  | Septic Systems (leach field)                      | Residential     | MP, VOC, SOC, TO, NN | H            | H            |
| 23          | House  | Residential (single family homes)                 | Residential     | VOC, SOC, NN         | H            | H            |
| 24          | PCS#12   | Crops, corn, soybean, wheat                       | Agriculture     | NN, SOC, MP          | H            | H            |
| 25          | House  | Septic Systems (leach field)                      | Residential     | MP, VOC, SOC, TO, NN | H            | H            |
| 26          | House  | Residential (single family homes)                 | Residential     | VOC, SOC, NN         | H            | H            |
| 27          | House  | Septic Systems (leach field)                      | Residential     | MP, VOC, SOC, TO, NN | H            | H            |
| 28          | House  | Septic Systems (leach field)                      | Residential     | MP, VOC, SOC, TO, NN | H            | H            |

Regulated PSSC List

| WEST VIRGINIA - EPA RCRA                   |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |
|--|-------------------------------|-------------------------------------|----------------------------------|-----------------|-------------|--------------------|-------------------------------------|-------------|-------------|------------|---|
| PSSC Number                                | PRIMARY NAME                  | LOCATION                            | CITY NAME                        | RIPS CODE       | HUC CODE    | EPA REGION         | SITE TYPE                           | CREATE DATE | UPDATE DATE | CONVEYOR   | REFERENCE POINT                         |
| R-4  | RHODRICK PROPERTY UST REMOVAL | 1178 KABLETOWN ROAD                 | CHARLES TOWN                     | 54037           | 2070007     | 3                  | STATIONARY                          | 2/17/2010   | 11/4/2013   | RES-GEODCC | ENTRANCE POINT OF A FACILITY OR STATION |
| WEST VIRGINIA - EPA NPDES                  |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |
| PSSC Number                                | Permit ID                     | Facility Name                       | Description                      | T/C Description | Permit Type | UT Description     | SP Name                             |             |             |            |   |
| R-2  | WVSG10026                     | Snyder Environmental Services, Inc. | Sludge/Septic Land Disposal (GP) | Renewed         | Sewage      | Land               | Snyder Environmental Services, Inc. |             |             |            |   |
| R-3  | WVGR70001                     | Black Fly/Gypsy Moth Programs       | Pesticide                        | Renewed         | Industrial  | Outlet             | WV Department of Agriculture        |             |             |            |   |
| R-4  | WV0117544                     | Oakwood Farm, LLC                   | Land Application                 | Now             | Industrial  | Land               | Oakwood Farm, LLC                   |             |             |            |   |
| R-5  | WVSG10066                     | Powell's Plumbing, Inc.             | Sludge/Septic Land Disposal (GP) | Renewed         | Sewage      | Land               | Powell's Plumbing, Inc.             |             |             |            |   |
| R-6  | WVG416065                     | Shannondale Apartments Building 1   | Home Aeration Unit General       | Now             | Sewage      | Land               | Shannondale Apartments, LLC         |             |             |            |   |
| R-7  | WVG416066                     | Shannondale Apartments Building 2   | Home Aeration Unit General       | Now             | Sewage      | Land               | Shannondale Apartments, LLC         |             |             |            |   |
| WEST VIRGINIA - ABOVE GROUND STORAGE TANKS |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |
| PSSC Number                                | REFERENCE ID                  | RESPONSIBLE                         | FACILITY Location                | TANK LABEL      | TANK STATUS | CAPACITY (gallons) | Class Level                         | Product     | COMMENTS    | SECONDARY  | SPILL PLAN                              |
|  |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |
|  |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |
|  |                               |                                     |                                  |                 |             |                    |                                     |             |             |            |   |

## APPENDIX B. EARLY WARNING MONITORING SYSTEM FORMS

### Select and Attach the Appropriate Form for Your System

**Form A** - Complete if you currently have an early warning monitoring system for a groundwater source.

**Form B** - Complete if you currently have an early warning monitoring system installed for a surface water source.

**Form C** - If you do not currently have an early warning monitoring system installed for a surface water intake or are planning to upgrade or replace your current system, complete this form.

**Form D** - If you do not currently have an early warning monitoring system installed for a groundwater source or are planning to upgrade or replace your current system, complete this form.

**Note:** You may need to fill out and attach more than one form to your Protection Plan, depending on your current situation.

## Appendix B - Form B

### Proposed Ground Monitoring Worksheet

|  |
|--|
| Describe the type of early warning detection equipment that could be installed, including design:  |
| The Utility has an existing Surface Scatter 6 continuous monitoring system for turbidity in the raw water at the treatment plant. It is possible to upgrade the HACH monitoring equipment to a newer version that would be capable of additional analytical monitoring capacity of pH, conductivity and dissolved oxygen in addition to turbidity. Approximate costs to upgrade would be approximately \$15,000  |
| Where would the equipment be located?:   |
| The current HACH Surface Scatter 6 is located at the water treatment plant. However, the Charles Town wet well structure at the intake is an ideal location to install an early warning detection system. The wet well is a cement structure with electrical service and an emergency power backup generator. The monitoring sensors can be installed in the wet well or in-line and the computer telemetry can be located in the pump area, which is elevated above the floodplain. The entire wet well structure is secure with a chain link fence and locked doors. |
| What would the maintenance plan for the monitoring equipment entail?:  |
| A service contract with HACH would enable an authorized HACH Technician to provide routine service on a quarterly basis to the monitoring equipment. This basic service contract would be approximately \$2,000 - \$3,000 per year with additional cost for replacement parts, if required.  |
| Describe the proposed sampling plan at the monitoring site:  |
| The online monitoring for pH, conductivity, dissolved oxygen and turbidity would be collected and logged on a 15 minutes interval and saved to the computer. The data would be reviewed by the operator on a daily basis to make adjustments to the treatment process.   |
| Describe the proposed procedures for data management and analysis:   |
| This upgrade would be installed at the water treatment plant in the raw water. Ideally, it would be better to have the raw water monitoring at the intake wet well location. Electronic computer data logging with alarms that can be set for pre-selected thresholds for each parameter. Alarms would alert the operator to a potential problem for further review.   |

## APPENDIX C. COMMUNICATION PLAN TEMPLATE

**Charles Town Utilities**

PWSID: WV3301905

Authorizing Signature: Daryl Hennessy

Contact Phone Number: (304)724-3280

Contact Email Address: ctwater@thfn.org

Plan Developed On: July 2021

### ACKNOWLEDGMENTS:

This plan was developed by [insert name, title of person completing plan, and who they work for] to meet certain requirements of the Source Water and Assessment Protection Program (SWAPP) and the Wellhead Protection Program (WHPP) for the State of West Virginia, as directed by the federal Safe Drinking Water Act (SDWA) and state laws and regulations.

## INTRODUCTION

---

Legislative Rule 64CSR3 requires public water systems to develop a Communication Plan that documents how public water suppliers, working in concert with state and local emergency response agencies, shall notify state and local health agencies and the public in the event of a spill or contamination event that poses a potential threat to public health and safety. The plan must indicate how the public water supplier will provide updated information, with an initial notification to the public to occur no later than thirty minutes after the supplier becomes aware that the spill, release or potential contamination of the public water system poses a potential threat to public health and safety.

The public water system has responsibility to communicate to the public, as well as to state and local health agencies. This plan is intended to comply with the requirements of Legislative Rule 64CSR3, and other state and federal regulations.

## TIERS REPORTING SYSTEM

---

This water system has elected to use the Tiered Incident / Event Reporting System (TIERS) for communicating with the public, agencies, the media, and other entities in the event of a spill or other incident that may threaten water quality. TIERS provides a multi-level notification framework, which escalates the communicated threat level commensurate with the drinking water system risks associated with a particular contamination incident or event. TIERS also includes a procedural flow chart illustrating key incident response communication functions and how they interface with overall event response / incident management actions. Finally, TIERS identifies the roles and responsibilities for key people involved in risk response, public notification, news media and other communication.

TIERS provides an easy-to-remember five-tiered **A-B-C-D-E** risk-based incident response communication format, as described below. Table 1 provides also associated risk levels.

**A = Announcement.** The water system is issuing an announcement to the public and public agencies about an incident or event that may pose a threat to water quality. Additional information will be provided as it becomes available. As always, if water system customers notice anything unusual about their water, they should contact the water system.

**B = Boil Water Advisory.** A boil water advisory has been issued by the water system. Customers may use the water for showering, bathing, and other non-potable uses, but should boil water used for drinking or cooking.

**C = Cannot Drink.** The water system asks that users not drink or cook with the water at this time. Non-potable uses, such as showering, bathing, cleaning, and outdoor uses are not affected.

**D = Do Not Use.** An incident or event has occurred affecting nearly all uses of the water. Do not use the water for drinking, cooking, showering, bathing, cleaning, or other tasks where water can come in contact with your skin. Water can be used for flushing commodes and fire protection.

**E = Emergency.** Water cannot be used for any reason.



| Tier | Tier Category       | Risk Level     | Tier Summary  |
|------|---------------------|----------------|---|
| A    | Announcement        | Low            | The water system is issuing an announcement to the public and public agencies about an incident or event that could pose a threat to public health and safety. Additional information will be provided as it becomes available. |
| B    | Boil Water Advisory | Moderate       | Water system users are advised to boil any water to be used for drinking or cooking, due to possible microbial contamination. The system operator will notify users when the boil water advisory is lifted.                     |
| C    | Cannot Drink        | High           | System users should not drink or cook with the water until further notice. The water can still be used for showering, bathing, cleaning, and other tasks.   |
| D    | Do Not Use          | Very High      | The water should only be used for flushing commodes and fire protection until further notice. More information on this notice will be provided as soon as it is available.  |
| E    | Emergency           | Extremely High | The water should not be used for any purpose until further notice. More information on this notice will be provided as soon as it is available.   |

## COMMUNICATION TEAM

The Communication Team for the water system is listed in the table below, along with key roles. In the event of a spill or other incident that may affect water quality, the water system spokesperson will provide initial information, until the team assembles (if necessary) to provide follow-up communication

Water system communication team members, organizations, and roles.

| Team Member Name | Organization           | Phone         | Email            |
|------------------|------------------------|---------------|------------------|
| Daryl Hennessy   | Charles Town Utilities | (304)724-3280 | ctwater@thfn.org |
| Pete Kubic       | Charles Town Utilities | (304)724-3280 | ctwater@thfn.org |

In the event of a spill, release, or other incident that may threaten water quality, members of the team who are available will coordinate with the management staff of the local water supplier to:

- Collect information needed to investigate, analyze, and characterize the incident/event
- Provide information to the management staff, so they can decide how to respond
- Assist the management staff in handling event response and communication duties
- Coordinate fully and seamlessly with the management staff to ensure response effectiveness

## COMMUNICATION TEAM DUTIES

The communication team will be responsible for working cooperatively with the management staff and state and local emergency response agencies to notify local health agencies and the public of the initial spill or contamination event. The team will also provide updated information related to any contamination or impairment of the source water supply or the system's drinking water supply.

According to Legislative Rule 64CSR3, the initial notification to the public will occur no later than thirty minutes after the public water system becomes aware that the spill, release or potential contamination of the public water system poses a potential threat to public health and safety.

As part of the group implementing the Source Water Protection Plan, team members are expected to be familiar with the plan, including incident/event response and communication tasks. Specifically, team members should:

- Be knowledgeable on elements of the Source Water Protection Plan and Communication Plan
- Attend team meetings to ensure up-to-date knowledge of the system and its functions
- Participate in periodic exercises that “game out” incident response and communication tasks
- Help to educate local officials, the media, and others on source water protection
- Cooperate with water supplier efforts to coordinate incident response communication
- Be prepared to respond to requests for field investigations of reported incidents
- Not speak on behalf of the water supplier unless designated as the system’s spokesperson

The primary spokesperson will be responsible for speaking on behalf of the water system to local agencies, the public, and the news media. The spokesperson should work with the management staff and the team to ensure that all communication is clear, accurate, timely, and consistent. The spokesperson may authorize and/or direct others to issue news releases or other information that has been approved by the system’s management staff. The spokesperson is expected to be on call immediately when an incident or event which may threaten water quality occurs. The spokesperson will perform the following tasks in the event of a spill, release, or other event that threatens water quality:

- Announce which risk level (A, B, C, D, or E) will apply to the public notifications that are issued
- Issue news releases, updates, and other information regarding the incident/event
- Use the news media, email, social media, and other appropriate information venues
- Ensure that news releases are sent to local health agencies and the public
- Respond to questions from the news media and others regarding the incident/event
- Appear at news conferences and interviews to explain incident response, etc.

## INCIDENT / EVENT COMMUNICATION PROCEDURE

---

The flow chart in this section illustrates how the water system will respond when it receives a report that a spill, release, or other contamination event may have occurred. Key elements of the flow chart are described below.

### **Communication with agencies, the public, and the media during threat incidents**

Upon initial notification of the incident/event, system managers and staff will collect information and verify the need for further investigation. Only properly trained personnel will perform onsite investigations if permitted by emergency responders. If further investigation is warranted, and the initial facts support it, the water system spokesperson will issue a public communication statement consistent with the threat level. In addition, water system personnel and partners will be dispatched to conduct reconnaissance, a threat assessment, and a threat characterization, if present. This work may include:

- Verification of the incident/event type (spill, release, etc.)
- Location of incident/event
- Type of material(s) involved in spill, release, etc.
- Quantity of material involved
- Potential of the material to move, migrate, or be transported
- Relevant time factor(s) in the risk assessment (e.g., downstream movement rate)
- Overall level of risk to water system, whether low, moderate, high, or very high
- Development of the initial risk characterization

As the flow chart indicates, several iterative cycles will occur after the initial threat assessment, including communication with local agencies and the public, further investigation of the incident, possible implementation of

the water system's contingency plan, and eventual elimination of the threat and a return to normal operations.

Communication activities during this period will include:

- The initial release (i.e., Announcement, Boil Water Advisory, Cannot Drink, Do Not Use, or Emergency)
  - Sent to local health agencies, the public, and the news media within 30 minutes
- Notification of the local water system's source water protection and communication teams
  - If warranted by initial findings regarding the spill, release, or incident
- Notification of the WV Bureau of Public Health
  - As required
- Periodic information updates, as incident response information is received
- Updates to the applicable A-B-C-D-E advisory tier, as necessary

If time permits and the need arises, after the threat level is reduced, and operations return to normal, the water system staff, the communication and source water protection teams, and their partners may conduct a post-event review and assessment. The purpose of the review is to examine the response to the incident, relevant communication activities, and overall outcomes. Plans and procedures may be updated, altered, or adapted based on lessons learned through this process.

## EMERGENCY SHORT FORMS

### Emergency Communication Information

|  | Name  | Phone                        | Email            |                       |
|--|---|------------------------------|------------------|-----------------------|
| Designated spokesperson:                                 | Daryl Hennessy  | (304)724-3280                | ctwater@thfn.org |                       |
| Alternate spokesperson:                                  | Pete Kubic  | (304)724-3280                | ctwater@thfn.org |                       |
| Designated location to disseminate information to media: | Charles Town Utility Board<br>661 South George Street, Suite 101<br>Charles Town, WV 25414      |                              |                  |                       |
| Method of Contact:                                       | Word of Mouth<br>Posted Notices<br>Door-to-door canvassing<br>radio<br>newspaper<br>Auto Dialer |                              |                  |                       |
| Media Contacts:  | Name  | Title                        | Phone Number     | Email                 |
|  | Bill Kohler, The Herald Mail  | Editor                       | (301)733-5131    | billk@herald-mail.com |
| The Journal  |   | (304)263-8931                |                  | Spirit of Jefferson   |
| Publisher  | (304)725-2046   | editor@spiritofjefferson.com | WRNR Radio       |                       |
| (304)263-6586  | info@talkradiornr.com   | WKMZ Radio                   |                  | (304)263-2770         |
|  | WEPM 1340   |                              | (304)263-8868    |                       |
| WYII   |   | (304)263-0637                |                  | WHAG Channel 25       |
|  | (301)797-4400   |                              | WLTF             |                       |

## Emergency Service Contacts

|           | Name  | Emergency Phone | Alternative Phone | Email                          |
|-----------|---|-----------------|-------------------|--------------------------------|
| Police    | WV State Police                                       | (911)___-___    | (304)725-9779     |                                |
| Fire      | Citizens Fire Company                                 | (911)___-___    | (304)725-2814     |                                |
| Ambulance | Jefferson County Ambulance Authority                  | (911)___-___    | (307)283-287_     |                                |
| Hazmat    | Stephen Allen,<br>Director JCOHSEM                    | (911)___-___    | (304)728-3290     | sallen@jeffersoncountywv.org   |
| Other     | Jefferson County Sheriff, Pete Dougherty              | (911)___-___    | (304)728-3205     | pdougherty@jcsdvw.com          |
| Other     | Charles Town Police Department, Chief William Roper   | (911)___-___    | (304)725-2714     | ckutcher@charlestownpolice.com |
| Other     | Charles Town Police Department, Captain Glenn Stevens | (911)___-___    | (304)725-2714     | gstevens@charlestownpolice.com |

## Sensitive Populations

|   |   |   |                       |                 |                           |
|---|---|---|-----------------------|-----------------|---------------------------|
| Other Communities that are served by the Utility:               | Hospital, Nursing Homes, City of Ranson, Jefferson County Schools, and Charles Town Races |   |                       |                 |                           |
| Major User/Sensitive Population Notification                    | Name  | Emergency Phone                                   | Alternative Phone     | Email           |                           |
|   | Jefferson Memorial Hospital   |   | (304)728-1600         |                 |                           |
|   | Blue Ridge Care & Rehabilitation Center/Willowtree Manor                                  |   | (304)725-6575         |                 |                           |
|   | Genesis healthcare/Shenandoah Health Village Center                                       |   | (304)724-1101         |                 |                           |
|   | City of Ranson Andy Blake City Manager  |   | (304)724-1101         |                 |                           |
|   | Wright Denny School, Charles Town Middle (Jefferson County Schools) Ralph Dinges          |   | (304)725-2513         |                 |                           |
|   | Charles Town Races Donald Godfrey   |   | (304)886-9749         |                 |                           |
| EED District Office Contact                                     | Name  | Phone   | Email                 |                 |                           |
|   | Alan Marchun  | (304)725-9453                                     | alan.f.marchun@wv.gov |                 |                           |
| OEHS Readiness Coordinator                                      | Lee Orr   | (304)356-4290                                     |                       |                 |                           |
| Downstream Water System Contacts                                | Water System Name   | Contact Name                                      | Emergency Phone       | Alternate Phone | Email                     |
|   | City of Brunswick, MD   | Patrick Hoffmaster                                |                       | (301)834-7671   |                           |
|   | City of Fredrick, MD  | Ben Arneson (Superintendent of Water Maintenance) |                       | (301)600-1681   | susans@cityoffredrick.com |
|   | Sandy Hook Water System   | Kim Bowers  |                       | (240)313-2600   |                           |
|   | Petersville, MD   |   |                       | (301)834-7500   |                           |
| Are you planning on implementing the TIER Communications plan?: |   |   | Yes                   |                 |                           |

### Emergency Service Key Staff Members

|  | Name              | Title           | Phone         | Email                 |
|--|-------------------|-----------------|---------------|-----------------------|
| Key Staff Responsible for Coordinating Emergency Response Procedures:                              | Kristen Stolipher | Utility Manager | (304)724-3280 |                       |
| kstolipher@ctubwv.com  | Chris Hutzler     | Chief Operator  | (304)725-3761 | chutzler@ctubwv.com   |
| Staff Responsible for Keeping Confidential PSSC Information and Releasing to Emergency Responders. | Kristen Stolipher | Utility Manager | (304)724-3280 | kstolipher@ctubwv.com |

## Emergency Response Information

|  |                        |               |
|--|------------------------|---------------|
| List Laboratories available to perform sample analysis in case of emergency.   | <b>Name</b>            | <b>Phone</b>  |
|  | HydroChem Laboratories | (304)725-6174 |
|  | Pace Analytical        | (877)859-7778 |
| Has utility developed a detailed Emergency Response Plan in accordance with the Public Health Security Bioterrorism preparedness and Response Plan Act of 2002 that covers the following areas?: | Yes                    |               |
| When was the emergency response plan developed or last updated?:   | 2016                   |               |

## EMERGENCY CONTACT INFORMATION

---

**State Emergency Spill Notification**

1-800-642-3074

**Office of Emergency Services**<http://www.wvdhsem.gov/>

Charleston, WV- (304) 558-5380

**WV Bureau for Public Health Office of Environmental Health Services (OEHS)**[www.wvdhhr.org/oehs](http://www.wvdhhr.org/oehs)**Readiness Coordinator - Lee Orr**

Phone: 304-356-4290

Cell: 304-550-5607

E-mail: [Lee.E.Orr@wv.gov](mailto:Lee.E.Orr@wv.gov)**Environmental Engineering Division Staff**

Charleston, Central Office (304) 558-2981

Beckley, District 1 (304) 256-6666

St. Albans, District 2 (304) 722-0611

Kearneysville, District 4 (304) 725-9453

Wheeling, District 5 (304) 238-1145

Fairmont, District 6 (304) 368-2530

**National Response Center - Chemical, Oil, & Chemical/Biological Terrorism**

1-800-424-8802

**WV State Fire Marshal's Office**

1-800-233-3473

**West Virginia State Police**

1-304-746-2100

**WV Watch – Report Suspicious Activity**

1-866-989-2824

**DEP Distance Calculator**<http://tagis.dep.wv.gov/pswicheck/>



## PRESS RELEASE ATTACHMENTS

---

TIERS Levels A, B, C, D, and E

**UTILITY ISSUED NOTICE – LEVEL A  
PUBLIC WATER SYSTEM ANNOUNCEMENT  
A WATER SYSTEM INVESTIGATION IS UNDERWAY**

On \_\_\_\_\_ at \_\_\_\_:\_\_\_\_ AM/PM, the \_\_\_\_\_ Water System began investigating an incident that may affect local water quality.

The incident involves the following situation at this location:

---

---

---

There are no restrictions on water use at this time. As always, if water system customers notice anything unusual about their water – such as abnormal odors, colors, sheen, etc. – they should contact the water system at \_\_\_\_\_.

At this time there is no need for concern if you have consumed or used the water.

Regular updates will be provided about this Announcement as water system staff continue their investigation. Again, there are no restrictions on water use at this time.

State Water System ID# \_\_\_\_\_ Date Distributed: \_\_\_\_\_

UTILITY ISSUED NOTICE – LEVEL B  
BOIL WATER ADVISORY  
A BOIL WATER ADVISORY IS IN EFFECT

On \_\_\_\_\_ at \_\_\_\_:\_\_\_\_ am/pm, a water problem occurred causing contamination of your water. The areas that are affected are as follows:

Entire Water System or  Other: \_\_\_\_\_  
\_\_\_\_\_

CONDITIONS INDICATE THERE IS A HIGH PROBABILITY THAT YOUR WATER IS CONTAMINATED. TESTING HAS NOT OCCURRED TO CONFIRM OR DENY THE PRESENCE OF CONTAMINATION IN YOUR WATER.

What should I do?

- **DO NOT DRINK THE WATER WITHOUT BOILING IT FIRST.** Bring all water to a boil, let it boil for one minute, and let it cool before using, or use bottled water. Boiled or bottled water should be used for drinking, making ice, brushing teeth, washing dishes, bathing, and food preparation until further notice. Boiling kills bacteria and other organisms in the water.

What happened?

- The problem is related to \_\_\_\_\_

What is being done?

- The water system is taking the following action: \_\_\_\_\_  
\_\_\_\_\_

What should a customer do if they have consumed or used the water?

- \_\_\_\_\_

We will inform you when you no longer need to boil your water. We anticipate resolving the problem within \_\_\_\_\_ hours/days. For more information, please contact \_\_\_\_\_ at \_\_\_\_\_ or \_\_\_\_\_ at \_\_\_\_\_.

General guidelines on ways to lessen the health risk are available from the EPA Safe Drinking Water Hotline at 1 (800) 426-4791.

*Please share this information others who use this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.*

This notice was distributed by \_\_\_\_\_

State Water System ID# \_\_\_\_\_ Date Distributed: \_\_\_\_\_

UTILITY ISSUED NOTICE – LEVEL C  
“CANNOT DRINK” WATER NOTIFICATION  
A LEVEL C WATER ADVISORY IS IN EFFECT

On \_\_\_\_\_ at \_\_\_\_:\_\_\_\_ am/pm, a water problem occurred causing contamination of your water. The areas that are affected are as follows:

Entire Water System or  Other: \_\_\_\_\_  
\_\_\_\_\_

CONDITIONS INDICATE THERE IS A HIGH PROBABILITY THAT YOUR WATER IS CONTAMINATED. TESTING HAS NOT OCCURRED TO CONFIRM OR DENY THE PRESENCE OF CONTAMINATION IN YOUR WATER.

**What should I do?**

- **DO NOT DRINK THE WATER.** You can't drink the water, but you can use it for showering, bathing, toilet-flushing, and other non-potable purposes.
- **BOILING WILL NOT PURIFY THE WATER.** Do not drink the water, even if it is boiled.

**What happened?**

- The problem is related to \_\_\_\_\_

**What is being done?**

- The water system is taking the following action: \_\_\_\_\_  
\_\_\_\_\_

**What should a customer do if they have consumed or used the water?**

- \_\_\_\_\_

We will inform you when the water is safe to drink. We anticipate resolving the problem within \_\_\_\_\_ hours/days. For more information – or to report unusual water conditions such as abnormal odors, colors, sheen, etc. – please contact \_\_\_\_\_ at \_\_\_\_\_ or \_\_\_\_\_ at \_\_\_\_\_.

General guidelines on ways to lessen the health risk are available from the EPA Safe Drinking Water Hotline at 1 (800) 426-4791.

*Please share this information others who use this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.*

This notice was distributed by \_\_\_\_\_

State Water System ID# \_\_\_\_\_ Date Distributed: \_\_\_\_\_

UTILITY ISSUED NOTICE – LEVEL D  
“DO NOT USE” WATER NOTIFICATION  
A LEVEL D WATER ADVISORY IS IN EFFECT

On \_\_\_\_\_ at \_\_\_\_:\_\_\_\_ am/pm, a water problem occurred causing contamination of your water. The areas that are affected are as follows:

Entire Water System or  Other: \_\_\_\_\_  
\_\_\_\_\_

CONDITIONS INDICATE THERE IS A HIGH PROBABILITY THAT YOUR WATER IS CONTAMINATED. TESTING HAS NOT OCCURRED TO CONFIRM OR DENY THE PRESENCE OF CONTAMINATION IN YOUR WATER.

What should I do?

- **DO NOT DRINK THE WATER.** The water is contaminated.
- **DO NOT SHOWER OR BATHE IN THE WATER.** You can't use the water for drinking, showering, or bathing. It can be used for toilet flushing and firefighting.
- **BOILING WILL NOT PURIFY THE WATER.** Do not use the water, even if it is boiled. The type of contamination suspected is not removed by boiling.

What happened?

- The problem is related to \_\_\_\_\_

What is being done?

- The water system is taking the following action: \_\_\_\_\_  
\_\_\_\_\_

What should a customer do if they have consumed or used the water?

- \_\_\_\_\_

We will inform you when the water is safe to drink. We anticipate resolving the problem within \_\_\_\_\_ hours/days. For more information – or to report unusual water conditions such as abnormal odors, colors, sheen, etc. – please contact \_\_\_\_\_ at \_\_\_\_\_ or \_\_\_\_\_ at \_\_\_\_\_.

*Please share this information others who use this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.*

This notice was distributed by \_\_\_\_\_

State Water System ID# \_\_\_\_\_ Date Distributed: \_\_\_\_\_

UTILITY ISSUED NOTICE – LEVEL E  
EMERGENCY WATER NOTIFICATION  
A LEVEL E WATER ADVISORY IS IN EFFECT

On \_\_\_\_\_ at \_\_\_\_:\_\_\_\_ am/pm, a water problem occurred causing contamination of your water. The areas that are affected are as follows:

Entire Water System or  Other: \_\_\_\_\_  
\_\_\_\_\_

CONDITIONS INDICATE THERE IS A HIGH PROBABILITY THAT YOUR WATER IS CONTAMINATED. TESTING HAS NOT OCCURRED TO CONFIRM OR DENY THE PRESENCE OF CONTAMINATION IN YOUR WATER.

What should I do?

- **DO NOT DRINK THE WATER.** The water is contaminated.
- **DO NOT USE THE WATER FOR ANY PURPOSE!** You can't use the water for drinking, showering, or bathing, or any other use – not even for toilet flushing.
- **BOILING WILL NOT PURIFY THE WATER.** Do not use the water, even if it is boiled. The type of contamination suspected is not removed by boiling.

What happened?

- The problem is related to \_\_\_\_\_

What is being done?

- The water system is taking the following action: \_\_\_\_\_  
\_\_\_\_\_

What should a customer do if they have consumed or used the water?

- \_\_\_\_\_

We will inform you when the water is safe to drink. We anticipate resolving the problem within \_\_\_\_\_ hours/days. For more information – or to report unusual water conditions such as abnormal odors, colors, sheen, etc. – please contact \_\_\_\_\_ at \_\_\_\_\_ or \_\_\_\_\_ at \_\_\_\_\_.

*Please share this information others who use this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.*

This notice was distributed by \_\_\_\_\_

State Water System ID# \_\_\_\_\_ Date Distributed: \_\_\_\_\_

## APPENDIX D. SINGLE SOURCE FEASIBILITY

### Water Source Alternative:

| Did not complete the alternative source study        |   |
|--|---|
| Name of Alternative:                                 | Installed 1,000,000 gallon finished water tank. |
| Brief Description of the Alternative:                | Installed 1,000,000 gallon finished water tank. |
| Feasible?:   | No  |
| Provide Cost Estimate:                               | \$0   |
| Would this alternative supply 100% of your needs?:   | No  |
| Economic Criteria - Operation and Maintenance Costs: | 0   |
| Economic Criteria - Capital Cost:                    | 0   |
| Technical Criteria - Permitting:                     | 0   |
| Technical Criteria - Flexibility:                    | 0   |
| Technical Criteria - Resilience:                     | 0   |
| Technical Criteria - Institutional Requirements:     | 0   |
| Environmental Criteria - Environmental Impacts:      | 0   |
| Environmental Criteria - Aesthetic Impacts:          | 0   |
| Environmental Criteria - Stakeholder Issues:         | 0   |
| Final Score:   | 0.00%   |

## Feasibility Study Narrative

**Charles Town Utility Board Feasibility Study Summary****By TERRADON Corporation**

TERRADON Corporation was contracted by the Region 9 Economic Development Council to conduct the Feasibility Study for the Charles Town Utility Board (CTUB) Source Water Protection Plan. Sam Wilkes, MS and Jim Nagy, PE of TERRADON conducted an on-site meeting with Jane Arnett (General Manager) and Darrell Viands (Chief Operator) on February 16 and 17, 2016. During our meeting, the basic challenges, difficulties and feasibility of the following options were discussed and evaluated.

**○ Backup Raw Water Intake**

The Millville Quarry, which contains a large freshwater impoundment, is located approximately 3.4 miles northeast of the Charles Town Water Treatment Plant. A new 12" raw water line would need to be constructed between the quarry and the water treatment plant. It would also be necessary to construct an intake structure and raw water pump station at the quarry. The challenges of this option are right of way acquisition and working out an agreement with the quarry, as well as the excessive cost to construct almost three and a half miles of raw water line to the WTP, an intake structure, and raw water pumping station. Due to costs and logistics, this alternative is deemed to be not feasible. Cost of this alternative is estimated to be \$1,175,000.

**○ Interconnection with Neighboring Public Water Supplies**

The neighboring public water supplies adjacent to CTUB utilize groundwater as the source of their drinking water, and provide disinfection with chlorine. CTUB on the other hand uses the Shenandoah River as its source and provides disinfection with chloramines. Combining groundwater that has been disinfected with chlorine, with surface water that has been disinfected with chloramines can cause problems in the distribution system. Preliminary discussions with WVDHHR have indicated that there are a number of variables that may need to be addressed, and that it may be necessary to provide treatment at the location of the interconnection to enable blending of water into the system. The additional expense of adding treatment at the location of the interconnection makes this option unfeasible. Therefore, it was not carried any further through the evaluation process. Cost for the actual interconnection itself would be approximately \$5,000, and the meter vault be is estimated to be about \$25,000. Cost for treatment components that may be required cannot be determined without further investigation.

**○ Treated Water Storage**

Charles Town Utility Board has completed the financing, design and other technical components of establishing a 1M gallon finished water storage tank at the Water Treatment Plant. This capital improvement project is scheduled to go to construction during 2016. This project has been funded at a cost of \$865,000 and will satisfy the requirements of Senate Bill 373 by providing the system with 2.4 days of finished water storage. Therefore this option was not evaluated further in this feasibility analysis.

**○ Raw Water Storage**

This scenario examines the feasibility of constructing a raw water impoundment adjacent to the WTP. Raw water from the Shenandoah River would be pumped into the pond, which could be used in the event of a water contamination problem with the Shenandoah River. The pond should be sized to provide approximately 2.5 days of water at the maximum daily usage. Combined with the finished water storage of the system (after the new water storage tank at the WTP is completed), CTUB would be able to avoid withdrawing water from the Shenandoah River for about five days. This should be long enough to get through any conceivable emergency that may occur. Major advantages to this option are that the pond

78

would be out of the floodplain, and the existing raw water pumps could be used to fill the pond. Disadvantages to this plan would be the cost of obtaining property next to the WTP, the cost of new raw pumps at the impoundment, and maintaining raw water circulation and quality in the pond. A rough estimate of the cost for this alternative is \$950,000.

○ **Establish Groundwater Well(s) at the Water Treatment Plant**

Another option is to install a groundwater well(s) at the water treatment plant that can be used in the event of an emergency. This option has been considered in the past; however, there may be problems with water quantity/quality. It would be necessary to drill a test well in order to determine if this option is viable. Only minor modifications, if any, should be required to the treatment process, keeping in mind that the well(s) would be for emergency use only. The main challenges with this option are if the well or wells will have enough volume to supply the system and the potential for treatment problems if the well water contains arsenic or nitrates. Cost for a test well would be \$15,000 to \$30,000. Further investigation would be needed in order to cost a production well or wells.

○ **Temporary Water Intake on Evitts Run**

Initially, a temporary emergency water intake on Evitts Run was considered. However, after researching this option further, it was quickly ruled out due to the Charles Town Waste Water Plant being located approximately 4.5 miles upstream along Evitts Run. Public perception and WVDHHR permitting would be the main challenges to this option. This option was not evaluated any further.

The additional 1M gallon treated storage tank will allow Charles Town Utility Board to be compliant with Senate Bill 373 requirements. Based on the feasibility analysis conducted the other alternatives are too costly, as well as technically challenging to warrant implementation at this time. Continuing to work on improvements to the distribution system to reduce unaccounted for water is the next most cost effective solution (after construction of the additional finished water storage) to provide further system reliability. However, as system demand increases the raw water storage option, as well as the interconnection, should be evaluated further to provide CTUB with other alternatives to meet their needs.



Matrix Document

Completed By: James Nagy, PE, TERRADON Corporation

Date: 4/25/11

PWSID: WV3301905

Charles Town Utilities

| Alternative Strategy Description | Economic Criteria               |               |       |                | Technical Criteria |             |            |               | Environmental Criteria |       |         |                | Final Score | Total Capital Cost | Comments |                       |                   |                    |             |   |
|----------------------------------|---------------------------------|---------------|-------|----------------|--------------------|-------------|------------|---------------|------------------------|-------|---------|----------------|-------------|--------------------|----------|-----------------------|-------------------|--------------------|-------------|---|
|                                  | Operation and Maintenance Costs | Capital Costs | Total | Weighted Total | Permitting         | Flexibility | Resilience | Institutional | Requirements           | Total | Total % | Weighted Total |             |                    |          | Environmental Impacts | Aesthetic Impacts | Stakeholder Issues | Total       | Total %   |
| Backup Intake                    | 1.0                             | 0.0           | 1.0   | 16.7%          | 6.7%               | 1.6         | 1.5        | 2.0           | 2.3                    | 7.4   | 61.9%   | 24.8%          | 3.0         | 3.0                | 2.0      | 8.0                   | 88.9%             | 17.8%              | #####       | This is a backup emergency intake at Millville Quarry with approximately 17,500 feet of raw water main to the WTP.  |
| Interconnect                     | 1.0                             | 1.0           | 2.0   | 33.3%          | 13.3%              | 2.0         | 0.0        | 2.0           | 3.0                    | 7.0   | 58.3%   | 23.3%          | 3.0         | 2.5                | 3.0      | 8.5                   | 94.4%             | 18.9%              | \$30,000.0  | Neighboring systems are groundwater systems. It may be difficult to mix surface and groundwater within the distribution system.                                       |
| Treated water storage            | 3.0                             | 3.0           | 6.0   | 100.0%         | 40.0%              | 3.0         | 3.0        | 3.0           | 3.0                    | 12.0  | 100.0%  | 40.0%          | 3.0         | 3.0                | 3.0      | 9.0                   | 100.0%            | 20.0%              | \$865,000.0 | Charles Town is in the process of adding 1M gallons of additional storage at the Treatment Plant. This project has been bid and should be go to construction in 2016. |
| Raw Water Storage                | 2.0                             | 2.0           | 4.0   | 66.7%          | 26.7%              | 2.0         | 2.0        | 1.7           | 2.0                    | 7.7   | 63.9%   | 25.6%          | 3.0         | 2.5                | 1.3      | 6.8                   | 75.9%             | 15.2%              | \$950,000.0 | This is a reasonable alternative however property acquisition could be a barrier.   |
| Well(s) at Water Treatment Plant | 2.0                             | 1.0           | 3.0   | 50.0%          | 20.0%              | 2.0         | 2.0        | 2.0           | 3.0                    | 9.0   | 75.0%   | 30.0%          | 3.0         | 3.0                | 3.0      | 9.0                   | 100.0%            | 20.0%              | \$30,000.0  | Further investigation would be needed in order to determine if this alternative is practical.   |

Scoring:

- 0 – Not feasible. Criterion cannot be met by this alternative and removes the alternative from further consideration.
- 1 – Feasible but difficult. Criterion represents a significant barrier to successful implementation but does not eliminate it from consideration.
- 2 – Feasible. Criterion can be met by the alternative.
- 3 – Very Feasible. Criterion can be easily met by the alternative



| Criteria                                    | Question   | Backup Intake   | Feasibility | Interconnect  | Feasibility | Treated Water Storage  | Feasibility | Raw Water Storage   | Feasibility | Well(s) at Water Treatment Plant  | Feasibility |
|---|--|---|-------------|---|-------------|--|-------------|---|-------------|---|-------------|
| Resilience                                  | Will the alternative provide any advantages or disadvantages to meeting seasonal changes in demand?  | No  | 3           | No  | 2           | Yes  | 3           | Yes   | 2           | Yes   | 3           |
|   | How resilient will the alternative be to extreme weather conditions such as drought and flooding?  | No, the emergency intake will be vulnerable to extreme weather and potential washouts.                          | 1           | NA  | 2           | Resilient  | 3           | Resilient   | 2           | Intermediate Feasible   | 2           |
|   | Will the alternative be expandable to meet the growing needs of the service area?  | No  | 2           | NA  | 2           | Additional finished water storage can easily be added as necessary to meet demand  | 3           | Yes   | 1           | Unknown   | 1           |
| <b>Resilience-Feasibility Score</b>         |  |   | <b>2.0</b>  |   | <b>2.0</b>  |  | <b>3.0</b>  |   | <b>1.7</b>  |   | <b>2.0</b>  |
| Institutional Requirements                  | Identify any agreements or other legal instruments with governmental entities, private institutions or other PWSU required to implement the alternative. | None  | 3           | NA  | 3           | None   | 3           | Unknown   | 2           | None  | 3           |
|   | Are any development/planning restrictions in place that can act as a barrier to the implementation of the alternative?                                   | Unknown   | 2           | NA  | 3           | No   | 3           | Unknown   | 2           | No  | 3           |
| Environmental Impacts                       | Identify potential land acquisitions and easements requirements.   | Land acquisitions and easements for intake, pumping station, and raw water pipeline                             | 2           | NA  | 3           | None   | 3           | Land acquisition would be necessary   | 2           | None  | 3           |
|   | <b>Institutional Requirements-Feasibility Score</b>  |   | <b>2.3</b>  |   | <b>3.0</b>  |  | <b>3.0</b>  |   | <b>2.0</b>  |   | <b>3.0</b>  |
| Environmental Impacts                       | Identify any environmentally protected areas or habitats that might be impacted by the alternative.  | None  | 3           | NA  | 3           | None   | 3           | None  | 3           | None  | 3           |
|   | <b>Environmental Impacts-Feasibility Score</b>   |   | <b>3.0</b>  |   | <b>3.0</b>  |  | <b>3.0</b>  |   | <b>3.0</b>  |   | <b>3.0</b>  |
| Aesthetic Impacts                           | Identify any visual or noise issues caused by the alternative that may affect local land uses?   | Minimal   | 3           | NA  | 2           | Slight visual impact   | 3           | Slight visual impact  | 2           | None  | 3           |
|   | Identify any mitigation measures that will be required to address aesthetic impacts?   | Potential stream crossings  | 3           | NA  | 3           | None   | 3           | None  | 3           | None  | 3           |
| Stakeholder Issues                          | <b>Aesthetic Impacts-Feasibility Score</b>   |   | <b>3.0</b>  |   | <b>2.5</b>  |  | <b>3.0</b>  |   | <b>2.5</b>  |   | <b>3.0</b>  |
|   | Identify the potential stakeholders affected by the alternative.   | Landowners and DCH  | 2           | NA  | 3           | None   | 3           | Adjacent property owner(s)  | 2           | NA  | 3           |
| Stakeholder Issues                          | Identify the potential issues with stakeholders for and against the alternative.   | None  | 2           | NA  | 3           | None   | 3           | Unknown   | 1           | NA  | 3           |
|   | Will stakeholder concerns represent a significant barrier to implementation (or assistance) of the alternative?  | No  | 2           | NA  | 3           | No   | 3           | Unknown   | 1           | NA  | 3           |
| <b>Stakeholder Issues-Feasibility Score</b> |  |   | <b>2.0</b>  |   | <b>3.0</b>  |  | <b>3.0</b>  |   | <b>1.3</b>  |   | <b>3.0</b>  |
| Comments                                    |  | This is a backup emergency intake at Middle Church with approximately 12,500 feet of raw water main to the WTP. |             | Neighboring systems are groundwater systems. It may be difficult to mix surface and groundwater within the distribution system. |             | Charles Town is in the process of adding 100 gallons of additional storage at the Treatment Plant. This project has been bid and should be go to construction in 2016. |             | This is a reasonable alternative however property acquisition could be a barrier. |             | Further investigation would be needed in order to determine if this alternative is practical. |             |

Instructions: Using the expanded instructions in the "FEASIBILITY STUDY GUIDANCE DOCUMENT", complete the white and gray input cells. Rank each criteria based on the evidence provided and best professional judgment. Rank the criteria 0-3, assuming 0=not feasible and 3=most feasible. The password to edit fillable cells is "swpp".

**SCORES:**  
 0 – Not feasible. Criterion cannot be met by this alternative and removes the alternative from further consideration.  
 1 – Feasible but difficult. Criterion represents a significant barrier to successful implementation but does not eliminate it from consideration.  
 2 – Feasible. Criterion can be met by the alternative.

| Criteria | Question | Backup Intake | Feasibility | Interconnect | Feasibility | Treated Water Storage | Feasibility | Raw Water Storage | Feasibility | Well(s) at Water Treatment Plant | Feasibility |
|----------|----------|---------------|-------------|--------------|-------------|-----------------------|-------------|-------------------|-------------|----------------------------------|-------------|
|----------|----------|---------------|-------------|--------------|-------------|-----------------------|-------------|-------------------|-------------|----------------------------------|-------------|

3 - Very Feasible. Criterion can be easily met by the alternative

## APPENDIX E. SUPPORTING DOCUMENTATION