


First real life tests of a Vortex Water Machine



The Challenge: Raw sewage from a septic field was mixed with dechlorinated water & incubated at 105°F for 72 hours. (A very smelly affair!)

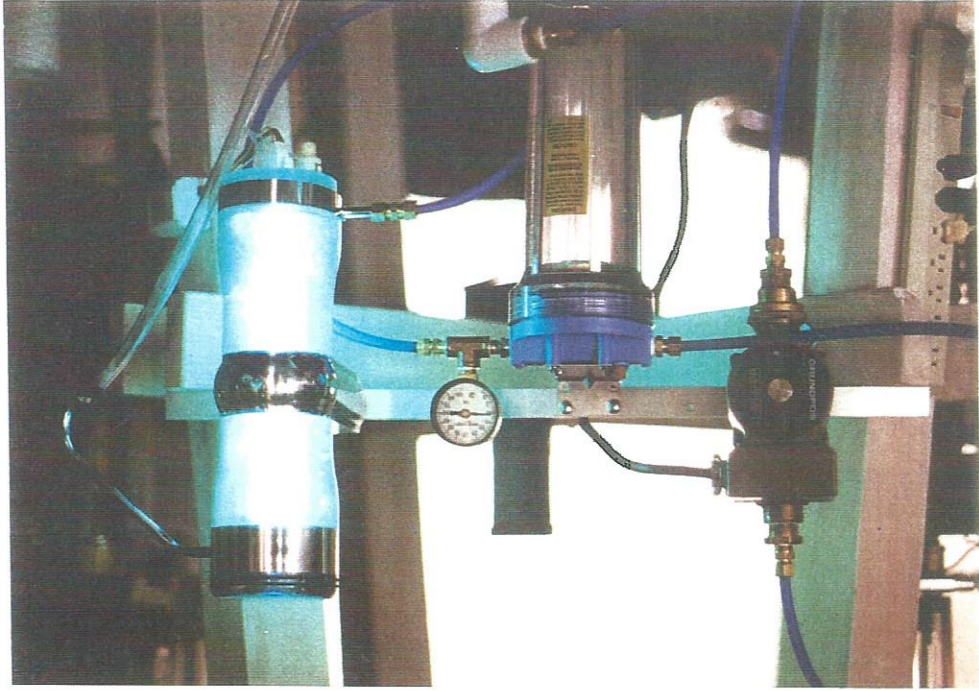

The Lab Results: The untreated water was laden with fecal coliform "too numerous to count"

The Vortex treated water was a 100% coliform free, in each sample better than Prescott municipal water, and in one sample totally sterile.