

Septic Inspection



Interior Exterior Home Inspection, Inc.

Inspector: Seth Larman

Lic# 70002235

PO Box 639

Choctaw, OK 73020

Phone: (405) 534-7366

Email: seth@inexhomeinspection.com

Sample Report





Septic Inspection

Site Conditions

Date: Sample Report


Time: 4:00 PM

Weather: Dry

Temp: 72

- Material: **Concrete**
- Type: Aerobic
- Riser Watertight: **YES**
- Are Risers Damage Free: **YES**
- Is septic tank readily accessible: **YES**
- Was the septic tank Clean out clear of debris: **YES**
- Was the ground dry around septic tank: **YES**
- Stress test done: **YES**
- Scum Layer: New Tank
- Sludge Layer: New Tank
- Wall Conditions: Serviceable
- Leach Field Dry: Yes (Aerobic System)
- Was the septic tank operational during the inspection: **YES**
- Septic tank Maintenance: Recommend household bleach to the bleach port every month.

Location

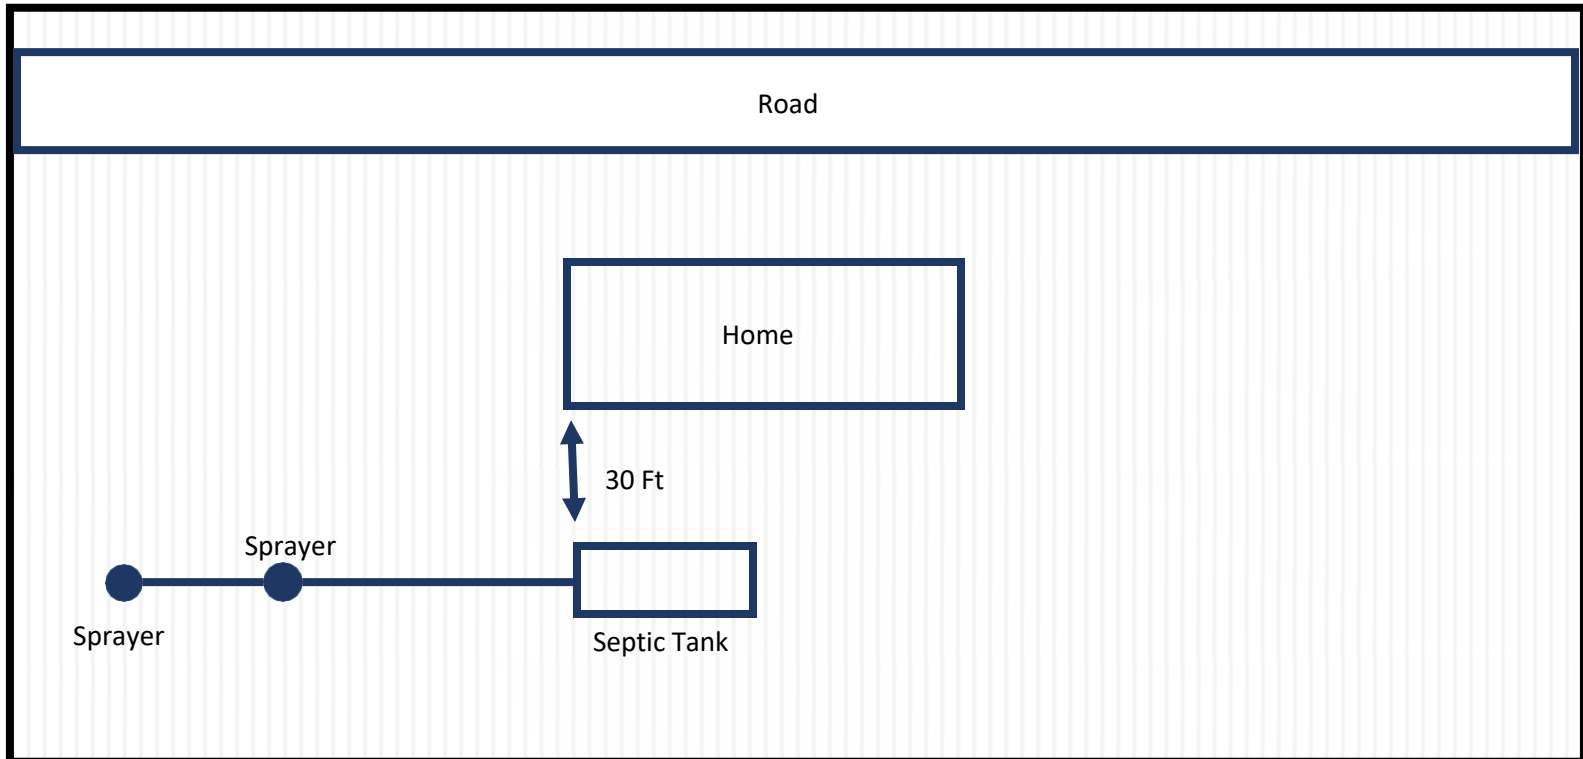

Septic Inspection



- Septic Tank Location



- Bleach Port



- Cleanout

Septic Inspection



- Chambers



- Sprayer Locations