

CBA38MV

DAVE LENNOX SIGNATURE® COLLECTION R-410A Ready - Multi-Position - Variable Speed - 60 Hz

Bulletin No. 210803 February 2023 Supersedes November 2022










Nominal Capacity - 1.5 to 5 Tons Optional Electric Heat - 4 to 25 kW

MODEL NUMBER IDENTIFICATION CB A 38 MV- 018/024 - 230 - 6 - 01 Unit Type Minor Revision Number CB = Air Handler **Refrigerant Metering Device** Refrigerant Type 6 = TXV - R-410A Non-bleedport (indoor unit) A = Aluminum Coil / R-410A Voltage 230 = 208/230V-60hz-1ph Series _ Configuration . **Nominal Cooling Capacity - Tons** MV = Multi-Position, Variable 018/024 = 1.5 to 2 tons030 = 2.5 tonsSpeed Blower Motor 036 = 3 tons042 = 3.5 tons048 = 4 tons 060 = 5 tons

FEATURE HIGHLIGHTS

- 1. Quantum™ Coil
- 2. Refrigerant Line Connections
- 3. Check and Expansion Valve
- 4. Heavy Gauge Steel Two-Piece Cabinet
- 5. Dual Position Drain Pans
- 6. Air Filter
- 7. Variable Blower Motor
- 8. Lennox® Communicating Control
- 9. Transformer
- 10. Electric Heat (option)

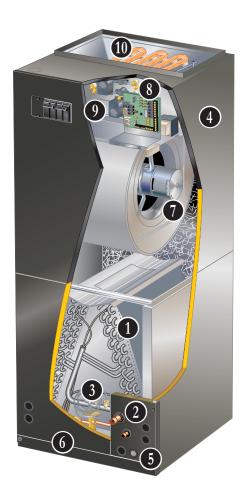

CONTENTS

Approvals And Warranty
Blower Data
Dimensions - Accessories
Dimensions - Unit
Electrical Data
Electric Heat Data
Features
nstallation Clearances With Electric Heat
Optional Accessories - Order Separately
Replacement Circuit Breakers
Specifications

APPROVALS AND WARRANTY

APPROVALS

- Tested with matching air conditioners and heat pump units in the Lennox Research Laboratory environmental test room in accordance with AHRI Standard 210/240
- AHRI Certified system match-ups and expanded ratings, visit www.LennoxPros.com
- ETL Listed to US and Canadian safety standards and components within are bonded for grounding to meet safety standards for servicing required by NEC and CEC
- Optional electric heaters are ETL listed and rated in accordance with US Department of Energy (DOE) test procedures and Federal Trade Commission (FTC) labeling regulations
- · Blower performance data according to unit tests conducted in Lennox air test chamber
- · Approved for installation in manufactured housing and mobile homes
- ISO 9001 Registered Manufacturing Quality System

WARRANTY

- All covered components
 - · Limited ten years in residential applications
 - · Limited one year in non-residential applications

NOTE - Refer to Lennox® Basic Limited Warranty at www.Lennox.com for additional details.

FEATURES

APPLICATIONS

- 1.5 to 5 ton nominal sizes
- Multi-position (upflow, downflow or horizontal) applications
- Applicable to expansion valve systems in R-410A cooling applications and check and expansion valve systems in R-410A heat pump applications
- Wide-range check and expansion valve is factory installed
- Applicable to Lennox® Smart Zoning System
- Optional field installed electric heaters available in several sizes for additive heating capacity

ZONING APPLICATIONS

- Units can be used with certain zoning systems.
 Zone control panel MUST be able to interface and communicate with the variable speed motor in the unit.
- Lennox® Smart Zoning System has this capability

REFRIGERANT SYSTEM

- 1 Quantum™ Coil
 - Lennox designed and fabricated coil
 - Enhanced aluminum alloy tube/enhanced fin coil for superior corrosion resistance
 - Aluminum tubing, hairpins, distributor and header tubes.
 - Ripple-edged aluminum fins
 - Twin coil construction assembled in a "A" configuration for large surface area
 - Provides excellent heat transfer and low air resistance for maximum efficiency
 - Precise circuiting for uniform refrigerant distribution
 - Lanced fins provide maximum exposure of fin surface to air stream
 - Rifled tubing provides superior heat transfer

 Coil thoroughly factory tested under high pressure to ensure leakproof construction

2 Refrigerant Line Connections

- Copper refrigerant sweat connections on both liquid and suction lines for easy brazing.
- Lines extend outside of the cabinet for ease of connection.
- See dimension drawings for locations

3 Check and Expansion Valve Furnished

- For use with R-410A systems
- · Wide range valve with Chatleff style fitting
- · Factory installed on all models, internal to cabinet

CABINET

- 4 · Constructed of heavy-gauge galvanized steel
 - Completely insulated with thick fiberglass insulation
 - Pre-painted steel cabinets have mildly textured enamel finish with primer coat on unpainted side of all panels
 - Units are shipped in one piece but may be disassembled into two separate sections for ease of installation in tight applications
 - Thick rubber gasket between sections of the two piece cabinets provides an air tight seal
 - No external screw heads on sides of cabinet for tight installations without damage to walls or woodwork
 - Removable panels provide complete service access
 - · Electrical inlets provided in sides and top of cabinet
 - See dimension drawings for locations

Low Leakage Cabinet

 All models have less than 2% air leakage and meet ANSI/ASHRAE Standard 193-2010 "Method of Test for Determining the Air Tightness of HVAC Equipment"

CABINET (continued)

Multi-Position Capability

- · Shipped for upflow and horizontal right-hand discharge
- Quickly converted to downflow or left-hand, horizontal air discharge
- Easily converts to downflow position with furnished coil support rails and filter support rack

Dual Position Microbial Drain Pans

- Designed for upflow, downflow or horizontal applications
- Deep, corrosion resistant plastic drain pans have dual pipe drains
- Anti-Microbial additive resists growth of mold and mildew on drain pan which improves indoor air quality and reduces drain line blockage
- · See dimension drawings

Optional Accessories

Downflow Combustible Flooring Base

 Base is required for models with electric heat installed in downflow position on combustible floors

Horizontal Support Frame Kit

- Provides support of unit in horizontal applications
- Consists of (2) 1 x 1-1/2 x 32-5/8 in. and (2) 1 x 3 x 53-7/8 in. painted heavy gauge cold rolled steel support channels with assembly and suspending holes
- · Bolts and nuts furnished for field assembly
- · Suspending rods must be field provided

Side Return Unit Stand (Upflow Only)

- Raises unit 16 in. above floor for side return air duct connection
- · Eliminates need for wooden platform construction
- · All aluminum construction
- Two adjustable frames fit all sizes

Wall Hanging Bracket Kit (Upflow Only)

- · Allows unit to be hung on wall at any height
- Consists of heavy-gauge steel support brackets (one for air handler, one for wall mount)
- · Screws furnished for fastening one bracket to unit
- Bolts for fastening one bracket to wall are field provided

High Performance Economizer (Commercial Applications Only)

- Designed for applications requiring outdoor air to be utilized in a commercial HVAC system
- Allows the entry of fresh outdoor air for free cooling, reducing the requirement for mechanical cooling
- Heavy gauge galvanized steel cabinet lined with thick fiberglass insulation
- Mixed air sensor, outdoor air sensor and 24VAC transformer furnished
- Approved for California Title 24 building standards
- · ASHRAE 90.1-2010 compliant
- See separate Product Specifications bulletin for additional information and available control and sensor options

NOTE - Economizer is not compatible with a Lennox[®] Communicating system.

FILTER

- 6 · Disposable 1 inch filter is furnished
 - Filter rack furnished in cabinet for easy filter installation
 - See Specifications tables for filter sizes

BLOWER

7

Variable-Speed Blower Motor

- High efficiency multi-speed blower motor maintains specified air volumes up to a maximum of 0.8 in. w.g. total external static
- Multi-speed operation is achieved by the use of an ECM (Electronically Commutated Motor) motor
- Allows cooling ramping profiles (field selectable) for enhanced dehumidification



- Motor accelerates and decelerates gradually, reducing start-up and shut-down sound
- Leadless blower motor features simple plug-in connections
- Motor is controlled by the Lennox® Communicating Control that allows blower to operate at two of eight air volumes or speeds available
- Speeds may be field selected on Lennox®
 Communicating Control depending on size of air handler and air volume desired
- See blower performance tables

Blower Assembly

- Lennox designed and built, direct drive blower
- Each blower is statically and dynamically balanced as an assembly before installation in the unit
- Blower motor is resiliently mounted to blower assembly
- · Blower slides out of cabinet for servicing

CONTROLS




8 Lennox[®] Communicating Control

- Advanced control communicates information about various operating parameters in the air handler to the optional Lennox[®] Communicating Thermostat to constantly maintain the highest level of comfort, performance and efficiency available
- Auto Configuration On start-up the control board automatically sends a description of the unit



- Connections for connecting a conventional heating/ cooling thermostat are also provided on the board
- · Control also features:
 - Lennox Humiditrol® Whole Home Dehumidification System (EDA) compatible
 - EEPROM storage of all local configurations
 - Non-volatile memory storage of 100 alarm codes with display of last 10 codes for troubleshooting
 - Connections for optional outdoor temperature sensor (communicates temperature on RSBUS to thermostat)
 - Controls evaporator humidity by controlling blower and compressor staging on two-stage outdoor units
 - Two Stages HEAT and COOL (with four different air volume selections for each) are made by simple jumper pins on board
 - ADJUST jumper pin allows approximately 10% higher, normal or 10% lower motor speed selection within HEAT and COOL speeds selected for fine tuning air volume
 - DELAY jumper pin allows selection of blower motor dehumidification profiles during cooling mode
 - Option 1 Motor runs at 100% of capacity until demand met. Once demand is met, motor ramps down to stop.
 - Option 2 Cooling When cool demand is initiated, motor ramps up to 100% and runs at 100% until demand is satisfied. Once demand is met, motor runs at 100% for 45 seconds, then ramps down to stop.
 - Option 2 Heat Pump: When heat pump demand is initiated, 30 second motor on delay starts. After the motor on delays expires, motor ramps up to 100% and runs at 100% until demand is satisfied. Once demand is met, motor runs at 100% for 45 seconds, then ramps down to stop.
 - Option 3 Motor runs at 82% of capacity for approximately 7.5 minutes, then 100% capacity (if needed) until demand is satisfied. Once demand is met, motor ramps down to stop.



- Display LED Seven segment LED displays alphanumeric information related to diagnostics as well as system operation and status
 - Diagnostic codes are held in non-volatile memory, immune from power interruptions
 - Holds up to ten diagnostic codes in order of occurrence for recall on demand
 - Port on blower door allows for easy viewing
- Dehumidification (Active or Humiditrol® Option) A jumper on the control board must be clipped to enable active dehumidification and/or operation with a Humiditrol Whole-Home Dehumidification System
 - During a call for cooling, air volume is automatically reduced, forcing humidity removal by the air conditioner or heat pump system
 - After the humidity has reached the desired set-point the cooling air volume returns to its designed rate
 - A dehumidification signal from the thermostat reduces the cooling cfm to 70% of the requested cooling cfm

NOTE - A humidity controlling thermostat or device is also required.

- Electric Heat Operation Control for up to three electric heat stages
- EvenHeater® Electric Heat Control Up to four electric heat stages are available when utilizing the EvenHeater® control feature furnished on the Lennox® Communicating Control
 - EVENHEAT jumper position on control board determines target discharge air temperature of 85°F, 100°F, 115°F or 130°F
 - Default setting is 85°F

NOTE - Optional Discharge Air Sensor is required.

- Heat Pump Operation A jumper on the control board must be clipped to enable operation with a single or twostage heat pump
 - The indoor blower is started without delay when a call for heat is received
- Two-Stage Cooling Operation A jumper on the control board must be clipped to enable operation with a two-stage air conditioner
 - The cooling blower speeds for first and second stage cooling will be dictated by the applicable DIP switch settings
- Lennox System Operations Monitor Connection -Monitors outdoor unit operation. (communicating mode)
- Continuous Blower Speed Adjustable continuous blower speed is a percentage of the high cooling speed selection. There are four selectable options (via DIP switch settings) of 28%, 38% (default setting), 70% and 100%



• Transformer - 70VA transformer furnished as standard. Factory installed in the unit control box

CONTROLS (continued)

Lennox® Communicating Control (continued)

- Accessory Terminal One 24 volt humidifier output is furnished for non-powered humidifiers
- · Control board is factory installed in the unit control box

Optional Accessories

S40 Smart Wi-Fi Thermostat (part of the Lennox® Residential Communicating Control System)

 Recognizes and connects to all Lennox® Communicating products to automatically configure and control

the heating/cooling system (based on userspecified settings) for the highest level of comfort, performance and efficiency



 Recognizes model and serial number information for Lennox®

Communicating products to simplify system setup

- Lennox Smart Room Sensors, Lennox Wireless Extenders and Lennox Smart Air Quality Monitor can be added to the system
- Smart home automation compatible with Amazon Alexa®, Google Assistant, Control4® and Building36®
- · Sends service alerts and reminders
- Lennox Smart Thermostat App features Wi-Fi remote temperature monitoring and adjustment through a home wireless network apps for smartphones or tablets
- Lennox Smart Technician App allows installer to manage systems in the home
- Service Dashboard features online real-time monitoring and advanced diagnostics of installed Lennox[®] Communicating systems
- Simple easy-to-use touchscreen allows complete system configuration
- Scheduled maintenance alerts, system warnings and troubleshooting are also displayed on thermostat screen
- Easy to read 7 inch high definition color display (measured diagonally)
- Conventional outdoor units (not Lennox® Communicating) can easily be added and controlled by the S40 Thermostat
- Installer setup screens allow quick and simple system configuration without a manual, Installer can also run tests on complete system or individual components for easy maintenance and troubleshooting
- Serial communications bus (RSBus), with less wiring than a conventional heating/cooling system, allows system communication
- Uses standard 4-wire unshielded thermostat wiring
- High Definition Color Display with Subbase and wallplate furnished for easy installation

NOTE - See the Lennox® S40 Thermostat Product Specifications bulletin in the Controls section for more information.

Remote Outdoor Temperature Sensor

- · Allows thermostat to display outdoor temperature
- Automatically detected when connected to thermostat

NOTE - Sensor is required for the Enhanced Dehumidification Accessory (EDA).

NOTE - Sensor is furnished as standard with Lennox® Communicating outdoor units, optional for conventional units.

Thermostat

- · Thermostat is not furnished with unit
- See Lennox Price Book for selection

Hot Water Heat Kit

- Controls a third-party hot water boiler with a hot water heating coil installed downstream from the air handler
- Kit contains all necessary relays and plug-in wiring harness to control boiler

NOTE - This kit is only approved for use in systems using a Lennox® Communicating thermostat or a CS7500 thermostat.



10 OPTIONAL ELECTRIC HEAT

- ETL listed
- · Field install internal to unit cabinet
- Available in several voltages and kW sizes
- See Electric Heat tables
- Helix wound nichrome heating elements exposed directly in air stream resulting in instant heat transfer, low element temperatures and long service life
- Each element equipped with accurately located limit control with fixed temperature off setting and automatic reset
- Supplemental thermal cutoff limit control, provides positive protection in case of excessive temperatures
- Thermal sequencer relay brings elements on and off line, in sequence and equal increments, with time delay between each
- Initiates and terminates blower operation
- · Heating control relay(s) furnished as standard
- Control box and access cover constructed of heavy gauge galvanized steel
- · Factory assembled with controls installed and wired
- · Electric heat low voltage controls plug-in to air handler

Circuit Breaker (CB) Models

- All "CB" model heaters are equipped with circuit breakers for overload and short circuit protection
- · Factory wired and mounted on electric heat unit
- · Current sensitive and temperature actuated
- Manual reset
- Circuit breakers qualify as disconnect means at unit in many areas, eliminate the need for field provided disconnect
- · Consult local electrical code in your area

Optional Accessories

Circuit Breaker Cover Kit

- · Flexible plastic cover protects circuit breaker
- Recommended in areas with high humidity or unconditioned areas to prevent nuisance tripping

Single-Point Power Source Control Box

- Control Box may be used with optional electric heat when single power supply is connected to multi-circuit electric heat
- Field installs external to the unit cabinet on either side or top
- Constructed of heavy gauge steel, baked enamel finish, pre-punched mounting holes, electrical inlet knockouts, and terminal strip
- Removable cover provides easy access
- Dimensions (H x W x D) 7 x 7 x 4 in.

SPECIFICATIO	NS			
General Data	Model Number	CBA38MV-018/024	CBA38MV-030	CBA38MV-036
	Nominal tonnage	1.5 to 2	2.5	3
	Factory Installed Expansion Valve	12J18	12J18	12J19
	Refrigerant	R-410A	R-410A	R-410A
Connections	Suction / vapor (o.d.) line - sweat	3/4	3/4	3/4
in.	Liquid line (o.d.) - sweat	3/8	3/8	3/8
	Condensate drain - in. (fpt)	(2) 3/4	(2) 3/4	(2) 3/4
Indoor	Net face area - ft.2	4.4	5.0	5.0
Coil	Tube outside diameter - in.	3/8	3/8	3/8
	Number of rows	3	3	3
	Fins per inch	14	14	14
Blower Data	Wheel nominal diameter x width - in.	10 x 8	11 x 8	11 x 8
	Motor output - hp	1/2	1/2	3/4
Filters	¹ Number and size - in.	(1) 20 x 20 x 1	(1) 20 x 20 x 1	(1) 20 x 20 x 1
Shipping Data - 1 Pa	ackage - Ibs.	141	154	159
ELECTRICAL D	ATA	·		
	Voltage - phase - 60hz	208/230V-1ph	208/230V-1ph	208/230V-1ph
2	Maximum overcurrent protection (unit only)	15	15	15
	³ Minimum circuit ampacity (unit only)	5	5	5
CONTROLS				
S40 Smart Wi-Fi The	ermostat	22V24	22V24	22V24
Remote Outdoor A (for dual fuel and ED	ir Temperature Sensor OA)	X2658	X2658	X2658
Discharge Air Temp	perature Sensor	88K38	88K38	88K38
OPTIONAL AC	CESSORIES - ORDER SEPARAT	ΓELY		
Circuit Breaker Cov	er Kit	82W01	82W01	82W01
Downflow Combusti	ible Flooring Base	44K15	44K15	44K15
Electric Heat		See	Electric Heat Data tal	oles
Horizontal Support I	Frame Kit	56J18	56J18	56J18
Hot Water Heat Kit		90W84	90W84	90W84
Side Return Unit Sta	and (Upflow)	45K32	45K32	45K32
Single-Point Power	Source Control Box	21H39	21H39	21H39
Wall Hanging Brack	et Kit (Upflow)	45K30	45K30	45K30
High Performance E	conomizer (Commercial Only)	10U53	10U53	10U53

¹ Disposable frame type filter.

⁵ Optional for EvenHeater® electric heat operation and service diagnostics.

INSTALLATION CLEARANCES WITH ELECTRIC HEAT							
Cabinet	0 inch (0 mm)						
To Plenum	0 inch (0 mm)						
To Outlet Duct within 3 feet (914 mm)	0 inch (0 mm)						
Floor	See Note #1						
Service / Maintenance	See Note #2						

¹ Units installed on combustible floors in the downflow position with electric heat require optional downflow combustible flooring base.

NOTE - If cabinet depth is more than 24 inches (610 mm), allow a minimum of the cabinet depth plus 2 inches (51 mm).

² HACR type circuit breaker or fuse.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Remote Outdoor Temperature Sensor is used with conventional (non-Lennox® Communicating) outdoor units (sensor is furnished with Lennox® Communicating outdoor units). Allows the thermostat to display outdoor temperature. Required in dual-fuel and Humiditrol® applications.

² Front service access - 24 inches (610 mm) minimum.

SPECIFICATION				
General Data	Model Number	CBA38MV-042	CBA38MV-048	CBA38MV-060
	Nominal tonnage	3.5	4	5
	Factory Installed Expansion Valve	12J20	12J20	12J20
	Refrigerant	R-410A	R-410A	R-410A
Connections	Suction / vapor (o.d.) line - sweat	7/8	7/8	7/8
in.	Liquid line (o.d.) - sweat	3/8	3/8	3/8
	Condensate drain - in. (fpt)	(2) 3/4	(2) 3/4	(2) 3/4
Indoor	Net face area - ft.²	7.22	7.22	8.33
Coil	Tube outside diameter - in.	3/8	3/8	3/8
	Number of rows	3	3	3
	Fins per inch	14	14	14
Blower Data	Wheel nominal diameter x width - in.	12 x 9	12 x 9	12 x 9
	Motor output - hp	1	1	1
Filters	¹ Number and size - in.	(1) 20 x 24 x 1	(1) 20 x 24 x 1	(1) 20 x 24 x 1
Shipping Data - 1 F	Package - Ibs.	189	189	199
ELECTRICAL	DATA			
	Voltage - phase - 60hz	208/230V-1ph	208/230V-1ph	208/230V-1ph
2	2 Maximum overcurrent protection (unit only) \lceil	15	15	15
	³ Minimum circuit ampacity (unit only)	10	10	10
CONTROLS				
S40 Smart Wi-Fi Th	ermostat	22V24	22V24	22V24
Remote Outdoor A (for dual fuel and E	Air Temperature Sensor	X2658	X2658	X2658
Discharge Tempe	rature Sensor	88K38	88K38	88K38
OPTIONAL AC	CESSORIES - ORDER SEPARAT	ELY		
Circuit Breaker Co	ver Kit	82W01	82W01	82W01
Downflow Combus	tible Flooring Base	44K15	44K15	44K15
Electric Heat		See	e Electric Heat Data tal	oles
Horizontal Support	Frame Kit	56J18	56J18	56J18
Hot Water Heat Kit		90W84	90W84	90W84
Side Return Unit S	tand (Upflow)	45K32	45K32	45K32
Single-Point Power	r Source Control Box	21H39	21H39	21H39
Wall Hanging Brac	ket Kit (Upflow)	45K30	45K30	45K30
High Performance	Economizer (Commercial Only)	10U53	10U53	10U53

¹ Disposable frame type filter.

REPLACEMENT CIRCUIT BREAKERS											
Voltage	Description	Catalog No.									
208/240V - 1 Phase	25 amp, 2 pole	41K13									
	30 amp, 2 pole	17K70									
	35 amp, 2 pole	72K07									
	40 amp, 2 pole	49K14									
	45 amp, 2 pole	17K71									
	50 amp, 2 pole	41K12									
	60 amp, 2 pole	17K72									
208/240V - 3 Phase	30 amp, 3 pole	64W47									
	35 amp, 3 pole	41K14									
	40 amp, 3 pole	41K16									
	45 amp, 3 pole	18M86									
	50 amp, 3 pole	41K15									
	60 amp, 3 pole	41K17									

² HACR type circuit breaker or fuse.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Remote Outdoor Temperature Sensor is used with conventional (non-Lennox® Communicating) outdoor units (sensor is furnished with Lennox® Communicating outdoor units). Allows the thermostat to display outdoor temperature. Required in dual-fuel and Humiditrol® applications.

⁵ Optional for EvenHeater® electric heat operation and service diagnostics.

CBA38MV-018/024 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

	Jumper Speed Positions										
"ADJUST" Jumper Setting		"HEAT"	' Speed		"COOL" Speed						
	1	2	3	4	1	2	3	4			
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm			
+	460	685	885	1050	460	685	885	1050			
NORM	400	575	795	940	400	575	795	940			
_	365	515	715	830	365	515	715	830			

NOTES - The effect of static pressure, filter and electric heater resistance is included in the air volumes listed.

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 250 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 250 cfm.

CRA38MV-018/024 BLOWER MOTOR WATTS

CBA38MV-018/024	BLOWE	R MOTOR	WATTS								
AT "+" (Plus) SET	TING ("A	djust" Jum	per at "+"	Setting)							
Jumper			. M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.		
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
"HEAT" Speed	Tap 1	NA	32	44	58	71	90	104	131	145	
	Tap 2	NA	56	85	103	121	139	165	190	207	
	Tap 3	NA	105	131	161	183	202	241	263	292	
	Tap 4	NA	164	194	220	253	277	310	330	360	
"COOL" Speed	Tap 1	NA	32	44	58	71	90	104	131	145	
	Tap 2	NA	56	85	103	121	139	165	190	207	
	Tap 3	NA	105	131	161	183	202	241	263	292	
	Tap 4	NA	164	194	220	253	277	310	330	360	
AT "NORM" SETT	ING ("Ad	just" Jump	er at NORI	M Setting)							
Jumper		Motor Watts @ Various External Static Pressures - in. wg.									
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
"HEAT" Speed	Tap 1	NA	27	42	52	69	79	99	114	133	
	Tap 2	NA	44	59	77	95	117	137	152	183	
	Tap 3	NA	79	108	126	159	181	199	231	252	
	Tap 4	NA	117	145	167	197	228	254	273	313	
"COOL" Speed	Tap 1	NA	27	42	52	69	79	99	114	133	
	Tap 2	NA	44	59	77	95	117	137	152	183	
	Tap 3	NA	79	108	126	159	181	199	231	252	
	Tap 4	NA	117	145	167	197	228	254	273	313	
AT "-" (Minus) SE	TTING ("	Adjust" Ju	mper at "-	" Setting)							
Jumper			. M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.		
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
"HEAT" Speed	Tap 1	NA	24	40	48	60	76	94	106	117	
	Tap 2	NA	37	48	68	93	106	129	145	157	
	Tap 3	NA	70	85	106	129	153	181	203	222	
	Tap 4	NA	90	117	138	162	190	216	236	265	
"COOL" Speed	Tap 1	NA	24	40	48	60	76	94	106	117	
	Tap 2	NA	37	48	68	93	106	129	145	157	
	Tap 3	NA	70	85	106	129	153	181	203	222	
	Tap 4	NA	90	117	138	162	190	216	236	265	

CBA38MV-030 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

	Jumper Speed Positions										
"ADJUST" Jumper Setting		"HEAT"	'Speed		"COOL" Speed						
	1	2	3	4	1	2	3	4			
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm			
+	630	875	1095	1315	630	875	1095	1315			
NORM	545	785	995	1195	545	785	995	1195			
	510	700	890	1075	510	700	890	1075			

 $NOTES - The \ effect \ of \ static \ pressure, \ filter \ and \ electric \ heater \ resistance \ is \ included \ in \ the \ air \ volumes \ listed.$

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 250 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 250 cfm.

CBA38MV-030 BLOWER MOTOR WATTS

AT "+" (Plus) SET	TING ("A	djust" Jun	nper at "+"	Setting)								
Jumper			Motor Watts @ Various External Static Pressures - in. wg.									
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
"HEAT" Speed	Tap 1	NA	35	55	76	95	116	138	164	179		
	Tap 2	NA	80	100	122	148	171	194	214	239		
	Tap 3	NA	140	167	189	216	237	273	291	322		
	Tap 4	NA	231	262	295	328	355	377	412	441		
"COOL" Speed	Tap 1	NA	35	55	76	95	116	138	164	179		
	Tap 2	NA	80	100	122	148	171	194	214	239		
	Tap 3	NA	140	167	189	216	237	273	291	322		
	Tap 4	NA	231	262	295	328	355	377	412	441		
AT "NORM" SETT	ING ("Ad	just" Jum	per at NOR	M Setting)		,	1	'	'			
Jumper			N	lotor Watts	@ Various	External S	tatic Press	ures - in. w	/g.			
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
"HEAT" Speed	Tan 1	NΙΛ	36	10	61	80	02	11/	124	120		

Jumper		Motor Watts @ Various External Static Pressures - in. wg.										
Speed Positions		0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8		
"HEAT" Speed	Tap 1	NA	36	48	61	80	92	114	124	139		
	Tap 2	NA	61	84	104	122	143	169	186	210		
	Tap 3	NA	109	134	153	178	203	231	254	281		
	Tap 4	NA	174	205	238	264	284	310	338	372		
"COOL" Speed	Tap 1	NA	36	48	61	80	92	114	124	139		
	Tap 2	NA	61	84	104	122	143	169	186	210		
	Tap 3	NA	109	134	153	178	203	231	254	281		
	Tap 4	NA	174	205	238	264	284	310	338	372		

AT "-" (Minus) SETTING ("Adjust" Jumper at "-" Setting)

Jumper		Motor Watts @ Various External Static Pressures - in. wg.									
Speed Positions		0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8	
"HEAT" Speed	Tap 1	NA	29	43	58	77	88	102	119	134	
	Tap 2	NA	44	64	89	106	125	157	174	202	
	Tap 3	NA	85	104	129	152	176	199	219	239	
	Tap 4	NA	133	157	185	207	231	258	285	317	
"COOL" Speed	Tap 1	NA	29	43	58	77	88	102	119	134	
	Tap 2	NA	44	64	89	106	125	157	174	202	
	Tap 3	NA	85	104	129	152	176	199	219	239	
	Tap 4	NA	133	157	185	207	231	258	285	317	

CBA38MV-036 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

"ADJUST"	Jumper Speed Positions									
Jumper Setting		"HEAT"	Speed		"COOL" Speed					
	1	2	3	4	1	2	3	4		
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm		
+	920	1255	1410	1580	920	1255	1410	1580		
NORM	815	1165	1315	1435	815	1165	1315	1435		
_	720	1010	1155	1285	720	1010	1155	1285		

NOTES - The effect of static pressure, filter and electric heater resistance is included in the air volumes listed.

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 250 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 250 cfm.

CBA38MV-036 BLOWER MOTOR WATTS

Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	n/a	88	108	132	161	190	208	234	248
	Tap 2	n/a	174	212	237	269	304	328	370	385
	Tap 3	n/a	232	282	314	341	374	410	434	473
	Tap 4	n/a	332	365	409	438	480	520	546	576
"COOL" Speed	Tap 1	n/a	88	108	132	161	190	208	234	248
	Tap 2	n/a	174	212	237	269	304	328	370	385
	Tap 3	n/a	232	282	314	341	374	410	434	473
	Tap 4	n/a	332	365	409	438	480	520	546	576

AT "NORM" SETTING ("Adjust" Jumper at NORM Setting)

Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	n/a	70	89	113	137	155	188	199	233
	Tap 2	n/a	145	168	201	221	258	279	316	348
	Tap 3	n/a	200	223	265	293	316	359	374	403
	Tap 4	n/a	259	291	309	351	390	429	447	488
"COOL" Speed	Tap 1	n/a	70	89	113	137	155	188	199	233
	Tap 2	n/a	145	168	201	221	258	279	316	348
	Tap 3	n/a	200	223	265	293	316	359	374	403
	Tap 4	n/a	259	291	309	351	390	429	447	488

AT "-" (Minus) SETTING ("Adjust" Jumper at "-" Setting)

711 ((,											
Jumper		Motor Watts @ Various External Static Pressures - in. wg.											
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8			
"HEAT" Speed	Tap 1	n/a	50	78	97	119	144	163	185	199			
	Tap 2	n/a	105	130	156	177	212	239	264	280			
	Tap 3	n/a	144	167	197	224	255	281	316	340			
	Tap 4	n/a	191	229	253	283	310	339	366	398			
"COOL" Speed	Tap 1	n/a	50	78	97	119	144	163	185	199			
	Tap 2	n/a	105	130	156	177	212	239	264	280			
	Tap 3	n/a	144	167	197	224	255	281	316	340			
	Tap 4	n/a	191	229	253	283	310	339	366	398			

CBA38MV-042 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

"ADJUST"	Jumper Speed Positions										
Jumper		"HEAT"	'Speed			"COOL"	' Speed				
Setting	1	2	3	4	1	2	3	4			
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm			
+	1100	1320	1540	1760	1100	1320	1540	1760			
NORM	1000	1200	1400	1600	1000	1200	1400	1600			
_	900	1080	1260	1440	900	1080	1260	1440			

 $NOTES - The \ effect \ of \ static \ pressure, \ filter \ and \ electric \ heater \ resistance \ is \ included \ in \ the \ air \ volumes \ listed.$

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 450 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 450 cfm.

CBA38MV-042 BLOWER MOTOR WATTS

Jumper			M	lotor Watts	@ Various	External S	tatic Press	ures - in. w	g.								
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8							
"HEAT" Speed	Tap 1	NA	121	154	177	199	233	252	283	315							
	Tap 2	NA	189	221	247	282	310	344	370	403							
	Tap 3	NA	283	312	341	382	422	454	481	515							
	Tap 4	NA	407	446	488	528	567	583	646	671							
"COOL" Speed	Tap 1	NA	121	154	177	199	233	252	283	315							
	Tap 2	NA	189	221	247	282	310	344	370	403							
	Tap 3	NA	283	312	341	382	422	454	481	515							
Tap 4		NA	407	446	488	528	567	583	646	671							
AT "NORM" SETTING ("Adju		ust" Jump	er at NORI	M Setting)													
Jumper			M	lotor Watts	@ Various	Motor Watts @ Various External Static Pressures - in. wg.											

Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	104	134	153	184	207	236	257	286
	Tap 2	NA	142	171	203	234	253	298	327	351
	Tap 3	NA	212	240	269	308	337	371	408	429
	Tap 4	NA	309	341	367	406	441	476	516	559
"COOL" Speed	Tap 1	NA	104	134	153	184	207	236	257	286
	Tap 2	NA	142	171	203	234	253	298	327	351
	Tap 3	NA	212	240	269	308	337	371	408	429
	Tap 4	NA	309	341	367	406	441	476	516	559

AT "-" (Minus) SETTING ("Adjust" Jumper at "-" Setting)

Ai (illiniao) OL		rajaot oa	inpor at	oottiiig)						
Jumper			M	lotor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	78	104	126	155	175	199	209	247
	Tap 2	NA	115	139	168	196	218	247	274	309
	Tap 3	NA	165	192	220	247	290	316	360	376
	Tap 4	NA	237	269	301	327	356	407	430	481
"COOL" Speed	Tap 1	NA	78	104	126	155	175	199	209	247
	Tap 2	NA	115	139	168	196	218	247	274	309
	Tap 3	NA	165	192	220	247	290	316	360	376
	Tap 4	NA	237	269	301	327	356	407	430	481

CBA38MV-048 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

		Jumper Speed Positions										
"ADJUST"		"HEAT"	Speed		"COOL" Speed							
Jumper Setting	1	1 2		4	1	2	3	4				
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm				
+	1670	1870	2100	2200	1670	1870	2100	2200				
NORM	1460	1670	1870	2100	1460	1670	1870	2100				
-	1230	1410	1600	1800	1230	1410	1600	1800				

NOTES - The effect of static pressure, filter and electric heater resistance is included in the air volumes listed.

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 450 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 450 cfm.

CRA38MV-048 BLOWER MOTOR WATTS

AT "+" (Plus) SET	TING ("A	OTOR WAT		Setting)						
Jumper	11110 (A	ajast van	•	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	335	374	399	436	495	518	572	611
-	Tap 2	NA	459	502	537	586	644	689	724	759
	Tap 3	NA	668	738	778	845	881	957	996	1019
	Tap 4	NA	808	865	922	975	1003	1025	1017	987
'COOL" Speed	Tap 1	NA	335	374	399	436	495	518	572	611
	Tap 2	NA	459	502	537	586	644	689	724	759
	Tap 3	NA	668	738	778	845	881	957	996	1019
	Tap 4	NA	808	865	922	975	1003	1025	1017	987
AT "NORM" SETT	ING ("Ad	just" Jump	er at NORI	M Setting)						
Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	225	264	289	336	358	396	432	464
	Tap 2	NA	320	374	398	434	484	523	558	610
	Tap 3	NA	451	498	529	583	619	682	721	768
	Tap 4	NA	643	699	731	795	848	919	966	998
'COOL" Speed	Tap 1	NA	225	264	289	336	358	396	432	464
	Tap 2	NA	320	374	398	434	484	523	558	610
	Tap 3	NA	451	498	529	583	619	682	721	768
	Tap 4	NA	643	699	731	795	848	919	966	998
AT "–" (Minus) SE	TTING ("	Adjust" Ju	mper at "-	" Setting)						
Jumper			. M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Position	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	146	178	207	227	265	299	317	359
	Tap 2	NA	207	243	272	305	345	371	419	438
	Tap 3	NA	290	347	383	412	447	486	525	548
	Tap 4	NA	410	440	491	528	572	613	651	694
'COOL" Speed	Tap 1	NA	146	178	207	227	265	299	317	359
	Tap 2	NA	207	243	272	305	345	371	419	438
	Tap 3	NA	290	347	383	412	447	486	525	548
	Tap 4	NA	410	440	491	528	572	613	651	694

CBA38MV-060 BLOWER PERFORMANCE

0 through 0.80 in. w.g. External Static Pressure Range

"ADJUST"	Jumper Speed Positions										
Jumper		"HEAT"	'Speed		"COOL" Speed						
Setting	1	2	3	4	1	2	3	4			
	cfm	cfm	cfm	cfm	cfm	cfm	cfm	cfm			
+	1695	1890	2140	2210	1695	1890	2140	2210			
NORM	1525	1680	1850	2075	1525	1680	1850	2075			
_	1300	1450	1630	1800	1300	1450	1630	1800			

 $NOTES-The\ effect\ of\ static\ pressure,\ filter\ and\ electric\ heater\ resistance\ is\ included\ in\ the\ air\ volumes\ listed.$

First stage cooling air volume is 70% of COOL speed setting. Continuous fan speed is approximately 28%, 38%, 70% and 100% (Jumper selectable) of the same second-stage COOL speed selected, minimum 450 cfm.

Lennox® Smart Zoning System applications - minimum blower speed is 450 cfm.

CBA38MV-060 BLOWER MOTOR WATTS

Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	334	368	412	449	491	532	557	603
	Tap 2	NA	462	511	549	601	640	681	720	762
	Tap 3	NA	670	710	765	820	868	921	963	1005
	Tap 4	NA	757	810	853	909	961	1001	1034	1026
"COOL" Speed	Tap 1	NA	334	368	412	449	491	532	557	603
	Tap 2	NA	462	511	549	601	640	681	720	762
	Tap 3	NA	670	710	765	820	868	921	963	1005
	Tap 4	NA	757	810	853	909	961	1001	1034	1026
AT "NORM" SETT	ING ("Adj	ust" Jump	er at NORI	/I Setting)						
Jumper			M	otor Watts	@ Various	External S	tatic Press	ures - in. w	g.	
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	0.8
"HEAT" Speed	Tap 1	NA	245	285	319	350	398	425	462	497
	Tap 2	NA	330	368	414	443	469	505	558	600
	Tap 3	NA	442	497	515	554	603	643	685	735
	Tap 4	NA	600	653	701	752	798	842	889	935
"COOL" Speed	Tap 1	NA	245	285	319	350	398	425	462	497
	Tap 2	NA	330	368	414	443	469	505	558	600
	Tap 3	NA	442	497	515	554	603	643	685	735
	Tap 4	NA	600	653	701	752	798	842	889	935

AT "-" (Minus) SETTING ("Adjust" Jumper at "-" Setting)

Ai (iiiiiiao) OL	-111110 (rajaot oa	iiipoi at	Oottiiig)										
Jumper			Motor Watts @ Various External Static Pressures - in. wg.											
Speed Positi	ons	0	0.1	0.2	0.3	0.4	0.5	0.6	0.7	8.0				
"HEAT" Speed	Tap 1	NA	181	204	235	261	304	323	357	383				
	Tap 2	NA	218	259	283	315	357	390	422	457				
	Tap 3	NA	300	333	365	395	443	476	527	559				
	Tap 4	NA	400	430	470	515	543	592	639	678				
"COOL" Speed	Tap 1	NA	181	204	235	261	304	323	357	383				
	Tap 2	NA	218	259	283	315	357	390	422	457				
	Tap 3	NA	300	333	365	395	443	476	527	559				
	Tap 4	NA	400	430	470	515	543	592	639	678				

ELECTRIC HEAT	Γ DATA				CBA38	BMV-018	/024 SIN	GLE PHASE
	Model Number	No. of Stages	Volts Input	kW Input	¹Btuh Input	² Blower Motor Full Load Amps	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
4 kW	ECB38-4 (16V86)	1	208	3.0	10,250	3.9	23	425
4 lbs.	Terminal Block ECB38-4CB (16V87)		220	3.4	11,450	3.9	24	425
	30A Circuit breaker		230	3.7	12,550	3.9	25	4 25
			240	4.0	13,650	3.9	26	30
5 kW	ECB38-5 (16V88)	1	208	3.8	12,800	3.9	28	4 30
4 lbs.	Terminal Block ECB38-5CB (16V89)		220	4.2	14,300	3.9	29	4 30
	35A Circuit breaker		230	4.6	15,700	3.9	30	4 30
			240	5.0	17,100	3.9	31	35
6 kW	ECB38-6 (16V90)	1	208	4.5	15,400	3.9	32	4 35
4 lbs.	Terminal Block ECB38-6CB (16V91)		220	5.0	17,100	3.9	33	⁴ 35
	40A Circuit breaker		230	5.5	18,800	3.9	35	⁴ 35
			240	6.0	20,500	3.9	36	40
8 kW	ECB38-8 (16V92)	2	208	6.0	20,500	3.9	41	⁴ 45
5 lbs.	Terminal Block ECB38-8CB (16V93)		220	6.7	22,900	3.9	43	⁴ 45
	50A Circuit breaker		230	7.3	25,100	3.9	45	⁴ 45
			240	8.0	27,300	3.9	47	50
9 kW	ECB38-9CB (16V94)	2	208	6.8	23,100	3.9	46	4 50
5 lbs.	60A Circuit breaker		220	7.6	25,800	3.9	48	4 50
			230	8.3	28,200	3.9	50	4 50

9.0

240

30,700

3.9

52

60

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

 $^{^{\}rm 5}$ HACR type circuit breaker or fuse.

ELECT	TRIC HEAT DATA							CBA	38M	V-030	SINGL	E PHASE
	Model Number	No. of			¹ Btuh	² Blower Motor Full	Cir	imum cuit acity	_	imum urrent ection		e Point Source
	inodo: Namibol	Stages	Input	Input	Input	Load Amps	CkT 1	Ckt 2	CkT 1	Ckt 2	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
4 kW	ECB38-4 (16V86)	1	208	3.0	10,250	3.9	23		⁴ 25		23	25
4 lbs.	Terminal Block ECB38-4CB (16V87)		220	3.4	11,450	3.9	24		425		24	25
	30A Circuit breaker		230	3.7	12,550	3.9	25		⁴ 25		25	25
			240	4.0	13,650	3.9	26		30		26	30
5 kW	ECB38-5 (16V88)	1	208	3.8	12,800	3.9	28		4 30		28	30
4 lbs.	Terminal Block ECB38-5CB (16V89)		220	4.2	14,300	3.9	29		⁴ 30		29	30
	35A Circuit breaker		230	4.6	15,700	3.9	30		⁴ 30		30	30
			240	5.0	17,100	3.9	31		35		31	35
6 kW	ECB38-6 (16V90)	1	208	4.5	15,400	3.9	32		⁴ 35		32	35
4 lbs.	Terminal Block ECB38-6CB (16V91)		220	5.0	17,100	3.9	33		⁴ 35		33	35
	40A Circuit breaker		230	5.5	18,800	3.9	35		435		35	35
			240	6.0	20,500	3.9	36		40		36	40
8 kW	ECB38-8 (16V92)	2	208	6.0	20,500	3.9	41		⁴ 45		41	45
5 lbs.	Terminal Block ECB38-8CB (16V93)		220	6.7	22,900	3.9	43		⁴ 45		43	45
	50A Circuit breaker		230	7.3	25,100	3.9	45		⁴ 45		45	45
			240	8.0	27,300	3.9	47		50		47	50
9 kW	ECB38-9CB (16V94)	2	208	6.8	23,100	3.9	46		⁴ 50		46	50
5 lbs.	60A Circuit breaker		220	7.6	25,800	3.9	48		⁴ 50		48	50
			230	8.3	28,200	3.9	50		⁴ 50		50	50
			240	9.0	30,700	3.9	52		60		52	60
12.5 kW	ECB38-12.5CB (16V95)	2	208	9.4	32,000	3.9	24	38	⁴ 25	4 40	61	70
10 lbs.	(1) 30A and (1) 45A Circuit breaker		220	10.5	35,800	3.9	25	40	⁴ 25	4 40	65	70
	()		230	11.5	39,200	3.9	26	42	30	45	67	70
			240	12.5	42,600	3.9	27	44	30	45	71	80
15 kW	ECB38-15CB (16V96)	2	208	11.3	38,400	3.9	28	45	430	445	72	80
12 lbs.	(1) 35A and (1) 60A Circuit breaker		220	12.6	43,000	3.9	29	48	430	⁴ 50	76	80
	. ,		230	13.8	47,000	3.9	30	50	430	4 50	80	80
			240	15.0	51,200	3.9	31	52	35	60	83	90

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

 $^{^{\}rm 5}$ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA						³ Mini	CBA imum	⁵ Max	imum	İ	E PHASE
	Model Number	No. of		kW	¹Btuh	² Blower Motor	l	cuit acity		urrent ection	_	r Source
	model Number	Stages	Input	Input	Input	Full Load Amps	Ckt 1	Ckt 2	Ckt 1	Ckt 2	³ Minimum Circuit Ampacity	Maximum Overcurrent Protection
5 kW	ECB38-5 (16V88)	1	208	3.8	12,800	5.2	29		4 30		29	30
4 lbs.	Terminal Block ECB38-5CB (16V89)		220	4.2	14,300	5.2	30		4 30		30	35
	35A Circuit breaker		230	4.6	15,700	5.2	32		35		32	35
			240	5.0	17,100	5.2	33		35		33	35
6 kW	ECB38-6 (16V90)	1	208	4.5	15,400	5.2	34		4 35		34	35
4 lbs.	Terminal Block ECB38-6CB (16V91)		220	5.0	17,100	5.2	35		435		35	35
	40A Circuit breaker		230	5.5	18,800	5.2	36		40		36	40
			240	6.0	20,500	5.2	38		40		38	40
8 kW	ECB38-8 (16V92)	2	208	6.0	20,500	5.2	43		⁴ 45		43	45
5 lbs.	Terminal Block ECB38-8CB (16V93)		220	6.7	22,900	5.2	45		⁴ 45		45	45
	50A Circuit breaker		230	7.3	25,100	5.2	46		50		46	50
			240	8.0	27,300	5.2	48		50		48	50
9 kW	ECB38-9CB (16V94)	2	208	6.8	23,100	5.2	47		⁴ 50		47	50
5 lbs.	60A Circuit breaker	2	220	7.6	25,800	5.2	50		⁴ 50		50	50
			230	8.3	28,200	5.2	52		60		52	60
			240	9.0	30,700	5.2	53		60		53	60
	/ ECB38-12.5CB (16V95)	2	208	9.4	32,000	5.2	25	38	⁴ 25	⁴ 40	63	70
10 lbs.	(1) 30A and (1) 45A Circuit breaker		220	10.5	35,800	5.2	26	40	30	⁴ 40	66	70
	()		230	11.5	39,200	5.2	27	42	30	45	69	70
			240	12.5	42,600	5.2	28	44	30	45	72	80
15 kW	ECB38-15CB (16V96)	2	208	11.3	38,400	5.2	29	45	4 30	445	74	80
12 lbs.	(1) 35A and (1) 60A Circuit breaker		220	12.6	43,000	5.2	30	48	4 30	⁴ 50	78	80
	, ,		230	13.8	47,000	5.2	32	50	35	4 50	82	90
			240	15.0	51,200	5.2	33	52	35	60	85	90
20 kW	ECB38-20CB (16V97)	2	208	15.0	51,200	5.2	47	50	⁴ 50	⁴ 50	97	100
19 lbs.	(2) 60A Circuit breaker		220	16.8	57,300	5.2	49	53	⁴ 50	60	102	110
			230	18.4	62,700	5.2	51	55	60	60	106	110
		1	0 1 0								1	

240

20.0

68,200

5.2

53

57

60

60

111

125

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

 $^{^{\}rm 2}\,\mbox{Amps}$ shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

 $^{^{\}rm 5}$ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA							CBA	M88	V-036	THRE	E PHASE
	Model Number	No. of	Volts	kW	¹ Btuh	² Blower Motor	³ Mini Cire Amp	cuit	⁵ Max Overc Prote	urrent	_	le Point r Source
	Model Number	Stages	Input	Input	Input	Full Load Amps	Ckt 1	Ckt 2	Ckt 1	Ckt 2	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
8 kW	ECB38-8 (16V99)	1	208	6.0	20,500	5.2	28		30		28	30
5 lbs.	Terminal Block		220	6.7	22,900	5.2	29		30		29	30
		1	230	7.3	25,100	5.2	30		30		30	30
			240	8.0	27,300	5.2	30		30		30	35
10 kW	ECB38-10 (16W67)	1	208	7.5	25,600	5.2	33		35		33	35
6 lbs.	Terminal Block		220	8.4	28,700	5.2	35		35		35	35
		1	230	9.2	31,400	5.2	36		40		36	40
			240	10.0	34,100	5.2	37		40		37	40
15 kW	ECB38-15CB (16W68)	1	208	11.3	38,400	5.2	46		50		46	50
12 lbs.	50A Circuit breaker		220	12.6	43,000	5.2	48		50		48	50
			230	13.5	47,000	5.2	50		50		50	60
			240	15.0	51,200	5.2	52		4 60		52	60
20 kW	ECB38-20CB (16W69)	2	208	15.0	51,200	5.2	33	26	35	⁴ 30	59	60
19 lbs.	(2) 35A Circuit breaker	-, -	220	16.8	57,300	5.2	35	28	35	⁴ 30	62	70
			230	18.4	62,700	5.2	36	29	⁴ 40	⁴ 30	65	70
			240	20.0	68,200	5.2	37	30	4 40	35	67	70

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

 $^{^{\}rm 2}\,{\rm Amps}$ shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

⁵ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA							CBA	38MV	7-042	SINGL	E PHASE
	Madal Number	No. of	Volts	kW	¹Btuh	² Blower Motor Full	Circ	imum cuit acity	Overc	imum current ection		le Point r Source
	Model Number	Stages	Input	Input	Input	Load Amps	Ckt 1	Ckt 2	Ckt 1	Ckt 2	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
4 kW	ECB38-4 (16V86)	1	208	3.0	10,250	6.9	27		4 30		27	30
4 lbs.	Terminal Block ECB38-4CB (16V87)		220	3.4	11,450	6.9	28		4 30		28	30
	35A Circuit breaker		230	3.7	12,550	6.9	28		4 30		28	30
			240	4.0	13,650	6.9	29		4 30		29	30
5 kW	ECB38-5 (16V88)	1	208	3.8	12,800	6.9	31		35		31	35
4 lbs.	Terminal Block ECB38-5CB (16V89)		220	4.2	14,300	6.9	32		35		32	35
	35A Circuit breaker		230	4.6	15,700	6.9	34		35		34	35
			240	5.0	17,100	6.9	35		35		35	35
6 kW	ECB38-6 (16V90)	1	208	4.5	15,400	6.9	36		40		36	40
4 lbs.	Terminal Block ECB38-6CB (16V91)		220	5.0	17,100	6.9	37		40		37	40
	40A Circuit breaker		230	5.5	18,800	6.9	39		40		39	40
			240	6.0	20,500	6.9	40		40		40	40
8 kW	ECB38-8 (16V92)	2	208	6.0	20,500	6.9	45		⁴ 45		45	45
5 lbs.	Terminal Block ECB38-8CB (16V93)		220	6.7	22,900	6.9	47		50		47	50
	50A Circuit breaker		230	7.3	25,100	6.9	48		50		48	50
			240	8.0	27,300	6.9	50		50		50	60
9 kW	ECB38-9CB (16V94)	2	208	6.8	23,100	6.9	49		⁴ 50		49	50
5 lbs.	60A Circuit breaker		220	7.6	25,800	6.9	52		60		52	60
			230	8.3	28,200	6.9	54		60		54	60
			240	9.0	30,700	6.9	56		60		56	60
	ECB38-12.5CB (16V95)	2	208	9.4	32,000	6.9	27	38	30	440	65	70
10 lbs.	(1) 30A and (1) 45A Circuit breaker		220	10.5	35,800	6.9	29	40	30	440	68	70
	. ,		230	11.5	39,200	6.9	29	42	30	45	71	80
			240	12.5	42,600	6.9	31	44	4 3 5	45	74	80
15 kW	ECB38-15CB (16V96)	2	208	11.3	38,400	6.9	31	45	35	445	76	80
12 lbs.	(1) 35A and (1) 60A Circuit breaker		220	12.6	43,000	6.9	32	48	35	⁴ 50	80	90
			230	13.5	47,000	6.9	34	50	35	4 50	84	90
			240	15.0	51,200	6.9	35	52	35	60	87	90
20 kW	ECB38-20CB (16V97)	2	208	15.0	51,200	6.9	49	50	⁴ 50	⁴ 50	99	100
19 lbs.	(2) 60A Circuit breaker		220	16.8	57,300	6.9	52	53	60	60	104	110
			230	18.4	62,700	6.9	54	55	60	60	108	110
			240	20.0	68,200	6.9	56	57	60	60	113	125

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

⁵ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA							CBA	M88	V-042	2 THRE	E PHASE
	Model Number	No. of	Volts	kW	¹ Btuh	² Blower Motor Full		mum cuit acity	Overc	imum urrent ection		le Point r Source
	woder Number	Stages	Input	Input	Input	Load Amps	Ckt 1	Ckt 2	Ckt 1	Ckt 2	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
8 kW	ECB38-8 (16V99)	1	208	6.0	20,500	6.9	30		35		30	35
5 lbs.	Terminal block		220	6.7	22,900	6.9	31		35		31	35
			230	7.3	25,100	6.9	32		35		32	35
			240	8.0	27,300	6.9	33		35		33	35
10 kW	ECB38-10 (16W67)	1	208	7.5	25,600	6.9	35		40		35	40
6 lbs.	Terminal block		220	8.4	28,700	6.9	37		40		37	40
			230	9.2	31,400	6.9	38		40		38	40
			240	10.0	34,100	6.9	39		40		39	40
15 kW	ECB38-15CB (16W68)	1	208	11.3	38,400	6.9	48		50		48	50
12 lbs.	50A Circuit breaker		220	12.6	43,000	6.9	51		4 60		51	60
			230	13.5	47,000	6.9	52		4 60		52	60
			240	15.0	51,200	6.9	54		⁴ 60		54	60
20 kW	ECB38-20CB (16W69)	2	208	15.0	51,200	6.9	35	26	4 40	430	61	70
19 lbs.	(2) 35A Circuit breaker		220	16.8	57,300	6.9	37	28	4 40	430	64	70
			230	18.4	62,700	6.9	38	29	440	430	67	70
			240	20.0	68,200	6.9	39	30	440	35	69	70

¹ Electric heater capacity only - does not include additional blower motor heat capacity.

² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

 $^{^{\}rm 5}$ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA	١			CB	A38MV	/-048	BAN	D CE	38A8	BMV-	060	SINGL	E PHASE
	Model Number	No. of			¹ Btuh	² Blower Motor Full	(linimu Circuit mpaci	t	Ov	laximi ercurr otecti	ent		e Point r Source
	Model Number	Stages	Input	Input	Input	Load Amps	Ckt 1	Ckt 2	Ckt 3	Ckt 1	Ckt 2	Ckt 3		⁵ Maximum Overcurrent Protection
4 kW	ECB38-4 (16V86)	1	208	3.0	10,250	6.9	27			430			27	30
4 lbs.	Terminal Block ECB38-4CB (16V87)		220	3.4	11,450	6.9	28			430			28	30
	35A Circuit breaker		230	3.7	12,550	6.9	28			430			28	30
			240	4.0	13,650	6.9	29			4 30			29	30
5 kW	ECB38-5 (16V88)	1	208	3.8	12,800	6.9	31			35			31	35
4 lbs.	Terminal Block ECB38-5CB (16V89)		220	4.2	14,300	6.9	32			35			32	35
	35A Circuit breaker		230	4.6	15,700	6.9	34			35			34	35
			240	5.0	17,100	6.9	35			35			35	35
6 kW	ECB38-6 (16V90)	1	208	4.5	15,400	6.9	36			40			36	40
4 lbs.	Terminal Block ECB38-6CB (16V91)		220	5.0	17,100	6.9	37			40			37	40
	40A Circuit breaker		230	5.5	18,800	6.9	39	-		40			39	40
			240	6.0	20,500	6.9	40			40			40	40
8 kW	ECB38-8 (16V92)	2	208	6.0	20,500	6.9	45			445			45	45
5 lbs.	Terminal Block ECB38-8CB (16V93)		220	6.7	22,900	6.9	47			50			47	50
	50A Circuit breaker		230	7.3	25,100	6.9	48			50			48	50
			240	8.0	27,300	6.9	50			50			50	60
9 kW	ECB38-9CB (16V94)	2	208	6.8	23,100	6.9	49			4 50			49	50
5 lbs.	60A Circuit breaker		220	7.6	25,800	6.9	52			60			52	60
			230	8.3	28,200	6.9	54			60			54	60
			240	9.0	30,700	6.9	56			60			56	60
	ECB38-12.5CB (16V95)	2	208	9.4	32,000	6.9	27	38		30	440		65	70
10 lbs.	(1) 30A and (1) 45A Circuit breaker		220	10.5	35,800	6.9	29	40		30	440		68	70
	(.)		230	11.5	39,200	6.9	29	42		30	45		71	80
			240	12.5	42,600	6.9	31	44		435	45		74	80
15 kW	ECB38-15CB (16V96)	2	208	11.3	38,400	6.9	31	45		35	445		76	80
12 lbs.	(1) 35A and (1) 60A Circuit breaker		220	12.6	43,000	6.9	32	48		35	⁴ 50		80	90
	(1) 00/10/10/10/10/10/10/10/10/10/10/10/10/1		230	13.5	47,000	6.9	34	50		35	4 50		84	90
			240	15.0	51,200	6.9	35	52		35	60		87	90
20 kW	ECB38-20CB (16V97)	2	208	15.0	51,200	6.9	49	50		4 50	4 50		99	100
19 lbs.	(2) 60A Circuit breaker		220	16.8	57,300	6.9	52	53		60	60		104	110
			230	18.4	62,700	6.9	54	55		60	60		108	110
			240	20.0	68,200	6.9	56	57		60	60		113	125
25 kW	ECB38-25CB (16V98)	3	208	18.8	64,100	6.9	46	38	38	4 50	440	440	122	125
19 lbs.	(1) 60A and (2) 45A Circuit breaker		220	21.0	71,700	6.9	48	40	40	4 50	440	440	128	150
	()		230	23.0	78,300	6.9	50	42	42	4 50	45	45	134	150
			240	25.0	85,300	6.9	52	44	44	60	45	45	140	150

 $^{^{\}mbox{\tiny 1}}$ Electric heater capacity only - does not include additional blower motor heat capacity.

² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.

⁵ HACR type circuit breaker or fuse.

ELEC	TRIC HEAT DATA	١			CE	3A38M	V-04	8 AN	D CB	A38N	/V-060 TH	REE PHASE
	Model Number	No. of	Volts	kW	¹ Btuh	² Blower Motor Full	Cir	imum cuit acity	Overc	imum urrent ection		Point Source
	Model Number	Stages	Input	Input	Input	Load Amps	Ckt 1	Ckt 2	Ckt 1	Ckt 2	³ Minimum Circuit Ampacity	⁵ Maximum Overcurrent Protection
8 kW	ECB38-8 (16V99)		208	6.0	20,500	6.9	30		35		30	35
5 lbs.	Terminal block		220	6.7	22,900	6.9	31		35		31	35
			230	7.3	25,100	6.9	32		35		32	35
			240	8.0	27,300	6.9	33		35		33	35
10 kW	ECB38-10 (16W67)		208	7.5	25,600	6.9	35		40		35	40
6 lbs.	Terminal block		220	8.4	28,700	6.9	37		40		37	40
			230	9.2	31,400	6.9	38		40		38	40
			240	10.0	34,100	6.9	39		40		39	40
15 kW	ECB38-15CB (16W68)		208	11.3	38,400	6.9	48		50		48	50
12 lbs.	50A Circuit breaker		220	12.6	43,000	6.9	51		460		51	60
			230	13.5	47,000	6.9	52		460		52	60
			240	15.0	51,200	6.9	54		460		54	60
20 kW	ECB38-20CB (16W69)	2	208	15.0	51,200	6.9	35	26	440	430	61	70
19 lbs.	(2) 35A Circuit breaker		220	16.8	57,300	6.9	37	28	440	430	64	70
			230	18.4	62,700	6.9	38	29	440	430	67	70
			240	20.0	68,200	6.9	39	30	440	35	69	70
25 kW	ECB38-25CB (16W70)	2	208	18.8	64,100	6.9	42	33	445	435	74	80
19 lbs.	(1) 50A and (1) 40A Circuit breaker		220	21.0	71,700	6.9	44	34	445	435	78	80
	(1) 10/10/10/10/10/10/10/10/10/10/10/10/10/1		230	23.0	78,300	6.9	45	36	50	40	81	90
			240	25.0	85,300	6.9	47	38	50	40	84	90

¹ Electric heater capacity only - does not include additional blower motor heat capacity.


² Amps shown are for blower motor only.

³ Refer to National or Canadian Electrical Code manual to determine wire, fuse and disconnect size requirements. Use wires suitable for at least 167°F.

⁴ Bold text indicates that the circuit breaker on "CB" circuit breaker models must be replaced with size noted. See Replacement Circuit Breakers on page 9.


⁵ HACR type circuit breaker or fuse.

DIMENSIONS - UNIT UPFLOW POSITION

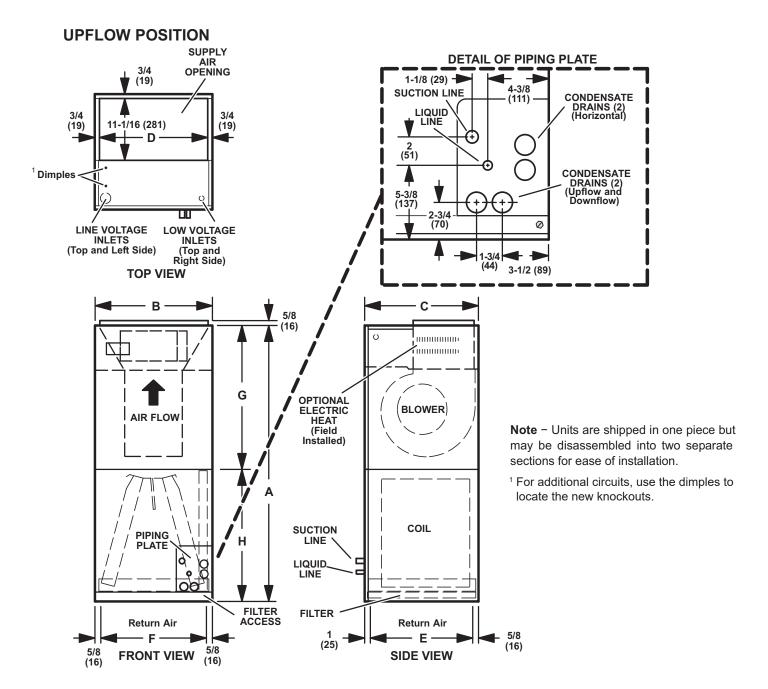

Model	1	A	E	3	C	;)	E	=		F	G	}	H	1
No.	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
CBA38MV-018/024	49-1/4	1251	21-1/4	540	20-5/8	524	19-3/4	502	19	483	20	508	24-5/8	625	24-5/8	625
CBA38MV-030 CBA38MV-036	51	1295	21-1/4	540	22-5/8	575	19-3/4	502	21	533	20	508	26-3/8	670	24-5/8	625
CBA38MV-042 CBA38MV-048	58-1/2	1486	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	30-5/8	778
CBA38MV-060	62-1/2	1588	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	34-5/8	879


DIMENSIONS - UNIT DOWNFLOW POSITION

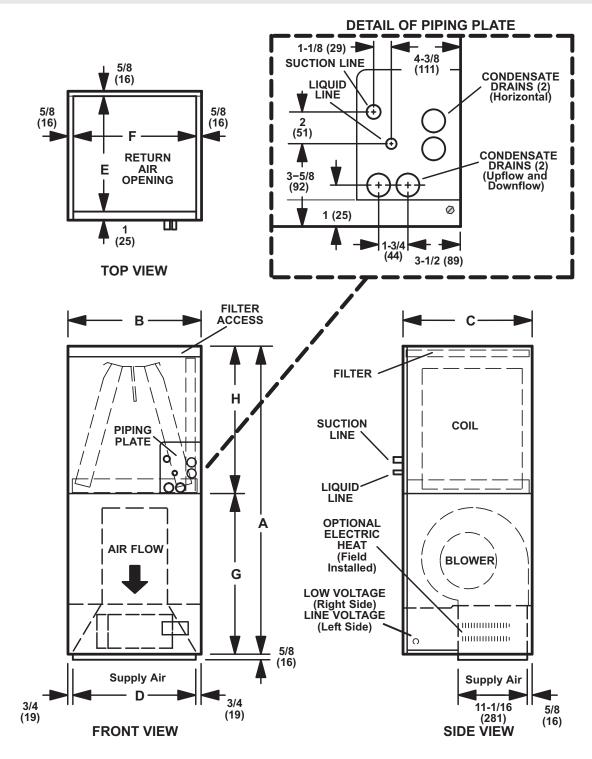


Note – Units are shipped in one piece but may be disassembled into two separate sections for ease of installation.

Model	-	4	Е	3	C	;	С)	Е	=	F	•	G	;	Н	1
No.	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
CBA38MV-018/024	49-1/4	1251	21-1/4	540	20-5/8	524	19-3/4	502	19	483	20	508	24-5/8	625	24-5/8	625
CBA38MV-030 CBA38MV-036	51	1295	21-1/4	540	22-5/8	575	19-3/4	502	21	533	20	508	26-3/8	670	24-5/8	625
CBA38MV-042 CBA38MV-048	58-1/2	1486	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	30-5/8	778
CBA38MV-060	62-1/2	1588	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	34-5/8	879

RIGHT-HAND AIR DISCHARGE

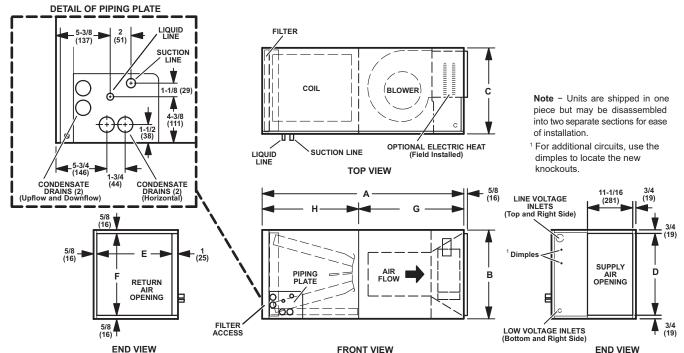


LEFT-HAND AIR DISCHARGE

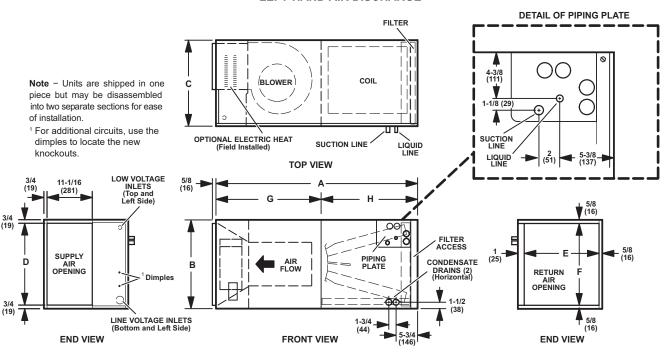


Model	-	4	Е	3	C	;	С)	E	=	F	=	G	;	Н	1
No.	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm	in	mm
CBA38MV-018/024	49-1/4	1251	21-1/4	540	20-5/8	524	19-3/4	502	19	483	20	508	24-5/8	625	24-5/8	625
CBA38MV-030 CBA38MV-036	51	1295	21-1/4	540	22-5/8	575	19-3/4	502	21	533	20	508	26-3/8	670	24-5/8	625
CBA38MV-042 CBA38MV-048	58-1/2	1486	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	30-5/8	778
CBA38MV-060	62-1/2	1588	21-1/4	540	24-5/8	625	19-3/4	502	23	584	20	508	27-7/8	708	34-5/8	879


DIMENSIONS - UNIT AIRFLOW

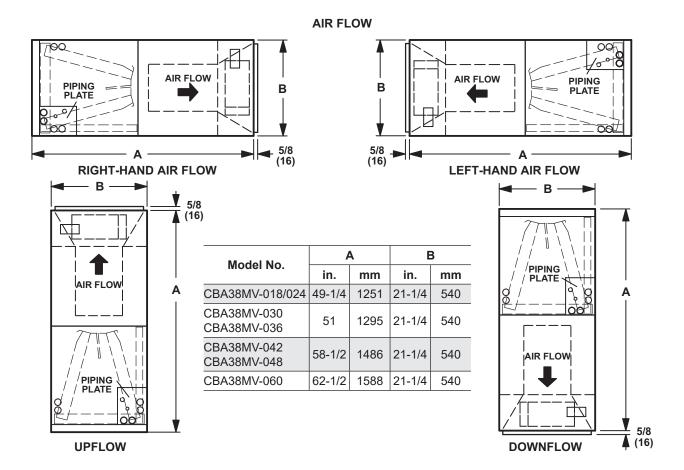

DOWNFLOW COMBUSTIBLE FLOORING BASE

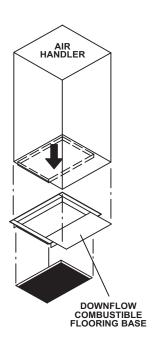

Catalog No. - 44K15

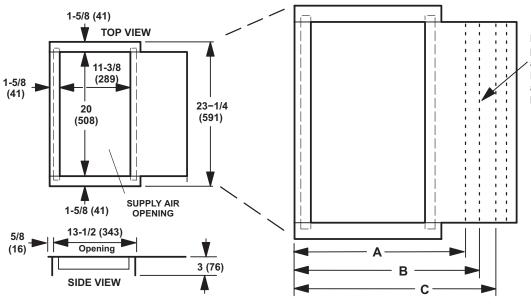

Break off extended width at pre-perforated line to fit specific air handler application.

NOTE - Width of base includes an additional 2 in. (51 mm) for air handler positioning adjustment.

Model No.	018	/024	030,	036	042, 04	48, 060
woder No.	in.	mm	in.	mm	in.	mm
Α	22-5/8	575				
В			24-5/8	625		
С					26-5/8	676

REVISIONS	
Sections	Description of Change
Electric Heat Data	Blower Motor Full Load Amps updated for 018/024 and 042 models.





Visit us at www.Lennox.com
For the latest technical information, www.LennoxPros.com
Contact us at 1-800-9-LENNOX