

INVERNESS WSD 2026 Drinking Water Quality Report

Covering Data For Calendar Year 2025

Public Water System ID: CO0203012

Esta es información importante. Si no la pueden leer, necesitan que alguien se la traduzca.

We are pleased to present to you this year's water quality report. Our constant goal is to provide you with a safe and dependable supply of drinking water. Please contact LUIS TOVAR at 303-649-9857; 720-274-8348 with any questions or for public participation opportunities that may affect water quality. **Please see the water quality data from our wholesale system(s) (either attached or included in this report) for additional information about your drinking water.**

General Information

All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency's Safe Drinking Water Hotline (1-800-426-4791) or by visiting [epa.gov/ground-water-and-drinking-water](https://www.epa.gov/ground-water-and-drinking-water).

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV-AIDS or other immune system disorders, some elderly, and infants can be particularly at risk of infections. These people should seek advice about drinking water from their health care providers. For more information about contaminants and potential health effects, or to receive a copy of the U.S. Environmental Protection Agency (EPA) and the U.S. Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by *Cryptosporidium* and microbiological contaminants call the EPA Safe Drinking Water Hotline at (1-800-426-4791).

Contaminant Information

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

- **Microbial contaminants:** viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wildlife.
- **Inorganic contaminants:** salts and metals, which can be naturally-occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining, or farming.

- **Pesticides and herbicides:** may come from a variety of sources, such as agriculture, urban storm water runoff, and residential uses.
- **Radioactive contaminants:** can be naturally occurring or be the result of oil and gas production and mining activities.
- **Organic chemical contaminants:** including synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and also may come from gas stations, urban storm water runoff, and septic systems.

In order to ensure that tap water is safe to drink, the Colorado Department of Public Health and Environment prescribes regulations limiting the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration regulations establish limits for contaminants in bottled water that must provide the same protection for public health.

Lead in Drinking Water

Lead can cause serious health effects in people of all ages, especially pregnant people, infants (both formula-fed and breastfed), and young children. Lead in drinking water is primarily from materials and parts used in service lines and in home plumbing. We are responsible for providing high quality drinking water and removing lead pipes but cannot control the variety of materials used in the plumbing in your home. Because lead levels may vary over time, lead exposure is possible even when your tap sampling results do not detect lead at one point in time.

You can help protect yourself and your family by identifying and removing lead materials within your home plumbing and taking steps to reduce your family's risk. Using a filter, certified by an American National Standards Institute accredited certifier to reduce lead, is effective in reducing lead exposures. Follow the instructions provided with the filter to ensure the filter is used properly.

Use only cold water for drinking, cooking, and making baby formula. Boiling water does not remove lead from water. Before using tap water for drinking, cooking, or making baby formula, flush your pipes for several minutes. You can do this by running your tap, taking a shower, doing laundry or a load of dishes. If you have a lead service line or galvanized requiring replacement service line, you may need to flush your pipes for a longer period. If you are concerned about lead in your water and wish to have your water tested, contact LUIS TOVAR at 303-649-9857; 720-274-8348. Information on lead in drinking water, testing methods, and steps you can take to minimize exposure is available at epa.gov/safewater/lead.

Service Line Inventory

New state and federal laws require us to inventory all water service lines in our service area to classify the material. A service line is the underground pipe that carries water from the water main, likely in the street, into your home or building. If you would like to view a copy of our service line inventory or have questions about the material of your service line, contact LUIS TOVAR at 303-649-9857; 720-274-8348.

Source Water Assessment and Protection (SWAP)

The Colorado Department of Public Health and Environment may have provided us with a Source Water Assessment Report for our water supply. For general information or to obtain a copy of the report please visit wqcdcompliance.com/ccr. The report is located under “Guidance: Source Water Assessment Reports”. Search the table using our system name or ID, or by contacting LUIS TOVAR at 303-649-9857; 720-274-8348. The Source Water Assessment Report provides a screening-level evaluation of potential contamination that *could* occur. It *does not* mean that the contamination *has or will* occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that quality finished water is delivered to your homes. In addition, the source water assessment results provide a starting point for developing a source water protection plan. Potential sources of contamination in our source water area are listed below. Please contact us to learn more about what you can do to help protect your drinking water sources, any questions about the Drinking Water Quality Report, to learn more about our system, or to attend scheduled public meetings. We want you, our valued customers, to be informed about the services we provide and the quality water we deliver to you every day. Our groundwater drinking water sources, if any, are located in ARAPAHOE county near our water system.

Our Water Sources

Sources (Water Type - Source Type)	Potential Source(s) of Contamination
<p>WELL 3R (Groundwater-Well) PURCHASED FROM DENVER (Surface Water-Consecutive Connection) WELL 1R (Groundwater-Well) WELL 4R (Groundwater-Well) PURCHASED FROM WISE CO0103843 (Surface Water-Consecutive Connection) WELL 2 (Groundwater-Well)</p>	<p>EPA Hazardous Waste Generators, EPA Chemical Inventory/Storage Sites, EPA Toxic Release Inventory Sites, Permitted Wastewater Discharge Sites, Aboveground, Underground and Leaking Storage Tank Sites, Existing/Abandoned Mine Sites, Other Facilities, Commercial/Industrial/Transportation, High Intensity Residential, Low Intensity Residential, Urban Recreational Grasses, Row Crops, Fallow, Small Grains, Pasture / Hay, Evergreen Forest, Septic Systems, Road Miles</p>

Terms and Abbreviations

- **Maximum Contaminant Level (MCL)** – The highest level of a contaminant allowed in drinking water.
- **Treatment Technique (TT)** – A required process intended to reduce the level of a contaminant in drinking water.
- **Health-Based** – A violation of either a MCL or TT.

- **Non-Health-Based** – A violation that is not a MCL or TT.
- **Action Level (AL)** – The concentration of a contaminant which, if exceeded, triggers treatment and other regulatory requirements.
- **Maximum Residual Disinfectant Level (MRDL)** – The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.
- **Maximum Contaminant Level Goal (MCLG)** – The level of a contaminant in drinking water below which there is no known or expected risk to health. MCLGs allow for a margin of safety.
- **Maximum Residual Disinfectant Level Goal (MRDLG)** – The level of a drinking water disinfectant, below which there is no known or expected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control microbial contaminants.
- **Violation (No Abbreviation)** – Failure to meet a Colorado Primary Drinking Water Regulation.
- **Formal Enforcement Action (No Abbreviation)** – Escalated action taken by the State (due to the risk to public health, or number or severity of violations) to bring a non-compliant water system back into compliance.
- **Variance and Exemptions (V/E)** – Department permission not to meet a MCL or treatment technique under certain conditions.
- **Gross Alpha (No Abbreviation)** – Gross alpha particle activity compliance value. It includes radium-226, but excludes radon 222, and uranium.
- **Picocuries per liter (pCi/L)** – Measure of the radioactivity in water.
- **Nephelometric Turbidity Unit (NTU)** – Measure of the clarity or cloudiness of water. Turbidity in excess of 5 NTU is just noticeable to the typical person.
- **Compliance Value (No Abbreviation)** – Single or calculated value used to determine if regulatory contaminant level (e.g. MCL) is met. Examples of calculated values are the 90th Percentile, Running Annual Average (RAA) and Locational Running Annual Average (LRAA).
- **Average (x-bar)** – Typical value.
- **Range (R)** – Lowest value to the highest value.
- **Sample Size (n)** – Number or count of values (i.e. number of water samples collected).
- **Parts per million = Milligrams per liter (ppm = mg/L)** – One part per million corresponds to one minute in two years or a single penny in \$10,000.
- **Parts per billion = Micrograms per liter (ppb = ug/L)** – One part per billion corresponds to one minute in 2,000 years, or a single penny in \$10,000,000.
- **Not Applicable (N/A)** – Does not apply or not available.
- **Level 1 Assessment** – A study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.
- **Level 2 Assessment** – A very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

Detected Contaminants

INVERNESS WSD routinely monitors for contaminants in your drinking water according to Federal and State laws. The following table(s) show all detections found in the period of January 1 to December 31, 2025 unless otherwise noted. The State of Colorado requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants are not expected to vary significantly from year to year, or the system is not considered vulnerable to this type of contamination. Therefore, some of our data, though representative, may be more than one-year-old.

Note: Only detected contaminants sampled within the last 5 years appear in this report. If no tables appear in this section, then no contaminants were detected in the last round of monitoring.

Disinfectants Sampled in the Distribution System

TT Requirement: At least 95% of samples per period (month or quarter) must be at least 0.2 ppm OR

If sample size is less than 40 no more than 1 sample is below 0.2 ppm

Typical Sources: Water additive used to control microbes

Disinfectant Name	Time Period	Results	Number of Samples Below Level	Sample Size	TT Violation	MRDL
Chloramine	December, 2025	Lowest period percentage of samples meeting TT requirement: 100%	0	9	No	4.0 ppm

Lead and Copper Sampled in the Distribution System

Contaminant Name	Time Period	Tap Sample Range Low - High	90 th Percentile	Sample Size	Unit of Measure	90 th Percentile AL	Sample Sites Above AL	90 th Percentile AL Exceedance	Typical Sources
Copper	03/12/2025 to 04/03/2025	0.005 to 0.338	0.29	41	ppm	1.3	0	No	Corrosion of household plumbing systems; Erosion of natural deposits
Lead	08/19/2025 to 08/21/2025	0 to 4.0	2	40	ppb	15	0	No	Corrosion of household plumbing systems; Erosion of natural deposits
Copper	08/19/2025 to	0.012 to 0.605	0.12	40	ppm	1.3	0	No	Corrosion of household plumbing

Contaminant Name	Time Period	Tap Sample Range Low - High	90 th Percentile	Sample Size	Unit of Measure	90 th Percentile AL	Sample Sites Above AL	90 th Percentile AL Exceedance	Typical Sources
	08/21/2025								systems; Erosion of natural deposits
Lead	03/12/2025 to 04/03/2025	0 to 3.0	2	41	ppb	15	0	No	Corrosion of household plumbing systems; Erosion of natural deposits

Disinfection Byproducts Sampled in the Distribution System

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure	MCL	MCLG	MCL Violation	Typical Sources
Total Haloacetic Acids (HAA5)	2025	11.59	10.04 to 13.15	2	ppb	60	N/A	No	Byproduct of drinking water disinfection
Total Trihalomethanes (TTHM)	2025	30.73	26.8 to 34.65	2	ppb	80	N/A	No	Byproduct of drinking water disinfection

Radionuclides Sampled at the Entry Point to the Distribution System

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure	MCL	MCLG	MCL Violation	Typical Sources
Gross Alpha	2025	0.7	0 to 2.1	3	pCi/L	15	0	No	Erosion of natural deposits

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure	MCL	MCLG	MCL Violation	Typical Sources
Combined Radium	2025	2.4	1.7 to 3.3	3	pCi/L	5	0	No	Erosion of natural deposits

Inorganic Contaminants Sampled at the Entry Point to the Distribution System

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure	MCL	MCLG	MCL Violation	Typical Sources
Barium	2025	0.12	0.12 to 0.12	1	ppm	2	2	No	Discharge of drilling wastes; discharge from metal refineries; erosion of natural deposits
Chromium	2025	3	3 to 3	1	ppb	100	100	No	Discharge from steel and pulp mills; erosion of natural deposits
Fluoride	2023	1.01	1.01 to 1.01	2	ppm	4	4	No	Erosion of natural deposits; water additive which promotes strong teeth; discharge from fertilizer and aluminum factories

Secondary Contaminants

Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin, or tooth discoloration) or aesthetic effects (such as taste, odor, or color) in drinking water.

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure	Secondary Standard
Sodium	2023	26	26 to 26	1	ppm	N/A

Unregulated Contaminants

EPA has implemented the Unregulated Contaminant Monitoring Rule (UCMR) to collect data for contaminants that are suspected to be present in drinking water and do not have health-based standards set under the Safe Drinking Water Act. EPA uses the results of UCMR monitoring to learn about the occurrence of unregulated contaminants in drinking water and to decide whether or not these contaminants will be regulated in the future. We performed monitoring and reported the analytical results of the monitoring to EPA in accordance with its Unregulated Contaminant Monitoring Rule (UCMR). Once EPA reviews the submitted results, the results are made available in the EPA's National Contaminant Occurrence Database (NCOD) (epa.gov/dwucmr/national-contaminant-occurrence-database-ncod) Consumers can review UCMR results by accessing the NCOD. Contaminants that were detected during our UCMR sampling and the corresponding analytical results are provided below. More information about the contaminants that were included in UCMR monitoring can be found at: drinktap.org/Water-Info/Whats-in-My-Water/Unregulated-Contaminant-Monitoring-Rule-UCMR. Learn more about the EPA UCMR at: epa.gov/dwucmr/learn-about-unregulated-contaminant-monitoring-rule or contact the Safe Drinking Water Hotline at (800) 426-4791 or epa.gov/ground-water-and-drinking-water.

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure

Contaminant Name	Year	Average	Range Low - High	Sample Size	Unit of Measure

Violations

Non-Health-Based Violations

These violations do not usually mean that there was a problem with the water quality. If there had been, we would have notified you immediately. We missed collecting a sample (water quality is unknown), we reported the sample result after the due date, or we did not complete a report/notice by the required date. Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

Name	Description	Time Period	Describe the steps taken to resolve and the anticipated resolution date:
GROSS ALPHA	FAILURE TO MONITOR AND/OR REPORT	01/01/2020 - 12/31/2025	Monitoring and reporting activities were not completed as facility was not being used, and procedures have been reviewed to support ongoing compliance with sampling and reporting requirements.
COMBINED URANIUM	FAILURE TO MONITOR AND/OR REPORT	01/01/2020 - 12/31/2025	Monitoring and reporting activities were not completed as facility was not being used, and procedures have been reviewed to support ongoing compliance with sampling and reporting requirements.



2025

Water Quality Report

INFORME DE CALIDAD DE AGUA

 DENVER WATER

WHAT IS THIS REPORT?

The Environmental Protection Agency requires public water suppliers that serve the same people year-round (community water systems) to provide consumer confidence reports to their customers. These reports are also known as annual water quality reports.

This report summarizes information regarding water sources used, any detected contaminants, compliance and educational information. **Where does your water come from?**



Denver's drinking water comes from rivers, lakes, streams, reservoirs and springs fed by high-quality mountain snowmelt. Denver Water's supply is 100% surface water that covers about 4,000 square miles of watersheds on both sides of the Continental Divide.

Mountain water sources

Denver Water's water sources include the upper South Platte River, the upper Blue River,



Bear Creek, South Boulder Creek, Ralston Creek, tributaries to the Fraser River, and the upper Williams Fork River. Denver Water stores its water in five mountain reservoirs: Antero, Eleven Mile Canyon, Cheesman, Dillon and Gross. From these reservoirs, the water is sent to the metro area through a complex system of streams, canals and pipes to be treated.

After treatment, drinking water is fed by both gravity and pumps to a system of underground, clean-water reservoirs before continuing to your home or business. More

In this report:

What we test

Denver Water has met all drinking water regulated water contaminants. Test results are on pages 6-

Monitoring requirements not

In 2024, Denver Water failed to meet two requirements. This did not pose a safety risk and not require any action from you. For details, see

Public board


The Denver Board of Water responsible for setting water rates and cost and maintenance of the water system. meetings are generally held twice a a schedule and location of board meetings, denverwater.org/BoardMeet

Obtain a paper copy of this

Paper copies of this report, in English or can be requested through Denver Water Care **303-893-**, Monday through from 7:30 a.m. to 5:30 p.m. You can also CustomerCare@denverwater.

Información importante acerca de la calidad

Para recibir la versión en español del Calidad de Agua de 2025 de Denver Water, a Servicio al **303-893-** o denverwater.org/2025CalidadD

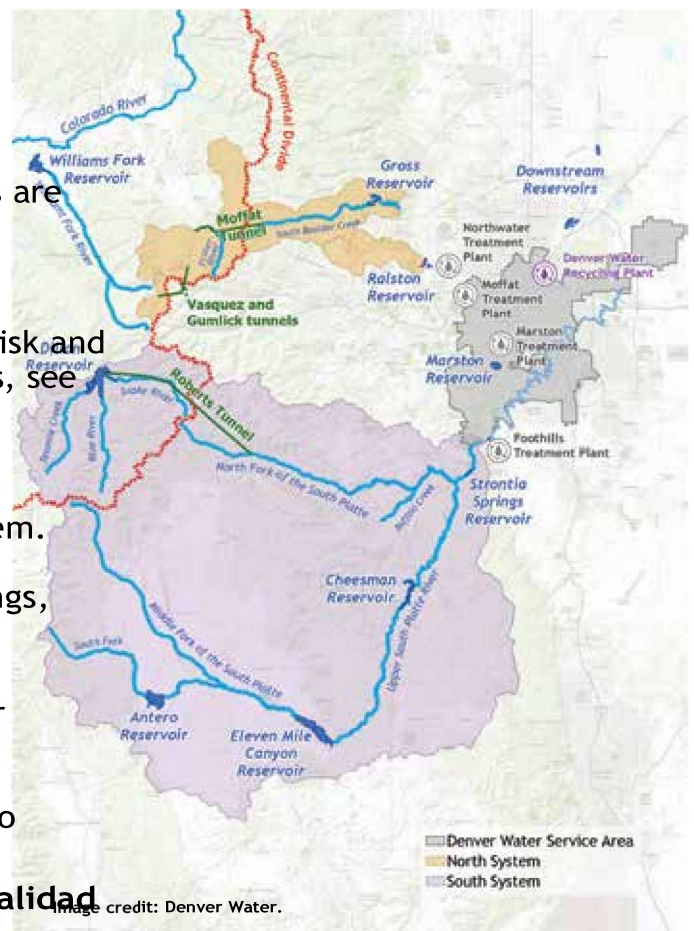

than 3,000 miles of water mains – enough to stretch from Los Angeles to New York – carry water to Denver Water customers.

Source water assessment

The Colorado Department of Public Health and Environment has completed a source water assessment of the potential for contaminants reaching any of Denver Water’s three terminal reservoirs at Strontia Springs,



Marston and Ralston, the last stop for water before it is treated. The potential sources of contamination that may exist are:

- EPA areas of concern.
- permitted wastewater discharge sites.
- above-ground, underground and leaking storage tank sites.
- solid waste sites.
- existing or abandoned mine sites. *Continued on the next page.*

- other facilities.
- commercial, industrial and transportation activities.
- residential, urban recreational grasses.
- quarries, strip mines and gravel pits.
- agriculture.
- forests.
- septic systems; oil and gas wells and roads.

The Source Water Assessment Report provides a screening level evaluation of potential contamination that could occur. It does not mean that the contamination has or will occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that high-quality drinking water is delivered to your home.

For general information, or to obtain a copy of the report, please visit wqcdcompliance.com/ccr. The report is located under “Guidance: Source Water Assessment Reports.” Search the table using 116001, Denver Water Board, or call Denver Water Customer Care at **303-893-2444**.

DENVER WATER'S SYSTEM

Devoted to water quality

Denver Water proudly serves high-quality water to 1.5 million people in the city of Denver and many surrounding suburbs. Since 1918, we have expertly planned, developed and operated a complex system that provides clean, safe, great-tasting water. Denver Water is a public agency funded by water rates, new tap fees and the sale of hydropower, not taxes. We are Colorado's oldest and largest water utility – Denver Water has a total water service area of approximately 300 square miles.

Denver Water serves 25% of the state's population with less than 2% of all the water used in the state. The natural environment is our lifeline, and we help protect it by promoting wise water use. In 2024, we collected about 63,000 water samples and conducted about 145,000 tests. Denver Water is required by state and federal law to monitor for – and provide this report on – regulated contaminants in drinking water.

Denver Water also goes above and beyond these requirements to monitor for additional compounds in drinking water. This information is available on our website at denverwater.org/TreatedWater.

WATER AT A GLANCE

All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the

water poses a health risk. In order to ensure that tap water is safe to drink, the Colorado Department of Public Health and Environment's regulations set limits on the

amount of certain contaminants in water provided by public water

SOURCES OF DRINKING WATER



Photo credit: Denver Water.

Sources of drinking water include rivers, lakes, streams, ponds, reservoirs, springs and wells. As water travels over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material. It can also pick up substances resulting from human activity and the presence of animals. Contaminants may include the following:

Microbial contaminants

Viruses, bacteria and other microbes that may come from sewage treatment plants, septic systems, agricultural livestock operations and wildlife.

Inorganic contaminants

Salts and metals, which can naturally occur or result from urban stormwater runoff, industrial or domestic wastewater discharges, oil and gas production, mining or farming.

Pesticides and herbicides

Chemical substances resulting from a variety of sources, such as agricultural and urban stormwater runoff, and residential uses.

Organic chemical contaminants

Substances including synthetic and volatile organic chemicals, which are byproducts of industrial processes and petroleum production, and also may come from gas stations, urban stormwater runoff and septic systems.

Radioactive contaminants

Substances that can be naturally occurring or be the result of oil and gas production, and mining activities.

systems. The Food and Drug Administration sets limits for contaminants in bottled water to provide the same protection for public health.

More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency Safe Drinking Water Hotline at **800-426-4791** or by visiting epa.gov/ground-water-and-drinking-water.

Some people may be more vulnerable to contaminants

Denver Water is committed to delivering safe water to our customers. Lead can get into water as it moves through customer-owned water service lines and household plumbing

in drinking water than the general population. Immunocompromised people, such as people with cancer undergoing chemotherapy, people who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly and infants, can be particularly at risk of infections.

Those at risk should seek advice about drinking water from their health care providers. Guidelines from the fixtures made before 2014 do not meet today's "lead-free" requirements.

Lead exposure can cause serious health problems for all

EPA and the Centers for Disease Control and Prevention on appropriate ways to lessen the risk of infection by cryptosporidium and other microbial contaminants are available from the Safe Drinking Water Hotline, **800-426-4791**.

The Lead Reduction Program has five main components:

- Managing our system's water chemistry, including an increased pH level to reduce the risk of lead

LEAD REDUCTION PROGRAM

that contain lead.

Service lines bring water into a home or building from Denver Water's main delivery pipe in the street. In Denver Water's experience, homes built prior to 1951 are more likely to have lead service lines. Homes built before 1987 may have lead solder connecting copper pipes in their plumbing. Faucets and

age groups, especially pregnant people and young children.

To address this issue, Denver Water has launched the Lead Reduction Program, which was approved in December 2019 by the Environmental Protection Agency and Colorado Department of Public Health and Environment.

getting into drinking water from lead service lines or household plumbing.

- Maintaining (and updating) a publicly accessible inventory of all customer-owned lead service lines in Denver Water's service area. This interactive map is available at denverwater.org/Lead.

- Providing a free water pitcher and filters that are certified to remove lead to all customers suspected of having a lead service line until their line is replaced, and for six months after.
- Replacing the entire inventory of lead service lines within our service area with copper lines at no direct charge to the customer. When initially launched, all lead service lines were slated to be removed by 2035. Progress on service line replacements can be viewed on the program dashboard at denverwater.org/Lead.
- Ongoing communication, outreach and education to

reach and engage with the diverse communities we serve.

How the program came to be

Since 1992, as part of the EPA’s Lead and Copper Rule, Denver Water has monitored water quality in homes that have service lines or plumbing that contain lead.

Only once, in 2012, did test results from those homes indicate additional action was needed to protect public health, and Denver Water remains in compliance today. However, Denver Water is still required to implement the best plan to reduce the risk of lead in tap water in homes with lead-containing plumbing or service lines.

That plan is the Lead Reduction Program, which is now underway. Learn more about this effort and the program at denverwater.org/Lead.

If you are concerned about lead, you can request to have your water tested. Denver Water customers can request a free lead test kit at denverwater.org/Leadtest.

Information on lead in drinking water, testing and steps to minimize exposure is available from the Safe Drinking Water Hotline at **800-426-4791**, at epa.gov/safewater/lead and at denverwater.org/Lead.

HOW TO MINIMIZE YOUR EXPOSURE TO LEAD

You share the responsibility of protecting yourself and your family from lead in your home's plumbing. You can take the following actions to reduce your household's risk of exposure.

Flush If water has not particles been used in your old lead service



Replace old the property line.



they may have trapped fixtures Replace from

for a few hours, such as faucets and indoor first thing in the morning or plumbing with "lead-free" components. Maintain filters when coming home from work,



run Faucets and fixtures installed prior to Follow the manufacturer's cold water from the kitchen or any 2014 do not meet today's requirements maintenance schedule

bathroom faucet for five minutes. for "lead-free" fixtures. for the filtration system

You can also run the dishwasher, you have, including water pitchers, take a shower or do a load of Clean aerators faucet-mounted filters, under-sink

laundry to help flush water in your A faucet aerator is a small screen filter or

refrigerator filters. The home's internal plumbing before added to the end of a faucet to mix air results of your water quality test may

drinking, cooking or preparing with water to reduce the flow of water help to determine if you still wish to infant formula. coming from the faucet. Remove and continue

using a filter. Boiling the clean the aerators on your faucets, as water does not remove lead.

You can find instructional videos on flushing and filter use at denverwater.org/Lead.

IS THERE A PRESENCE OF

CRYPTOSPORIDIUM AND GIARDIA?

Denver Water has tested for *Cryptosporidium* (crypto) and giardia in both raw and treated water since the 1980s. Since that time, Denver Water has never detected a viable indication of either in the drinking water.

Crypto and giardia are microscopic organisms that, when ingested, can

cause diarrhea, cramps, fever and other gastro-intestinal symptoms. Crypto and giardia are usually spread through means other than drinking water.

While most people readily recover from the symptoms, crypto and giardia can cause more serious illness in people with compromised immune

SIGNIFICANT DEFICIENCY

Public water suppliers are required to notify customers of unresolved deficiencies in design, operation, maintenance or administration, or a failure or malfunction in a system component, including sources, treatment, storage or distribution system that have

2022, i
deficie
conditi
eviden
drink v
situati
• Sto
insp
hat
Ave
inst

the potential to cause risks to the reliable delivery of safe drinking water.

What happened?

During a state inspection in September

Denver Water is repairing the hatches according to the corrective action plan; repairs will be completed by May 2025.

How did this impact drinking water quality?

There is no evidence that the water you drink was affected by this situation.

What has been done to correct this situation?

Denver Water worked with the state health department to develop a corrective action plan and make necessary repairs.

systems. The organisms are in many of Colorado's rivers and streams and are a result of animal wastes in the watershed. At the treatment plants, Denver Water removes crypto and giardia through effective filtration, and giardia is also killed by disinfection.

WATER QUALITY VIOLATIONS

Combined Uranium Sampling

In 2024, our water system was in violation of a drinking water monitoring requirement. Although this situation did not pose a safety risk and does not require you to take action, as our customers you have a right to know what happened and what we did to correct this situation.

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of regular monitoring are an indicator of whether or not our drinking water meets health standards. During the first quarter of 2024, monitoring and testing for

combined uranium at the Moffat Treatment Plant was not completed.

Turbidity Monitoring

In 2024, our water system was in violation of a state drinking water monitoring requirement at one of our treatment plants. Although this situation did not pose a safety risk and does not require you to take action, as our customers you have a right to know what happened and what we did to correct this situation.

What happened?

We are required to monitor your drinking water for specific contaminants on a regular basis. Results of

regular monitoring are an indicator of whether our drinking water meets health standards. During the first quarter of 2024 there was a 17-hour lapse in monitoring and testing for turbidity at one of our 17 **What happened?**

Combined uranium sampling at Moffat Treatment Plant is a quarterly requirement and was automatically scheduled for collection in January 2024. The treatment plant went offline January 9th, 2024 and the collection was not rescheduled when Moffat Treatment Plant came back online, which resulted in the monitoring violation.

How did this impact water quality? Five years of historical combined uranium results at Moffat Treatment Plant show no detection of uranium. Additionally, uranium was sampled monthly during 2024 while

Moffat Treatment Plant was online during subsequent quarters, and no uranium was detected. Given historical and ongoing results, we do not believe there is a risk to public health.

regulatory turbidity meters at Foothills Treatment Plant due to lack of water flow to that specific meter. Turbidity measures suspended material in water, or, how clear the water is.

How did this impact water quality? Turbidity at the treatment plant was confirmed to be within acceptable ranges at alternate sampling points during the 17-hour time lapse. Given results at the other 16 turbidity meters and all other water quality

parameters within regulatory limits, we do not believe that water quality was impacted during the lapse in turbidity measurements at the single meter

What was done?

- A new alarm system was programmed to notify treatment plant staff when turbidity

What was done?

- Instituted monthly sampling for combined uranium at Moffat Treatment Plant to ensure redundancy in our sampling program.
- Developed procedure and trained staff on scheduling and verifying collection of compliance drinking water samples in tandem with plant outage schedules in accordance with our state compliance monitoring schedule.

This problem has been resolved. For more information, please contact Denver Water Customer Care,

303-893-2444, 7:30 a.m.-5:30 p.m., Monday through Friday.

instrumentation flow rates are outside of manufacturer recommended settings. The alarms trigger

immediate intervention and investigation to restore flow or further repair.

- All turbidity instrument flow alarm functions were then tested and confirmed to be in working order. This change in alarm settings supplement instrument checks done on a regular shift by shift basis to ensure all turbidity instruments have correct flow and meet manufacturer settings.

The problem was resolved in March 2024. For more information, please contact Denver Water Customer Care, 303-893-2444, 7:30 a.m.-5:30 p.m., Monday through Friday.

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

What is Denver Water doing about PFAS?

Denver Water is committed to ensuring a clean, safe water supply for our customers that meets or goes beyond state and federal drinking water standards.

We have tested for PFAS-related compounds in the source water that comes into our treatment plants and the drinking water that leaves the plants since 2017 and have not detected anything above the Environmental Protection Agency's new regulatory limits.

Learn more about PFAS monitoring at denverwater.org/PFAS.

Fluoride in Denver Water's treated water

Fluoride is a naturally occurring compound in Denver Water's source water. It enters the water when fluoriderich minerals in soils and rock dissolve.

The Centers for Disease Control and Prevention recognizes the widespread adoption of community fluoridation as one of the 10 greatest public health achievements of the 20th century.

Since Denver Water began monitoring and managing the level of fluoridation in our water back in 1953, we have relied on the latest science from the foremost national and local authorities to inform our policy.


Learn more at denverwater.org/Fluoride.

THE TREATMENT PROCESS

The treatment process consists of five steps:

1 COAGULATION/ FLOCCULATION

Raw water is drawn into mixing basins at our treatment plants where we add positively charged coagulant and polymer to bond with the negatively charged particles that are suspended in the water that we want to remove. As the negatively charged particles and the positively charged coagulants are joined together, they form larger particles called floc.




SEDIMENTATION

Over time, the now larger floc particles become heavy enough to settle to the bottom of a basin from which sediment is removed.



FILTRATION

The water is then filtered through layers of filter media made of anthracite coal. As the water moves through the filter media, larger particles get caught in the spaces between the grains of anthracite, and clear water emerges.




DISINFECTION

As protection against any bacteria, viruses and other microbes that might remain, disinfectant is added before the water flows into underground reservoirs throughout the distribution system and into your home or business. Denver Water carefully monitors the amount of disinfectant added to maintain quality of the water at the farthest reaches of the system.



5 CORROSION CONTROL

Treatment operators maintain the water's pH by adding alkaline substances to make the water less corrosive. This helps strengthen an existing coating on the inside of water service lines. The coating reduces the potential for lead to get into the water.



REGULATED WATER CONTAMINANTS: WHAT IS IN THE WATER?

TERMS, ABBREVIATIONS AND SYMBOLS

Some of the terms, abbreviations and symbols contained in this report are unique to the water industry and might not be familiar to all customers. Terms used in the table are explained below.

action level (AL)	locational running annual average (LRAA)	(ppm = mg/L). One part per million
		Concentration of a contaminant that, The average of sample results for samples corresponds to one minute in two years or if exceeded, triggers treatment or collected at a particular monitoring location a single penny in \$10,000. other requirements that a water system during the most recent four calendar quarters.
		must follow.
	picocuries per liter (pCi/L)	
	maximum contaminant level (MCL)	Measure of radioactivity in water.
average		Highest level of a contaminant allowed in drinking water. MCLs are set as close to
Typical value.	range (R)	the maximum contaminant level goal as Lowest value to the highest value.
below reporting level (BRL)	feasible using the best available treatment	
	Below the reportable level for an analysis technology.	running annual average (RAA)
	or below the lowest reliable level that The average of sample results for samples can be measured.	collected during the most
	maximum contaminant level goal (MCLG)	recent four
		Level of a contaminant in drinking water calendar quarters.
compliance value	below which there is no known or expected	
	Single or calculated value used to risk to health. MCLGs allow for a margin	sample size
	determine if a regulatory contaminant of safety. Number or count of values. (i.e., number of level is met. Examples of calculated water samples collected).	values include average, 90th percentile, maximum residual disinfection level
	running annual average, locational (MRDL) secondary maximum contaminant level running annual average. Highest level of a disinfectant allowed in (SMCL)	
	drinking water. There is convincing evidence	Non-enforceable, recommended limits for
contaminant	that the addition of disinfectant is necessary	substances that may affect the taste, odor, Potentially harmful physical, biological, to control microbial contaminants. color, or other aesthetic qualities of chemical or radiological substance. drinking water.
	maximum residual disinfection level goal	
formal enforcement action (MRDLG)		treatment technique (TT)
	Escalated action taken by the state (due	The level of a drinking water disinfectant, Required process intended to reduce the to the risk to public health, or number below which there is no known or expected level of a contaminant in drinking water. or severity of violations) to bring a risk to health. MRDLGs do not reflect noncompliant water system back the benefits of the use of disinfectants to turbidity into compliance. control microbial contaminants. Measure of suspended material in water. In

the water field, a turbidity measurement, **health-based nephelometric turbidity unit (NTU)** expressed in nephelometric turbidity units. Violation of either a maximum Measure of the clarity or cloudiness of (NTU), is used to indicate clarity of water. contaminant level or treatment technique. water. Turbidity in excess of 5 NTU is just noticeable to the typical person. **unregulated contaminant monitoring rule**

gross alpha **five (UCMR5)**
 Gross alpha particle activity compliance **non-health-based** The fifth list of unregulated contaminants, value. It includes **Level 1 assessment** A violation that is not a maximum created by the Environmental Protection Agency, to be monitored by identify contaminant level or treatment technique. Agency, to be monitored by public water potential problems and determine (if systems. A new list is determined every possible) why total coliform bacteria have **not applicable (N/A)** five years. been found in our water system. Does not apply or not available.

variance and exemptions
Level 2 assessment **parts per billion (ppb)** Department permission not to meet A very detailed study of the water Parts per billion = Micrograms per liter maximum contaminant level or treatment system to identify potential problems (ppb = ug/L). One part per billion technique under certain conditions. and determine (if possible) why an corresponds to one minute in 2,000 years E. coli maximum contaminant level or a single penny in \$10 million. **violation** violation has occurred and/or why total Failure to meet a Colorado primary drinking coliform bacteria have been found in **parts per million (ppm)** water regulation. our water system on multiple occasions. Parts per million = Milligrams per liter

REGULATED WATER CONTAMINANTS: WHAT WE TEST FOR

Data collected throughout 2024
 Denver Water monitors for the list of regulated parameters below in our treated drinking water. Sample points include entry points to the distribution system from our four treatment plants – Foothills, Marston, Moffat, Northwater – and sites throughout Denver Water’s distribution system.

Inorganic Chemicals	Volatile Organic Chemicals
---------------------	----------------------------



Antimony	Thallium	Benzene	1,2-Dichloropropane	Trichloroethylene
Arsenic	Sodium	Carbon Tetrachloride	Ethylbenzene	Xylenes (total)
Barium	Total Chlorine	1,2-Dichloroethane	Monochlorobenzene	Vinyl Chloride
Beryllium	Fluoride	o-Dichlorobenzene	Styrene	
Cadmium	Nitrate	p-Dichlorobenzene	Tetrachloroethylene	
Chromium	Nitrite	1,1-Dichloroethylene	Toluene	
Mercury	Lead	cis-1,2-Dichloroethylene	1,2,4-Trichlorobenzene	
Nickel	Copper	trans-1,2-Dichloroethylene	1,1,1-Trichloroethane	
Selenium		Dichloromethane	1,1,2-Trichloroethane	
Synthetic Organic Chemicals		Disinfection Byproducts		
1,2-Dibromo-3-chloropropane	Endothall	Haloacetic Acids (HAA5) are regulated as the sum of the five contaminants listed below:	Total Trihalomethanes (TTHM) are regulated as the sum of the four contaminants listed below:	
2,4,5-TP	Endrin	Dibromoacetic Acid	Chloroform	
2,4-D	Ethylene dibromide	Dichloroacetic Acid	Bromodichloromethane	
Aldicarb	Heptachlor	Monobromoacetic Acid	Dibromochloromethane	
Aldicarb sulfone	Heptachlor Epoxide	Monochloroacetic Acid	Bromoform	
Aldicarb sulfoxide	Hexachlorobenzene	Trichloroacetic Acid		
Atrazine	Hexachlorocyclopentadiene	Radiological Contaminants		
Benzo(a)pyrene	Lasso (Alachlor)	Gross Alpha Emitters excluding Uranium		
BHC-Gamma	Methoxychlor	Combined Radium		
Carbofuran	Oxamyl	Combined Uranium		
Chlordane	Pentachlorophenol	Microbiological Contaminants		
Dalapon	Picloram	Total Coliform		
Di(2-ethylhexyl) adipate	Polychlorinated Biphenyls	<i>E. coli</i>		
Di(2-ethylhexyl) phthalate	Simazine	Other Regulated Contaminants		
Dinoseb	Toxaphene	Total Organic Carbon		
Diquat		Turbidity		

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Foothills Treatment Plant, one entry point to the Denver Water distribution system, in 2024. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic Contaminants Detected at the Entry Point to the Distribution System – Foothills

Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Barium	2024	Monthly	34.0	30.0-36.5	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Fluoride	2024	Monthly	675	530-930	ppb	4,000 (2,000 is SMCL)*	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories.
Nitrate as N	2024	Monthly	107	BRL-144	ppb	10,000	10,000	✓	Runoff from fertilizer use, leaching from septic tanks and sewage, erosion of natural deposits.
Nickel	2024	Monthly	1.10	1.0-1.2	ppb	N/A	N/A	✓	Discharge from industrial uses such as transportation, chemical industry, electrical equipment and construction.
Sodium	2024	Monthly	19,520	17,700-21,100	ppb	N/A	N/A	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Summary of Turbidity Sampled at the Entry Point to the Distribution System – Foothills

Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2024	Daily	Highest single measurement: 0.131 NTU (August)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff
Turbidity	2024	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU.	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total Organic Carbon (Disinfection Byproducts Precursor) Removal Ratio of Raw and Finished Water – Foothills

Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2024	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/ or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Radiologicals Detected at the Entry Point to the Distribution System – Foothills

Chemical Parameters	Year	Sampling Frequency	Average	Result	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Combined Radium (Ra-226 and Ra-228)	2021	6-9 years	0.75	BRL-1.5	pCi/L	5	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Gross Alpha (excluding Uranium)	2024	6-9 years	N/A	1.8	pCi/L	15	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Combined Uranium	2024	Monthly	Average	Range	ppb	30	0	✓	Erosion of natural deposits, mine drainage.
			0.1	BRL-0.5					

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Marston Treatment Plant, one entry point to the Denver Water distribution system, in 2024. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic Contaminants Detected at the Entry Point to the Distribution System – Marston

Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
---------------------	------	--------------------	---------	-------	-----------------	-----	------	--------------	-----------------

Arsenic	2024	Monthly	0.1	BRL-0.8	ppb	10	0	✓	Erosion of natural deposits, discharge of drilling wastes
Barium	2024	Monthly	39.9	33.9-49.9	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Fluoride	2024	Monthly	636	510-760	ppb	4,000 (2,000 is SMCL)*	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories
Nitrate as N	2024	Monthly	119	58-167	ppb	10,000	10,000	✓	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits.
Nickel	2024	Monthly	1.65	1.0-2.3	ppb	N/A	N/A	✓	Discharge from industrial uses such as transportation, chemical industry, electrical equipment & construction.
Sodium	2024	Monthly	23,350	19,100-29,300	ppb	N/A	N/A	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water

Summary of Turbidity Sampled at the Entry Point to the Distribution System – Marson

Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2024	Daily	Highest single measurement: 0.129 NTU (February)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff
Turbidity	2024	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total Organic Carbon (Disinfection Byproducts Precursor) Removal Ratio of Raw and Finished Water – Marston

Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2024	Once per month	**Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Radiologicals Detected at the Entry Point to the Distribution System – Marston

Chemical Parameters	Year	Sampling Frequency	Average	Result	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Combined Radium (Ra-226 and Ra-228)	2021	6-9 years	0.95	BRL-1.9	pCi/L	5	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Gross Alpha (excluding Uranium)	2024	6-9 years	N/A	2.7	pCi/L	15	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Combined Uranium	2024	Monthly	Average	Range	ppb	30	0	✓	Erosion of natural deposits, mine drainage.
			0.2	BRL-1.4					

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Moffat Treatment Plant, one entry point to the Denver Water distribution system, in 2024. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic Contaminants Detected at the Entry Point to the Distribution System – Moffat

Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
---------------------	------	--------------------	---------	-------	-----------------	-----	------	--------------	-----------------



Barium	2024	Monthly	21.7	18.9-26.8	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Chromium	2024	Monthly	0.33	BRL-1.0	ppb	100	100	✓	Discharge from steel and pulp mills; erosion of natural deposits.
Fluoride	2024	Monthly	585	480-640	ppb	4,000 (2,000 is SMCL)*	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories.
Nitrate as N	2024	Monthly	86	76-93	ppb	10,000	10,000	✓	Runoff from fertilizer use, leaching from septic tanks and sewage, erosion of natural deposits.
Sodium	2024	Monthly	12,230	11,300-12,900	ppb	N/A	N/A	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Summary of Turbidity Sampled at the Entry Point to the Distribution System – Moffat

Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2024	Daily	Highest single measurement: 0.208 NTU (July)	NTU	Maximum 1 NTU for any one single measurement	✓	Soil runoff
Turbidity	2024	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total Organic Carbon (Disinfection Byproducts Precursor) Removal Ratio of Raw and Finished Water – Moffat

Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2024	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (THMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Radiologicals Detected at the Entry Point to the Distribution System – Moffat

Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Combined Radium (Ra-226 and Ra-228)	2021	6-9 years	1.1	BRL-2.1	pCi/L	5	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Gross Alpha (excluding Uranium)	2023	6-9 years	3	1.1-4.8	pCi/L	15	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Combined Uranium	2024	Monthly	BRL	BRL	ppb	30	0	✓	Erosion of natural deposits, mine drainage.

The data tables below include regulated contaminants from page 7 that were monitored for and detected at Northwater Treatment Plant, one entry point to the Denver Water distribution system, in 2024. If a contaminant from page 7 is not displayed in these tables, then it was not detected above the reporting limit at the sample location.

Inorganic Contaminants Detected at the Entry Point to the Distribution System – Northwater

Chemical Parameters	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Barium	2024	Monthly	23.4	17.3-30.2	ppb	2,000	2,000	✓	Erosion of natural deposits, discharge of drilling wastes.
Chromium	2024	Monthly	0.80	BRL-1.1	ppb	100	100	✓	Discharge from steel and pulp mills; erosion of natural deposits.

Fluoride	2024	Monthly	251	BRL-600	ppb	4,000 (2,000 is SMCL)*	4,000	✓	Erosion of natural deposits, water additive that promotes strong teeth, discharge from fertilizer and aluminum factories.
Nitrate as N	2024	Monthly	76	60-93	ppb	10,000	10,000	✓	Runoff from fertilizer use; leaching from septic tanks, sewage; erosion of natural deposits.
Sodium	2024	Monthly	13,844	10,200-16,500	ppb	N/A	N/A	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor or color) in drinking water.

Summary of Turbidity Sampled at the Entry Point to the Distribution System – Northwater

Chemical Parameters	Year	Sampling Frequency	Level Found	Unit of Measure	Treatment Technique Requirement	Standard Met	Typical Sources
Turbidity	2024	Daily	Highest single measurement: 0.141 NTU (October)	NTU	Maximum 1 NTU for any one single measurement.	✓	Soil runoff
Turbidity	2024	Daily	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	NTU	In any month, at least 95% of samples must be less than 0.3 NTU.	✓	Soil runoff

Turbidity has no health effects. However, turbidity can interfere with disinfection and provide a medium for microbial growth. Turbidity may indicate the presence of disease-causing organisms. These organisms include bacteria, viruses and parasites that can cause symptoms such as nausea, cramps, diarrhea and associated headaches.

Total Organic Carbon (Disinfection Byproducts Precursor) Removal Ratio of Raw and Finished Water – Northwater

Chemical Parameters	Year	Frequency	Treatment Technique Requirement	Standard Met	Typical Sources
Total Organic Carbon Ratio	2024	Once per month	Denver Water uses enhanced treatment to remove the required amount of natural organic material and/or demonstrates compliance with alternative criteria.	✓	Natural organic matter present in the environment.

Total organic carbon (TOC) has no health effects. However, total organic carbon provides a medium for the formation of disinfection byproducts including trihalomethanes (TTHMs) and haloacetic acids (HAA5s). Drinking water containing these byproducts in excess of the MCL may lead to adverse health effects, liver or kidney problems, or nervous system effects, and may lead to an increased risk of getting cancer.

Radiologicals Detected at the Entry Point to the Distribution System – Northwater

Chemical Parameters	Year	Sampling Frequency	Average	Result	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Gross Alpha (excluding Uranium)	2024	Quarterly	BRL	BRL	pCi/L	15	0	✓	Erosion of natural deposits, mine drainage, industrial or manufacturing discharges.
Combined Uranium	2024	Monthly	BRL	BRL	ppb	30	0	✓	Erosion of natural deposits, mine drainage.

The following data tables provide regulated contaminants in Denver Water's distribution system.

Lead and Copper Sampled in the Distribution System

Contaminant Name	Period	Tap Sample Range	90th Percentile	Sample Size	Unit of Measure	90th Percentile Action Level	Sample Sites Above Action Limit	Standard Met	Typical Sources
Copper	1/1/2024 - 6/30/2024	BRL-826	60	402	ppb	1,300	0	✓	Corrosion of household plumbing; erosion of natural deposits.
Lead	1/1/2024 - 6/30/2024	BRL-44.6	4	457	ppb	15	7	✓	Corrosion of household plumbing; erosion of natural deposits.
Copper	7/1/2024 - 12/31/2024	BRL-261	60	478	ppb	1,300	0	✓	Corrosion of household plumbing; erosion of natural deposits.
Lead	7/1/2024 - 12/31/2024	BRL-35.9	3.6	478	ppb	15	3	✓	Corrosion of household plumbing; erosion of natural deposits.

Microbial Contaminants Regulated in the Distribution System

Name	Year	Sampling Frequency	MCL	MCLG	Unit of Measure	Highest Monthly Percentage	Number of Positives	Standard Met	Typical Sources
Total Coliform (T. coli)	2024	Daily	No more than 5% positive per month	0	Present/Absent	No positive samples in 2024	0 out of 4,723 total samples 0; 0 <i>E. coli</i> positive samples	✓	Naturally present in the environment.

Disinfectants Sampled in the Distribution System*

Name	Year	Results	Number of Samples Below Level	Frequency	MRDL	Standard Met	Typical Sources
Disinfectant as Total Cl2	2024	Lowest period percentage of samples above 0.2 ppm: 100%	0	Daily	4.0 ppm	✓	Drinking water disinfectant used to control microbial growth.

*Treatment technique requirement: at least 95% of samples per period (month or quarter) must be at least 0.2 ppm.

Disinfection Byproducts Sampled in the Distribution System

Name	Year	Sampling Frequency	Highest Locational RAA	Range	Unit of Measure	MCL	MCLG	Standard Met	Typical Sources
Total Trihalo-methanes (TTHM)	2024	Quarterly	37.9	16.4-64.7	ppb	80	N/A	✓	Byproduct of drinking water disinfection.
Haloacetic Acids (HAA5s)	2024	Quarterly	22.9	7.7-37.2	ppb	60	N/A	✓	Byproduct of drinking water disinfection.

The data tables below provide information on unregulated parameters that were detected in the Denver Water distribution system.

Water Quality Parameters with Secondary Maximum Contaminant Levels Sampled in the Distribution System

Name	Year	Sampling Frequency	Average	Range	Unit of Measure	MCL	SMCL*	Standard Met	Typical Sources
Aluminum	2024	Quarterly	39.5	17.5-81.0	ppb	N/A	50-200	✓	Erosion of natural deposits.
Chloride	2024	Quarterly	21,400	8,700-34,500	ppb	N/A	250,000	✓	Naturally occurring; road salt.
Copper	2024	Quarterly	5.9	BRL-69.5	ppb	N/A	1,000	✓	Corrosion of household plumbing; erosion of natural deposits.
Manganese	2024	Quarterly	2.5	BRL-10.6	ppb	N/A	50	✓	Naturally occurring.
Sulfate	2024	Quarterly	49,200	22,000-69,000	ppb	N/A	250,000	✓	Naturally occurring.
Zinc	2024	Quarterly	2.5	BRL-11.1	ppb	N/A	5,000	✓	Naturally occurring.

*Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin or tooth discoloration) or aesthetic effects (such as taste, odor, or color) in drinking water.

Additional Water Quality Parameters Sampled in the Distribution System

Name	Year	Sampling Frequency	Average	Range	Unit of Measure	Typical Sources
Alkalinity	2024	Monthly	62,200	44,000-81,000	ppb	Erosion of natural deposits.
Total Hardness	2024	Quarterly	89,000	48,000-116,000	ppb	Erosion of natural deposits.
Conductivity	2024	Quarterly	296	140-410	µs/cm	Naturally occurring.
Potassium	2024	Quarterly	1,700	810-2,200	ppb	Erosion of natural deposits.
Calcium	2024	Quarterly	25,300	15,400-33,100	ppb	Erosion of natural deposits.
Magnesium	2024	Quarterly	6,400	2,400-8,200	ppb	Erosion of natural deposits.
Boron	2024	Quarterly	12.1	BRL-19.8	ppb	Erosion of natural deposits.

These parameters do not have an EPA MCL or SMCL, but can be helpful in understanding the buffering capacity and mineral content of the water. Some applications of these parameters include understanding scale build-up on water fixtures, caring for a home aquarium or brewing beer.

TESTING FOR UNREGULATED CONTAMINANTS



Since 1996, the Environmental Protection Agency, through its Unregulated Contaminant Monitoring Rule, every five years requires water utilities across the country to test for a list of substances that are suspected of being in drinking water but are not currently regulated under the Safe Drinking Water Act. Utilities report their test results to the EPA, which uses the information to learn more about the presence of these substances and decide whether they should be regulated in the future to protect public health.

Denver Water's 2024 test results were reported to the EPA as required. The data tables below include substances that were detected during Denver Water's tests and the levels at which they were found.

The American Water Works Association has more information about the rule and the process on its website: [drinktap.org/Water-Info/Whats-in-My-Water/Unregulated-Contaminant-Monitoring-Rule-UCMR](https://www.drinktap.org/Water-Info/Whats-in-My-Water/Unregulated-Contaminant-Monitoring-Rule-UCMR). Information about the rule also can be found on the EPA's website at www.epa.gov/dwucmr/learn-about-unregulated-contaminant-monitoring-rule or you can contact the Safe Drinking Water Hotline at 800-426-4791 or water.epa.gov/drink/contact.cfm.

UCMR5: PFAS Contaminants Sampled at Entry Point to the Distribution System – All Treatment Plants					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
11-chloroeicosafluoro-3-oxaundecane-1-sulfonic acid (11Cl-PF3OUdS)	2023/2024	BRL	BRL	ppb	0.005
1H,1H, 2H, 2H-perfluorohexane sulfonic acid (4:2FTS)	2023/2024	BRL	BRL	ppb	0.003
1H,1H, 2H, 2H-perfluorooctane sulfonic acid (6:2FTS)	2023/2024	BRL	BRL	ppb	0.005
1H,1H, 2H, 2H-perfluorodecane sulfonic acid (8:2 FTS)	2023/2024	BRL	BRL	ppb	0.005
9-chlorohexadecafluoro-3-oxanonane-1-sulfonic acid (9Cl-PF3ONS)	2023/2024	BRL	BRL	ppb	0.002
4,8-dioxa-3H-perfluorononanoic acid (ADONA)	2023/2024	BRL	BRL	ppb	0.003
Hexafluoropropylene oxide dimer acid (HFPO DA)	2023/2024	BRL	BRL	ppb	0.005
Nonafluoro-3,6-dioxaheptanoic acid (NFDHA)	2023/2024	BRL	BRL	ppb	0.02
Perfluorobutanoic acid (PFBA)	2023/2024	BRL	BRL	ppb	0.005
Perfluorobutanesulfonic acid (PFBS)	2023/2024	BRL	BRL	ppb	0.003
Perfluorodecanoic Acid (PFDA)	2023/2024	BRL	BRL	ppb	0.003
Perfluorododecanoic Acid (PFDoA)	2023/2024	BRL	BRL	ppb	0.003
Perfluoro(2-ethoxyethane)sulfonic acid (PFEESA)	2023/2024	BRL	BRL	ppb	0.003
Perfluoroheptanesulfonic acid (PFHpS)	2023/2024	BRL	BRL	ppb	0.003
Perfluoroheptanoic acid (PFHpA)	2023/2024	BRL	BRL	ppb	0.003
Perfluorohexanoic Acid (PFHxA)	2023/2024	BRL	BRL	ppb	0.003
Perfluorohexanesulfonic acid (PFHxS)	2023/2024	BRL	BRL	ppb	0.003
Perfluoro-4-methoxybutanoic acid (PFMBA)	2023/2024	BRL	BRL	ppb	0.003
Perfluoro-3-methoxypropanoic acid (PFMPA)	2023/2024	BRL	BRL	ppb	0.004
Perfluorononanoic Acid (PFNA)	2023/2024	BRL	BRL	ppb	0.004
Perfluorooctanoic Acid (PFOA)	2023/2024	BRL	BRL	ppb	0.004
Perfluorooctanesulfonic acid (PFOS)	2023/2024	BRL	BRL	ppb	0.004
Perfluoropentanoic acid (PFPeA)	2023/2024	BRL	BRL	ppb	0.003
Perfluoropentanesulfonic acid (PFPeS)	2023/2024	BRL	BRL	ppb	0.004
Perfluoroundecanoic acid (PFUnA)	2023/2024	BRL	BRL	ppb	0.002
N-ethyl perfluorooctanesulfonamidoacetic acid (NEtFOSAA)	2023/2024	BRL	BRL	ppb	0.005
N-methyl perfluorooctanesulfonamidoacetic acid (NMeFOSAA)	2023/2024	BRL	BRL	ppb	0.006
Perfluorotetradecanoic acid (PFTA)	2023/2024	BRL	BRL	ppb	0.008
Perfluorotridecanoic acid (PFTTrDA)	2023/2024	BRL	BRL	ppb	0.007

In 2023, three treatment plant entry points (Foothills, Marston and Moffat) were tested for the above Per- and polyfluoroalkyl Substances (PFAS) under UCMR5, and were below the minimum reporting levels. In 2024, North Treatment Plant entry point was tested for the above Per- and polyfluoroalkyl Substances (PFAS) under UCMR5, and were below the minimum reporting levels.

UCMR5 Lithium Contaminant Sampled at Entry Point to the Distribution System – Foothills Treatment Plant



Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	5.30	BRL-10.8	ppb	9
UCMR5 Lithium Contaminant Sampled at Entry Point to the Distribution System – Marston Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	9.23	9- 9.4	ppb	9
UCMR5 Lithium Contaminant Sampled at Entry Point to the Distribution System – Moffat Treatment Plant					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2023	BRL	BRL	ppb	9
UCMR5: Lithium Contaminant Sampled at Entry Point to the Distribution System - NTP					
Chemical Parameters	Year	Average	Range	Unit of Measure	Minimum Reporting Level
Lithium	2024	BRL	BRL	ppb	9



160 W. 12th Ave., Denver, CO 80202
303-893-8020

For more information on water including opportunities for public denverwater.org

DenverWater

youtube.com/YourDenverWater

@DenverWater

@Denver_Water

denverwater.org/Tap

Denver Water's Public Water System Identification: CO0116001

Photo credit: Denver Water.

