

HOLLOW STRUCTURAL SECTIONS

Beam Load Tables



**Steel Tube
Institute**
OF NORTH AMERICA


1998 REVISED EDITION

HSS Manufacturing Methods

The transformation of steel strip into hollow structural sections (HSS) is the result of operations including forming, welding and sizing. Currently three methods are being used in North America for the manufacture of HSS. These methods, including two ERW methods and an SAW method, are described below. Both ERW methods meet ASTM A 500 and CSA G-40.21 requirements for the manufacture of HSS, and the ERW sizes included in this publication may be produced to either standard. The SAW method is not included as a manufacturing process in the ASTM or CSA specification. SAW sizes listed in this publication can be specified to meet desired physical and dimensional criteria of ASTM A500 and CSA G-40.21


Electric Resistance Welding (ERW) Process

In the tube mill, flat steel strip (1) is formed continuously around its longitudinal axis to produce a round tube. This is done by moving the strip through a progressive set of rolls (2-6). The strip edges (7) are heated by either high frequency induction or contact welding and then forged together by weld rolls to create a continuous longitudinal weld without the addition of filler metal. The weld seam (8) is then cooled and processed through a set of sizing/shaping rolls which cold-form it into a round (9), square (10) or rectangular (11) section.

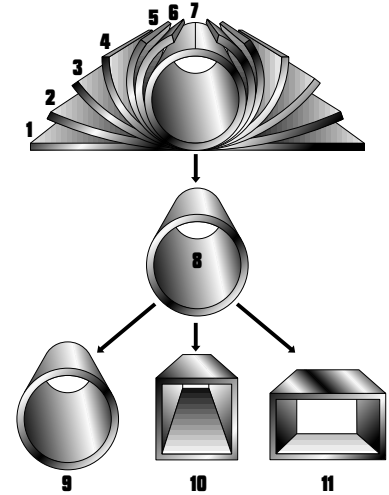


Form-Square Weld-Square (ERW) Process

In the weld mill, driven forming dies progressively shape the flat strip (1) by forming the top two corners (2) of the square or rectangular tube in the initial forming station. Subsequent stations form the bottom two corners (3) of the shape. No cold working of the sides of the shape is performed, and the shape's seam is welded by high-frequency contacts when the tube is near its final shape and size. The welded tube (4) is cooled and then driven through a series of sizing stations which qualifies the tube's final dimensions.

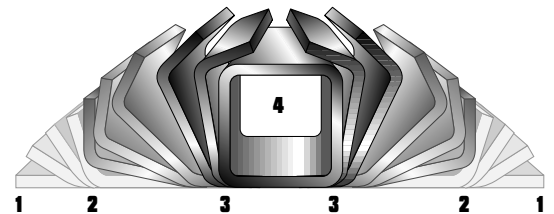

Submerged Arc Weld (SAW) Process

Two identical pieces of flat strip (1) are placed in a press brake and formed into two identical halves (2) of a finished tube size. A backup bar is tack welded to each leg of one of the half-sections (3). The two half-sections are fitted together toe-to-toe (4) and welded by the submerged arc process to complete the square or rectangular section (5).

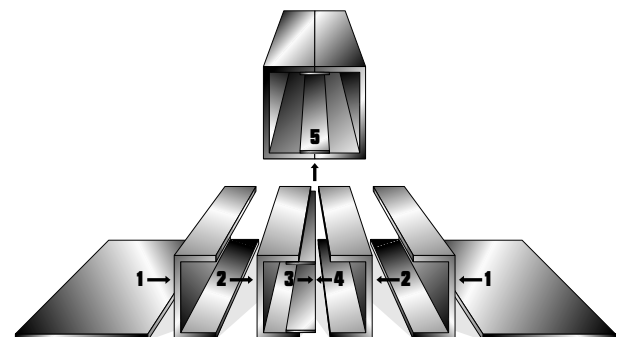

STI/HSS Member Companies

Bull Moose Tube Company

1819 Clarkson Road, Suite 100
Chesterfield, MO 63017
Telephone: (636) 537-2600
(800) 325-4467
Fax: (636) 537-5848

Columbia Structural Tubing

8735 N Harborsgate ST
Portland, OR 97203
Telephone: (503) 737-1200
(877) 737-1202
Fax: (503) 737-1202

Hannibal Industries, Inc.

P.O. Box 58814,
3851 Santa Fe Avenue
Los Angeles, CA 90058
Telephone: (323) 588-4261
Fax: (323) 589-5640

IPSCO Tubulars Inc.

P.O. Box 18, 2011 7th Avenue
Camanche, IA 52730
Telephone: (563) 242-0000
(800) 945-8936
Fax: (563) 242-9137

Maruichi American Corp.

P.O. Box 3187
11529 Greenstone Ave.
Santa Fe Springs, CA 90670
Telephone: (562) 903-8600
(800) 654-5495
Fax: (562) 903-8601

Prolamsa

(Mexico Headquarters)
Carretera a Colombia Km. 5.75
Escobedo, N.L.,
Mexico C.P. 45560
Tel +52 (81) 8154-0200
Fax +52 (81) 8901-1709

Prolamsa USA, Inc.

(U.S. Headquarters)
770 South Post Oak Lane
Suite 200, Houston, TX 77056
Tel (281) 494-0900
Fax (281) 494-0990

Southland Tube Inc.

P.O. Box 2425
Birmingham, AL 35201-2425
Telephone: (205) 251-1884
(800) 543-9024
FAX: (205) 251-1553

Valmont Industries

(Structural Tube Division)
HWY 275, P.O. Box 358
Valley, NB 68064
Telephone: (800) 345-6825
Fax: (402) 359-4481

Vest, Incorporated

6023 Alcoa Avenue
Los Angeles, CA 90058
Telephone: (323) 581-8823
(800) 421-6370
Fax: (323) 581-3465

Welded Tube

111 Rayette Road
Concord, Ontario,
Canada L4K 2E9
Telephone: (905) 669-1111
(800) 565-8823
Fax: (905) 669-8570

Please Note:

*We've tried to make this brochure as comprehensive and factual as possible.
However, some information may have been updated since the time of printing.
Your HSS producer is your best source for up-to-date information.*



Foreword

Tables of allowable uniformly distributed loads are presented for rectangular and square hollow structural sections (HSS) manufactured by the electric resistance welding (ERW) and the submerged arc welding (SAW) processes. Tables of maximum unbraced compression flange lengths and tables of midspan deflections for uniformly loaded simple span beams are also included.

The tables of allowable uniformly distributed loads have been calculated in accordance with the 1989 “Specification for Structural Steel Buildings - Allowable Stress Design and Plastic Design” published by the American Institute of Steel Construction. The allowable uniformly distributed loads are based upon section property data for HSS that were recalculated in 1996 to account for today’s more precise manufacturing methods. The recalculated section property data for HSS are published in “Hollow Structural Sections - Dimensions and Section Properties” available from the Steel Tube Institute of North America.

Tables are presented for two specified minimum yield stress steels - $F_y = 46$ ksi and $F_y = 50$ ksi. Allowable uniform loads for HSS sizes produced by the ERW and SAW manufacturing methods are presented in separate tables.

The allowable uniformly distributed loads are based upon the allowable bending stress, F_b , equal to $0.66F_y$ and $0.60F_y$. The allowable uniformly distributed loads for slender sections are calculated in accordance with AISC “Specification” Appendix B. Slender sections are indicated in the tables with an asterisk (*) immediately following the design wall thickness parameter and a double asterisk (**) immediately following the modified value of S_x .

The tabulated loads include the weight of the HSS beam which must be deducted to determine the net load that the beam will support. It is assumed that the load is applied in the plane of the minor axis and that the HSS beam deflects vertically in the plane of bending only.

Deflections corresponding to the tabulated loads are also given. Deflections caused by actual loading less than the full allowable load may be obtained by multiplying the tabulated deflection by the ratio of the actual load to the tabulated allowable uniform load.

Tabulated values of maximum laterally unsupported lengths, L_c , of compression flanges of HSS beams from 1 1/4 inches through 32 inches in width and for varying ratios of M_1/M_2 are presented for $F_y = 46$ ksi and $F_y = 50$ ksi specified minimum yield stress steels - see page xx and page xx. The L_c values are calculated in accordance with AISC “Specification” Sections B5 and F3 which specify that the laterally unsupported length of the compression flange of an HSS beam for which the allowable bending stress may be taken at $0.66F_y$ shall not exceed the value

$$\left(1950 + 1200 \frac{M_1}{M_2} \right) \frac{b}{F_y}$$

except that it need not be less than $1200(b/F_y)$.

Refer to Part 2, Beam and Girder Design, in the AISC 9th edition “Manual of Steel Construction” for a discussion of lateral support of beams, beams with concentrated loads and vertical deflection. Symbols used in these tables follow those used in the AISC “Manual”

Tables of deflections for fully stressed, uniformly loaded simple beams from 1 1/4 inches through 32 inches in depth and for varying span lengths are also included. These tables are presented for allowable bending stresses equal to 33 ksi (0.66×50 ksi), 30.0 ksi (0.60×50 ksi) and 27.6 ksi (0.60×46 ksi) - see pages xx - yy. Deflections for allowable bending stress equal to 30.36 ksi (0.60×46 ksi) can be obtained by adding approximately 1 % to the deflection values presented in the table for allowable bending stress equal to 30.0 ksi.

Table of Contents

Page

How to Use the Beam Load Tables6
 Lc Tables7

Beam Load Tables

Rectangular HSS (ERW) $F_y = 46 \text{ ksi}$ 8
 Square HSS (ERW) $F_y = 46 \text{ ksi}$ 38

Rectangular HSS (ERW) $F_y = 50 \text{ ksi}$ 50
 Square HSS (ERW) $F_y = 50 \text{ ksi}$ 80

Rectangular HSS (SAW) $F_y = 46 \text{ ksi}$ 92
 Square HSS (SAW) $F_y = 46 \text{ ksi}$ 98

Rectangular HSS (SAW) $F_y = 50 \text{ ksi}$ 102
 Square HSS (SAW) $F_y = 50 \text{ ksi}$ 108

Deflection Tables113

The information presented in this publication has been prepared in accordance with recognized engineering principles and is for general information only. While it is believed to be accurate, this information should not be used or relied upon for any specific application without competent professional examination and verification of its accuracy, suitability, and applicability by a licensed professional engineer, designer, or architect. The publication of the material contained herein is not intended as a representation or warranty on the part of The Steel Tube Institute of North America or of any other person named herein, that this information is suitable for any general or particular use or of freedom from infringement of any patent or patents. Anyone making use of this information assumes all liability arising from such use.

Caution must be exercised when relying upon other specifications and codes developed by other bodies and incorporated by reference herein since such material may be modified or amended from time to time subsequent to the printing of this edition. The Institute bears no responsibility for such material other than to refer to it and incorporate it by reference at the time of the initial publication of this edition.



How To Use The Beam Load Tables

Example I

A simply supported 8 in. x 4 in. x 1/4 in. ERW HSS beam of $F_y = 46$ ksi (ASTM A500 Gr. B) spans 16 feet. The compression flange is braced laterally at 3 feet from each end. Determine the total uniform load capacity and midspan deflection for loading in the plane of the minor axis.

Due to symmetry, $M_1/M_2 = -1.0$ for the 10 ft. center segment of the HSS beam. Enter the $F_y = 46$ ksi Table of L_c values for $M_1/M_2 = -1.0$ and a flange width equal to 4 inches, and note that $L_c = 8.7$ ft. < 10.0 ft.; therefore $F_b = 0.60 F_y = 27.6$ ksi. Enter the $F_y = 46$ ksi Load Table for the 8 in. x 4 in. x 1/4 in. HSS. Read across the row at the span equal to 16 feet and note that the total allowable uniform load is 12 kips (in the shaded area) with a corresponding midspan deflection equal to 0.91 in.

Example II

A simply supported 10 in. x 6 in. x 1/4 in. ERW HSS beam of $F_y = 50$ ksi (ASTM A500 Gr. C) spans 18 feet. The compression flange is braced laterally at the ends. Determine the total uniform load capacity and midspan deflection for loading in the plane of the minor axis.

Due to symmetry, $M_1/M_2 = 0$ for the simply supported HSS beam. Enter the $F_y = 50$ ksi Table of L_c values for $M_1/M_2 = 0$ and a flange width equal to 6 inches, and note that $L_c = 19.5$ ft. > 16.0 ft.; therefore $F_b = 0.66 F_y = 33.0$ ksi. Enter the $F_y = 50$ ksi Load Table for the 10 in. x 6 in. x 1/4 in. HSS. Read across the row at the span equal to 18 feet and note that the total allowable uniform load is 24 kips (in the unshaded area) with a corresponding midspan deflection equal to 1.11 in.

Example III

Select the lightest 7-inch deep, simply supported ERW HSS beam of $F_y = 50$ ksi (ASTM A500 Gr. C) to span 6 feet and support a load of 5.3 kips per foot (includes estimated weight of HSS beam). The beam is laterally supported for its entire length.

Required total uniform load to be supported is equal to 31.8 kips (5.3 kips/ft. x 6 ft.)

Enter the $F_y = 50$ ksi Load Table for the 7-inch deep HSS. Read across the rows at the span equal to 6 ft. and note the following:

7 in. x 5 in. x 1/4 in. HSS (19.02 lbs./ft.) can support 37 kips > 31.8 kips - O.K.

7 in. x 5 in. x 3/16 in. HSS (14.53 lbs./ft.) can support 29 kips < 31.8 kips - No Good

7 in. x 4 in. x 1/4 in. HSS (17.32 lbs./ft.) can support 32 kips > 31.8 kips - O.K.

7 in. x 4 in. x 3/16 in. HSS (13.25 lbs./ft.) can support 25 kips < 31.8 kips - No Good

7 in. x 3 in. x 3/8 in. HSS (22.37 lbs./ft.) can support 36 kips > 31.8 kips - O.K.

7 in. x 3 in. x 5/16 in. HSS (19.08 lbs./ft.) can support 31 kips < 31.8 kips - No Good

Select: 7 in. x 4 in. x 1/4 in. HSS (weight = 17.32 lbs./ft.)

Example IV


A simply supported 10 in. x 6 in. x 1/4 in. ERW HSS beam of $F_y = 50$ ksi (ASTM A500 Gr. C) spans 18 feet and supports a uniformly distributed load of 500 pounds /ft. (Total DL + LL). The compression flange is braced laterally at the ends. Determine the midspan deflection for the applied loading.

Total load supported = 500 pounds/ft. x 18 ft. = 9. kips

Total allowable uniform load equals 24 kips; corresponding midspan deflection equals 1.11 in. (see Example II).

Deflection due to applied loading: = 1.11 in. x $\frac{9 \text{ kips}}{24 \text{ kips}}$ = 0.42 in.

Beam Load Tables



HSS Beam Load Tables / Structural Steel Tubing

L_c

Maximum unbraced length of compression flange, in feet, for which allowable bending stress, F_b , may be taken at $0.66 F_y$.

$F_y = 46$ ksi																															
M_1/M_2	Flange Width, Inches																														
	1 1/4	1 1/2	1 5/8	1 3/4	2	2 1/4	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	7	8	9	10	12	14	16	18	20	22	24	26	28	30	32		
+1.0	7.1	8.6	9.3	10.0	11.4	12.8	14.3	17.1	20.0	22.8	25.7	28.5	31.4	34.2	39.9	45.7	51.4	57.1	68.5	79.9	91.3										
+0.9	6.9	8.2	8.9	9.6	11.0	12.4	13.7	16.5	19.2	22.0	24.7	27.4	30.2	32.9	38.4	43.9	49.4	54.9	65.9	76.8	87.8	98.8									
+0.8	6.6	7.9	8.6	9.2	10.5	11.9	13.2	15.8	18.5	21.1	23.7	26.4	29.0	31.6	36.9	42.2	47.4	52.7	63.3	73.8	84.3	94.9									
+0.7	6.3	7.6	8.2	8.8	10.1	11.4	12.6	15.2	17.7	20.2	22.7	25.3	27.8	30.3	35.4	40.4	45.5	50.5	60.7	70.8	80.9	91.0									
+0.6	6.0	7.3	7.9	8.5	9.7	10.9	12.1	14.5	16.9	19.3	21.8	24.2	26.6	29.0	33.9	38.7	43.5	48.4	58.0	67.7	77.4	87.1	96.7								
+0.5	5.8	6.9	7.5	8.1	9.2	10.4	11.5	13.9	16.2	18.5	20.8	23.1	25.4	27.7	32.3	37.0	41.6	46.2	55.4	64.7	73.9	83.2	92.4								
+0.4	5.5	6.6	7.2	7.7	8.8	9.9	11.0	13.2	15.4	17.6	19.8	22.0	24.2	26.4	30.8	35.2	39.6	44.0	52.8	61.6	70.4	79.2	88.0	96.8							
+0.3	5.2	6.3	6.8	7.3	8.4	9.4	10.5	12.6	14.6	16.7	18.8	20.9	23.0	25.1	29.3	33.5	37.7	41.8	50.2	58.6	67.0	75.3	83.7	92.1							
+0.2	5.0	6.0	6.4	6.9	7.9	8.9	9.9	11.9	13.9	15.9	17.9	19.8	21.8	23.8	27.8	31.7	35.7	39.7	47.6	55.5	63.5	71.4	79.3	87.3	95.2						
+0.1	4.7	5.6	6.1	6.6	7.5	8.4	9.4	11.3	13.1	15.0	16.9	18.8	20.6	22.5	26.3	30.0	33.8	37.5	45.0	52.5	60.0	67.5	75.0	82.5	90.0	97.5					
0.0	4.4	5.3	5.7	6.2	7.1	7.9	8.8	10.6	12.4	14.1	15.9	17.7	19.4	21.2	24.7	28.3	31.8	35.3	42.4	49.5	56.5	63.6	70.7	77.7	84.8	91.8	98.9				
-0.1	4.1	5.0	5.4	5.8	6.6	7.5	8.3	9.9	11.6	13.3	14.9	16.6	18.2	19.9	23.2	26.5	29.8	33.2	39.8	46.4	53.0	59.7	66.3	72.9	79.6	86.2	92.8	99.5			
-0.2	3.9	4.6	5.0	5.4	6.2	7.0	7.7	9.3	10.8	12.4	13.9	15.5	17.0	18.6	21.7	24.8	27.9	31.0	37.2	43.4	49.6	55.8	62.0	68.2	74.3	80.5	86.7	92.9	99.1		
-0.3	3.6	4.3	4.7	5.0	5.8	6.5	7.2	8.6	10.1	11.5	13.0	14.4	15.8	17.3	20.2	23.0	25.9	28.8	34.6	40.3	46.1	51.8	57.6	63.4	69.1	74.9	80.7	86.4	92.2		
-0.4	3.3	4.0	4.3	4.7	5.3	6.0	6.7	8.0	9.3	10.7	12.0	13.3	14.6	16.0	18.6	21.3	24.0	26.6	32.0	37.3	42.6	47.9	53.3	58.6	63.9	69.2	74.6	79.9	85.2		
-0.5	3.1	3.7	4.0	4.3	4.9	5.5	6.1	7.3	8.6	9.8	11.0	12.2	13.5	14.7	17.1	19.6	22.0	24.5	29.3	34.2	39.1	44.0	48.9	53.8	58.7	63.6	68.5	73.4	78.3		
-0.6	2.8	3.3	3.6	3.9	4.5	5.0	5.6	6.7	7.8	8.9	10.0	11.1	12.3	13.4	15.6	17.8	20.1	22.3	26.7	31.2	35.7	40.1	44.6	49.0	53.5	57.9	62.4	66.8	71.3		
-0.625 to -1.0	2.7	3.3	3.5	3.8	4.3	4.9	5.4	6.5	7.6	8.7	9.8	10.9	12.0	13.0	15.2	17.4	19.6	21.7	26.1	30.4	34.8	39.1	43.5	47.8	52.2	56.5	60.9	65.2	69.6		

$F_y = 50$ ksi																															
M_1/M_2	Flange Width, Inches																														
	1 1/4	1 1/2	1 5/8	1 3/4	2	2 1/4	2 1/2	3	3 1/2	4	4 1/2	5	5 1/2	6	7	8	9	10	12	14	16	18	20	22	24	26	28	30	32		
+1.0	6.6	7.9	8.5	9.2	10.5	11.8	13.1	15.8	18.4	21.0	23.6	26.3	28.9	31.5	36.8	42.0	47.3	52.5	63.0	73.5	84.0	94.5									
+0.9	6.3	7.6	8.2	8.8	10.1	11.4	12.6	15.2	17.7	20.2	22.7	25.3	27.8	30.3	35.4	40.4	45.5	50.5	60.6	70.7	80.8	90.9									
+0.8	6.1	7.3	7.9	8.5	9.7	10.9	12.1	14.6	17.0	19.4	21.8	24.3	26.7	29.1	34.0	38.8	43.6	48.5	58.2	67.9	77.6	87.3	97.0								
+0.7	5.8	7.0	7.6	8.1	9.3	10.5	11.6	14.0	16.3	18.6	20.9	23.3	25.6	27.9	32.6	37.2	41.9	46.5	55.8	65.1	74.4	83.7	93.0								
+0.6	5.6	6.7	7.2	7.8	8.9	10.0	11.1	13.4	15.6	17.8	20.0	22.3	24.5	26.7	31.2	35.6	40.1	44.5	53.4	62.3	71.2	80.1	89.0	97.9							
+0.5	5.3	6.4	6.9	7.4	8.5	9.6	10.6	12.8	14.9	17.0	19.1	21.3	23.4	25.5	29.8	34.0	38.3	42.5	51.0	59.5	68.0	76.5	85.0	93.5							
+0.4	5.1	6.1	6.6	7.1	8.1	9.1	10.1	12.2	14.2	16.2	18.2	20.3	22.3	24.3	28.4	32.4	36.5	40.5	48.6	56.7	64.8	72.9	81.0	89.1	97.2						
+0.3	4.8	5.8	6.3	6.7	7.7	8.7	9.6	11.6	13.5	15.4	17.3	19.3	21.2	23.1	27.0	30.8	34.6	38.5	46.2	53.9	61.6	69.3	77.0	84.7	92.4						
+0.2	4.6	5.5	5.9	6.4	7.3	8.2	9.1	11.0	12.8	14.6	16.4	18.3	20.1	21.9	25.6	29.2	32.9	36.5	43.8	51.1	58.4	65.7	73.0	80.3	87.6	94.9					
+0.1	4.3	5.2	5.6	6.0	6.9	7.8	8.6	10.4	12.1	13.8	15.5	17.3	19.0	20.7	24.2	27.6	31.1	34.5	41.4	48.3	55.2	62.1	69.0	75.9	82.8	89.7	96.6				
0.0	4.1	4.9	5.3	5.7	6.5	7.3	8.1	9.8	11.4	13.0	14.6	16.3	17.9	19.5	22.8	26.0	29.3	32.5	39.0	45.5	52.0	58.5	65.0	71.5	78.0	84.5	91.0	97.5			
-0.1	3.8	4.6	5.0	5.3	6.1	6.9	7.6	9.2	10.7	12.2	13.7	15.3	16.8	18.3	21.4	24.4	27.5	30.5	36.6	42.7	48.8	54.9	61.0	67.1	73.2	79.3	85.4	91.5	97.6		
-0.2	3.6	4.3	4.6	5.0	5.7	6.4	7.1	8.6	10.0	11.4	12.8	14.3	15.7	17.1	19.9	22.8	25.7	28.5	34.2	39.9	45.6	51.3	57.0	62.7	68.4	74.1	79.8	85.5	91.2		
-0.3	3.3	4.0	4.3	4.6	5.3	6.0	6.6	8.0	9.3	10.6	11.9	13.3	14.6	15.9	18.6	21.2	23.9	26.5	31.8	37.1	42.4	47.7	53.0	58.3	63.6	68.9	74.2	79.5	84.8		
-0.4	3.1	3.7	4.0	4.3	4.9	5.5	6.1	7.4	8.6	9.8	11.0	12.3	13.5	14.7	17.2	19.6	22.1	24.5	29.4	34.3	39.2	44.1	49.0	53.9	58.8	63.7	68.6	73.5	78.4		
-0.5	2.8	3.4	3.7	3.9	4.5	5.1	5.6	6.8	7.9	9.0	10.1	11.3	12.4	13.5	15.8	18.0	20.3	22.5	27.0	31.5	36.0	40.5	45.0	49.5	54.0	58.5	63.0	67.5	72.0		
-0.6	2.6	3.1	3.3	3.6	4.1	4.6	5.1	6.2	7.2	8.2	9.2	10.3	11.3	12.3	14.4	16.4	18.4	20.5	24.6	28.7	32.8	36.9	41.0	45.1	49.2	53.3	57.4	61.5	65.6		
-0.625 to -1.0	2.5	3.0	3.3	3.5	4.0	4.5	5.0	6.0	7.0	8.0	9.0	10.0	11.0	12.0	14.0	16.0	18.0	20.0	24.0	28.0	32.0	36.0	40.0	44.0	48.0	52.0	56.0	60.0	64.0		


Note: M_1/M_2 is the ratio of the smaller to larger bending moment at the ends of that portion of the member unbraced in the plane of bending under consideration. M_1/M_2 is positive when the member is bent in reverse curvature and negative when bent in single curvature.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		20 x 12						Nominal Size		20 x 8				
Wall Thickness		1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches
Weight Per Foot		103.30		78.52		65.87		Weight Per Foot		110.36	89.68	68.31	57.36	
Design Wall Thickness		0.465	0.349	0.291*	Design Wall Thickness		0.581	0.465	0.349	0.291				
Span in Feet	4	684	0.03	514	0.02	428	0.02	4	729	602	469	398	0.03	
	5	627	0.04	442	0.04	362	0.03	5	583	482	375	318	0.04	
	6	523	0.06	368	0.05	302	0.05	6	486	401	312	265	0.06	
	7	448	0.08	315	0.07	259	0.07	7	416	344	268	227	0.08	
	8	392	0.10	276	0.09	226	0.09	8	364	301	234	199	0.10	
	9	349	0.13	245	0.12	201	0.11	9	324	268	208	177	0.13	
	10	314	0.16	221	0.14	181	0.14	10	291	241	187	159	0.16	
	11	285	0.19	201	0.17	165	0.17	11	265	219	170	145	0.19	
	12	261	0.23	184	0.21	151	0.20	12	243	201	156	133	0.23	
	13	241	0.27	170	0.24	139	0.24	13	224	185	144	122	0.27	
	14	224	0.31	158	0.28	129	0.27	14	208	172	134	114	0.31	
	15	209	0.35	147	0.32	121	0.31	15	194	161	125	106	0.35	
	16	196	0.40	138	0.37	113	0.36	16	182	151	117	99	0.40	
	17	185	0.45	130	0.41	107	0.40	17	171	142	110	94	0.45	
	18	174	0.51	123	0.46	101	0.45	18	162	134	104	88	0.51	
	19	165	0.57	116	0.52	95	0.50		147	122	95	80	0.46	
	20	157	0.63	110	0.57	91	0.56	20	146	120	94	80	0.63	
	21	149	0.69	105	0.63	86	0.61		132	109	85	72	0.57	
	22	143	0.76	100	0.69	82	0.67	22	132	109	85	72	0.76	
	23	136	0.83	96	0.76	79	0.74		120	100	77	66	0.69	
	24	131	0.90	92	0.82	75	0.80	24	121	100	78	66	0.90	
	26	121	1.06	85	0.97	70	0.94		110	91	71	60	0.82	
	Span in Feet	28	112	1.23	—	—	—	—	26	112	93	72	61	1.06
			102	1.12	79	1.12	65	1.09		102	84	66	56	0.97
		30	105	1.41	—	—	—	—	28	104	86	67	57	1.23
			95	1.28	74	1.28	60	1.25		95	78	61	52	1.12
32		98	1.61	—	—	—	—	30	97	80	62	53	1.41	
		89	1.46	69	1.46	57	1.42		88	73	57	48	1.28	
34		92	1.82	—	—	—	—	32	91	75	59	50	1.61	
		84	1.65	65	1.65	53	1.61		83	68	53	45	1.46	
36		87	2.04	—	—	—	—	34	86	71	55	47	1.82	
		79	1.85	61	1.85	50	1.80		78	64	50	43	1.65	
38		83	2.27	—	—	—	—	36	81	67	52	44	2.04	
		75	2.06	58	2.06	48	2.01		74	61	47	40	1.85	
42		75	2.77	—	—	—	—	38	77	63	49	42	2.27	
		68	2.52	53	2.52	43	2.45		70	58	45	38	2.06	
46	68	3.32	—	—	—	—	42	69	57	45	38	2.77		
	62	3.02	48	3.02	39	2.94		63	52	41	34	2.52		
							46	63	52	41	35	3.32		
								58	48	37	31	3.02		

WEB SHEAR AND PROPERTY VALUES


V, kips	342		257		214		V, kips	428	342	257	214	
S _x , In. ³	155		120		98.4**		S _x , In. ³	144	119	92.6	78.6	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



Nominal Size		20 x 4				Nominal Size		18 x 6						
Wall Thickness		1/2	3/8	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	
Weight Per Foot		76.07	58.10	48.86		Weight Per Foot		93.34	76.07	58.10	48.86	39.43		
Design Wall Thickness		0.465	0.349	0.291		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		
Span in Feet	4	424	332	283	0.03	Span in Feet	4	521	433	339	288	235	0.03	
	5	339	266	227	0.04		5	417	347	271	231	188	157	0.04
	6	283	222	189	0.06		6	347	289	226	192	157	134	0.06
	7	242	190	162	0.08		7	298	248	193	165	134	118	0.08
	8	212	166	142	0.10		8	261	217	169	144	118	105	0.10
	10	170	133	113	0.16		9	232	193	150	128	105	94	0.14
		154	121	103	0.14		10	208	173	135	115	94	86	0.17
	11	154	121	103	0.19		11	190	158	123	105	86	78	0.21
		140	110	94	0.17		12	174	144	113	96	78	72	0.25
	12	141	111	94	0.23		13	160	133	104	89	72	67	0.29
		128	101	86	0.21		14	149	124	97	82	67	61	0.34
	13	130	102	87	0.27		14	135	113	88	75	61	57	0.31
		119	93	79	0.24			15	139	116	90	77	63	57
	14	121	95	81	0.31		15	126	105	82	70	57	53	0.36
		110	86	74	0.28			16	130	108	85	72	59	53
	15	113	89	76	0.35		16	118	98	77	66	53	50	0.41
		103	81	69	0.32			17	123	102	80	68	55	50
	16	106	83	71	0.40		17	111	93	72	62	50	48	0.46
		96	76	64	0.37			18	116	96	75	64	52	48
	18	94	74	63	0.51		18	105	88	68	58	48	47	0.51
		86	67	57	0.46			20	104	87	68	58	47	43
	20	85	66	57	0.63		20	95	79	62	52	43	43	0.63
		77	60	52	0.57			22	95	79	62	52	43	39
	22	77	60	52	0.76		22	86	72	56	48	39	36	0.77
		70	55	47	0.69			24	87	72	56	48	39	36
	24	71	55	47	0.90		24	79	66	51	44	36	36	0.91
		64	50	43	0.82			26	80	67	52	44	36	33
	26	65	51	44	1.06		26	73	61	47	40	33	34	1.07
59		46	40	0.97	28	74		62	48	41	34	31	1.37	
28	61	47	40	1.23	28	68	56	44	37	31	29	1.24		
	55	43	37	1.12		30	69	58	45	38	31	29	1.57	
30	57	44	38	1.41	30	63	53	41	35	29	27	1.43		
	51	40	34	1.28		32	65	54	42	36	29	27	1.79	
34	50	39	33	1.82	32	59	49	38	33	27	25	1.62		
	45	36	30	1.65		34	61	51	40	34	28	25	2.02	
38	45	35	30	2.27	34	56	46	36	31	25	23	1.83		
	41	32	27	2.06		38	55	46	36	30	25	23	2.52	
42	40	32	27	2.77	38	50	41	32	28	23	22	2.29		
	37	29	25	2.52		42	50	41	32	27	22	20	3.08	
46	37	29	25	3.32	42	45	38	29	25	20	20	2.80		
	34	26	22	3.02										

WEB SHEAR AND PROPERTY VALUES

V, kips	342	257	214		V, kips	385	308	231	193	154	
S_x , in. ³	83.8	65.7	56.0		S_x , in. ³	103	85.6	66.9	57.0	46.5	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		16 x 12						Nominal Size		16 x 8				
Wall Thickness		1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches
Weight Per Foot		89.68		68.31		57.36		Weight Per Foot		93.34	76.07	58.10	48.86	
Design Wall Thickness		0.465	0.349	0.291 *	Design Wall Thickness		0.581	0.465	0.349	0.291				
Span in Feet	4	548	0.03	403	0.03	332	0.03	4	516	430	335	285	0.03	
	5	457	0.05	323	0.04	265	0.04	5	413	344	268	228	0.05	
	6	381	0.07	269	0.06	221	0.06	6	344	286	224	190	0.07	
	7	327	0.10	231	0.09	190	0.08	7	295	245	192	163	0.10	
	8	286	0.13	202	0.11	166	0.11	8	258	215	168	143	0.13	
	9	254	0.16	179	0.14	147	0.14	9	229	191	149	127	0.16	
	10	229	0.20	161	0.18	133	0.17	10	206	172	134	114	0.20	
	11	208	0.24	147	0.22	121	0.21	11	188	156	122	104	0.24	
	12	191	0.28	134	0.26	111	0.25	12	172	143	112	95	0.28	
	13	176	0.33	124	0.30	102	0.29	13	159	132	103	88	0.33	
	14	163	0.38	115	0.35	95	0.34	14	147	123	96	82	0.38	
	15	152	0.44	108	0.40	88	0.39	15	138	115	89	76	0.44	
	16	143	0.50	101	0.46	83	0.44	16	129	107	84	71	0.50	
	17	135	0.57	95	0.52	78	0.50	17	121	101	79	67	0.57	
	18	127	0.64	90	0.58	74	0.56	18	115	95	75	63	0.64	
	19	120	0.71	85	0.64	70	0.62		104	87	68	58	0.58	
	20	114	0.79	81	0.71	66	0.69	19	109	90	71	60	0.71	
	21	109	0.87	77	0.79	63	0.76		99	82	64	55	0.64	
	22	104	0.95	73	0.86	60	0.84	20	103	86	67	57	0.79	
	23	99	1.04	70	0.94	58	0.92		94	78	61	52	0.71	
	24	95	1.13	67	1.03	55	1.00	22	94	78	61	52	0.95	
	25	91	1.23	65	1.12	53	1.08		85	71	55	47	0.86	
	26	88	1.33	62	1.21	51	1.17	24	86	72	56	48	1.13	
	27	85	1.43	—	—	—	—		78	65	51	43	1.03	
	28	82	1.54	—	—	—	—	26	79	66	52	44	1.33	
	29	79	1.65	—	—	—	—		72	60	47	40	1.21	
	30	76	1.77	—	—	—	—	28	74	61	48	41	1.54	
	31	69	1.61	54	1.61	44	1.56		67	56	44	37	1.40	
	32	71	2.01	—	—	—	—	29	71	59	46	39	1.65	
	33	65	1.83	50	1.83	41	1.77		65	54	42	36	1.50	
	34	67	2.27	—	—	—	—	31	67	55	43	37	1.89	
	35	61	2.06	47	2.06	39	2.00		61	50	39	33	1.71	
	36	64	2.54	—	—	—	—	32	65	54	42	36	2.01	
	37	58	2.31	45	2.31	37	2.24		59	49	38	32	1.83	
	38	62	2.69	—	—	—	—	34	61	51	39	34	2.27	
	39	56	2.44	44	2.44	36	2.37		55	46	36	31	2.06	
	40	62	2.69	—	—	—	—	36	57	48	37	32	2.54	
41	56	2.44	44	2.44	36	2.37	52		43	34	29	2.31		
42	56	2.44	44	2.44	36	2.37	37	56	46	36	31	2.69		
43	51	2.37	41	2.37	33	2.24		51	42	33	28	2.44		

WEB SHEAR AND PROPERTY VALUES

V, kips	274	V, kips	342
S _x , In. ³	113	S _x , In. ³	102
	205		274
	87.7		205
			171
			171
			72.1 **
			56.4

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		16 x 4				Nominal Size		14 x 10							
Wall Thickness		1/2	3/8	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches
Weight Per Foot		62.46	47.90	40.35		Weight Per Foot		93.34	76.07	58.10		48.86		39.43	
Design Wall Thickness		0.465	0.349	0.291	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233 *				
Span in Feet	4	288	228	195	0.03	Span in Feet	4	497	414	323	0.04	250	0.03	195	0.03
	5	230	182	156	0.05		5	398	331	259	0.06	200	0.05	156	0.05
	6	192	152	130	0.07		6	331	276	216	0.08	167	0.07	130	0.07
	7	165	130	111	0.10		7	284	237	185	0.11	143	0.10	111	0.10
	8	144	114	97	0.13		8	248	207	162	0.14	125	0.13	98	0.12
	9	128	101	87	0.16		9	221	184	144	0.18	111	0.17	87	0.16
	10	116	92	79	0.14		10	199	166	129	0.22	100	0.20	78	0.20
	11	115	91	78	0.20		11	181	151	118	0.27	91	0.25	71	0.24
	12	105	83	71	0.18		12	166	138	108	0.32	83	0.29	65	0.28
	13	105	83	71	0.24		13	153	127	99	0.38	77	0.34	60	0.33
	14	95	75	64	0.22		14	142	118	92	0.44	71	0.40	56	0.38
	15	96	76	65	0.28		15	133	110	86	0.50	67	0.46	52	0.44
	16	87	69	59	0.26		16	124	103	81	0.57	62	0.52	49	0.50
	17	89	70	60	0.33		17	117	97	76	0.65	59	0.59	46	0.56
	18	81	64	54	0.30		18	110	92	72	0.73	56	0.66	43	0.63
	19	82	65	56	0.38		19	105	87	68	0.81	53	0.74	41	0.70
	20	75	59	51	0.35		20	99	83	65	0.90	50	0.82	39	0.78
	21	77	61	52	0.44		21	95	79	62	0.99	48	0.90	37	0.86
	22	70	55	47	0.40		22	90	75	59	1.09	—	—	—	—
	23	72	57	49	0.50		23	82	68	53	0.99	45	0.99	35	0.95
	24	65	52	44	0.46		24	86	72	56	1.19	—	—	—	—
	25	68	54	46	0.57		25	79	65	51	1.08	43	1.08	34	1.03
	26	62	49	42	0.52		26	83	69	54	1.29	—	—	—	—
	27	64	51	43	0.64		27	75	63	49	1.17	42	1.17	33	1.12
	28	58	46	39	0.58		28	80	66	52	1.40	—	—	—	—
	29	58	46	39	0.79		29	72	60	47	1.27	40	1.27	31	1.22
	30	52	41	35	0.71		30	76	64	50	1.52	—	—	—	—
	31	52	41	35	0.95		31	69	58	45	1.38	38	1.38	30	1.32
	32	48	38	32	0.86		32	74	61	48	1.64	—	—	—	—
	33	48	38	32	1.13		33	67	56	44	1.49	37	1.49	29	1.42
	34	44	35	30	1.03		34	71	59	46	1.76	—	—	—	—
	35	41	33	28	1.54		35	65	54	42	1.60	36	1.60	28	1.53
	36	37	30	25	1.40		36	66	55	43	2.02	—	—	—	—
	37	36	28	24	2.01		37	60	50	39	1.84	33	1.84	26	1.76
	38	33	26	22	1.83		38	62	52	40	2.30	—	—	—	—
	39	32	25	22	2.54		39	56	47	37	2.09	31	2.09	24	2.00
	40	29	23	20	2.31										
41	31	25	21	2.69											
42	28	22	19	2.44											

WEB SHEAR AND PROPERTY VALUES													
V, kips	274	205	171		V, kips	299	240	180		150		120	
S _x , In. ³	56.9	45.0	38.5		S _x , In. ³	98.2	81.8	63.9		54.3		42.4 **	

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=46



Nominal Size		14 x 6								Nominal Size		14 x 4							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	
Weight Per Foot		76.33	62.46	47.90	40.35	32.63		24.73		Weight Per Foot		67.82	55.66	42.79	36.10	29.23	22.18		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174		
Span in Feet	4	345	290	229	196	160	0.04	112	0.03	Span in Feet	4	270	229	182	156	129	99	0.04	
	5	276	232	183	157	128	0.06	89	0.05		5	216	183	146	125	103	79	0.06	
	6	230	194	153	131	107	0.08	75	0.07		6	180	153	121	104	86	66	0.08	
	7	197	166	131	112	92	0.11	64	0.10		7	154	131	104	89	73	56	0.11	
	8	173	145	115	98	80	0.14	56	0.13		8	135	115	91	78	64	49	0.14	
	9	153	129	102	87	71	0.18	50	0.17		9	120	102	81	69	57	44	0.18	
	10	138	116	92	78	64	0.22	45	0.20			109	93	74	63	52	40	0.17	
	11	125	106	83	71	58	0.27	41	0.25		10	108	92	73	63	51	39	0.22	
	12	115	97	76	65	53	0.32	37	0.29			98	83	66	57	47	36	0.20	
	13	106	89	71	60	49	0.38	34	0.34		11	98	83	66	57	47	36	0.27	
	14	99	83	65	56	46	0.44	—	—			89	76	60	52	42	33	0.25	
		90	75	60	51	42	0.40	32	0.40		90	76	61	52	43	33	0.32		
	15	92	77	61	52	43	0.50	—	—		12	82	69	55	47	39	30	0.29	
		84	70	56	47	39	0.46	30	0.46			83	71	56	48	40	30	0.38	
	16	86	73	57	49	40	0.57	—	—		13	75	64	51	44	36	28	0.34	
		78	66	52	45	36	0.52	28	0.52			77	65	52	45	37	28	0.44	
	17	81	68	54	46	38	0.65	—	—		14	70	60	47	41	33	26	0.40	
		74	62	49	42	34	0.59	26	0.59			72	61	49	42	34	26	0.50	
	18	77	65	51	44	36	0.73	—	—		15	65	56	44	38	31	24	0.46	
		70	59	46	40	32	0.66	25	0.66			67	57	46	39	32	25	0.57	
	19	73	61	48	41	34	0.81	—	—		16	61	52	41	36	29	22	0.52	
		66	56	44	37	31	0.74	24	0.74			63	54	43	37	30	23	0.65	
	20	69	58	46	39	32	0.90	—	—		17	58	49	39	33	27	21	0.59	
		63	53	42	36	29	0.82	22	0.82			60	51	40	35	29	22	0.73	
	21	66	55	44	37	31	0.99	—	—		18	54	46	37	32	26	20	0.66	
		60	50	40	34	28	0.90	21	0.90			57	48	38	33	27	21	0.81	
	22	63	53	42	36	29	1.09	—	—		19	52	44	35	30	25	19	0.74	
		57	48	38	32	27	0.99	20	0.99			54	46	36	31	26	20	0.90	
	24	58	48	38	33	27	1.29	—	—		20	49	42	33	28	23	18	0.82	
		52	44	35	30	24	1.17	19	1.17			49	42	33	28	23	18	1.09	
	26	53	45	35	30	25	1.52	—	—		22	45	38	30	26	21	16	0.99	
		48	41	32	27	22	1.38	17	1.38			45	38	30	26	21	16	1.29	
28	49	41	33	28	23	1.76	—	—	24	41	35	28	24	19	15	1.17			
	45	38	30	25	21	1.60	16	1.60		41	35	28	24	19	15	1.52			
30	46	39	31	26	21	2.02	—	—	26	38	32	25	22	18	14	1.38			
	42	35	28	24	19	1.84	15	1.84		39	33	26	22	18	14	1.76			
32	43	36	29	24	20	2.30	—	—	28	35	30	24	20	17	13	1.60			
	39	33	26	22	18	2.09	14	2.09		36	31	24	21	17	13	2.02			
									30	33	28	22	19	16	12	1.84			
									32	34	29	23	20	16	12	2.30			
										31	26	21	18	15	11	2.09			

WEB SHEAR AND PROPERTY VALUES																	
V, kips	299	240	180	150	120		90		V, kips	299	240	180	150	120	90		
S _x , In. ³	68.2	57.4	45.3	38.7	31.7		24.3		S _x , In. ³	53.3	45.3	36.0	30.9	25.4	19.5		

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		12 X 10						
Wall Thickness		1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches
Weight Per Foot		69.27	53.00		44.60		36.03	
Design Wall Thickness		0.465	0.349		0.291		0.233 *	
Span in Feet	4	333	261	0.04	202	0.04	158	0.04
	5	267	209	0.07	162	0.06	126	0.06
	6	222	174	0.09	135	0.09	105	0.08
	7	191	149	0.13	116	0.12	90	0.11
	8	167	131	0.17	101	0.15	79	0.15
	9	148	116	0.21	90	0.19	70	0.18
	10	133	104	0.26	81	0.24	63	0.23
	11	121	95	0.32	74	0.29	57	0.27
	12	111	87	0.38	67	0.34	53	0.33
	13	103	80	0.44	62	0.40	49	0.38
	14	95	75	0.51	58	0.47	45	0.44
	15	89	70	0.59	54	0.54	42	0.51
	16	83	65	0.67	51	0.61	39	0.58
	17	78	61	0.76	48	0.69	37	0.66
	18	74	58	0.85	45	0.77	35	0.73
	19	70	55	0.94	43	0.86	33	0.82
	20	67	52	1.05	40	0.95	32	0.91
	21	64	50	1.15	39	1.05	30	1.00
	22	61	47	1.27	—	—	—	—
		55	43	1.15	37	1.15	29	1.10
	23	58	45	1.38	—	—	—	—
		53	41	1.26	35	1.26	27	1.20
	24	56	44	1.51	—	—	—	—
		51	40	1.37	34	1.37	26	1.31
	25	53	42	1.64	—	—	—	—
		49	38	1.49	32	1.49	25	1.42
	26	51	40	1.77	—	—	—	—
		47	37	1.61	31	1.61	24	1.53
27	49	39	1.91	—	—	—	—	
	45	35	1.73	30	1.73	23	1.65	
28	48	37	2.05	—	—	—	—	
	43	34	1.87	29	1.87	23	1.78	
WEB SHEAR AND PROPERTY VALUES								
V, kips	205	154		129		103		
S_x, in.³	65.9	51.6		44.0		34.3 **		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		12 x 8								
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		76.33	62.46	47.90	40.35		32.63		24.73	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174*			
Span in Feet	4	334	281	221	189	0.04	141	0.04	101	0.04
	5	268	225	177	151	0.07	113	0.06	81	0.06
	6	223	187	147	126	0.09	94	0.09	67	0.08
	7	191	160	126	108	0.13	80	0.12	58	0.11
	8	167	140	111	95	0.17	70	0.15	50	0.14
	9	149	125	98	84	0.21	63	0.19	45	0.18
	10	134	112	88	76	0.26	56	0.24	40	0.22
	11	122	102	80	69	0.32	51	0.29	37	0.27
	12	111	94	74	63	0.38	47	0.34	34	0.32
	13	103	86	68	58	0.44	43	0.40	31	0.38
	14	96	80	63	54	0.51	40	0.47	29	0.44
	15	89	75	59	50	0.59	38	0.54	27	0.50
	16	84	70	55	47	0.67	35	0.61	25	0.57
	17	79	66	52	45	0.76	33	0.69	24	0.65
	18	74	62	49	42	0.85	—	—	—	—
		68	57	45	38	0.77	31	0.77	22	0.72
	19	70	59	47	40	0.94	—	—	—	—
		64	54	42	36	0.86	30	0.86	21	0.81
	20	67	56	44	38	1.05	—	—	—	—
		61	51	40	34	0.95	28	0.95	20	0.89
	21	64	53	42	36	1.15	—	—	—	—
		58	49	38	33	1.05	27	1.05	19	0.98
	22	61	51	40	34	1.27	—	—	—	—
		55	46	37	31	1.15	26	1.15	18	1.08
	23	58	49	38	33	1.38	—	—	—	—
		53	44	35	30	1.26	24	1.26	18	1.18
	24	56	47	37	32	1.51	—	—	—	—
		51	43	34	29	1.37	23	1.37	17	1.29
25	54	45	35	30	1.64	—	—	—	—	
	49	41	32	28	1.49	23	1.49	16	1.40	
26	51	43	34	29	1.77	—	—	—	—	
	47	39	31	26	1.61	22	1.61	15	1.51	
27	50	42	33	28	1.91	—	—	—	—	
	45	38	30	25	1.73	21	1.73	15	1.63	
28	48	40	32	27	2.05	—	—	—	—	
	43	36	29	25	1.87	20	1.87	14	1.75	
WEB SHEAR AND PROPERTY VALUES										
V, kips	257	205	154	129		103		77		
S _x , In. ³	66.1	55.5	43.7	37.4		30.6		21.9**		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=46



ERW

Nominal Size		12 x 6								Nominal Size		12 x 4							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	
Weight Per Foot		67.82	55.66	42.79	36.10	29.23				22.18	Weight Per Foot		59.32	48.85	37.69	31.84	25.82		19.63
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174				
Span in Feet	4	270	229	181	155	128	0.04	89	0.04	Span in Feet	4	206	177	142	121	101	77	0.04	
	5	216	183	145	124	102	0.07	71	0.06		5	165	141	113	97	81	62	0.07	
	6	180	152	121	104	85	0.09	59	0.09		6	138	118	94	81	67	52	0.09	
	7	154	131	104	89	73	0.13	51	0.12		7	118	101	81	69	58	44	0.13	
	8	135	114	91	78	64	0.17	45	0.15		8	103	88	71	61	50	39	0.17	
	9	120	102	81	69	57	0.21	40	0.19		9	92	78	63	54	45	34	0.21	
	10	108	91	72	62	51	0.26	36	0.24		10	83	71	57	49	41	31	0.19	
	11	98	83	66	56	46	0.32	32	0.29		11	83	71	57	49	40	31	0.26	
	12	90	76	60	52	43	0.38	30	0.34		12	75	64	52	44	37	28	0.24	
	13	83	70	56	48	39	0.44	27	0.40		13	75	64	52	44	37	28	0.32	
	14	77	65	52	44	36	0.51	—	—		14	68	58	47	40	33	26	0.29	
	15	72	61	48	41	34	0.59	—	—		15	69	59	47	40	34	26	0.38	
	16	68	57	45	39	32	0.67	—	—		16	63	54	43	37	31	23	0.34	
	17	64	54	43	37	30	0.76	—	—		17	64	54	44	37	31	24	0.44	
	18	60	51	40	35	28	0.85	—	—		18	58	49	40	34	28	22	0.40	
	19	57	48	38	33	27	0.94	—	—		19	59	50	40	35	29	22	0.51	
	20	54	46	36	31	26	1.05	—	—		20	54	46	37	32	26	20	0.47	
	21	51	44	35	30	24	1.15	—	—		21	55	47	38	32	27	21	0.59	
	22	49	42	33	28	23	1.27	—	—		22	50	43	34	29	24	19	0.54	
	23	47	40	32	27	22	1.38	—	—		23	52	44	35	30	25	19	0.67	
	24	45	38	30	26	21	1.51	—	—		24	47	40	32	28	23	18	0.61	
	25	43	37	29	25	20	1.64	—	—		25	49	42	33	29	24	18	0.76	
	26	42	35	28	24	20	1.77	—	—		26	44	38	30	26	22	17	0.69	
	27	40	34	27	23	19	1.91	—	—		27	46	39	31	27	22	17	0.85	
	28	39	33	26	22	18	2.05	—	—		28	42	36	29	25	20	16	0.77	
		35	30	24	20	17	1.87	13	1.87			43	37	30	26	21	16	0.94	
												40	34	27	23	19	15	0.86	
												41	35	28	24	20	15	1.05	
										38	32	26	22	18	14	0.95			
										39	34	27	23	19	15	1.15			
										36	31	25	21	17	13	1.05			
										38	32	26	22	18	14	1.27			
										34	29	23	20	17	13	1.15			
										36	31	25	21	18	13	1.38			
										33	28	22	19	16	12	1.26			
										34	29	24	20	17	13	1.51			
										31	27	21	18	15	12	1.37			
										32	27	22	19	15	12	1.77			
										29	25	20	17	14	11	1.61			
										29	25	20	17	14	11	1.61			
										27	23	18	16	13	10	1.87			
WEB SHEAR AND PROPERTY VALUES																			
V, kips		257	205	154	129	103		77		V, kips		257	205	154	129	103	77		
S _x , In. ³		53.4	45.2	35.8	30.7	25.2		19.4		S _x , In. ³		40.8	34.9	28.0	24.0	19.9	15.3		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		12 x 3 1/2			Nominal Size		12 x 3			Nominal Size		12 x 2			
Wall Thickness		3/8	5/16	Δ Inches	Wall Thickness		5/16	1/4	3/16	Δ Inches	Wall Thickness		1/4	3/16	Δ Inches
Weight Per Foot		36.41	30.78		Weight Per Foot		29.72	24.12	18.35		Weight Per Foot		22.42	17.08	
Design Wall Thickness		0.349	0.291	Design Wall Thickness		0.291	0.233	0.174	Design Wall Thickness		0.233	0.174			
Span in Feet	4	132	113	0.04	Span in Feet	4	105	87	67	0.04	Span in Feet	4	73	57	0.04
	5	105	91	0.07		5	84	70	54	0.07		5	59	45	0.07
	6	88	76	0.09		6	70	58	45	0.09		6	53	41	0.06
	7	75	65	0.13		7	60	50	38	0.13		6	49	38	0.09
	8	66	57	0.17		7	54	45	35	0.12		6	44	34	0.09
	9	58	50	0.21		8	52	44	34	0.17		7	42	32	0.13
	10	53	46	0.19		8	48	40	31	0.15		7	38	29	0.12
	11	48	41	0.26		9	47	39	30	0.21		8	37	28	0.17
	12	44	38	0.38		9	42	35	27	0.19		8	33	26	0.15
	13	40	35	0.44		10	42	35	27	0.26		9	33	25	0.21
	14	38	32	0.51		10	38	32	24	0.24		9	30	23	0.19
	15	35	30	0.59		11	38	32	24	0.32		10	29	23	0.26
	16	32	27	0.54		11	35	29	22	0.29		10	27	21	0.24
	17	33	28	0.67		12	35	29	22	0.38		11	27	21	0.32
	18	30	26	0.61		12	32	26	20	0.34		11	24	19	0.29
	19	31	27	0.76		13	32	27	21	0.44		12	24	19	0.38
	20	28	24	0.69		13	29	24	19	0.40		12	22	17	0.34
	21	29	25	0.85		14	30	25	19	0.51		13	23	17	0.44
	22	27	23	0.77		14	27	23	17	0.47		13	21	16	0.40
	23	28	24	0.94		15	28	23	18	0.59		14	21	16	0.51
	24	25	22	0.86		15	25	21	16	0.54		14	19	15	0.47
	25	26	23	1.05		16	26	22	17	0.67		15	20	15	0.59
	26	24	21	0.95		16	24	20	15	0.61		15	18	14	0.54
	27	25	22	1.15		17	24	20	15	0.61		16	18	14	0.67
	28	23	20	1.05		17	25	20	16	0.76		16	17	13	0.61
		28	27	0.85		18	22	19	14	0.69		17	17	13	0.76
		28	25	0.86		18	22	18	14	0.77		17	16	12	0.69
		28	26	1.05		19	23	19	15	0.85		18	16	13	0.85
	28	24	0.95	19	21	18	14	0.86	18	15	11	0.77			
	28	25	1.15	20	22	18	14	0.94	19	15	12	0.94			
	28	23	1.05	20	20	17	13	0.86	19	14	11	0.86			
	28	24	1.27	21	21	17	13	1.05	20	15	12	1.05			
	28	22	1.15	21	19	16	12	0.95	20	14	11	0.86			
	28	24	1.27	22	19	16	12	1.27	21	15	11	1.05			
	28	22	1.15	22	17	14	11	1.15	21	13	10	0.95			
	28	22	1.51	24	17	15	11	1.51	22	13	10	1.27			
	28	20	1.37	24	16	13	10	1.37	22	12	9.4	1.15			
	28	20	1.77	26	16	13	10	1.77	24	12	9.4	1.51			
	28	18	1.61	26	15	12	9.4	1.61	24	11	8.6	1.37			
	28	19	2.05	28	15	12	9.6	2.05	26	11	8.7	1.77			
	28	17	1.87	28	14	11	8.7	1.87	26	10	7.9	1.61			
										28	10	8.1	2.05		
											9.5	7.4	1.87		

WEB SHEAR AND PROPERTY VALUES												
V, kips	154	129		V, kips	129	103	77		V, kips	103	77	
S _x , In. ³	26.0	22.4		S _x , In. ³	20.7	17.2	13.3		S _x , In. ³	14.5	11.2	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		10 x 8								Nominal Size		10 x 6							
Wall Thickness		1/2	3/8	5/16	Δ	1/4	Δ	3/16	Δ	Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ	3/16	Δ
Weight Per Foot		55.66	42.79	36.10	Inches	29.23	Inches	22.18	Inches	Weight Per Foot		59.32	48.85	37.69	31.84	25.82	Inches	19.63	Inches
Design Wall Thickness		0.465	0.349	0.291		0.233		0.174*		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174	
Span in Feet	2	342	257	214	0.01	171	0.01	128	0.01	Span in Feet	2	407	342	257	214	171	0.01	128	0.01
	3	288	229	196	0.03	146	0.03	104	0.02		3	271	231	184	159	131	0.03	91	0.03
	4	216	172	147	0.05	109	0.05	78	0.04		4	203	174	138	119	98	0.05	69	0.05
	5	173	137	117	0.08	88	0.07	63	0.07		5	163	139	111	95	79	0.08	55	0.07
	6	144	114	98	0.11	73	0.10	52	0.10		6	136	116	92	79	65	0.11	46	0.10
	7	123	98	84	0.15	63	0.14	45	0.13		7	116	99	79	68	56	0.15	39	0.14
	8	108	86	73	0.20	55	0.18	39	0.17		8	102	87	69	59	49	0.20	34	0.18
	9	96	76	65	0.25	49	0.23	35	0.22		9	90	77	61	53	44	0.25	30	0.23
	10	86	69	59	0.31	44	0.29	31	0.27		10	81	69	55	48	39	0.31	27	0.29
	11	79	62	53	0.38	40	0.35	28	0.32		11	74	63	50	43	36	0.38	25	0.35
	12	72	57	49	0.45	36	0.41	26	0.38		12	68	58	46	40	33	0.45	23	0.41
	13	66	53	45	0.53	34	0.48	24	0.45		13	63	53	43	37	30	0.53	21	0.48
	14	62	49	42	0.62	31	0.56	22	0.52		14	58	50	39	34	28	0.62	—	—
	15	58	46	39	0.71	29	0.64	21	0.60			53	45	36	31	25	0.56	20	0.56
	16	54	43	37	0.80	27	0.73	20	0.68		15	54	46	37	32	26	0.71	—	—
	17	51	40	35	0.91	26	0.83	18	0.77			49	42	33	29	24	0.64	18	0.64
	18	48	38	33	1.02	—	—	—	—		16	51	43	35	30	25	0.80	—	—
		44	35	30	0.93	24	0.93	17	0.86			46	39	31	27	22	0.73	17	0.73
	19	45	36	31	1.13	—	—	—	—		17	48	41	33	28	23	0.91	—	—
		41	33	28	1.03	23	1.03	16	0.96			44	37	30	25	21	0.83	16	0.83
	20	43	34	29	1.26	—	—	—	—		18	45	39	31	26	22	1.02	—	—
		39	31	27	1.14	22	1.14	16	1.06			41	35	28	24	20	0.93	15	0.93
	21	41	33	28	1.39	—	—	—	—		19	43	37	29	25	21	1.13	—	—
37		30	25	1.26	21	1.26	15	1.17	39	33		26	23	19	1.03	14	1.03		
22	39	31	27	1.52	—	—	—	—	20	41	35	28	24	20	1.26	—	—		
	36	28	24	1.38	20	1.38	14	1.29		37	32	25	22	18	1.14	14	1.14		
23	38	30	26	1.66	—	—	—	—	21	39	33	26	23	19	1.39	—	—		
	34	27	23	1.51	19	1.51	14	1.40		35	30	24	21	17	1.26	13	1.26		
22										22	37	32	25	22	18	1.52	—	—	
											34	29	23	20	16	1.38	12	1.38	
23										23	35	30	24	21	17	1.66	—	—	
											32	27	22	19	16	1.51	12	1.51	

WEB SHEAR AND PROPERTY VALUES

V, kips	171	128	107		86		64		V, kips	214	171	128	107	86		64	
S _x , in. ³	42.7	33.9	29.0		23.8		17.0**		S _x , in. ³	40.2	34.3	27.3	23.5	19.4		14.9	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		10 x 5					Nominal Size		10 x 4						
Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		35.13	29.72	24.12	18.35		Weight Per Foot		50.81	42.05	32.58	27.59	22.42	17.08	
Design Wall Thickness		0.349	0.291	0.233	0.174		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	244	210	171	128	0.01	Span in Feet	2	303	261	210	182	151	117	0.01
	3	163	140	116	89	0.03		3	202	174	140	121	101	78	0.03
	4	122	105	87	67	0.05		4	151	131	105	91	75	59	0.05
	5	98	84	70	53	0.08		5	121	104	84	73	60	47	0.08
	6	81	70	58	45	0.11		6	101	87	70	61	50	39	0.11
	7	70	60	50	38	0.15		7	86	75	60	52	43	34	0.15
	8	61	53	44	33	0.20		8	76	65	53	46	38	29	0.20
	9	54	47	39	30	0.25		9	67	58	47	40	34	26	0.25
	10	49	42	35	27	0.31			61	53	43	37	30	24	0.23
	11	44	38	32	24	0.38		10	61	52	42	36	30	23	0.31
		40	35	29	22	0.35			55	47	38	33	27	21	0.29
	12	41	35	29	22	0.45		11	55	47	38	33	27	21	0.38
		37	32	26	20	0.41			50	43	35	30	25	19	0.35
	13	38	32	27	21	0.53		12	50	44	35	30	25	20	0.45
		34	29	24	19	0.48			46	40	32	28	23	18	0.41
	14	35	30	25	19	0.62		13	47	40	32	28	23	18	0.53
		32	27	23	17	0.56			42	37	29	25	21	16	0.48
	15	33	28	23	18	0.71		14	43	37	30	26	22	17	0.62
		30	26	21	16	0.64			39	34	27	24	20	15	0.56
	16	30	26	22	17	0.80		15	40	35	28	24	20	16	0.71
		28	24	20	15	0.73			37	32	26	22	18	14	0.64
	17	29	25	20	16	0.91		16	38	33	26	23	19	15	0.80
		26	23	19	14	0.83			34	30	24	21	17	13	0.73
18	27	23	19	15	1.02	17	36	31	25	21	18	14	0.91		
	25	21	18	13	0.93		32	28	23	19	16	13	0.83		
19	26	22	18	14	1.13	18	34	29	23	20	17	13	1.02		
	23	20	17	13	1.03		31	26	21	18	15	12	0.93		
20	24	21	17	13	1.26	19	32	27	22	19	16	12	1.13		
	22	19	16	12	1.14		29	25	20	17	14	11	1.03		
21	23	20	17	13	1.39	20	30	26	21	18	15	12	1.26		
	21	18	15	12	1.26		28	24	19	17	14	11	1.14		
22	22	19	16	12	1.52	21	29	25	20	17	14	11	1.39		
	20	17	14	11	1.38		26	23	18	16	13	10	1.26		
23	21	18	15	12	1.66	22	28	24	19	17	14	11	1.52		
	19	17	14	11	1.51		25	22	17	15	12	9.7	1.38		
						23	26	23	18	16	13	10	1.66		
							24	21	17	14	12	9.3	1.51		

WEB SHEAR AND PROPERTY VALUES

V, kips	128	107	86	64	V, kips	214	171	128	107	86	64
S _x , In. ³	24.1	20.8	17.2	13.2	S _x , In. ³	29.9	25.8	20.8	18.0	14.9	11.6

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		10 x 3 1/2		Nominal Size		10 x 3						Nominal Size		10 x 2				
Wall Thickness		3/16	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		16.44		Weight Per Foot		30.03	25.46	20.72	15.80	10.71		Weight Per Foot		27.48	23.34	19.02	14.53	
Design Wall Thickness		0.174	Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	Design Wall Thickness		0.349	0.291	0.233	0.174			
Span in Feet	2	108	0.01	Span in Feet	2	178	155	129	100	69	0.01	Span in Feet	2	145	127	106	83	0.01
	3	72	0.03		3	119	103	86	67	46	0.03		3	96	84	71	55	0.03
	4	54	0.05		4	89	77	64	50	35	0.05		4	72	63	53	41	0.05
	5	43	0.08		5	71	62	51	40	28	0.08		5	58	51	43	33	0.08
	6	36	0.11		6	59	52	43	33	23	0.11		6	53	46	39	30	0.07
	7	31	0.15		7	51	44	37	29	20	0.15		7	48	42	35	28	0.11
	8	27	0.20		8	46	40	33	26	18	0.14		8	44	38	32	25	0.10
	9	25	0.18		9	45	39	32	25	17	0.20		9	41	36	30	24	0.15
	10	24	0.25		10	40	35	29	23	16	0.18		10	38	33	28	22	0.14
	11	22	0.23		11	40	34	29	22	15	0.25		11	36	32	27	21	0.20
	12	22	0.31		12	36	31	26	20	14	0.23		12	33	29	24	19	0.18
	13	20	0.29		13	36	31	26	20	14	0.31		13	32	28	24	18	0.25
	14	20	0.38		14	32	28	23	18	13	0.29		14	29	26	21	17	0.23
	15	18	0.35		15	32	28	23	18	13	0.38		15	29	25	21	17	0.31
	16	18	0.45		16	29	26	21	17	11	0.35		16	26	23	19	15	0.29
	17	16	0.41		17	30	26	21	17	12	0.45		17	26	23	19	15	0.38
	18	17	0.53		18	27	23	19	15	10	0.41		18	24	21	18	14	0.35
	19	15	0.48		19	27	24	20	15	11	0.53		19	24	21	18	14	0.45
	20	15	0.62		20	25	22	18	14	9.7	0.48		20	22	19	16	13	0.41
	21	14	0.56		21	25	22	18	14	9.9	0.62		21	22	19	16	13	0.53
	22	14	0.71		22	23	20	17	13	9.0	0.56		22	20	18	15	12	0.48
	23	13	0.64		23	24	21	17	13	9.2	0.71		23	21	18	15	12	0.62
	24	13	0.80		24	22	19	16	12	8.4	0.64		24	19	16	14	11	0.56
25	12	0.73	25	22	19	16	12	8.6	0.80	25	19	17	14	11	0.71			
26	13	0.91	26	20	18	15	11	7.9	0.73	26	18	15	13	10	0.64			
27	12	0.83	27	21	18	15	12	8.1	0.91	27	18	16	13	10	0.80			
28	12	1.02	28	19	17	14	11	7.4	0.83	28	16	14	12	9.4	0.73			
29	11	0.93	29	20	17	14	11	7.7	1.02	29	17	15	13	9.8	0.91			
30	11	1.13	30	18	16	13	10	7.0	0.93	30	15	14	11	8.9	0.83			
31	10	1.03	31	19	16	14	11	7.3	1.13	31	16	14	12	9.2	1.02			
32	11	1.26	32	17	15	12	9.6	6.6	1.03	32	15	13	11	8.4	0.93			
33	9.8	1.14	33	18	15	13	10	6.9	1.26	33	15	13	11	8.7	1.13			
34	10	1.39	34	16	14	12	9.1	6.3	1.14	34	14	12	10	7.9	1.03			
35	9.4	1.26	35	17	15	12	9.5	6.6	1.39	35	14	13	11	8.3	1.26			
36	9.8	1.52	36	15	13	11	8.6	6.0	1.26	36	13	12	9.7	7.5	1.14			
37	8.9	1.38	37	16	14	12	9.1	6.3	1.52	37	14	12	10	7.9	1.39			
38	9.4	1.66	38	15	13	11	8.3	5.7	1.38	38	13	11	9.2	7.2	1.26			
39	8.6	1.51	39	15	13	11	8.7	6.0	1.66	39	13	12	9.7	7.5	1.52			
40			40	14	12	10	7.9	5.5	1.51	40	12	10	8.8	6.8	1.38			
41			41							41	13	11	9.2	7.2	1.66			
42			42							42	11	10	8.4	6.6	1.51			

WEB SHEAR AND PROPERTY VALUES																
V, kips	64		V, kips	128	107	86	64	43		V, kips	128	107	86	64		
S _x , In. ³	10.7		S _x , In. ³	17.6	15.3	12.7	9.87	6.83		S _x , In. ³	14.3	12.5	10.5	8.19		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW


Nominal Size		9 x 7							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		59.32	48.85	37.69	31.84	25.82		19.63	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174 *	
Span in Feet	2	385	308	231	193	154	0.01	115	0.01
	3	261	223	178	152	126	0.03	86	0.03
	4	196	167	134	114	95	0.06	65	0.05
	5	157	134	107	91	76	0.09	52	0.08
	6	131	111	89	76	63	0.13	43	0.11
	7	112	95	76	65	54	0.17	37	0.15
	8	98	83	67	57	47	0.22	32	0.20
	9	87	74	59	51	42	0.28	29	0.25
	10	78	67	53	46	38	0.35	26	0.31
	11	71	61	49	42	34	0.42	24	0.38
	12	65	56	45	38	32	0.50	22	0.45
	13	60	51	41	35	29	0.59	20	0.53
	14	56	48	38	33	27	0.68	19	0.61
	15	52	45	36	30	25	0.79	17	0.70
	16	49	42	33	29	24	0.89	—	—
		45	38	30	26	22	0.81	16	0.80
	17	46	39	31	27	22	1.01	—	—
		42	36	29	24	20	0.92	15	0.90
	18	44	37	30	25	21	1.13	—	—
		40	34	27	23	19	1.03	14	1.01
	19	41	35	28	24	20	1.26	—	—
	37	32	26	22	18	1.15	14	1.12	
20	39	33	27	23	19	1.40	—	—	
	36	30	24	21	17	1.27	13	1.24	
21	37	32	25	22	18	1.54	—	—	
	34	29	23	20	16	1.40	12	1.37	
WEB SHEAR AND PROPERTY VALUES									
V, kips	192	154	116	96	77			58	
S_x , In. ³	38.7	33.0	26.4	22.6	18.7			14.1**	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		9 x 5						Δ Inches
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	
Weight Per Foot		50.81	42.05	32.58	27.59	22.42	17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	300	258	207	179	149	<u>115</u>	0.01
	3	200	172	138	119	99	77	0.03
	4	150	129	104	90	74	58	0.06
	5	120	103	83	72	60	46	0.09
	6	100	86	69	60	50	38	0.13
	7	86	74	59	51	43	33	0.17
	8	75	65	52	45	37	29	0.22
	9	67	57	46	40	33	26	0.28
	10	60	52	41	36	30	23	0.35
	11	54	47	38	33	27	21	0.42
		50	43	34	30	25	19	0.38
	12	50	43	35	30	25	19	0.50
		45	39	31	27	23	17	0.46
	13	46	40	32	28	23	18	0.59
		42	36	29	25	21	16	0.54
	14	43	37	30	26	21	16	0.68
		39	34	27	23	19	15	0.62
	15	40	34	28	24	20	15	0.79
		36	31	25	22	18	14	0.71
	16	37	32	26	22	19	14	0.89
		34	29	24	20	17	13	0.81
17	35	30	24	21	18	14	1.01	
	32	28	22	19	16	12	0.92	
18	33	29	23	20	17	13	1.13	
	30	26	21	18	15	12	1.03	
19	32	27	22	19	16	12	1.26	
	29	25	20	17	14	11	1.15	
20	30	26	21	18	15	12	1.40	
	27	23	19	16	14	10	1.27	
21	29	25	20	17	14	11	1.54	
	26	22	18	16	13	10	1.40	
WEB SHEAR AND PROPERTY VALUES								
V, kips		192	154	116	96	77	58	
S_x, in.³		29.6	25.5	20.5	17.7	14.7	11.4	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


$F_y=46$



ERW

Nominal Size		9 x 3					Δ Inches
Wall Thickness	1/2	3/8	5/16	1/4	3/16		
Weight Per Foot	35.24	27.48	23.34	19.02	14.53		
Design Wall Thickness	0.465	0.349	0.291	0.233	0.174		
Span in Feet	2	181	149	130	108	85	0.01
	3	121	99	86	72	56	0.03
	4	91	74	65	54	42	0.06
	5	72	60	52	43	34	0.09
	6	60	50	43	36	28	0.13
	7	52	43	37	31	24	0.17
		47	39	34	28	22	0.16
	8	45	37	32	27	21	0.22
		41	34	29	25	19	0.20
	9	40	33	29	24	19	0.28
		37	30	26	22	17	0.26
	10	36	30	26	22	17	0.35
		33	27	24	20	15	0.32
	11	33	27	24	20	15	0.42
		30	25	21	18	14	0.38
	12	30	25	22	18	14	0.50
		27	23	20	16	13	0.46
	13	28	23	20	17	13	0.59
		25	21	18	15	12	0.54
	14	26	21	19	15	12	0.68
		24	19	17	14	11	0.62
15	24	20	17	14	11	0.79	
	22	18	16	13	10	0.71	
16	23	19	16	14	11	0.89	
	21	17	15	12	9.6	0.81	
17	21	18	15	13	9.9	1.01	
	19	16	14	12	9.0	0.92	
18	20	17	14	12	9.4	1.13	
	18	15	13	11	8.5	1.03	
19	19	16	14	11	8.9	1.26	
	17	14	12	10	8.1	1.15	
20	18	15	13	11	8.5	1.40	
	16	14	12	9.8	7.7	1.27	
21	17	14	12	10	8.0	1.54	
	16	13	11	9.4	7.3	1.40	
WEB SHEAR AND PROPERTY VALUES							
V, kips	154	116	96	77	58		
S_x , In. ³	17.9	14.7	12.8	10.7	8.35		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



Nominal Size		8 x 6							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		50.81	42.05	32.58	27.59	22.42		17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174	
Span in Feet	2	288	248	200	171	137	0.02	100	0.01
	3	192	165	134	115	95	0.04	67	0.03
	4	144	124	100	87	71	0.06	50	0.06
	5	115	99	80	69	57	0.10	40	0.09
	6	96	83	67	58	48	0.14	33	0.13
	7	82	71	57	49	41	0.19	29	0.17
	8	72	62	50	43	36	0.25	25	0.23
	9	64	55	45	38	32	0.32	22	0.29
	10	58	50	40	35	29	0.39	20	0.36
	11	52	45	36	31	26	0.48	18	0.43
	12	48	41	33	29	24	0.57	17	0.51
	13	44	38	31	27	22	0.66	15	0.60
	14	41	35	29	25	20	0.77	—	—
		37	32	26	22	19	0.70	14	0.70
	15	38	33	27	23	19	0.88	—	—
		35	30	24	21	17	0.80	13	0.80
	16	36	31	25	22	18	1.01	—	—
		33	28	23	20	16	0.91	13	0.91
17	34	29	24	20	17	1.13	—	—	
	31	27	21	19	15	1.03	12	1.03	
18	32	28	22	19	16	1.27	—	—	
	29	25	20	17	14	1.16	11	1.16	
WEB SHEAR AND PROPERTY VALUES									
V, kips		171	137	103	86	69		51	
S _x , in. ³		28.5	24.5	19.8	17.1	14.1		10.9	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		8 x 4								
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		42.30	35.24	27.48	23.34	19.02	14.53		9.86	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174		0.116	
Span in Feet	2	207	181	149	130	107	84	0.02	53	0.01
	3	138	121	99	86	72	56	0.04	35	0.03
	4	104	91	74	65	54	42	0.06	26	0.06
	5	83	72	60	52	43	33	0.10	21	0.09
	6	69	60	50	43	36	28	0.14	18	0.13
	7	59	52	43	37	31	24	0.19	15	0.17
	8	52	45	37	32	27	21	0.25	13	0.23
	9	46	40	33	29	24	19	0.32	—	—
		42	37	30	26	22	17	0.29	12	0.29
	10	41	36	30	26	21	17	0.39	—	—
		38	33	27	24	20	15	0.36	11	0.36
	11	38	33	27	24	20	15	0.48	—	—
		34	30	25	21	18	14	0.43	9.6	0.43
	12	35	30	25	22	18	14	0.57	—	—
		31	27	23	20	16	13	0.51	8.8	0.51
	13	32	28	23	20	17	13	0.66	—	—
		29	25	21	18	15	12	0.60	8.1	0.60
	14	30	26	21	19	15	12	0.77	—	—
		27	24	19	17	14	11	0.70	7.5	0.70
	15	28	24	20	17	14	11	0.88	—	—
		25	22	18	16	13	10	0.80	7.0	0.80
	16	26	23	19	16	13	10	1.01	—	—
		24	21	17	15	12	9.5	0.91	6.6	0.91
	17	24	21	18	15	13	9.8	1.13	—	—
22		19	16	14	11	9.0	1.03	6.2	1.03	
18	23	20	17	14	12	9.3	1.27	—	—	
	21	18	15	13	11	8.5	1.16	5.9	1.16	
WEB SHEAR AND PROPERTY VALUES										
V, kips		171	137	103	86	69	51		34	
S_x , In. ³		20.5	17.9	14.7	12.8	10.6	8.27		5.73	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		8 x 3							Nominal Size		8 x 2					
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		31.84	24.93	21.21	17.32	13.25	9.01		Weight Per Foot		22.37	19.08	15.62	11.97	8.16	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	
Span in Feet	2	148	122	107	90	70	49	0.02	Span in Feet	2	97	85	72	57	40	0.02
	3	99	82	72	60	47	33	0.04		3	64	57	48	38	27	0.04
	4	74	61	54	45	35	24	0.06		4	48	43	36	28	20	0.06
	5	59	49	43	36	28	20	0.10		5	39	34	29	23	16	0.10
	6	49	41	36	30	23	16	0.14		5	35	31	26	21	14	0.09
	7	42	35	31	26	20	14	0.19		6	32	28	24	19	13	0.14
		38	32	28	23	18	13	0.17			29	26	22	17	12	0.13
	8	37	31	27	22	18	12	0.25		7	28	24	21	16	11	0.19
		34	28	24	20	16	11	0.23			25	22	19	15	10	0.17
	9	33	27	24	20	16	11	0.32		8	24	21	18	14	9.9	0.25
		30	25	22	18	14	9.9	0.29			22	19	16	13	9.0	0.23
	10	30	24	21	18	14	9.8	0.39		9	21	19	16	13	8.8	0.32
		27	22	20	16	13	8.9	0.36			20	17	15	11	8.0	0.29
	11	27	22	20	16	13	8.9	0.48		10	19	17	14	11	8.0	0.39
		24	20	18	15	12	8.1	0.43			18	16	13	10	7.2	0.36
	12	25	20	18	15	12	8.1	0.57		11	18	16	13	10	7.2	0.48
		22	19	16	14	11	7.4	0.51			16	14	12	9.4	6.6	0.43
	13	23	19	17	14	11	7.5	0.66		12	16	14	12	9.5	6.6	0.57
21		17	15	13	9.8	6.8	0.60	15	13		11	8.6	6.0	0.51		
14	21	17	15	13	10	7.0	0.77	13	15	13	11	8.7	6.1	0.66		
	19	16	14	12	9.1	6.3	0.70		14	12	10	7.9	5.6	0.60		
15	20	16	14	12	9.0	6.5	0.88	14	14	12	10	8.1	5.7	0.77		
	18	15	13	11	8.5	5.9	0.80		13	11	9.4	7.4	5.2	0.70		
16	18	15	13	11	8.8	6.1	1.01	15	13	11	10	7.6	5.3	0.88		
	17	14	12	10	8.0	5.6	0.91		12	10	8.7	6.9	4.8	0.80		
17	17	14	13	11	8.3	5.8	1.13	16	12	11	9.0	7.1	5.0	1.01		
	16	13	11	9.6	7.5	5.2	1.03		11	9.7	8.2	6.5	4.5	0.91		
18	16	14	12	10	7.8	5.4	1.27	17	11	10	8.5	6.7	4.7	1.13		
	15	12	11	9.1	7.1	4.9	1.16		10	9.1	7.7	6.1	4.3	1.03		
									18	11	9.5	8.0	6.3	4.4	1.27	
										9.8	8.6	7.3	5.7	4.0	1.16	

WEB SHEAR AND PROPERTY VALUES

V, kips	137	103	86	69	51	34		V, kips	103	86	69	51	34	
S _x , In. ³	14.6	12.1	10.6	8.88	6.94	4.83		S _x , In. ³	9.56	8.43	7.12	5.61	3.93	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46




ERW

Nominal Size		7 x 5									
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	
Weight Per Foot		42.30	35.24	27.48	23.34	19.02	14.53		9.86		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174		0.116*		
Span in Feet	2	200	175	143	124	103	81	0.02	48	0.02	
	3	134	117	95	83	69	54	0.04	32	0.04	
	4	100	88	71	62	52	40	0.07	24	0.06	
	5	80	70	57	50	41	32	0.11	19	0.10	
	6	67	58	48	41	34	27	0.16	16	0.14	
	7	57	50	41	36	29	23	0.22	14	0.19	
	8	50	44	36	31	26	20	0.29	12	0.25	
	9	45	39	32	28	23	18	0.36	11	0.32	
	10	40	35	29	25	21	16	0.45	9.7	0.39	
	11	36	32	26	23	19	15	0.54	—	—	
		33	29	24	21	17	13	0.49	8.8	0.47	
	12	33	29	24	21	17	13	0.65	—	—	
		30	27	22	19	16	12	0.59	8.1	0.56	
	13	31	27	22	19	16	12	0.76	—	—	
		28	24	20	17	14	11	0.69	7.5	0.66	
	14	29	25	20	18	15	12	0.88	—	—	
		26	23	19	16	13	10	0.80	6.9	0.76	
	15	27	23	19	17	14	11	1.01	—	—	
		24	21	17	15	13	9.8	0.92	6.5	0.88	
	16	25	22	18	16	13	10	1.15	—	—	
		23	20	16	14	12	9.2	1.04	6.1	1.00	
	WEB SHEAR AND PROPERTY VALUES										
	V, kips		150	120	90	75	60	45		30	
	S _x , In. ³		19.8	17.3	14.1	12.3	10.2	7.96		5.27**	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		7 x 4							
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		31.84	24.93	21.21	17.32	13.25		9.01	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116	
Span in Feet	2	147	120	105	88	69	0.02	44	0.02
	3	98	80	70	59	46	0.04	29	0.04
	4	73	60	53	44	34	0.07	22	0.07
	5	59	48	42	35	28	0.11	17	0.10
	6	49	40	35	29	23	0.16	15	0.15
	7	42	34	30	25	20	0.22	12	0.20
	8	37	30	26	22	17	0.29	11	0.26
	9	33	27	23	20	15	0.36	—	—
		30	24	21	18	14	0.33	9.7	0.33
	10	29	24	21	18	14	0.45	—	—
		27	22	19	16	13	0.41	8.7	0.41
	11	27	22	19	16	13	0.54	—	—
		24	20	17	15	11	0.49	7.9	0.49
	12	24	20	18	15	11	0.65	—	—
		22	18	16	13	10	0.59	7.3	0.59
	13	23	19	16	14	11	0.76	—	—
	21	17	15	12	9.6	0.69	6.7	0.69	
14	21	17	15	13	9.8	0.88	—	—	
	19	16	14	11	8.9	0.80	6.2	0.80	
15	20	16	14	12	9.2	1.01	—	—	
	18	15	13	11	8.3	0.92	5.8	0.92	
16	18	15	13	11	8.6	1.15	—	—	
	17	14	12	10	7.8	1.04	5.4	1.04	
WEB SHEAR AND PROPERTY VALUES									
V, kips		120	90	75	60	45		30	
S_x, in.³		14.5	11.9	10.4	8.72	6.80		4.73	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		7 x 3							Nominal Size		6 x 5				
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		28.43	22.37	19.08	15.62	11.97	8.16		Weight Per Foot		24.93	21.21	17.32	13.25	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	
Span in Feet	2	117	98	86	73	57	40	0.02	Span in Feet	2	114	100	83	65	0.02
	3	78	66	58	49	38	27	0.04		3	76	66	56	43	0.05
	4	59	49	43	36	29	20	0.07		4	57	50	42	33	0.08
	5	47	39	35	29	23	16	0.11		5	46	40	33	26	0.13
	6	39	33	29	24	19	13	0.16		6	38	33	28	22	0.19
	7	34	28	25	21	16	11	0.22		7	33	28	24	19	0.26
		30	26	22	19	15	10	0.20		8	29	25	21	16	0.34
	8	29	25	22	18	14	10	0.29		9	25	22	19	14	0.42
		27	22	20	17	13	9.1	0.26		10	23	20	17	13	0.52
	9	26	22	19	16	13	8.9	0.36		11	21	18	15	12	0.63
		24	20	17	15	12	8.1	0.33			19	16	14	11	0.58
	10	23	20	17	15	11	8.0	0.45		12	19	17	14	11	0.75
		21	18	16	13	10	7.3	0.41			17	15	13	9.9	0.69
	11	21	18	16	13	10	7.3	0.54		13	18	15	13	10	0.88
		19	16	14	12	9.0	6.6	0.49			16	14	12	9.1	0.80
	12	20	16	14	12	10	6.7	0.65		14	16	14	12	9.3	1.03
18		15	13	11	8.7	6.1	0.59	15	13		11	8.5	0.93		
13	18	15	13	11	8.8	6.1	0.76								
	16	14	12	10	8.0	5.6	0.69								
14	17	14	12	10	8.2	5.7	0.88								
	15	13	11	9.0	7.4	5.2	0.80								
15	16	13	12	9.7	7.6	5.3	1.01								
	14	12	10	8.8	6.9	4.8	0.92								
16	15	12	11	9.1	7.1	5.0	1.15								
	13	11	9.8	8.3	6.5	4.5	1.04								

WEB SHEAR AND PROPERTY VALUES													
V, kips	120	90	75	60	45	30	V, kips	77	64	51	38		
S _x , In. ³	11.6	9.73	8.54	7.19	5.65	3.95	S _x , In. ³	11.3	9.85	8.25	6.44		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46




ERW

Nominal Size		6 x 4								Nominal Size		6 x 3							
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	
Weight Per Foot		28.43	22.37	19.08	15.62	11.97		8.16		Weight Per Foot		25.03	19.82	16.96	13.91	10.70	7.31		
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		
Span in Feet	2	114	95	84	70	55	0.02	35	0.02	Span in Feet	2	90	77	68	57	45	32	0.02	
	3	76	64	56	47	37	0.05	23	0.04		3	60	51	45	38	30	21	0.05	
	4	57	48	42	35	28	0.08	18	0.08		4	45	38	34	29	23	16	0.08	
	5	46	38	33	28	22	0.13	14	0.12		5	36	31	27	23	18	13	0.13	
	6	38	32	28	23	18	0.19	12	0.17		6	30	26	23	19	15	11	0.19	
	7	33	27	24	20	16	0.26	10	0.23		7	26	22	19	16	13	9.1	0.26	
	8	29	24	21	18	14	0.34	8.8	0.30			23	20	18	15	12	8.3	0.23	
	9	25	21	19	16	12	0.42	—	—		8	23	19	17	14	11	7.9	0.34	
		23	19	17	14	11	0.39	7.8	0.39			21	17	15	13	10	7.2	0.30	
	10	23	19	17	14	11	0.52	—	—		9	20	17	15	13	10	7.1	0.42	
		21	17	15	13	10	0.48	7.0	0.48			18	15	14	12	9.1	6.4	0.39	
	11	21	17	15	13	10	0.63	—	—		10	18	15	14	11	9.0	6.4	0.52	
		19	16	14	12	9.1	0.58	6.4	0.58			16	14	12	10	8.2	5.8	0.48	
	12	19	16	14	12	9.2	0.75	—	—		11	16	14	12	10	8.2	5.8	0.63	
17		14	13	11	8.4	0.69	5.8	0.69	15	13		11	9.5	7.5	5.3	0.58			
13	18	15	13	11	8.5	0.88	—	—	12	15	13	11	9.5	7.5	5.3	0.75			
	16	13	12	9.9	7.7	0.80	5.4	0.80		14	12	10	8.7	6.9	4.8	0.69			
14	16	14	12	10	7.9	1.03	—	—	13	14	12	10	8.8	7.0	4.9	0.88			
	15	12	11	9.1	7.2	0.93	5.0	0.93		13	11	9.5	8.0	6.3	4.4	0.80			
14	13	11	9.7	8.2	6.5	4.5	1.03		14	13	11	9.7	8.2	6.5	4.5	1.03			
	12	9.9	8.8	7.4	5.9	4.1	0.93			12	9.9	8.8	7.4	5.9	4.1	0.93			

WEB SHEAR AND PROPERTY VALUES

V, kips	103	77	64	51	38		26		V, kips	103	77	64	51	38	26	
S _x , In. ³	11.3	9.43	8.27	6.96	5.46		3.81		S _x , In. ³	8.94	7.57	6.69	5.66	4.47	3.14	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing


Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		6 x 2						Nominal Size		5 x 4					
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		17.27	14.83	12.21	9.42	6.46		Weight Per Foot		25.03	19.82	16.96	13.91	10.70	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	58	52	44	35	25	0.02	Span in Feet	2	86	72	64	54	43	0.03
	3	39	34	29	24	17	0.05		3	57	48	43	36	28	0.06
	4	29	26	22	18	12	0.08		4	43	36	32	27	21	0.10
	5	23	21	18	14	10	0.13		5	34	29	26	22	17	0.16
		21	19	16	13	9.1	0.12		6	29	24	21	18	14	0.23
	6	19	17	15	12	8.3	0.19		7	25	21	18	15	12	0.31
		18	16	13	11	7.6	0.17		8	21	18	16	14	11	0.40
	7	17	15	13	10	7.1	0.26		9	19	16	14	12	9.5	0.51
		15	13	11	9.2	6.5	0.23			17	15	13	11	8.6	0.46
	8	14	13	11	8.8	6.2	0.34		10	17	14	13	11	8.5	0.63
		13	12	10	8.0	5.7	0.30			16	13	12	10	7.8	0.57
	9	13	11	9.8	7.8	5.6	0.42		11	16	13	12	9.8	7.8	0.76
		12	10	8.9	7.1	5.0	0.39			14	12	11	8.9	7.1	0.69
	10	12	10	8.8	7.1	5.0	0.52								
11		9.4	8.0	6.4	4.5	0.48									
11	11	9.4	8.0	6.4	4.5	0.63									
	9.6	8.5	7.3	5.8	4.1	0.58									
12	9.6	8.6	7.4	5.9	4.2	0.75									
	8.8	7.8	6.7	5.4	3.8	0.69									
13	8.9	8.0	6.8	5.4	3.8	0.88									
	8.1	7.2	6.2	4.9	3.5	0.80									
14	8.3	7.4	6.3	5.0	3.6	1.03									
	7.5	6.7	5.7	4.6	3.2	0.93									
WEB SHEAR AND PROPERTY VALUES															
V, kips	77	64	51	38	26		V, kips	86	64	54	43	32			
S _x , In. ³	5.71	5.11	4.37	3.49	2.47		S _x , In. ³	8.48	7.16	6.32	5.35	4.22			


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$




ERW

Nominal Size		5 x 3							Nominal Size		5 x 2 1/2			
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches
Weight Per Foot		21.63	17.27	14.83	12.21	9.42	6.46		Weight Per Foot		11.36	8.78	6.03	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116	
Span in Feet	2	66	57	51	43	35	24	0.03	Span in Feet	2	38	30	22	0.03
	3	44	38	34	29	23	16	0.06		3	25	20	14	0.06
	4	33	29	25	22	17	12	0.10		4	19	15	11	0.10
	5	27	23	20	17	14	9.8	0.16		5	15	12	8.7	0.16
	6	22	19	17	14	12	8.1	0.23		6	13	10	7.2	0.23
	7	19	16	15	12	9.9	7.0	0.31		6	12	9.2	6.6	0.21
	8	17	14	13	11	8.6	6.1	0.40		7	11	8.7	6.2	0.31
	9	15	13	11	9.6	7.7	5.4	0.51		7	9.9	7.9	5.6	0.28
	10	13	11	10	8.7	6.9	4.9	0.63		8	9.5	7.6	5.4	0.40
	11	12	10	9.3	7.9	6.3	4.4	0.57		8	8.6	6.9	4.9	0.37
		11	11	9.5	8.4	7.2	5.7	0.69		9	8.5	6.8	4.8	0.51
									9	7.7	6.2	4.4	0.46	
									10	7.6	6.1	4.3	0.63	
									10	6.9	5.5	3.9	0.57	
									11	6.9	5.5	3.9	0.76	
									11	6.3	5.0	3.6	0.69	

WEB SHEAR AND PROPERTY VALUES													
V, kips	86	64	54	43	32	21		V, kips	43	32	21		
S_x , in. ³	6.56	5.65	5.03	4.29	3.41	2.41		S_x , in. ³	3.76	3.01	2.14		


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		5 x 2						Nominal Size		4 x 3					
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		14.72	12.70	10.51	8.15	5.61		Weight Per Foot		14.72	12.70	10.51	8.15	5.61	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	
Span in Feet	2	42	38	33	26	19	0.03	Span in Feet	2	40	36	31	25	18	0.03
	3	28	25	22	18	13	0.06		3	27	24	21	17	12	0.07
	4	21	19	16	13	9.4	0.10		4	20	18	16	12	8.9	0.13
	5	17	15	13	11	7.5	0.16		5	16	14	12	10	7.1	0.20
		15	14	12	9.6	6.8	0.14			6	13	12	10	8.3	5.9
	6	14	13	11	8.8	6.3	0.23		6	11	10	8.9	7.1	5.1	0.38
		13	11	9.9	8.0	5.7	0.21			7	10	9.4	8.1	6.5	4.6
	7	12	11	9.3	7.5	5.4	0.31		7	10	9.0	7.8	6.2	4.5	0.50
		11	9.8	8.5	6.8	4.9	0.28			8	9.1	8.2	7.1	5.7	4.0
	8	10	9.5	8.2	6.6	4.7	0.40		8	8.9	8.0	6.9	5.6	4.0	0.64
		9.5	8.6	7.4	6.0	4.3	0.37			9	8.1	7.3	6.3	5.0	3.6
9	9.3	8.4	7.3	5.8	4.2	0.51	9								
	8.5	7.6	6.6	5.3	3.8	0.46									
10	8.4	7.6	6.5	5.3	3.8	0.63	10								
	7.6	6.9	5.9	4.8	3.4	0.57									
11	7.6	6.9	5.9	4.8	3.4	0.76	11								
	6.9	6.3	5.4	4.3	3.1	0.69									
WEB SHEAR AND PROPERTY VALUES															
V, kips	64	54	43	32	21		V, kips	51	43	34	26	17			
S_x , In. ³	4.14	3.74	3.23	2.60	1.86		S_x , In. ³	3.96	3.57	3.07	2.47	1.76			

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		4 x 2 1/2				Nominal Size		4 x 2							
Wall Thickness		5/16	1/4	3/16	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches		
Weight Per Foot		11.64	9.66	7.51		Weight Per Foot		12.17	10.58	8.81	6.87	4.75			
Design Wall Thickness		0.291	0.233	0.174		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116			
Span in Feet	2	31	27	22	0.03	Span in Feet	2	28	26	23	19	13	0.03		
	3	21	18	15	0.07		3	19	17	15	12	8.9	8.9	0.07	
	4	15	13	11	0.13		4	14	13	11	9.3	6.7	6.7	0.13	
	5	12	11	8.7	0.20		5	11	10	9.1	7.4	5.3	5.3	0.20	
	6	10	9.0	7.3	0.28		6	10	9.4	8.3	6.7	4.9	4.9	0.18	
		9.4	8.2	6.6	0.26			9.4	8.6	7.6	6.2	4.5	4.5	0.28	
	7	8.8	7.7	6.2	0.38		7	8.6	7.9	6.9	5.6	4.0	4.0	0.26	
		8.0	7.0	5.7	0.35			8.1	7.4	6.5	5.3	3.8	3.8	0.38	
	8	7.7	6.7	5.4	0.50		8	7.4	6.7	5.9	4.8	3.5	3.5	0.35	
		7.0	6.1	4.9	0.46			7.1	6.5	5.7	4.6	3.3	3.3	0.50	
	9	6.9	6.0	4.8	0.64		9	6.4	5.9	5.2	4.2	3.0	3.0	0.46	
		6.3	5.4	4.4	0.58			6.3	5.8	5.1	4.1	3.0	3.0	0.64	
								5.7	5.2	4.6	3.7	2.7	2.7	0.58	
	WEB SHEAR AND PROPERTY VALUES														
	V, kips		43	34	26			V, kips		51	43	34	26	17	
	S_x , in. ³		3.06	2.66	2.15			S_x , in. ³		2.80	2.56	2.25	1.83	1.32	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=46



ERW

Nominal Size		3 1/2 x 2 1/2						Nominal Size		3 x 2 1/2				
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		12.17	10.58	8.81	6.87	4.75		Weight Per Foot		9.51	7.96	6.23	4.33	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.291	0.233	0.174	0.116	
Span in Feet	1	55	50	44	36	26	0.01	Span in Feet	1	39	35	29	21	0.01
	2	27	25	22	18	13	0.04		2	20	17	14	10	0.04
	3	18	17	15	12	8.6	0.08		3	13	12	9.5	6.9	0.09
	4	14	13	11	8.9	6.5	0.14		4	9.8	8.7	7.1	5.2	0.17
	5	11	10	8.8	7.1	5.2	0.22		5	7.9	6.9	5.7	4.2	0.26
	6	9.1	8.4	7.3	5.9	4.3	0.32		6	6.5	5.8	4.8	3.5	0.38
		8.3	7.6	6.7	5.4	3.9	0.29			5.9	5.2	4.3	3.2	0.34
	7	7.8	7.2	6.3	5.1	3.7	0.44		7	5.6	4.9	4.1	3.0	0.51
		7.1	6.5	5.7	4.6	3.4	0.40			5.1	4.5	3.7	2.7	0.47
	8	6.9	6.3	5.5	4.5	3.2	0.57							
		6.2	5.7	5.0	4.0	2.9	0.52							
	WEB SHEAR AND PROPERTY VALUES													
V, kips	45	37	30	22	15		V, kips	32	26	19	13			
S _x , In. ³	2.71	2.48	2.17	1.76	1.28		S _x , In. ³	1.94	1.71	1.41	1.03			


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



ERW

Nominal Size		3 x 2					Nominal Size	3 x 1 1/2				Nominal Size	3 x 1				
Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches
Weight Per Foot		8.45	7.11	5.59	3.90		Weight Per Foot		6.26	4.96	3.48		Weight Per Foot		4.32	3.05	
Design Wall Thickness		0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116		Design Wall Thickness		0.174	0.116	
Span in Feet	1	32	29	24	18	0.01	Span in Feet	1	23	19	14	0.01	Span in Feet	1	14	11	0.01
	2	16	14	12	8.8	0.04		2	11	9.6	7.1	0.04		2	7.2	5.5	0.04
	3	11	9.6	8.0	5.8	0.09		3	7.6	6.4	4.8	0.09		3	4.8	3.7	0.09
	4	8.0	7.2	6.0	4.4	0.17		4	5.7	4.8	3.6	0.17		4	4.4	3.3	0.09
	5	6.4	5.7	4.8	3.5	0.26		5	5.2	4.3	3.2	0.15		5	3.6	2.8	0.17
	6	5.3	4.8	4.0	2.9	0.38		6	4.5	3.8	2.9	0.26		6	3.3	2.5	0.15
	7	4.8	4.4	3.6	2.7	0.34		7	4.1	3.5	2.6	0.24		7	2.9	2.2	0.26
	8	4.6	4.1	3.4	2.5	0.51		8	3.8	3.2	2.4	0.38		8	2.6	2.0	0.24
	4.2	3.7	3.1	2.3	0.47	9	3.4	2.9	2.2	0.34	9	2.4	1.8	0.38			
							10	3.2	2.7	2.0	0.51	10	2.2	1.7	0.34		
							11	2.9	2.5	1.9	0.47	11	2.1	1.6	0.51		
												12	1.9	1.4	0.47		

WEB SHEAR AND PROPERTY VALUES														
V, kips	32	26	19	13		V, kips	26	19	13		V, kips	19	13	
S _x , In. ³	1.58	1.42	1.18	0.866		S _x , In. ³	1.12	0.945	0.706		S _x , In. ³	0.713	0.545	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


$F_y=46$



ERW

Nominal Size		2 1/2 x 1 1/2				Nominal Size		2 x 1 1/2			Nominal Size		2 x 1		
Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches
Weight Per Foot		5.41	4.32	3.05		Weight Per Foot		3.68	2.63		Weight Per Foot		3.04	2.20	
Design Wall Thickness		0.233	0.174	0.116	Design Wall Thickness		0.174	0.116	Design Wall Thickness		0.174	0.116			
Span in Feet	1	17	14	11	0.01	Span in Feet	1	10	7.8	0.02	Span in Feet	1	7.1	5.7	0.02
	2	8.3	7.1	5.4	0.05		2	5.0	3.9	0.06		2	3.5	2.8	0.06
	3	5.5	4.8	3.6	0.11		3	3.3	2.6	0.14		3	2.4	1.9	0.14
	4	4.1	3.6	2.7	0.20		4	2.5	1.9	0.25		4	2.1	1.7	0.13
	5	3.8	3.2	2.5	0.18		4	2.3	1.8	0.23		4	1.8	1.4	0.25
		3.3	2.9	2.2	0.31										
		3.0	2.6	2.0	0.29										
WEB SHEAR AND PROPERTY VALUES															
V, kips		21	16	11		V, kips		13	8.5		V, kips		13	8.5	
S_x , In. ³		0.820	0.705	0.535		S_x , In. ³		0.494	0.383		S_x , In. ³		0.349	0.280	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables / Structural Steel Tubing

Notes


A large, empty rectangular box with a green border, intended for notes or additional information.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		16 x 16								Nominal Size		14 x 14							
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	5/16	Δ	Wall Thickness		5/8	1/2	Δ	3/8	Δ	5/16	Δ	
Weight Per Foot		127.37	Inches	103.30	Inches	78.52	Inches	65.87	Inches	Weight Per Foot		110.36	89.68	Inches	68.31	Inches	57.36	Inches	
Design Wall Thickness		0.581		0.465		0.349*		0.291*		Design Wall Thickness		0.581	0.465		0.349*		0.291*		
Span in Feet	4			548	0.03	411	0.03	343	0.02	Span in Feet	4	599	479	0.04	360	0.03	291	0.03	
	5	684	0.05	519	0.04	372	0.04	289	0.04		5	518	429	0.06	297	0.05	233	0.05	
	6	577	0.07	432	0.06	310	0.06	241	0.05		6	432	358	0.08	247	0.07	194	0.07	
	7	494	0.10	371	0.09	265	0.08	207	0.07		7	370	306	0.11	212	0.10	166	0.09	
	8	433	0.13	324	0.11	232	0.11	181	0.10		8	324	268	0.14	185	0.13	145	0.12	
	9	385	0.16	288	0.14	206	0.13	161	0.12		9	288	238	0.18	165	0.16	129	0.15	
	10	346	0.20	259	0.18	186	0.17	145	0.15		10	259	215	0.22	148	0.20	116	0.18	
	11	315	0.24	236	0.22	169	0.20	131	0.18		11	236	195	0.27	135	0.24	106	0.22	
	12	288	0.28	216	0.26	155	0.24	121	0.22		12	216	179	0.32	124	0.29	97	0.27	
	13	266	0.33	200	0.30	143	0.28	111	0.26		13	199	165	0.38	114	0.34	89	0.31	
	14	247	0.38	185	0.35	133	0.32	103	0.30		14	185	153	0.44	106	0.39	83	0.36	
	15	231	0.44	173	0.40	124	0.37	96	0.34		15	173	143	0.50	99	0.45	78	0.41	
	16	216	0.50	162	0.46	116	0.42	90	0.39		16	162	134	0.57	93	0.51	73	0.47	
	17	204	0.57	153	0.52	109	0.48	85	0.44		17	152	126	0.65	87	0.58	68	0.53	
	18	192	0.64	144	0.58	103	0.54	80	0.49		18	144	119	0.73	82	0.65	65	0.60	
	19	182	0.71	137	0.64	98	0.60	76	0.55		19	136	113	0.81	78	0.72	61	0.66	
	20	173	0.79	130	0.71	93	0.66	72	0.61		20	130	107	0.90	74	0.80	58	0.74	
	21	165	0.87	124	0.79	88	0.73	69	0.67		21	123	102	0.99	71	0.88	55	0.81	
	22	157	0.95	118	0.86	84	0.80	66	0.73		22	118	98	1.09	67	0.97	53	0.89	
	23	150	1.04	113	0.94	81	0.87	63	0.80		23	113	93	1.19	64	1.05	51	0.97	
	24	144	1.13	108	1.03	77	0.95	60	0.87		24	108	89	1.29	62	1.15	48	1.06	
	25	138	1.23	104	1.12	74	1.03	58	0.95		25	104	86	1.40	59	1.25	47	1.15	
	26	133	1.33	100	1.21	71	1.12	56	1.03		26	100	83	1.52	57	1.35	45	1.24	
	27	128	1.43	96	1.30	69	1.20	54	1.11		27	96	79	1.64	55	1.45	43	1.34	
	28	124	1.54	93	1.40	66	1.29	52	1.19		28	93	77	1.76	53	1.56	42	1.44	
	29	119	1.65	89	1.50	64	1.39	50	1.28		29	89	74	1.89	51	1.68	40	1.55	
	30	115	1.77	86	1.61	62	1.49	48	1.37		30	86	72	2.02	49	1.79	39	1.66	
	31	112	1.89	84	1.71	60	1.59	47	1.46		31	84	69	2.16	—	—	—	—	
	32	108	2.01	81	1.83	58	1.69	45	1.55			76	63	1.96	48	1.92	38	1.77	
	33	105	2.14	79	1.94	56	1.80	44	1.65		32	81	67	2.30	—	—	—	—	
	34	102	2.27	76	2.06	55	1.91	43	1.76			74	61	2.09	46	2.04	36	1.89	
	35	99	2.40	—	—	—	—	—	—		35	—	—	—	—	—	—	—	
		90	2.19	74	2.19	53	2.02	41	1.86			—	—	—	—	—	—	—	
	36	96	2.54	—	—	—	—	—	—		36	—	—	—	—	—	—	—	
87		2.31	72	2.31	52	2.14	40	1.97	—	—		—	—	—	—	—			
37	94	2.69	—	—	—	—	—	—	37	—	—	—	—	—	—	—			
	85	2.44	70	2.44	50	2.26	39	2.08		—	—	—	—	—	—	—			
WEB SHEAR AND PROPERTY VALUES																			
V, kips	342		274		205		171		V, kips	299	240		180		150				
S_x, In.³	171		141		101**		78.6**		S_x, In.³	128	106		80.6**		63.2**				

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		12 x 12								
Wall Thickness		5/8	1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches
Weight Per Foot		93.34	76.07		58.10		48.86		39.43	
Design Wall Thickness		0.581	0.465	0.349	0.291 *	0.233 *				
Span in Feet	4	462	386	0.04	274	0.04	225	0.04	167	0.03
	5	370	308	0.07	219	0.06	180	0.06	134	0.05
	6	308	257	0.09	182	0.09	150	0.08	111	0.08
	7	264	220	0.13	156	0.12	129	0.11	95	0.10
	8	231	193	0.17	137	0.15	113	0.15	83	0.13
	9	205	171	0.21	122	0.19	100	0.19	74	0.17
	10	185	154	0.26	109	0.24	90	0.23	67	0.21
	11	168	140	0.32	100	0.29	82	0.28	61	0.25
	12	154	129	0.38	91	0.34	75	0.33	56	0.30
	13	142	119	0.44	84	0.40	69	0.39	51	0.35
	14	132	110	0.51	78	0.47	64	0.45	48	0.41
	15	123	103	0.59	73	0.54	60	0.52	45	0.47
	16	115	96	0.67	68	0.61	56	0.59	42	0.53
	17	109	91	0.76	64	0.69	53	0.67	39	0.60
	18	103	86	0.85	61	0.77	50	0.75	37	0.68
	19	97	81	0.94	58	0.86	47	0.83	35	0.75
	20	92	77	1.05	55	0.95	45	0.92	33	0.84
	21	88	73	1.15	52	1.05	43	1.01	32	0.92
	22	84	70	1.27	50	1.15	41	1.11	30	1.01
	23	80	67	1.38	48	1.26	39	1.22	29	1.11
	24	77	64	1.51	46	1.37	38	1.33	28	1.20
	25	74	62	1.64	44	1.49	36	1.44	27	1.31
	26	71	59	1.77	42	1.61	35	1.56	26	1.41
	27	68	57	1.91	—	—	—	—	—	—
		62	52	1.73	41	1.73	33	1.68	25	1.52
	28	66	55	2.05	—	—	—	—	—	—
		60	50	1.87	41	1.87	32	1.80	24	1.64
	WEB SHEAR AND PROPERTY VALUES									
V, kips	257	205		154		129		103		
S _x , In. ³	91.3	76.2		59.5		49.0 **		36.3 **		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		10 x 10										
Wall Thickness		5/8	1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches	
Weight Per Foot		76.33	62.46	47.90		40.35		32.63		24.73		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233 *	0.174 *					
Span in Feet	2	428			0.01	214	0.01	171	0.01	128	0.01	
	3	410	342	257	0.03	212	0.03	165	0.02	111	0.02	
	4	308	259	204	0.05	159	0.05	124	0.04	83	0.04	
	5	246	207	164	0.08	127	0.07	99	0.07	67	0.06	
	6	205	173	136	0.11	106	0.10	82	0.10	56	0.09	
	7	176	148	117	0.15	91	0.14	71	0.13	48	0.12	
	8	154	130	102	0.20	79	0.18	62	0.17	42	0.15	
	9	137	115	91	0.25	71	0.23	55	0.22	37	0.19	
	10	123	104	82	0.31	63	0.29	49	0.27	33	0.24	
	11	112	94	74	0.38	58	0.35	45	0.33	30	0.29	
	12	103	86	68	0.45	53	0.41	41	0.39	28	0.34	
	13	95	80	63	0.53	49	0.48	38	0.46	26	0.40	
	14	88	74	58	0.62	45	0.56	35	0.53	24	0.47	
	15	82	69	55	0.71	42	0.64	33	0.61	22	0.54	
	16	77	65	51	0.80	40	0.73	31	0.70	21	0.61	
	17	72	61	48	0.91	37	0.83	29	0.79	20	0.69	
	18	68	58	45	1.02	35	0.93	27	0.88	19	0.78	
	19	65	55	43	1.13	33	1.03	26	0.98	18	0.86	
	20	62	52	41	1.26	32	1.14	25	1.09	17	0.96	
	21	59	49	39	1.39	30	1.26	24	1.20	16	1.06	
		22	56	47	37	1.52	—	—	—	—	—	—
			51	43	34	1.38	29	1.38	22	1.32	15	1.16
		23	54	45	36	1.66	—	—	—	—	—	—
		49	41	32	1.51	28	1.51	22	1.44	14	1.27	
WEB SHEAR AND PROPERTY VALUES												
V, kips		214	171	128		107		86		64		
S_x, In.³		60.8	51.2	40.4		34.5		26.9**		18.1**		

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		9 x 9								
Wall Thickness		1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches	
Weight Per Foot		55.66	42.79	36.10		29.23		22.18		
Design Wall Thickness		0.465	0.349	0.291		0.233*		0.174*		
Span in Feet	2	308	231	193	0.01	154	0.01	115	0.01	
	3	274	217	186	0.03	138	0.03	93	0.02	
	4	205	163	140	0.06	104	0.05	70	0.04	
	5	164	130	112	0.09	83	0.08	56	0.07	
	6	137	109	93	0.13	69	0.11	47	0.10	
	7	117	93	80	0.17	59	0.15	40	0.14	
	8	103	81	70	0.22	52	0.20	35	0.18	
	9	91	72	62	0.28	46	0.26	31	0.22	
	10	82	65	56	0.35	41	0.31	28	0.28	
	11	75	59	51	0.42	38	0.38	25	0.34	
	12	68	54	47	0.50	35	0.45	23	0.40	
	13	63	50	43	0.59	32	0.53	22	0.47	
	14	59	47	40	0.68	30	0.62	20	0.54	
	15	55	43	37	0.79	28	0.71	19	0.62	
	16	51	41	35	0.89	26	0.81	17	0.71	
	17	48	38	33	1.01	24	0.91	16	0.80	
	18	46	36	31	1.13	23	1.02	16	0.90	
	19	43	34	29	1.26	22	1.14	15	1.00	
		20	41	33	28	1.40	—	—	—	—
			37	30	25	1.27	21	1.26	14	1.11
		21	39	31	27	1.54	—	—	—	—
		36	28	24	1.40	20	1.39	13	1.22	
WEB SHEAR AND PROPERTY VALUES										
V, kips		154	116	96		77		58		
S _x , In. ³		40.6	32.2	27.6		22.5**		15.2**		

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		8 x 8									
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches	
Weight Per Foot		59.32	48.85	37.69	31.84		25.82		19.63		
Design Wall Thickness		0.581	0.465	0.349	0.291		0.233		0.174 *		
Span in Feet	2	342	274	205	171	0.02	137	0.01	102	0.01	
	3	246	210	168	144	0.04	109	0.03	77	0.03	
	4	185	158	126	108	0.06	81	0.06	58	0.05	
	5	148	126	101	87	0.10	65	0.09	46	0.08	
	6	123	105	84	72	0.14	54	0.13	38	0.12	
	7	106	90	72	62	0.19	47	0.17	33	0.16	
	8	92	79	63	54	0.25	41	0.23	21	0.21	
	9	82	70	56	48	0.32	36	0.29	26	0.27	
	10	74	63	50	43	0.39	33	0.36	23	0.33	
	11	67	57	46	39	0.48	30	0.43	21	0.40	
	12	62	53	42	36	0.57	27	0.51	19	0.47	
	13	57	49	39	33	0.66	25	0.60	18	0.55	
	14	53	45	36	31	0.77	23	0.70	16	0.64	
	15	49	42	34	29	0.88	22	0.80	15	0.74	
	16	46	39	31	27	1.01	20	0.91	14	0.84	
	17	43	37	30	25	1.13	19	1.03	14	0.95	
		18	41	35	28	24	1.27	—	—	—	—
			37	32	25	22	1.16	18	1.16	13	1.06
WEB SHEAR AND PROPERTY VALUES											
V, kips		171	137	103	86		69		51		
S _x , In. ³		36.5	31.2	24.9	21.4		17.7		12.5 **		

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		7 x 7							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		50.81	42.05	32.58	27.59	22.42		17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174 *	
Span in Feet	2	270	233	180	150	120	0.02	90	0.02
	3	180	155	125	108	90	0.04	61	0.04
	4	135	116	94	81	67	0.07	46	0.06
	5	108	93	75	65	54	0.11	37	0.10
	6	90	78	63	54	45	0.16	31	0.14
	7	77	67	54	46	38	0.22	26	0.19
	8	68	58	47	40	34	0.29	23	0.25
	9	60	52	42	36	30	0.36	20	0.32
	10	54	47	38	32	27	0.45	18	0.40
	11	49	42	34	29	24	0.54	17	0.48
	12	45	39	31	27	22	0.65	15	0.57
	13	42	36	29	25	21	0.76	14	0.67
	14	39	33	27	23	19	0.88	13	0.78
	15	36	31	25	22	18	1.01	12	0.89
	16	34	29	24	20	17	1.15	—	—
			31	26	21	18	15	1.04	12
WEB SHEAR AND PROPERTY VALUES									
V, kips		150	120	90	75	60		45	
S _x , In. ³		26.7	23.0	18.6	16.0	13.3		10.0 **	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		6 x 6									
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		42.30	35.24	27.48	23.34	19.02		14.53		9.86	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174		0.116*	
Span in Feet	2	186	163	133	115	97	0.02	68	0.02	41	0.02
	3	124	109	88	77	64	0.05	46	0.04	28	0.04
	4	93	81	66	58	48	0.08	34	0.08	21	0.07
	5	74	65	53	46	39	0.13	27	0.12	17	0.10
	6	62	54	44	38	32	0.19	23	0.17	14	0.15
	7	53	47	38	33	28	0.26	20	0.23	12	0.20
	8	47	41	33	29	24	0.34	17	0.30	10	0.27
	9	41	36	29	26	21	0.42	15	0.39	9.2	0.34
	10	37	33	27	23	19	0.52	14	0.48	8.3	0.42
	11	34	30	24	21	18	0.63	12	0.58	7.5	0.50
	12	31	27	22	19	16	0.75	11	0.69	6.9	0.60
	13	29	25	20	18	15	0.88	11	0.80	6.4	0.70
	14	27	23	19	16	14	1.03	—	—	—	—
			24	21	17	15	0.93	9.8	0.93	5.9	0.81
WEB SHEAR AND PROPERTY VALUES											
V, kips		128	103	77	64	51		38		26	
S _x , In. ³		18.4	16.1	13.1	11.4	9.54		7.42		4.51**	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		5 1/2 x 5 1/2								Nominal Size		5 x 5								
Wall Thickness		3/8	5/16	1/4	Δ	3/16	Δ	1/8	Δ	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ	1/8	Δ	
Weight Per Foot		24.93	21.21	17.32	Inches	13.25	Inches	9.01	Inches	Weight Per Foot		28.43	22.37	19.08	15.62	11.97	Inches	8.16	Inches	
Design Wall Thickness		0.349	0.291	0.233		0.174		0.116*		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116*		
Span in Feet	2	109	95	80	0.02	57	0.02	36	0.02	Span in Feet	2	105	88	77	65	51	0.03	31	0.02	
	3	73	64	53	0.05	38	0.05	24	0.04		3	70	58	51	43	34	20	0.06	20	0.05
	4	55	48	40	0.09	28	0.08	18	0.08		4	53	44	39	32	25	15	0.10	15	0.09
	5	44	38	32	0.14	23	0.13	14	0.12		5	42	35	31	26	20	12	0.16	12	0.14
	6	36	32	27	0.21	19	0.19	12	0.17		6	35	29	26	22	17	10	0.23	10	0.20
	7	31	27	23	0.28	16	0.25	10	0.23		7	30	25	22	19	15	8	0.31	8.8	0.27
	8	27	24	20	0.37	14	0.33	9.0	0.30		8	26	22	19	16	13	7	0.40	7.7	0.35
	9	24	21	18	0.46	13	0.42	8.0	0.38		9	23	19	17	14	11	6	0.51	6.8	0.44
	10	22	19	16	0.57	11	0.52	7.2	0.47		10	21	18	15	13	10	6	0.63	6.1	0.54
	11	20	17	15	0.69	10	0.63	6.5	0.57		11	19	16	14	12	9.3	0.76	—	—	
	12	18	16	13	0.82	—	—	—	—			17	15	13	11	8.4	0.69	5.6	0.66	
	WEB SHEAR AND PROPERTY VALUES																			
V, kips		71	59	47		35		23		V, kips		86	64	54	43	32		21		
S _x , in. ³		10.8	9.43	7.90		6.17		3.91**		S _x , in. ³		10.4	8.67	7.61	6.41	5.03		3.34**		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		4 1/2 x 4 1/2								Nominal Size		4 x 4							
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ	1/8	Δ	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ	1/8	Δ
Weight Per Foot		25.03	19.82	16.96	13.91	10.70	Inches	7.31	Inches	Weight Per Foot		21.63	17.27	14.83	12.21	9.42	Inches	6.46	Inches
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116*		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116	
Span in Feet	2	81	69	61	51	41	0.03	26	0.03	Span in Feet	2	60	52	46	39	31	0.03	20	0.03
	3	54	46	40	34	27	0.06	17	0.06		3	40	35	31	26	21	0.07	13	0.06
	4	41	34	30	26	20	0.11	13	0.10		4	30	26	23	20	16	0.13	10	0.11
	5	32	27	24	21	16	0.17	10	0.16		5	24	21	18	16	13	0.20	8.1	0.18
	6	27	23	20	17	14	0.25	8.6	0.23		6	20	17	15	13	10	0.28	6.7	0.26
	7	23	20	17	15	12	0.34	7.4	0.31		7	17	15	13	11	9.0	0.38	5.8	0.35
	8	20	17	15	13	10	0.45	6.4	0.40		8	15	13	12	9.9	7.8	0.50	5.1	0.46
	9	18	15	13	11	9.0	0.57	5.7	0.51		9	13	12	10	8.8	7.0	0.64	—	—
	10	16	14	12	10	8.1	0.70	—	—			12	10	9.3	8.0	6.3	0.58	4.5	0.58
WEB SHEAR AND PROPERTY VALUES																			
V, kips		77	58	48	39	29		19		V, kips		68	51	43	34	26		17	
S _x , in. ³		8.02	6.78	5.99	5.08	4.01		2.80**		S _x , in. ³		5.95	5.13	4.57	3.90	3.10		2.20	

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		3 1/2 x 3 1/2						Nominal Size		3 x 3					
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		14.72	12.70	10.51	8.15	5.61		Weight Per Foot		12.17	10.58	8.81	6.87	4.75	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	
Span in Feet	1	75	68	58	45	30	0.01	Span in Feet	1	51	47	41	33	24	0.01
	2	37	34	29	23	17	0.04		2	25	23	20	17	12	0.04
	3	25	23	19	16	11	0.08		3	17	16	14	11	8.0	0.09
	4	19	17	15	12	8.4	0.14		4	13	12	10	8.3	6.0	0.17
	5	15	14	12	9.4	6.7	0.22		5	10	9.3	8.1	6.6	4.8	0.26
	6	12	11	9.7	7.8	5.6	0.32		6	8.5	7.8	6.8	5.5	4.0	0.38
	7	11	9.7	8.3	6.7	4.8	0.44		7	7.3	6.7	5.8	4.7	3.4	0.51
	8	9.4	8.5	7.3	5.8	4.2	0.57			6.6	6.0	5.3	4.3	3.1	0.47
		8.5	7.7	6.6	5.3	3.8	0.52								
WEB SHEAR AND PROPERTY VALUES															
V, kips		45	37	30	22	15		V, kips		39	32	26	19	13	
S _x , In. ³		3.70	3.34	2.88	2.31	1.66		S _x , In. ³		2.51	2.30	2.01	1.64	1.19	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



ERW

Nominal Size		2 1/2 x 2 1/2					Nominal Size		2 1/4 x 2 1/4				Nominal Size		2 x 2			
Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches
Weight Per Foot		8.45	7.11	5.59	3.90		Weight Per Foot		6.26	4.96	3.48		Weight Per Foot		5.41	4.32	3.05	
Design Wall Thickness		0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116	
Span in Feet	1	29	26	22	16	0.01	Span in Feet	1	20	17	13	0.01	Span in Feet	1	15	13	9.8	0.02
	2	15	13	11	8.1	0.05		2	10	8.6	6.4	0.06		2	7.5	6.5	4.9	0.06
	3	9.8	8.8	7.3	5.4	0.11		3	6.7	5.7	4.3	0.13		3	5.0	4.3	3.3	0.14
	4	7.3	6.6	5.5	4.0	0.20		4	5.1	4.3	3.2	0.22		4	3.8	3.2	2.5	0.25
	5	5.9	5.3	4.4	3.2	0.31		5	4.0	3.4	2.6	0.35						
								3.7	3.1	2.3	0.32							
WEB SHEAR AND PROPERTY VALUES																		
V, kips		27	21	16	11		V, kips		19	14	9.6		V, kips		17	13	8.5	
S _x , In. ³		1.45	1.30	1.08	0.798		S _x , In. ³		1.00	0.847	0.633		S _x , In. ³		0.745	0.640	0.486	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



ERW

Nominal Size		1 3/4 x 1 3/4		Nominal Size		1 5/8 x 1 5/8			Nominal Size		1 1/2 x 1 1/2			Nominal Size		1 1/4 x 1 1/4		
Wall Thickness		3/16	Δ	Wall Thickness		3/16	1/8	Δ	Wall Thickness		3/16	1/8	Δ	Wall Thickness		3/16	1/8	Δ
Weight Per Foot		3.68	Inches	Weight Per Foot		3.36	2.42	Inches	Weight Per Foot		3.04	2.20	Inches	Weight Per Foot		2.40	1.78	Inches
Design Wall Thickness		0.174		Design Wall Thickness		0.174	0.116		Design Wall Thickness		0.174	0.116		Design Wall Thickness		0.174	0.116	
Span in Feet	1	9.4	0.02	Span in Feet	1	7.8	6.1	0.02	Span in Feet	1	6.4	5.1	0.02	Span in Feet	1	3.9	3.3	0.03
	2	4.7	0.07		2	3.9	3.1	0.08		2	3.2	2.5	0.08		2	2.0	1.6	0.10
Span in Feet	3	3.1	0.16	Span in Feet	3	2.6	2.0	0.17	Span in Feet	3	2.1	1.7	0.19	Span in Feet				
	4	2.3	0.29															
		2.1	0.26															
WEB SHEAR AND PROPERTY VALUES																		
V, kips		11		V, kips		10	6.9		V, kips		9.6	6.4		V, kips		8.0	5.3	
S _x , In. ³		0.462		S _x , In. ³		0.384	0.302		S _x , In. ³		0.314	0.251		S _x , In. ³		0.194	0.162	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



Nominal Size		20 x 12						Nominal Size		20 x 8				
Wall Thickness		1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches
Weight Per Foot		103.30		78.52		65.87		Weight Per Foot		110.36	89.68	68.31	57.36	
Design Wall Thickness		0.465	0.349	0.291 *	Design Wall Thickness		0.581	0.465	0.349	0.291				
Span in Feet	4	744	0.03	558	0.02	466	0.02	4	792	655	509	432	0.03	
	5	682	0.04	480	0.04	388	0.04	5	634	524	407	346	0.04	
	6	568	0.06	400	0.06	324	0.05	6	528	436	340	288	0.06	
	7	487	0.08	343	0.08	277	0.07	7	453	374	291	247	0.08	
	8	426	0.11	300	0.10	243	0.10	8	396	327	255	216	0.11	
	9	379	0.14	267	0.13	216	0.12	9	352	291	226	192	0.14	
	10	341	0.17	240	0.16	194	0.15	10	317	262	204	173	0.17	
	11	310	0.21	218	0.19	177	0.18	11	288	238	185	157	0.21	
	12	284	0.25	200	0.22	162	0.21	12	264	218	170	144	0.25	
	13	262	0.29	185	0.26	149	0.25	13	244	201	157	133	0.29	
	14	244	0.33	171	0.30	139	0.29	14	226	187	146	124	0.33	
	15	227	0.38	160	0.35	129	0.34	15	211	175	136	115	0.38	
	16	213	0.44	150	0.40	121	0.38	16	198	164	127	108	0.44	
	17	201	0.49	141	0.45	114	0.43	17	186	154	120	102	0.49	
	18	189	0.55	133	0.50	108	0.48	18	169	140	109	92	0.45	
	19	179	0.62	126	0.56	102	0.54	19	176	145	113	96	0.55	
	20	171	0.68	120	0.62	97	0.60	20	160	132	103	87	0.50	
	21	162	0.75	114	0.68	92	0.66	21	158	131	102	86	0.68	
	22	155	0.83	109	0.75	88	0.72	22	144	119	93	79	0.62	
	23	148	0.90	104	0.82	84	0.79	23	144	119	93	79	0.83	
	24	142	0.98	100	0.89	81	0.86	24	131	108	84	71	0.75	
	26	131	1.15	—	—	—	—	26	132	109	85	72	0.98	
	28	122	1.34	—	—	—	—	28	120	99	77	66	0.89	
	30	114	1.54	—	—	—	—	30	122	101	78	67	1.15	
32	107	1.75	—	—	—	—	32	111	92	71	60	1.05		
34	100	1.97	—	—	—	—	34	113	94	73	62	1.34		
36	95	2.21	—	—	—	—	36	103	85	66	56	1.22		
38	90	2.46	—	—	—	—	38	106	87	68	58	1.54		
40	85	2.73	—	—	—	—	40	96	79	62	52	1.40		
42	81	3.01	—	—	—	—	42	99	82	64	54	1.75		
								90	74	58	49	1.59		
								93	77	60	51	1.97		
								85	70	54	46	1.79		
								88	73	57	48	2.21		
								80	66	51	44	2.01		
								83	69	54	46	2.46		
								76	63	49	41	2.24		
								79	65	51	43	2.73		
								72	60	46	39	2.48		
								75	62	49	41	3.01		
								69	57	44	37	2.74		

WEB SHEAR AND PROPERTY VALUES

V, kips	372		279		233		V, kips	465	372	279	233	
S _x , In. ³	155		120		97.1 **		S _x , In. ³	144	119	92.6	78.6	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		20 x 4				Nominal Size		18 x 6						
Wall Thickness		1/2	3/8	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	
Weight Per Foot		76.07	58.10	48.86		Weight Per Foot		93.34	76.07	58.10	48.86	39.43		
Design Wall Thickness		0.465	0.349	0.291		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		
Span in Feet	4	461	361	308	0.03	Span in Feet	4	567	471	368	314	256	0.03	
	5	369	289	246	0.04		5	453	377	294	251	205	205	0.05
	6	307	241	205	0.06		6	378	314	245	209	171	171	0.07
	7	263	206	176	0.08		7	324	269	210	179	146	146	0.09
	8	230	181	154	0.11		8	283	235	184	157	128	128	0.12
	9	205	161	137	0.14		9	252	209	164	139	114	114	0.15
		186	146	124	0.13		10	227	188	147	125	102	102	0.19
	10	184	145	123	0.17		11	206	171	134	114	93	93	0.23
		168	131	112	0.16		12	189	157	123	105	85	85	0.27
	11	168	131	112	0.21		13	174	145	113	96	79	79	0.32
		152	119	102	0.19			158	132	103	88	72	72	0.29
	12	154	120	103	0.25		14	162	135	105	90	73	73	0.37
		140	110	93	0.22			147	122	96	81	66	66	0.34
	13	142	111	95	0.29		15	151	126	98	84	68	68	0.43
		129	101	86	0.26			137	114	89	76	62	62	0.39
	14	132	103	88	0.33		16	142	118	92	78	64	64	0.49
		120	94	80	0.30			129	107	84	71	58	58	0.44
	15	123	96	82	0.38		17	133	111	87	74	60	60	0.55
		112	88	75	0.35			121	101	79	67	55	55	0.50
	16	115	90	77	0.44		18	126	105	82	70	57	57	0.61
		105	82	70	0.40			114	95	74	63	52	52	0.56
	18	102	80	68	0.55		20	113	94	74	63	51	51	0.76
		93	73	62	0.50			103	86	67	57	47	47	0.69
	20	92	72	62	0.68		22	103	86	67	57	47	47	0.92
		84	66	56	0.62			94	78	61	52	42	42	0.83
	22	84	66	56	0.83		24	94	78	61	52	43	43	1.09
		76	60	51	0.75			86	71	56	48	39	39	0.99
	24	77	60	51	0.98		26	87	72	57	48	39	39	1.28
70		55	47	0.89	79	66		51	44	36	36	1.17		
26	71	56	47	1.15	28	81	67	53	45	37	37	1.49		
	64	51	43	1.05		74	61	48	41	33	33	1.35		
28	66	52	44	1.34	30	76	63	49	42	34	34	1.71		
	60	47	40	1.22		69	57	45	38	31	31	1.55		
30	61	48	41	1.54	32	71	59	46	39	32	32	1.94		
	56	44	37	1.40		64	54	42	36	29	29	1.77		
34	54	43	36	1.97	34	67	55	43	37	30	30	2.19		
	49	39	33	1.79		61	50	39	34	27	27	1.99		
38	49	38	32	2.46	36	63	52	41	35	28	28	2.46		
	44	35	29	2.24		57	48	37	32	26	26	2.23		
42	44	34	29	3.01	38	60	50	39	33	27	27	2.74		
	40	31	27	2.74		54	45	35	30	24	24	2.49		

WEB SHEAR AND PROPERTY VALUES											
V, kips	372	279	233		V, kips	418	335	251	210	168	
S _x , In. ³	83.8	65.7	56.0		S _x , In. ³	103	85.6	66.9	57.0	46.5	

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



Nominal Size		16 x 12						Nominal Size		16 x 8				
Wall Thickness		1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches
Weight Per Foot		89.68		68.31		57.36		Weight Per Foot		93.34	76.07	58.10	48.86	
Design Wall Thickness		0.465	0.349	0.291*	Design Wall Thickness		0.581	0.465	0.349	0.291				
Span in Feet	4	595	0.03	439	0.03	356	0.03	Span in Feet	4	561	467	365	310	0.03
	5	497	0.05	351	0.05	284	0.05		5	449	374	292	248	0.05
	6	414	0.08	292	0.07	237	0.07		6	374	311	243	207	0.08
	7	355	0.10	251	0.10	203	0.09		7	321	267	208	177	0.10
	8	311	0.14	219	0.12	178	0.12		8	281	233	182	155	0.14
	9	276	0.17	195	0.16	158	0.15		9	249	208	162	138	0.17
	10	249	0.21	175	0.19	142	0.19		10	224	187	146	124	0.21
	11	226	0.26	159	0.23	129	0.22		11	204	170	133	113	0.26
	12	207	0.31	146	0.28	119	0.27		12	187	156	122	103	0.31
	13	191	0.36	135	0.33	109	0.31		13	173	144	112	95	0.36
	14	178	0.42	125	0.38	102	0.36		14	160	133	104	89	0.42
	15	166	0.48	117	0.44	95	0.42		15	150	125	97	83	0.48
	16	155	0.55	110	0.50	89	0.47		16	140	117	91	78	0.55
	17	146	0.62	103	0.56	84	0.54		17	132	110	86	73	0.62
	18	138	0.69	97	0.63	79	0.60			120	100	78	66	0.56
	19	131	0.77	92	0.70	75	0.67		18	125	104	81	69	0.69
	20	124	0.85	88	0.78	71	0.74			113	94	74	63	0.63
	21	118	0.94	84	0.86	68	0.82		19	118	98	77	65	0.77
	22	113	1.03	80	0.94	65	0.90			107	89	70	59	0.70
	23	108	1.13	76	1.03	62	0.98		20	112	93	73	62	0.85
	24	104	1.23	73	1.12	59	1.07			102	85	66	56	0.78
	25	99	1.33	—	—	—	—		21	107	89	69	59	0.94
		90	1.21	70	1.21	57	1.16			97	81	63	54	0.86
	26	96	1.44	—	—	—	—		22	102	85	66	56	1.03
		87	1.31	67	1.31	55	1.25			93	77	60	51	0.94
	27	92	1.56	—	—	—	—		23	98	81	63	54	1.13
		84	1.41	65	1.41	53	1.35			89	74	58	49	1.03
	28	89	1.67	—	—	—	—		24	94	78	61	52	1.23
		81	1.52	63	1.52	51	1.45			85	71	55	47	1.12
	30	83	1.92	—	—	—	—		26	86	72	56	48	1.44
		75	1.75	58	1.75	47	1.67			78	65	51	43	1.31
	32	78	2.18	—	—	—	—		28	80	67	52	44	1.67
		71	1.99	55	1.99	44	1.90			73	61	47	40	1.52
	34	73	2.47	—	—	—	—		30	75	62	49	41	1.92
66		2.24	52	2.24	42	2.14	68	57		44	38	1.75		
32	70	—	—	—	—	—	32	70	58	46	39	2.18		
	64	—	—	—	—	—		64	53	41	35	1.99		
34	66	—	—	—	—	—	34	66	55	43	36	2.47		
	60	—	—	—	—	—		60	50	39	33	2.24		

WEB SHEAR AND PROPERTY VALUES

V, kips	298		223		186		V, kips	372	298	223	186
S _x , In. ³	113		87.7		71.1**		S _x , In. ³	102	84.9	66.3	56.4

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		16 x 4				Nominal Size		14 x 10							
Wall Thickness		1/2	3/8	5/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches
Weight Per Foot		62.46	47.90	40.35		Weight Per Foot		93.34	76.07	58.10		48.86		39.43	
Design Wall Thickness		0.465	0.349	0.291	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233*				
Span in Feet	4	313	248	212	0.03	Span in Feet	4	540	450	351	0.04	272	0.04	209	0.03
	5	250	198	169	0.05		5	432	360	281	0.06	217	0.06	167	0.05
	6	209	165	141	0.08		6	360	300	234	0.09	181	0.08	139	0.08
	7	179	141	121	0.10		7	309	257	201	0.12	155	0.11	119	0.10
	8	156	124	106	0.14		8	270	225	176	0.16	136	0.14	105	0.13
	9	139	110	94	0.17		9	240	200	156	0.20	121	0.18	93	0.17
		126	100	86	0.16		10	216	180	141	0.24	109	0.22	84	0.21
	10	125	99	85	0.21		11	196	164	128	0.30	99	0.27	76	0.25
		114	90	77	0.19		12	180	150	117	0.35	91	0.32	70	0.30
	11	114	90	77	0.26		13	166	138	108	0.41	84	0.37	64	0.35
		103	82	70	0.23		14	154	129	100	0.48	78	0.43	60	0.41
	12	104	83	71	0.31		15	144	120	94	0.55	72	0.50	56	0.47
		95	75	64	0.28		16	135	112	88	0.62	68	0.57	52	0.54
	13	96	76	65	0.36		17	127	106	83	0.70	64	0.64	49	0.60
		88	69	59	0.33		18	120	100	78	0.79	60	0.72	46	0.68
	14	89	71	61	0.42		19	114	95	74	0.88	57	0.80	44	0.76
		81	64	55	0.38		20	108	90	70	0.98	54	0.89	42	0.84
	15	83	66	56	0.48		21	103	86	67	1.08	—	—	—	—
		76	60	51	0.44			94	78	61	0.98	52	0.98	40	0.92
	16	78	62	53	0.55		22	98	82	64	1.18	—	—	—	—
		71	56	48	0.50			89	74	58	1.07	49	1.07	38	1.01
	17	74	58	50	0.62		23	94	78	61	1.29	—	—	—	—
		67	53	45	0.56			85	71	56	1.17	47	1.17	36	1.11
	18	70	55	47	0.69		24	90	75	59	1.40	—	—	—	—
		63	50	43	0.63			82	68	53	1.28	45	1.28	35	1.21
	19	66	52	45	0.77		25	86	72	56	1.52	—	—	—	—
		60	47	41	0.70			79	65	51	1.39	43	1.39	33	1.31
	20	63	50	42	0.85		26	83	69	54	1.65	—	—	—	—
		57	45	39	0.78			76	63	49	1.50	42	1.50	32	1.41
	22	57	45	39	1.03		27	80	67	52	1.78	—	—	—	—
		52	41	35	0.94			73	61	47	1.62	40	1.62	31	1.53
	24	52	41	35	1.23		28	77	64	50	1.91	—	—	—	—
		47	38	32	1.12			70	58	46	1.74	39	1.74	30	1.64
	26	48	38	33	1.44		29	74	62	48	2.05	—	—	—	—
44		35	30	1.31	68	56		44	1.86	37	1.86	29	1.76		
30	42	33	28	1.92	30	72	60	47	2.19	—	—	—	—		
	38	30	26	1.75		65	55	43	2.00	36	2.00	28	1.88		
34	37	29	25	2.47											
	33	26	23	2.24											

WEB SHEAR AND PROPERTY VALUES													
V, kips	298	223	186		V, kips	325	260	195		163		130	
S _x , In. ³	56.9	45.0	38.5		S _x , In. ³	98.2	81.8	63.9		54.3		41.8**	

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50




Nominal Size		14 x 6								Nominal Size		14 x 4							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	
Weight Per Foot		76.33	62.46	47.90	40.35	32.63		24.73		Weight Per Foot		67.82	55.66	42.79	36.10	29.23	22.18		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174			
Span in Feet	4	375	316	249	213	174	0.04	122	0.04	Span in Feet	4	293	249	198	170	140	107	0.04	
	5	300	253	199	170	139	0.06	97	0.06		5	235	199	158	136	112	86	0.06	
	6	250	210	166	142	116	0.09	81	0.08		6	195	166	132	113	93	72	0.09	
	7	214	180	142	122	100	0.12	69	0.11		7	168	142	113	97	80	61	0.12	
	8	188	158	125	106	87	0.16	61	0.14		8	147	125	99	85	70	54	0.16	
	9	167	140	111	95	77	0.20	54	0.18		9	130	111	88	76	62	48	0.20	
	10	150	126	100	85	70	0.24	49	0.22			118	101	80	69	56	43	0.18	
	11	136	115	91	77	63	0.30	44	0.27		10	117	100	79	68	56	43	0.24	
	12	125	105	83	71	58	0.35	41	0.32			107	91	72	62	51	39	0.22	
	13	115	97	77	65	54	0.41	—	—		11	107	91	72	62	51	39	0.30	
		105	88	70	60	49	0.37	37	0.37			97	82	65	56	46	35	0.27	
	14	107	90	71	61	50	0.48	—	—		12	98	83	66	57	47	36	0.35	
		97	82	65	55	45	0.43	35	0.43			89	76	60	52	42	33	0.32	
	15	100	84	66	57	46	0.55	—	—		13	90	77	61	52	43	33	0.41	
		91	77	60	52	42	0.50	32	0.50			82	70	55	48	39	30	0.37	
	16	94	79	62	53	44	0.62	—	—		14	84	71	57	49	40	31	0.48	
		85	72	57	48	40	0.57	30	0.57			76	65	51	44	36	28	0.43	
	17	88	74	59	50	41	0.70	—	—		15	78	66	53	45	37	29	0.55	
		80	68	53	46	37	0.64	29	0.64			71	60	48	41	34	26	0.50	
	18	83	70	55	47	39	0.79	—	—		16	73	62	50	42	35	27	0.62	
		76	64	50	43	35	0.72	27	0.72			67	57	45	39	32	24	0.57	
	19	79	66	52	45	37	0.88	—	—		17	69	59	47	40	33	25	0.70	
		72	60	48	41	33	0.80	26	0.80			63	53	42	36	30	23	0.64	
	20	75	63	50	43	35	0.98	—	—		18	65	55	44	38	31	24	0.79	
		68	57	45	39	32	0.89	24	0.89			59	50	40	34	28	22	0.72	
	22	68	57	45	39	32	1.18	—	—		19	62	52	42	36	29	23	0.88	
		62	52	41	35	29	1.07	22	1.07			56	48	38	33	27	21	0.80	
	24	63	53	42	35	29	1.40	—	—		20	59	50	40	34	28	21	0.98	
		57	48	38	32	26	1.28	20	1.28			53	45	36	31	25	20	0.89	
	26	58	49	38	33	27	1.65	—	—		22	53	45	36	31	25	20	1.18	
52		44	35	30	24	1.50	19	1.50	48	41		33	28	23	18	1.07			
28	54	45	36	30	25	1.91	—	—	24	49	42	33	28	23	18	1.40			
	49	41	32	28	23	1.74	17	1.74		44	38	30	26	21	16	1.28			
30	50	42	33	28	23	2.19	—	—	26	45	38	30	26	21	17	1.65			
	45	38	30	26	21	2.00	16	2.00		41	35	28	24	20	15	1.50			
28	42	36	28	24	20	1.91	—	—	28	42	36	28	24	20	15	1.91			
	38	32	26	22	18	1.74	—	—		38	32	26	22	18	14	1.74			
30	39	33	26	23	19	2.19	—	—	30	39	33	26	23	19	14	2.19			
	36	30	24	21	17	2.00	—	—		36	30	24	21	17	13	2.00			

WEB SHEAR AND PROPERTY VALUES

V, kips	325	260	195	163	130		97		V, kips	325	260	195	163	130	97	
S _x , In. ³	68.2	57.4	45.3	38.7	31.7		24.3		S _x , In. ³	53.3	45.3	36.0	30.9	25.4	19.5	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



ERW

Nominal Size		12 X 10						
Wall Thickness		1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches
Weight Per Foot		69.27	53.00		44.60		36.03	
Design Wall Thickness		0.465	0.349		0.291		0.233*	
Span in Feet	4	362	284	0.05	220	0.04	169	0.04
	5	290	227	0.07	176	0.06	135	0.06
	6	242	189	0.10	147	0.09	113	0.09
	7	207	162	0.14	126	0.13	97	0.12
	8	181	142	0.18	110	0.17	85	0.16
	9	161	126	0.23	98	0.21	75	0.20
	10	145	114	0.28	88	0.26	68	0.24
	11	132	103	0.34	80	0.31	61	0.29
	12	121	95	0.41	73	0.37	56	0.35
	13	112	87	0.48	68	0.44	52	0.41
	14	104	81	0.56	63	0.51	48	0.48
	15	97	76	0.64	59	0.58	45	0.55
	16	91	71	0.73	55	0.66	42	0.62
	17	85	67	0.82	52	0.75	40	0.70
	18	81	63	0.92	49	0.84	38	0.79
	19	76	60	1.03	46	0.93	36	0.88
	20	72	57	1.14	44	1.03	34	0.97
	21	69	54	1.25	—	—	—	—
		63	49	1.14	42	1.14	32	1.07
	22	66	52	1.38	—	—	—	—
		60	47	1.25	40	1.25	31	1.18
	23	63	49	1.50	—	—	—	—
		57	45	1.37	38	1.37	29	1.28
	24	60	47	1.64	—	—	—	—
		55	43	1.49	37	1.49	28	1.40
25	58	45	1.78	—	—	—	—	
	53	41	1.62	35	1.62	27	1.52	
WEB SHEAR AND PROPERTY VALUES								
V, kips		223	168		140		112	
S_x, In.³		65.9	51.6		44.0		33.8**	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		12 x 8								
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		76.33	62.46	47.90	40.35		32.63		24.73	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174*			
Span in Feet	4	364	305	240	206	0.05	153	0.04	108	0.04
	5	291	244	192	165	0.07	122	0.06	86	0.06
	6	242	204	160	137	0.10	102	0.09	72	0.09
	7	208	174	137	118	0.14	87	0.13	61	0.12
	8	182	153	120	103	0.18	77	0.17	54	0.15
	9	162	136	107	91	0.23	68	0.21	48	0.19
	10	145	122	96	82	0.28	61	0.26	43	0.24
	11	132	111	87	75	0.34	56	0.31	39	0.29
	12	121	102	80	69	0.41	51	0.37	36	0.34
	13	112	94	74	63	0.48	47	0.44	33	0.40
	14	104	87	69	59	0.56	44	0.51	31	0.47
	15	97	81	64	55	0.64	41	0.58	29	0.54
	16	91	76	60	51	0.73	38	0.66	27	0.61
	17	86	72	57	48	0.82	—	—	—	—
		78	65	51	44	0.75	36	0.75	25	0.69
	18	81	68	53	46	0.92	—	—	—	—
		73	62	49	42	0.84	34	0.84	24	0.77
	19	77	64	51	43	1.03	—	—	—	—
		70	58	46	39	0.93	32	0.93	23	0.86
	20	73	61	48	41	1.14	—	—	—	—
		66	56	44	37	1.03	31	1.03	22	0.95
	21	69	58	46	39	1.25	—	—	—	—
		63	53	42	36	1.14	29	1.14	20	1.05
	22	66	56	44	37	1.38	—	—	—	—
		60	50	40	34	1.25	28	1.25	20	1.15
23	63	53	42	36	1.50	—	—	—	—	
	57	48	38	33	1.37	27	1.37	19	1.26	
24	61	51	40	34	1.64	—	—	—	—	
	55	46	36	31	1.49	26	1.49	18	1.37	
25	58	49	38	33	1.78	—	—	—	—	
	53	44	35	30	1.62	24	1.62	17	1.49	
WEB SHEAR AND PROPERTY VALUES										
V, kips		279	223	168	140		112		84	
S _x , In. ³		66.1	55.5	43.7	37.4		30.6		21.5**	

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50




Nominal Size		12 x 6								Nominal Size		12 x 4							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	
Weight Per Foot		67.82	55.66	42.79	36.10	29.23				22.18	Weight Per Foot		59.32	48.85	37.69	31.84	25.82		19.63
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174				
Span in Feet	4	294	249	197	169	139	0.05	97	0.04	Span in Feet	4	224	192	154	132	109	84	0.05	
	5	235	199	158	135	111	0.07	78	0.06		5	180	154	123	106	88	67	0.07	
	6	196	166	131	113	92	0.10	65	0.09		6	150	128	103	88	73	56	0.10	
	7	168	142	113	96	79	0.14	55	0.13		7	128	110	88	75	63	48	0.14	
	8	147	124	98	84	69	0.18	49	0.17		8	112	96	77	66	55	42	0.18	
	9	131	110	88	75	62	0.23	43	0.21		9	100	85	68	59	49	37	0.23	
	10	117	99	79	68	55	0.28	39	0.26			91	78	62	53	44	34	0.21	
	11	107	90	72	61	50	0.34	35	0.31		10	90	77	62	53	44	34	0.28	
	12	98	83	66	56	46	0.41	32	0.37			82	70	56	48	40	31	0.26	
	13	90	76	61	52	43	0.48	—	—		11	82	70	56	48	40	31	0.34	
		82	70	55	47	39	0.44	30	0.44			74	63	51	44	36	28	0.31	
	14	84	71	56	48	40	0.56	—	—		12	75	64	51	44	36	28	0.41	
		76	65	51	44	36	0.51	28	0.51			68	58	47	40	33	26	0.37	
	15	78	66	53	45	37	0.64	—	—		13	69	59	47	41	34	26	0.48	
		71	60	48	41	34	0.58	26	0.58			63	54	43	37	31	24	0.44	
	16	73	62	49	42	35	0.73	—	—		14	64	55	44	38	31	24	0.56	
		67	57	45	38	32	0.66	24	0.66			58	50	40	34	28	22	0.51	
	17	69	58	46	40	33	0.82	—	—		15	60	51	41	35	29	22	0.64	
		63	53	42	36	30	0.75	23	0.75			54	47	37	32	27	20	0.58	
	18	65	55	44	38	31	0.92	—	—		16	56	48	39	33	27	21	0.73	
		59	50	40	34	28	0.84	22	0.84			51	44	35	30	25	19	0.66	
	19	62	52	41	36	29	1.03	—	—		17	53	45	36	31	26	20	0.82	
		56	48	38	32	27	0.93	20	0.93			48	41	33	28	23	18	0.75	
	20	59	50	39	34	28	1.14	—	—		18	50	43	34	29	24	19	0.92	
		53	45	36	31	25	1.03	19	1.03			45	39	31	27	22	17	0.84	
21	56	47	38	32	26	1.25	—	—	19	47	40	32	28	23	18	1.03			
	51	43	34	29	24	1.14	18	1.14		43	37	29	25	21	16	0.93			
22	53	45	36	31	25	1.38	—	—	20	45	38	31	26	22	17	1.14			
	49	41	33	28	23	1.25	18	1.25		41	35	28	24	20	15	1.03			
23	51	43	34	29	24	1.50	—	—	21	43	37	29	25	21	16	1.25			
	46	39	31	27	22	1.37	17	1.37		39	33	27	23	19	15	1.14			
24	49	41	33	28	23	1.64	—	—	22	41	35	28	24	20	15	1.38			
	45	38	30	26	21	1.49	16	1.49		37	32	25	22	18	14	1.25			
25	47	40	32	27	22	1.78	—	—	23	39	33	27	23	19	15	1.50			
	43	36	29	25	20	1.62	16	1.62		35	30	24	21	17	13	1.37			
										24	37	32	26	22	18	14	1.64		
										34	29	23	20	17	13	1.49			
										25	36	31	25	21	18	13	1.78		
										33	28	22	19	16	12	1.62			

WEB SHEAR AND PROPERTY VALUES

V, kips	279	223	168	140	112		84		V, kips	279	223	168	140	112	84	
S _x , In. ³	53.4	45.2	35.8	30.7	25.2		19.4		S _x , In. ³	40.8	34.9	28.0	24.0	19.9	15.3	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		12 x 3 1/2			Nominal Size		12 x 3				Nominal Size		12 x 2		
Wall Thickness		3/8	5/16	Δ Inches	Wall Thickness		5/16	1/4	3/16	Δ Inches	Wall Thickness		1/4	3/16	Δ Inches
Weight Per Foot		36.41	30.78		Weight Per Foot		29.72	24.12	18.35		Weight Per Foot		22.42	17.08	
Design Wall Thickness		0.349	0.291	Design Wall Thickness		0.291	0.233	0.174	Design Wall Thickness		0.233	0.174			
Span in Feet	4	143	123	0.05	Span in Feet	4	114	95	73	0.05	Span in Feet	4	80	62	0.05
	5	114	99	0.07		5	91	76	59	0.07		5	64	49	0.07
	6	95	82	0.10		6	76	63	49	0.10		6	58	45	0.06
	7	82	70	0.14		7	65	54	42	0.14		7	53	41	0.10
	8	72	62	0.18		8	57	47	37	0.18		8	46	35	0.14
		65	56	0.17			52	43	33	0.17			41	32	0.13
	9	64	55	0.23		9	51	42	33	0.23		9	40	31	0.18
		58	50	0.21			46	38	30	0.21			36	28	0.17
	10	57	49	0.28		10	46	38	29	0.28		10	35	27	0.23
		52	45	0.26			41	34	27	0.26			32	25	0.21
	11	52	45	0.34		11	41	34	27	0.34		11	32	25	0.28
		47	41	0.31			38	31	24	0.31			29	22	0.26
	12	48	41	0.41		12	38	32	24	0.41		12	29	22	0.34
		43	37	0.37			35	29	22	0.37			26	20	0.31
	13	44	38	0.48		13	35	29	23	0.48		13	27	21	0.41
		40	34	0.44			32	26	20	0.44			24	19	0.37
	14	41	35	0.56		14	33	27	21	0.56		14	25	19	0.48
		37	32	0.51			30	25	19	0.51			22	17	0.44
	15	38	33	0.64		15	30	25	20	0.64		15	23	18	0.56
		35	30	0.58			28	23	18	0.58			21	16	0.51
	16	36	31	0.73		16	28	24	18	0.73		16	21	16	0.64
		33	28	0.66			26	22	17	0.66			19	15	0.58
	17	34	29	0.82		17	27	22	17	0.82		17	20	15	0.73
		31	26	0.75			24	20	16	0.75			18	14	0.66
	18	32	27	0.92		18	25	21	16	0.92		18	19	14	0.82
29		25	0.84	23	19		15	0.84	17	13	0.75				
19	30	26	1.03	19	24	20	15	1.03	19	18	14	0.92			
	27	24	0.93		22	18	14	0.93		16	12	0.84			
20	29	25	1.14	20	23	19	15	1.14	20	17	13	1.03			
	26	22	1.03		21	17	13	1.03		15	12	0.93			
21	27	23	1.25	21	22	18	14	1.25	21	16	12	1.14			
	25	21	1.14		20	16	13	1.14		15	11	1.03			
22	26	22	1.38	22	21	17	13	1.38	22	15	12	1.25			
	24	20	1.25		19	16	12	1.25		14	11	1.14			
23	25	21	1.50	23	20	16	13	1.50	23	15	11	1.38			
	23	19	1.37		18	15	12	1.37		13	10	1.25			
24	24	21	1.64	24	19	16	12	1.64	24	14	11	1.50			
	22	19	1.49		17	14	11	1.49		13	9.7	1.37			
25	23	20	1.78	25	18	15	12	1.78	25	13	9.9	1.78			
	21	18	1.62		17	14	11	1.62		12	9.0	1.62			

WEB SHEAR AND PROPERTY VALUES													
V, kips	168	140		V, kips	140	112	84		V, kips	112	84		
S _x , In. ³	26.0	22.4		S _x , In. ³	20.7	17.2	13.3		S _x , In. ³	14.5	11.2		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		10 x 8								Nominal Size		10 x 6							
Wall Thickness		1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/8	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		55.66	42.79	36.10		29.23		22.18		Weight Per Foot		59.32	48.85	37.69	31.84	25.82		19.63	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174*	Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174					
Span in Feet	2	372	279	233	0.01	186	0.01	139	0.01	Span in Feet	2	442	372	279	233	186	0.01	139	0.01
	3	313	249	213	0.03	159	0.03	111	0.03		3	295	252	200	172	142	0.03	99	0.03
	4	235	186	160	0.05	119	0.05	84	0.05		4	221	189	150	129	107	0.05	75	0.05
	5	188	149	128	0.09	95	0.08	67	0.07		5	177	151	120	103	85	0.09	60	0.08
	6	157	124	106	0.12	79	0.11	56	0.10		6	147	126	100	86	71	0.12	50	0.11
	7	134	107	91	0.17	68	0.15	48	0.14		7	126	108	86	74	61	0.17	43	0.15
	8	117	93	80	0.22	60	0.20	42	0.18		8	111	94	75	65	53	0.22	37	0.20
	9	104	83	71	0.28	53	0.25	37	0.23		9	98	84	67	57	47	0.28	33	0.25
	10	94	75	64	0.34	48	0.31	33	0.28		10	88	75	60	52	43	0.34	30	0.31
	11	85	68	58	0.41	43	0.38	30	0.34		11	80	69	55	47	39	0.41	27	0.38
	12	78	62	53	0.49	40	0.45	28	0.41		12	74	63	50	43	36	0.49	25	0.45
	13	72	57	49	0.58	37	0.52	26	0.48		13	68	58	46	40	33	0.58	—	—
	14	67	53	46	0.67	34	0.61	24	0.56		14	62	53	42	36	30	0.52	23	0.52
	15	63	50	43	0.77	32	0.70	22	0.64		15	63	54	43	37	30	0.67	—	—
	16	59	47	40	0.87	30	0.79	21	0.73		16	57	49	39	34	28	0.61	21	0.61
	17	55	44	38	0.99	—	—	—	—		17	59	50	40	34	28	0.77	—	—
	18	52	41	35	1.11	—	—	—	—		18	55	47	38	32	27	0.87	—	—
	19	49	39	34	1.23	—	—	—	—		19	52	44	35	30	25	0.99	—	—
	20	47	37	32	1.37	—	—	—	—		20	49	42	33	29	24	1.11	—	—
	21	45	36	30	1.51	—	—	—	—		21	47	40	32	27	22	1.23	—	—
		41	32	28	1.37	23	1.37	16	1.25			42	36	29	25	20	1.12	16	1.12
										44	38	30	26	21	1.37	—	—		
										40	34	27	24	19	1.24	15	1.24		
										42	36	29	25	20	1.51	—	—		
										38	33	26	22	18	1.37	14	1.37		

WEB SHEAR AND PROPERTY VALUES

V, kips	186	140	116	93	70	V, kips	232	186	140	116	93	70
S _x , in. ³	42.7	33.9	29.0	23.8	16.7**	S _x , in. ³	40.2	34.3	27.3	23.5	19.4	14.9

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$



ERW

Nominal Size		10 x 5					Nominal Size		10 x 4						
Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches	Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		35.13	29.72	24.12	18.35		Weight Per Foot		50.81	42.05	32.58	27.59	22.42	17.08	
Design Wall Thickness		0.349	0.291	0.233	0.174		Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	265	229	186	139	0.01	Span in Feet	2	329	284	229	198	164	128	0.01
	3	177	153	126	97	0.03		3	219	189	153	132	109	85	0.03
	4	133	114	95	73	0.05		4	164	142	114	99	82	64	0.05
	5	106	92	76	58	0.09		5	132	114	92	79	66	51	0.09
	6	88	76	63	48	0.12		6	110	95	76	66	55	43	0.12
	7	76	65	54	41	0.17		7	94	81	65	57	47	36	0.17
	8	66	57	47	36	0.22		8	82	71	57	50	41	32	0.22
	9	59	51	42	32	0.28		9	73	63	51	44	36	28	0.28
	10	53	46	38	29	0.34			66	57	46	40	33	26	0.25
	11	48	42	34	26	0.41		10	66	57	46	40	33	26	0.34
		44	38	31	24	0.38			60	52	42	36	30	23	0.31
	12	44	38	32	24	0.49		11	60	52	42	36	30	23	0.41
		40	35	29	22	0.45			54	47	38	33	27	21	0.38
	13	41	35	29	22	0.58		12	55	47	38	33	27	21	0.49
		37	32	26	20	0.52			50	43	35	30	25	19	0.45
	14	38	33	27	21	0.67		13	51	44	35	30	25	20	0.58
		34	30	25	19	0.61			46	40	32	28	23	18	0.52
	15	35	31	25	19	0.77		14	47	41	33	28	23	18	0.67
		32	28	23	18	0.70			43	37	30	26	21	17	0.61
	16	33	29	24	18	0.87		15	44	38	31	26	22	17	0.77
		30	26	22	17	0.79			40	34	28	24	20	15	0.70
17	31	27	22	17	0.99	16	41	35	29	25	20	16	0.87		
	28	24	20	16	0.90		37	32	26	23	19	15	0.79		
18	29	25	21	16	1.11	17	39	33	27	23	19	15	0.99		
	27	23	19	15	1.01		35	30	24	21	18	14	0.90		
19	28	24	20	15	1.23	18	37	32	25	22	18	14	1.11		
	25	22	18	14	1.12		33	29	23	20	17	13	1.01		
20	27	23	19	15	1.37	19	35	30	24	21	17	13	1.23		
	24	21	17	13	1.24		31	27	22	19	16	12	1.12		
21	25	22	18	14	1.51	20	33	28	23	20	16	13	1.37		
	23	20	16	13	1.37		30	26	21	18	15	12	1.24		
							21	31	27	22	19	16	12	1.51	
								28	25	20	17	14	11	1.37	

WEB SHEAR AND PROPERTY VALUES

V, kips	140	116	93	70		V, kips	232	186	140	116	93	70	
S _x , In. ³	24.1	20.8	17.2	13.2		S _x , In. ³	29.9	25.8	20.8	18.0	14.9	11.6	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		10 x 3 1/2		Nominal Size		10 x 3						Nominal Size		10 x 2				
Wall Thickness		3/16	Δ	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ	Wall Thickness		3/8	5/16	1/4	3/16	Δ
Weight Per Foot		16.44	Inches <th colspan="2">Weight Per Foot</th> <td>30.03</td> <td>25.46</td> <td>20.72</td> <td>15.80</td> <td>10.71</td> <td>Inches <th colspan="2">Weight Per Foot</th> <td>27.48</td> <td>23.34</td> <td>19.02</td> <td>14.53</td> <td>Δ</td> </td>	Weight Per Foot		30.03	25.46	20.72	15.80	10.71	Inches <th colspan="2">Weight Per Foot</th> <td>27.48</td> <td>23.34</td> <td>19.02</td> <td>14.53</td> <td>Δ</td>	Weight Per Foot		27.48	23.34	19.02	14.53	Δ
Design Wall Thickness		0.174		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	
Span in Feet	2	118	0.01	Span in Feet	2	194	168	140	109	75	0.01	Span in Feet	2	157	138	116	90	0.01
	3	78	0.03		3	129	112	93	72	50	0.03		3	105	92	77	60	0.03
	4	59	0.05		4	97	84	70	54	38	0.05		4	79	69	58	45	0.05
	5	47	0.09		5	77	67	56	43	30	0.09		5	63	55	46	36	0.09
	6	39	0.12		6	65	56	47	36	25	0.12		6	57	50	42	33	0.08
	7	34	0.17		7	55	48	40	31	21	0.17		7	52	46	39	30	0.12
	8	29	0.22		8	50	44	36	28	20	0.15		8	48	42	35	27	0.11
	9	26	0.28		9	48	42	35	27	19	0.22		9	45	39	33	26	0.17
	10	24	0.34		10	44	38	32	25	17	0.20		10	41	36	30	23	0.15
	11	21	0.41		11	43	37	31	24	17	0.28		11	39	34	29	23	0.22
	12	20	0.49		12	39	34	28	22	15	0.25		12	36	31	26	20	0.20
	13	18	0.58		13	35	31	25	20	14	0.31		13	35	31	26	20	0.28
	14	17	0.67		14	32	28	23	18	12	0.38		14	32	28	23	18	0.25
	15	16	0.77		15	32	28	23	18	13	0.49		15	31	28	23	18	0.34
	16	15	0.87		16	30	26	21	17	12	0.58		16	29	25	21	16	0.31
	17	14	0.99		17	29	26	21	16	11	0.45		17	29	25	21	16	0.41
	18	13	1.11		18	28	24	20	16	11	0.52		18	26	23	19	15	0.38
	19	12	1.23		19	27	24	20	15	11	0.61		19	26	23	19	15	0.49
	20	12	1.37		20	25	22	18	14	9.8	0.61		20	24	21	18	14	0.45
	21	11	1.51		21	26	22	19	14	10	0.77		21	24	21	18	14	0.58
						22	24	20	16	11	0.67		22	22	20	17	13	0.67
				23	23	19	14	10	0.70	23	20	18	15	12	0.61			
				24	21	17	14	9.4	0.87	24	21	18	15	12	0.77			
				25	22	19	14	9.1	0.70	25	19	17	14	11	0.70			
				26	22	19	14	8.5	0.79	26	20	17	14	11	0.87			
				27	23	20	16	8.8	0.99	27	19	17	14	11	0.79			
				28	21	18	15	8.0	0.90	28	20	17	14	11	0.87			
				29	22	19	16	8.3	1.11	29	18	16	13	10	0.79			
				30	20	17	14	7.6	1.01	30	19	16	14	11	0.99			
				31	20	18	15	7.9	1.23	31	17	15	12	9.6	0.90			
				32	19	16	13	7.2	1.12	32	17	15	13	10	1.11			
				33	19	17	14	7.5	1.37	33	16	14	12	9.1	1.01			
				34	18	15	13	6.8	1.24	34	17	14	12	9.5	1.23			
				35	18	16	13	6.5	1.51	35	15	13	11	8.6	1.12			
				36	17	15	12	5.4	1.37	36	16	14	12	9.0	1.37			
				37	17	15	12	4.4	1.24	37	14	13	11	8.2	1.24			
				38	17	15	12	3.4	1.51	38	15	13	11	8.6	1.51			
				39	17	15	12	2.4	1.37	39	14	12	10	7.8	1.37			
				40	17	15	12	1.4	1.24	40	14	12	10	7.8	1.37			

WEB SHEAR AND PROPERTY VALUES																
V, kips	70		V, kips	140	116	93	70	46		V, kips	140	116	93	70		
S _x , In. ³	10.7		S _x , In. ³	17.6	15.3	12.7	9.87	6.83		S _x , In. ³	14.3	12.5	10.5	8.19		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



ERW


Nominal Size		9 x 7								
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		59.32	48.85	37.69	31.84		25.82		19.63	
Design Wall Thickness		0.581	0.465	0.349	0.291		0.233		0.174*	
Span in Feet	2	418	335	251	210	0.02	168	0.01	125	0.01
	3	284	242	194	166	0.03	125	0.03	93	0.03
	4	213	182	145	124	0.06	94	0.06	70	0.05
	5	170	145	116	99	0.09	75	0.09	56	0.08
	6	142	121	97	83	0.14	62	0.12	46	0.12
	7	122	104	83	71	0.19	53	0.17	40	0.16
	8	106	91	73	62	0.24	47	0.22	35	0.21
	9	95	81	65	55	0.31	42	0.28	31	0.27
	10	85	73	58	50	0.38	37	0.34	28	0.33
	11	77	66	53	45	0.46	34	0.42	25	0.40
	12	71	61	48	41	0.55	31	0.50	23	0.48
	13	65	56	45	38	0.64	29	0.58	21	0.56
	14	61	52	41	36	0.74	27	0.68	20	0.65
	15	57	48	39	33	0.85	—	—	—	—
		52	44	35	30	0.78	25	0.78	19	0.75
	16	53	45	36	31	0.97	—	—	—	—
		48	41	33	28	0.88	23	0.88	17	0.85
	17	50	43	34	29	1.10	—	—	—	—
		46	39	31	27	1.00	22	1.00	16	0.96
	18	47	40	32	28	1.23	—	—	—	—
43		37	29	25	1.12	21	1.12	15	1.08	
19	45	38	31	26	1.37	—	—	—	—	
	41	35	28	24	1.24	20	1.24	15	1.20	
WEB SHEAR AND PROPERTY VALUES										
V, kips		209	167	126	105		84		63	
S _x , In. ³		38.7	33.0	26.4	22.6		18.7		13.9**	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		9 x 5						Δ Inches
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	
Weight Per Foot		50.81	42.05	32.58	27.59	22.42	17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	326	281	226	195	162	125	0.02
	3	217	187	150	130	108	84	0.03
	4	163	140	113	97	81	63	0.06
	5	130	112	90	78	65	50	0.09
	6	109	94	75	65	54	42	0.14
	7	93	80	64	56	46	36	0.19
	8	81	70	56	49	40	31	0.24
	9	72	62	50	43	36	28	0.31
	10	65	56	45	39	32	25	0.38
	11	59	51	41	35	29	23	0.46
		54	46	37	32	27	21	0.42
	12	54	47	38	32	27	21	0.55
		49	43	34	30	25	19	0.50
	13	50	43	35	30	25	19	0.64
		46	39	32	27	23	18	0.58
	14	47	40	32	28	23	18	0.74
		42	36	29	25	21	16	0.68
	15	43	37	30	26	22	17	0.85
		39	34	27	24	20	15	0.78
16	41	35	28	24	20	16	0.97	
	37	32	26	22	18	14	0.88	
17	38	33	27	23	19	15	1.10	
	35	30	24	21	17	13	1.00	
18	36	31	25	22	18	14	1.23	
	33	28	23	20	16	13	1.12	
19	34	30	24	20	17	13	1.37	
	31	27	22	19	15	12	1.24	
WEB SHEAR AND PROPERTY VALUES								
V, kips		209	167	126	105	84	63	
S_x, In.³		29.6	25.5	20.5	17.7	14.7	11.4	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=50



ERW

Nominal Size		9 x 3					Δ Inches	
Wall Thickness	1/2	3/8	5/16	1/4	3/16			
Weight Per Foot	35.24	27.48	23.34	19.02	14.53			
Design Wall Thickness	0.465	0.349	0.291	0.233	0.174			
Span in Feet	2	197	162	141	118	92	0.02	
	3	131	108	94	78	61	0.03	
	4	98	81	70	59	46	0.06	
	5	79	65	56	47	37	0.09	
	6	66	54	47	39	31	0.14	
	7	56	46	40	34	26	0.19	
		51	42	37	31	24	0.17	
	8	49	40	35	29	23	0.24	
		45	37	32	27	21	0.22	
	9	44	36	31	26	20	0.31	
		40	33	28	24	19	0.28	
	10	39	32	28	24	18	0.38	
		36	29	26	21	17	0.34	
	11	36	29	26	21	17	0.46	
		33	27	23	19	15	0.42	
	12	33	27	23	20	15	0.55	
		30	25	21	18	14	0.50	
	13	30	25	22	18	14	0.64	
		28	23	20	16	13	0.58	
	14	28	23	20	17	13	0.74	
		26	21	18	15	12	0.68	
	15	26	22	19	16	12	0.85	
		24	20	17	14	11	0.78	
	16	25	20	18	15	11	0.97	
		22	18	16	13	10	0.88	
	17	23	19	17	14	11	1.10	
		21	17	15	13	9.8	1.00	
	18	22	18	16	13	10	1.23	
		20	16	14	12	9.3	1.12	
	19	21	17	15	12	9.7	1.37	
		19	15	13	11	8.8	1.24	
	WEB SHEAR AND PROPERTY VALUES							
	V, kips	167	126	105	84	63		
	S _x , In. ³	17.9	14.7	12.8	10.7	8.35		

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$



ERW

Nominal Size		8 x 6							
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		50.81	42.05	32.58	27.59	22.42		17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174	
Span in Feet	2	314	270	218	186	149	0.02	109	0.02
	3	209	180	145	125	103	0.04	73	0.03
	4	157	135	109	94	78	0.07	55	0.06
	5	125	108	87	75	62	0.11	44	0.10
	6	105	90	73	63	52	0.15	36	0.14
	7	90	77	62	54	44	0.21	31	0.19
	8	78	67	54	47	39	0.27	27	0.25
	9	70	60	48	42	34	0.35	24	0.31
	10	63	54	44	38	31	0.43	22	0.39
	11	57	49	40	34	28	0.52	20	0.47
	12	52	45	36	31	26	0.61	18	0.56
	13	48	41	34	29	24	0.72	—	—
		44	38	30	26	22	0.66	17	0.66
	14	45	39	31	27	22	0.84	—	—
		41	35	28	24	20	0.76	16	0.76
	15	42	36	29	25	21	0.96	—	—
		38	33	26	23	19	0.87	15	0.87
16	39	34	27	24	19	1.09	—	—	
	36	31	25	21	18	0.99	14	0.99	
17	37	32	26	22	18	1.23	—	—	
	34	29	23	20	17	1.12	13	1.12	
WEB SHEAR AND PROPERTY VALUES									
V, kips		186	149	112	93	75		56	
S_x, in.³		28.5	24.5	19.8	17.1	14.1		10.9	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$



ERW

Nominal Size		8 x 4								
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		42.30	35.24	27.48	23.34	19.02	14.53		9.86	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174		0.116	
Span in Feet	2	226	197	162	141	117	91	0.02	57	0.02
	3	150	131	108	94	78	61	0.04	38	0.03
	4	113	98	81	70	58	45	0.07	29	0.06
	5	90	79	65	56	47	36	0.11	23	0.10
	6	75	66	54	47	39	30	0.15	19	0.14
	7	64	56	46	40	33	26	0.21	16	0.19
	8	56	49	40	35	29	23	0.27	14	0.25
	9	50	44	36	31	26	20	0.35	—	—
		46	40	33	28	24	18	0.31	13	0.31
	10	45	39	32	28	23	18	0.43	—	—
		41	36	29	26	21	17	0.39	11	0.39
	11	41	36	29	26	21	17	0.52	—	—
		37	33	27	23	19	15	0.47	10	0.47
	12	38	33	27	23	19	15	0.61	—	—
		34	30	25	21	18	14	0.56	9.6	0.56
	13	35	30	25	22	18	14	0.72	—	—
		32	28	23	20	16	13	0.66	8.8	0.66
	14	32	28	23	20	17	13	0.84	—	—
		29	26	21	18	15	12	0.76	8.2	0.76
	15	30	26	22	19	16	12	0.96	—	—
27		24	20	17	14	11	0.87	7.6	0.87	
16	28	25	20	18	15	11	1.09	—	—	
	26	22	18	16	13	10	0.99	7.2	0.99	
17	27	23	19	17	14	11	1.23	—	—	
	24	21	17	15	12	9.7	1.12	6.7	1.12	
WEB SHEAR AND PROPERTY VALUES										
V, kips		186	149	112	93	75	56		37	
S _x , In. ³		20.5	17.9	14.7	12.8	10.6	8.27		5.73	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50




ERW

Nominal Size		8 x 3							Nominal Size		8 x 2					
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		31.84	24.93	21.21	17.32	13.25	9.01		Weight Per Foot		22.37	19.08	15.62	11.97	8.16	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	
Span in Feet	2	161	133	117	98	76	53	0.02	Span in Feet	2	105	93	78	62	43	0.02
	3	107	89	78	65	51	35	0.04		3	70	62	52	41	29	0.04
	4	80	67	58	49	38	27	0.07		4	53	46	39	31	22	0.07
	5	64	53	47	39	31	21	0.11		5	42	37	31	25	17	0.11
	6	54	44	39	33	25	18	0.15			38	34	28	22	16	0.10
	7	46	38	33	28	22	15	0.21		6	35	31	26	21	14	0.15
		42	35	30	25	20	14	0.19			32	28	24	19	13	0.14
	8	40	33	29	24	19	13	0.27		7	30	26	22	18	12	0.21
		37	30	27	22	17	12	0.25			27	24	20	16	11	0.19
	9	36	30	26	22	17	12	0.35		8	26	23	20	15	11	0.27
		32	27	24	20	15	11	0.31			24	21	18	14	9.8	0.25
	10	32	27	23	20	15	11	0.43		9	23	21	17	14	9.6	0.35
		29	24	21	18	14	9.7	0.39			21	19	16	12	8.7	0.31
	11	29	24	21	18	14	9.7	0.52		10	21	19	16	12	8.6	0.43
		27	22	19	16	13	8.8	0.47			19	17	14	11	7.9	0.39
	12	27	22	19	16	13	8.9	0.61		11	19	17	14	11	7.9	0.52
		24	20	18	15	12	8.1	0.56			17	15	13	10	7.1	0.47
13	25	20	18	15	12	8.2	0.72	12	18	15	13	10	7.2	0.61		
	22	19	16	14	11	7.4	0.66		16	14	12	9.4	6.6	0.56		
14	23	19	17	14	11	7.6	0.84	13	16	14	12	9.5	6.7	0.72		
	21	17	15	13	9.9	6.9	0.76		15	13	11	8.6	6.0	0.66		
15	21	18	16	13	10	7.1	0.96	14	15	13	11	8.8	6.2	0.84		
	19	16	14	12	9.3	6.4	0.87		14	12	10	8.0	5.6	0.76		
16	20	17	15	12	9.5	6.6	1.09	15	14	12	10	8.2	5.8	0.96		
	18	15	13	11	8.7	6.0	0.99		13	11	9.5	7.5	5.2	0.87		
17	19	16	14	11	9.0	6.3	1.23	16	13	12	9.8	7.7	5.4	1.09		
	17	14	12	10	8.2	5.7	1.12		12	11	8.9	7.0	4.9	0.99		
									17	12	11	9.2	7.3	5.1	1.23	
										11	9.9	8.4	6.6	4.6	1.12	

WEB SHEAR AND PROPERTY VALUES

V, kips	149	112	93	75	56	37		V, kips	112	93	75	56	37	
S _x , In. ³	14.6	12.1	10.6	8.88	6.94	4.83		S _x , In. ³	9.56	8.43	7.12	5.61	3.93	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$




ERW

Nominal Size		7 x 5									
Wall Thickness		5/8	1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	
Weight Per Foot		42.30	35.24	27.48	23.34	19.02	14.53		9.86		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174		0.116*		
Span in Feet	2	218	190	155	135	112	88	0.02	52	0.02	
	3	145	127	103	90	75	58	0.04	35	0.04	
	4	109	95	78	68	56	44	0.08	26	0.07	
	5	87	76	62	54	45	35	0.12	21	0.10	
	6	73	63	52	45	37	29	0.18	17	0.15	
	7	62	54	44	39	32	25	0.24	15	0.20	
	8	54	48	39	34	28	22	0.31	13	0.27	
	9	48	42	34	30	25	19	0.40	12	0.34	
	10	44	38	31	27	22	18	0.49	10	0.42	
	11	40	40	35	28	25	20	16	0.59	—	—
		36	36	31	26	22	19	14	0.54	9.4	0.50
	12	36	36	32	26	23	19	15	0.70	—	—
		33	33	29	24	21	17	13	0.64	8.7	0.60
	13	34	34	29	24	21	17	13	0.82	—	—
		30	30	27	22	19	16	12	0.75	8.0	0.71
	14	31	31	27	22	19	16	13	0.96	—	—
		28	28	25	20	18	15	11	0.87	7.4	0.82
	15	29	29	25	21	18	15	12	1.10	—	—
26		26	23	19	16	14	11	1.00	6.9	0.94	
WEB SHEAR AND PROPERTY VALUES											
V, kips		163	130	98	81	65	49		32		
S _x , In. ³		19.8	17.3	14.1	12.3	10.2	7.96		5.19**		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=50



ERW

Nominal Size		7 x 4							
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		31.84	24.93	21.21	17.32	13.25		9.01	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116	
Span in Feet	2	160	131	114	96	75	0.02	47	0.02
	3	106	87	76	64	50	0.04	32	0.04
	4	80	65	57	48	37	0.08	24	0.07
	5	64	52	46	38	30	0.12	19	0.11
	6	53	44	38	32	25	0.18	16	0.16
	7	46	37	33	27	21	0.24	14	0.22
	8	40	33	29	24	19	0.31	12	0.28
	9	35	29	25	21	17	0.40	—	—
		32	26	23	19	15	0.36	11	0.36
	10	32	26	23	19	15	0.49	—	—
		29	24	21	17	14	0.44	9.5	0.44
	11	29	24	21	17	14	0.59	—	—
		26	22	19	16	12	0.54	8.6	0.54
	12	27	22	19	16	12	0.70	—	—
		24	20	17	15	11	0.64	7.9	0.64
13	25	20	18	15	12	0.82	—	—	
	22	18	16	13	10	0.75	7.3	0.75	
14	23	19	16	14	11	0.96	—	—	
	21	17	15	12	9.7	0.87	6.8	0.87	
15	21	17	15	13	10	1.10	—	—	
	19	16	14	12	9.1	1.00	6.3	1.00	
WEB SHEAR AND PROPERTY VALUES									
V, kips		130	98	81	65	49		32	
S_x, in.³		14.5	11.9	10.4	8.72	6.80		4.73	


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=50



ERW

Nominal Size		7 x 3							Nominal Size		6 x 5				
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		28.43	22.37	19.08	15.62	11.97	8.16		Weight Per Foot		24.93	21.21	17.32	13.25	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	
Span in Feet	2	128	107	94	79	62	43	0.02	Span in Feet	2	124	108	91	71	0.02
	3	85	71	63	53	41	29	0.04		3	83	72	61	47	0.05
	4	64	54	47	40	31	22	0.08		4	62	54	45	35	0.09
	5	51	43	38	32	25	17	0.12		5	50	43	36	28	0.14
	6	43	36	31	26	21	14	0.18		6	41	36	30	24	0.20
	7	36	31	27	23	18	12	0.24		7	36	31	26	20	0.28
		33	28	24	21	16	11	0.22		8	31	27	23	18	0.36
	8	32	27	23	20	16	11	0.31		9	28	24	20	16	0.46
		29	24	21	18	14	9.9	0.28		10	25	22	18	14	0.57
	9	28	24	21	18	14	9.7	0.40		11	23	20	17	13	0.69
		26	22	19	16	13	8.8	0.36			21	18	15	12	0.63
	10	26	21	19	16	12	8.7	0.49		12	21	18	15	12	0.82
		23	19	17	14	11	7.9	0.44			19	16	14	11	0.74
	11	23	19	17	14	11	7.9	0.59							
		21	18	16	13	10	7.2	0.54							
12	21	18	16	13	10	7.2	0.70								
	19	16	14	12	9.4	6.6	0.64								
13	20	16	14	12	9.6	6.7	0.82								
	18	15	13	11	8.7	6.1	0.75								
14	18	15	13	11	8.9	6.2	0.96								
	17	14	12	10	8.1	5.6	0.87								
15	17	14	13	11	8.3	5.8	1.10								
	15	13	11	9.6	7.5	5.3	1.00								
WEB SHEAR AND PROPERTY VALUES															
V, kips		130	98	81	65	49	32	V, kips		84	70	56	42		
S _x , In. ³		11.6	9.73	8.54	7.19	5.65	3.95	S _x , In. ³		11.3	9.85	8.25	6.44		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



Nominal Size		6 x 4								Nominal Size		6 x 3							
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	
Weight Per Foot		28.43	22.37	19.08	15.62	11.97		8.16		Weight Per Foot		25.03	19.82	16.96	13.91	10.70	7.31		
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116	Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116				
Span in Feet	2	124	104	91	77	60	0.02	38	0.02	Span in Feet	2	98	83	74	62	49	35	0.02	
	3	83	69	61	51	40	0.05	25	0.05		3	66	56	49	42	33	23	0.05	
	4	62	52	45	38	30	0.09	19	0.08		4	49	42	37	31	25	17	0.09	
	5	50	41	36	31	24	0.14	15	0.13		5	39	33	29	25	20	14	0.14	
	6	41	35	30	26	20	0.20	13	0.19		6	33	28	25	21	16	12	0.20	
	7	36	30	26	22	17	0.28	11	0.25		7	28	24	21	18	14	9.9	0.28	
	8	31	26	23	19	15	0.36	9.5	0.33			26	22	19	16	13	9.0	0.25	
	9	28	23	20	17	13	0.46	—	—		8	25	21	18	16	12	8.6	0.36	
		25	21	18	15	12	0.42	8.5	0.42			22	19	17	14	11	7.9	0.33	
	10	25	21	18	15	12	0.57	—	—		9	22	19	16	14	11	7.7	0.46	
		23	19	17	14	11	0.52	7.6	0.52			20	17	15	13	9.9	7.0	0.42	
	11	23	19	17	14	11	0.69	—	—		10	20	17	15	12	9.8	6.9	0.57	
21		17	15	13	9.9	0.63	6.9	0.63	18	15		13	11	8.9	6.3	0.52			
12	21	17	15	13	10	0.82	—	—	11	18	15	13	11	8.9	6.3	0.69			
	19	16	14	12	9.1	0.74	6.4	0.74		16	14	12	10	8.1	5.7	0.63			
										12	16	14	12	10	8.2	5.8	0.82		
											15	13	11	9.4	7.4	5.2	0.74		

WEB SHEAR AND PROPERTY VALUES																	
V, kips	112	84	70	56	42		28		V, kips	112	84	70	56	42	28		
S _x , In. ³	11.3	9.43	8.27	6.96	5.46		3.81		S _x , In. ³	8.94	7.57	6.69	5.66	4.47	3.14		


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


F_y=50



ERW

Nominal Size		6 x 2						Nominal Size		5 x 4					
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches
Weight Per Foot		17.27	14.83	12.21	9.42	6.46		Weight Per Foot		25.03	19.82	16.96	13.91	10.70	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	
Span in Feet	2	63	56	48	38	27	0.02	Span in Feet	2	93	79	70	59	46	0.03
	3	42	37	32	26	18	0.05		3	62	53	46	39	31	0.06
	4	31	28	24	19	14	0.09		4	47	39	35	29	23	0.11
	5	25	22	19	15	11	0.14		5	37	32	28	24	19	0.17
		23	20	17	14	9.9	0.13		6	31	26	23	20	15	0.25
	6	21	19	16	13	9.1	0.20		7	27	23	20	17	13	0.33
		19	17	15	12	8.2	0.19		8	23	20	17	15	12	0.44
	7	18	16	14	11	7.8	0.28		9	21	18	15	13	10	0.55
		16	15	12	10	7.1	0.25			19	16	14	12	9.4	0.50
	8	16	14	12	9.6	6.8	0.36		10	19	16	14	12	9.3	0.68
		14	13	11	8.7	6.2	0.33			17	14	13	11	8.4	0.62
	9	14	12	11	8.5	6.0	0.46								
13		11	9.7	7.8	5.5	0.42									
10	13	11	9.6	7.7	5.4	0.57									
	11	10	8.7	7.0	4.9	0.52									
11	11	10	8.7	7.0	4.9	0.69									
	10	9.3	7.9	6.3	4.5	0.63									
12	10	9.4	8.0	6.4	4.5	0.82									
	9.5	8.5	7.3	5.8	4.1	0.74									
WEB SHEAR AND PROPERTY VALUES															
V, kips	84	70	56	42	28		V, kips	93	70	58	47	35			
S _x , In. ³	5.71	5.11	4.37	3.49	2.47		S _x , In. ³	8.48	7.16	6.32	5.35	4.22			


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$




ERW

Nominal Size		5 x 3							Nominal Size		5 x 2 1/2			
Wall Thickness		1/2	3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches
Weight Per Foot		21.63	17.27	14.83	12.21	9.42	6.46		Weight Per Foot		11.36	8.78	6.03	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116	
Span in Feet	2	72	62	55	47	38	27	0.03	Span in Feet	2	41	33	24	0.03
	3	48	41	37	31	25	18	0.06		3	28	22	16	0.06
	4	36	31	28	24	19	13	0.11		4	21	17	12	0.11
	5	29	25	22	19	15	11	0.17		5	17	13	9.4	0.17
	6	24	21	18	16	13	8.8	0.25		6	14	11	7.8	0.25
	7	21	18	16	13	11	7.6	0.33			13	10	7.1	0.22
		19	16	14	12	9.7	6.9	0.30		7	12	9.5	6.7	0.33
	8	18	16	14	12	9.4	6.6	0.44			11	8.6	6.1	0.30
		16	14	13	11	8.5	6.0	0.40		8	10	8.3	5.9	0.44
	9	16	14	12	10	8.3	5.9	0.55			9.4	7.5	5.4	0.40
15		13	11	9.5	7.6	5.4	0.50	9	9.2	7.4	5.2	0.55		
10	14	12	11	9.4	7.5	5.3	0.68		8.4	6.7	4.8	0.50		
	13	11	10	8.6	6.8	4.8	0.62	10	8.3	6.6	4.7	0.68		
									7.5	6.0	4.3	0.62		

WEB SHEAR AND PROPERTY VALUES													
V, kips	93	70	58	47	35	23		V, kips	47	35	23		
S_x , in. ³	6.56	5.65	5.03	4.29	3.41	2.41		S_x , in. ³	3.76	3.01	2.14		


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



ERW

Nominal Size		5 x 2						Nominal Size		4 x 3					
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		14.72	12.70	10.51	8.15	5.61		Weight Per Foot		14.72	12.70	10.51	8.15	5.61	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	
Span in Feet	2	46	41	36	29	20	0.03	Span in Feet	2	44	39	34	27	19	0.03
	3	30	27	24	19	14	0.06		3	29	26	23	18	13	0.08
	4	23	21	18	14	10	0.11		4	22	20	17	14	9.7	0.14
	5	18	16	14	11	8.2	0.17		5	17	16	14	11	7.7	0.21
		17	15	13	10	7.4	0.16		6	15	13	11	9.1	6.5	0.31
	6	15	14	12	9.5	6.8	0.25		7	12	11	9.6	7.8	5.5	0.42
		14	12	11	8.7	6.2	0.22			11	10	8.8	7.1	5.0	0.38
	7	13	12	10	8.2	5.8	0.33		8	11	9.8	8.4	6.8	4.8	0.55
		12	11	9.2	7.4	5.3	0.30			9.9	8.9	7.7	6.2	4.4	0.50
	8	11	10	8.9	7.2	5.1	0.44								
10		9.4	8.1	6.5	4.7	0.40									
9	10	9.1	7.9	6.4	4.5	0.55									
	9.2	8.3	7.2	5.8	4.1	0.50									
10	9.1	8.2	7.1	5.7	4.1	0.68									
	8.3	7.5	6.5	5.2	3.7	0.62									
WEB SHEAR AND PROPERTY VALUES															
V, kips	70	58	47	35	23		V, kips	56	47	37	28	19			
S _x , In. ³	4.14	3.74	3.23	2.60	1.86		S _x , In. ³	3.96	3.57	3.07	2.47	1.76			


Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$



ERW

Nominal Size		4 x 2 1/2				Nominal Size		4 x 2							
Wall Thickness		5/16	1/4	3/16	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches		
Weight Per Foot		11.64	9.66	7.51		Weight Per Foot		12.17	10.58	8.81	6.87	4.75			
Design Wall Thickness		0.291	0.233	0.174		Design Wall Thickness		0.349	0.291	0.233	0.174	0.116			
Span in Feet	2	34	29	24	0.03	Span in Feet	2	31	28	25	20	15	0.03		
	3	22	20	16	0.08		3	21	19	17	13	9.7	0.08		
	4	17	15	12	0.14		4	15	14	12	10	7.3	0.14		
	5	13	12	9.5	0.21		5	12	11	9.9	8.1	5.8	0.21		
	6	11	9.8	7.9	0.31			11	10	9.0	7.3	5.3	0.19		
		10	8.9	7.2	0.28		6	10	9.4	8.3	6.7	4.8	0.31		
	7	9.6	8.4	6.8	0.42			9.3	8.5	7.5	6.1	4.4	0.28		
		8.7	7.6	6.1	0.38		7	8.8	8.0	7.1	5.8	4.1	0.42		
	8	8.4	7.3	5.9	0.55			8.0	7.3	6.4	5.2	3.8	0.38		
		7.7	6.7	5.4	0.50		8	7.7	7.0	6.2	5.0	3.6	0.55		
								7.0	6.4	5.6	4.6	3.3	0.50		
	WEB SHEAR AND PROPERTY VALUES														
	V, kips		47	37	28			V, kips		56	47	37	28	19	
	S_x , in. ³		3.06	2.66	2.15			S_x , in. ³		2.80	2.56	2.25	1.83	1.32	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


$F_y=50$



ERW

Nominal Size		3 1/2 x 2 1/2						Nominal Size		3 x 2 1/2				
Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		12.17	10.58	8.81	6.87	4.75		Weight Per Foot		9.51	7.96	6.23	4.33	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116		Design Wall Thickness		0.291	0.233	0.174	0.116	
Span in Feet	1	60	55	48	39	28	0.01	Span in Feet	1	43	38	31	23	0.01
	2	30	27	24	19	14	0.04		2	21	19	16	11	0.05
	3	20	18	16	13	9.4	0.09		3	14	13	10	7.6	0.10
	4	15	14	12	9.7	7.0	0.16		4	11	9.4	7.8	5.7	0.18
	5	12	11	9.5	7.7	5.6	0.24		5	8.5	7.5	6.2	4.5	0.28
	6	9.9	9.1	8.0	6.5	4.7	0.35		6	7.1	6.3	5.2	3.8	0.41
		9.0	8.3	7.2	5.9	4.3	0.32				6.5	5.7	4.7	3.4
7	8.5	7.8	6.8	5.5	4.0	0.48								
	7.7	7.1	6.2	5.0	3.7	0.43								
WEB SHEAR AND PROPERTY VALUES														
V, kips		49	41	33	24	16		V, kips		35	28	21	14	
S _x , In. ³		2.71	2.48	2.17	1.76	1.28		S _x , In. ³		1.94	1.71	1.41	1.03	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=50$



ERW

Nominal Size		3 x 2					Nominal Size		3 x 1 1/2				Nominal Size		3 x 1		
Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches
Weight Per Foot		8.45	7.11	5.59	3.90		Weight Per Foot		6.26	4.96	3.48		Weight Per Foot		4.32	3.05	
Design Wall Thickness		0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116		Design Wall Thickness		0.174	0.116	
Span in Feet	1	35	31	26	19	0.01	Span in Feet	1	25	21	16	0.01	Span in Feet	1	16	12	0.01
	2	17	16	13	9.5	0.05		2	12	10	7.8	0.05		2	7.8	6.0	0.05
	3	12	10	8.7	6.4	0.10		3	8.2	6.9	5.2	0.10		3	5.2	4.0	0.10
	4	8.7	7.8	6.5	4.8	0.18		4	6.2	5.2	3.9	0.18		3	4.8	3.6	0.09
	5	7.0	6.2	5.2	3.8	0.28		5	5.6	4.7	3.5	0.17		4	3.9	3.0	0.18
		6.3	5.7	4.7	3.5	0.26			4.9	4.2	3.1	0.28		4	3.6	2.7	0.17
	6	5.8	5.2	4.3	3.2	0.41		6	4.5	3.8	2.8	0.26		5	3.1	2.4	0.28
		5.3	4.7	3.9	2.9	0.37			4.1	3.5	2.6	0.41		5	2.9	2.2	0.26
									3.7	3.2	2.4	0.37		6	2.6	2.0	0.41
									2.4	1.8				6	2.4	1.8	0.37
WEB SHEAR AND PROPERTY VALUES																	
V, kips		35	28	21	14		V, kips		28	21	14		V, kips		21	14	
S_x, In.³		1.58	1.42	1.18	0.866		S_x, In.³		1.12	0.945	0.706		S_x, In.³		0.713	0.545	


Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


$F_y=50$



ERW

Nominal Size		2 1/2 x 1 1/2				Nominal Size		2 x 1 1/2			Nominal Size		2 x 1		
Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches
Weight Per Foot		5.41	4.32	3.05		Weight Per Foot		3.68	2.63		Weight Per Foot		3.04	2.20	
Design Wall Thickness		0.233	0.174	0.116		Design Wall Thickness		0.174	0.116		Design Wall Thickness		0.174	0.116	
Span in Feet	1	18	16	12	0.01	Span in Feet	1	11	8.4	0.02	Span in Feet	1	7.7	6.2	0.02
	2	9.0	7.8	5.9	0.05		2	5.4	4.2	0.07		2	3.8	3.1	0.07
	3	6.0	5.2	3.9	0.12		3	3.6	2.8	0.15		3	2.6	2.1	0.15
	4	4.5	3.9	2.9	0.22		4	2.7	2.1	0.27			2.3	1.9	0.14
		4.1	3.5	2.7	0.20			2.5	1.9	0.25		1.9	1.5	0.27	
5	3.6	3.1	2.4	0.34						4	1.7	1.4	0.25		
		3.3	2.8	2.1	0.31										
WEB SHEAR AND PROPERTY VALUES															
V, kips		23	17	12		V, kips		14	9.3		V, kips		14	9.3	
S _x , In. ³		0.820	0.705	0.535		S _x , In. ³		0.494	0.383		S _x , In. ³		0.349	0.280	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables / Structural Steel Tubing


Notes

A large, empty rectangular box with a green border, intended for notes or additional information.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		16 x 16								Nominal Size		14 x 14							
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	5/16	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	5/16	Δ
Weight Per Foot		127.30	Inches	103.30	Inches	78.52	Inches	65.87	Inches	Weight Per Foot		110.36	Inches	89.68	Inches	68.31	Inches	57.36	Inches
Design Wall Thickness		0.581		0.465		0.349*		0.291*		Design Wall Thickness		0.581		0.465		0.349*		0.291*	
Span in Feet	4			595	0.03	447	0.03	372	0.03	Span in Feet	4	651	0.04	521	0.04	391	0.03	311	0.03
	5	744	0.05	564	0.05	396	0.04	309	0.04		5	563	0.06	424	0.06	317	0.05	248	0.05
	6	627	0.08	470	0.07	330	0.06	258	0.06		6	469	0.09	353	0.08	264	0.08	207	0.07
	7	537	0.10	403	0.10	283	0.09	221	0.08		7	402	0.12	303	0.11	227	0.10	177	0.10
	8	470	0.14	353	0.12	248	0.11	193	0.10		8	352	0.16	265	0.14	198	0.14	155	0.13
	9	418	0.17	313	0.16	220	0.14	172	0.13		9	313	0.20	236	0.18	176	0.17	138	0.16
	10	376	0.21	282	0.19	198	0.18	155	0.16		10	282	0.24	212	0.22	159	0.21	124	0.20
	11	342	0.26	256	0.23	180	0.21	141	0.20		11	256	0.30	193	0.27	144	0.26	113	0.24
	12	314	0.31	235	0.28	165	0.25	129	0.23		12	235	0.35	177	0.32	132	0.31	104	0.28
	13	289	0.36	217	0.33	152	0.30	119	0.27		13	217	0.41	163	0.37	122	0.36	96	0.33
	14	269	0.42	201	0.38	141	0.34	110	0.32		14	201	0.48	151	0.43	113	0.42	89	0.39
	15	251	0.48	188	0.44	132	0.40	103	0.37		15	188	0.55	141	0.50	106	0.48	83	0.44
	16	235	0.55	176	0.50	124	0.45	97	0.42		16	176	0.62	133	0.57	99	0.55	78	0.50
	17	221	0.62	166	0.56	116	0.51	91	0.47		17	166	0.70	125	0.64	93	0.62	73	0.57
	18	209	0.69	157	0.63	110	0.57	86	0.53		18	156	0.79	118	0.72	88	0.69	69	0.64
	19	198	0.77	148	0.70	104	0.64	81	0.59		19	148	0.88	112	0.80	83	0.77	65	0.71
	20	188	0.85	141	0.78	99	0.70	77	0.65		20	141	0.98	106	0.89	79	0.85	62	0.79
	21	179	0.94	134	0.86	94	0.78	74	0.72		21	134	1.08	101	0.98	76	0.94	59	0.87
	22	171	1.03	128	0.94	90	0.85	70	0.79		22	128	1.18	96	1.07	72	1.03	56	0.95
	23	164	1.13	123	1.03	86	0.93	67	0.86		23	122	1.29	92	1.17	69	1.13	54	1.04
	24	157	1.23	118	1.12	83	1.01	64	0.93		24	117	1.40	88	1.28	66	1.23	52	1.13
	25	150	1.33	113	1.21	79	1.10	62	1.01		25	113	1.52	85	1.39	63	1.33	50	1.23
	26	145	1.44	108	1.31	76	1.19	59	1.10		26	108	1.65	82	1.50	61	1.44	48	1.33
	27	139	1.56	104	1.41	73	1.28	57	1.18		27	104	1.78	79	1.62	59	1.55	46	1.43
	28	134	1.67	101	1.52	71	1.38	55	1.27		28	101	1.91	76	1.74	57	1.67	44	1.54
	29	130	1.79	97	1.63	68	1.48	53	1.37		29	97	2.05	—	—	—	—	—	—
	30	125	1.92	94	1.75	66	1.58	52	1.46		30	88	1.86	73	1.86	55	1.79	43	1.65
	31	121	2.05	91	1.86	64	1.69	50	1.56		31	94	2.19	—	—	—	—	—	—
	32	118	2.18	88	1.99	62	1.80	48	1.66		32	85	2.00	71	2.00	53	1.92	41	1.77
	33	114	2.32	—	—	—	—	—	—		33	—	—	—	—	—	—	—	—
			104	2.11	85	2.11	60	1.92	47		1.77								
	34	111	2.47	—	—	—	—	—	—		34	—	—	—	—	—	—	—	—
		101	2.24	83	2.24	58	2.03	45	1.88										

WEB SHEAR AND PROPERTY VALUES

V, kips	372		298		223		186		V, kips	325		260		195		163	
S_x, In.³	171		141		99.0**		77.3**		S_x, In.³	128		106		79.3**		62.1**	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		12 x 12									
Wall Thickness		5/8	1/2	Δ Inches	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches	
Weight Per Foot		93.34	76.07		58.10		48.86		39.43		
Design Wall Thickness		0.581	0.465	0.349	0.291 *	0.233 *					
Span in Feet	4	502	419	0.05	298	0.04	241	0.04	179	0.04	
	5	402	335	0.07	238	0.06	193	0.06	143	0.06	
	6	335	279	0.10	198	0.09	161	0.09	119	0.08	
	7	287	239	0.14	170	0.13	138	0.12	102	0.11	
	8	251	210	0.18	149	0.17	121	0.16	89	0.14	
	9	223	186	0.23	132	0.21	107	0.20	79	0.18	
	10	201	168	0.28	119	0.26	96	0.25	71	0.22	
	11	183	152	0.34	108	0.31	88	0.30	65	0.27	
	12	167	140	0.41	99	0.37	80	0.35	60	0.32	
	13	155	129	0.48	92	0.44	74	0.42	55	0.38	
	14	143	120	0.56	85	0.51	69	0.48	51	0.44	
	15	134	112	0.64	79	0.58	64	0.55	48	0.50	
	16	126	105	0.73	74	0.66	60	0.63	45	0.57	
	17	118	99	0.82	70	0.75	57	0.71	42	0.65	
	18	112	93	0.92	66	0.84	54	0.80	40	0.72	
	19	106	88	1.03	63	0.93	51	0.89	38	0.81	
	20	100	84	1.14	60	1.03	48	0.98	36	0.89	
	21	96	80	1.25	57	1.14	46	1.08	34	0.99	
	22	91	76	1.38	54	1.25	44	1.19	32	1.08	
	23	87	73	1.50	52	1.37	42	1.30	31	1.18	
	24	84	70	1.64	50	1.49	40	1.42	30	1.29	
	25	80	67	1.78	—	—	—	—	—	—	
		73	61	1.62	48	1.62	39	1.54	29	1.40	
	WEB SHEAR AND PROPERTY VALUES										
	V, kips	279	223		168		140		112		
S _x , In. ³	91.3	76.2		59.5		48.2 **		35.7 **			

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		10 x 10										
Wall Thickness		5/8	1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches	
Weight Per Foot		76.33	62.46	47.90		40.35		32.63		24.73		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233 *	0.174 *					
Span in Feet	2	465			0.01	233	0.01	186	0.01	139	0.01	
	3	446	372	279	0.03	230	0.03	176	0.03	118	0.02	
	4	334	282	222	0.05	173	0.05	132	0.05	89	0.04	
	5	268	225	178	0.09	138	0.08	106	0.07	71	0.06	
	6	223	188	148	0.12	115	0.11	88	0.10	59	0.09	
	7	191	161	127	0.17	99	0.15	75	0.14	51	0.12	
	8	167	141	111	0.22	86	0.20	66	0.19	44	0.16	
	9	149	125	99	0.28	77	0.25	59	0.24	39	0.21	
	10	134	113	89	0.34	69	0.31	53	0.29	35	0.25	
	11	122	102	81	0.41	63	0.38	48	0.35	32	0.31	
	12	111	94	74	0.49	58	0.45	44	0.42	30	0.37	
	13	103	87	68	0.58	53	0.52	41	0.49	27	0.43	
	14	96	80	63	0.67	49	0.61	38	0.57	25	0.50	
	15	89	75	59	0.77	46	0.70	35	0.65	24	0.57	
	16	84	70	56	0.87	43	0.79	33	0.74	22	0.65	
	17	79	66	52	0.99	41	0.90	31	0.84	21	0.73	
	18	74	63	49	1.11	38	1.01	29	0.94	20	0.82	
	19	70	59	47	1.23	36	1.12	28	1.05	19	0.92	
	20	67	56	44	1.37	35	1.24	26	1.16	18	1.02	
		21	64	54	42	1.51	—	—	—	—	—	—
			58	49	38	1.37	33	1.37	25	1.28	17	1.12
WEB SHEAR AND PROPERTY VALUES												
V, kips		232	186	140		116		93		70		
S_x, In.³		60.8	51.2	40.4		34.5		26.4 **		17.7 **		

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		9 x 9								
Wall Thickness		1/2	3/8	Δ Inches	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		55.66	42.79		36.10		29.23		22.18	
Design Wall Thickness		0.465	0.349	0.291	0.233 *	0.174 *				
Span in Feet	2	<u>335</u>	<u>251</u>	0.02	<u>210</u>	0.01	<u>168</u>	0.01	<u>125</u>	0.01
	3	<u>298</u>	<u>236</u>	0.03	<u>184</u>	0.03	<u>147</u>	0.03	<u>100</u>	0.03
	4	<u>223</u>	<u>177</u>	0.06	<u>138</u>	0.06	<u>111</u>	0.05	<u>75</u>	0.05
	5	<u>179</u>	<u>142</u>	0.09	<u>110</u>	0.09	<u>88</u>	0.08	<u>60</u>	0.07
	6	<u>149</u>	<u>118</u>	0.14	<u>92</u>	0.12	<u>74</u>	0.12	<u>50</u>	0.11
	7	<u>128</u>	<u>101</u>	0.19	<u>79</u>	0.17	<u>63</u>	0.16	<u>43</u>	0.15
	8	<u>112</u>	<u>89</u>	0.24	<u>69</u>	0.22	<u>55</u>	0.22	<u>38</u>	0.19
	9	<u>99</u>	<u>79</u>	0.31	<u>61</u>	0.28	<u>49</u>	0.27	<u>33</u>	0.24
	10	<u>89</u>	<u>71</u>	0.38	<u>55</u>	0.34	<u>44</u>	0.34	<u>30</u>	0.30
	11	<u>81</u>	<u>64</u>	0.46	<u>50</u>	0.42	<u>40</u>	0.41	<u>27</u>	0.36
	12	<u>74</u>	<u>59</u>	0.55	<u>46</u>	0.50	<u>37</u>	0.48	<u>25</u>	0.43
	13	<u>69</u>	<u>54</u>	0.64	<u>42</u>	0.58	<u>34</u>	0.57	<u>23</u>	0.50
	14	<u>64</u>	<u>51</u>	0.74	<u>39</u>	0.68	<u>32</u>	0.66	<u>21</u>	0.58
	15	<u>60</u>	<u>47</u>	0.85	<u>37</u>	0.78	<u>29</u>	0.76	<u>20</u>	0.67
	16	<u>56</u>	<u>44</u>	0.97	<u>35</u>	0.88	<u>28</u>	0.86	<u>19</u>	0.76
	17	<u>53</u>	<u>42</u>	1.10	<u>32</u>	1.00	<u>26</u>	0.97	<u>18</u>	0.86
	18	<u>50</u>	<u>39</u>	1.23	<u>31</u>	1.12	<u>25</u>	1.09	<u>17</u>	0.96
	19	<u>47</u>	<u>37</u>	1.37	—	—	—	—	—	—
			<u>43</u>	<u>34</u>	1.24	<u>29</u>	1.24	<u>23</u>	1.21	<u>16</u>
WEB SHEAR AND PROPERTY VALUES										
V, kips		167	126		105		84		63	
S _x , In. ³		40.6	32.2		27.6		22.1 **		15.0 **	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		8 x 8									
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches	
Weight Per Foot		59.32	48.85	37.69	31.84		25.82		19.63		
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233	0.174 *				
Span in Feet	2	372	298	223	186	0.02	149	0.02	111	0.01	
	3	268	229	183	157	0.04	118	0.03	82	0.03	
	4	201	172	137	118	0.07	89	0.06	62	0.06	
	5	161	137	110	94	0.11	71	0.10	49	0.09	
	6	134	114	91	78	0.15	59	0.14	41	0.13	
	7	115	98	78	67	0.21	51	0.19	35	0.17	
	8	100	86	68	59	0.27	44	0.25	31	0.22	
	9	89	76	61	52	0.35	39	0.31	27	0.28	
	10	80	69	55	47	0.43	35	0.39	25	0.35	
	11	73	62	50	43	0.52	32	0.47	22	0.42	
	12	67	57	46	39	0.61	30	0.56	21	0.51	
	13	62	53	42	36	0.72	27	0.66	19	0.59	
	14	57	49	39	34	0.84	25	0.76	18	0.69	
	15	54	46	37	31	0.96	24	0.87	16	0.79	
	16	50	43	34	29	1.09	22	0.99	15	0.90	
		17	47	40	32	28	1.23	—	—	—	—
			43	37	29	25	1.12	21	1.12	14	1.01
WEB SHEAR AND PROPERTY VALUES											
V, kips		186	149	112	93		75		56		
S _x , In. ³		36.5	31.2	24.9	21.4		17.7		12.3 **		

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		7 x 7								
Wall Thickness		5/8	1/2	3/8	5/16	Δ Inches	1/4	Δ Inches	3/16	Δ Inches
Weight Per Foot		50.81	42.05	32.58	27.59		22.42		17.08	
Design Wall Thickness		0.581	0.465	0.349	0.291		0.233		0.174 *	
Span in Feet	2	294	253	195	163	0.02	130	0.02	97	0.02
	3	196	169	136	117	0.04	89	0.04	66	0.04
	4	147	127	102	88	0.08	67	0.07	49	0.07
	5	117	101	82	70	0.12	53	0.11	40	0.11
	6	98	84	68	59	0.18	44	0.16	33	0.15
	7	84	72	58	50	0.24	38	0.22	28	0.21
	8	73	63	51	44	0.31	33	0.28	25	0.27
	9	65	56	45	39	0.40	30	0.36	22	0.34
	10	59	51	41	35	0.49	27	0.44	20	0.43
	11	53	46	37	32	0.59	24	0.54	18	0.52
	12	49	42	34	29	0.70	22	0.64	16	0.61
	13	45	39	31	27	0.82	20	0.75	15	0.72
	14	42	36	29	25	0.96	19	0.87	14	0.83
	15	39	34	27	23	1.10	—	—	—	—
			36	31	25	21	1.00	18	1.00	13
WEB SHEAR AND PROPERTY VALUES										
V, kips		163	130	98	81		65		49	
S_x, In.³		26.7	23.0	18.6	16.0		13.3		9.88 **	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		6 x 6									
Wall Thickness		5/8	1/2	3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	1/8	Δ Inches
Weight Per Foot		42.30	35.24	27.48	23.34	19.02		14.53		9.86	
Design Wall Thickness		0.581	0.465	0.349	0.291	0.233		0.174		0.116 *	
Span in Feet	2	202	177	144	125	105	0.02	74	0.02	44	0.02
	3	135	118	96	84	70	0.05	49	0.05	30	0.04
	4	101	89	72	63	52	0.09	37	0.08	22	0.07
	5	81	71	58	50	42	0.14	30	0.13	18	0.11
	6	67	59	48	42	35	0.20	25	0.19	15	0.16
	7	58	51	41	36	30	0.28	21	0.25	13	0.22
	8	51	44	36	31	26	0.36	19	0.33	11	0.28
	9	45	39	32	28	23	0.46	16	0.42	9.8	0.36
	10	40	35	29	25	21	0.57	15	0.52	8.9	0.44
	11	37	32	26	23	19	0.69	13	0.63	8.1	0.54
	12	34	30	24	21	17	0.82	12	0.74	7.4	0.64
	WEB SHEAR AND PROPERTY VALUES										
V, kips		139	112	84	70	56		42		28	
S _x , In. ³		18.4	16.1	13.1	11.4	9.54		7.42		4.43 **	

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		5 1/2 x 5 1/2								Nominal Size		5 x 5								
Wall Thickness		3/8	5/16	1/4	Δ Inches	3/16	Δ Inches	1/8	Δ Inches	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	
Weight Per Foot		24.93	21.21	17.32		13.25		9.01		Weight Per Foot		28.43	22.37	19.08	15.62	11.97		8.16		
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116*	Design Wall Thickness		0.465	0.349	0.291	0.233	0.174	0.116*						
Span in Feet	2	119	104	87	0.02	62	0.02	38	0.02	Span in Feet	2	114	95	84	71	55	0.03	33	0.02	
	3	79	69	58	0.06	41	0.05	26	0.05		3	76	64	56	47	37	0.06	22	0.05	
	4	59	52	43	0.10	31	0.09	19	0.08		4	57	48	42	35	28	0.11	16	0.09	
	5	48	41	35	0.16	25	0.14	15	0.13		5	46	38	33	28	22	0.17	13	0.14	
	6	40	35	29	0.22	21	0.20	13	0.18		6	38	32	28	24	18	0.25	11	0.21	
	7	34	30	25	0.30	18	0.28	11	0.25		7	33	27	24	20	16	0.33	9.4	0.28	
	8	30	26	22	0.40	15	0.36	9.6	0.32		8	29	24	21	18	14	0.44	8.2	0.37	
	9	26	23	19	0.50	14	0.46	8.5	0.41		9	25	21	19	16	12	0.55	7.3	0.47	
	10	24	21	17	0.62	12	0.56	7.7	0.50		10	23	19	17	14	11	0.68	6.6	0.58	
	11	22	19	16	0.75	11	0.68	7.0	0.61											
	WEB SHEAR AND PROPERTY VALUES																			
V, kips		77	64	51		38		26		V, kips		93	70	58	47	35		23		
S_x, In.³		10.8	9.43	7.90		6.17		3.84**		S_x, In.³		10.4	8.67	7.61	6.41	5.03		3.28**		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		4 1/2 x 4 1/2								Nominal Size		4 x 4								
Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ	1/8	Δ	Wall Thickness		1/2	3/8	5/16	1/4	3/16	Δ	1/8	Δ	
Weight Per Foot		25.03	19.82	16.96	13.91	10.70	Inches	7.31	Inches	Weight Per Foot		21.63	17.27	14.83	12.21	9.42	Inches	6.46	Inches	
Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116*		Design Wall Thickness		0.465	0.349	0.291	0.233	0.174		0.116		
Span in Feet	2	88	75	66	56	44	0.03	28	0.03	Span in Feet	2	65	56	50	43	34	0.03	22	0.03	
	3	59	50	44	37	29	0.07	18	0.06		3	44	38	34	29	23	0.08	15	0.07	
	4	44	37	33	28	22	0.12	14	0.11		4	33	28	25	21	17	0.14	11	0.12	
	5	35	30	26	22	18	0.19	11	0.17		5	26	23	20	17	14	0.21	8.8	0.19	
	6	29	25	22	19	15	0.27	9.2	0.24		6	22	19	17	14	11	0.31	7.3	0.28	
	7	25	21	19	16	13	0.37	7.9	0.33		7	19	16	14	12	9.7	0.42	6.3	0.38	
	8	22	19	16	14	11	0.49	6.9	0.43		8	16	14	13	11	8.5	0.55	5.5	0.50	
	9	20	17	15	12	9.8	0.61	6.1	0.54											
WEB SHEAR AND PROPERTY VALUES																				
V, kips		84	63	52	42	31		21		V, kips		74	56	47	37	28		19		
S_x, In.³		8.02	6.78	5.99	5.08	4.01		2.75**		S_x, In.³		5.95	5.13	4.57	3.90	3.10		2.20		

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.


* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support




Nominal Size		3 1/2 x 3 1/2							Nominal Size		3 x 3					
Wall Thickness		3/8	5/16	1/4	3/16	Δ Inches	1/8	Δ Inches	Wall Thickness		3/8	5/16	1/4	3/16	1/8	Δ Inches
Weight Per Foot		14.72	12.70	10.51	8.15		5.61		Weight Per Foot		12.17	10.58	8.81	6.87	4.75	
Design Wall Thickness		0.349	0.291	0.233	0.174	0.116	Design Wall Thickness		0.349	0.291	0.233	0.174	0.116			
Span in Feet	1	81	73	63	49	0.01	32	0.01	Span in Feet	1	55	51	44	36	26	0.01
	2	41	37	32	25	0.04	17	0.04		2	28	25	22	18	13	0.05
	3	27	24	21	17	0.09	11	0.08		3	18	17	15	12	8.7	0.10
	4	20	18	16	13	0.16	8.3	0.14		4	14	13	11	9.0	6.5	0.18
	5	16	15	13	10	0.24	6.6	0.22		5	11	10	8.8	7.2	5.2	0.28
	6	14	12	11	8.5	0.35	5.5	0.32		6	9.2	8.4	7.4	6.0	4.4	0.41
	7	12	10	9.1	7.3	0.48	4.7	0.43								
WEB SHEAR AND PROPERTY VALUES																
V, kips		49	41	33	24		16		V, kips		42	35	28	21	14	
S_x, In.³		3.70	3.34	2.88	2.31		1.66		S_x, In.³		2.51	2.30	2.01	1.64	1.19	

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.
 Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support



Nominal Size		2 1/2 x 2 1/2					Nominal Size		2 1/4 x 2 1/4				Nominal Size		2 x 2			
Wall Thickness		5/16	1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches	Wall Thickness		1/4	3/16	1/8	Δ Inches
Weight Per Foot		8.45	7.11	5.59	3.90		Weight Per Foot		6.26	4.96	3.48		Weight Per Foot		5.41	4.32	3.05	
Design Wall Thickness		0.291	0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116		Design Wall Thickness		0.233	0.174	0.116	
Span in Feet	1	32	29	24	18	0.01	Span in Feet	1	22	19	14	0.02	Span in Feet	1	16	14	11	0.02
	2	16	14	12	8.8	0.05		2	11	9.3	7.0	0.06		2	8.2	7.0	5.3	0.07
	3	11	9.5	7.9	5.9	0.12		3	7.3	6.2	4.6	0.14		3	5.5	4.7	3.6	0.15
	4	8.0	7.2	5.9	4.4	0.22		4	5.5	4.7	3.5	0.24		4	4.1	3.5	2.7	0.27
	5	6.4	5.7	4.8	3.5	0.34												

WEB SHEAR AND PROPERTY VALUES


V, kips	29	23	17	12	V, kips	21	16	10	V, kips	19	14	9.3
S _x , in. ³	1.45	1.30	1.08	0.798	S _x , in. ³	1.00	0.847	0.633	S _x , in. ³	0.745	0.640	0.486



HSS Beam Load Tables Square Structural Steel Tubing


Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



ERW


Nominal Size		1 3/4 x 1 3/4			Nominal Size		1 5/8 x 1 5/8			Nominal Size		1 1/2 x 1 1/2			Nominal Size		1 1/4 x 1 1/4		
Wall Thickness		3/16	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches	Wall Thickness		3/16	1/8	Δ Inches	
Weight Per Foot		3.68		Weight Per Foot		3.36	2.42		Weight Per Foot		3.04	2.20		Weight Per Foot		2.40	1.78		
Design Wall Thickness		0.174		Design Wall Thickness		0.174	0.116		Design Wall Thickness		0.174	0.116		Design Wall Thickness		0.174	0.116		
Span in Feet	1	10	0.02	Span in Feet	1	8.4	6.6	0.02	Span in Feet	1	6.9	5.5	0.02	Span in Feet	1	4.3	3.6	0.03	
	2	5.1	0.08		2	4.2	3.3	0.08		2	3.5	2.8	0.09		2	2.1	1.8	0.11	
	3	3.4	0.18		3	2.8	2.2	0.19		3	2.3	1.8	0.20						
WEB SHEAR AND PROPERTY VALUES																			
V, kips		12		V, kips		11	7.5		V, kips		10	7.0		V, kips		8.7	5.8		
S _x , In. ³		0.462		S _x , In. ³		0.384	0.302		S _x , In. ³		0.314	0.251		S _x , In. ³		0.194	0.162		



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



SAW

Nominal Size		32 x 24						Nominal Size		30 x 24					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		225.80	Inches	183.50	Inches	138.95	Inches	Weight Per Foot		217.30	Inches	176.70	Inches	133.84	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6					883	0.03	Span in Feet	6					828	0.03
	7	1470	0.04	1180	0.04	839	0.04		7	1380	0.05	1100	0.04	765	0.04
	8	1410	0.06	1070	0.05	734	0.05		8	1290	0.06	980	0.06	669	0.05
	9	1260	0.07	953	0.07	652	0.06		9	1150	0.08	871	0.07	595	0.06
	10	1130	0.09	857	0.08	587	0.07		10	1040	0.09	784	0.09	535	0.08
	11	1030	0.11	779	0.10	534	0.09		11	942	0.11	713	0.10	487	0.09
	12	943	0.13	715	0.12	489	0.10		12	863	0.14	653	0.12	446	0.11
	13	870	0.15	660	0.14	452	0.12		13	797	0.16	603	0.15	412	0.13
	14	808	0.17	612	0.16	419	0.14		14	740	0.19	560	0.17	382	0.15
	15	754	0.20	572	0.18	391	0.16		15	691	0.21	523	0.20	357	0.17
	16	707	0.23	536	0.21	367	0.19		16	647	0.24	490	0.22	335	0.20
	17	666	0.26	504	0.24	345	0.21		17	609	0.27	461	0.25	315	0.22
	18	629	0.29	476	0.26	326	0.24		18	576	0.31	435	0.28	297	0.25
	19	596	0.32	451	0.29	309	0.26		19	545	0.34	413	0.31	282	0.28
	20	566	0.36	429	0.33	293	0.29		20	518	0.38	392	0.35	268	0.31
	21	539	0.39	408	0.36	280	0.32		21	493	0.42	373	0.38	255	0.34
	22	514	0.43	390	0.39	267	0.35		22	471	0.46	356	0.42	243	0.37
	23	492	0.47	373	0.43	255	0.39		23	450	0.50	341	0.46	233	0.41
	24	472	0.51	357	0.47	245	0.42		24	432	0.55	327	0.50	223	0.44
	25	453	0.56	343	0.51	235	0.46		25	414	0.59	314	0.54	214	0.48
	26	435	0.60	330	0.55	226	0.49		26	398	0.64	301	0.59	206	0.52
	27	419	0.65	318	0.59	217	0.53		27	384	0.69	290	0.63	198	0.56
	28	404	0.70	306	0.64	210	0.57		28	370	0.74	280	0.68	191	0.61
	30	377	0.80	286	0.73	196	0.66		29	357	0.80	270	0.73	185	0.65
	32	354	0.91	268	0.83	183	0.75		30	345	0.85	261	0.78	178	0.69
	34	333	1.03	252	0.94	173	0.84		32	324	0.97	245	0.89	167	0.79
	36	314	1.15	238	1.06	163	0.94		34	305	1.10	231	1.00	157	0.89
	38	298	1.28	226	1.18	154	1.05		36	288	1.23	218	1.12	149	1.00
40	283	1.42	214	1.30	147	1.17	38	273	1.37	206	1.25	141	1.12		
42	269	1.57	204	1.44	140	1.29	40	259	1.52	196	1.39	134	1.24		
44	257	1.72	195	1.58	133	1.41	42	247	1.67	187	1.53	127	1.36		
46	246	1.88	186	1.73	128	1.54	44	235	1.83	178	1.68	122	1.49		
48	236	2.05	179	1.88	122	1.68	46	225	2.01	170	1.84	116	1.63		
50	226	2.22	171	2.04	117	1.82	48	216	2.18	163	2.00	112	1.78		
54	210	2.59	159	2.38	109	2.12	50	207	2.37	157	2.17	107	1.93		
58	195	2.99	148	2.74	101	2.45	54	192	2.76	145	2.53	99	2.25		
62	183	3.42	138	3.13	95	2.80	58	179	3.19	135	2.92	92	2.60		
66	171	3.87	130	3.55	89	3.17	62	167	3.64	126	3.33	86	2.97		
70	162	4.35	122	3.99	84	3.57	66	157	4.13	119	3.78	81	3.36		
74	153	4.87	116	4.46	79	3.99	70	148	4.64	112	4.25	76	3.78		


WEB SHEAR AND PROPERTY VALUES														
V, kips	736		589		442		V, kips		690		552		414	
S _x , In. ³	615**		466**		319**		S _x , In. ³		563**		426**		291**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46




Nominal Size		28 x 24						Nominal Size		26 x 24					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		208.79	Inches	169.89	Inches	128.74	Inches	Weight Per Foot		200.28	Inches	163.08	Inches	123.64	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6			1030	0.03	773	0.03	Span in Feet	6			957	0.04	718	0.03
	7	1290	0.05	1020	0.05	694	0.04		7	1200	0.05	920	0.05	623	0.04
	8	1180	0.07	892	0.06	607	0.05		8	1070	0.07	805	0.06	545	0.06
	9	1050	0.08	793	0.08	540	0.07		9	949	0.09	716	0.08	485	0.07
	10	944	0.10	714	0.09	486	0.08		10	854	0.11	644	0.10	436	0.09
	11	858	0.12	649	0.11	442	0.10		11	776	0.13	585	0.12	396	0.11
	12	787	0.15	595	0.13	405	0.12		12	711	0.16	537	0.14	363	0.13
	13	726	0.17	549	0.16	374	0.14		13	657	0.18	495	0.17	335	0.15
	14	674	0.20	510	0.18	347	0.16		14	610	0.21	460	0.20	311	0.17
	15	629	0.23	476	0.21	324	0.19		15	569	0.25	429	0.22	291	0.20
	16	590	0.26	446	0.24	304	0.21		16	534	0.28	403	0.25	273	0.22
	17	555	0.29	420	0.27	286	0.24		17	502	0.32	379	0.29	257	0.25
	18	524	0.33	397	0.30	270	0.27		18	474	0.35	358	0.32	242	0.28
	19	497	0.37	376	0.33	256	0.30		19	449	0.39	339	0.36	230	0.32
	20	472	0.41	357	0.37	243	0.33		20	427	0.44	322	0.40	218	0.35
	21	449	0.45	340	0.41	231	0.36		21	407	0.48	307	0.44	208	0.39
	22	429	0.49	325	0.45	221	0.40		22	388	0.53	293	0.48	198	0.42
	23	410	0.54	310	0.49	211	0.44		23	371	0.58	280	0.53	190	0.46
	24	393	0.59	297	0.53	202	0.47		24	356	0.63	268	0.57	182	0.50
	25	378	0.63	286	0.58	194	0.51		25	342	0.68	258	0.62	174	0.55
	26	363	0.69	275	0.63	187	0.56		26	328	0.74	248	0.67	168	0.59
	27	350	0.74	264	0.68	180	0.60		27	316	0.80	239	0.73	162	0.64
	28	337	0.80	255	0.73	173	0.65		28	305	0.86	230	0.78	156	0.69
	29	325	0.85	246	0.78	168	0.69		29	294	0.92	222	0.84	150	0.74
	30	315	0.91	238	0.84	162	0.74		30	285	0.98	215	0.90	145	0.79
	32	295	1.04	223	0.95	152	0.84		32	267	1.12	201	1.02	136	0.90
	34	278	1.17	210	1.07	143	0.95		34	251	1.26	189	1.15	128	1.01
	36	262	1.32	198	1.20	135	1.07		36	237	1.42	179	1.29	121	1.14
	38	248	1.47	188	1.34	128	1.19		38	225	1.58	169	1.44	115	1.27
	40	236	1.63	178	1.48	121	1.32		40	213	1.75	161	1.59	109	1.40
	42	225	1.79	170	1.64	116	1.45		42	203	1.93	153	1.76	104	1.55
44	215	1.97	162	1.80	110	1.59	44	194	2.12	146	1.93	99	1.70		
46	205	2.15	155	1.96	106	1.74	46	186	2.31	140	2.11	95	1.85		
48	197	2.34	149	2.14	101	1.90	48	178	2.52	134	2.29	91	2.02		
50	189	2.54	143	2.32	97	2.06	50	171	2.73	129	2.49	87	2.19		
52	182	2.75	137	2.51	93	2.23	52	164	2.96	124	2.69	84	2.37		
56	169	3.19	127	2.91	87	2.58	54	158	3.19	119	2.90	81	2.56		
60	157	3.66	119	3.34	81	2.96	56	152	3.43	115	3.12	78	2.75		
64	147	4.16	112	3.80	76	3.37	58	147	3.68	111	3.35	75	2.95		
65	145	4.29	110	3.92	75	3.48	60	142	3.94	107	3.58	73	3.16		
WEB SHEAR AND PROPERTY VALUES															
V, kips		644		515		386		V, kips		598		478		359	
S _x , In. ³		513**		388**		264**		S _x , In. ³		464**		350**		237**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46




Nominal Size		24 x 22						Nominal Size		22 x 20					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		183.27	Inches	149.47	Inches	113.43	Inches	Weight Per Foot		166.25	Inches	135.86	Inches	103.22	Inches
Design Wall Thickness		0.625		0.500*		0.375*		Design Wall Thickness		0.625		0.500*		0.375*	
Span in Feet	5					662	0.02	Span in Feet	5	1010	0.03	810	0.03	607	0.03
	6	1100	0.04	883	0.04	638	0.04		6	984	0.05	807	0.05	552	0.04
	7	1030	0.06	804	0.05	547	0.05		7	844	0.06	691	0.06	473	0.06
	8	897	0.08	704	0.07	478	0.06		8	738	0.08	605	0.08	414	0.07
	9	797	0.10	626	0.09	425	0.08		9	656	0.11	538	0.10	368	0.09
	10	718	0.12	563	0.11	383	0.10		10	591	0.13	484	0.13	331	0.11
	11	652	0.14	512	0.14	348	0.12		11	537	0.16	440	0.15	301	0.14
	12	598	0.17	469	0.16	319	0.14		12	492	0.19	403	0.18	276	0.16
	13	552	0.20	433	0.19	294	0.17		13	454	0.22	372	0.22	255	0.19
	14	513	0.23	402	0.22	273	0.19		14	422	0.25	346	0.25	237	0.22
	15	478	0.27	375	0.25	255	0.22		15	394	0.29	323	0.29	221	0.25
	16	449	0.30	352	0.29	239	0.25		16	369	0.33	302	0.33	207	0.29
	17	422	0.34	331	0.32	225	0.29		17	347	0.38	285	0.37	195	0.33
	18	399	0.39	313	0.36	213	0.32		18	328	0.42	269	0.41	184	0.37
	19	378	0.43	296	0.40	201	0.36		19	311	0.47	255	0.46	174	0.41
	20	359	0.48	282	0.45	191	0.40		20	295	0.52	242	0.51	166	0.45
	21	342	0.52	268	0.49	182	0.44		21	281	0.57	230	0.56	158	0.50
	22	326	0.58	256	0.54	174	0.48		22	268	0.63	220	0.62	151	0.55
	23	312	0.63	245	0.59	166	0.52		23	257	0.69	210	0.67	144	0.60
	24	299	0.69	235	0.65	159	0.57		24	246	0.75	202	0.73	138	0.65
	25	287	0.74	225	0.70	153	0.62		25	236	0.81	194	0.80	132	0.70
	26	276	0.80	217	0.76	147	0.67		26	227	0.88	186	0.86	127	0.76
	27	266	0.87	209	0.82	142	0.72		28	211	1.02	173	1.00	118	0.88
	28	256	0.93	201	0.88	137	0.78		30	197	1.17	161	1.15	110	1.01
	29	247	1.00	194	0.94	132	0.83		32	185	1.33	151	1.30	104	1.15
	30	239	1.07	188	1.01	128	0.89		34	174	1.50	142	1.47	97	1.30
	32	224	1.22	176	1.15	120	1.01		36	164	1.68	134	1.65	92	1.46
	34	211	1.38	166	1.29	113	1.14		38	155	1.87	127	1.84	87	1.63
36	199	1.54	156	1.45	106	1.28	40	148	2.08	121	2.04	83	1.80		
38	189	1.72	148	1.62	101	1.43	42	141	2.29	115	2.25	79	1.99		
40	179	1.90	141	1.79	96	1.58	44	134	2.51	110	2.46	75	2.18		
42	171	2.10	134	1.98	91	1.75	46	128	2.75	105	2.69	72	2.38		
44	163	2.30	128	2.17	87	1.92	48	123	2.99	101	2.93	69	2.60		
46	156	2.52	122	2.37	83	2.09	50	118	3.24	97	3.18	66	2.82		
48	150	2.74	117	2.58	80	2.28	51	116	3.38	95	3.31	65	2.93		
50	144	2.97	113	2.80	77	2.47									
52	138	3.22	108	3.03	74	2.68									
54	133	3.47	104	3.27	71	2.89									
56	128	3.73	101	3.51	68	3.10									
WEB SHEAR AND PROPERTY VALUES															
V, kips	552		442		331		V, kips	506		405		304			
S _x , In. ³	390		306**		208**		S _x , In. ³	321		263**		180**			

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		20 x 18						Nominal Size		20 x 16					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		149.24	Inches	122.25	Inches	93.01	Inches	Weight Per Foot		140.73	Inches	115.45	Inches	87.91	Inches
Design Wall Thickness		0.625		0.500		0.375 *		Design Wall Thickness		0.625		0.500		0.375 *	
Span in Feet	5	920	0.04	736	0.04	552	0.03	Span in Feet	4			736	0.02	552	0.02
	6	874	0.06	669	0.05	469	0.05		5	920	0.04	732	0.04	541	0.03
	7	749	0.08	573	0.07	402	0.06		6	796	0.06	610	0.05	451	0.05
	8	655	0.10	501	0.09	352	0.08		7	682	0.08	523	0.07	386	0.07
	9	582	0.13	446	0.12	313	0.10		8	597	0.10	458	0.09	338	0.09
	10	524	0.16	401	0.14	282	0.13		9	531	0.13	407	0.12	301	0.11
	11	477	0.19	365	0.17	256	0.16		10	478	0.16	366	0.14	270	0.14
	12	437	0.23	334	0.21	235	0.19		11	434	0.19	333	0.17	246	0.16
	13	403	0.27	309	0.24	217	0.22		12	398	0.23	305	0.21	225	0.20
	14	374	0.31	287	0.28	201	0.25		13	367	0.27	282	0.24	208	0.23
	15	349	0.35	267	0.32	188	0.29		14	341	0.31	262	0.28	193	0.27
	16	328	0.40	251	0.37	176	0.33		15	318	0.35	244	0.32	180	0.31
	17	308	0.45	236	0.41	166	0.37		16	299	0.40	229	0.37	169	0.35
	18	291	0.51	223	0.46	156	0.42		17	281	0.45	215	0.41	159	0.39
	19	276	0.57	211	0.52	148	0.47		18	265	0.51	203	0.46	150	0.44
	20	262	0.63	201	0.57	141	0.52		19	251	0.57	193	0.52	142	0.49
	21	250	0.69	191	0.63	134	0.57		20	239	0.63	183	0.57	135	0.55
	22	238	0.76	182	0.69	128	0.63		21	227	0.69	174	0.63	129	0.60
	23	228	0.83	174	0.76	122	0.68		22	217	0.76	166	0.69	123	0.66
	24	218	0.90	167	0.82	117	0.74		23	208	0.83	159	0.76	118	0.72
	25	210	0.98	160	0.89	113	0.81		24	199	0.90	153	0.82	113	0.78
	26	202	1.06	154	0.97	108	0.87		25	191	0.98	146	0.89	108	0.85
	27	194	1.14	149	1.04	104	0.94		26	184	1.06	141	0.97	104	0.92
	28	187	1.23	143	1.12	101	1.01		27	177	1.14	136	1.04	100	0.99
	29	181	1.32	138	1.20	97	1.09		28	171	1.23	131	1.12	97	1.07
	30	175	1.41	134	1.28	94	1.16		30	159	1.41	122	1.28	90	1.23
	31	169	1.51	129	1.37	91	1.24		32	149	1.61	114	1.46	85	1.40
	32	164	1.61	125	1.46	88	1.32		34	140	1.82	108	1.65	80	1.58
	33	159	1.71	122	1.55	85	1.41		36	133	2.04	—	—	—	—
	34	154	1.82	118	1.65	83	1.49		36	121	1.85	102	1.85	75	1.77
	36	146	2.04	111	1.85	78	1.67		38	126	2.27	—	—	—	—
	38	138	2.27	106	2.06	74	1.87		38	114	2.06	96	2.06	71	1.97
	40	131	2.51	—	—	—	—		40	119	2.51	—	—	—	—
	40	119	2.28	100	2.28	70	2.07		40	109	2.28	92	2.28	68	2.18
	42	125	2.77	—	—	—	—		42	114	2.77	—	—	—	—
	42	113	2.52	96	2.52	67	2.28		42	103	2.52	87	2.52	64	2.40
	44	119	3.04	—	—	—	—		44	109	3.04	—	—	—	—
	44	108	2.76	91	2.76	64	2.50		44	99	2.76	83	2.76	61	2.64
46	114	3.32	—	—	—	—	46	104	3.32	—	—	—	—		
46	104	3.02	87	3.02	61	2.73	46	94	3.02	80	3.02	59	2.88		

WEB SHEAR AND PROPERTY VALUES


V, kips	460		368		276		V, kips	460		368		276	
S _x , In. ³	259		218		153 **		S _x , In. ³	236		199		147 **	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing


Total Allowable Uniform Load in Kips for Beams with Lateral Support

$F_y=46$



Nominal Size		20 x 12		Nominal Size		18 x 12					
Wall Thickness		5/8	Δ Inches	Wall Thickness		5/8	1/2	Δ Inches	3/8	Δ Inches	
Weight Per Foot		123.72		Weight Per Foot		115.21	95.03		72.59		
Design Wall Thickness		0.625		Design Wall Thickness		0.625	0.500		0.375		
Span in Feet	4	920	0.03	Span in Feet	3	828		0.02			
	5	765	0.04		4	815	662	0.03	497	0.03	
	6	638	0.06		5	652	559	0.04	397	0.04	
	7	546	0.08		6	543	466	0.06	331	0.06	
	8	478	0.10		7	466	399	0.09	284	0.08	
	9	425	0.13		8	407	349	0.11	248	0.10	
	10	383	0.16		9	362	310	0.14	221	0.13	
	11	348	0.19		10	326	279	0.17	199	0.16	
	12	319	0.23		11	296	254	0.21	181	0.19	
	13	294	0.27		12	272	233	0.25	166	0.23	
	14	273	0.31		13	251	215	0.29	153	0.27	
	15	255	0.35		14	233	200	0.34	142	0.31	
	16	239	0.40		15	217	186	0.39	132	0.36	
	17	225	0.45		16	204	175	0.45	124	0.41	
	18	213	0.51		17	192	164	0.50	117	0.46	
	19	201	0.57		18	181	155	0.57	110	0.51	
	20	191	0.63		19	172	147	0.63	105	0.57	
	21	182	0.69		20	163	140	0.70	99	0.63	
	22	174	0.76		21	155	133	0.77	95	0.70	
	23	166	0.83		22	148	127	0.84	90	0.77	
	24	159	0.90		23	142	121	0.92	86	0.84	
	25	153	0.98		24	136	116	1.01	83	0.91	
	26	147	1.06		25	130	112	1.09	79	0.99	
					26	125	107	1.18	76	1.07	
		27	142		1.14		27	121	1.27	—	—
			129		1.04			110	1.16	74	1.16
	28	137	1.23		28	116	1.37	—	—		
		124	1.12			106	1.24	71	1.24		
	30	128	1.41		30	109	1.57	—	—		
		116	1.28			99	1.43	66	1.43		
	32	120	1.61		32	102	1.79	—	—		
		109	1.46			93	1.62	62	1.62		
	34	113	1.82		34	96	2.02	—	—		
		102	1.65			87	1.83	58	1.83		
	38	101	2.27		36	91	2.26	—	—		
		92	2.06			82	2.06	55	2.06		
	42	91	2.77		38	86	2.52	—	—		
		83	2.52			78	2.29	52	2.29		
	46	83	3.32		42	78	3.08	—	—		
		76	3.02			71	2.80	47	2.80		
WEB SHEAR AND PROPERTY VALUES											
V, kips		460		V, kips		414	331		248		
S _x , In. ³		189		S _x , In. ³		161	138		108		


Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.
 Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		16 x 12		Nominal Size		14 x 12			
Wall Thickness		5/8	Δ Inches	Wall Thickness		1/2	Δ Inches	3/8	Δ Inches
Weight Per Foot		106.71		Weight Per Foot		81.42		62.39	
Design Wall Thickness		0.625		Design Wall Thickness		0.500		0.375	
Span in Feet	3	736	0.02	Span in Feet	3	515	0.02	386	0.02
	4	688	0.03		4	490	0.04	351	0.03
	5	551	0.05		5	392	0.06	281	0.05
	6	459	0.07		6	327	0.08	234	0.07
	7	393	0.10		7	280	0.11	201	0.10
	8	344	0.13		8	245	0.14	175	0.13
	9	306	0.16		9	218	0.18	156	0.17
	10	275	0.20		10	196	0.22	140	0.20
	11	250	0.24		11	178	0.27	128	0.25
	12	229	0.28		12	163	0.32	117	0.29
	13	212	0.33		13	151	0.38	108	0.34
	14	197	0.38		14	140	0.44	100	0.40
	15	184	0.44		15	131	0.50	94	0.46
	16	172	0.50		16	123	0.57	88	0.52
	17	162	0.57		17	115	0.65	83	0.59
	18	153	0.64		18	109	0.73	78	0.66
	19	145	0.71		19	103	0.81	74	0.74
	20	138	0.79		20	98	0.90	70	0.82
	21	131	0.87		21	93	0.99	67	0.90
	22	125	0.95		22	89	1.09	64	0.99
	23	120	1.04		23	85	1.19	61	1.08
	24	115	1.13		24	82	1.29	58	1.17
	25	110	1.23		25	78	1.40	56	1.27
	26	106	1.33		26	75	1.52	54	1.38
	27	102	1.43		27	73	1.64	—	—
		93	1.30			66	1.49	52	1.49
	28	98	1.54		28	70	1.76	—	—
		89	1.40			64	1.60	50	1.60
	30	92	1.77		29	68	1.89	—	—
		83	1.61			61	1.72	48	1.72
	32	86	2.01		30	65	2.02	—	—
		78	1.83			59	1.84	47	1.84
	34	81	2.27		31	63	2.16	—	—
		74	2.06			58	1.96	45	1.96
	36	76	2.54		32	61	2.30	—	—
		70	2.31			56	2.09	44	2.09
	37	74	2.69						
	68	2.44							
WEB SHEAR AND PROPERTY VALUES									
V, kips	368		V, kips		258		193		
S _x , In. ³	136		S _x , In. ³		96.9		76.3		


Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.
 Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46




Nominal Size		32 x 32						Nominal Size		30 x 30					
Wall Thickness		5/8	Δ Inches	1/2	Δ Inches	3/8	Δ Inches	Wall Thickness		5/8	Δ Inches	1/2	Δ Inches	3/8	Δ Inches
Weight Per Foot		259.83		210.72		159.37		Weight Per Foot		242.82		197.11		149.16	
Design Wall Thickness		0.625*	0.500*	0.375*	Design Wall Thickness		0.625*	0.500*	0.375*						
Span in Feet	7			1180	0.03	883	0.03	Span in Feet	6					828	0.02
	8	1470	0.05	1160	0.05	782	0.04		7			1100	0.04	804	0.03
	9	1380	0.06	1030	0.06	695	0.05		8	1380	0.06	1040	0.05	704	0.04
	10	1240	0.08	927	0.07	626	0.06		9	1240	0.07	926	0.06	626	0.06
	11	1130	0.09	843	0.09	569	0.08		10	1120	0.09	834	0.08	563	0.07
	12	1040	0.11	773	0.10	521	0.09		11	1020	0.10	758	0.09	512	0.08
	13	957	0.13	713	0.12	481	0.11		12	932	0.12	695	0.11	469	0.10
	14	888	0.15	662	0.14	447	0.12		13	861	0.15	641	0.13	433	0.12
	15	829	0.18	618	0.16	417	0.14		14	799	0.17	595	0.15	402	0.13
	16	777	0.20	580	0.18	391	0.16		15	746	0.19	556	0.17	375	0.15
	17	732	0.23	546	0.21	368	0.18		16	699	0.22	521	0.20	352	0.18
	18	691	0.25	515	0.23	348	0.20		17	658	0.25	490	0.22	331	0.20
	19	655	0.28	488	0.26	329	0.23		18	622	0.28	463	0.25	313	0.22
	20	622	0.31	464	0.28	313	0.25		19	589	0.31	439	0.28	296	0.25
	21	592	0.35	442	0.31	298	0.28		20	559	0.34	417	0.31	282	0.27
	22	565	0.38	422	0.34	284	0.30		21	533	0.38	397	0.34	268	0.30
	23	541	0.42	403	0.38	272	0.33		22	509	0.42	379	0.38	256	0.33
	24	518	0.45	386	0.41	261	0.36		23	486	0.45	362	0.41	245	0.36
	25	498	0.49	371	0.45	250	0.39		24	466	0.50	347	0.45	235	0.40
	26	478	0.53	357	0.48	241	0.42		25	447	0.54	333	0.49	225	0.43
	27	461	0.57	343	0.52	232	0.46		26	430	0.58	321	0.53	217	0.46
	28	444	0.62	331	0.56	223	0.49		27	414	0.63	309	0.57	209	0.50
	29	429	0.66	320	0.60	216	0.53		28	400	0.67	298	0.61	201	0.54
	30	415	0.71	309	0.64	209	0.56		29	386	0.72	287	0.65	194	0.58
	32	389	0.80	290	0.73	196	0.64		30	373	0.77	278	0.70	188	0.62
	34	366	0.91	273	0.82	184	0.72		32	350	0.88	260	0.80	176	0.70
	36	346	1.02	258	0.92	174	0.81		34	329	0.99	245	0.90	166	0.79
	38	327	1.13	244	1.03	165	0.90		36	311	1.11	232	1.01	156	0.89
40	311	1.26	232	1.14	156	1.00	38	294	1.24	219	1.12	148	0.99		
42	296	1.38	221	1.26	149	1.10	40	280	1.38	208	1.24	141	1.10		
44	283	1.52	211	1.38	142	1.21	42	266	1.52	198	1.37	134	1.21		
46	270	1.66	202	1.51	136	1.33	44	254	1.66	189	1.50	128	1.33		
48	259	1.81	193	1.64	130	1.44	46	243	1.82	181	1.64	122	1.45		
50	249	1.96	185	1.78	125	1.57	48	233	1.98	174	1.79	117	1.58		
54	230	2.29	172	2.08	116	1.83	50	224	2.15	167	1.94	113	1.71		
58	214	2.64	160	2.40	108	2.11	54	207	2.51	154	2.27	104	2.00		
62	201	3.02	150	2.74	101	2.41	58	193	2.89	144	2.61	97	2.31		
66	188	3.42	141	3.10	95	2.73	62	180	3.30	134	2.99	91	2.64		
70	178	3.84	132	3.49	89	3.07	66	170	3.74	126	3.39	85	2.99		
74	168	4.30	125	3.90	85	3.43	70	160	4.21	119	3.81	80	3.36		
WEB SHEAR AND PROPERTY VALUES															
V, kips		736		589		442		V, kips		690		552		414	
S _x , In. ³		676**		504**		340**		S _x , In. ³		608**		453**		306**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



SAW

Nominal Size		28 x 28						Nominal Size		26 x 26					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		225.80	Inches	183.50	Inches	138.95	Inches	Weight Per Foot		208.79	Inches	169.89	Inches	128.74	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6					773	0.03	Span in Feet	6			957	0.03	718	0.03
	7	1290	0.05	1030	0.04	718	0.04		7	1200	0.05	944	0.05	636	0.04
	8	1250	0.06	932	0.05	628	0.05		8	1100	0.07	826	0.06	557	0.05
	9	1110	0.08	828	0.07	558	0.06		9	977	0.09	734	0.08	495	0.07
	10	997	0.10	745	0.09	502	0.08		10	880	0.11	661	0.10	445	0.08
	11	907	0.12	677	0.10	457	0.09		11	800	0.13	601	0.12	405	0.10
	12	831	0.14	621	0.12	419	0.11		12	733	0.15	550	0.14	371	0.12
	13	767	0.16	573	0.15	386	0.13		13	677	0.18	508	0.16	343	0.14
	14	712	0.19	532	0.17	359	0.15		14	628	0.21	472	0.19	318	0.16
	15	665	0.21	497	0.19	335	0.17		15	586	0.24	440	0.22	297	0.19
	16	623	0.24	466	0.22	314	0.19		16	550	0.27	413	0.25	278	0.22
	17	587	0.27	438	0.25	295	0.22		17	517	0.31	389	0.28	262	0.24
	18	554	0.31	414	0.28	279	0.25		18	489	0.34	367	0.31	247	0.27
	19	525	0.34	392	0.31	264	0.27		19	463	0.38	348	0.35	234	0.30
	20	499	0.38	373	0.34	251	0.30		20	440	0.42	330	0.38	223	0.34
	21	475	0.42	355	0.38	239	0.33		21	419	0.47	315	0.42	212	0.37
	22	453	0.46	339	0.42	228	0.37		22	400	0.51	300	0.46	202	0.41
	23	434	0.50	324	0.45	218	0.40		23	382	0.56	287	0.51	194	0.44
	24	416	0.55	311	0.49	209	0.44		24	366	0.61	275	0.55	186	0.48
	25	399	0.59	298	0.54	201	0.47		25	352	0.66	264	0.60	178	0.53
	26	384	0.64	287	0.58	193	0.51		26	338	0.71	254	0.65	171	0.57
	27	369	0.69	276	0.63	186	0.55		27	326	0.77	245	0.70	165	0.61
	28	356	0.75	266	0.67	179	0.59		28	314	0.83	236	0.75	159	0.66
	29	344	0.80	257	0.72	173	0.64		29	303	0.89	228	0.81	154	0.71
	30	332	0.86	248	0.77	167	0.68		30	293	0.95	220	0.86	148	0.76
	32	312	0.97	233	0.88	157	0.77		32	275	1.08	206	0.98	139	0.86
	34	293	1.10	219	0.99	148	0.87		34	259	1.22	194	1.11	131	0.97
	36	277	1.23	207	1.11	140	0.98		36	244	1.37	183	1.24	124	1.09
	38	262	1.37	196	1.24	132	1.09		38	231	1.53	174	1.38	117	1.21
	40	249	1.52	186	1.37	126	1.21		40	220	1.69	165	1.53	111	1.34
	42	237	1.68	177	1.52	120	1.33		42	209	1.86	157	1.69	106	1.48
44	227	1.84	169	1.66	114	1.47	44	200	2.05	150	1.85	101	1.63		
46	217	2.01	162	1.82	109	1.60	46	191	2.24	144	2.03	97	1.78		
48	208	2.19	155	1.98	105	1.74	48	183	2.43	138	2.21	93	1.94		
50	199	2.38	149	2.15	100	1.89	50	176	2.64	132	2.39	89	2.10		
52	192	2.57	143	2.32	97	2.05	52	169	2.86	127	2.59	86	2.27		
56	178	2.98	133	2.69	90	2.37	54	163	3.08	122	2.79	82	2.45		
60	166	3.42	124	3.09	84	2.72	56	157	3.31	118	3.00	80	2.64		
64	156	3.89	116	3.52	78	3.10	58	152	3.55	114	3.22	77	2.83		
65	153	4.02	115	3.63	77	3.20	60	147	3.80	110	3.45	74	3.03		
WEB SHEAR AND PROPERTY VALUES															
V, kips		644		515		386		V, kips		598		478		359	
S _x , in. ³		542**		405**		273**		S _x , in. ³		478**		359**		242**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=46



SAW

Nominal Size		24 x 24						Nominal Size		22 x 22					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		191.78	Inches	156.28	Inches	118.53	Inches	Weight Per Foot		174.76	Inches	142.67	Inches	108.32	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625		0.500*		0.375*	
Span in Feet	5					662	0.02	Span in Feet	5					607	0.03
	6	1100	0.04	883	0.04	650	0.03		6	1010	0.05	810	0.04	564	0.04
	7	1100	0.06	825	0.05	557	0.05		7	912	0.06	715	0.06	484	0.05
	8	959	0.08	722	0.07	488	0.06		8	798	0.08	626	0.08	423	0.07
	9	853	0.10	642	0.09	433	0.08		9	709	0.11	556	0.10	376	0.09
	10	767	0.12	578	0.11	390	0.09		10	638	0.13	500	0.12	339	0.11
	11	698	0.14	525	0.13	355	0.11		11	580	0.16	455	0.15	308	0.13
	12	639	0.17	481	0.15	325	0.14		12	532	0.19	417	0.18	282	0.15
	13	590	0.20	444	0.18	300	0.16		13	491	0.22	385	0.21	260	0.18
	14	548	0.23	413	0.21	279	0.18		14	456	0.25	357	0.24	242	0.21
	15	512	0.27	385	0.24	260	0.21		15	426	0.29	334	0.27	226	0.24
	16	480	0.30	361	0.28	244	0.24		16	399	0.33	313	0.31	212	0.27
	17	451	0.34	340	0.31	229	0.27		17	376	0.38	294	0.35	199	0.31
	18	426	0.38	321	0.35	217	0.31		18	355	0.42	278	0.39	188	0.35
	19	404	0.43	304	0.39	205	0.34		19	336	0.47	263	0.44	178	0.39
	20	384	0.47	289	0.43	195	0.38		20	319	0.52	250	0.49	169	0.43
	21	365	0.52	275	0.47	186	0.42		21	304	0.57	238	0.54	161	0.47
	22	349	0.57	263	0.52	177	0.46		22	290	0.63	227	0.59	154	0.52
	23	334	0.63	251	0.57	170	0.50		23	278	0.69	218	0.64	147	0.56
	24	320	0.68	241	0.62	163	0.54		24	266	0.75	209	0.70	141	0.62
	25	307	0.74	231	0.67	156	0.59		25	255	0.81	200	0.76	135	0.67
	26	295	0.80	222	0.73	150	0.64		26	246	0.88	192	0.82	130	0.72
	27	284	0.86	214	0.78	144	0.69		27	236	0.95	185	0.89	125	0.78
	28	274	0.93	206	0.84	139	0.74		28	228	1.02	179	0.95	121	0.84
	29	265	1.00	199	0.90	135	0.79		29	220	1.09	173	1.02	117	0.90
	30	256	1.07	193	0.97	130	0.85		30	213	1.17	167	1.10	113	0.96
	32	240	1.21	181	1.10	122	0.97		32	200	1.33	156	1.25	106	1.09
	34	226	1.37	170	1.24	115	1.09		34	188	1.50	147	1.41	100	1.23
36	213	1.53	160	1.39	108	1.22	36	177	1.68	139	1.58	94	1.38		
38	202	1.71	152	1.55	103	1.36	38	168	1.87	132	1.76	89	1.54		
40	192	1.89	144	1.72	98	1.51	40	160	2.08	125	1.95	85	1.71		
42	183	2.09	138	1.90	93	1.66	42	152	2.29	119	2.15	81	1.88		
44	174	2.29	131	2.08	89	1.83	44	145	2.51	114	2.36	77	2.07		
46	167	2.50	126	2.27	85	2.00	46	139	2.75	109	2.58	74	2.26		
48	160	2.73	120	2.48	81	2.17	48	133	2.99	104	2.80	71	2.46		
50	153	2.96	116	2.69	78	2.36	50	128	3.24	100	3.04	68	2.67		
52	148	3.20	111	2.91	75	2.55	51	125	3.38	98	3.17	66	2.78		
54	142	3.45	107	3.13	72	2.75									
56	137	3.71	103	3.37	70	2.96									
WEB SHEAR AND PROPERTY VALUES															
V, kips	552		442		331		V, kips	506		405		304			
S _x , In. ³	417**		314**		212**		S _x , In. ³	347		272**		184**			

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=46



Nominal Size		20 x 20						Nominal Size		18 x 18					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		157.75	Inches	129.06	Inches	98.12	Inches	Weight Per Foot		140.73	Inches	115.45	Inches	87.91	Inches
Design Wall Thickness		0.625		0.500*		0.375*		Design Wall Thickness		0.625		0.500		0.375*	
Span in Feet	5	920	0.04	736	0.03	552	0.03	Span in Feet	4						
	6	868	0.05	711	0.05	485	0.04		5	828	0.04	662	0.04	489	0.04
	7	744	0.07	610	0.07	415	0.06		6	756	0.06	580	0.06	408	0.05
	8	651	0.09	534	0.09	363	0.08		7	648	0.09	497	0.08	350	0.07
	9	579	0.12	474	0.11	323	0.10		8	567	0.11	435	0.10	306	0.09
	10	521	0.14	427	0.14	291	0.12		9	504	0.14	386	0.13	272	0.12
	11	473	0.17	388	0.17	264	0.15		10	453	0.17	348	0.16	245	0.14
	12	434	0.21	356	0.20	242	0.18		11	412	0.21	316	0.19	222	0.17
	13	401	0.24	328	0.24	224	0.21		12	378	0.25	290	0.23	204	0.21
	14	372	0.28	305	0.27	208	0.24		13	349	0.29	268	0.27	188	0.24
	15	347	0.32	285	0.31	194	0.28		14	324	0.34	248	0.31	175	0.28
	16	325	0.37	267	0.36	182	0.32		15	302	0.39	232	0.36	163	0.32
	17	306	0.41	251	0.40	171	0.36		16	283	0.45	217	0.41	153	0.37
	18	289	0.46	237	0.45	162	0.40		17	267	0.50	205	0.46	144	0.42
	19	274	0.52	225	0.50	153	0.44		18	252	0.57	193	0.51	136	0.47
	20	260	0.57	213	0.56	145	0.49		19	239	0.63	183	0.57	129	0.52
	21	248	0.63	203	0.62	138	0.54		20	227	0.70	174	0.63	122	0.58
	22	237	0.69	194	0.68	132	0.60		21	216	0.77	166	0.70	117	0.63
	23	226	0.76	186	0.74	126	0.65		22	206	0.84	158	0.77	111	0.70
	24	217	0.82	178	0.80	121	0.71		23	197	0.92	151	0.84	106	0.76
	25	208	0.89	171	0.87	116	0.77		24	189	1.01	145	0.91	102	0.83
	26	200	0.97	164	0.94	112	0.83		25	181	1.09	139	0.99	98	0.90
	27	193	1.04	158	1.02	108	0.90		26	174	1.18	134	1.07	94	0.97
	28	186	1.12	152	1.10	104	0.97		27	168	1.27	129	1.16	91	1.05
	29	180	1.20	147	1.18	100	1.04		28	162	1.37	124	1.24	87	1.13
	30	174	1.28	142	1.26	97	1.11		29	156	1.47	120	1.33	84	1.21
	31	168	1.37	138	1.34	94	1.18		30	151	1.57	116	1.43	82	1.29
	32	163	1.46	133	1.43	91	1.26		31	146	1.68	112	1.52	79	1.38
33	158	1.55	129	1.52	88	1.34	32	142	1.79	109	1.62	76	1.47		
34	153	1.65	126	1.62	86	1.42	33	137	1.90	105	1.73	74	1.57		
35	149	1.75	122	1.71	83	1.51	34	133	2.02	102	1.83	72	1.66		
36	145	1.85	119	1.81	81	1.60	35	130	2.14	99	1.94	70	1.76		
37	141	1.95	115	1.91	79	1.69	36	126	2.26	97	2.06	68	1.86		
38	137	2.06	112	2.02	77	1.78	37	123	2.39	94	2.17	66	1.97		
39	134	2.17	109	2.13	75	1.87	38	119	2.52	92	2.29	64	2.08		
40	130	2.28	107	2.24	73	1.97		40	113	2.79	—	—	—	—	
42	124	2.52	102	2.47	69	2.17		40	103	2.54	87	2.54	61	2.30	
44	118	2.76	97	2.71	66	2.39		42	108	3.08	—	—	—	—	
46	113	3.02	93	2.96	63	2.61		42	98	2.80	83	2.80	58	2.54	

WEB SHEAR AND PROPERTY VALUES


V, kips	460		368		276		V, kips		414		331		248	
S _x , in. ³	283		232**		158**		S _x , in. ³		224		189		133**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



Nominal Size		32 x 24						Nominal Size		30 x 24					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		225.80	Inches	183.50	Inches	138.95	Inches	Weight Per Foot		217.30	Inches	176.70	Inches	133.84	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6					960	0.03	Span in Feet	6					900	0.03
	7	1600	0.05	1280	0.04	897	0.04		7	1500	0.05	1200	0.05	817	0.04
	8	1520	0.06	1150	0.06	875	0.05		8	1390	0.06	1050	0.06	715	0.05
	9	1350	0.08	1020	0.07	698	0.06		9	1230	0.08	931	0.08	636	0.07
	10	1210	0.10	918	0.09	628	0.08		10	1110	0.10	838	0.09	572	0.08
	11	1100	0.12	835	0.11	571	0.09		11	1010	0.12	762	0.11	520	0.10
	12	1010	0.14	765	0.13	523	0.11		12	925	0.15	698	0.13	477	0.12
	13	932	0.16	706	0.15	483	0.13		13	854	0.17	645	0.16	440	0.14
	14	866	0.19	656	0.17	449	0.15		14	793	0.20	599	0.18	409	0.16
	15	808	0.21	612	0.20	419	0.18		15	740	0.23	559	0.21	381	0.19
	16	758	0.24	574	0.22	393	0.20		16	694	0.26	524	0.24	358	0.21
	17	713	0.28	540	0.25	369	0.23		17	653	0.29	493	0.27	336	0.24
	18	673	0.31	510	0.28	349	0.25		18	617	0.33	466	0.30	318	0.27
	19	638	0.34	483	0.32	331	0.28		19	584	0.37	441	0.33	301	0.30
	20	606	0.38	459	0.35	314	0.31		20	555	0.41	419	0.37	286	0.33
	21	577	0.42	437	0.38	299	0.34		21	529	0.45	399	0.41	272	0.36
	22	551	0.46	417	0.42	285	0.38		22	505	0.49	381	0.45	260	0.40
	23	527	0.50	399	0.46	273	0.41		23	483	0.54	364	0.49	249	0.44
	24	505	0.55	383	0.50	262	0.45		24	463	0.58	349	0.53	238	0.48
	25	485	0.59	367	0.55	251	0.49		25	444	0.63	335	0.58	229	0.52
	26	466	0.64	353	0.59	242	0.53		26	427	0.69	322	0.63	220	0.56
	27	449	0.69	340	0.64	233	0.57		27	411	0.74	310	0.68	212	0.60
	28	433	0.75	328	0.68	224	0.61		28	396	0.80	299	0.73	204	0.65
	29	418	0.80	317	0.73	217	0.66		29	383	0.85	289	0.78	197	0.69
	30	404	0.86	306	0.79	209	0.70		30	370	0.91	279	0.83	191	0.74
	32	379	0.97	287	0.89	196	0.80		32	347	1.04	262	0.95	179	0.84
	34	356	1.10	270	1.01	185	0.90		34	326	1.17	246	1.07	168	0.95
	36	337	1.23	255	1.13	174	1.01		36	308	1.32	233	1.20	159	1.07
38	319	1.37	242	1.26	165	1.13	38	292	1.47	221	1.34	151	1.19		
40	303	1.52	230	1.40	157	1.25	40	278	1.62	210	1.48	143	1.32		
42	289	1.68	219	1.54	150	1.38	42	264	1.79	200	1.64	136	1.46		
44	275	1.84	209	1.69	143	1.51	44	252	1.97	190	1.80	130	1.60		
46	263	2.01	200	1.85	137	1.65	46	241	2.15	182	1.96	124	1.75		
48	253	2.19	191	2.01	131	1.80	48	231	2.34	175	2.14	119	1.90		
50	242	2.38	184	2.18	126	1.95	50	222	2.54	168	2.32	114	2.06		
52	233	2.57	177	2.36	121	2.11	52	213	2.75	161	2.51	110	2.23		
56	216	2.98	164	2.74	112	2.44	54	206	2.96	155	2.70	106	2.41		
60	202	3.43	153	3.14	105	2.81	56	198	3.18	150	2.91	102	2.59		
64	189	3.90	143	3.58	98	3.19	58	191	3.42	144	3.12	99	2.77		
68	178	4.40	135	4.04	92	3.60	60	185	3.66	140	3.34	95	2.97		
								64	173	4.16	131	3.80	89	3.38	

WEB SHEAR AND PROPERTY VALUES														
V, kips	800		640		480			V, kips		750		600		450
S _x , In. ³	606**		459**		314**			S _x , In. ³		555**		419**		286**

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.

** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.




HSS Beam Load Tables

Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



SAW


Nominal Size		28 x 24						Nominal Size		26 x 24					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		208.79	Inches	169.89	Inches	128.74	Inches	Weight Per Foot		200.28	Inches	163.08	Inches	123.64	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6			1120	0.04	840	0.03	Span in Feet	6			1040	0.04	780	0.03
	7	1400	0.05	1090	0.05	740	0.04		7	1300	0.06	983	0.05	669	0.05
	8	1260	0.07	953	0.06	648	0.06		8	1140	0.07	860	0.07	585	0.06
	9	1120	0.09	847	0.08	576	0.07		9	1020	0.09	764	0.09	520	0.08
	10	1010	0.11	762	0.10	518	0.09		10	914	0.12	688	0.11	468	0.09
	11	918	0.13	693	0.12	471	0.11		11	831	0.14	625	0.13	425	0.11
	12	842	0.16	635	0.14	432	0.13		12	762	0.17	573	0.15	390	0.14
	13	777	0.18	586	0.17	398	0.15		13	703	0.20	529	0.18	360	0.16
	14	721	0.21	544	0.19	370	0.17		14	653	0.23	491	0.21	334	0.18
	15	673	0.24	508	0.22	345	0.20		15	609	0.26	459	0.24	312	0.21
	16	631	0.28	476	0.25	324	0.22		16	571	0.30	430	0.27	293	0.24
	17	594	0.31	448	0.29	305	0.25		17	538	0.34	405	0.31	275	0.27
	18	561	0.35	423	0.32	288	0.28		18	508	0.38	382	0.34	260	0.30
	19	532	0.39	401	0.36	273	0.32		19	481	0.42	362	0.38	246	0.34
	20	505	0.43	381	0.40	259	0.35		20	457	0.47	344	0.43	234	0.38
	21	481	0.48	363	0.44	247	0.39		21	435	0.52	328	0.47	223	0.41
	22	459	0.53	346	0.48	235	0.42		22	415	0.57	313	0.51	213	0.46
	23	439	0.57	331	0.52	225	0.46		23	397	0.62	299	0.56	203	0.50
	24	421	0.63	318	0.57	216	0.51		24	381	0.67	287	0.61	195	0.54
	25	404	0.68	305	0.62	207	0.55		25	366	0.73	275	0.66	187	0.59
	26	388	0.73	293	0.67	199	0.59		26	352	0.79	265	0.72	180	0.64
	27	374	0.79	282	0.72	192	0.64		27	339	0.85	255	0.78	173	0.69
	28	361	0.85	272	0.78	185	0.69		28	326	0.92	246	0.83	167	0.74
	29	348	0.91	263	0.83	179	0.74		29	315	0.98	237	0.89	161	0.79
	30	337	0.98	254	0.89	173	0.79		30	305	1.05	229	0.96	156	0.85
	32	316	1.11	238	1.01	162	0.90		32	286	1.20	215	1.09	146	0.96
	34	297	1.26	224	1.14	152	1.01		34	269	1.35	202	1.23	138	1.09
	36	281	1.41	212	1.28	144	1.14		36	254	1.52	191	1.38	130	1.22
	38	266	1.57	201	1.43	136	1.27		38	241	1.69	181	1.54	123	1.36
	40	253	1.74	191	1.58	130	1.40		40	229	1.87	172	1.70	117	1.51
42	240	1.92	181	1.75	123	1.55	42	218	2.06	164	1.88	111	1.66		
44	230	2.10	173	1.92	118	1.70	44	208	2.27	156	2.06	106	1.82		
46	220	2.30	166	2.10	113	1.86	46	199	2.48	150	2.25	102	1.99		
48	210	2.50	159	2.28	108	2.02	48	190	2.70	143	2.45	98	2.17		
50	202	2.72	152	2.48	104	2.19	50	183	2.93	138	2.66	94	2.35		
52	194	2.94	147	2.68	100	2.37	52	176	3.16	132	2.88	90	2.54		
54	187	3.17	141	2.89	96	2.56	54	169	3.41	127	3.10	87	2.74		
56	180	3.41	136	3.11	93	2.75	55	166	3.54	125	3.22	85	2.85		
58	174	3.66	131	3.33	89	2.95									
60	168	3.91	127	3.57	86	3.16									
WEB SHEAR AND PROPERTY VALUES															
V, kips	700		560		420		V, kips	650		520		390			
S _x , in. ³	505**		381**		259**		S _x , in. ³	457**		344**		234**			

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50




Nominal Size		24 x 22						Nominal Size		22 x 20					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		183.27	Inches	149.47	Inches	113.43	Inches	Weight Per Foot		166.25	Inches	135.86	Inches	103.22	Inches
Design Wall Thickness		0.625		0.500*		0.375*		Design Wall Thickness		0.625		0.500*		0.375*	
Span in Feet	5					720	0.03	Span in Feet	5	1100	0.04	880	0.03	660	0.03
	6	1200	0.05	960	0.04	680	0.04		6	1070	0.05	863	0.05	590	0.04
	7	1110	0.06	860	0.06	583	0.05		7	917	0.07	740	0.07	506	0.06
	8	975	0.08	753	0.08	510	0.07		8	803	0.09	648	0.09	443	0.08
	9	867	0.10	669	0.10	453	0.09		9	713	0.11	576	0.11	393	0.10
	10	780	0.13	602	0.12	408	0.11		10	642	0.14	518	0.14	354	0.12
	11	709	0.16	547	0.14	371	0.13		11	584	0.17	471	0.16	322	0.15
	12	650	0.19	502	0.17	340	0.15		12	535	0.20	432	0.20	295	0.17
	13	600	0.22	463	0.20	314	0.18		13	494	0.24	398	0.23	272	0.20
	14	557	0.25	430	0.23	291	0.21		14	459	0.28	370	0.27	253	0.24
	15	520	0.29	401	0.27	272	0.24		15	428	0.32	345	0.31	236	0.27
	16	488	0.33	376	0.31	255	0.27		16	401	0.36	324	0.35	221	0.31
	17	459	0.37	354	0.35	240	0.30		17	378	0.41	305	0.39	208	0.35
	18	433	0.42	334	0.39	227	0.34		18	357	0.46	288	0.44	197	0.39
	19	411	0.47	317	0.43	215	0.38		19	338	0.51	273	0.49	186	0.43
	20	390	0.52	301	0.48	204	0.42		20	321	0.56	259	0.54	177	0.48
	21	371	0.57	287	0.53	194	0.47		21	306	0.62	247	0.60	169	0.53
	22	355	0.63	274	0.58	185	0.51		22	292	0.68	235	0.66	161	0.58
	23	339	0.68	262	0.63	177	0.56		23	279	0.75	225	0.72	154	0.64
	24	325	0.74	251	0.69	170	0.61		24	268	0.81	216	0.78	148	0.69
	25	312	0.81	241	0.75	163	0.66		25	257	0.88	207	0.85	142	0.75
	26	300	0.87	232	0.81	157	0.71		26	247	0.95	199	0.92	136	0.81
	27	289	0.94	223	0.87	151	0.77		27	238	1.03	192	0.99	131	0.88
	28	279	1.01	215	0.94	146	0.83		28	229	1.11	185	1.07	126	0.94
	29	269	1.09	208	1.01	141	0.89		29	221	1.19	179	1.15	122	1.01
	30	260	1.16	201	1.08	136	0.95		30	214	1.27	173	1.23	118	1.08
	32	244	1.32	188	1.23	128	1.08		32	201	1.44	162	1.40	111	1.23
	34	229	1.49	177	1.38	120	1.22		34	189	1.63	152	1.57	104	1.39
	36	217	1.68	167	1.55	113	1.37		36	178	1.83	144	1.77	98	1.56
	38	205	1.87	158	1.73	107	1.52		38	169	2.04	136	1.97	93	1.74
	40	195	2.07	151	1.92	102	1.69		40	161	2.26	130	2.18	89	1.93
42	186	2.28	143	2.11	97	1.86	42	153	2.49	123	2.40	84	2.12		
44	177	2.50	137	2.32	93	2.04	44	146	2.73	118	2.64	80	2.33		
46	170	2.74	131	2.53	89	2.23	46	140	2.98	113	2.88	77	2.55		
48	163	2.98	125	2.76	85	2.43	48	137	3.12	110	3.01	75	2.66		
50	156	3.23	120	2.99	82	2.64									
51	153	3.36	118	3.11	80	2.74									
WEB SHEAR AND PROPERTY VALUES															
V, kips	600		480		360		V, kips	550		440		330			
S _x , in. ³	390		301**		204**		S _x , in. ³	321		259**		177**			

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



Nominal Size		20 x 18						Nominal Size		20 x 16							
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ		
Weight Per Foot		149.24	Inches	122.25	Inches	93.01	Inches	Weight Per Foot		140.73	Inches	115.45	Inches	87.91	Inches		
Design Wall Thickness		0.625		0.500		0.375 *		Design Wall Thickness		0.625		0.500		0.375 *			
Span in Feet	5	1000	0.04	800	0.04	600	0.03	Span in Feet	4			800	0.02	600	0.02		
	6	950	0.06	727	0.06	500	0.05		5	1000	0.04	796	0.04	580	0.04		
	7	814	0.08	623	0.08	429	0.07		6	865	0.06	663	0.06	483	0.05		
	8	712	0.11	545	0.10	375	0.09		7	742	0.08	569	0.08	414	0.07		
	9	633	0.14	484	0.13	333	0.11		8	649	0.11	498	0.10	363	0.09		
	10	570	0.17	436	0.16	300	0.14		9	577	0.14	442	0.13	322	0.12		
	11	518	0.21	396	0.19	273	0.17		10	519	0.17	398	0.16	290	0.15		
	12	475	0.25	363	0.22	250	0.20		11	472	0.21	362	0.19	264	0.18		
	13	438	0.29	335	0.26	231	0.23		12	433	0.25	332	0.22	242	0.21		
	14	407	0.33	311	0.30	214	0.27		13	399	0.29	306	0.26	223	0.25		
	15	380	0.38	291	0.35	200	0.31		14	371	0.33	284	0.30	207	0.29		
	16	356	0.44	273	0.40	188	0.35		15	346	0.38	265	0.35	193	0.33		
	17	335	0.49	256	0.45	176	0.40		16	325	0.44	249	0.40	181	0.37		
	18	317	0.55	242	0.50	167	0.45		17	305	0.49	234	0.45	171	0.42		
	19	300	0.62	229	0.56	158	0.50		18	288	0.55	221	0.50	161	0.47		
	20	285	0.68	218	0.62	150	0.55		19	273	0.62	209	0.56	153	0.53		
	21	271	0.75	208	0.68	143	0.61		20	260	0.68	199	0.62	145	0.58		
	22	259	0.83	198	0.75	136	0.67		21	247	0.75	190	0.68	138	0.64		
	23	248	0.90	190	0.82	130	0.73		22	236	0.83	181	0.75	132	0.71		
	24	237	0.98	182	0.89	125	0.79		23	226	0.90	173	0.82	126	0.77		
	25	228	1.07	174	0.97	120	0.86		24	216	0.98	166	0.89	121	0.84		
	26	219	1.15	168	1.05	115	0.93		25	208	1.07	159	0.97	116	0.91		
	27	211	1.24	161	1.13	111	1.00		26	200	1.15	153	1.05	112	0.99		
	28	204	1.34	156	1.22	107	1.08		27	192	1.24	147	1.13	107	1.07		
	29	196	1.44	150	1.31	103	1.16		28	185	1.34	142	1.22	104	1.15		
	30	190	1.54	145	1.40	100	1.24		29	179	1.44	137	1.31	100	1.23		
	31	184	1.64	141	1.49	97	1.32		30	173	1.54	133	1.40	97	1.31		
	32	178	1.75	136	1.59	94	1.41		31	167	1.64	128	1.49	94	1.40		
	33	173	1.86	132	1.69	91	1.50		32	162	1.75	124	1.59	91	1.50		
	34	168	1.97	128	1.79	88	1.59			34	153	1.97	—	—	—	—	
	36	158	2.21	121	2.01	83	1.78				139	1.79	117	1.79	85	1.69	
		38	150	2.46	—	—	—				144	2.21	—	—	—	—	
			136	2.24	115	2.24	79		1.99			131	2.01	111	2.01	81	1.89
		40	142	2.73	—	—	—					137	2.46	—	—	—	—
			130	2.48	109	2.48	75		2.20			124	2.24	105	2.24	76	2.11
		42	136	3.01	—	—	—					130	2.73	—	—	—	—
		123	2.74	104	2.74	71	2.43			118	2.48	100	2.48	73	2.34		
										124	3.01	—	—	—	—		
										112	2.74	95	2.74	69	2.58		

WEB SHEAR AND PROPERTY VALUES


V, kips	500		400		300		V, kips	500		400		300	
S _x , In. ³	259		218		150 **		S _x , In. ³	236		199		145 **	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support


$F_y=50$



SAW

Nominal Size		20 x 12		Nominal Size		18 x 12						
Wall Thickness		5/8	Δ Inches	Wall Thickness		5/8	1/2	Δ Inches	3/8	Δ Inches		
Weight Per Foot		123.72		Weight Per Foot		115.21	95.03		72.59			
Design Wall Thickness		0.625		Design Wall Thickness		0.625	0.500		0.375			
Span in Feet	4	1000	0.03	Span in Feet	3	900		0.02				
	5	832	0.04		4	886	720	0.03	540	0.03		
	6	693	0.06		5	708	607	0.05	432	0.04		
	7	594	0.08		6	590	506	0.07	360	0.06		
	8	520	0.11		7	506	434	0.09	309	0.08		
	9	462	0.14		8	443	380	0.12	270	0.11		
	10	416	0.17		9	394	337	0.15	240	0.14		
	11	378	0.21		10	354	304	0.19	216	0.17		
	12	347	0.25		11	322	276	0.23	196	0.21		
	13	320	0.29		12	295	253	0.27	180	0.25		
	14	297	0.33		13	272	234	0.32	166	0.29		
	15	277	0.38		14	253	217	0.37	154	0.34		
	16	260	0.44		15	236	202	0.43	144	0.39		
	17	245	0.49		16	221	190	0.49	135	0.44		
	18	231	0.55		17	208	179	0.55	127	0.50		
	19	219	0.62		18	197	169	0.61	120	0.56		
	20	208	0.68		19	186	160	0.68	114	0.62		
	21	198	0.75		20	177	152	0.76	108	0.69		
	22	189	0.83		21	169	145	0.84	103	0.76		
	23	181	0.90		22	161	138	0.92	98	0.83		
	24	173	0.98		23	154	132	1.00	94	0.91		
	25	166	1.07		24	148	127	1.09	90	0.99		
	26	160	1.15		25	142	121	1.19	—	—		
	27	154	1.24		26	136	117	1.28	86	1.08		
	28	149	1.34		27	131	112	1.38	83	1.17		
	30	139	1.54		28	127	108	1.49	80	1.26		
	32	130	1.75		30	118	101	1.71	77	1.35		
	34	122	1.97		32	111	95	1.94	72	1.55		
	38	109	2.46		34	101	86	1.77	68	1.77		
	42	99	3.01		36	98	84	2.46	64	1.99		
		90	2.74		38	89	77	2.23	60	2.23		
						85	73	2.49	57	2.49		
	WEB SHEAR AND PROPERTY VALUES											
	V, kips	500			V, kips	450	360		270			
	S _x , In. ³	189			S _x , In. ³	161	138		108			


Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.
 Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.



HSS Beam Load Tables Rectangular Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



Nominal Size		16 x 12		Nominal Size		14 x 12			
Wall Thickness		5/8	Δ Inches	Wall Thickness		1/2	Δ Inches	3/8	Δ Inches
Weight Per Foot		106.71		Weight Per Foot		81.42		62.39	
Design Wall Thickness		0.625		Design Wall Thickness		0.500		0.375	
Span in Feet	3	800	0.02	Span in Feet	3	560	0.02	420	0.02
	4	748	0.03		4	533	0.04	382	0.04
	5	598	0.05		5	426	0.06	305	0.06
	6	499	0.08		6	355	0.09	254	0.08
	7	427	0.10		7	305	0.12	218	0.11
	8	374	0.14		8	266	0.16	191	0.14
	9	332	0.17		9	237	0.20	170	0.18
	10	299	0.21		10	213	0.24	153	0.22
	11	272	0.26		11	194	0.30	139	0.27
	12	249	0.31		12	178	0.35	127	0.32
	13	230	0.36		13	164	0.41	117	0.37
	14	214	0.42		14	152	0.48	109	0.43
	15	199	0.48		15	142	0.55	102	0.50
	16	187	0.55		16	133	0.62	95	0.57
	17	176	0.62		17	125	0.70	90	0.64
	18	166	0.69		18	118	0.79	85	0.72
	19	157	0.77		19	112	0.88	80	0.80
	20	150	0.85		20	107	0.98	76	0.89
	21	142	0.94		21	102	1.08	73	0.98
	22	136	1.03		22	97	1.18	69	1.07
	23	130	1.13		23	93	1.29	66	1.17
	24	125	1.23		24	89	1.40	64	1.28
	25	120	1.33		25	85	1.52	—	—
		109	1.21			78	1.39	61	1.39
	26	115	1.44		26	82	1.65	—	—
		105	1.31			75	1.50	59	1.50
	27	111	1.56		27	79	1.78	—	—
		101	1.41			72	1.62	57	1.62
	28	107	1.67		28	76	1.91	—	—
		97	1.52			69	1.74	55	1.74
	30	100	1.92		29	74	2.05	—	—
		91	1.75			67	1.86	53	1.86
	32	94	2.18		30	71	2.19	—	—
		85	1.99			65	2.00	51	2.00
34	88	2.47							
	80	2.24							
WEB SHEAR AND PROPERTY VALUES									
V, kips	400		V, kips	280		210			
S _x , In. ³	136		S _x , In. ³	96.9		76.3			


Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.
 Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



Nominal Size		32 x 32						Nominal Size		30 x 30					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		259.83	Inches	210.72	Inches	159.37	Inches	Weight Per Foot		242.82	Inches	197.11	Inches	149.16	Inches
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*	
Span in Feet	6					960	0.02	Span in Feet	6					900	0.03
	7			1280	0.04	954	0.03		7	1500	0.04	1200	0.04	860	0.04
	8	1600	0.05	1240	0.05	835	0.04		8	1490	0.06	1110	0.05	753	0.05
	9	1480	0.07	1100	0.06	742	0.05		9	1330	0.07	989	0.07	669	0.06
	10	1330	0.08	990	0.08	668	0.07		10	1190	0.09	890	0.08	602	0.07
	11	1210	0.10	900	0.09	607	0.08		11	1090	0.11	809	0.10	547	0.09
	12	1110	0.12	825	0.11	557	0.10		12	995	0.13	742	0.12	502	0.11
	13	1020	0.14	762	0.13	514	0.11		13	918	0.16	685	0.14	463	0.12
	14	949	0.16	707	0.15	477	0.13		14	853	0.18	636	0.16	430	0.14
	15	885	0.19	660	0.17	445	0.15		15	796	0.21	593	0.19	401	0.16
	16	830	0.21	619	0.19	418	0.17		16	746	0.23	556	0.21	376	0.19
	17	781	0.24	582	0.22	393	0.19		17	702	0.27	524	0.24	354	0.21
	18	738	0.27	550	0.25	371	0.22		18	663	0.30	494	0.27	334	0.24
	19	699	0.30	521	0.27	352	0.24		19	628	0.33	468	0.30	317	0.26
	20	664	0.34	495	0.30	334	0.27		20	597	0.37	445	0.33	301	0.29
	21	632	0.37	471	0.34	318	0.29		21	569	0.40	424	0.37	287	0.32
	22	604	0.41	450	0.37	304	0.32		22	543	0.44	405	0.40	274	0.35
	23	577	0.44	430	0.40	290	0.35		23	519	0.49	387	0.44	262	0.39
	24	553	0.48	413	0.44	278	0.39		24	498	0.53	371	0.48	251	0.42
	25	531	0.52	396	0.48	267	0.42		25	478	0.57	356	0.52	241	0.46
	26	511	0.57	381	0.51	257	0.45		26	459	0.62	342	0.56	232	0.50
	27	492	0.61	367	0.55	247	0.49		27	442	0.67	330	0.61	223	0.53
	28	474	0.66	354	0.60	239	0.52		28	426	0.72	318	0.65	215	0.57
	29	458	0.70	341	0.64	230	0.56		29	412	0.77	307	0.70	208	0.62
	30	443	0.75	330	0.68	223	0.60		30	398	0.83	297	0.75	201	0.66
	32	415	0.86	309	0.78	209	0.68		32	373	0.94	278	0.85	188	0.75
	34	391	0.97	291	0.88	196	0.77		34	351	1.06	262	0.96	177	0.85
	36	369	1.09	275	0.99	186	0.87		36	332	1.19	247	1.08	167	0.95
	38	349	1.21	261	1.10	176	0.97		38	314	1.32	234	1.20	158	1.06
	40	332	1.34	248	1.22	167	1.07		40	299	1.47	223	1.33	151	1.17
	42	316	1.48	236	1.34	159	1.18		42	284	1.62	212	1.46	143	1.29
	44	302	1.62	225	1.47	152	1.29		44	271	1.78	202	1.61	137	1.42
46	289	1.77	215	1.61	145	1.42	46	260	1.94	193	1.76	131	1.55		
48	277	1.93	206	1.75	139	1.54	48	249	2.11	185	1.91	125	1.69		
50	266	2.09	198	1.90	134	1.67	50	239	2.29	178	2.07	120	1.83		
52	255	2.27	190	2.06	128	1.81	52	230	2.48	171	2.24	116	1.98		
56	237	2.63	177	2.38	119	2.10	56	213	2.88	159	2.60	108	2.30		
60	221	3.02	165	2.74	111	2.41	60	199	3.30	148	2.99	100	2.64		
64	208	3.43	155	3.12	104	2.74	64	187	3.76	139	3.40	94	3.00		
68	195	3.87	146	3.52	98	3.09									
WEB SHEAR AND PROPERTY VALUES															
V, kips	800		640		480		V, kips	750		600		450			
S _x , in. ³	664**		495**		334**		S _x , in. ³	597**		445**		301**			

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



SAW

Nominal Size		28 x 28						Nominal Size		26 x 26							
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ		
Weight Per Foot		225.80	Inches	183.50	Inches	138.95	Inches	Weight Per Foot		208.79	Inches	169.89	Inches	128.74	Inches		
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625*		0.500*		0.375*			
Span in Feet	6					840	0.03	Span in Feet	6					1040	0.04	780	0.03
	7	1400	0.05	1120	0.04	769	0.04		7	1300	0.06	1010	0.05	680	0.04	680	0.04
	8	1330	0.06	995	0.06	673	0.05		8	1180	0.07	880	0.07	595	0.06	595	0.06
	9	1180	0.08	884	0.07	598	0.07		9	1040	0.09	782	0.08	529	0.07	529	0.07
	10	1060	0.10	796	0.09	538	0.08		10	940	0.11	704	0.10	476	0.09	476	0.09
	11	967	0.12	724	0.11	489	0.10		11	855	0.14	640	0.12	433	0.11	433	0.11
	12	887	0.15	663	0.13	448	0.12		12	783	0.16	587	0.15	397	0.13	397	0.13
	13	818	0.17	612	0.16	414	0.14		13	723	0.19	542	0.17	366	0.15	366	0.15
	14	760	0.20	569	0.18	384	0.16		14	671	0.22	503	0.20	340	0.18	340	0.18
	15	709	0.23	531	0.21	359	0.18		15	627	0.25	469	0.23	317	0.20	317	0.20
	16	665	0.26	498	0.23	336	0.21		16	588	0.29	440	0.26	298	0.23	298	0.23
	17	626	0.29	468	0.27	316	0.23		17	553	0.33	414	0.30	280	0.26	280	0.26
	18	591	0.33	442	0.30	299	0.26		18	522	0.37	391	0.33	264	0.29	264	0.29
	19	560	0.37	419	0.33	283	0.29		19	495	0.41	371	0.37	251	0.32	251	0.32
	20	532	0.41	398	0.37	269	0.32		20	470	0.45	352	0.41	238	0.36	238	0.36
	21	507	0.45	379	0.40	256	0.36		21	448	0.50	335	0.45	227	0.40	227	0.40
	22	484	0.49	362	0.44	245	0.39		22	427	0.55	320	0.49	216	0.43	216	0.43
	23	463	0.54	346	0.49	234	0.43		23	409	0.60	306	0.54	207	0.48	207	0.48
	24	443	0.58	332	0.53	224	0.47		24	392	0.65	293	0.59	198	0.52	198	0.52
	25	426	0.63	318	0.57	215	0.51		25	376	0.71	282	0.64	190	0.56	190	0.56
	26	409	0.69	306	0.62	207	0.55		26	362	0.76	271	0.69	183	0.61	183	0.61
	27	394	0.74	295	0.67	199	0.59		27	348	0.82	261	0.74	176	0.66	176	0.66
	28	380	0.80	284	0.72	192	0.64		28	336	0.89	251	0.80	170	0.70	170	0.70
	29	367	0.85	274	0.77	186	0.68		29	324	0.95	243	0.86	164	0.76	164	0.76
	30	355	0.91	265	0.83	179	0.73		30	313	1.02	235	0.92	159	0.81	159	0.81
	32	333	1.04	249	0.94	168	0.83		32	294	1.16	220	1.05	149	0.92	149	0.92
	34	313	1.17	234	1.06	158	0.94		34	276	1.31	207	1.18	140	1.04	140	1.04
	36	296	1.31	221	1.19	149	1.05		36	261	1.46	196	1.32	132	1.16	132	1.16
	38	280	1.46	209	1.33	142	1.17		38	247	1.63	185	1.47	125	1.30	125	1.30
	40	266	1.62	199	1.47	135	1.30		40	235	1.81	176	1.63	119	1.44	119	1.44
42	253	1.79	190	1.62	128	1.43	42	224	1.99	168	1.80	113	1.59	113	1.59		
44	242	1.96	181	1.78	122	1.57	44	214	2.19	160	1.98	108	1.74	108	1.74		
46	231	2.15	173	1.94	117	1.72	46	204	2.39	153	2.16	103	1.90	103	1.90		
48	222	2.34	166	2.11	112	1.87	48	196	2.60	147	2.35	99	2.07	99	2.07		
50	213	2.54	159	2.29	108	2.03	50	188	2.82	141	2.55	95	2.25	95	2.25		
52	205	2.74	153	2.48	103	2.19	52	181	3.05	135	2.76	92	2.43	92	2.43		
54	197	2.96	147	2.68	100	2.36	54	174	3.29	130	2.98	88	2.62	88	2.62		
56	190	3.18	142	2.88	96	2.54	56	171	3.42	128	3.09	87	2.72	87	2.72		
58	183	3.41	137	3.09	93	2.73											
60	177	3.65	133	3.30	90	2.92											
WEB SHEAR AND PROPERTY VALUES																	
V, kips	700		560		420		V, kips	650		520		390					
S _x , In. ³	532**		398**		269**		S _x , In. ³	470**		352**		238**					

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

Fy=50



Nominal Size		24 x 24						Nominal Size		22 x 22							
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ		
Weight Per Foot		191.78	Inches	156.28	Inches	118.53	Inches	Weight Per Foot		174.76	Inches	142.67	Inches	108.32	Inches		
Design Wall Thickness		0.625*		0.500*		0.375*		Design Wall Thickness		0.625		0.500*		0.375*			
Span in Feet	5					<u>720</u>	0.03	Span in Feet	5						<u>660</u>	0.03	
	6	<u>1200</u>	0.05	<u>960</u>	0.04	<u>697</u>	0.04		6	<u>1100</u>	0.05	<u>880</u>	0.05	<u>603</u>	0.04	603	0.04
	7	1170	0.06	883	0.06	597	0.05		7	991	0.07	763	0.06	517	0.06	517	0.06
	8	1030	0.08	773	0.07	523	0.06		8	868	0.09	668	0.08	453	0.07	453	0.07
	9	911	0.10	687	0.09	464	0.08		9	771	0.11	593	0.11	402	0.09	402	0.09
	10	820	0.13	618	0.11	418	0.10		10	694	0.14	534	0.13	362	0.11	362	0.11
	11	745	0.15	562	0.14	380	0.12		11	631	0.17	485	0.16	329	0.14	329	0.14
	12	683	0.18	515	0.17	348	0.15		12	578	0.20	445	0.19	302	0.16	302	0.16
	13	631	0.21	475	0.19	322	0.17		13	534	0.24	411	0.22	278	0.19	278	0.19
	14	586	0.25	441	0.23	299	0.20		14	496	0.28	381	0.25	259	0.22	259	0.22
	15	547	0.28	412	0.26	279	0.23		15	463	0.32	356	0.29	241	0.26	241	0.26
	16	513	0.32	386	0.29	261	0.26		16	434	0.36	334	0.33	226	0.29	226	0.29
	17	482	0.37	364	0.33	246	0.29		17	408	0.41	314	0.38	213	0.33	213	0.33
	18	456	0.41	343	0.37	232	0.33		18	386	0.46	297	0.42	201	0.37	201	0.37
	19	432	0.46	325	0.42	220	0.36		19	365	0.51	281	0.47	191	0.41	191	0.41
	20	410	0.51	309	0.46	209	0.40		20	347	0.56	267	0.52	181	0.46	181	0.46
	21	390	0.56	294	0.51	199	0.45		21	330	0.62	254	0.57	172	0.50	172	0.50
	22	373	0.61	281	0.56	190	0.49		22	315	0.68	243	0.63	165	0.55	165	0.55
	23	357	0.67	269	0.61	182	0.53		23	302	0.75	232	0.69	157	0.60	157	0.60
	24	342	0.73	258	0.66	174	0.58		24	289	0.81	223	0.75	151	0.66	151	0.66
	25	328	0.79	247	0.72	167	0.63		25	278	0.88	214	0.81	145	0.71	145	0.71
	26	315	0.86	238	0.78	161	0.68		26	267	0.95	205	0.88	139	0.77	139	0.77
	27	304	0.92	229	0.84	155	0.74		27	257	1.03	198	0.95	134	0.83	134	0.83
	28	293	0.99	221	0.90	149	0.79		28	248	1.11	191	1.02	129	0.90	129	0.90
	29	283	1.06	213	0.97	144	0.85		29	239	1.19	184	1.09	125	0.96	125	0.96
	30	273	1.14	206	1.03	139	0.91		30	231	1.27	178	1.17	121	1.03	121	1.03
	32	256	1.30	193	1.18	131	1.03		32	217	1.44	167	1.33	113	1.17	113	1.17
	34	241	1.46	182	1.33	123	1.17		34	204	1.63	157	1.50	106	1.32	106	1.32
	36	228	1.64	172	1.49	116	1.31		36	193	1.83	148	1.68	101	1.48	101	1.48
	38	216	1.83	163	1.66	110	1.46		38	183	2.04	141	1.88	95	1.65	95	1.65
	40	205	2.02	155	1.84	105	1.62		40	174	2.26	134	2.08	91	1.83	91	1.83
42	195	2.23	147	2.03	100	1.78	42	165	2.49	127	2.29	86	2.01	86	2.01		
44	186	2.45	140	2.23	95	1.96	44	158	2.73	121	2.51	82	2.21	82	2.21		
46	178	2.68	134	2.43	91	2.14	46	151	2.98	116	2.75	79	2.42	79	2.42		
48	171	2.91	129	2.65	87	2.33	48	148	3.12	114	2.87	77	2.52	77	2.52		
50	164	3.16	124	2.87	84	2.53											
51	161	3.29	121	2.99	82	2.63											
WEB SHEAR AND PROPERTY VALUES																	
V, kips	600		480		360		V, kips	550		440		330					
S _x , in. ³	410**		309**		209**		S _x , in. ³	347		267**		181**					

Loads above heavy horizontal line based upon maximum shear stress, F_v , equal to $0.40 F_y$.

Loads in shaded area based upon maximum allowable bending stress, F_b , equal to $0.60 F_y$.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of $238/\sqrt{F_y}$.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables Square Structural Steel Tubing

Total Allowable Uniform Load in Kips for Beams with Lateral Support

F_y=50



Nominal Size		20 x 20						Nominal Size		18 x 18					
Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ	Wall Thickness		5/8	Δ	1/2	Δ	3/8	Δ
Weight Per Foot		157.75	Inches	129.06	Inches	98.12	Inches	Weight Per Foot		140.73	Inches	115.45	Inches	87.91	Inches
Design Wall Thickness		0.625		0.500*		0.375*		Design Wall Thickness		0.625		0.500		0.375*	
Span in Feet	5	1000	0.04	800	0.04	600	0.03	Span in Feet	4					540	0.02
	6	943	0.06	760	0.05	517	0.05		5	900	0.05	720	0.04	520	0.04
	7	809	0.08	651	0.07	443	0.06		6	821	0.07	630	0.06	433	0.06
	8	708	0.10	570	0.10	388	0.08		7	704	0.09	540	0.08	371	0.07
	9	629	0.13	507	0.12	344	0.11		8	616	0.12	473	0.11	325	0.10
	10	566	0.16	456	0.15	310	0.13		9	548	0.15	420	0.14	289	0.12
	11	515	0.19	415	0.18	282	0.16		10	493	0.19	378	0.17	260	0.15
	12	472	0.22	380	0.21	258	0.19		11	448	0.23	344	0.21	236	0.18
	13	435	0.26	351	0.25	238	0.22		12	411	0.27	315	0.25	217	0.22
	14	404	0.30	326	0.29	221	0.26		13	379	0.32	291	0.29	200	0.26
	15	377	0.35	304	0.34	207	0.30		14	352	0.37	270	0.34	186	0.30
	16	354	0.40	285	0.38	194	0.34		15	329	0.43	252	0.39	173	0.34
	17	333	0.45	268	0.43	182	0.38		16	308	0.49	236	0.44	163	0.39
	18	314	0.50	253	0.48	172	0.43		17	290	0.55	222	0.50	153	0.44
	19	298	0.56	240	0.54	163	0.47		18	274	0.61	210	0.56	144	0.50
	20	283	0.62	228	0.60	155	0.53		19	259	0.68	199	0.62	137	0.55
	21	270	0.68	217	0.66	148	0.58		20	246	0.76	189	0.69	130	0.61
	22	257	0.75	207	0.72	141	0.64		21	235	0.84	180	0.76	124	0.67
	23	246	0.82	198	0.79	135	0.70		22	224	0.92	172	0.83	118	0.74
	24	236	0.89	190	0.86	129	0.76		23	214	1.00	164	0.91	113	0.81
	25	226	0.97	182	0.93	124	0.82		24	205	1.09	158	0.99	108	0.88
	26	218	1.05	175	1.01	119	0.89		25	197	1.19	151	1.08	104	0.96
	27	210	1.13	169	1.09	115	0.96		26	190	1.28	145	1.17	100	1.03
	28	202	1.22	163	1.17	111	1.03		27	183	1.38	140	1.26	96	1.11
	29	195	1.31	157	1.26	107	1.11		28	176	1.49	135	1.35	93	1.20
	30	189	1.40	152	1.34	103	1.18		29	170	1.60	130	1.45	90	1.29
	31	183	1.49	147	1.43	100	1.26		30	164	1.71	126	1.55	87	1.38
	32	177	1.59	143	1.53	97	1.35		31	159	1.82	122	1.66	84	1.47
	33	172	1.69	138	1.63	94	1.43		32	154	1.94	118	1.77	81	1.56
	34	166	1.79	134	1.73	91	1.52		33	149	2.07	115	1.88	79	1.66
	35	162	1.90	130	1.83	89	1.61		34	145	2.19	111	1.99	76	1.77
	36	157	2.01	127	1.93	86	1.70		35	141	2.32	108	2.11	74	1.87
	37	153	2.12	123	2.04	84	1.80		36	137	2.46	105	2.23	72	1.98
	38	149	2.24	120	2.16	82	1.90		37	133	2.60	—	—	—	—
	39	145	2.36	117	2.27	79	2.00			121	2.36	102	2.36	70	2.09
	40	142	2.48	114	2.39	78	2.10		38	130	2.74	—	—	—	—
	41	138	2.61	111	2.51	76	2.21			118	2.49	99	2.49	68	2.21
	42	135	2.74	109	2.63	74	2.32								


WEB SHEAR AND PROPERTY VALUES													
V, kips	500		400		300		V, kips	450		360		270	
S _x , In. ³	283		228**		155**		S _x , In. ³	224		189		130**	

Loads above heavy horizontal line based upon maximum shear stress, F_v, equal to 0.40 F_y.

Loads in shaded area based upon maximum allowable bending stress, F_b, equal to 0.60 F_y.

* Slender element section. Width-thickness ratio exceeds AISC "Specification" Section B5.1 limiting value of 238/√F_y.


** Modified value of section modulus calculated in accordance with AISC "Specification" Appendix Section B5.2.b.



HSS Beam Load Tables / Structural Steel Tubing

Notes

A large, empty rectangular box with a green border, intended for notes or additional information.



HSS Beam Load Tables / Structural Steel Tubing


Midspan Deflections

In Inches - Simple Span - Uniformly Distributed Load

		Depth - in inches																
		32	30	28	26	24	22	20	18	16	14	12	10	9	8	7	6	5 1/2
Span in Feet	2	0.004	0.004	0.004	0.004	0.005	0.005	0.006	0.006	0.007	0.008	0.010	0.011	0.013	0.014	0.016	0.019	0.021
	3	0.008	0.009	0.009	0.010	0.011	0.012	0.013	0.014	0.016	0.018	0.021	0.026	0.029	0.032	0.037	0.043	0.047
	4	0.014	0.015	0.016	0.018	0.019	0.021	0.023	0.025	0.029	0.033	0.038	0.046	0.051	0.057	0.065	0.076	0.083
	5	0.022	0.024	0.025	0.027	0.030	0.032	0.036	0.040	0.045	0.051	0.059	0.071	0.079	0.089	0.102	0.119	0.130
	6	0.032	0.034	0.037	0.040	0.043	0.047	0.051	0.057	0.064	0.073	0.086	0.103	0.114	0.128	0.147	0.171	0.187
	7	0.044	0.047	0.050	0.054	0.058	0.064	0.070	0.078	0.087	0.100	0.117	0.140	0.155	0.175	0.200	0.233	0.254
	8	0.057	0.061	0.065	0.070	0.076	0.083	0.091	0.102	0.114	0.131	0.152	0.183	0.203	0.228	0.261	0.305	0.332
	9	0.072	0.077	0.083	0.089	0.096	0.105	0.116	0.128	0.145	0.165	0.193	0.231	0.257	0.289	0.330	0.385	0.420
	10	0.089	0.095	0.102	0.110	0.119	0.130	0.143	0.159	0.178	0.204	0.238	0.286	0.317	0.357	0.408	0.476	0.519
	11	0.108	0.115	0.123	0.133	0.144	0.157	0.173	0.192	0.216	0.247	0.288	0.345	0.384	0.432	0.494	0.576	0.628
	12	0.128	0.137	0.147	0.158	0.171	0.187	0.206	0.228	0.257	0.294	0.343	0.411	0.457	0.514	0.587	0.685	0.748
	13	0.151	0.161	0.172	0.186	0.201	0.219	0.241	0.268	0.302	0.345	0.402	0.483	0.536	0.603	0.689	0.804	
	14	0.175	0.187	0.200	0.215	0.233	0.254	0.280	0.311	0.350	0.400	0.466	0.560	0.622	0.700	0.799	0.933	
	15	0.201	0.214	0.229	0.247	0.268	0.292	0.321	0.357	0.402	0.459	0.535	0.642	0.714	0.803	0.918		
	16	0.228	0.244	0.261	0.281	0.305	0.332	0.365	0.406	0.457	0.522	0.609	0.731	0.812	0.914	1.044		
	17	0.258	0.275	0.295	0.317	0.344	0.375	0.413	0.458	0.516	0.589	0.688	0.825	0.917	1.031			
	18	0.289	0.308	0.330	0.356	0.385	0.420	0.463	0.514	0.578	0.661	0.771	0.925	1.028	1.156			
	19	0.322	0.344	0.368	0.396	0.429	0.469	0.515	0.573	0.644	0.736	0.859	1.031	1.145				
	20	0.357	0.381	0.408	0.439	0.476	0.519	0.571	0.634	0.714	0.816	0.952	1.142	1.269				
	21	0.393	0.420	0.450	0.484	0.525	0.572	0.630	0.700	0.787	0.899	1.049	1.259	1.399				
	22	0.432	0.461	0.494	0.532	0.576	0.628	0.691	0.768	0.864	0.987	1.152	1.382					
	23	0.472	0.503	0.539	0.581	0.629	0.687	0.755	0.839	0.944	1.079	1.259	1.510					
	24	0.514	0.548	0.587	0.633	0.685	0.748	0.822	0.914	1.028	1.175	1.370						
	25	0.558	0.595	0.637	0.686	0.744	0.811	0.892	0.991	1.115	1.275	1.487						
	26	0.603	0.643	0.689	0.742	0.804	0.877	0.965	1.072	1.206	1.379	1.608						
	27	0.650	0.694	0.743	0.801	0.867	0.946	1.041	1.156	1.301	1.487	1.735						
	28	0.700	0.746	0.799	0.861	0.933	1.017	1.119	1.244	1.399	1.599	1.865						
	29	0.750	0.800	0.858	0.924	1.001	1.091	1.201	1.334	1.501	1.715							
	30	0.803	0.857	0.918	0.988	1.071	1.168	1.285	1.428	1.606	1.835							
	31	0.857	0.915	0.980	1.055	1.143	1.247	1.372	1.524	1.715	1.960							
	32	0.914	0.975	1.044	1.124	1.218	1.329	1.462	1.624	1.827	2.088							
	33	0.972	1.036	1.110	1.196	1.296	1.413	1.555	1.727	1.943								
	34	1.031	1.100	1.179	1.269	1.375	1.500	1.650	1.834	2.063								
	35	1.093	1.166	1.249	1.345	1.457	1.590	1.749	1.943	2.186								
	36	1.156	1.233	1.322	1.423	1.542	1.682	1.850	2.056	2.313								
	37	1.221	1.303	1.396	1.503	1.629	1.777	1.954	2.172	2.443								
	38	1.288	1.374	1.472	1.586	1.718	1.874	2.061	2.290									
	39	1.357	1.448	1.551	1.670	1.809	1.974	2.171	2.413									
	40	1.428	1.523	1.632	1.757	1.903	2.076	2.284	2.538									
	41	1.500	1.600	1.714	1.846	2.000	2.182	2.400	2.666									
	42	1.574	1.679	1.799	1.937	2.099	2.289	2.518	2.798									
	43	1.650	1.760	1.885	2.030	2.200	2.400	2.640										
	44	1.727	1.843	1.974	2.126	2.303	2.513	2.764										
	45	1.807	1.927	2.065	2.224	2.409	2.628	2.891										
	46	1.888	2.014	2.158	2.324	2.517	2.746	3.021										
	47	1.971	2.102	2.253	2.426	2.628	2.867											
	48	2.056	2.193	2.349	2.530	2.741	2.990											
	49	2.142	2.285	2.448	2.637	2.856	3.116											
	50	2.231	2.379	2.549	2.745	2.974	3.245											
	51	2.321	2.475	2.652	2.856	3.094	3.376											
	52	2.413	2.573	2.757	2.969	3.217												
	53	2.506	2.673	2.864	3.085	3.342												
	54	2.602	2.775	2.973	3.202	3.469												
	55	2.699	2.879	3.085	3.322	3.599												
	56	2.798	2.985	3.198	3.444	3.731												
	57	2.899	3.092	3.313	3.568													
	58	3.002	3.202	3.430	3.694													
	59	3.106	3.313	3.550	3.823													
	60	3.212	3.426	3.671	3.953													
	61	3.320	3.541	3.794														
	62	3.430	3.658	3.920														
	63	3.541	3.777	4.047														
	64	3.655	3.898	4.177														
	65	3.770	4.021	4.308														
	66	3.887	4.146															
	67	4.005	4.272															
	68	4.126	4.401															
	69	4.248	4.531															
	70	4.372	4.663															
	71	4.498																
	72	4.625																
	73	4.755																
	74	4.886																

$F_b = 27.6 \text{ ksi}$

		Depth - in inches											
		5	4 1/2	4	3 1/2	3	2 1/2	2 1/4	2	1 3/4	1 5/8	1 1/2	1 1/4
Span in Feet	2	0.023	0.025	0.029	0.033	0.038	0.046	0.051	0.057	0.065	0.070	0.076	0.091
	3	0.051	0.057	0.064	0.073	0.086	0.103	0.114	0.128	0.147	0.158	0.171	
	4	0.091	0.102	0.114	0.131	0.152	0.183	0.203	0.228	0.261			
	5	0.143	0.159	0.178	0.204	0.238	0.286	0.317					
	6	0.206	0.228	0.257	0.294	0.343							
	7	0.280	0.311	0.350	0.400	0.466							
	8	0.365	0.406	0.457	0.522								
	9	0.463	0.514	0.578									
	10	0.571	0.634										
	11	0.691											




HSS Beam Load Tables / Structural Steel Tubing Midspan Deflections

In Inches - Simple Span - Uniformly Distributed Load

Span in Feet	Depth - in inches																
	32	30	28	26	24	22	20	18	16	14	12	10	9	8	7	6	5 1/2
2	0.004	0.004	0.004	0.005	0.005	0.006	0.006	0.007	0.008	0.009	0.010	0.012	0.014	0.016	0.018	0.021	0.023
3	0.009	0.009	0.010	0.011	0.012	0.013	0.014	0.016	0.017	0.020	0.023	0.028	0.031	0.035	0.040	0.047	0.051
4	0.016	0.017	0.018	0.019	0.021	0.023	0.025	0.028	0.031	0.035	0.041	0.050	0.055	0.062	0.071	0.083	0.090
5	0.024	0.026	0.028	0.030	0.032	0.035	0.039	0.043	0.048	0.055	0.065	0.078	0.086	0.097	0.111	0.129	0.141
6	0.035	0.037	0.040	0.043	0.047	0.051	0.056	0.062	0.070	0.080	0.093	0.112	0.124	0.140	0.160	0.186	0.203
7	0.048	0.051	0.054	0.058	0.063	0.069	0.076	0.084	0.095	0.109	0.127	0.152	0.169	0.190	0.217	0.253	0.276
8	0.062	0.066	0.071	0.076	0.083	0.090	0.099	0.110	0.124	0.142	0.166	0.199	0.221	0.248	0.284	0.331	0.361
9	0.079	0.084	0.090	0.097	0.105	0.114	0.126	0.140	0.157	0.180	0.209	0.251	0.279	0.314	0.359	0.419	0.457
10	0.097	0.103	0.111	0.119	0.129	0.141	0.155	0.172	0.194	0.222	0.259	0.310	0.345	0.388	0.443	0.517	0.564
11	0.117	0.125	0.134	0.144	0.156	0.171	0.188	0.209	0.235	0.268	0.313	0.376	0.417	0.469	0.536	0.626	0.683
12	0.140	0.149	0.160	0.172	0.186	0.203	0.223	0.248	0.279	0.319	0.372	0.447	0.497	0.559	0.638	0.745	
13	0.164	0.175	0.187	0.202	0.219	0.238	0.262	0.291	0.328	0.375	0.437	0.524	0.583	0.656	0.749		
14	0.190	0.203	0.217	0.234	0.253	0.276	0.304	0.338	0.380	0.434	0.507	0.608	0.676	0.760	0.869		
15	0.218	0.233	0.249	0.269	0.291	0.317	0.349	0.388	0.436	0.499	0.582	0.698	0.776	0.873	0.998		
16	0.248	0.265	0.284	0.306	0.331	0.361	0.397	0.441	0.497	0.567	0.662	0.794	0.883	0.993			
17	0.280	0.299	0.320	0.345	0.374	0.408	0.448	0.498	0.561	0.641	0.747	0.897	0.997	1.121			
18	0.314	0.335	0.359	0.387	0.419	0.457	0.503	0.559	0.628	0.718	0.838	1.006	1.117				
19	0.350	0.373	0.400	0.431	0.467	0.509	0.560	0.622	0.700	0.800	0.934	1.120	1.245				
20	0.388	0.414	0.443	0.477	0.517	0.564	0.621	0.690	0.776	0.887	1.034	1.241					
21	0.428	0.456	0.489	0.526	0.570	0.622	0.684	0.760	0.855	0.978	1.141	1.369					
22	0.469	0.501	0.536	0.578	0.626	0.683	0.751	0.834	0.939	1.073	1.252						
23	0.513	0.547	0.586	0.631	0.684	0.746	0.821	0.912	1.026	1.173	1.368						
24	0.559	0.596	0.638	0.688	0.745	0.813	0.894	0.993	1.117	1.277	1.490						
25	0.606	0.647	0.693	0.746	0.808	0.882	0.970	1.078	1.212	1.385	1.616						
26	0.656	0.699	0.749	0.807	0.874	0.954	1.049	1.166	1.311	1.499							
27	0.707	0.754	0.808	0.870	0.943	1.028	1.131	1.257	1.414	1.616							
28	0.760	0.811	0.869	0.936	1.014	1.106	1.217	1.352	1.521	1.738							
29	0.816	0.870	0.932	1.004	1.088	1.186	1.305	1.450	1.631	1.864							
30	0.873	0.931	0.998	1.074	1.164	1.270	1.397	1.552	1.746	1.995							
31	0.932	0.994	1.065	1.147	1.243	1.356	1.491	1.657	1.864								
32	0.993	1.059	1.135	1.222	1.324	1.445	1.589	1.766	1.986								
33	1.056	1.127	1.207	1.300	1.408	1.536	1.690	1.878	2.112								
34	1.121	1.196	1.281	1.380	1.495	1.631	1.794	1.993	2.242								
35	1.188	1.267	1.358	1.462	1.584	1.728	1.901	2.112									
36	1.257	1.341	1.436	1.547	1.676	1.828	2.011	2.234									
37	1.328	1.416	1.517	1.634	1.770	1.931	2.124	2.360									
38	1.400	1.494	1.600	1.724	1.867	2.037	2.241	2.490									
39	1.475	1.573	1.686	1.816	1.967	2.146	2.360										
40	1.552	1.655	1.773	1.910	2.069	2.257	2.483										
41	1.630	1.739	1.863	2.006	2.174	2.371	2.608										
42	1.711	1.825	1.955	2.106	2.281	2.488	2.737										
43	1.793	1.913	2.049	2.207	2.391	2.608											
44	1.878	2.003	2.146	2.311	2.503	2.731											
45	1.964	2.095	2.244	2.417	2.619	2.857											
46	2.052	2.189	2.345	2.526	2.736	2.985											
47	2.142	2.285	2.448	2.637	2.856	3.116											
48	2.234	2.383	2.554	2.750	2.979												
49	2.329	2.484	2.661	2.866	3.105												
50	2.425	2.586	2.771	2.984	3.233												
51	2.523	2.691	2.883	3.105	3.363												
52	2.622	2.797	2.997	3.228													
53	2.724	2.906	3.113	3.353													
54	2.828	3.017	3.232	3.481													
55	2.934	3.129	3.353	3.611													
56	3.041	3.244	3.476														
57	3.151	3.361	3.601														
58	3.263	3.480	3.729														
59	3.376	3.601	3.858														
60	3.491	3.724	3.990														
61	3.609	3.849															
62	3.728	3.977															
63	3.849	4.106															
64	3.972	4.237															
65	4.098																
66	4.225																
67	4.354																
68	4.484																

$F_b = 30.0 \text{ ksi}$

Span in Feet	Depth - in inches											
	5	4 1/2	4	3 1/2	3	2 1/2	2 1/4	2	1 3/4	1 5/8	1 1/2	1 1/4
2	0.025	0.028	0.031	0.035	0.041	0.050	0.055	0.062	0.071	0.076	0.083	0.099
3	0.056	0.062	0.070	0.080	0.093	0.112	0.124	0.140	0.160	0.172	0.186	
4	0.099	0.110	0.124	0.142	0.166	0.199	0.221	0.248				
5	0.155	0.172	0.194	0.222	0.259	0.310						
6	0.223	0.248	0.279	0.319	0.372							
7	0.304	0.338	0.380	0.434								
8	0.397	0.441	0.497									
9	0.503	0.559										
10	0.621											



HSS Beam Load Tables / Structural Steel Tubing


Midspan Deflections

In Inches - Simple Span - Uniformly Distributed Load


		Depth - in inches																
		32	30	28	26	24	22	20	18	16	14	12	10	9	8	7	6	5 1/2
Span in Feet	2	0.004	0.005	0.005	0.005	0.006	0.006	0.007	0.008	0.009	0.010	0.011	0.014	0.015	0.017	0.020	0.023	0.025
	3	0.010	0.010	0.011	0.012	0.013	0.014	0.015	0.017	0.019	0.022	0.026	0.031	0.034	0.038	0.044	0.051	0.056
	4	0.017	0.018	0.020	0.021	0.023	0.025	0.027	0.030	0.034	0.039	0.046	0.055	0.061	0.068	0.078	0.091	0.099
	5	0.027	0.028	0.030	0.033	0.036	0.039	0.043	0.047	0.053	0.061	0.071	0.085	0.095	0.107	0.122	0.142	0.155
	6	0.038	0.041	0.044	0.047	0.051	0.056	0.061	0.068	0.077	0.088	0.102	0.123	0.137	0.154	0.176	0.205	0.223
	7	0.052	0.056	0.060	0.064	0.070	0.076	0.084	0.093	0.105	0.119	0.139	0.167	0.186	0.209	0.239	0.279	0.304
	8	0.068	0.073	0.078	0.084	0.091	0.099	0.109	0.121	0.137	0.156	0.182	0.218	0.243	0.273	0.312	0.364	0.397
	9	0.086	0.092	0.099	0.106	0.115	0.126	0.138	0.154	0.173	0.198	0.230	0.277	0.307	0.346	0.395	0.461	0.503
	10	0.107	0.114	0.122	0.131	0.142	0.155	0.171	0.190	0.213	0.244	0.284	0.341	0.379	0.427	0.488	0.569	0.621
	11	0.129	0.138	0.148	0.159	0.172	0.188	0.207	0.229	0.258	0.295	0.344	0.413	0.459	0.516	0.590	0.688	
	12	0.154	0.164	0.176	0.189	0.205	0.223	0.246	0.273	0.307	0.351	0.410	0.492	0.546	0.614	0.702		
	13	0.180	0.192	0.206	0.222	0.240	0.262	0.288	0.321	0.361	0.412	0.481	0.577	0.641	0.721	0.824		
	14	0.209	0.223	0.239	0.257	0.279	0.304	0.335	0.372	0.418	0.478	0.558	0.669	0.743	0.836			
	15	0.240	0.256	0.274	0.295	0.320	0.349	0.384	0.427	0.480	0.549	0.640	0.768	0.853	0.960			
	16	0.273	0.291	0.312	0.336	0.364	0.397	0.437	0.486	0.546	0.624	0.728	0.874	0.971				
	17	0.308	0.329	0.352	0.379	0.411	0.448	0.493	0.548	0.617	0.705	0.822	0.987	1.096				
	18	0.346	0.369	0.395	0.425	0.461	0.503	0.553	0.614	0.691	0.790	0.922	1.106					
	19	0.385	0.411	0.440	0.474	0.513	0.560	0.616	0.685	0.770	0.880	1.027	1.232					
	20	0.427	0.455	0.488	0.525	0.569	0.621	0.683	0.759	0.853	0.975	1.138						
	21	0.470	0.502	0.538	0.579	0.627	0.684	0.753	0.836	0.941	1.075	1.255						
	22	0.516	0.551	0.590	0.635	0.688	0.751	0.826	0.918	1.033	1.180	1.377						
	23	0.564	0.602	0.645	0.695	0.752	0.821	0.903	1.003	1.129	1.290	1.505						
	24	0.614	0.655	0.702	0.756	0.819	0.894	0.983	1.092	1.229	1.405							
	25	0.667	0.711	0.762	0.821	0.889	0.970	1.067	1.185	1.334	1.524							
	26	0.721	0.769	0.824	0.888	0.962	1.049	1.154	1.282	1.442	1.648							
	27	0.778	0.830	0.889	0.957	1.037	1.131	1.244	1.383	1.555	1.778							
	28	0.836	0.892	0.956	1.029	1.115	1.217	1.338	1.487	1.673								
	29	0.897	0.957	1.025	1.104	1.196	1.305	1.436	1.595	1.794								
	30	0.960	1.024	1.097	1.182	1.280	1.397	1.536	1.707	1.920								
	31	1.025	1.094	1.172	1.262	1.367	1.491	1.640	1.823	2.050								
	32	1.092	1.165	1.248	1.345	1.457	1.589	1.748	1.942									
	33	1.162	1.239	1.328	1.430	1.549	1.690	1.859	2.065									
	34	1.233	1.315	1.409	1.518	1.644	1.794	1.973	2.192									
	35	1.307	1.394	1.494	1.608	1.742	1.901	2.091	2.323									
	36	1.383	1.475	1.580	1.702	1.843	2.011	2.212										
	37	1.460	1.558	1.669	1.797	1.947	2.124	2.337										
	38	1.540	1.643	1.761	1.896	2.054	2.241	2.465										
	39	1.623	1.731	1.854	1.997	2.163	2.360	2.596										
	40	1.707	1.821	1.951	2.101	2.276	2.483											
	41	1.793	1.913	2.049	2.207	2.391	2.608											
	42	1.882	2.007	2.151	2.316	2.509	2.737											
	43	1.973	2.104	2.254	2.428	2.630												
	44	2.065	2.203	2.360	2.542	2.754												
	45	2.160	2.304	2.469	2.659	2.880												
	46	2.257	2.408	2.580	2.778	3.010												
	47	2.357	2.514	2.693	2.900													
	48	2.458	2.622	2.809	3.025													
	49	2.561	2.732	2.927	3.153													
	50	2.667	2.845	3.048	3.282													
	51	2.775	2.960	3.171														
	52	2.885	3.077	3.297														
	53	2.997	3.196	3.425														
	54	3.111	3.318	3.555														
	55	3.227	3.442															
	56	3.346	3.569															
	57	3.466	3.697															
	58	3.589	3.828															
	59	3.714																
	60	3.841																
	61	3.970																
	62	4.101																

$F_b = 33.0 \text{ ksi}$

		Depth - in inches											
		5	4 1/2	4	3 1/2	3	2 1/2	2 1/4	2	1 3/4	1 5/8	1 1/2	1 1/4
Span in Feet	2	0.027	0.030	0.034	0.039	0.046	0.055	0.061	0.068	0.078	0.084	0.091	0.109
	3	0.061	0.068	0.077	0.088	0.102	0.123	0.137	0.154	0.176	0.189		
	4	0.109	0.121	0.137	0.156	0.182	0.218	0.243					
	5	0.171	0.190	0.213	0.244	0.284							
	6	0.246	0.273	0.307	0.351								
	7	0.335	0.372	0.418									
	8	0.437	0.486										
	9	0.553											



HSS APPLICATIONS

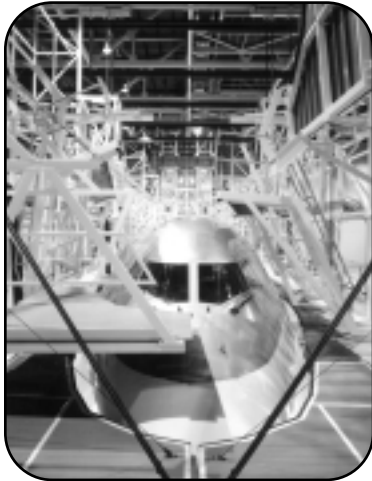

**Steel Tube
Institute**
OF NORTH AMERICA

2000 Ponce de Leon, Suite 600, Coral Gables, FL 33134 • Tel: (305) 421-6326
E-mail: STINA@steeltubeinstitute.org • Website: <http://www.steeltubeinstitute.org>



American
Iron and Steel
Institute