GE Critical Power

GPS 4848 Galaxy Power System

-48V DC Large Power Plant H569-434

The industry standard for telecom power, the GPS4848/100 is the first choice to meet dc power requirements of large centralized switching, and Internet Services data center applications. The GPS provides output capacities up to 20,000A in an integrated multi-cabinet configuration utilizing 3-Phase 3-wire rectifiers operating on commercial 208/220/240Vac or 380/400/480Vac. The Galaxy Millennium II controller provides detailed system management and flexible control of GE and third part equipment.



The system can be deployed in centralized or distributed system architectures. GPS provides industry leading capacity of up to 3080 Amps in a single cabinet which can scale to 20,000 Amps in a multi-cabinet system solution. A single Millennium II controller links all components of the system, while intelligently interacting with the local and remote Ethernet networks.

595 Rectifier

The 595LT-TE rectifier integrates proven technology with superior control features in a compact, cost effective solution. This highly efficient rectifier platform provides unparalleled performance maximizing system investment approaching 96%. The 595LT-TE series offers two modules for use in -48V applications.

Rectifier:

- 595LTA-TE, 220A/48V output @ 480VAC
- 595LTB-TE, 220A/48V output @208/240VAC



The Galaxy Millennium II controller combines sophisticated power monitoring and remote management. This flagship controller simplifies operations and maintenance while lowering administrative costs. Remote peripheral modules support over 500 monitoring points for GE or third party devices. Ethernet, SNMP, and TL1 provide integration and surveillance of system-state conditional reporting and capacity management.

Features and Benefits

Reliability

- Delivers decades of service
- High availability architecture
- NEBS level 3 certified

Intelligence

- Industry leading controller features
- Ethernet interface for remote access
- Centralized network management

Investment Protection

- Backward compatibility
- Flexible upgrade options
- Seamless integration with ferro plants

On Time Delivery

- Standard building blocks
- 4 6 week availability
- 24/7 technical support



- Telecom central office, IS data centers and MTSO applications
- Streamlined system control and monitoring
- 20,000 Amp capacity
- Rectifier efficiencies approaching 96%



Galaxy 595LT TE Rectifiers



- Provides high power density
- Plug and Play installation of the rectifier in a shelf connected to a compatible system controller initializes all set up parameters automatically. No adjustments are needed.
- Digital meter, rectifier state and on/off/standby indicators
- Extended service life parallel operation with automatic load sharing ensures that parallel units are not unduly stressed even when a unit fails or is removed.
- Monitoring / control the built in microprocessor controls and monitors all critical rectifier functions and communicates with the system controller using the built in Galaxy Protocol serial interface.
- Fail safe performance hot insertion capabilities allow for rectifier replacement without system shutdown; soft start and inrush current protection prevent nuisance tripping of upstream breakers.

Applications

- Telecommunications networks
- Digital subscriber line (DSL)
- Indoor/outdoor wireless

- Routers/switches
- Fiber in the loop
- Transmission

- Data networks
- PBX

Key Features

- Digital load sharing
- Hot pluggable
- Front panel meter

- System State LED indicators
- High power density
- 3-Phase, 3-wire input

- RoHS 5/6 compliant
- -48V input
- Approaching 96% efficient

Specifications

Input	595LTA TE Rectifier	595LTB TE Rectifier
Voltage Range	320 - 530 Vac	176 - 275 Vac
Input Current (Specified) Rated Maximum Typical Maximum	20A at 480V 25A at 380V 30A 22A at 320Vac 19A at 380Vac 15A at 480Vac	40A at 208Vac 35A at 240Vac 50A 41A at 176Vac 36A at 200Vac 33A at 208Vac 30A at 240Vac
Input Frequency	44 – 63Hz	44 – 63Hz
Power Factor	0.99 at >50% to 100% load	0.99 at >50% to 100% load
Efficiency (from 100Adc to 220Adc)	96%	95.5%
Total Harmonic Distortion	<5% from 50 – 100% load	<5% from 50 – 100% load
Output		
Voltage Adjust Range	44-58Vdc float/boost	44-58Vdc float/boost
Voltage Nominal	52Vdc	52Vdc
Regulation (with controller)	±0.5%	±0.5%
Ripple	100mVrms	100mVrms
Output Current -0°C to 37°C -0°C to 40°C 50°C	NA 220A 200A	220A NA 200A
Heat Release 54Vdc - 160Adc 54Vdc - 200Adc 54Vdc - 220Adc	270W (920 BTU/hr) 450W (1,550 BTU/hr) 560W (1,930 BTU/hr)	360W (1,240 BTU/hr) 510W (1,750 BTU/hr) 630W (2,150 BTU/hr)


Environmental	
Operating Temperature	-5°C to +55°C (23°F to 131°F)
Storage Temperature	-40°C to +85°C (-40°F to 185°F)
Humidity	< 95% non-condensing
Altitude	-50 to 4000 meters (Altitudes above 1500 meters, de-rate the temperature by 0.656C per 100 meters
Mechanical	
Length (inch/mm)	18.2/470
Width (inch/mm)	10.40/265
Height (inch/mm)	8.25/210
Weight (lb/Kg)	LTA – 37/17 LTB – 33/15


Safety and Standards Compliance	595LT TE Rectifier
NEBs Level 3	Evaluated by independent NRTL test lab to Telcordia GR63, Issue 3 & GR 1089, Issue 5
Safety	UL Recognized (US & Canada) and VDE UL 1950, EN60950/IEC950 CSA 234/950 (tested for SELV output)
RoHS	Compliant to RoHS EU Directive 2002/95/EC; RoHS 5/6
Electromagnetic Compliance: Emission and Immunity	EN55022 (CISPR22) Radiated/conducted emission Class; IEC/EN61000-4-2 ESD levels 3 & 4 IEC/EN61000-4-3 Radiated Immunity. 10Vm IEC/EN61000-4-4 Electrical Fast Transients/Burst, level 4 IEC/EN61000-4-5 Lightning Surge, level 4 FCC Part 15, Class A; GR1089-CORE, Issue 5

Outline Drawing

Rectifier Control and Feature Panel

- 3 Position Power Switch
- On and Stand by LED lamps
- Current Display Meter
- Status LED's
- ALM (red): Thermal/Comm.
- LIM (yel.): Current Limit
- FAN ALM (red): Fan Fail
- BST (yel.): Boost/Equalize mode






Cabinet Specifications

Mechanical	
Height	84.0 inches (2,134mm)
Width	23.6 inches (600mm)
Depth	23.6 inches (600mm)

Thermal (54Vdc at 220Adc)	595 LTA TE	595 LTB TE
4 Rectifiers	2,240W (7,720 BTU/hr)	2,520W (8,600 BTU/hr)
6 Rectifiers	3,360W (11,580 BTU/hr)	3,780 (12,900 BTU/hr)
8 Rectifiers	4480W (15,440 BTU/hr)	5,040W (17,200 BTU/hr)
12 Rectifiers	6,720 (23,160 BTU/hr)	7,560 (25,800 BTU/hr)
14 Rectifiers	7,840 (27,020 BTU/hr)	8,820 (30,100 BTU/hr)

Environmental	
Operating Temperature Range	0°C to +45°C (32°F to 113°F)
Operating Relative Humidity	< 95% non-condensing
Storage Temperature Range	-40°C to +85°C (-40°F to 185°F)
EMC	FCC and CISPR22 (EN55022) Class A
Immunity	GR1089, EN55024

Agency Certifications	
UL	Canada/US UL60950/UL1801
EMI/EMC	CISPR Class A conducted and radiated

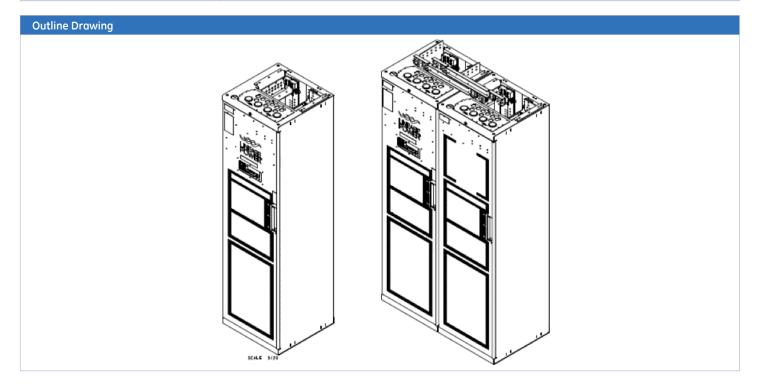

AC Input Specifications

Group Code	# of Rect shelves	# of Rect per CB	Nominal Rect Voltage	Input Current per CB	Circuit Breaker	# of Circuit Breakers	Wire Size at 90C per NEC 310-16	Wires per Conduit	# of Conduits	Minimum Conduit Size
321	3	3	208	104.7	150	2	1/0	3	2	1 1/4
7.77	3	3	480	44.6	70	2	4	6	1	1 1/4
323	3	3	480	44.6	70	2	6	3	2	3/4
725	3	1	208	34.9	50	6	4	9	2	1 1/4
325	3	1	208	34.9	50	6	8	3	6	3/4
	3	1	480	14.9	25	6	8	18	1	1 1/2
327	3	1	480	14.9	25	6	10	9	2	3/4
	3	1	480	14.9	25	6	10	3	6	1/2
	6	1	480	14.9	25	12	8	18	2	1 1/2
	6	1	480	14.9	25	12	8	18	2	1 1/2
328	6	1	480	14.9	25	12	10	9	4	3/4
	6	1	480	14.9	25	12	10	9	4	3/4
	6	1	480	14.9	25	12	10	6	6	1/2
329	6	1	208	34.9	50	12	6	6	6	1
329	6	1	208	34.9	50	12	4	9	4	1 1/2
332	7	1	480	14.9	25	14	10	6	7	1/2
333	7	1	208	34.9	50	14	6	6	7	1
334	6	3	480	44.6	70	4	4	6	2	1 1/4
334	6	3	480	44.6	70	4	6	3	4	3/4
335	6	3	208	104.7	150	4	1/0	3	4	1 1/4
	3	1	480	14.9	25	6	8	18	1	1 1/2
371	3	1	480	14.9	25	6	10	9	2	3/4
	3	1	480	14.9	25	6	10	3	6	1/2
220	4	2	208	69.8	100	2	2	3	2	1
224	4	1	208	34.9	50	4	6	6	2	1
224	4	1	208	34.9	50	4	8	3	4	1/2
226	4	1	480	14.9	25	4	10	6	2	1/2
270	4	2	480	29.8	50	2	8	3	2	1/2

Additional Information

Product Documentation

H569434: Ordering Guide A copy of the appropriate installation manuals below ship with each system.

108994042: Galaxy Power System 4848/100 with dual rectifier shelf Product Manual

108327362: Installation Guide for Galaxy Power Systems

Ordering Information – GPS4848 Galaxy Power System

The GPS4848 system can be deployed in centralized or distributed system architectures. GPS provides industry leading capacity of up to 3080 Amps in a single cabinet which can scale to 20,000 Amps in a multi-cabinet system solution. A single Millennium II controller links all components of the system, while intelligently interacting with the local and remote Ethernet networks. Designed for either internal input AC breakers or terminal strip terminations, rectifier shelves can be spread across multiple bays as the system grows. For greater flexibility and working space, the 4848 may be equipped with a larger 36 inch wide distribution bay to accommodate large cable termination and egress.

Key Features

- Telecom central office, IS data centers and MTSO applications
- Streamlined system control and monitoring
- 20,000 Amp capacity
- Rectifier efficiencies approaching 96%





Wide Bay Wired with 750MCM Cable

Step 1: Select the Power Bays

-48V Distribi		mary (Control) Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Distributed	108997516	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, bulk feed 480V AC input for up to six 595LTA rectifiers, 1500A battery shunt	480Vac 3-Phase	
1,320A		H569434 G-1, 19, 323, 32	2 AC Feeds 6 Circuit Breakers	Vertical Distribution Available: 36"
-48V Distributed	108997425	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 480V AC input for up to six 595LTA rectifiers, 1500A battery shunt	480Vac 3-Phase	
1,320A		H569434 G-1, 19, 327, 32	6 AC Feeds Terminal Strip	Vertical Distribution Available: 45"
-48V Distributed	108997524	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, bulk feed 480V AC input for up to four 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
880A		H569-434 G-1, 19, 322, 32A	1 AC Feed 4 Circuit Breakers	Vertical Distribution Available: 54"
-48V Distributed	108997482	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 480V AC input for up to four 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
880A		H569434 G-1, 19, 326, 32A	4 AC Feeds Terminal Strip	Vertical Distribution Available: 54"
-48V Distributed	CC109126182	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 480V AC input for up to eight 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
1,760A		H596-434 G-1, 19, 330, 32A	8 AC Feeds Terminal Strip	Vertical Distribution Available: 54"

Step 1: Select the Power Bays – Distributed Architecture (cont.)

-48V Distribu	uted Architecture Pri	mary (Control) Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Distributed	CC109145942	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, bulk feed 208-240V AC input for up to six 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
1,320A		H569434 G-1, 19, 321, 32	2 AC Feeds 6 Circuit Breakers	Vertical Distribution Available: 36"
-48V Distributed	CC109150067	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 208-240V AC input for up to six 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
1,320A		H569434 G-1, 19, 325, 32	6 AC Feeds Terminal Strip	Vertical Distribution Available: 45"
-48V Distributed	CC109154571	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, bulk feed 208-240V AC input for up to four 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
880A		H569-434 G-1, 19, 320, 32	2 AC Feed 4 Circuit Breakers	Vertical Distribution Available: 51"
-48V Distributed	CC109154588	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 208-240V AC input for up to four 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
880A		H569-434 G-1, 19, 324, 32	4 AC Feeds Terminal Strip	Vertical Distribution Available: 54"
-48V Distributed	CC109128484	GPS 4848 Distributed Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 208-240V AC input for up to eight 595LTB rectifiers, 3000A battery shunt	240Vac 3 Phase	
1,760A		H596-434 G-1, 19, 331, 32A	8 AC Feeds Terminal Strip	Vertical Distribution Available: 54"

Step 1: Select the Power Bays – Distributed Architecture (cont.)

-48V Distribu	ıted Architecture Su	pplementary Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Distributed	108997508	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, bulk feed 480V AC input for up to six 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
1,320A		H569434 G-1, 18D, 323, 32A	2 AC Feeds 6 Circuit Breakers	Vertical Distribution Available: 36"
-48V Distributed	108997433	GPS 4848 Distributed Architecture Full Height Supplemental Bay, no controller, terminal strip feed 480V AC input for up to six 595LTA rectifiers, 1500A battery shunt	480Vac 3-Phase	
1,320A		H569434 G-1, 18D, 327, 32	6 AC Feeds Terminal Strip	Vertical Distribution Available: 45"
-48V Distributed	108997532	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, bulk feed 480V AC input for up to four 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
880A		H569-434 G-1, 18D, 322, 32A	1 AC Feed 4 Circuit Breakers	Vertical Distribution Available: 54"
-48V Distributed	108997490	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, terminal strip feed 480V AC input for up to four 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
880A		H569-434 G-1, 18D, 326, 32A	4 AC Feeds Terminal Strip	Vertical Distribution Available: 54"
-48V Distributed	CC109126174	GPS 4848 Distributed Architecture Full Height Supplemental Bay, no controller, terminal strip feed 480V AC input for up to eight 595LTA rectifiers, 3000A battery shunt	480Vac 3-Phase	
1,760A		H596-434 G-1, 18D, 330, 32A	8 AC Feeds Terminal Strip	Vertical Distribution Available: 36"

Step 1: Select the Power Bays – Distributed Architecture (cont.)

-48V Distribu	uted Architecture Su	pplementary Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Distributed	CC109151148	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, bulk feed 208-240V AC input for up to four 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
880A		H569-434 G-1, 18D, 320, 32	2 AC Feeds 4 Circuit Breakers	Vertical Distribution Available: 51"
-48V Distributed	CC109150075	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, terminal strip feed 208-240V AC input for up to four 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
880A		H569-434 G-1, 18D, 324, 32	4 AC Feeds Terminal Strip	Vertical Distribution Available: 54"
-48V Distributed	CC109152690	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, bulk feed 208-240V AC input for up to six 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
1,320A		H569434 G-1, 18D, 321, 32	2 AC Feeds 6 Circuit Breakers	Vertical Distribution Available: 36"
-48V Distributed	CC109147955	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, terminal strip feed 208-240V AC input for up to six 595LTB rectifiers, 1500A battery shunt	240Vac 3 Phase	
1,320A		H569434 G-1, 18D, 325, 32	6 AC Feeds Terminal Strip	Vertical Distribution Available: 45"
-48V Distributed	CC109128476	GPS 4848 Distributed Architecture Full Height Supplemental Bay , no controller, terminal strip feed 208-240V AC input for up to eight 595LTB rectifiers, 3000A battery shunt	240Vac 3 Phase	
1,760A		H596-434 G-1, 18D, 331, 32A	8 AC Feeds Terminal Strip	Vertical Distribution Available: 36"

Step 1: Select the Power Bays – Centralized Architecture

-48V Centrali	-48V Centralized Architecture Primary (Control) Bays						
Output	Ordering Code	Model	AC Input	Picture			
-48V Centralized	108994406	GPS 4848 Centralized Architecture Full Height Control Bay , Millennium II controller, bulk feed 480V AC input for up to twelve 595LTA rectifiers, battery shunt	480Vac 3-Phase				
2,640A		H569434 G2, 19, 334, 33	4 AC Feeds 12 Circuit Breakers	Rectifier Only Bay			
-48V Centralized	108994380	GPS 4848 Centralized Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 480V AC input for up to twelve 595LTA rectifiers, battery shunt	480Vac 3-Phase				
2,640A		H569434 G2, 19, 328, 33	12 AC Feeds Terminal Strip	Rectifier Only Bay			
-48V Centralized	CC109134235	GPS 4848 Centralized Architecture Full Height Control Bay , Millennium II controller, bulk feed for 208-240V AC input for up to twelve 595LTB rectifiers	240Vac 3 Phase				
2,640A		H569434 G2, 19, 335, 33	4 AC Feeds 12 Circuit Breakers	Rectifier Only Bay			
-48V Centralized	CC109145777	GPS 4848 Centralized Architecture Full Height Control Bay , Millennium II controller, terminal strip feed 208-240V AC input for up to twelve 595LTB rectifiers	240Vac 3 Phase				
2,640A		H569434 G2, 19, 329, 33	12 AC Feeds Terminal Strip	Rectifier Only Bay			
-48V Centralized	108982752	GPS 4848 4800 Amp Centralized Architecture Full Height Control Bay , Millennium II controller, distribution only	Distribution Only Bay	T. T			
4,800A		H569-434 G2, 16, 29, 33		Vertical Distribution Space: 72"			
-48V Centralized	CC109167607	GPS 4848 4800 Amp Centralized Architecture Full Height Control WIDE Bay , distribution only Vertical Distribution Space: 72.0" with Controller	Distribution Only Bay	100			
4,800A		H569434 G2, 19, 430, 33		Vertical Distribution Space: 72"			

Step 1: Select the Power Bays – Centralized Architecture (cont.)

-48V Central	lized Architecture Su	pplementary Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Centralized	108993275	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, bulk feed 480V AC input for up to twelve 595LTA rectifiers	480Vac 3-Phase	
2,640A		H569-434 G2, 18C, 334, 33	4 AC Feeds 12 Circuit Breakers	Rectifier Only Bay
-48V Centralized	CC109133006	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, terminal strip feed 480V AC input for up to twelve 595LTA rectifiers	480Vac 3-Phase	
2,640A		H569-434 G2, 18C, 328, 33	12 AC Feeds Terminal Strip	Rectifier Only Bay
-48V Centralized	108993283	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, terminal strip 480V AC input for up to fourteen 595LTA rectifiers	480Vac 3-Phase	
3,080A		H569-434 G2, 18C, 332, 33	14 AC Feeds Terminal Strip	Rectifier Only Bay
-48V Centralized	CC109134227	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, bulk feed 208-240V AC input for up to twelve 595LTB rectifiers	240Vac 3 Phase	
2,640A		H569-434 G2, 18C, 335, 33	4 AC Feeds 12 Circuit Breakers	Rectifier Only Bay
-48V Centralized	CC109144333	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, terminal strip feed 208-240V AC input for up to twelve 595LTB rectifiers	240Vac 3 Phase	
2,640A		H569-434 G2, 18C, 329, 33	12 AC Feeds Terminal Strip	Rectifier Only Bay
-48V Centralized	CC109136660	GPS 4848 Centralized Architecture Full Height Supplemental Rectifier Only Bay , no controller, terminal strip feed 208-240V AC input for up to fourteen 595LTB rectifiers	240Vac 3 Phase	
3,080A		H569-434 G2, 18C, 333, 33	14 AC Feeds Terminal Strip	Rectifier Only Bay

Step 1: Select the Power Bays – Centralized Architecture (cont.)

40V Centrum	zea Architecture Su	pplementary Bays		
Output	Ordering Code	Model	AC Input	Picture
-48V Centralized	108873415	GPS 4848 4800 Amp Centralized Architecture Full Height Supplemental Bay , distribution only , no controller	Distribution Only Bay	
4,800A		H569434 G2, 12, 29, 33		Vertical Distribution Space: 72"
-48V Centralized	CC109167615	GPS 4848 4800 Amp Centralized Architecture Full Height Supplemental WIDE Bay , distribution only , no controller (7'H × 36"W 24"D)	Distribution Only Bay	
4,800A		H569434 G2, 18C, 430, 33		Vertical Distribution Space: 72"
Bottom Feed	Solutions (bays to b	e installed in pairs)		
-48V Centralized	150034119	GPS 4848 Centralized Architecture Full Height Control Bay , Distribution only, Millennium II controller. Compatible with 150034120 only	Bottom Feed, Distribution Only Bay	
2,640A		H569434 G2,G19,G431		
-48V Centralized	150034120	GPS 4848 Centralized Architecture Full Height Supplemental Bay , Rectifiers only, no controller, bulk feed 480V AC input for up to twelve 595LTA rectifiers, battery shunt. Compatible with 150034119 or 150034121 only	480Vac 3-Phase	東二郎 東二郎 東二郎 東二郎
2,640A		H569434 G2, G18E, G334B,G33	4 AC Feeds 12 Circuit Breakers	
-48V Centralized	150034121	GPS 4848 Centralized Architecture Full Height Distribution only, No controller. Used as growth bay when 150034119 and 150034120 are already in place. Should be combined with 150034120 only	Bottom Feed, Distribution Only Bay	
2,640A		H569434 G2, 18C, 431		

Note: All supplemental bays include the interconnect bus bars to connect to an adjacent bay $\,$

Add	Additional Kits					
	Ordering Code	Model				
	850019233	Bus Bar Extender	Provides 16 return terminations			

Step 2: Select Rectifier

Rectifiers			
Output	Ordering Code	Model	Picture
220A	108979238	220 Amp, 48VDC output, 480VAC 3 Ph input Rectifier, 96% efficient 595LTA TE	\$: = ::
22071		33321112	
R ~	108990405	220 Amp, 48VDC output, 208 -240 VAC 3 Ph input Rectifier, approaching 96% efficient	9: m :::
220A		595LTB TE	
	108994686	595LT filler bracket and keying kit for LT rectifier when used with single rectifier shelf	G11 mg
	848693586	Spare Rectifier Fan Assembly for non-TE rectifiers	
	CC848880914	Spare Rectifier Fan Assembly for TE rectifiers	

Step 3: Select Field Installed Distribution Panels

Ordering Code	Group Code	Panel Description	Vertical Space (in.)	Internal Return Bars (Dist Arch Only)	Group Code	
108971474	G43A	6 Position 125A-800A Circuit Breaker Panel	12	108908070	G43	
108971318	G42A	3 Position 125A-600A Circuit Breaker Panel	6	108908070	G42	
108971417	G48B	5 Position 125A-800A Circuit Breaker Panel	9	108908070	G48	
108971532	G96A	10 Position 3A-100A Bullet Breaker Panel	6	108908104	G96	
108971680	G97A	14 Position 3A-200A Bullet Breaker Panel	6	108908104	G97	
108987678	G98B	22 Position 3A-200A Bullet Breaker Panel	9	108908104	G98B	
Field North Ame	rican Fuse Pa	nels				
108970872	G52A	10 Position 3A-60A TPS Fuse Panel	6	108908070	G52	
108986746	G54A	5 Position 70A-225A TPL-B Fuse Panel	9	108908070	G54	
CC109133113	G53A	2 Position 70A-600A TPL Fuse Panel	6	108908104	G53	
108985235		6 position 1A-15A GMT Fuse Panel	0	NA	NA	
108908278	Low Voltage	Low Voltage Load Disconnect Option				
108908070	Return Bus	Return Bus for panels in like shaded lines				
108908104	Return Bus	Return Bus for panels in like shades lines				

Distribution Pane	els with Grou	nd Return Included		
Ordering Code	Group Code	Description	Vertical Space (in.)	
108971466	G43	6 Position 125A-800A Circuit Breaker Panel	12	
108971292	G42	3 Position 125A-600A Circuit Breaker Panel	6	
108971409	G48	5 Position 125A-800A Circuit Breaker Panel	9	
CC109133105	G59	2 Position 70A-600A Fuse Panel	6	
408472322		Fuse Holder for 70-250A fuses in G59		
108986738	G54	5 Position 70A-225A Fuse Panel	9	
108971524	G96	10 Position 3A-100A Bullet Breaker Panel	6	
108971672	G97	14 Position 3A-100A Bullet Breaker Panel	6	
108987686	G98	22 Position 3A-200A Bullet Breaker Panel	9	
108985235	G58	6 Position GMT Holder up to 15A	0	

Step 4: Select Distribution Components

Note: Plug in, and bolt in distribution components are listed below. These must be selected to match the distribution panels selected in Step 3.

Ordering Code	Amperage	CB Positions (Poles)	Min Wire Gauge		
07998137	3	1	10		
407998145	5	1	10		
407998152	10	1	10		
407998160	15	1	10		
407998178	16	1	10		
407998186	20	1	10		
407998194	25	1	10		
407998202	30	1	10		
408213486	40	1	8		
407998210	45	1	8		
407998228	50	1	6		
407998236	60	1	6		
407998244	70	1	2		
407998251	80	1	2		
407998269	90	1	2		
407998277	100	1	2		
CC848808551	100	2	2		
408185353	125	2	2		
408185346	150	2	1/0		
408564941	200	3	2/0		
CC408573975	225	3	4/0		
408535752	250	3	4/0		
848631479	2-pole adapter bus kit (incl order one per breaker	udes bus for ¼" hole lug on 5/8	" centers and hardware),		
848745662	3-pole adapter bus kit (incl order one per breaker	3-pole adapter bus kit (includes bus for 5/16" hole lug on 1" centers and hardware), order one per breaker			

Step 4: Select Distribution Components (cont.)

Large Circuit Breake	r Kits			
Ordering Code	Amperage	CB Positions (Poles)	Min Wire Gauge	Photo
108908187	125	1	2	4
108908179	150	1	1/0	
108908195	175	1	2/0	
108908203	225	1	4/0	
108908211	300	2	2 × 4/0	
108908237	400	2	2 × 4/0	
108908229	500	3	3 × 4/0	
108908252	600	3	3 × 4/0	
108984782	800	4	4 × 4/0	

arge TPL Fuses					
Ordering Code	Amperage	Max # wires per position	Min Wire Gauge		
408472322	(Option	(Optional) 70-250A Fuse Holder Head for applications using <251A fuses in GP59 panel.			
402328926	0.18A Alarm Fuse				
406794776	70	3	6		
408239648	80	3	4		
406794784	100	3	2		
406925685	125	3	2		
406794792	150	3	1/0		
406794818	200	3	4/0		
406794982	225	3	4/0		
406794842	250	3	4/0		
406794867	300	3	2 × 4/0		
406794875	400	3	2 × 4/0		
406794883	500	3	2 x 4/0		
406794891	600	3	3 × 4/0		

Step 4: Select Distribution Components (cont.)

Ordering Code	Amperage	WP-92461 List	Min Wire Gauge	Photo
406700567	3	100	10	
406700583	5	101	10	
406700591	6	102	10	
406700609	10	103	10	
406700617	15	104	10	
406700625	20	105	10	
406700633	25	106	10	Ana TELPO
406700641	30	107	10	
406700658	40	108	10	
406700674	50	109	8	
406700682	60	110	6	
406700690	70	111	6	
402328926	0.18 Alarm Fuse			
408548944	Bullet Fuse Holder, TFD-101	-011-09 (Alarms on Blown Fuse	e or Fuse Head Removal)	
GMT Fuses				
405006222	0.25A			
3150439	0.5A			
405673146	1.33A			
405181983	2A			
406976985	3A			
406159061	5A			
405725433	7.5A			
406159236	10A			
406473959	15A			


Step 5: Select Remote Peripheral Monitoring Options (Millennium 2 Controller only)

Ordering Code	Description	Photo		
	Modules	# Inputs	# Temp	
108469461	J85501G1L21 RPM Shunt Monitoring (221F)	6	1	
108469479	J85501G1L22 RPM Voltage 0-200VDC (221D)	6	1	
108469495	J85501G1L23 RPM Transducers (221J)	6	1	
108298431	J85501G1L24 RPM Voltage 0-3VDC (221A)	6	1	
108298498	J85501G1L25 RPM Voltage 0-16VDC (221B)	6	1	
108469503	J85501G1L26 RPM Voltage 0-70VDC (221C)	6	1	
108298449	J85501G1L27 RPM Binary (222A)	6	1	
108483538	J85501G1L28 RPM Temperature (223T)	0	7	
108298456	J85501G1L9 RPM Control Relay (214A)	3	0	
	Supporting Material			
407377704	Connecting Cable for RPMs (Order by foot)			
848535332	Blue panel for mounting 6 modules above a GPS c	abinet		
848412367	White panel for mounting 6 modules in a 23-inch	rame inside GPS bo	ıy	
847307410	12' Cable to be used with Temperature Probes			
847917879	½" Diameter Ring Terminal Temperature Probe (Co	ıble Required)		
848528881	5/16" Diameter Ring Terminal Temperature Probe	(Cable Required)		ADDRESS NAME OF THE PARTY OF TH
405298308	Termination Resistor (1 per bus)			
406712968	Ferrite Bead (1 per bus)			V
403607955	Monitor Channel cable KS13385 22AWG stranded (order by the foot)	pair, R&Bk		
	Millennium	Remote Monito	ring	
	Millennium II 2 loops through 406712968 ferrite bead prior to termination onto Millennium II TB1 6/8 (7 shield)	Up to 300 Meter (980 Ft.N	rs Each Bus Up to 6	85 Remote Modules 6 Points Each Module Up to 510 Points)
	22 AWG has a 300 ft. max. one way cable length between Remote Module and monitored point. Order 403607955 by the foot. Engine Alternator Denotes Remote Monitoring Modules Denotes Last Remote Monitoring Module on bus. A 560 ohm, 10 watt Terminating Resistor is required for proper operation.	со	7377704 20 AWG 2 nductor standed ground shielded wire. AC Distribution	Plant 2 Batteries

Step 6: Select Optional AC Monitoring Equipment (Millennium 2 Controller only)

AC Monitoring Options					
Ordering Code	Description	Photo			
Configured Panels					
CC408646005	3P/3W 208/240V Line to Line, 10x12x14 box provides current, voltage, and power				
CC408646046	3P/3W 480V Line to Line, 10x12x14 box provides current, voltage, and power				
CC408646054	3P/4W 208V Line to Neutral, 10x12x14 box provides current, voltage, and power				
Transducers					
CC408645808	1-phase AC Current Transducer (Built-in CT; 150A max current; 350 kcmil max conductor size)				
CC408645816	1-phase AC Voltage Transducer 120V				
CC408645824	1-phase AC Voltage Transducer 208/240V				
CC408644537	3-phase AC Voltage Transducer 208/240V Line to Line	Min.			
CC408645741	3-phase AC Voltage Transducer 208/240V Line to Neutral (120V)				
CC408645832	3-phase AC Voltage Transducer 480V Line to Line				
CC408645840	3-phase AC Current Transducer	BIGG Lang			
Current Transform	ners (Required for configured panels and current transducers)				
CC408645857	Current Transformer, 200A primary, 5A secondary, 4 in inside diameter				
408524862	Current Transformer, 400A primary, 5A secondary, 4 in inside diameter				
CC408645865	Current Transformer, 600A primary, 5A secondary, 6 in inside diameter	000			
CC408645873	Current Transformer, 800A primary, 5A secondary, 6 in inside diameter	000			
CC408645881	Current Transformer, 1000A primary, 5A secondary, 8 in inside diameter	/ / /			
CC408645898	Current Transformer, 1200A primary, 5A secondary, 8 in inside diameter				
Miscellaneous					
CC408645907	Barrier terminal block to extend the CT secondary leads beyond their 12 ft factory length. Use 12 AWG THHN wire in conduit.				
CC408645915	Bud Industries Wall Box (12H \times 10W \times 8D) w/captive screw cover & internal mounting panel. For mounting transducers				

Step 7: Select Battery Termination Options

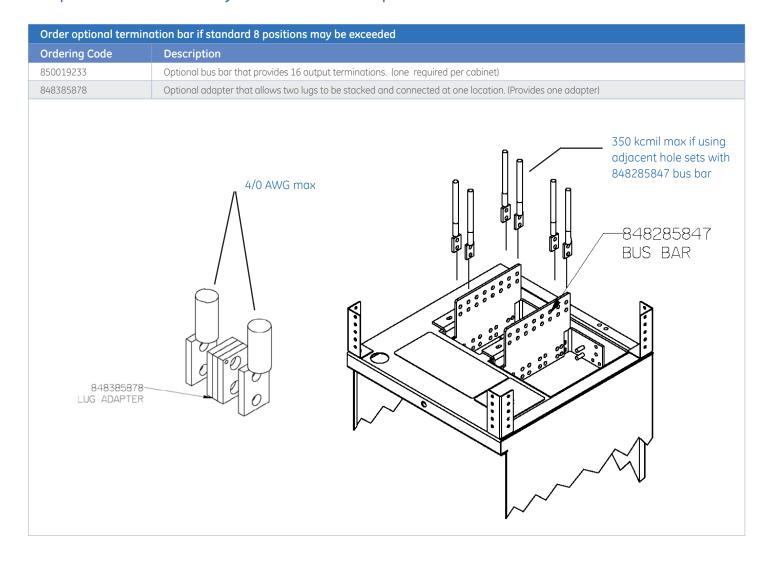


Step 8: Select Distributed Return Bus Bars

Standard Architecture 600mm Bays Ordering Code Description Externol Return Bus Kit for Mounting on Distributed Architecture Cabinets, 1 per cabinet, rated at 1800 Amps Only required if internal return bus bars were not ordered. The external return bus kit is an alternative to internal return buses when many large cables are required. Please contact GE for additional options for external return bus bars. 22 SETS OF 3/8 HOLES ON I INCH CENTERS FOR 750KCMIL CABLE 7 SETS OF I/4 INCH HOLES ON 5/8 INCH CENTERS CC848805160 EXTERNAL RETURN BUS KIT FOR MOUNTING ON DISTRIBUTED ARCHITECTURE CABINETS THIS KIT IS AN ALTERNATIVE TO INTERNAL RETURN BUSS WHEN MANY LARGE CABLES ARE REQUIRED.


Step 9: Select Centralized Return Bus Bars

Centralized Architecture		
Ordering Code	Description	
108298472	ED8301950G9 2600A Ground Bar arranged for mounting on auxiliary framing, or 20 or 25 inch ladder-type cable rack	
109006080	ED8301950G11 2600A Ground Bar for stacking with a Group 9, Maximum of 2 can be stacked	
108662933	ED8301950G9,2-11 Commonly ordered configuration containing 3 stacked 2600A ground bars	
Please see ED83019-50 Drawing, or contact GE, for more ground bar options.		

ED83019-50 Outline Drawing for the main bus bar in Groups 9 and 11 (28.62 inches long by 6.00 inches wide)

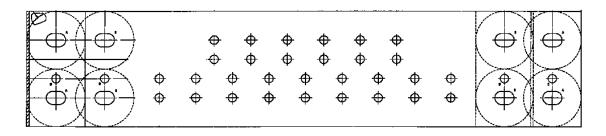

ED83019-50 Outline Drawing for stacking two Group 11's with a Group 9 (Height of 4.5 inches per stack)

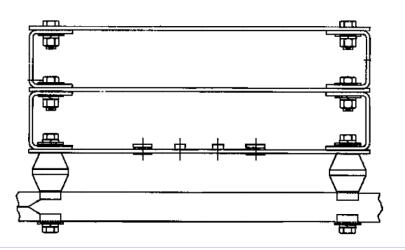



Ordering Code	Description
105579163	5200A Ground Bar arranged for mounting on auxiliary framing, or 20 or 25 inch ladder-type cable rack
Please see 10557916	3 Drawing, or contact GE, for more ground bar options of this style.
Outline Drawing for 1	.05579163 bus bar (72.0 in long by 6.00 in wide)

Step 10: Select Chandelier Bus Bar (Centralized Architecture)


	Description
Ordering Code 01412273	J85504A1L5 1,200 Amp Chandelier Bus Bar Assembly, Shunt Ordered Separately
3734851	J85504A1LG Growth busbars to List 5 for a 2,600 Amp Capacity
1412265	J85504A1L15 2,600 Amp Chandelier Bus Bar Assembly, Shunt Ordered Separately
1412257	J85504A1LQ Growth busbars to List 15 for a 5,200 Amp Capacity
)1978323	J85504A1L20 5,200 Amp Chandelier Bus Bar Assembly, Shunt Ordered Separately
47627650	50mV Shunt with 800 Amp Capacity
46799906	50mV Shunt with 1200 Amp Capacity
6799922	J85504A1LF 50mV Shunt with 2600 Amp Capacity
46799963	50mV Shunt with 4000 Amp Capacity
46799989	J85504A1LP 50mV Shunt with 6000 Amp Capacity
8656294	ED8301950G23 10,000 Amp Chandelier Bus Bar Assembly, Shunt Included
46799948	50mV Shunt with 2600 Amp Capacity
9008532	2600A Upgrade to Main Plant Chandelier
ease see contact GE	for more Chandelier options.
33019-50 Group 23	PARTIAL FRONT VIEW SEE FIG S Outline Drawing (Busbar is 72.00 inches long by 8.00 inches wide) Horizontal Busbars

Step 11: Select Optional Horizontal Return Bus Bar System (Centralized Architecture)

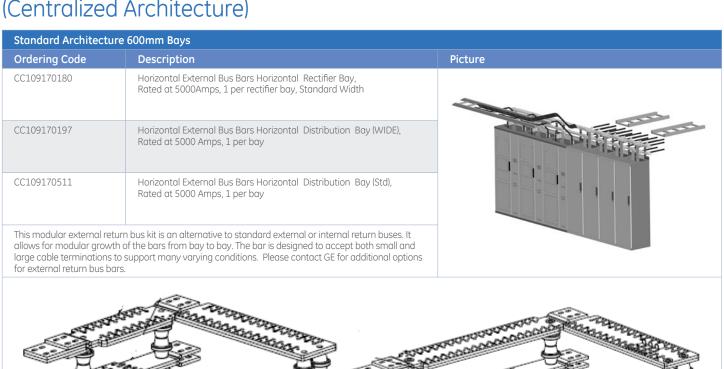

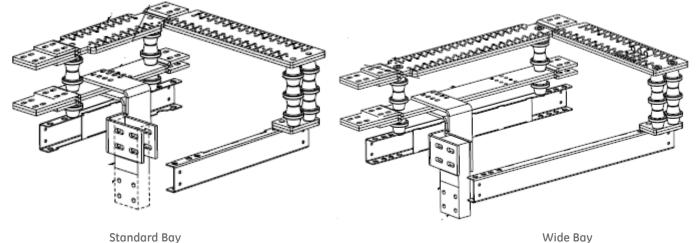


Horizontal Modular Distribution Bay Overhead Bus




Horizontal Modular Rectifier Bay Overhead Bus

Step 12: Select Optional Vertical Return Bus Bar System (Centralized Architecture)

Ordering Code	Description
CC109170404	Vertical External Bus Bars Rectifier Bay Rated at 5000Amps, 1 per rectifier bay, Standard Width
CC109170206	Vertical External Bus Bars Rectifier Bay Rated at 10000Amps, 1 per rectifier bay, Standard Width
CC109170412	Vertical External Bus Bars Horizontal Distribution Bay (WIDE), Rated at 5000 Amps, 1 per bay
CC109170214	Vertical External Bus Bars Horizontal Distribution Bay (WIDE), Rated at 10000 Amps, 1 per bay
CC109173175	Vertical External Bus Bars Horizontal Distribution Bay (Std), Rated at 5000 Amps, 1 per bay
This modular external return bus kit is an alternative to standard external or internal return buses. It allows for modular growth of the bars from bay to bay. The bar is designed to accept both small and large cable terminations to support many varying conditions. Please contact GE for additional options for external return bus bars.	

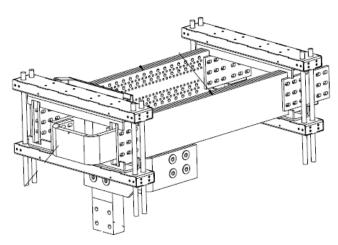

Horizontal Modular Distribution Bay Overhead Bus

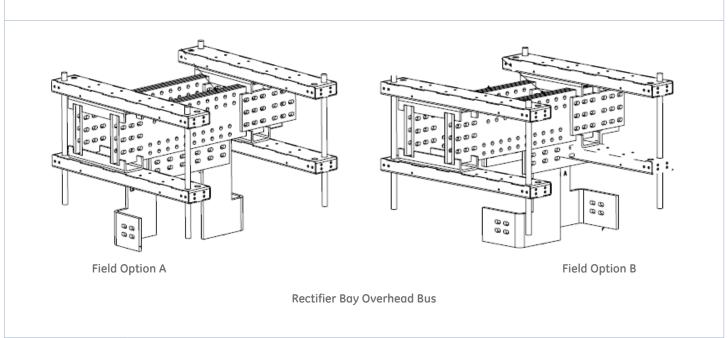

Notes		

Management Visibility

Galaxy Manager* software is the centralized visibility and control component of a comprehensive power management system designed to meet engineering, operations and maintenance needs. The Galaxy Manager client-server architecture enables remote access to system controllers across the power network.

- Dashboard display with one-click access to management information database
- Trend analysis
- Scheduled or on demand reports
- Fault, configuration, asset, and performance management

Training

GE offers on-site and classroom training options based on certification curriculum. Technical training can be tailored to individual customer needs. Training enables customers and partners to more effectively manage and support the power infrastructure. We have built our training program on practical learning objectives that are relevant to specific technologies or infrastructure design objectives.

Service & Support

GE field service and support personnel are trusted advisors to our customers – always available to answer questions and help with any project, large or small. Our certified professional services team consists of experts in every aspect of power conversion with the resources and experience to handle large turnkey projects along with custom approaches to complex challenges. Proven systems engineering and installation best practices are designed to safely deliver results that exceed our customers' expectations.

Warranty

GE is committed to providing quality products and solutions. We have developed a comprehensive warranty that protects you and provides a simple way to get your products repaired or replaced as soon as possible.

For full warranty terms and conditions please go to www.gecriticalpower.com.



CPB-GPS4848, Rev. 05/14

*Trademark of General Electric Company. Copyright 2014 General Electric Company. All Rights Reserved.

GE reserves the right to make changes to specifications of products described at any time without notice and without obligation to notify any person of such changes.

GE Critical Power

601 Shiloh Road, Plano, TX 75074 +1 877 546 3243 (toll-free in North America) +1 972 244 9288 (direct number) info.criticalpower@ge.com GECriticalPower.com

24/7 Technical Support pe.techsupport@ge.com