

PRECON PRECAST, LLC  
 6868 FM 730 SOUTH  
 AZLE, TX 76020

817-448-9718 OFFICE  
 817-448-9886 FAX  
 frank@preconprecast.com


1

**3500 SERIES**  
 1500 GALLON RECLAIM


General Notes: 1. Unit comes with interior piping installed.  
 2. Inflow section of unit must be filled with at least 14.5" of clear water prior to use.

Specifications: 1. Concrete has design strength of 5,000psi @ 28 days. 2. Steel reinforcement: ASTM A-615, grade 60 ASTM A-497 welded wire fabric. 3. Designed for H2O loading. 4. CI Casting: ASTM A-48, class 30/35.

Refer to wash equipment vendor's shop drawings for final plumbing configuration for water reclaim system

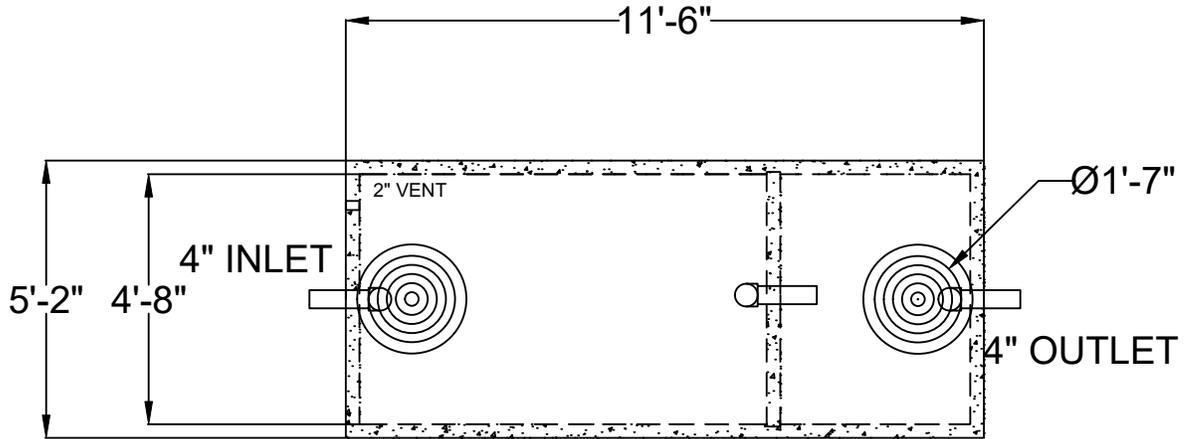

TOP VIEW

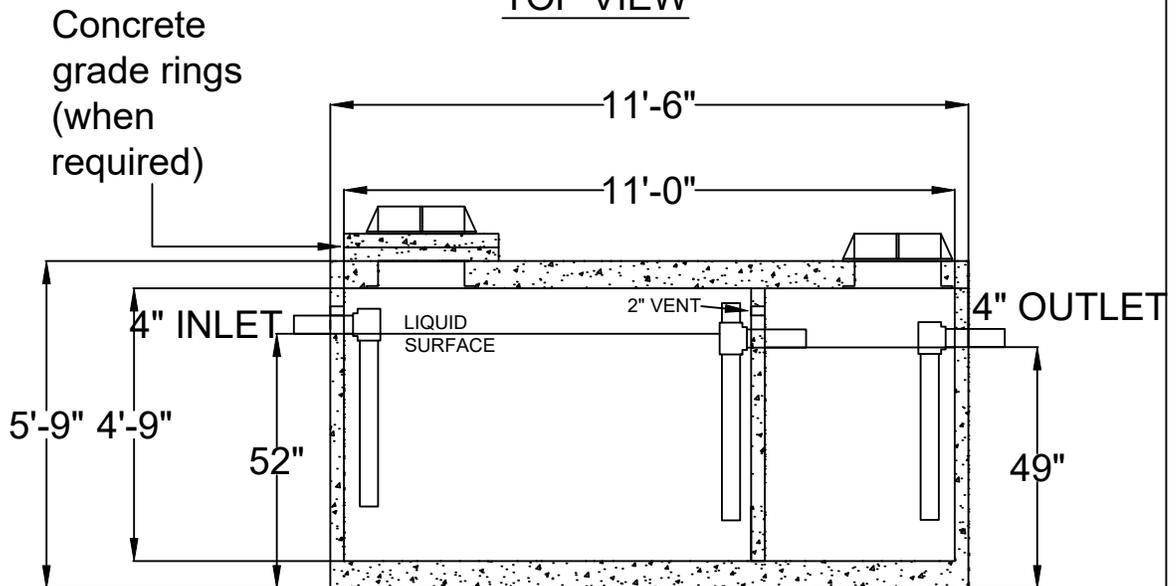

SIDE VIEW

1500galreclaim.dwg  FILE NAME:	APPROVED FOR PRODUCTION	AUTHORIZED BY
	DATE: 11/12/14	PRINT:
	JOB TITLE:	SIGN: