

Tri-County SUPER HEAT ASHRAE

American Society of Heating, Refrigerating and Air-Conditioning Engineers

IN THIS ISSUE...

Upcoming Meeting	1
Last Months Meeting	2
Golf Tournament Info	3-4
Marketing Opportunity	5
Business Card Ads	6
Advertisement	7
Leadership	8
History Article	9-12
Partial Roster	13



MEETING INFORMATION

Date: April 18, 2023
Location: Diamond Palace
 1241 Grand Ave.
 Diamond Bar, CA 91765
 (909) 860-2625

Time: 6:30 PM
Member Cost: \$45.00
Non-Member Cost: \$55.00

Golf Tournament Information

The Tri County ASHRAE Golf Tournament will be on April 6, 2023. Members are encouraged to support the chapter by playing in and/or sponsoring items for the tournament. See page 3 and 4 for complete details.

UPCOMING MEETING

Hope to see many of you at our April meeting! The theme for our April meeting will be Student Night.

Presentation summary:

The Tri County chapter of ASHRAE will be having our student night this month. Tri County members will be able to meet students who are interested in the HVAC industry. Also, a few Cal poly Pomona students will be discussing their ASHRAE Design Competition HVAC design. Hopefully, many of our members can attend this annual event.

GREAT TIME AT LAST MONTHS MEETING

A great time was had by all at last months meeting! Hope you are able to attend our Student Night meeting in April!



Tri County President Elect Kendal Smith (left) with speaker Narinder Kumar from JMD Sales



Clockwise from top left:

Kamal Iskander (Kamal S. Iskander And Associates), Cole Lemieux (DB Sales), Kendal Smith (Dawson Company), Narinder Kumar (JMD Sales), Jim Toda (Custom Cooling Company), Frankie Nguyen (PBS Engineers), Elvie Agamata (ICI Engineers), Tri County President Walter Escamilla (Goss Engineering), Tariq Hassan (PBS Engineers), Mike Franzen (Franzen Consulting), James Mansfield (DB Sales), Felix Monterosso (Willdan)



ASHRAE Tri-County Annual Golf Tournament Thursday, April 06th 2023

Hidden Valley Golf Club 10 Clubhouse Dr., Norco, CA 92806

Registration and Lunch: 11am •• **Tee-off:** 1pm •• **Banquet:** 6pm

Entry into tournament includes 18-holes of golf, range balls, riding cart, lunch, dinner and chance to win various prizes!

Banquet Awards and Recognition:

Trophy and Cash Prize for 1st and 2nd Place

Cash Prize for Closest to the Pin, Cash Prize for Longest Drive, Prize Drawings

See Attached Registration Form for More Info!

Thank you!

Golf Tournament Registration Form



2023 Annual Golf Tournament

Tournament:

Single Player Golfer with Banquet Ticket: **\$200**

Foursome with Banquet Tickets: **\$750**

Sponsorships:

Hole Sponsorship: **\$150**

Lunch Sponsorship (Company sign at lunch table): **\$150**

Dinner Sponsorship (Company sign at banquet tables): **\$250**

Raffle/Door Prize

<u>Name</u>	<u>e-mail Address</u>	<u>Company Name</u>	<u>Price</u>

<u>Sponsorship Item</u>	<u>Price</u>

Instructions for Registering:

For Payment Through Credit Card/PayPal [DUE BY March 20th, 2023 at Noon]:
 Visit [2023 ASHRAE Tri-County Golf Tournament - Powered by Eventzilla](#)

For Payment by Check [POSTMARKED BY March 20th, 2023]:

Make Checks Payable to "Tri-County ASHRAE"
 Mail Check(s) and a Copy of Registration Form(s) postmarked on or before 03/20/2023 to:
 Kakeru Fujikawa – Goss Engineering
 255 E. Rincon St., Suite 301 | Corona, CA 92879
 Office: (951) 340-1977 | kfujikawa@goss-eng.com

MARKETING OPPORTUNITY

PLEASE SUPPORT OUR
BUSINESS CARD/PAGE AD
ADVERTISERS LOCATED
HERE AND ELSEWHERE IN
THIS PUBLICATION...

**MAKE AN INVESTMENT
IN OUR INDUSTRY'S
FUTURE!**

If you would like to place a
business card/page ad in
Super Heat for the 2022-
2023 Tri-County ASHRAE
season, please contact us
via e-mail at
ashraetricounty@gmail.com

Looking for a unique marketing opportunity?

We've got a deal for you!

***For only \$50 (that's right, only \$50!) you and
many more can see your business card appear on
THIS MONTHLY PUBLICATION for the 2022-2023
Tri-County ASHRAE season!***

***And for only \$300 you can advertise your business
with a FULL page ad ! (\$150 half page Ad)***

***Now that you're interested, send a *.jpg version of
your business card and/or page ad to:
ashraetricounty@gmail.com and we will send you
a link to pay for the corresponding fees.***

TCSH Editor

BUSINESS CARDS



CDI
CUSTOM CURB ADAPTERS

Manny Perez
regional sales rep

562 301-4589 cell
mperez@cdicurbs.com




Maliha Williamson
Senior Sales Engineer
951.768.9885

4000 Hamner Avenue
Eastvale, CA 91752
USA

maliha.williamson@heatcraftrpd.com
heatcraftrpd.com



CUSTOM COOLING COMPANY, INC.

JIM TODA
Sales Engineer

425 W. BONITA AVENUE #106 • SAN DIMAS, CA 91773
Phone (909) 599-9222 FAX (909) 599-4418

E-MAIL: info@cccrops.com
WEB SITE: www.cccrops.com

MFGS. REPRESENTED

- AMERICAN COOLAIR/ILG..... AXIAL & CENTRIFUGAL FANS
- CHICAGO BLOWER..... APPLIED CENTRIFUGAL & AXIAL FANS
- TEXEL..... CORROSION RESISTANT FRP FANS
- COLMAC COIL MFG..... COILS & DRY COOLERS
- MAGIC-AIRE..... FAN COIL UNITS
- ENERTECH..... WATER SOURCE HEAT PUMPS
- THERMAL CORP..... CUSTOM AIR HANDLERS & FAN COILS
- KLEAN AIRE..... FILTER HOUSINGS & FILTERED SUPPLY FANS

ADDITIONAL PRODUCTS

Sound Traps - Gravity Vents - Louvers - Dampers

Advertise Now!



LEARN THE LATEST TECHNOLOGIES IN THE HVAC/R INDUSTRY

Our Energy Education Centers offer online and hands-on courses to help you maximize your customer's HVAC/R system performance.

Sign up to take a class with us at sce.com/classes



Our ASHRAE Tri-County leaders for the 2022-2023 season!

OFFICERS

President: Walter Escamilla / Goss Engineering Inc.

President Elect: Kendal Smith / Dawson Co.

Secretary: Abhimanyu Sah / Willdan Energy Solutions

Treasurer: Jhonattan Sebastian / Willdan Energy Solutions

BOARD OF GOVERNORS

Past President: Manny Perez / CDI Curbs

Board Member: Felix Monterroso / Willdan Energy Solutions

Board Member: Kakeru Fujikawa / Goss Engineering Inc.

I pledge allegiance



First Commercial Usage of Heat Pumps in 1948!

Page 1

Introduction: A Heat Pump in an Office Building

The use of heat pumps for the heating and cooling of the Equitable Building, initiated in 1948, was a pioneering achievement in the Western hemisphere. The theoretical conception of the heat pump was described in a neglected book, published in 1824, and written by a young French army officer, Sadi Carnot. Its practical application on a large scale is attributable to designers J. Donald Kroeker and Ray C. Chewning; building engineer, Charles E. Graham, and architect Pietro Belluschi. In 1948 if one were to predict the site of the first commercial heat pump installation in the US, Portland, Oregon would probably not even be on the list. Located in the north end of the Willamette Valley, the confluence of the Willamette River and the Columbia River, Portland enjoys a moderate climate. Winter average temperature is approximately 38°, while the summer average is 64°F. In 1948 the standard for building design because of the moderate temperatures in the summertime, did not require air conditioning in the Willamette Valley. The time that Equitable Savings & Loan decided to build a new headquarters building in Portland, the chairman of the board was Ralph H. Cake, a Portland native born in 1891. During the war there had been a moratorium on the construction of commercial buildings. In 1946 the partial relaxation on commercial building was granted under a permit system, and a federal office was created to review the applications and grant permits. Anticipating this procedure, Mr. Cake went to Washington, D.C. carrying plans for the new building. After a conference with the Administrator, assured approval was given, resulting in the first permit for construction of a large commercial building in a nation following World War II. This building was to be unique in the following ways: It was the first architectural style of a building that was to become standard for the next several decades. The building design by Pietro Belluschi, a nationally prominent Portland architect, was the first to use the natural colored aluminum sheathing, cast in anodized aluminum spandrels and heat absorbing double plate, green tinted windows. The use of aluminum in a Portland building was a natural, because of the production of aluminum in the northwest which was a result of the low-cost available hydroelectric power. A building of this type with no opening windows required an air conditioning system capable of providing an environment of comfort through summer and winter conditions. Ralph Cake had insisted on air conditioning in his buildings and heard about the heat pump used in England. Being a man of innovation he pressed for the use of the heat pump in this building. The office of J. Donald Kroeker was selected as the engineering firm to design the heating, ventilating and air conditioning system incorporating the first heat pump installation in the western hemisphere. Site clearance began in May 1946, and the building grand opening was held in January 1948.



Equitable Building,
Portland, Oregon

First Commercial Usage of Heat Pumps in 1948!

Page 2

SUMMARY—A description of the largest heat pump installation in the U.S. Year around air conditioning is effected by automatic switch-over from heating and cooling as required. Special features include heat recovery from ventilation exhaust air and heating of incoming ventilation air with waste cooling water resulting in a reduction of normal heat requirements by one third. Water at two different temperatures is supplied by wells of different depths. No provision is made for auxiliary heating. Circulated air is the heating or cooling medium arranged to permit change of partitions without effect on distribution of air. Comprised of 12 rental office stories, basement, and two penthouse levels, the building rises 200 ft above the street; is 200 x 100 ft at the street level and 62 x 200 ft at the third floor and above; has a floor space of 212,000 sq ft, and a volume of 2,275,000 cu ft; is the first all aluminum-clad building in the country; and incorporates some unusual architectural features, such as fixed, double glazed, column-to-column windows flush with the building faces throughout, neither horizontal nor vertical exterior reveals, and utmost flexibility of repartitioning without affecting electrical and mechanical factors.

Heat Pump—Water to Water

The typical room air circuit occurs on 13 levels. The heat source is well water pumped from two warm wells, roughly 150 ft deep, one of 64½°F at 195 gpm, the other 62½°F at 450 gpm, and is disposed to a 57°F well 510 ft deep. Four condensing units of the hermetically-sealed, diffusion centrifugal, constant-speed type, two of 200 rated ton capacity using Freon 11 and two of 70 ton rated capacity using Freon 113, are the basic heat pumps. In addition to circulating pumps in separate heating and cooling circuits shown, settling tank pumps are used to introduce well water from a settling or storage tank into the heating or cooling circuits as discussed in the following paragraphs. The heating or warm water circuit is a closed system when heating is the greater, during which time a thermostat in the return, through a step controller, determines the number and selection of condensing units to be operated. The evaporator, or cooling circuit, receives well water through settling tank pumps in a quantity determined by thermostat T1 in the chilled water return, operating valve W1. The chilled water is circulated to cooling coils in the fan units and then, after recovering heat from exhaust air and in turn heating ventilation air, is wasted to the casing of the cool well.

No Auxiliary Heat Provided

Another unusual feature of the heat pump installation is that it has no provision for auxiliary heat, which to date has been incorporated in other applications larger than residential. The capacity required for cooling was so far in excess of that necessary for heating, since one-third of the load at heating design temperature was provided by waste chilled water that no auxiliary source was seen justified.



Donald Kroeker, (right), the engineer for the original heat pump system in the Commonwealth Building, acted as the consulting engineer for the new installation. Much of the building's original system was utilized in the change-over.

First Commercial Usage of Heat Pumps in 1948!

Page 3

Costs

Decision to accomplish heating by means of the heat pump was reached after considering first and operating costs, both showing economical feasibility. Use of the district steam available in heating coils would have made temperature control by air mixing from plenum chambers less accurate and would have required greater cooling capacity to offset Donald Kroeker, (right), the engineer for the original heat pump system in the Commonwealth Building, acted as the consulting engineer for the new installation. Much of the building's original system was utilized in the change-over. damper leakage. The same was seen true, though to a lesser degree, in use of district steam to heat water for circulation through the coils in the fan units. The saving in first cost by either system was seen as being within one percent of that of the installation as made. Cost of the installation complete was \$0.29 per cu ft, or roughly \$1,250.00 per rated ton. While average operating costs cannot be accurately predicted, and were expected to vary widely with seasons, reasonably reliable comparisons were made. On the basis of a coefficient of performance for heating of 3.5, a 7-mill per kilowatt hour power rate, and a weighted value of waste chilled water utilization, a cost of \$0.46 per million Btu for heating was estimated. The applicable rate indicated for district steam during design was 22 percent higher. Steam rates have increased since that time.

Heating is Largely By-Product

During all normal heating weather a supply of by-product heat is available from cooling. Had steam been used for heating, this by-product would have been wasted. The heat pump made its utilization possible. Further, This heat pump, a part of the new installation, has the capacity to run 300 tons of refrigeration. It is one of two heat pumps which heat and cool the Commonwealth Building. When both pumps are running, the system can handle 700 tons of refrigeration. since air conditioning was a requirement, this cooling load was present in any case. Actually there was no heating period and no cooling season as such. It was difficult to discard the age honored concept that there must be these two separate seasons and that for comfort below 65°F outside must be charged to heating. Yet, in this instance, this clearly was not the case. In computing its estimate, the power company was therefore requested to charge to heating only the heating load in excess of the by-product from cooling. Further, on the same basis, the company was requested to charge to heating only the portion of the maximum heating demand for any month which exceeded the maximum cooling demand for that month. Another factor apparent on preliminary analysis was that the estimated building demand normally occurs at 4:30 p.m. and that, except at design heating conditions which do not recur each year, the morning pick-up load does not impose the maximum demand, making it necessary to investigate only the 4:30 p.m. conditions.




This heat pump, a part of the new installation, has the capacity to run 300 tons of refrigeration. It is one of two heat pumps which heat and cool the Commonwealth Building. When both pumps are running, the system can handle 700 tons of refrigeration.

First Commercial Usage of Heat Pumps in 1948!

Page 4

Heating COP for Representative Year Computed

The normal building demand for lights and power, chiefly for elevators, was estimated at 468 kw, the monthly consumption at 113,000 kwhr. The constant fan load was estimated at 67 kw and 23,692 kwhr. All power consumption in excess of 100,000 kwhr. is billed at 3.15 mills, all demand in excess of 10 kw at \$1.00 per kilowatt. The heating load for 1940 integrated under normal heating curves, plus heating accomplished with chilled waste water was computed at 5.01 billion Btu, the power consumption chargeable to heating at 99,000 kwhr or 340 million Btu. Related to each other these figures result in the fantastic job COP for heating of 14.8. Including auxiliaries chargeable to heating, this job COP for heating drops to 7.8. Auxiliaries include deep well pumps, settling tank pumps, and warm water circulating pumps. Inclusion of the latter in auxiliaries chargeable to heating is questionable, inasmuch as had steam been used for heating, a hot water generator would have been provided to furnish warm water for circulation to coils. In general, in any complex heating and cooling system, a coefficient of performance is meaningless without detailed specification of division of load between heating and cooling as herein attempted. In this application, if it had been contemplated to use steam for heating with the heat pump adapted independently for cooling, the internal cooling, or the minimum cooling requirement, would have been accomplished with outside air reheated as required at temperatures below 60°F, and a COP materially lower would have been shown. Outside air was not used for the internal or minimum cooling, inasmuch as to do so would have required equipment arrangement on each floor, encroaching on rentable floor space and would have necessitated additional complexity in automatic control.

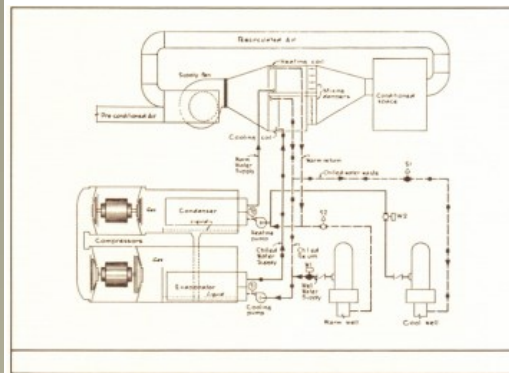

Basic Heat Pump Scheme.

Heating Cycle.

Actual Performance

The above performance data were based on design computations in 1947. Subsequently, actual conditions and performance were established in 1952-53 from recordings of power input to the heat pumps and numerous auxiliaries, such as pumps. The major change found was an increase in "Actual Cooling Load" over that predicted on the basis of design analyses. Over its 30 years of operation, some changes have been necessary, such as replacing all water chillers, but the performance is excellent. In 1953, the comparative costs of normal sources of energy would have been for use of district steam, 6.38 times that used by the heat pump system, and 4.44 for the use of oil to accomplish the heating and cooling required. As with any modern technological system, change is inevitable over time. Since the original installation, all the heat chillers have been replaced. The building and the capacity expanded. The building has also been expanded by the addition of approximately 30,000 sq. ft. An additional floor and expansions floor 4, 5, and 6. The original design the well water was circulated through the chillers and to the heating coils of the various floor air circulation systems. Subsequent scaling and corrosion damage to those chillers coils on each floor led to the installation of heat exchangers so that there was a closed system of treated water circulated through the coils and to minimize any scaling and corrosion damage. This also reduced the effectiveness of the system somewhat because of the heat exchanger efficiency. Today, the Equitable Building heat pump provides an economical method of heating and cooling and would comply with the standards of the new federal building Energy Performance Standards being studied and promulgated today.

2022-2023 PARTIAL ROSTER



Officers

President	Walter Escamilla Goss Engineering, Inc. — 951-340-1977
President-Elect	Kendal Smith Dawson Co. — 626-429-9312
Secretary	Abhimanyu Sah Willdan Energy Solutions — 662-360-6008
Treasurer	Jhonattan Sebastian Willdan Energy Solutions — 323-684-6741

Board of Governors

Manny Perez CDI Curbs — 562-301-4589
Kakeru Fujikawa Goss Engineering, Inc. — 714-310-8126
Felix Monterroso Willdan Energy Solutions — 626-629-9658

Committee Chairs

Chapter Technology Transfer	Kakeru Fujikawa Goss Engineering, Inc. — 714-310-8126
Student Activities	Kevin Le ACCO Engineered Systems - 626-586-2481
Research Promotion	Jim Toda Custom Cooling Company — 909-599-9222
Membership Promotion	Manny Perez CDI Curbs — 562-301-4589
Young Engineers in ASHRAE (YEA)	Felix Monterroso Willdan Energy Solutions — 626-629-9658
Newsletter Editor	Jim Toda Custom Cooling Company — 909-599-9222



Everyone in Tri-County is responsible for building a better tomorrow!

Tri-County SUPER HEAT

CELEBRATING
YEARS

34 1989-2023

TRI-COUNTY ASHRAE!

P A S T P R E S I D E N T S

1988-1989	SUKHDEV MATHAUDHU	2014-2015	RYAN RODRIGUEZ
1989-1990	SUKHDEV MATHAUDHU	2015-2016	SHAW GENTRY
1990-1991	JEFF LEONARD	2016-2017	CHRIS ROBLES
1991-1992	DEL THOMAS	2017-2018	IAN VILLAZANA
1992-1993	TONY PIERCE	2018-2019	KAKERU FUJIKAWA
1993-1994	GREG MORIN	2019-2020	FELIX MONTERROSO
1994-1995	TONY HENKEL	2020-2021	MICHAEL FRANZEN
1995-1996	JOHN HAVILAND	2021-2022	MANNY PEREZ
1996-1997	JOEL CARTER		
1997-1998	CHANDRA CHINDE		
1998-1999	JIM TODA		
1999-2000	RICHARD MCLEOD		
2000-2001	KERRY PARKER		
2001-2002	DEBRA CHAVIRA-SMITH		
2002-2003	LUCAS HYMAN		
2003-2004	JOE SANDERS		
2004-2005	BOB GASTEL		
2005-2006	ART ANDRES		
2006-2007	JIM PARKER		
2007-2008	KYLE LANDIS		
2008-2009	RICK CREED		
2009-2010	ROBERT MORSE		
2010-2011	TIM HALD		
2011-2012	JAIME LOPEZ		
2012-2013	ERICK DELGADO		
2013-2014	NICOLAS ROSNER		

— journal of the tri-county chapter of the —

American Society of Heating, Refrigerating, and Air Conditioning Engineers

ASHRAE, founded in 1894, is an international organization of more than 50,000 persons. Its sole objective is to advance through research, standards writing, publishing and continuing education the arts and sciences of heating, ventilation, air conditioning and refrigeration to serve the evolving needs of the public.