

4 Firefighter Command Post

Team to consist of 4 members.

Equipment to be supplied: Two hand lines 150' - 1 3/4" with nozzles and shut offs, platforms, kiddie pools, two sections hard suction & blindfolds. (Mask Painted black) (Nomex Hood on backwards if needed)

Equipment to bring: Full Structural Turnout Gear with all liners installed.

Event: Team Member #1 (Incident Commander) stands in a kiddie pool and must remain in the pool for the duration of the event. The IC must wear full Structural turnout gear. Their helmet must have a face shield or goggles. The IC's coat must be worn with the opening in the front, as normal. The IC's job is to shout out commands or directions to their teammates so they can (1) locate the hose and nozzle quicker, and (2) direct the water stream into the kiddie pool. Team Members #2, 3 & 4 must wear full PPE, with blackened-out SCBA Masks provided by the Association (No SCBA Pack). These team members will be disoriented by judges and then be placed on their knees, each Team will be placed in the same positions and when time starts, they will search for a charged hose line, and locate the nozzle. Once they have located their nozzle, they should move to the shooting line (hard suction hose) and attempt to hit team member #1 in the chest with the water stream in such a fashion to collect water in the pool. Team member #1 will be giving commands to adjust the aim of the water stream. After 1 minute and 30 seconds the water will be shut off by the truck operator. The team with the most water in their pool (measured by depth in inches) will be the winner of that round. This will be a single elimination event.

Penalties: Circumventing the blackened –out SCBA mask = Disqualification from the event.

Shooting position significantly forward of the shooting line = Disqualification from the event.


Maliciously interfering with the opposing team = Disqualification from the event.

Helmet falls off (5 seconds per infraction)



Notes:

The Apparatus will be placed far enough away as to not interfere with noise. Two sections of 2.5" hose will be hooked to the apparatus and then gated by a 2.5" gated WYE down to two 1 3/4" attack lines. The unit pressure will be 90 PSI during the event. The IC may not leave the pool until instructed to do so by the judges. Wringing water out of the PPE is encouraged. There will be two different measurements by separate judges.

Command Post

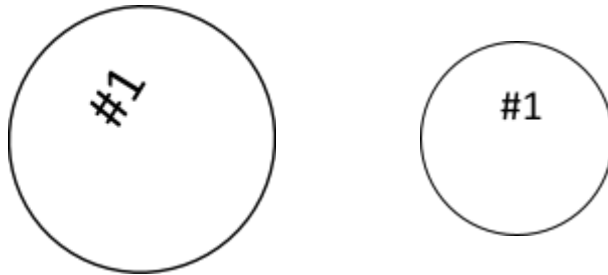

Kiddie Pools

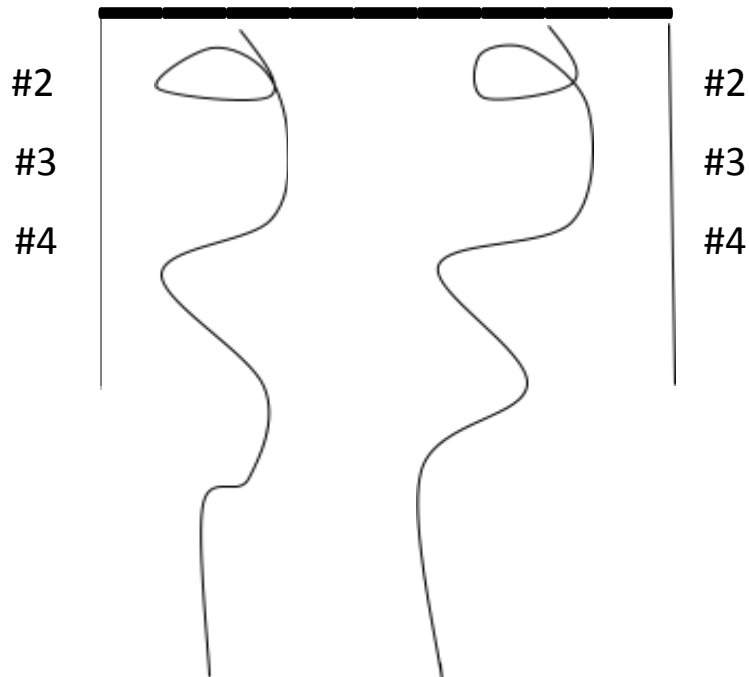

Shooting Line

Charged Hose lines



Fire Apparatus