UPS Remote Status Panel

Description:

UPS Remote Status Panel (URSP) is used to remotely monitor the alarm condition and real time state of any UPS. The URSP is wall mounted and can be located up to 1,000 feet from the UPS. The panel uses LED's to visually display the monitored UPS input status, the output that is being used and any UPS fault conditions. The URSP also has an audible alarm to warn of UPS fault conditions.

UPS AC Input	UPS Charger / Rectifier	UPS System Batteries	UPS Inverter
UPS Output	Load on Bypass	UPS Fault	UPS Overload
UPS Input Failure	UPS Low Battery	Audible Alarm Silenced	Battery BU Status

Assembly Overview

- Remotely monitor UPS systems from up to 1,000 ft.
- Visual indication with audible alarm
- Internal battery backup
- Powder coat finish
- ETL listed to UL 1778 and CSA certified

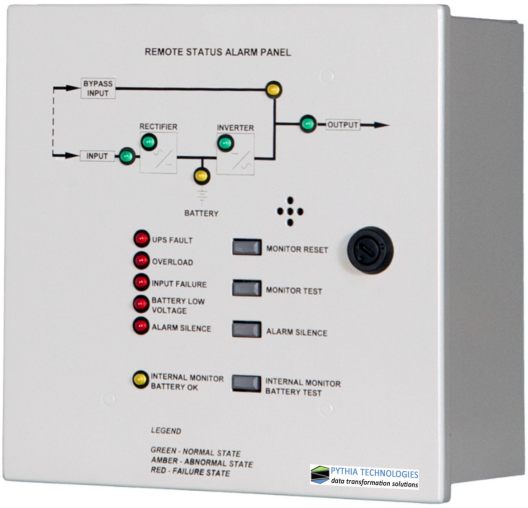

Assembly

CS0-UPS
External Power Supply Adapter

Dimensions

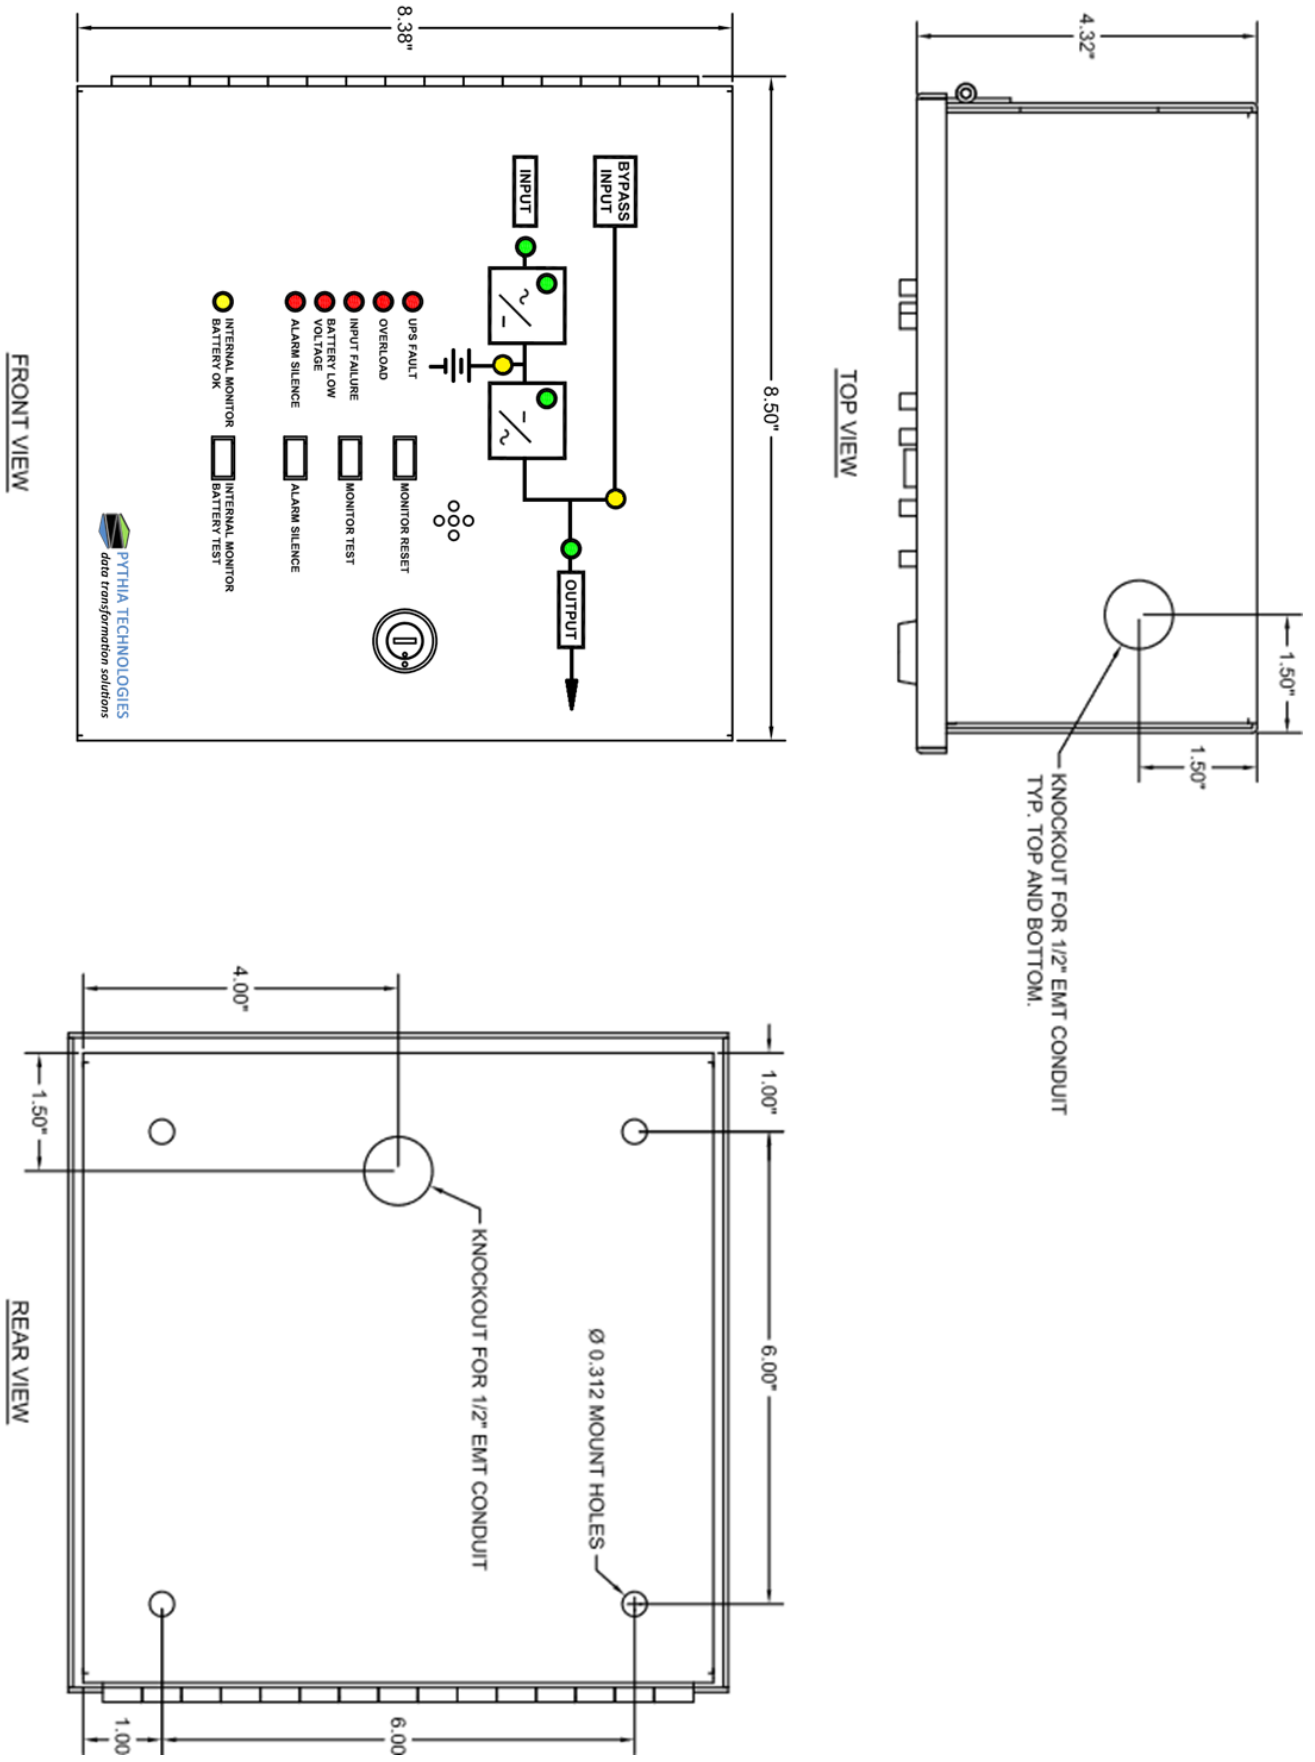
FRONT VIEW
8.38"
8.50"
INPUT
BYPASS INPUT
OUTPUT
UPS FAULT
OVERLOAD
INPUT FAILURE
BATTERY LOW VOLTAGE
ALARM SILENCE
INTERNAL MONITOR BATTERY OK
MONITOR RESET
MONITOR TEST
ALARM SILENCE
INTERNAL MONITOR BATTERY TEST
PYTHIA TECHNOLOGIES
data transformation solutions
TOP VIEW
4.32"
1.50"
1.50"
KNOCKOUT FOR 1/2" EMT CONDUIT
TYP. TOP AND BOTTOM.
REAR VIEW
4.00"
1.50"
1.00"
6.00"
KNOCKOUT FOR 1/2" EMT CONDUIT
Ø 0.312 MOUNT HOLES
1.00
6.00

Connections

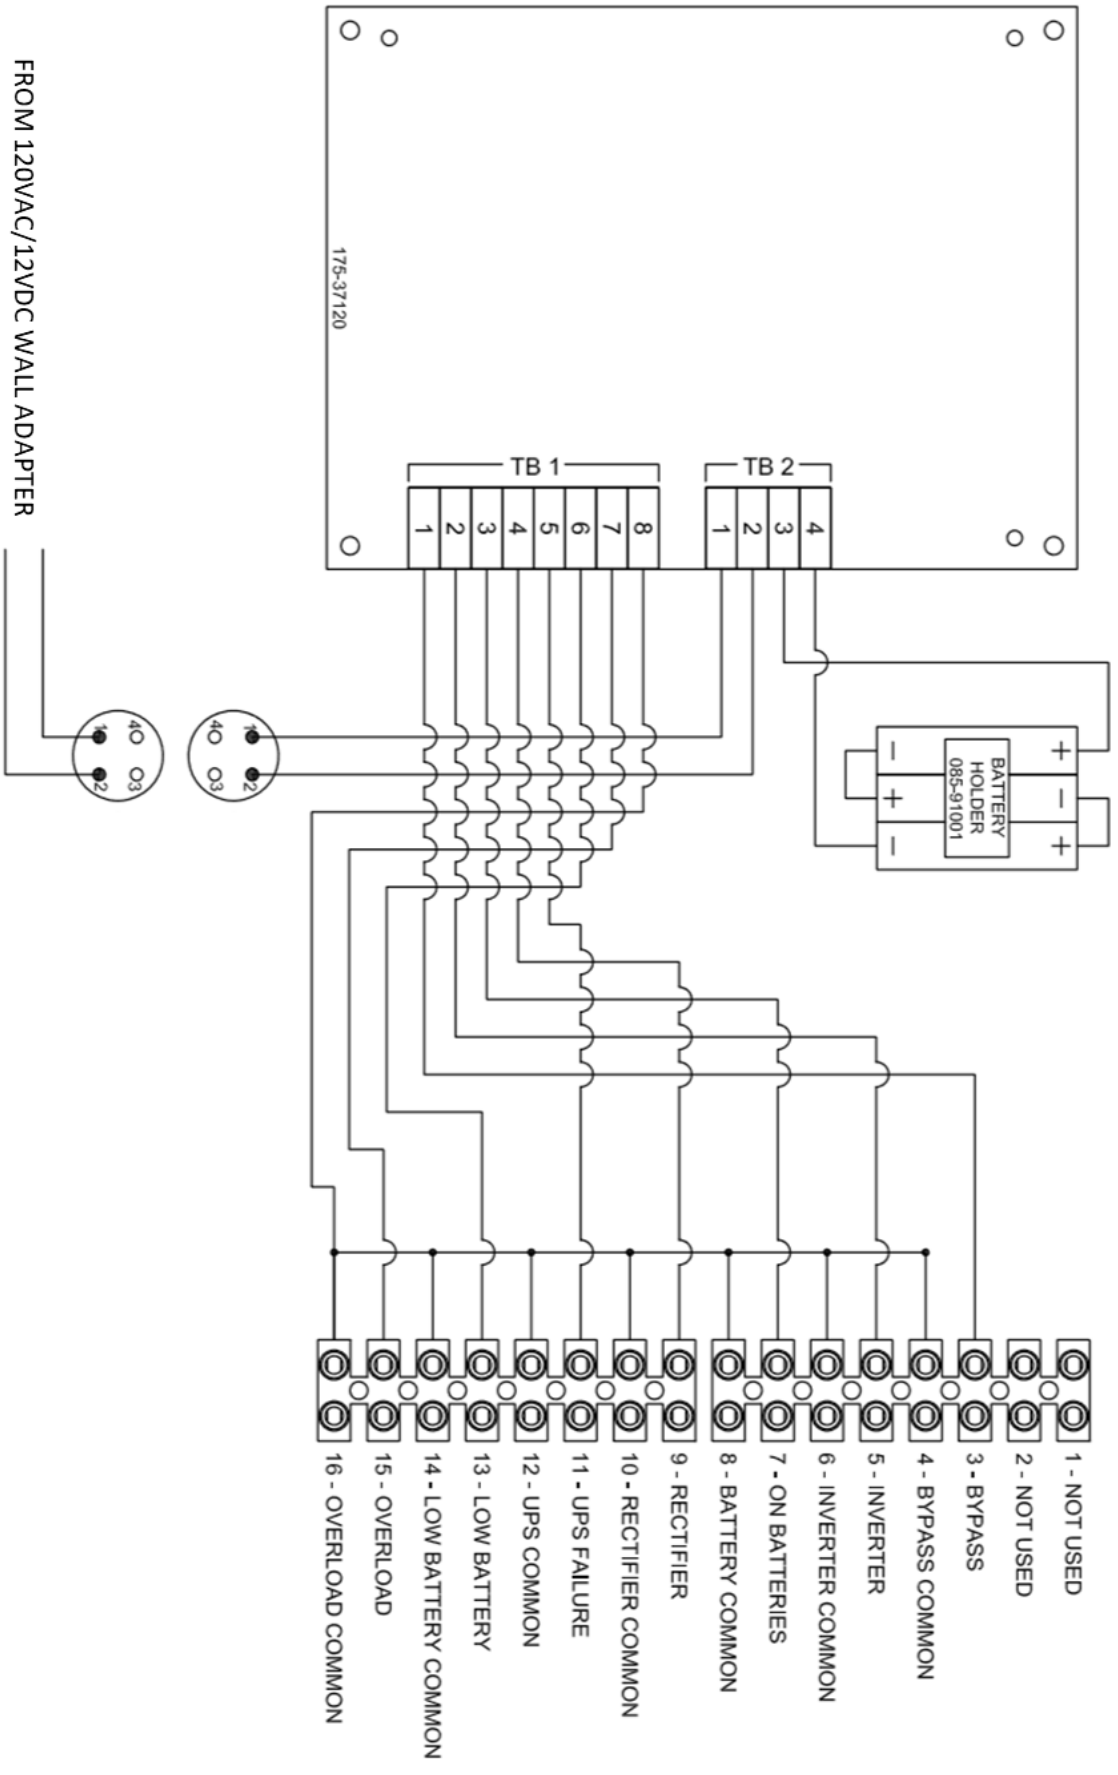

Key Features:

Monitor all UPS critical alarms
Remote contacts can be 1000 feet away
Audible and Visual indicators of Alarms
Battery backed up for extended uptime
UL and CSA Listed

SPECIFICATIONS

Communications	None
Alarm Inputs	7
Input Type	Dry-contact only / zero voltage relays or contacts
Dimensions	8.4” x 8.5” x 4.35”
Weight	6.0lbs
Certification	UL 1778, CSA

Other Specifications

none	

Ordering

CS0-UPS
Call for alternative assembly pricing

PYTHIA TECHNOLOGIES
data transformation solutions

175 S. Sandusky Street, Suite 321 Delaware OH 43015 Tel. 614.363.2272 Fax 740.693.8409

Sales@pythiatech.com

© 2018 Pythia Technologies, Inc.

All rights reserved throughout the world.

Specification may change at anytime without notice.

Document #: SPEC_CS0-UPS_001_0818