

CarbonFree Fort Frances Project
Draft Project Description Report

H375736-0000-840-066-0001


| | | | | | |
|------------|------|------------------|----------------------------|--------------------------|---|
| | | | <i>Hoffmann, Alexander</i> | <i>Thompson, Shanley</i> |  |
| 2025-08-20 | 3 | Approved for Use | A. Hoffman | S. Thompson | K. Vukovics |
| 2025-05-12 | 2 | Approved for Use | A. Nerino | S. Thompson | K. Vukovics |
| 2025-04-17 | 1 | Approved for Use | A. Nerino | S. Thompson | K. Vukovics |
| 2025-03-28 | 0 | Approved for Use | A. Nerino | S. Thompson | K. Vukovics |
| DATE | REV. | STATUS | PREPARED BY | CHECKED BY | APPROVED BY |
| | | | | Discipline Lead | Functional Manager |

Table of Contents

| | |
|--|------------|
| Report Disclaimer | ii |
| Table of Concordance | iii |
| 1. Introduction..... | 1 |
| 1.1 Legislative Requirements | 1 |
| 1.2 Purpose of Report..... | 2 |
| 2. General Information Requirements | 3 |
| 2.1 General Information | 3 |
| 2.2 Contacts | 4 |
| 2.3 Federal Involvement | 4 |
| 2.4 Authorizations Required | 4 |
| 3. Project Information..... | 5 |
| 3.1 Land Ownership..... | 5 |
| 3.2 Energy Sources for Generation | 6 |
| 3.3 Name Plate Capacity | 6 |
| 3.4 Class of the Renewable Energy Facility | 6 |
| 3.5 Project Components | 6 |
| 3.5.1 Project Layout..... | 6 |
| 3.6 Project Activities..... | 7 |
| 3.6.1 Assessments and Surveys | 7 |
| 3.6.2 Construction..... | 8 |
| 3.6.3 Operation and Maintenance | 10 |
| 3.6.4 Decommissioning | 14 |
| 4. Potential Negative Environmental Effects | 14 |
| 4.1 Preliminary Records Review and Site Visit | 15 |

List of Tables

| | |
|---|----|
| Table 4-1: Potential Negative Environmental Effects | 16 |
|---|----|

List of Figures

| | |
|--|---|
| Figure 3-1: Typical View of PV, Tracker and Racking Set Up | 7 |
|--|---|

List of Appendices

Appendix A Project Location

Report Disclaimer

This report has been prepared by Hatch Ltd. (Hatch) for the sole and exclusive use of Carbon Free Fort Frances Ltd. (the “Client”) for the purpose of assisting the Client in making decisions with respect to the development of a proposed solar photovoltaic project and shall not be (a) used for any other purpose, or (b) provided to, relied upon or used by any third party.

This report contains opinions, conclusions and recommendations made by Hatch, using its professional judgment and reasonable care. Any use of or reliance upon this report by the Client is subject to the following conditions:

- the report being read in the context of and subject to the terms of the agreement between Hatch and the Client including any methodologies, procedures, techniques, assumptions and other relevant terms or conditions that were specified or agreed therein;
- the report being read as a whole, with sections or parts hereof read or relied upon in context;
- the conditions of the Project Location may change over time (or may have already changed) due to natural forces or human intervention, and Hatch takes no responsibility for the impact that such changes may have on the accuracy or validity of the observations, conclusions and recommendations set out in this report; and
- the report is based on information made available to Hatch by the Client or by certain third parties; and unless stated otherwise in the Agreement, Hatch has not verified the accuracy, completeness or validity of such information, makes no representation regarding its accuracy and hereby disclaims any liability in connection therewith.

Table of Concordance

The following concordance table cross-references the contents of this Project Description Report with each requirement identified in Table 1 of O. Reg. 359/09 so that the required information can be easily found within this report.

| Requirement per Table 1 of O. Reg. 359/09 | Draft Project Description Report Section |
|---|--|
| 1. Describe any energy sources to be used to generate electricity at the renewable energy generation facility. | Section 3.2 |
| 2. Describe the facilities, equipment or technology that will be used to convert the renewable energy source or any other energy source to electricity. | Section 3.5 |
| 3. If applicable, describe the class of the renewable energy generation facility. | Section 3.4 |
| 4. Describe the activities that will be engaged in as part of the renewable energy project. | Section 3.6 |
| 5. Describe the name plate capacity of the renewable energy generation facility. | Section 3.3 |
| 5.1 i) Describe how the electricity that is proposed to be generated is intended to be used, sold or supplied to other persons. ii) Identify the duration of any agreements in respect of the use, sale or supply of the electricity. iii) Whether the name plate capacity of the facility exceeds the quantity of electricity that is intended to be used, sold or supplied to other persons, and, if so, by how much. | To be added in Final report |
| 6. Describe the ownership of the land on which the project location is to be situated. | Section 3.1 |
| 7. Describe if the person proposing to engage in the project does not own the land on which the project location is to be situated, a description of the permissions that are required to access the land and whether they have been obtained. | Section 3.1 |
| 8. Describe any negative environmental effects that may result from engaging in the project. | Section 4, Table 4-1 |
| 9. If the project is in respect of a Class 2 wind facility and it is determined that the project location is not on a property described in Column 1 of the Table to section 19, provide a summary of the matters addressed in making the determination. | N/A |
| 10. If the project is in respect of a Class 2 wind facility in respect of which section 20 applies and it is determined that the project location does not meet one of the descriptions set out in subsection 20 (2) or that the project location is not in an area described in subsection 20 (3), provide a summary of the matters addressed in making the determination. | N/A |
| 11. Provide an unbound, well-marked, legible and reproducible map that is an appropriate size to fit on a 215 mm by 280 mm page, showing the project location and the land within 300 m of the project location. | Appendix A |

1. Introduction

CarbonFree Fort Frances Ltd. (CarbonFree) is proposing to develop a 140-megawatt (MW) Class 3 solar photovoltaic (PV) project adjacent to Highway 611 in the unincorporated township of Miscampbell, approximately 7.5 km northwest of Fort Frances.

The proposed CarbonFree Fort Frances Project (hereinafter referred to as the Project) is a renewable energy generation facility which will use solar PV technology to generate electricity. Electricity generated by solar PV panels will be converted from direct current (DC) to alternating current (AC) by inverters and then stepped up (via pad-mounted inverters, medium voltage transformers and a main substation transformer) to 230 kilovolts (kV) prior to being connected to the existing Hydro One Networks Inc. (HONI) transmission line.

The Project aims to contribute to the government of Ontario's goal of accelerating new electricity generation from renewable sources to support the province's growing energy needs. Accordingly, CarbonFree intends to enter into an agreement for the sale or supply of electricity, the quantity of which will be commensurate with the name plate capacity of the facility.

1.1 Legislative Requirements

Ontario Regulation (O. Reg.) 359/09 – Renewable Energy Approvals Under Part V.0.1 of the Act, (herein referred to as the REA Regulation), came into force on September 24, 2009, and identifies the Renewable Energy Approval (REA) requirements for renewable energy generation facilities in Ontario. As per the REA Regulation (Part II, Section 4), ground mounted solar facilities with a name plate capacity greater than 10 kilowatts (kW) are classified as Class 3 solar facilities and require a REA.

Section 13 of the REA Regulation requires proponents of Class 3 solar projects to prepare a Project Description Report (PDR). As prescribed by Table 1 of O. Reg. 359/09, the PDR shall describe the following:

1. “Any energy sources to be used to generate electricity at the renewable energy generation facility.
2. The facilities, equipment or technology that will be used to convert the renewable energy source or any other energy source to electricity.
3. If applicable, the class of the renewable energy generation facility.
4. The activities that will be engaged in as part of the renewable energy project.
5. The name plate capacity of the renewable energy generation facility.

6. How the requirement set out in Section 57.2 is satisfied, including the following:
 - i. A description of how the electricity that is proposed to be generated is intended to be used, sold or supplied to other persons;
 - ii. The duration of any agreements in respect of the use, sale or supply of the electricity; and
 - iii. Whether the name plate capacity of the facility exceeds the quantity of electricity that is intended to be used, sold or supplied to other persons and, if so, by how much.
7. The ownership of the land on which the Project Location is to be situated.
8. Any negative environmental effects that may result from engaging in the Project.
9. An unbound, well-marked, legible and reproducible map that is an appropriate size to fit on a 215 mm by 280 mm page, showing the Project Location and the land within 300 m of the Project Location."

A draft of the PDR must be made available to the public, the local municipality and identified Indigenous communities, at least 60 days prior to the first and final public consultation meetings in accordance with O. Reg. 359/09.

1.2 Purpose of Report

The PDR is one of the first Project documents prepared once the REA process commences and serves several purposes. Initial drafts of the Report are used to provide preliminary information regarding the Project to the public, indigenous groups, municipalities and other government agencies. As the REA process progresses, the PDR will be updated based on information obtained from various studies and data collection activities as well as preliminary planning and engineering of the Project. As a consequence, the final version of the PDR will serve as a comprehensive overview document that summarizes all of the important information about the Project.

Section 2 of the PDR describes general information about the Project including the Project name, location and contact information. Section 3 describes the Project components, the major construction activities, operational aspects and decommissioning. Section 4 describes the potential environmental effects associated with the Project's construction, operation and decommissioning phases and the proposed mitigation measures to prevent/minimize those effects.

This PDR has been prepared in accordance with the requirements identified in Table 1 of O. Reg. 359/09, as well as the guidance provided in the Ministry of the Environment Conservation and Parks (MECP) *Guidance for Preparing the Project Description Report as part of an application under O. Reg. 359/09* (MECP, 2023).

2. General Information Requirements

2.1 General Information

The Project Location¹, per the definition in the REA Regulation, includes the entire footprint of the Project, including all temporary and permanent parts of the land that will be utilized. This includes the following features:

- All areas where vegetation will be cleared;
- Temporary and permanent access roads;
- Solar panel arrays;
- Inverters/pad-mounted transformers;
- Substation yard, main substation transformer and communication tower;
- Temporary laydown area for construction;
- Fencing; and
- Electrical distribution line from the substation to the interconnection point.

The properties are expected to be privately owned or leased by a CarbonFree-related entity. There are nine main parcels that will make up the Project Location. The Project is expected to cover a total area of approximately 274 ha, with the total area of the properties involved covering a total of 447 ha. The Property Identification Numbers (PINs) for these are as follows:

- 560150090
- 560150097
- 560150084
- 560150092
- 560150117
- 560150091
- 560150102
- 560150132

In addition, the following PINs contain easements for the MV (or HV) line to the point of connection:

¹ Project Location means, when used in relation to a renewable energy project, a part of land and all or part of any building or structure in, on or over which a person is engaging in or proposes to engage in the project and any air space in which a person is engaging in or proposed to engage in the project" (O. Reg. 359/09, s. 1 (1)).

- 560150091
- 560150101
- 560150069
- 560150123.

The primary existing land use within the Project Location is agricultural and pasture. The Project Location is presented in Appendix A as Figure 1. Surrounding land uses found within 300 m of the Project location are primarily agriculture and undeveloped forested areas.

2.2 **Contacts**

CarbonFree Fort Frances Ltd. is the proponent of the Project. Contact information is as follows:

Doug Deeks
Vice President - Projects
CarbonFree Group
1 St Clair Ave W No. 801, Toronto, ON M4V 1K6
Tel: 647-408-9680
Email: Ddeeks@carbonfree.com

The Proponent has retained Hatch Ltd. (Hatch) to assist in meeting the REA requirements. Contact information for Hatch is as follows:

Shanley Thompson, Environmental Scientist
Hatch Ltd.
973 Balmoral St, Thunder Bay, ON P7B 0E2
Tel: 807-625-8731
Email: shanley.thompson@hatch.com

2.3 **Federal Involvement**

No Federal lands or resources will be utilized for the Project and based on the resources within the Project Location, issues under Federal jurisdiction are not anticipated. The Project is not expected to be subject to either the *Impact Assessment Act* (IAA) or the *Fisheries Act*. Therefore, no Federal involvement (including permits and approvals) is required.

General compliance with the *Migratory Birds Convention Act* is expected to be maintained through removing and managing vegetation outside of the breeding bird period (April to September) or where necessary completing nest sweeps ahead of vegetation clearing activities.

2.4 **Authorizations Required**

The Project may require the following permits, approvals and authorizations, as applicable.

- Federal Legislation:
 - ♦ *Migratory Birds Convention Act* - Compliance with the migratory breeding bird timing windows.
- Provincial Legislation:
 - ♦ *Environmental Protection Act* - Renewable Energy Approval.
 - ♦ *Ontario Endangered Species Act* - ESA Permit(s).
 - ♦ Ministry of Transportation (MTO) – encroachment permits and easements.
 - ♦ *Ontario Heritage Act* – Archaeological assessments and cultural heritage assessments focused on the proposed Project Location are being scheduled. It is expected that a confirmation letter will be received from the Ministry of Citizenship and Multiculturalism following completion and submission of these assessments.
- Local approvals:
 - ♦ Road board easements and agreements.

As part of the REA approval process, it is expected that a letter of confirmation will be required from the Ministry of Natural Resources following the completion of the Project's Natural Heritage Assessment Report and associated technical documents required to be included in the final REA application.

3. Project Information

The following sections are intended to satisfy the requirements of Table 1 of O. Reg. 359/09: Section 10 – Project Description Report which directs the proponent to provide a description of the Project. Further details on the design of the Project will be provided in subsequent reports required as per O. Reg. 359/09, including the Construction Plan Report, Design and Operations Report and the Decommissioning Plan Report.

3.1 Land Ownership

The Project is proposed to be constructed on privately owned land. It is expected that the development will occur across approximately nine (9) separate parcels of land to facilitate the installation of solar panels and the transmission infrastructure required to connect to the existing grid. The northernmost properties will be utilized primarily for connecting to the existing HONI transmission network (as shown in Figure 1, Appendix A). The Project properties will be owned or leased by a related entity to the Project proponent which will lease or sublease the land to the Proponent. Easements are expected to be required to support electrical connections over Highway 611, Kliner Road and McFee Road. Ongoing consultation is being completed with the private landowners, Ministry of Transportation and Northern Municipal Services Office to determine the siting of easements and specific

requirements to facilitate the Project. Current property boundaries are depicted within Figure 1 of Appendix A.

3.2 Energy Sources for Generation

Solar energy will be used to generate electricity. No supplementary fuel sources are used in the generation of this renewable energy.

3.3 Name Plate Capacity

The DC name plate capacity of the solar panels will be 170 MW. The name plate grid connection (AC) capacity of the Project is expected to be 140 MW. The nameplate capacity will not exceed the quantity of electricity that is contracted to be sold to the IESO. Technical information related to the model and capacity of PV modules can be found in Section 3.5.

3.4 Class of the Renewable Energy Facility

The Project will be a Class 3 solar facility. That is, the Project is ground-mounted and greater than 10 kilowatts (kW).

3.5 Project Components

Figure 1 in Appendix A provides a conceptualized depiction of the Project including the Project Location boundaries, existing local roads, topographic contours, existing transmission line, land uses, natural features and waterbodies on and within 300 m of the Project Location.

The main components of the Project are expected to include the following:

- Approximately 272,636 solar PV modules, each 625 watts (W) and weighing about 33 kg, with approximate dimensions of 2,382 mm long by 1,134 mm wide by 30 mm thick.
- 4.4 MW AC inverters that will convert the direct current supplied by the PV modules to AC. Thirty pad-mounted 4.4 MVA (Megavolt-ampere) three-phase, liquid filled transformers that will 'step up' the voltage to 34.5 kV. Each installation will consist of a single 4.4 MW inverter and a single 4.4 MVA pad-mounted transformer.
- A gravel substation yard that will house an approximately 140 MVA substation transformer that will 'step up' the voltage from 34.5 kV to 230 kV, switchgear, control and monitoring equipment, and a communication tower.
- Approximately five entrance roads from Frog Creek Road, Highway 611, McFee Road, Kliner Road and Hayes Road and several gravel interior access roads.
- A chain link fence around the perimeter of the Project Location and a gated entrance.
- A surface water drainage system comprised of grassed swales, roadside ditches and culverts.

3.5.1 Project Layout

Upon exposure to sunlight, the solar modules convert solar radiation into DC electricity through a process referred to as the PV effect. This effect occurs when the sunlight energy is

transferred to semiconductors in the modules, which creates a corresponding electric current. The PV panels will be installed on racks mounted on tracking structures. The tracking structures are expected to be supported by steel piles, driven or screwed into the ground. Where necessary, these foundations may be supported by concrete. Tracking structures are expected to be oriented to the north-south, tracking the sun movement from east to west. A typical tracker system will have up to nine (9) foundation posts and up to 240 PV modules connected together by electrical wiring. The racks of modules will be arranged in long rows, typically spaced about 12 m apart east-to-west. The DC electrical current from the solar PV modules will be transmitted across the back of the modules and through underground wires connected to combiner boxes. The combiner boxes allow the connection of numerous incoming wires from the racks of modules into a single outgoing electrical cable. The DC electrical current from the combiner boxes will be transmitted through underground cabling connected to a 4.4 MW inverter. Each inverter will convert the DC electrical current to AC and medium voltage (MV) transformer will step up the voltage to 34.5 kV. The electricity, now at 34.5 kV (AC), will be transmitted through a combination of overhead and underground cabling to the main transformer situated in the substation yard, which will step up the voltage from 34.5 kV to 230 kV. Electricity will then flow from the substation yard through overhead electrical lines and connect to the transmission line at 230 kV.



Figure 3-1: Typical View of PV, Tracker and Racking Set Up²

3.6 Project Activities

In accordance with Table 1 of O. Reg. 359/09, the Project activities involved in the construction, operation and decommissioning phases of the Project are outlined in the following sections.

3.6.1 Assessments and Surveys

Site investigations and targeted field surveys are planned to take place between spring and fall 2025, as appropriate for each survey type, to meet REA process requirements. The results of these surveys may influence the layout of the Project. Site investigations and targeted field surveys may include the following:

² Example Image sourced from Arctech Skymart II Catalog. PV, tracker and racking technology used on site may vary.

- Ecological Land Classification;
- Wetland/Waterbody/Watercourse Delineation;
- Amphibian Surveys;
- Pileated Woodpecker Cavity Searches;
- Breeding Bird Surveys;
- Grassland bird Surveys; and
- Snag Surveys.

3.6.2 Construction

It is anticipated that construction of the Project will take between 18 months and 24 months, depending on time of year and various other factors. Prior to construction, the area will be surveyed, and any buried infrastructure will be located before commencing with site preparation. Construction is anticipated to start in late 2026, pending receipt of requisite permits and approvals.

3.6.2.1 Site Preparation

Prior to site preparation, a sediment and erosion control plan will be prepared and implemented. Trees and large standing vegetation will be cleared from areas where the PV arrays will be constructed. Meadow vegetation will be left in place to the extent possible. Locations of topsoil, timber and vegetation stockpiles will be pre-determined and not within 30 m of any identified waterbodies.

3.6.2.2 Access Road Construction

New primary access roads will be approximately 6 m wide and will be constructed of crushed gravel. Primary access roads will have entrances from Frog Creek Road, Highway 611, McFee Road, Kliner Road and Hayes Road. In addition, several smaller gravel roads, about 3 m to 5 m wide each, will be constructed within the interior areas of the Project Location. Exact dimensions and locations of access roads will be finalized in consultation with the Ministry of Transportation. Road construction will involve vegetation clearing (if necessary) and topsoil removal prior to the placement of a granular base. Ditches and culverts will be constructed, as necessary, to maintain drainage. Following construction, any access roads that are not required will be removed and restored by replacing the topsoil and seeding the area.

3.6.2.3 Laydown Area

A construction laydown area will occur on the Project Location, adjacent to where the solar PV arrays and substation are installed.

3.6.2.4 *Perimeter Fencing*

A chain link fence topped with barbed wire and access gates will be installed around the perimeter of the Project Location to prevent unauthorized access.

3.6.2.5 *Installation of Support Structures*

Foundations and/or support structures will be required beneath transformers, inverters and PV panels. Detailed engineering for the design of the foundations and support structures is yet to be completed. However, it is expected that the pads for the transformers and inverters will be concrete slab-on-grade. The PV panels will be installed on racks mounted on tracking structures. The tracking structures are expected to be supported by steel piles, driven or screwed into the ground. Concrete may be used to support or ballast the steel piles when necessary. It is estimated that up to 40,000 piles will be installed within the Project Location to support the tracking structures and the PV panels. Foundation construction and the installation of support structures will be subject to inspection prior to the installation of PV panels, and wiring.

3.6.2.6 *Installation of PV Modules, Trackers and Mounting Racks*

The solar PV modules will be mounted on racks mounted on tracking structures. Each tracker is comprised of a long steel torque tube (approximately 50 m to 100 m long) mounted on steel piles driven or screwed into the ground. A simple racking system will be assembled onto each torque tube, and the PV modules will be attached to the racking system. There will be approximately 2,700 trackers, each holding approximately 140 PV modules. The modules will be mounted on the racking system by installers with the help of a small mobile crane if needed.

3.6.2.7 *Substation Construction*

The substation yard will be located either at the northern extent of the parcel west adjacent Highway 611 or adjacent the point of interconnection on a separate parcel north of Hayes Road, adjacent to the existing HONI Right of Way (presented in Figure 1, Appendix A). Construction will include excavation of topsoil, installation of ground grid, foundation construction, construction of secondary containment, covering the area with crushed stone, installation of the substation transformer and other electrical equipment. Switchgear, protection and control equipment will be housed in a prefabricated, weatherproof building enclosure. The substation transformer will step up the voltage from 34.5 kV to 230 kV prior to connecting to the existing HONI 230 kV transmission line north of Hayes Road.

3.6.2.8 *Electrical Cable Installation*

A network of underground DC cabling will be required from the termination point of the PV array to the inverters and MV transformers, which will then convert the DC electricity to AC and step up the voltage to 34.5 kV. A network of overhead and underground AC cables may be required from the inverters, to connect the PV array to the proposed substation and HONI transmission system. A simple trenching device will be used to install the underground cables, whereby a slot is opened, the cable laid, and the soil replaced.

The overall length of the overhead MV transmission lines or high voltage (HV) transmission lines is dependent on the final location of the substation.

Regardless of substation location, approximately 1.5 km of overhead MV transmission lines are expected to run adjacent to Kliner and McFee Road and extend overtop Highway 611 and McFee Road to connect the solar arrays electrically.

If the substation is located on PIN 560150113, an additional 3 km of MV overhead transmission lines will be necessary to connect into the substation with a less than 500 m HV overhead line connecting to the existing 230 kV HONI transmission line located on the same property.

If the substation is located on PIN 560150091 an additional 3 km of HV overhead transmission line will be required to the point of interconnection with the existing 230 kV HONI transmission line.

3.6.2.9 *Electrical Distribution Line and Interconnection Point*

Connecting to the existing HONI 230 kV transmission line will require an overhead transmission line to be constructed between the Project substation yard and the point of interconnection (POI) with the existing HONI transmission line (presented in Figure 1, Appendix A).

3.6.2.10 *Testing and Commissioning*

Following the installation of all electrical components, testing and commissioning will be performed prior to start up and connection to the power grid. The solar modules, inverters, transformers and electrical cables will be checked for system continuity, reliability and performance. If problems or issues are identified, remedial corrections will be made prior to start up.

3.6.3 *Operation and Maintenance*

The Project will operate year-round and generate electricity during daylight hours. The amount of power generated will depend on daily weather conditions and sufficient solar irradiation. The Project will be operated remotely and accordingly, no employees will be on site with the exception of maintenance and inspection personnel or security staff (as needed). To ensure the safety and integrity of the Project, access will be limited to Project personnel and unauthorized public access will be prevented by fences, gates and security procedures.

Operationally, there are no significant hazards involved in the operation of the Project, nor are hazardous materials stored on site or created by the Project during its operation. The Project will not generate significant quantities of waste from its operation.

3.6.3.1 *Maintenance and Inspection*

The Project solar PV modules, inverters and transformers and other electrical equipment, wiring and electrical connections will be routinely inspected, typically on a monthly basis. Any broken or malfunctioning PV modules, electrical cabling or components will be repaired or

replaced by facility staff. Trash, debris and equipment parts replaced during maintenance and repair activities will be collected and properly stored in waste disposal bins. All waste collected during operation of the Project will be removed in accordance with provincial and local requirements.

Vegetative ground cover, drainage systems and trees will be monitored and maintained, typically on a monthly basis. Since suitable ground cover will be established under the PV modules, some form of vegetation abatement such as grass cutting may be required several times throughout the summer months and may extend outside of the fenced project area to maintain the fence line of the Project. No hazardous chemicals are anticipated to be used for regular maintenance or vegetation abatement activities and will only be considered for management of invasive species, where present. Limited and targeted use of herbicides will be applied by a licensed exterminator in accordance with the *Pesticides Act*, R.S.O. 1990, c. P.11 and O. Reg. 63/09 and will be used in accordance with the approved label for the product, along with standard mitigation measures for the herbicide. If required, water trucks will bring water to supply the water to support vegetative cover.

The Project Location, including any drainage features (e.g., grassed swales, culverts) and any sediment and erosion control measures (e.g., riprap protection, rock flow checks) will be visually inspected for any signs of erosion or sedimentation and recorded. Regular maintenance such as the cleanout of accumulated sediment and/or the removal of any debris blockage would be conducted at that time. If required, remedial works (e.g., stabilizing and/or reseeding of identified erosion areas) and repairs to any drainage features or sediment and erosion control measures will be implemented to minimize environmental impacts.

The need to clean the solar PV modules will be determined according to local weather conditions, such as the quantity and frequency of rain and snow at the Project Location. At the very most, it is expected that the modules will require cleaning quarterly, but it is possible that cleaning the modules will not be necessary at all. If required, water trucks will bring water to supply the water required. No chemicals will be used for the cleaning of the modules.

The transformers will be visually inspected on a quarterly basis and their status recorded. Any faulty equipment that could result in an oil leak will be repaired and any observed leaks will be cleaned up immediately by maintenance personnel. Secondary containment will be integrated into the design of the substation and will have the capacity to hold 110% of the mineral oil utilized in the transformer system. Transformer stations will be connected to a SCADA system that logs and communicates alarms in real time. Transformers will be monitored for oil levels, oil pressure, oil temperature, and gas accumulations to alert operators to faults so as identify potential issues or leaks. Spill response equipment will be left on site or in the maintenance trucks should leaks be observed.

During winter, primary access roads will be ploughed to clear snow to maintain access of personnel to Project facilities. Under most winter conditions, snow is expected to melt due to the module heating and the tilt of the modules. Under some conditions, manual snow removal may be performed by maintenance personnel who will clear the snow using a brush attached to a long pole.

3.6.3.2 *Stormwater Management*

A stormwater management design will be prepared to minimize any potential negative environmental effects to the existing drainage conditions (e.g., increased runoff, erosion and sedimentation) will not occur as a result of the Project. The following mitigation measures are expected to form part of the Project's stormwater management design:

- Existing drainage patterns within the Project Location will be maintained to the extent possible and/or as required to maintain the common law drainage rights of upstream or downstream riparian landowners.
- Following construction, the entire Project Location, with the exception of the access roads, will be re-vegetated with native grass or other suitable ground cover to promote surface water infiltration, filter storm water runoff and to prevent erosion.
- New drainage swales and channels will be constructed as enhanced (flat bottom) grassed swales to provide extended flow times, filtering of runoff and reduce the potential for erosion.
- Rainfall runoff from the solar modules, inverter building rooftops, transformer concrete pads (if not enclosed in an inverter building), interior roads and parking area will be directed to grassed or vegetated areas to promote infiltration and filtering of runoff by vegetation prior to its conveyance to on-site grassed swales.
- All transformers will use mineral oils or FR3 oils, which are non-toxic, non-bioaccumulating and readily biodegradable in the environment. All transformers will be routinely inspected and any faulty equipment that could result in an oil leak will be repaired. Secondary containment for the transformer substation will be incorporated into the substation design.
- Spill response equipment will be left on-site, and any observed leaks will be cleaned up immediately by maintenance personnel.

3.6.3.3 *Water Supply Facilities*

The Project does not require any on-site facilities to supply groundwater (wells) or surface water (ponds, watercourses) for operation of the Project. It is anticipated that water from rain and snow will be sufficient for cleaning the solar PV modules and maintaining vegetative cover on site; if not, the Proponent will contact local suppliers to provide water in tankers from off-site sources for this purpose. No chemicals will be used in the cleaning of the PV modules.

3.6.3.4 *Wastewater (Sewage) Facilities*

The Project will not generate any wastewater (sewage) or discharge any liquid effluent from its operation, nor does the Project require any on-site facilities for the collection, transmission, treatment or disposal of wastewater for operation of the Project.

During operation, sanitary facilities (e.g., permanent washrooms with a septic disposal system) are not required. If sanitary facilities are determined to be required, portable toilets, provided and serviced by a local sanitation company, will be used.

3.6.3.5 *Waste Disposal Facilities*

The Project will not generate significant quantities of waste from its operation. A small waste disposal bin(s) will be provided on site to collect any trash, debris or equipment parts replaced during routine maintenance of the Project during its operation. Periodically, when required, the Proponent will arrange for a licensed waste disposal company to empty the bins and haul the waste to an appropriate waste disposal facility off-site.

3.6.3.6 *Exhaust Equipment*

The Project has no facilities or equipment that will discharge contaminants or pollutants to the air (e.g., exhaust gases from emergency back-up diesel generators) during operation of the Project.

3.6.3.7 *Noise Generating Equipment*

Noise generating equipment during the operation of the Project is expected to be limited to inverters and transformers adjacent to the solar PV arrays and within the substation. Minor noise may be generated by tracker motors at intervals throughout the day. A noise study will be completed to review proposed locations of noise emitting equipment to confirm the applicable MECP and NPC-300 noise levels will not be exceeded during operation.

3.6.3.8 *Emergency Response and Communication Plan*

An Emergency Response and Communication Plan (ERCP) will be developed to ensure the safety of personnel, the public, and the environment throughout all phases of Project development. The plan will outline clear procedures for responding to potential emergencies such as severe weather, medical incidents, and equipment failures. It will also establish communication protocols with emergency services, regulatory agencies, and project stakeholders to ensure timely and effective information flow during and after any potential incidents. The ERCP will be reviewed regularly and updated as needed to reflect changes in project activities, site conditions, and regulatory requirements as development proceeds. The ERCP will be developed as part of the Designs and Operations Report, which outlines the exact site plan, design of the facility, how emergency communications will be handled, and details regarding operation of the facility including how environmental effects will be monitored and mitigated.

3.6.4 Decommissioning

The anticipated lifespan of the Project is approximately 25 years. At that time, the Project will be decommissioned or refurbished depending on market conditions and/or technological changes.

If the decision is to discontinue renewable energy generation, the decommissioning process would involve the following:

- Removal of the scrap metal and cabling. Where possible, these materials will be recycled, with non-recyclables taken to an approved disposal site.
- Removal of support structures and foundations; these materials will be recycled where possible.
- Cleanup and any necessary re-grading.

A Decommissioning Plan Report will be developed and published as part of the REA application process.

4. Potential Negative Environmental Effects

The potential negative environmental effects that may occur during construction, operation and decommissioning phases of the Project are described in Table 4-1. The Project is in the early development stages and thus, the details described herein are preliminary and will be revised following consultation and detailed environmental studies. The categories for the potential negative environmental effects were selected following the *Technical Guide to Renewable Energy Approvals* (MECP, 2023) and include:

- Cultural Heritage – includes protected properties, archaeological resources, and heritage resources;
- Natural Heritage – includes provincial parks or conservation reserves, Areas of Natural and Scientific Interest (ANSIs) (earth science and life science), southern wetlands, wildlife habitats, and woodlands;
- Water – includes waterbodies, such as lakes, permanent streams, intermittent streams and seepage areas;
- Air, Odour and Dust;
- Noise;
- Local Interests, Land Use and Infrastructure;
- Provincial and local infrastructure;
- Public Health and Safety;

- Areas Protected under Provincial Plans and Policies; and
- Other Resources.

Based on current knowledge of the Project, Project Location and standard/regulated environmental protection practices, proposed mitigation measures have been provided. Further details will be provided in subsequent reports [e.g., Natural Heritage Report, Water Assessment Report, Construction Plan Report, and where required, Environmental Impact Studies (EIS)]. Monitoring plans to confirm mitigation measures are having the intended effect will be made available in future Environmental Effects Monitoring Plans within the relevant reports (e.g., Natural Heritage Report, Water Assessment Report, Construction Plan Report).

As part of the REA process for the Project, if environmental features (e.g., natural features, waterbodies) are determined to be significant and within required setbacks from the Project, an EIS will be prepared. Any potential impacts identified in the EIS will have appropriate mitigation measures to minimize or eliminate negative effects.

4.1 Preliminary Records Review and Site Visit

A preliminary records review and site reconnaissance were conducted to support early-stage planning and natural heritage characterization for the Project. The records review included an evaluation of available provincial and regional data sources such as the Natural Heritage Information Centre (NHIC) Make-a-Map tool, Land Information Ontario (LIO), Crown Land Use Policy Atlas (CLUPA), and satellite imagery. The review focused on identifying the potential presence of species at risk (SAR), wetlands, watercourses, woodlands, and other natural heritage features within at least 300 m of the proposed Project location, consistent with Chapter 5 of the MECP's *Technical Guide for Renewable Energy Projects*.

A preliminary site reconnaissance was completed by Hatch Biologists in Spring 2025 to validate the findings of the records review, provide a baseline characterization of site conditions, and inform planning for future field investigations. The site was assessed on foot to the extent feasible, with the reconnaissance generally extending to a 300-m buffer around the Project location. At the time of the visit, photo documentation and georeferenced field notes were collected to support the identification and mapping of natural features and potential environmental constraints.

Table 4-1: Potential Negative Environmental Effects

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|-------------------|---|--|---|
| Cultural Heritage | Archaeological Resources | Excavations during Project construction may result in the discovery and/or disturbance of archaeological resources. | <p>An archaeological assessment will be undertaken by a licensed archaeologist at the proposed Project Location. The archaeological assessment process can include between 1 and 4 stages, beginning with a determination of the potential for archaeological resources (Stage 1), followed by a resource inventory (Stage 2), archaeological site assessment (Stage 3) and if necessary, mitigation (Stage 4).</p> <p>During construction, if an artifact is found, work will stop until a licensed archaeologist has cleared the area and approved that construction can re-commence, in accordance with Ministry of Citizenship and Multiculturalism requirements.</p> |
| | Protected Properties, Built Heritage and Cultural Heritage Landscapes | The proposed Project has the potential to cause negative effects to protected properties, built heritage and cultural heritage landscapes if such resources are identified in the vicinity of the proposed Project Location. | <p>If it is determined that there is a potential for heritage resources to be located at the Project Location a heritage assessment will be undertaken by heritage consultants or other qualified persons who have the appropriate expertise in the identification, evaluation and conservation of built heritage resources and cultural heritage landscapes and a heritage assessment report will be prepared to identify heritage resources, evaluate Project impacts and describe measures to be taken to avoid, eliminate or mitigate the impacts, where applicable.</p> <p>No protected properties or built heritage resources have been documented on or within 300 m of the Project Property. Further assessments are expected to confirm potential presence of built or cultural heritage landscapes.</p> |

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|------------------|---|--|---|
| Natural Heritage | Areas of Natural and Scientific Interest (ANSI) | No ANSIs were identified within 300 m of the Project Location. | None required. |
| | Wetlands | <p>There are currently five (5) unevaluated wetlands located within the boundaries of the Project footprint. In all cases solar PV and substation equipment and laydowns will be setback a minimum of 30 m from these features. Transmission line utility poles are yet to be sited but may overlap with two unevaluated wetlands. Efforts will be made to site the utility poles in locations outside of or minimally invasive to the wetlands.</p> <p>Further study is proposed to verify the boundaries and presence of wetland features.</p> <p>No Provincially Significant Northern Wetlands are known to occur within 300 m of the Project Location.</p> | <p>The Project Location has been setback 30 m from wetlands. Further studies will be completed in 2025 to confirm wetland boundaries and if necessary, setbacks will be adjusted to prevent impacts to wetlands.</p> <p>The results of these studies will be documented as part of the Natural Heritage Assessment being prepared. This document will be updated with conclusions pertaining to the likelihood, magnitude and significance of effects to these features</p> |
| | Woodland/Vegetation | The Project is located within areas of thickets, coniferous upland forest, mixed wood forests and agricultural lands. During construction, tree and vegetation removal will be necessary to facilitate the construction of the Project. | Work areas will be flagged to limit clearing and ensure it will not extend beyond the Project Location. |

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|----------|--|---|--|
| | Terrestrial Wildlife/ Wildlife Habitat (including species at risk) | Potential loss of wildlife habitat and potential wildlife avoidance of the Project Location during construction and operation may occur as a result of disturbance. | <p>Work areas will be clearly marked and will not extend beyond the Project Location.</p> <p>Further studies are planned in 2025 to identify candidate Significant Wildlife Habitats and identify necessary setbacks and additional mitigation measures. The results of these studies will be documented as part of the Natural Heritage Assessment being prepared. This document will be updated with conclusions pertaining to the likelihood, magnitude and significance of effects to these features.</p> <p>Additional mitigation measures are expected to include phasing vegetation removal outside of the active breeding bird and bat maternity periods (April to September), exclusion fencing (where necessary), and setbacks from present natural heritage features (wetlands, waterbodies).</p> |
| | Physiography/Topography | During construction, re-grading of excavated soils and some minor alterations to local topography may occur. | Decommissioning of the Project Location will include re-grading to original conditions (or as agreed to with the landowner) and as prescribed in any conditions of approval. |
| | Soils | <p>Grading activities are not expected to require soil excavation or removal from the Project Location.</p> <p>Potential reductions in soil quality may occur as a result of accidental spills, erosion, and soil compaction during construction.</p> | Erosion and sediment control measures will be implemented prior to and during construction and will remain in place until vegetation and soils are stabilized at the Project Location. Mitigation measures will be implemented to protect soil quality and minimize compaction during construction. |

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|-------------|------------------------------------|--|---|
| Water | Surface Water | Few surface water features overlap with the potential Project Location and will largely be setback from within the layout of the Project. The transmission line components may be required to pass overhead of watercourses. Utility pole siting will consider the location of watercourses and respect 30 m setbacks where possible. In rare instances, if this is not feasible, Environmental Impact Studies may be completed to assess impacts to specific waterbodies, if necessary. | A 30-m setback will be applied from all waterbodies. Erosion and sediment control measures and spill prevention and response measures will be implemented to minimize any potential impacts to surface water. A stormwater management plan will be developed, as required to maintain adequate site drainage. Mitigation measures will include best management practices, including, but not limited to, erosion and sediment control measures and maintenance of existing drainage conveyance (quality, quantity, surface water volumes/flow rates). |
| | Groundwater | Accidental spills pose a risk of deteriorating groundwater quality. | Spill prevention and response measures will be put into place throughout the Project Location to minimize the likelihood and impact of accidental spills. |
| | Aquatic Habitat | The installation of the Project may result in negative impacts to fish and fish habitat, due to loss of riparian vegetation which provides sources of shade, cover and food production. In addition, certain materials such as fuel, lubricating oils and other fluids associated with Project activities have the potential to negatively impact aquatic habitats. | A 30-m setback of the Project Location from all waterbodies will be applied to ensure the protection of aquatic biota and habitats. Erosion and sediment controls and spill prevention and response measures will be implemented to minimize any potential impacts to aquatic biota/habitats. |
| Air Quality | Air Quality, Odour and Dust | Reductions in local air quality may occur during construction and decommissioning. Fugitive dust may occur | Mitigation measures will include standard best management practices. |


| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|--|------------------------------------|---|---|
| | | as vegetation is removed and soils remain bare, as well as through the operation of equipment and vehicle traffic. There are no anticipated impacts identified during operations. | Dust will be suppressed during construction/decommissioning, in accordance with provincial requirements and regulations. |
| Noise | Noise | Temporary disturbance to neighboring residents, businesses and surrounding wildlife may occur during construction and decommissioning. The operation of inverters and transformers may result in increased ambient sound levels. | Siting of noise emitting equipment will be the primary mitigation measure to accommodate NPC-300 standards at adjacent noise receptors. Any necessary additional mitigation or noise attenuation strategies will be developed, as required. |
| Local Interests, Land Use and Infrastructure | Visual Landscape | Installation of the Project will result in a change to the local landscape. | Public consultation will be completed to identify the potential for adverse aesthetic effects as well as the development of appropriate mitigation measures, where necessary. |
| | Land Use | The Project is proposed to be located on privately owned land which is currently utilized for agricultural activities or is currently vacant and covered by woodland and successional vegetation. | Public consultation will be undertaken to determine any studies required to support local board approvals. All electrical infrastructure will be properly grounded to minimize the potential for stray voltage impacts on livestock. |
| | Traffic | Construction and decommissioning of the Project may result in increases in local area traffic and the potential for temporary disruption along routes used. Traffic flow is not expected to be affected throughout the operation of the Project. | A traffic management plan may be developed to address and mitigate any potential effects associated with traffic and ensure compliance with municipal requirements. Mitigation would include, but not limited to, designated entrance points, speed limits, signage and other measures to control traffic and safety protocols. |

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|---|-------------------------------------|--|---|
| | | Traffic impacts are not expected to have any significant effects on landfill sites or airports. | |
| Provincial and Local Infrastructure | Local Roads | Construction, operation and decommissioning of the Project will require the use of roads maintained by the Ministry of Transportation. The use of these roads is not expected to cause adverse effects beyond normal road usage. | A traffic management plan may be developed to address and mitigate any potential effects associated with traffic and ensure compliance with municipal requirements. Mitigation would include, but not limited to, measures to control traffic and safety protocols. |
| Public Health and Safety | Community Safety | Construction and decommissioning of the Project will result in a risk to community and workforce safety. During operation, potential risks to public safety are limited. | Safety procedures will be followed to ensure both worker and public safety. The public will not be allowed access during construction, operations or decommissioning. Perimeter fencing and gating will be utilized to prevent unauthorized access. An Emergency Response and Communication plan will be generated and updated as development progresses. |
| Areas Protected under Provincial Plans and Policies | Protected Area | The Project is not within any provincial land use plan areas (i.e., Greenbelt Plan, Oak Ridges Moraine Conservation Plan, Niagara Escarpment Plan, Lake Simcoe Protection Plan). | None required. |
| Other Resources | Waste Management and Disposal Sites | Construction and decommissioning of the Project will likely result in the generation of recyclable material, and municipal and sanitary waste. | The disposal and proper storage of wastes and recyclables will occur in accordance with provincial requirements and regulations. |

| Category | Environmental and Social Component | Potential Environmental Effects (Construction, Operation and Decommissioning) | Proposed Mitigation |
|----------|------------------------------------|---|---|
| | Aggregate Resources | The Project will not influence the availability of aggregate resources in the area. Any aggregate resources available within the Project Location will remain in place throughout the construction, operation and decommissioning of the Project. | The Project will not influence the availability of aggregate resources in the area. Any aggregate resources available within the Project Location will remain in place throughout the construction, operation and decommissioning of the Project. |
| | Airports/Aerodromes | The closest airport/aerodrome is over 5 km away from the Project Location. | Currently, glare associated with the Project is not anticipated to be a concern. Backtracking technology is anticipated to minimize potential glare impacts. |

Appendix A

Project Location

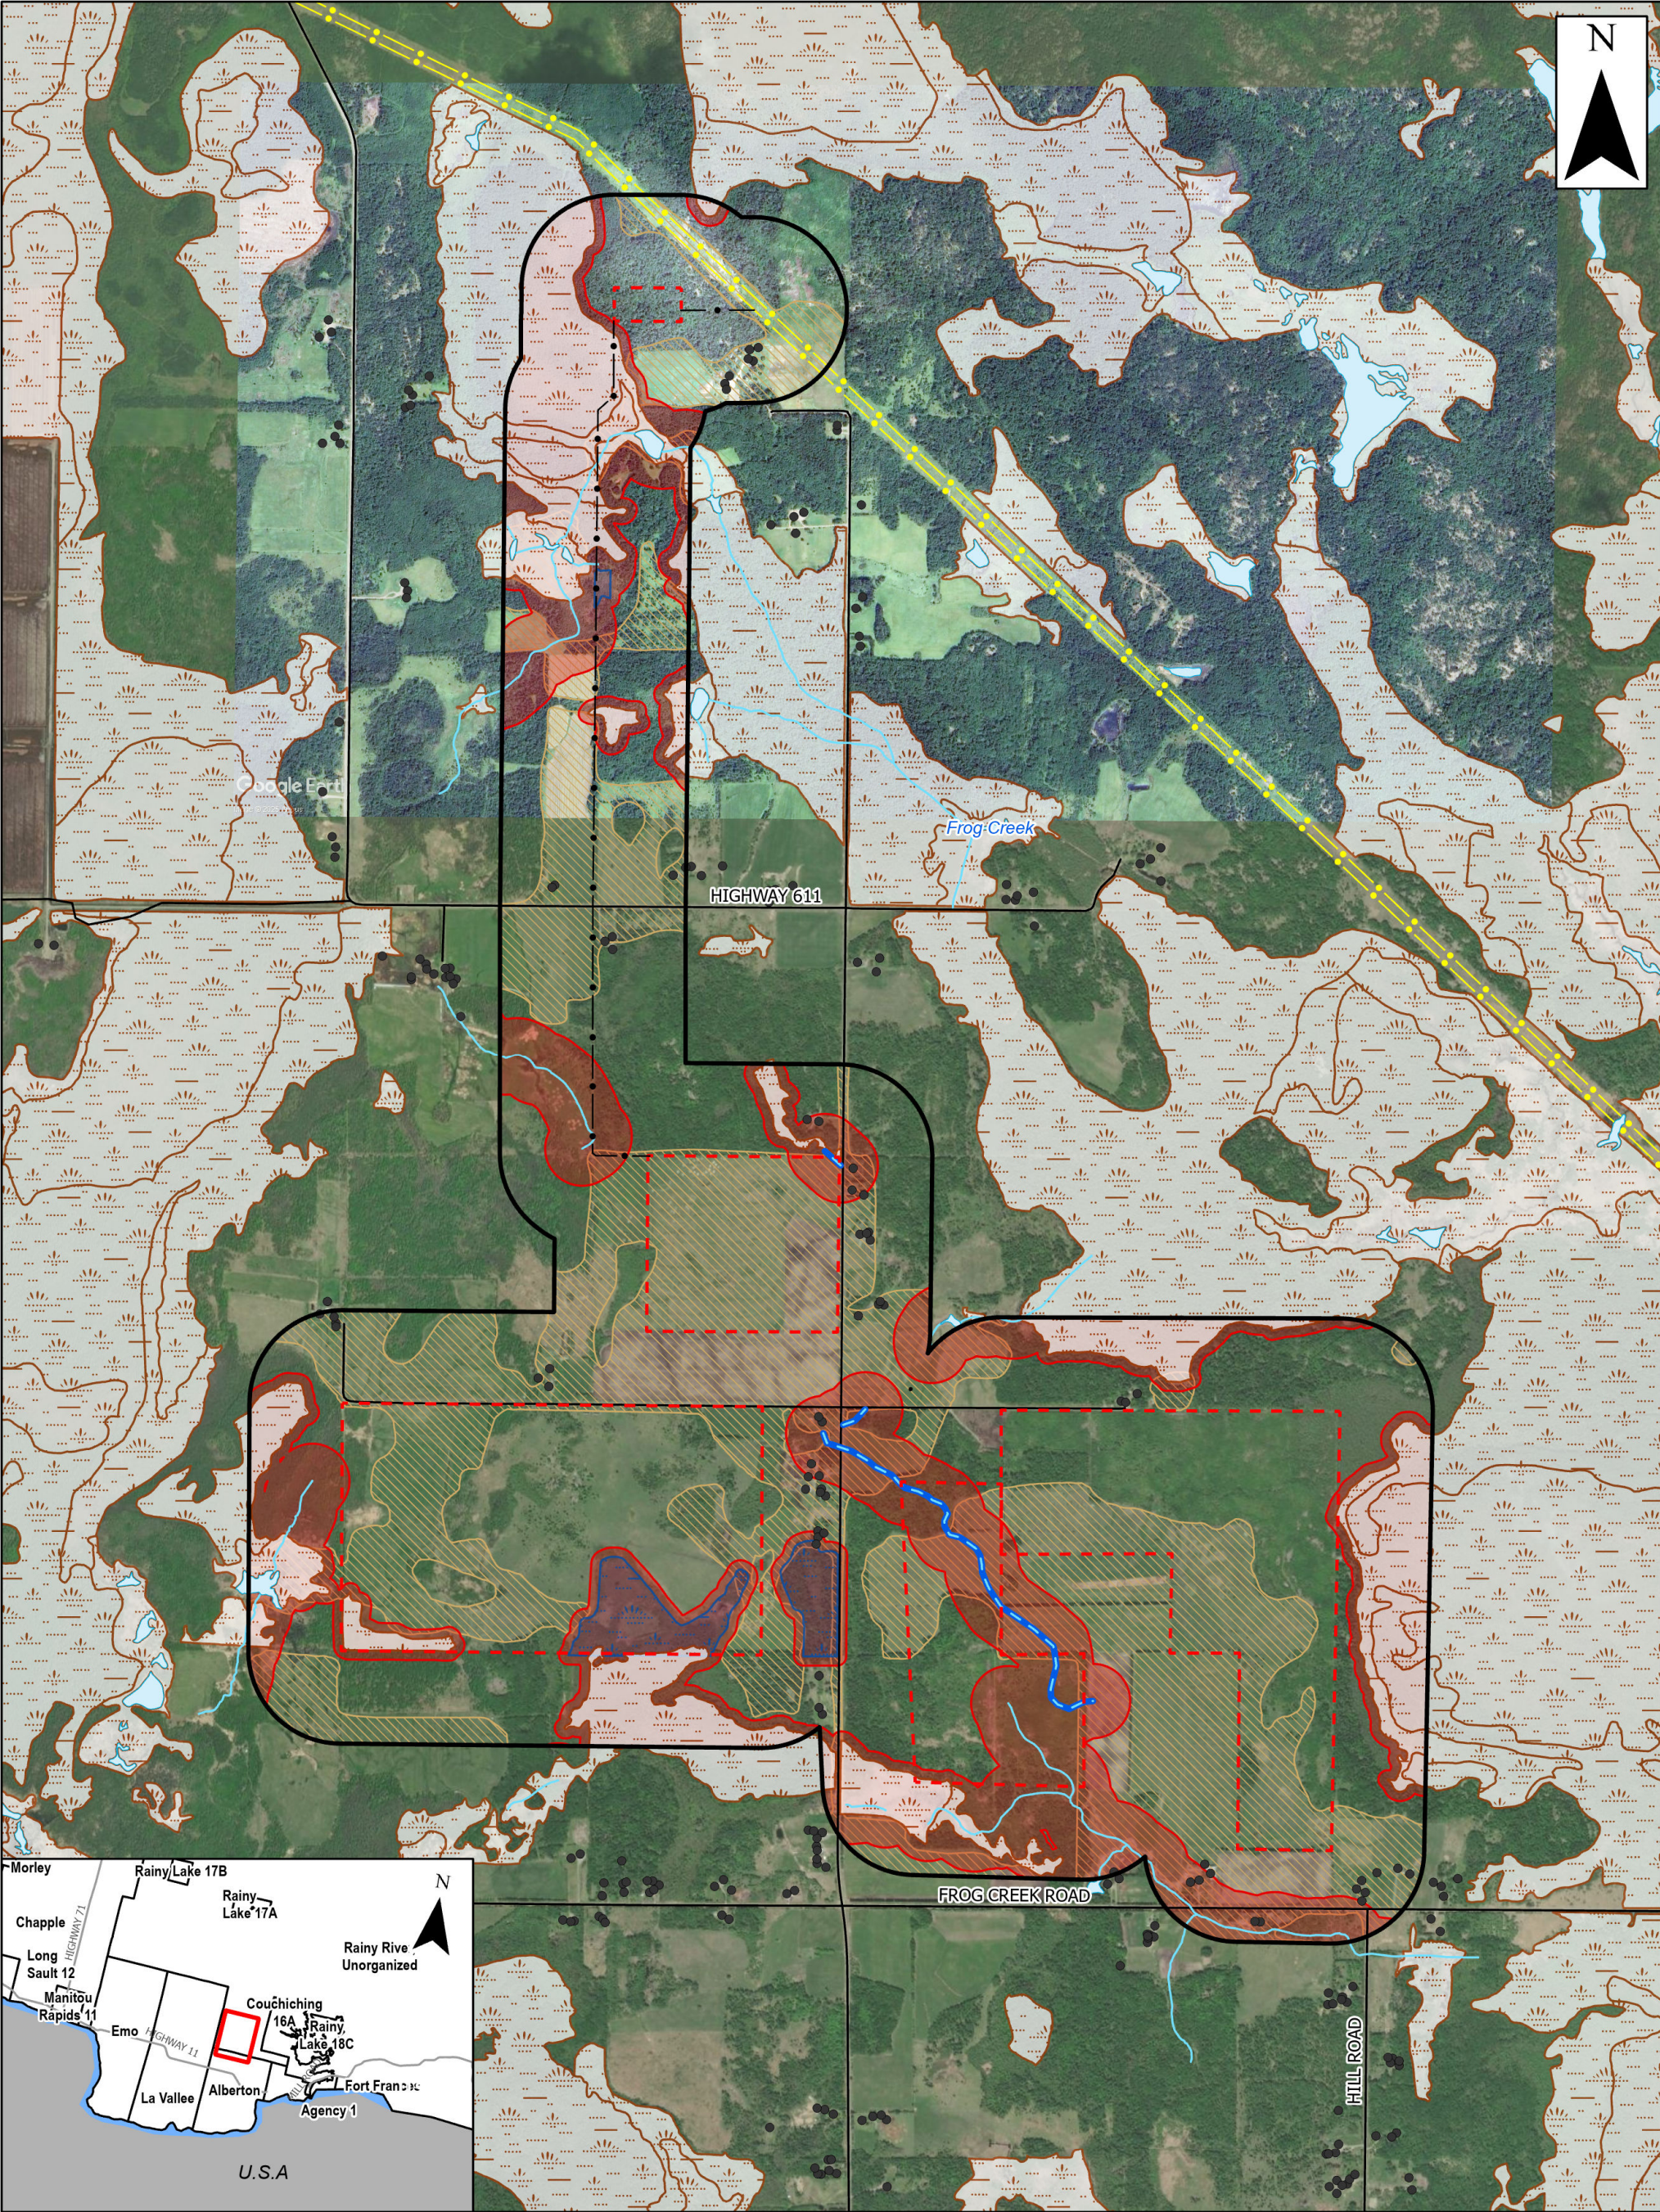

Study Area (300m Buffer)

Project Location

Proposed Transmission Line

Building

Road

Transmission Line

Watercourse (Field Verified)

Watercourse (Field Identified)

Waterbody

Unevaluated Wetland

Evaluated Wetland

Field Delineated Wetland

Agricultural Lands

Exclusion Zone

Notes

1. Produced by Hatch, contains information under the Open Government License - Ontario

2. Spatial referencing: NAD 83 UTM Zone 15N

3. GoogleEarth 2025 Image added for clarity due to cloud cover.

0200400800

Meters

1:20,000

PROJECT:

CarbonFree For Frances Solar Project

FIGURE TITLE:

Project Location

CLIENT:

CarbonFree Fort Frances Ltd.

DWG BY:

S. PERRY

CHK BY:

S. THOMPSON

FIG NO.:

1

PROJ. NO.:

H-375736

DATE:

25/08/18

PAGE:

1 of 1

REV NO.:

A

HATCH