


NOTE: All wiring of this equipment is to be done by experienced electrical personnel, and must be grounded to comply with National, State and Local Codes.

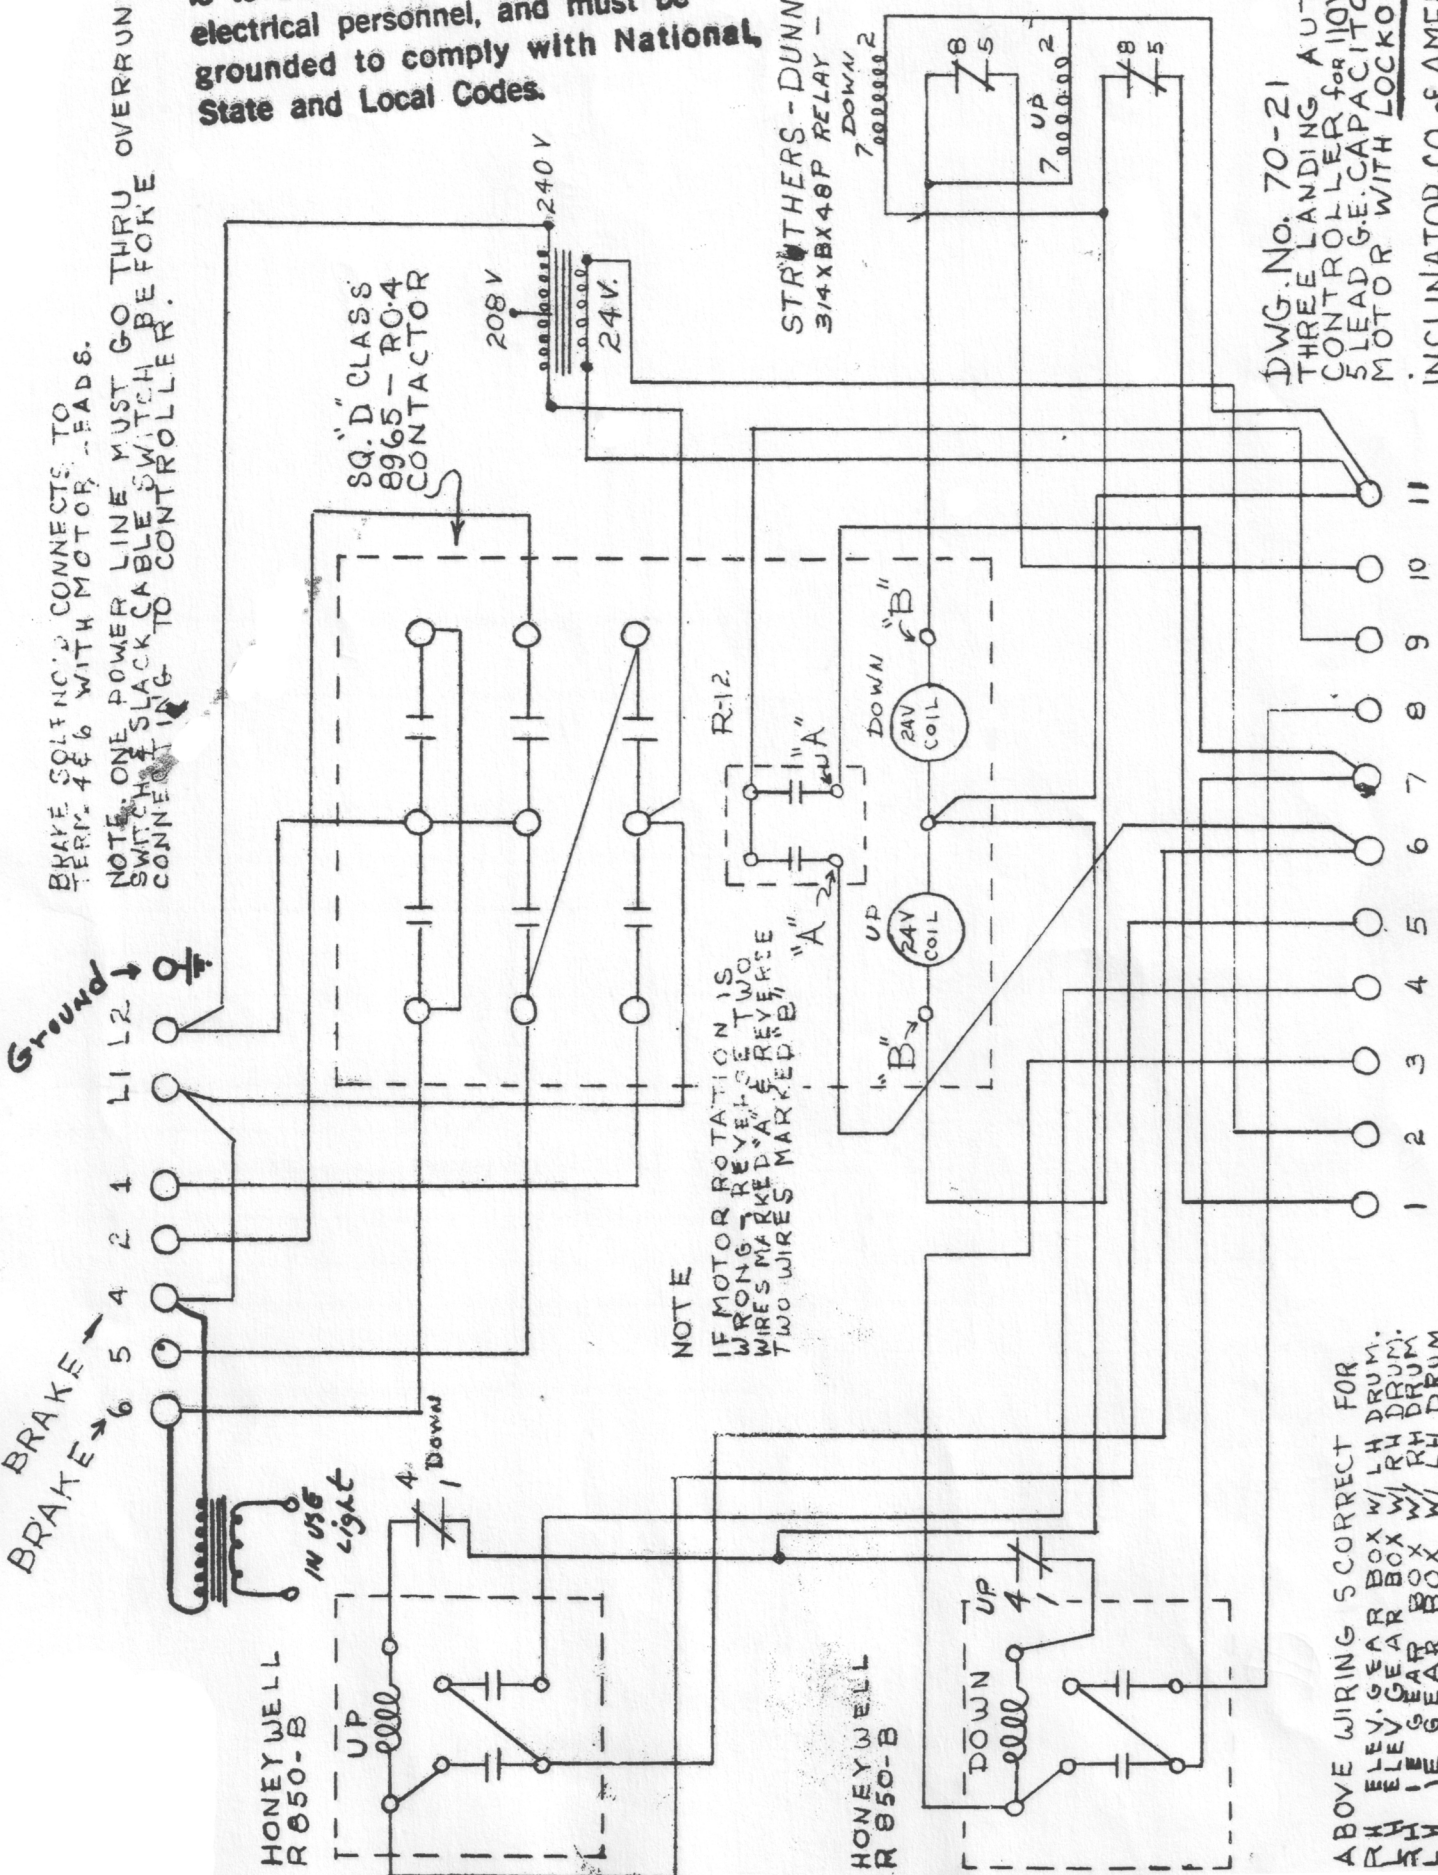

BRAKE COLENO. D CONNECTS TO TERM. 4 & 6 WITH MOTOR LEADS.  
 NOTE: ONE POWER LINE MUST GO THRU OVERRUN SWITCH & SLACK CABLE SWITCH BEFORE CONNECTING TO CONTROLLER.

Ground

BRAKE

HONEYWELL R850-B

HONEYWELL R850-B

NOTE: IF MOTOR ROTATION IS WRONG REVERSE TWO WIRES MARKED "A" & REVERSE TWO WIRES MARKED "B"

STRATHERS-DUNN TYPE  
 3/4 XB48P RELAY - LOCKOUT

DWG. No. 70-21  
 THREE LANDING AUTO. CONTROL LER for 110Y-220V 5 LEAD G.E. CAPACITOR MOTOR WITH LOCKOUTS  
 INCLINATOR CO. of AMERICA  
 HARRISBURG PA.

ABOVE WIRING SCORRECT FOR  
 RH ELEV. GEAR BOX W/ LH DRUM.  
 LH ELEV. GEAR BOX W/ RH DRUM.

By Chance 10-21-70

2A102126


TITLE

DIAGRAM-CONNECTION

FIRST MADE FOR 5KC49WG7000

LABEL 52X329931

INST. REVERSIBLE - SINGLE VOLTAGE - TYPE KC

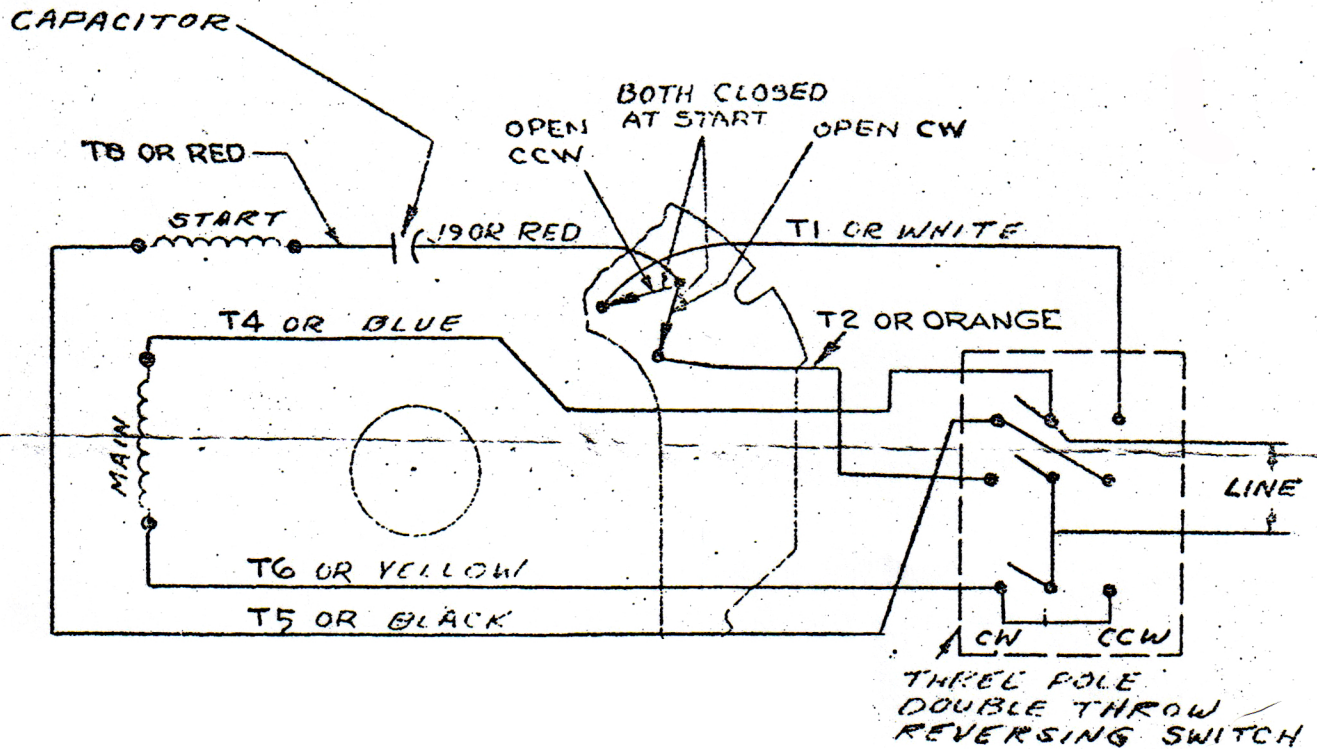

NOTE #1 - WHEN MORE THAN ONE CAPACITOR IS USED, CONNECT IN PARALLEL.

UNITS	APPROVED PARTS	SUPPLIES	REVISIONS	TERMINALS	ANALYSIS
5		✓			

PRINTS TO

B201	
B112	A41
G7	
F107(M)	
F114(4)	

MAR 21 1977