


SITE PLAN

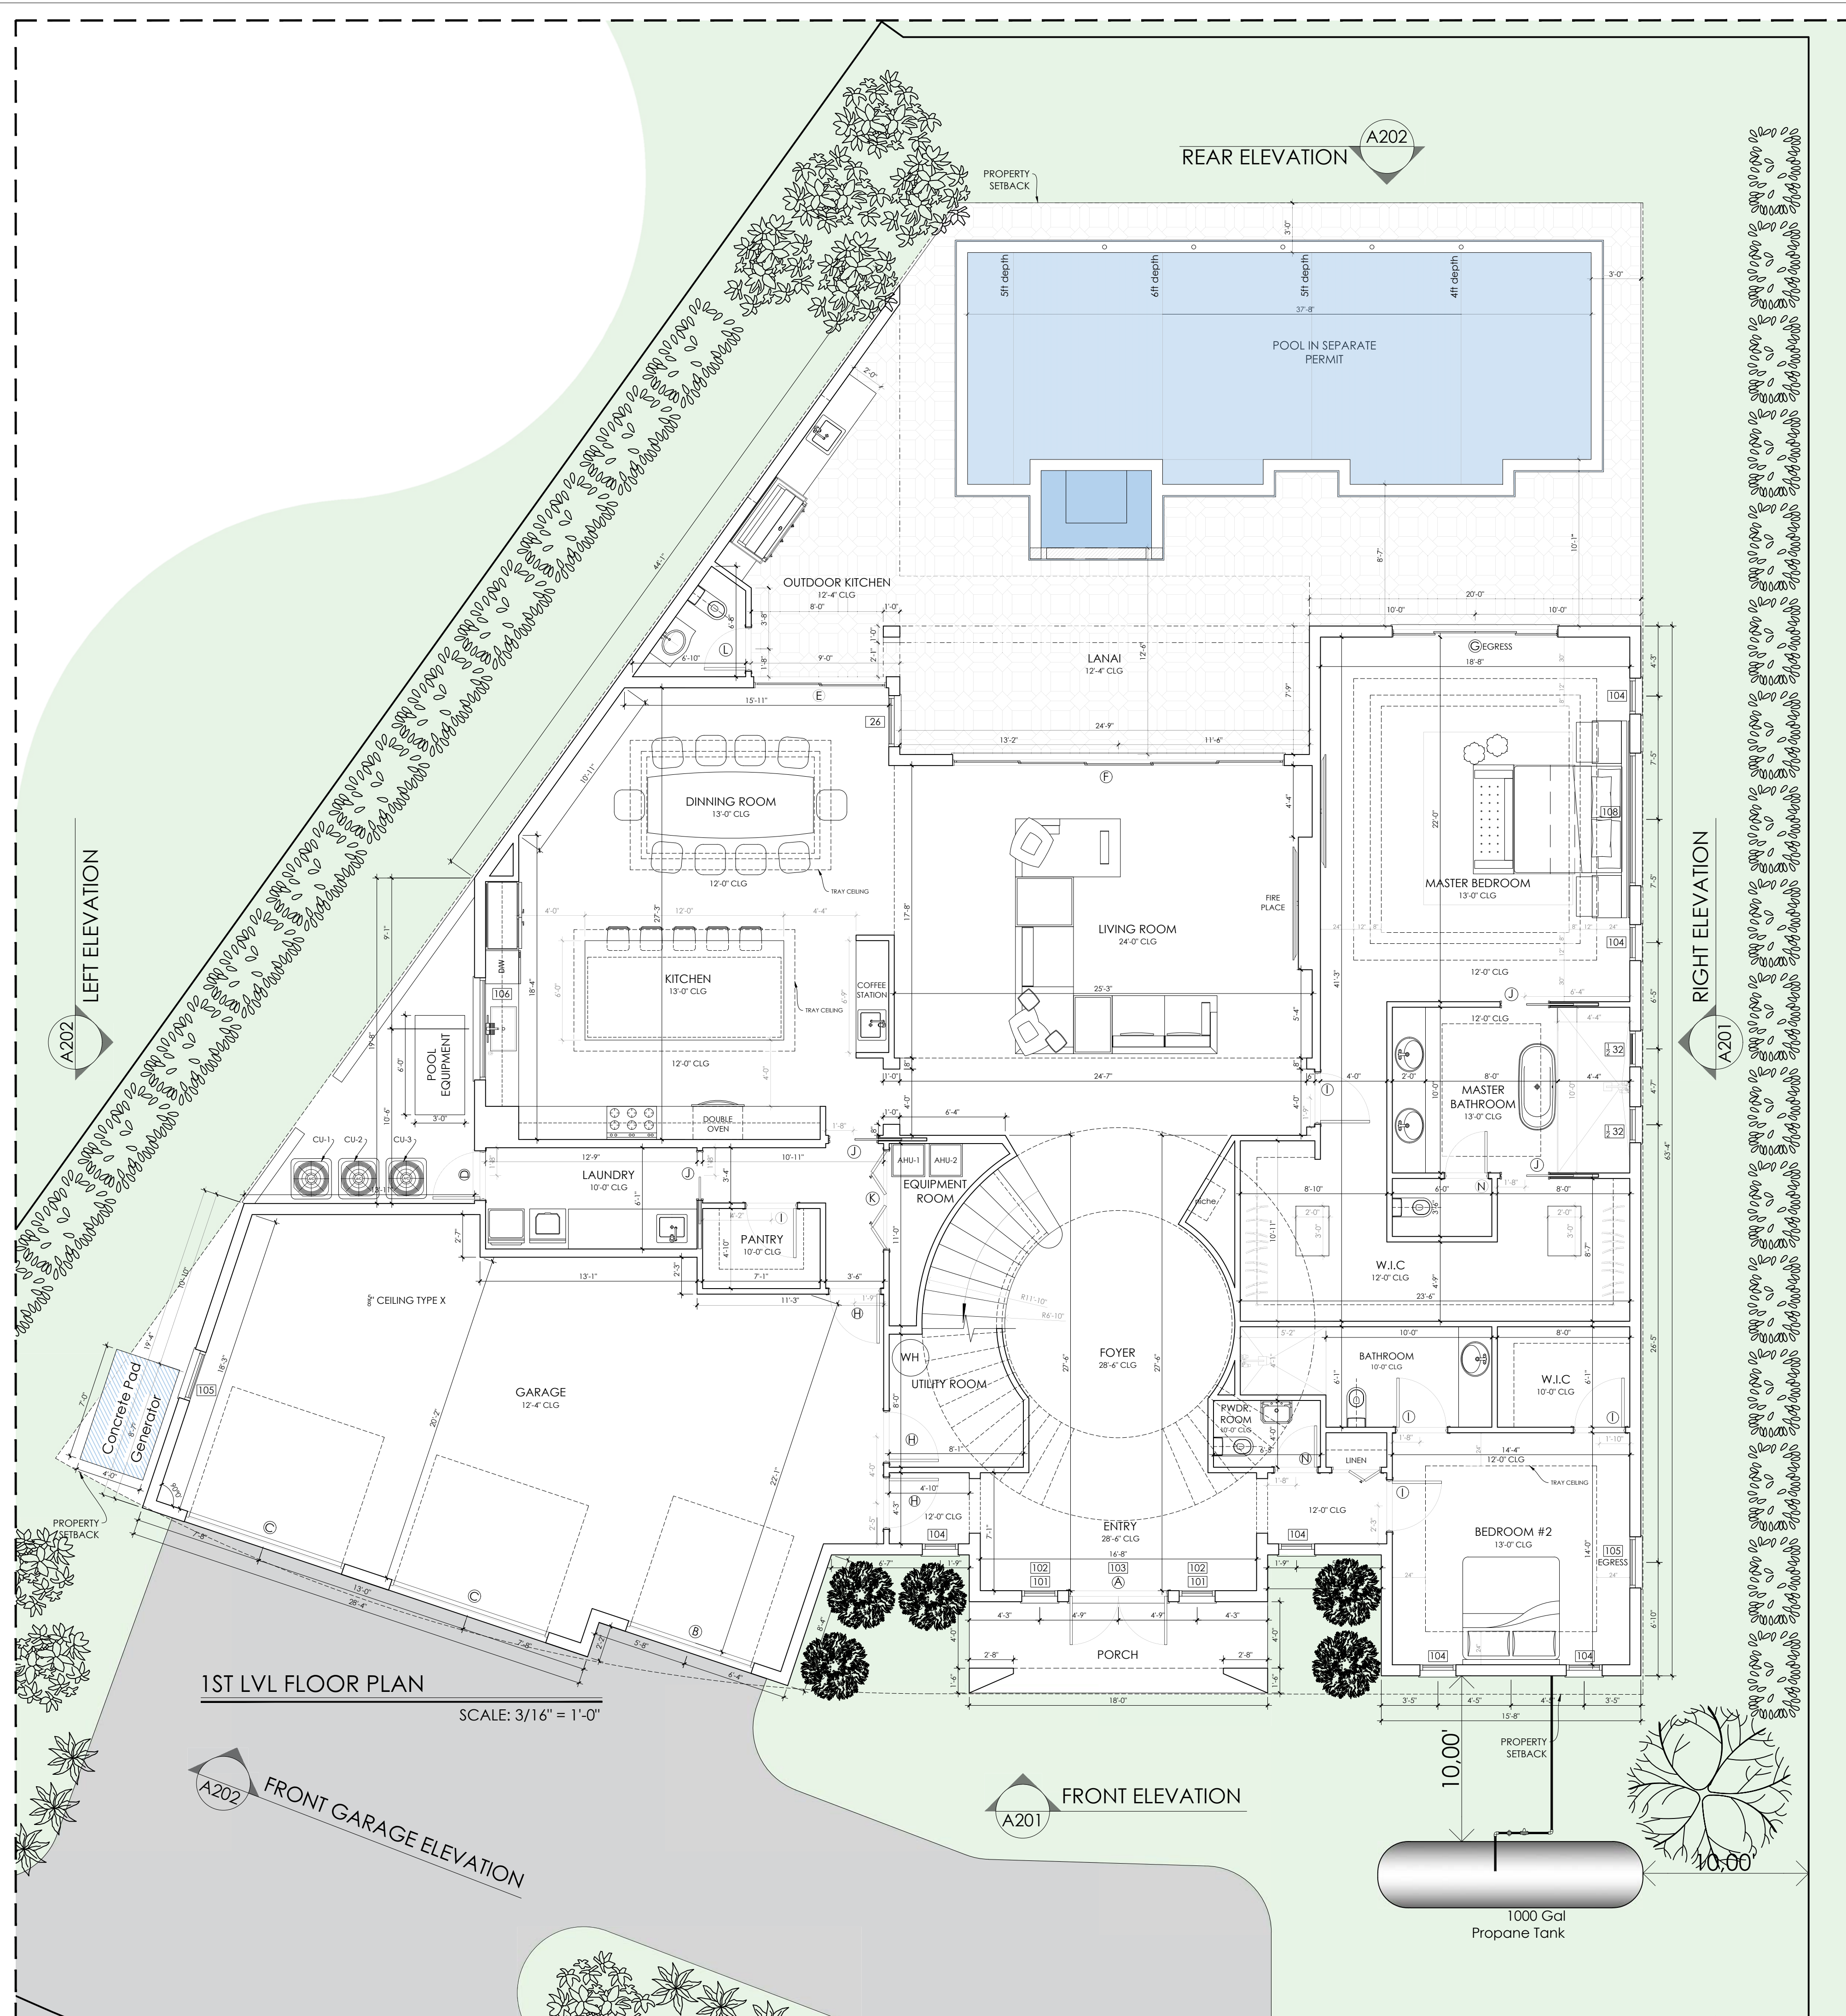

WINDOW SCHEDULE

NO.	STYLE	SIZE		MATERIAL	PROTECTION	REMARKS	LOCATION
		WIDTH	HEIGHT				
101	FIXED GLASS	26"	120"	ALUM.	IMPACT		ENTRY
102	FIXED GLASS	26"	24"	ALUM.	IMPACT		ENTRY
103	FIXED GLASS	72"	24"	ALUM.	IMPACT		ENTRY
104	FIXED GLASS	26"	84"	ALUM.	IMPACT		ENTRY, MASTER BEDROOM, BEDROOMS 2, 3, 4, DEN
105	SINGLE HUNG	37"	87"	ALUM.	IMPACT		GARAGE, BEDROOM 2
106	FIXED GLASS	74"	74"	ALUM.	IMPACT		KITCHEN
26	FIXED GLASS	37"	74"	ALUM.	IMPACT		DINING ROOM
108	FIXED GLASS	96"	26"	ALUM.	IMPACT		MASTER BEDROOM, STUDY
32	FIXED GLASS	26"	26"	ALUM.	IMPACT		MASTER BATHROOM, BATHROOM
110	FIXED GLASS	26"	96"	ALUM.	IMPACT		ENTRY
111	FIXED GLASS	72"	26"	ALUM.	IMPACT		ENTRY
112	FIXED GLASS	72"	44"	ALUM.	IMPACT		ENTRY
113	FIXED GLASS	140"	20"	ALUM.	IMPACT		ENTRY
114	FIXED GLASS	26"	66"	ALUM.	IMPACT		ENTRY, MEDIA ROOM
115	FIXED GLASS	48"	18"	ALUM.	IMPACT		BATHROOM
116	FIXED GLASS	240"	96"	ALUM.	IMPACT		LIVING ROOM
268	SINGLE HUNG	37"	74"	ALUM.	IMPACT		BEDROOM 3
118	FIXED GLASS	48"	26"	ALUM.	IMPACT		BATHROOMS

DOOR SCHEDULE

NO.	STYLE	SIZE		MATERIAL	PROTECTION	REMARKS
		WIDTH	HEIGHT			
A	DOUBLE FRENCH	6'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
B	GARAGE DOOR	8'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
C	GARAGE DOOR	10'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
D	SWING DOOR	3'-0"	8'-0"	FIBERGLASS	IMPACT	
E	SLIDING DOOR	8'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
F	SLIDING DOOR	20'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
G	SLIDING DOOR	10'-0"	10'-0"	FIBERGLASS	IMPACT	w/glass insert
H	SWING DOOR	3'-0"	8'-0"	Solid Core		20 MIN. FIRE RATING
I	SWING DOOR	3'-0"	8'-0"	Solid Core		
J	POCKET DOOR	3'-0"	8'-0"	Solid Core		
K	DOUBLE BI-FOLD	6'-0"	8'-0"	Solid Core		
L	SWING DOOR	2'-8"	8'-0"	FIBERGLASS	IMPACT	
M	DOUBLE BI-FOLD	4'-0"	8'-0"	Solid Core		
N	SWING DOOR	2'-8"	8'-0"	Solid Core		
O	DOUBLE FRENCH	6'-0"	8'-0"	FIBERGLASS	IMPACT	w/glass insert
P	SWING DOOR	2'-8"	8'-0"	FIBERGLASS	IMPACT	w/glass insert
Q	BI-FOLD DOOR	2'-0"	8'-0"	Solid Core		

Date

JUNE 2025

Designed by

DrawnCheck by

Scale


3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION. ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

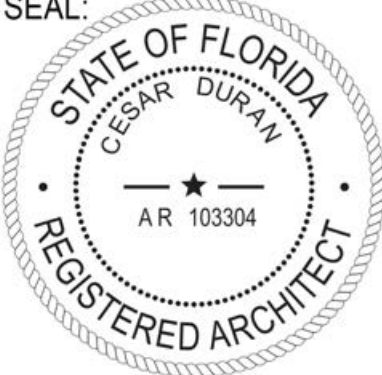


Sign & Seal


REVISION
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

Location	Revision


A101

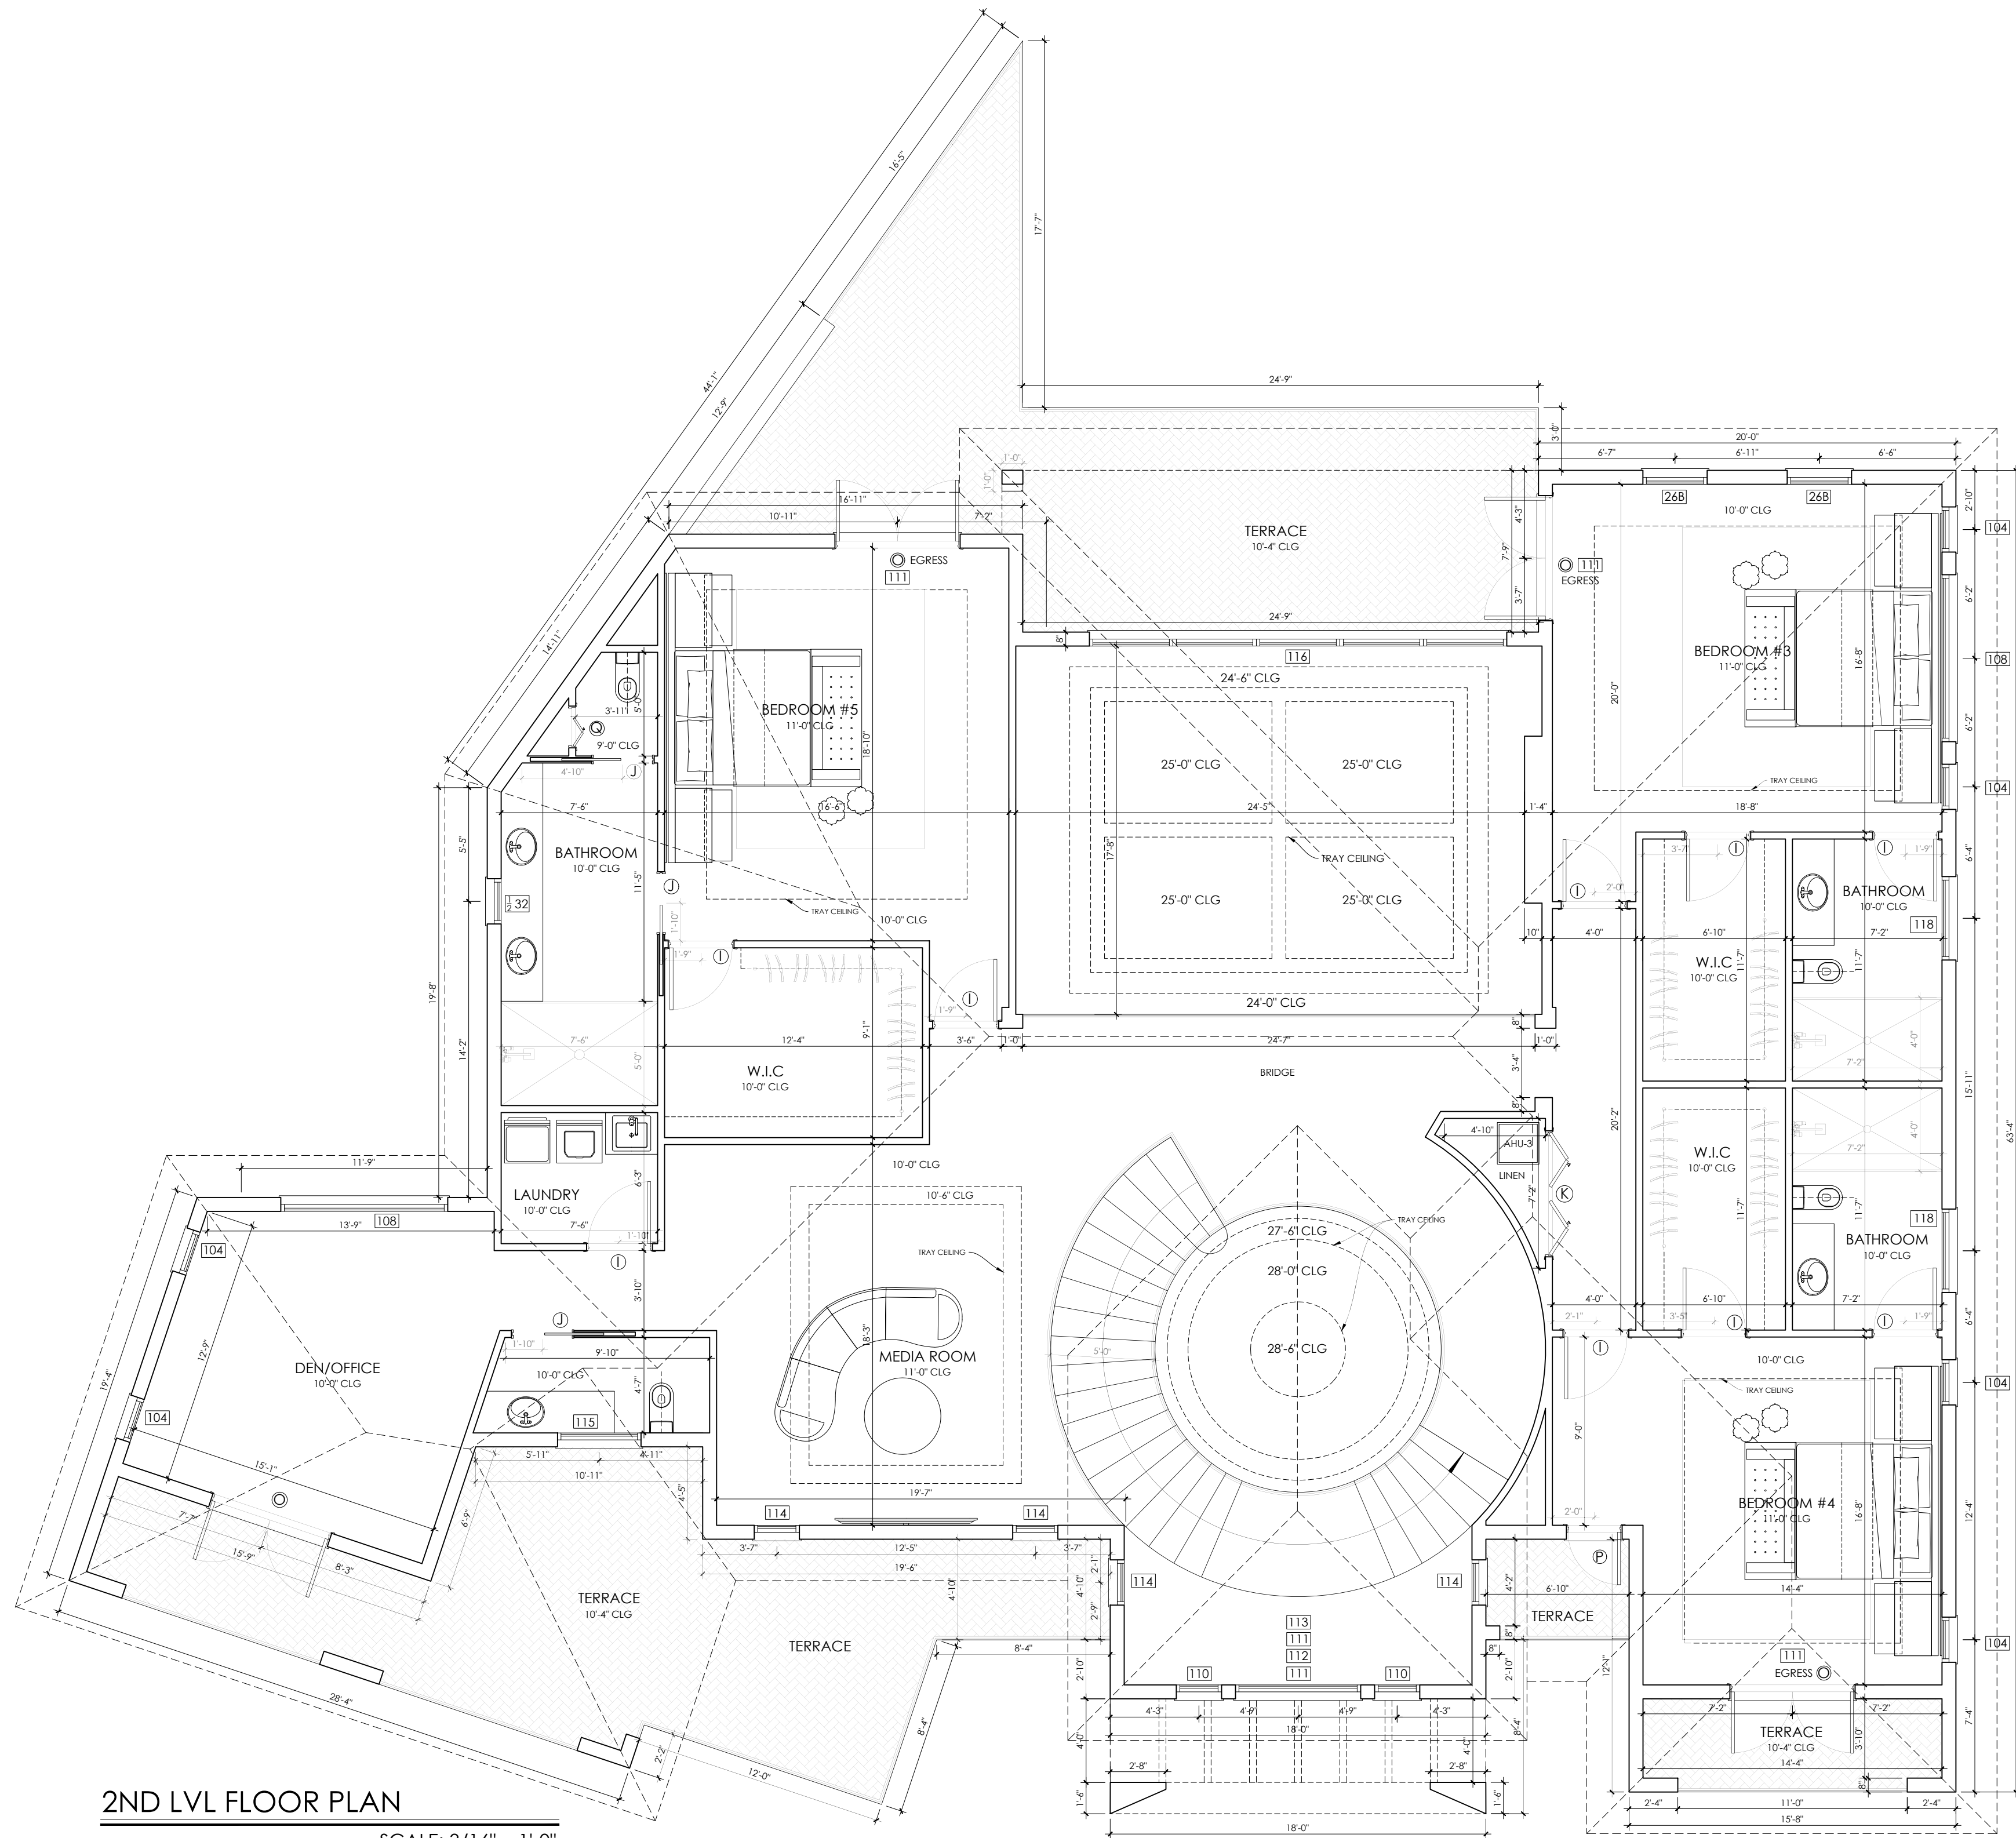

2ND LVL FLOOR PLAN
SCALE: 3/16" = 1'-0"

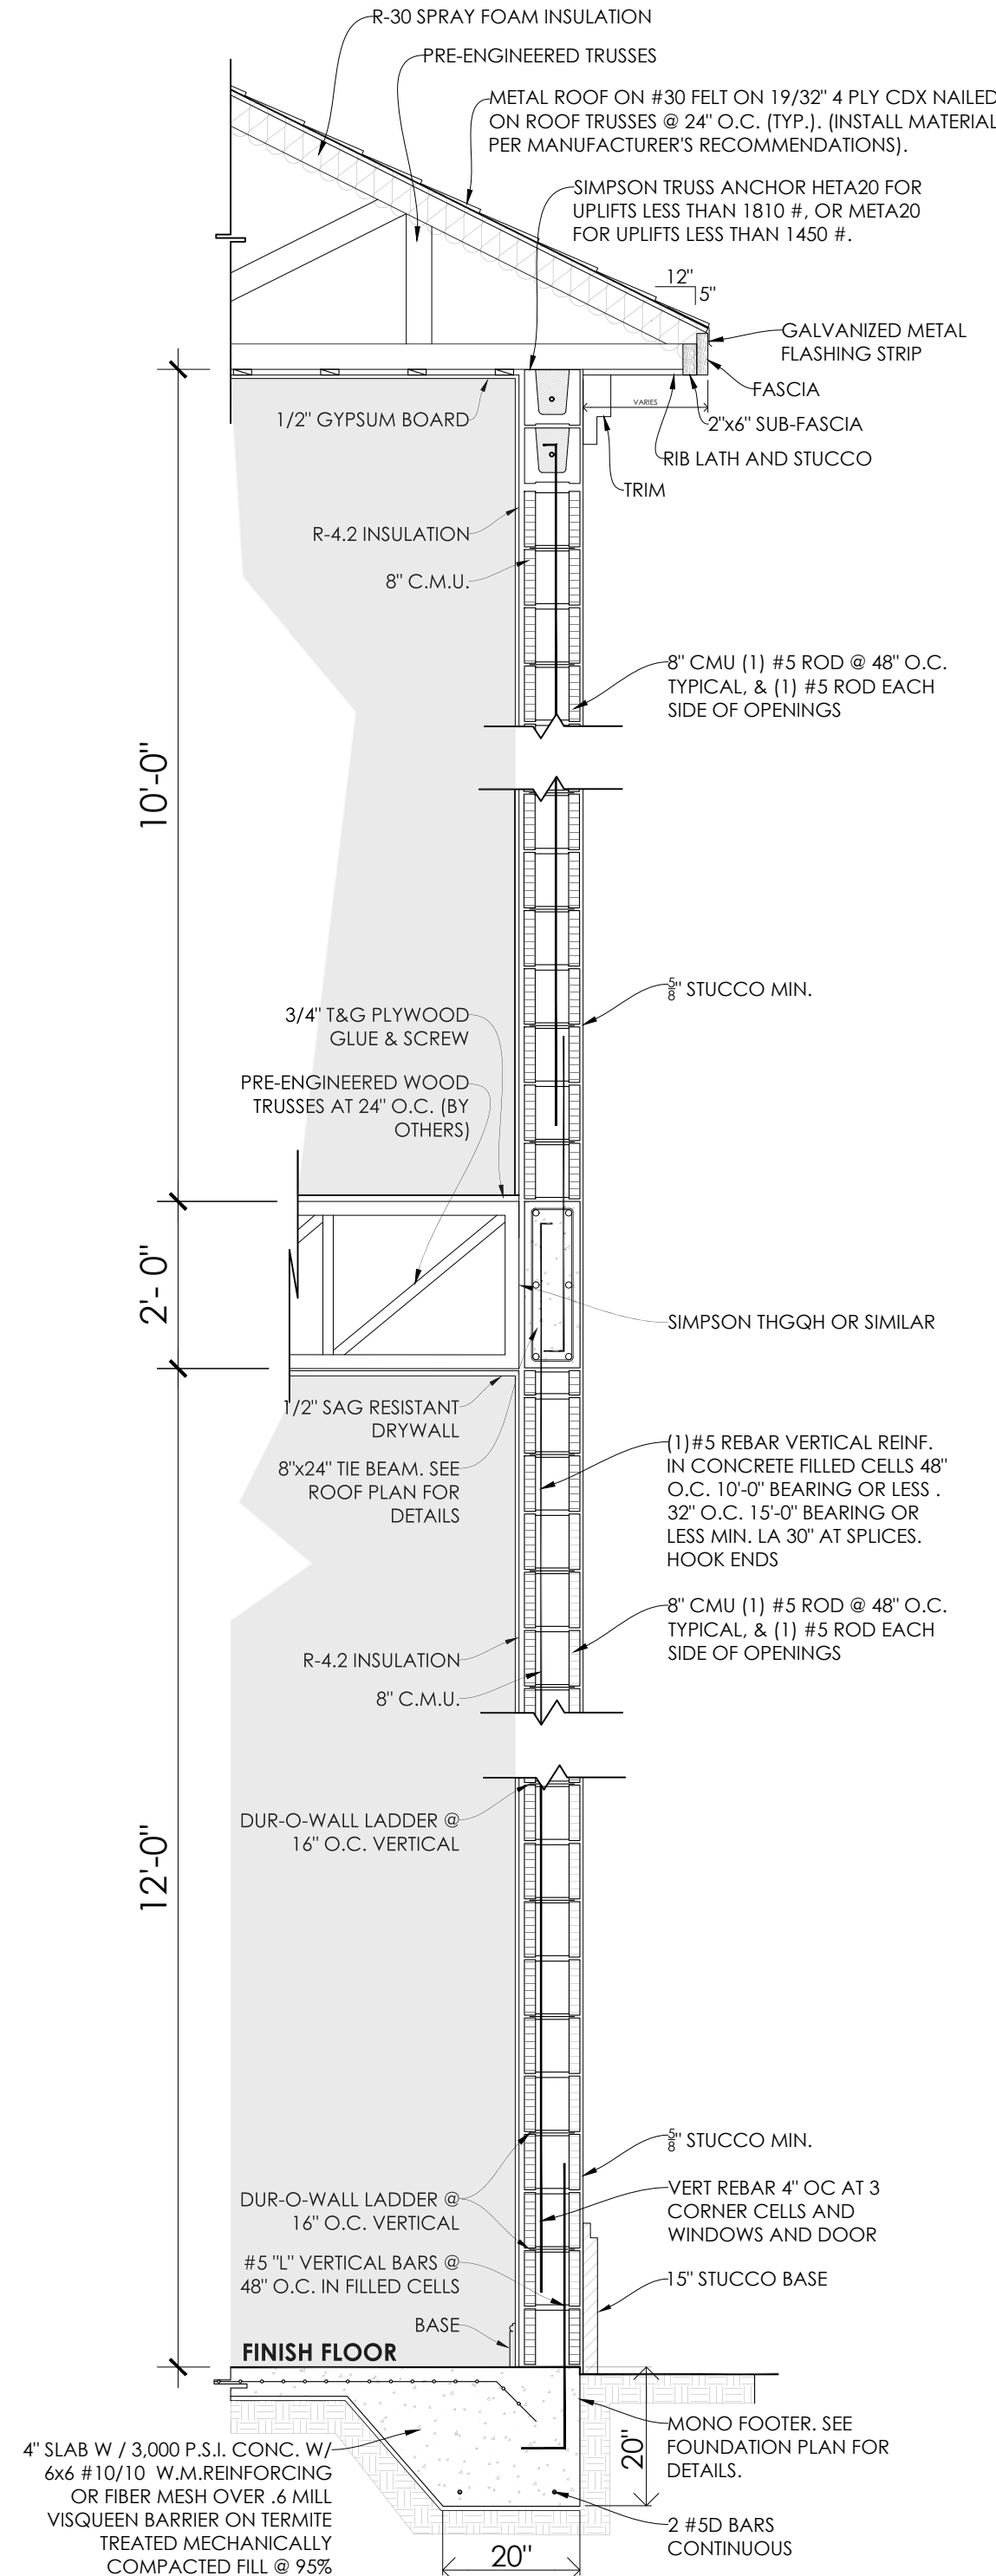

WALL SECTION TYP.
SCALE: 1/2"=1'-0"

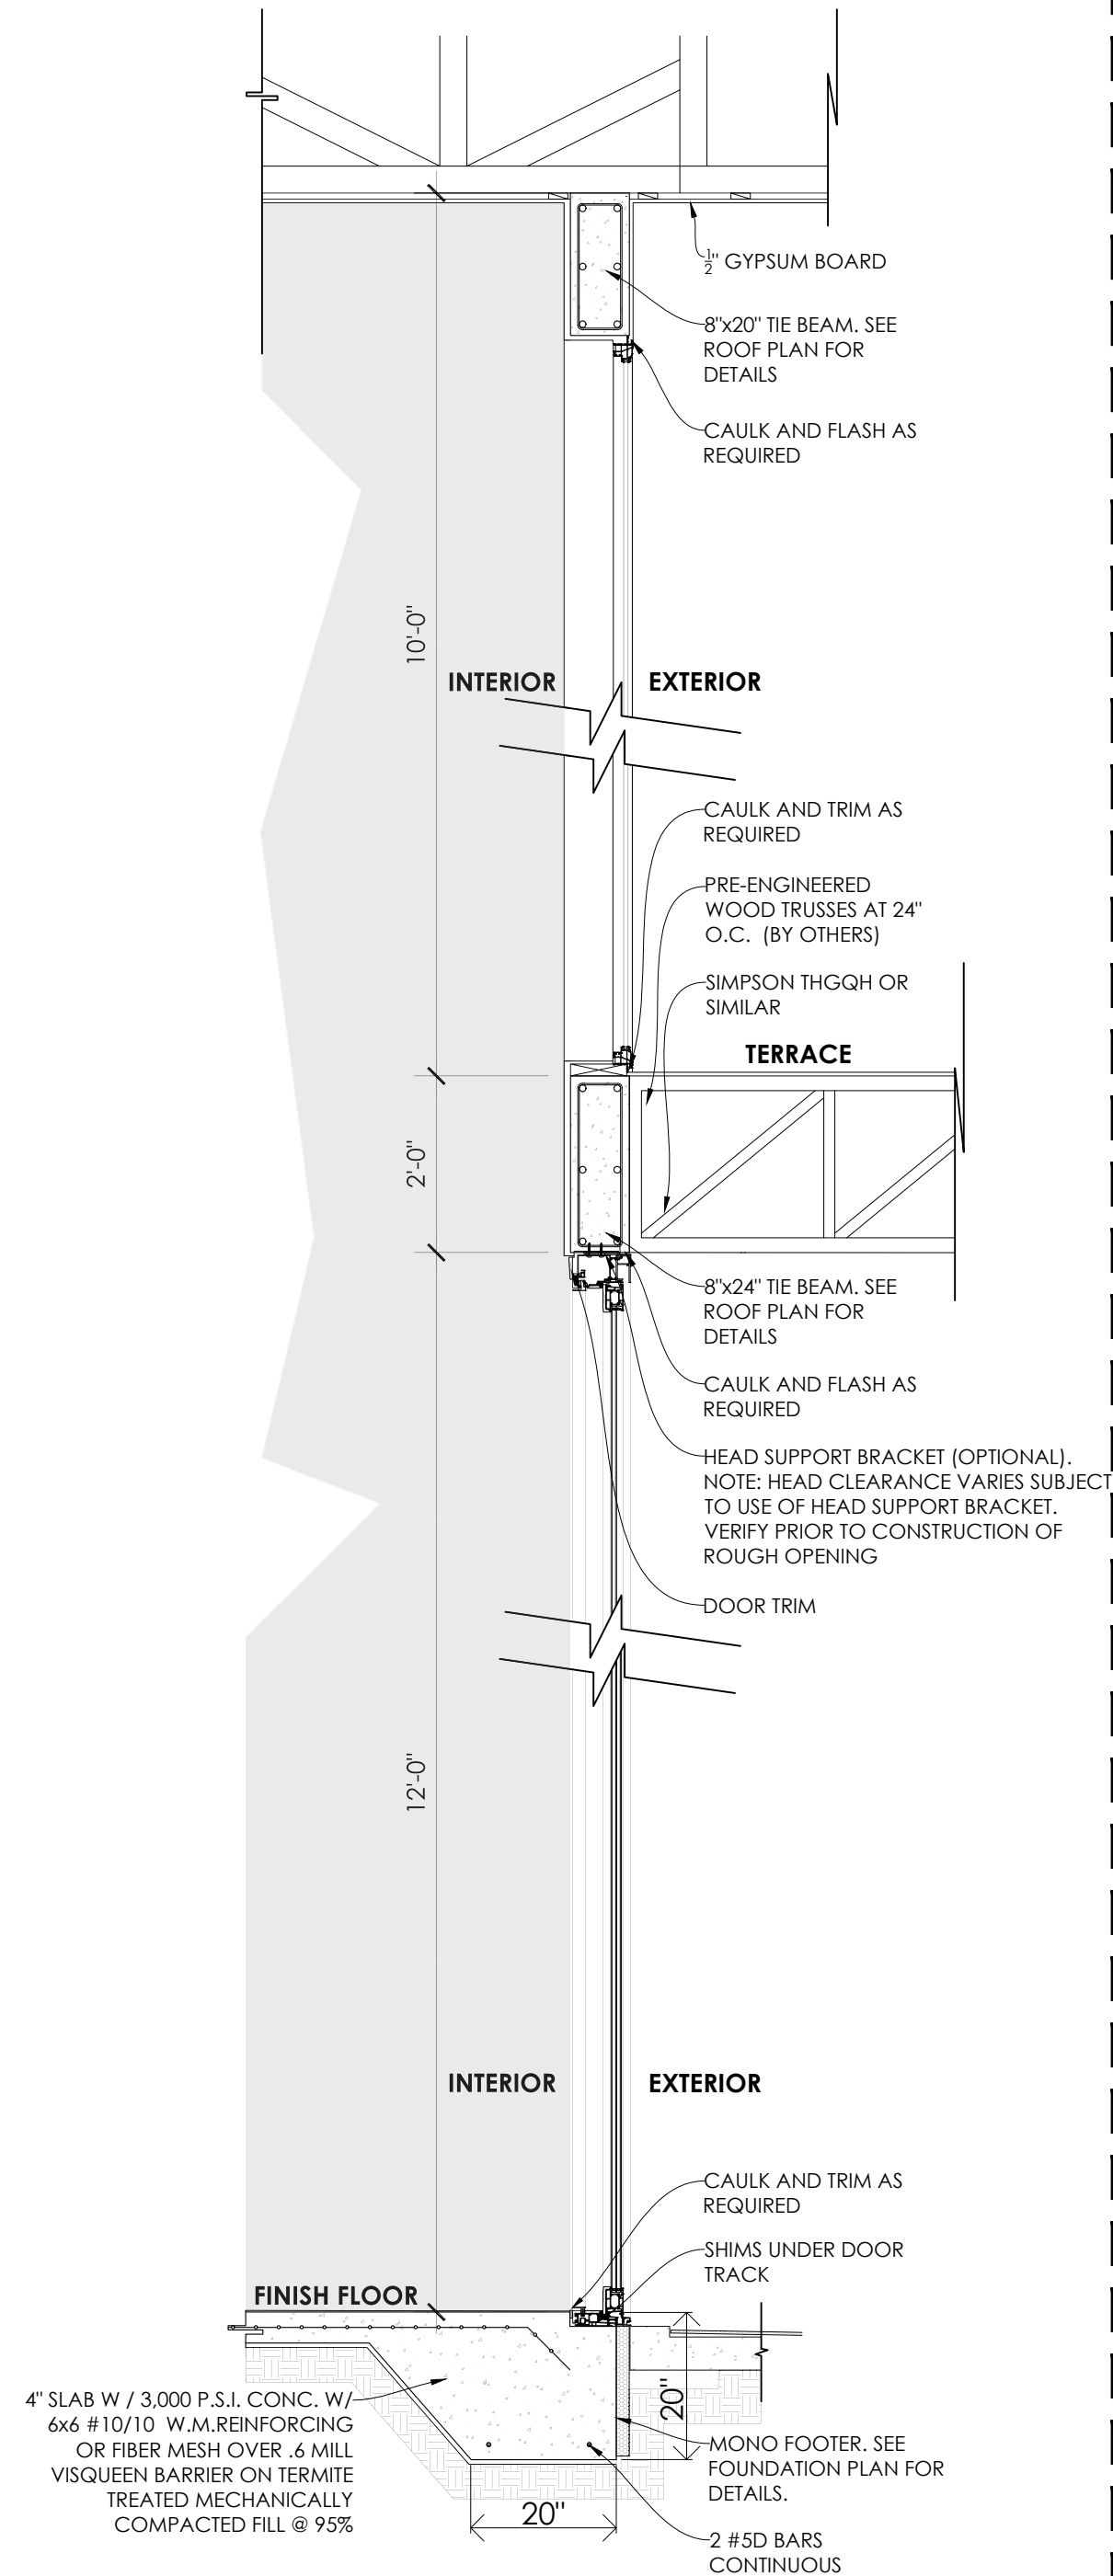

WALL SECTION TYP.
SCALE: 1/2"=1'-0"

Date
JUNE 2025

Designed by

Drawn

Check by

Scale
3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW
AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING
DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER
SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND
ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY
FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

SEAL:

Sign & Seal

Location

RESIDENCE
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

Revision

A102


Page

2ND LVL FLOOR PLAN




FRONT ELEVATION

SCALE: 3/16" = 1'-0"

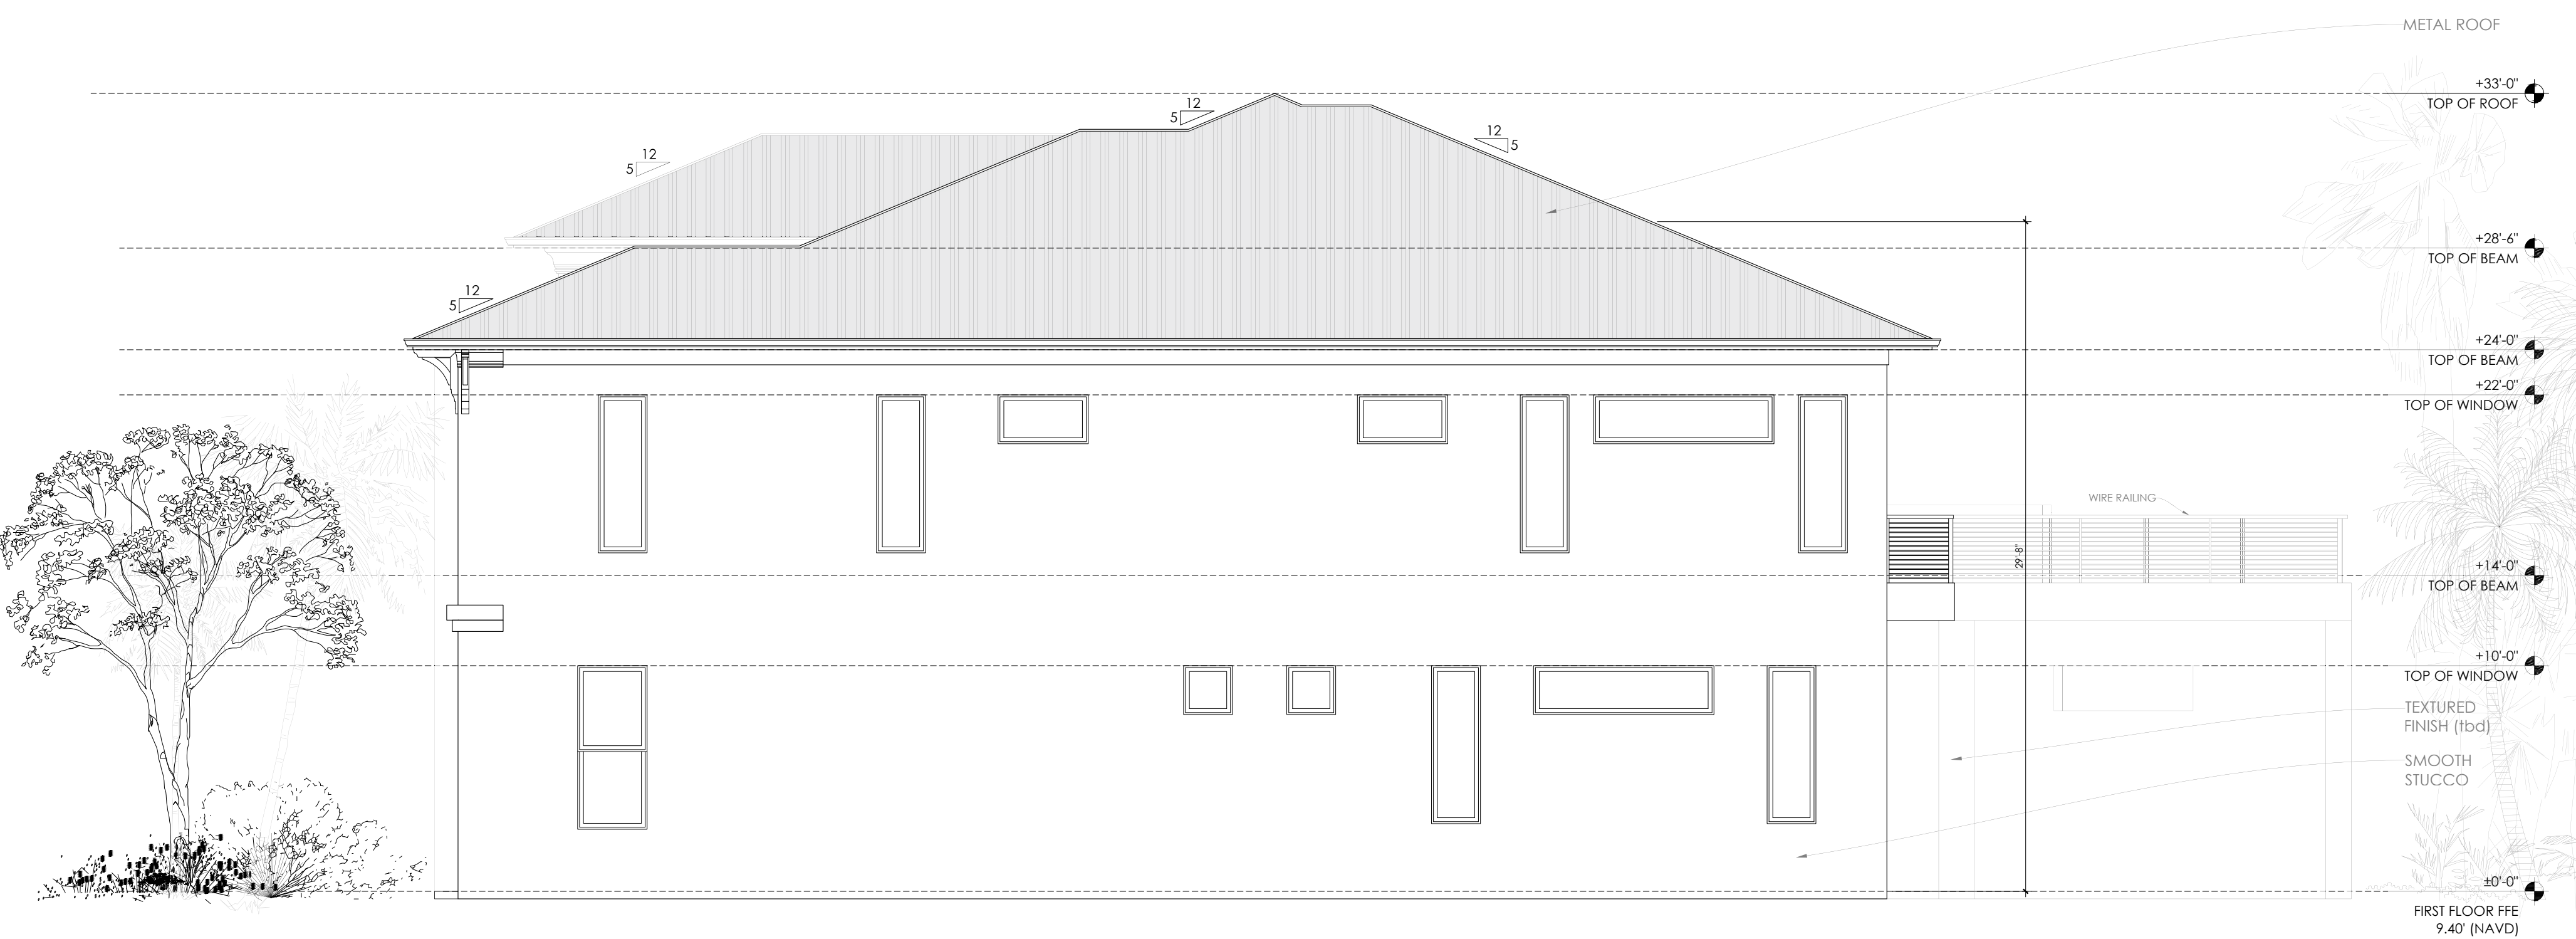

RIGHT ELEVATION

SCALE: 3/16" = 1'-0"

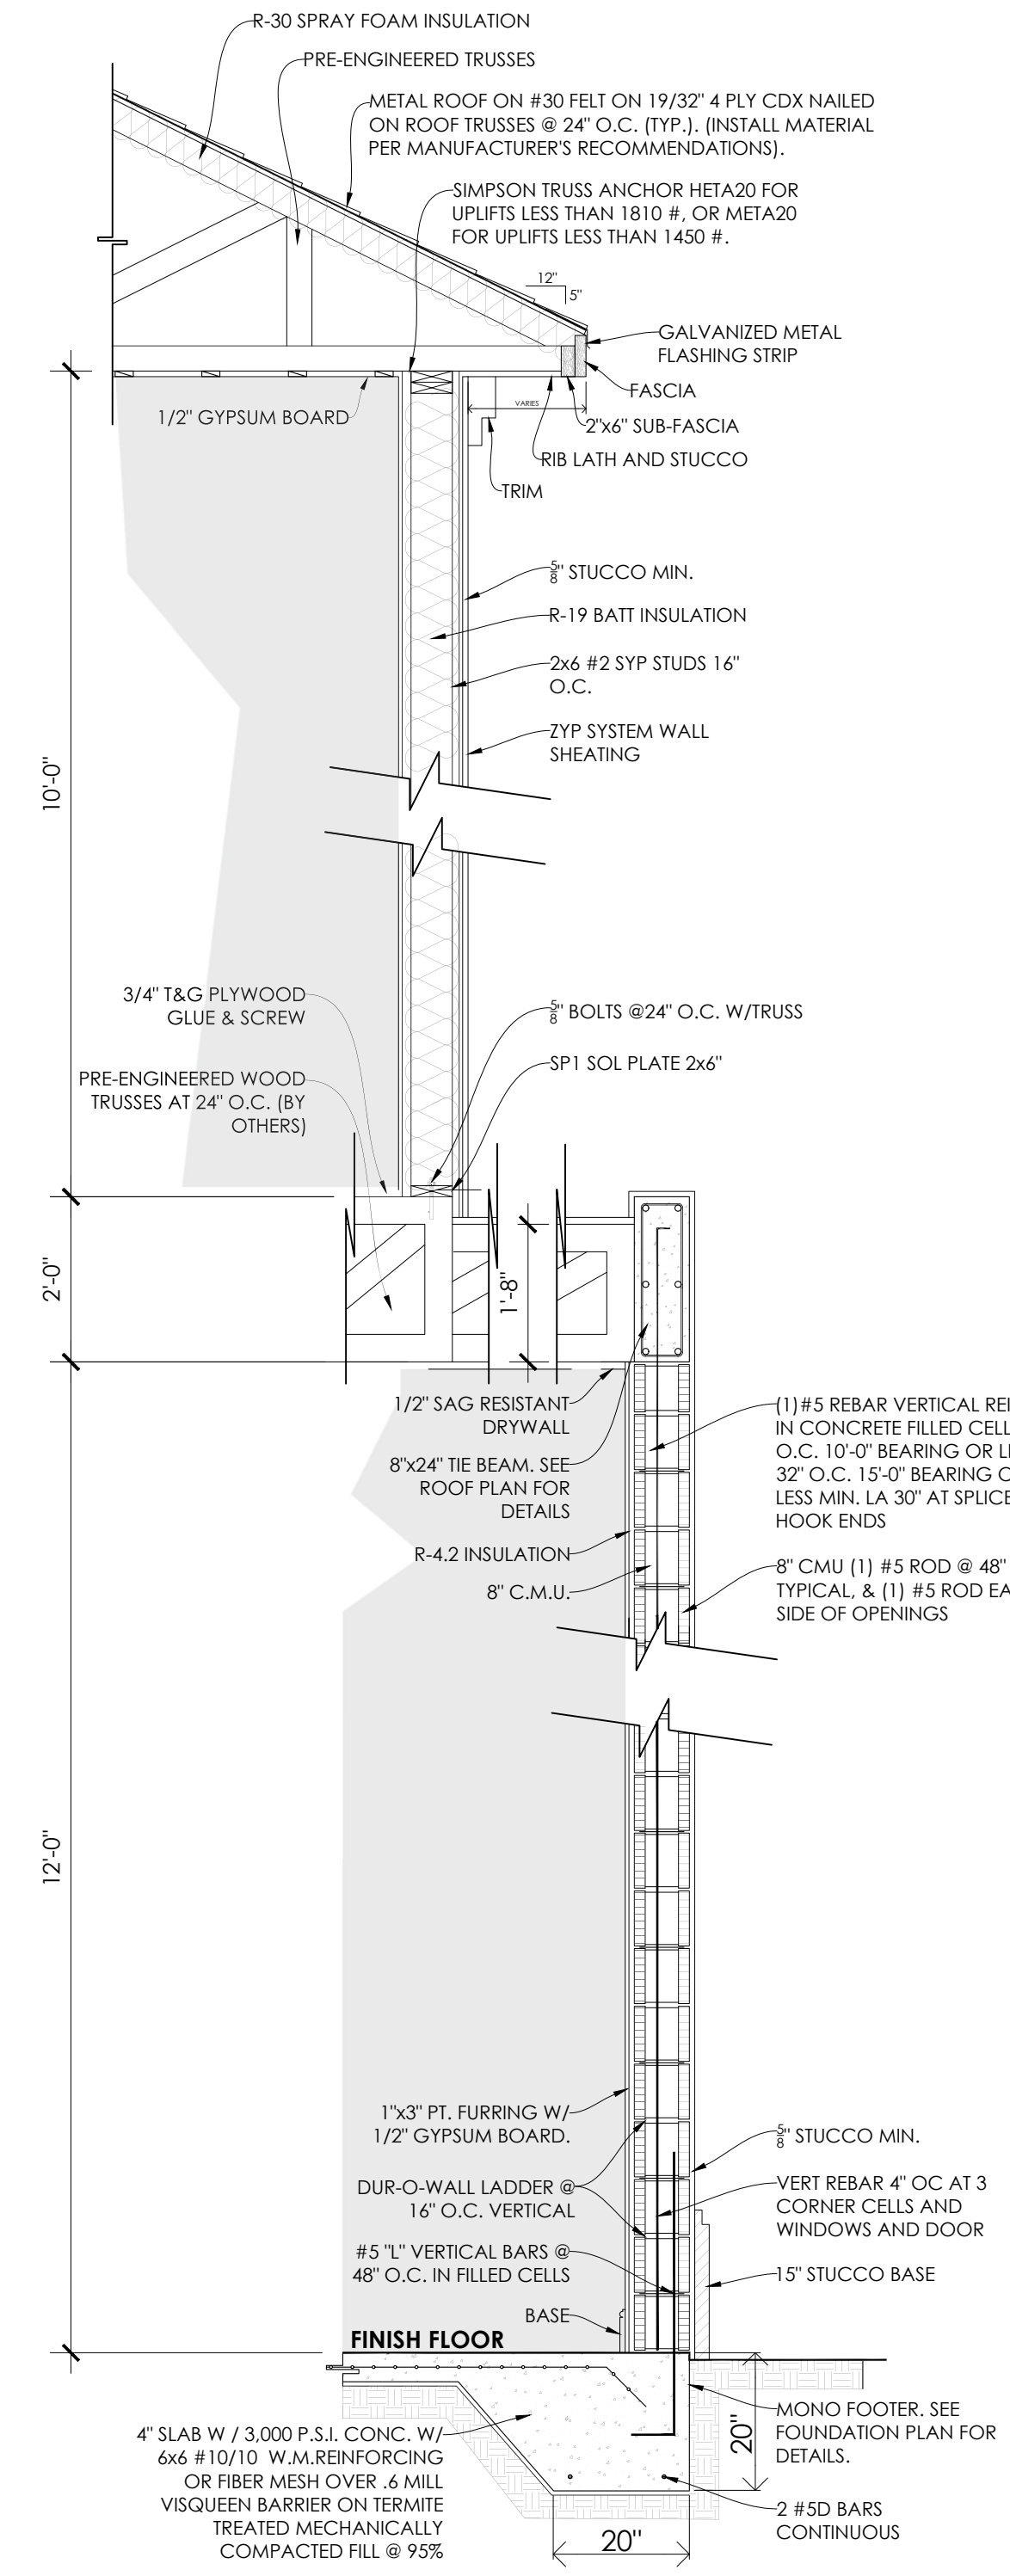

WALL SECTION TYP.

SCALE: 1/2"=1'-0"

Date
JUNE 2025

Designed by

Drawn

Check by

Scale
3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION. ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

D DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304
SEAL:




Sign & Seal

REVISION
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

Location
Revision

A201

Page
ELEVATIONS

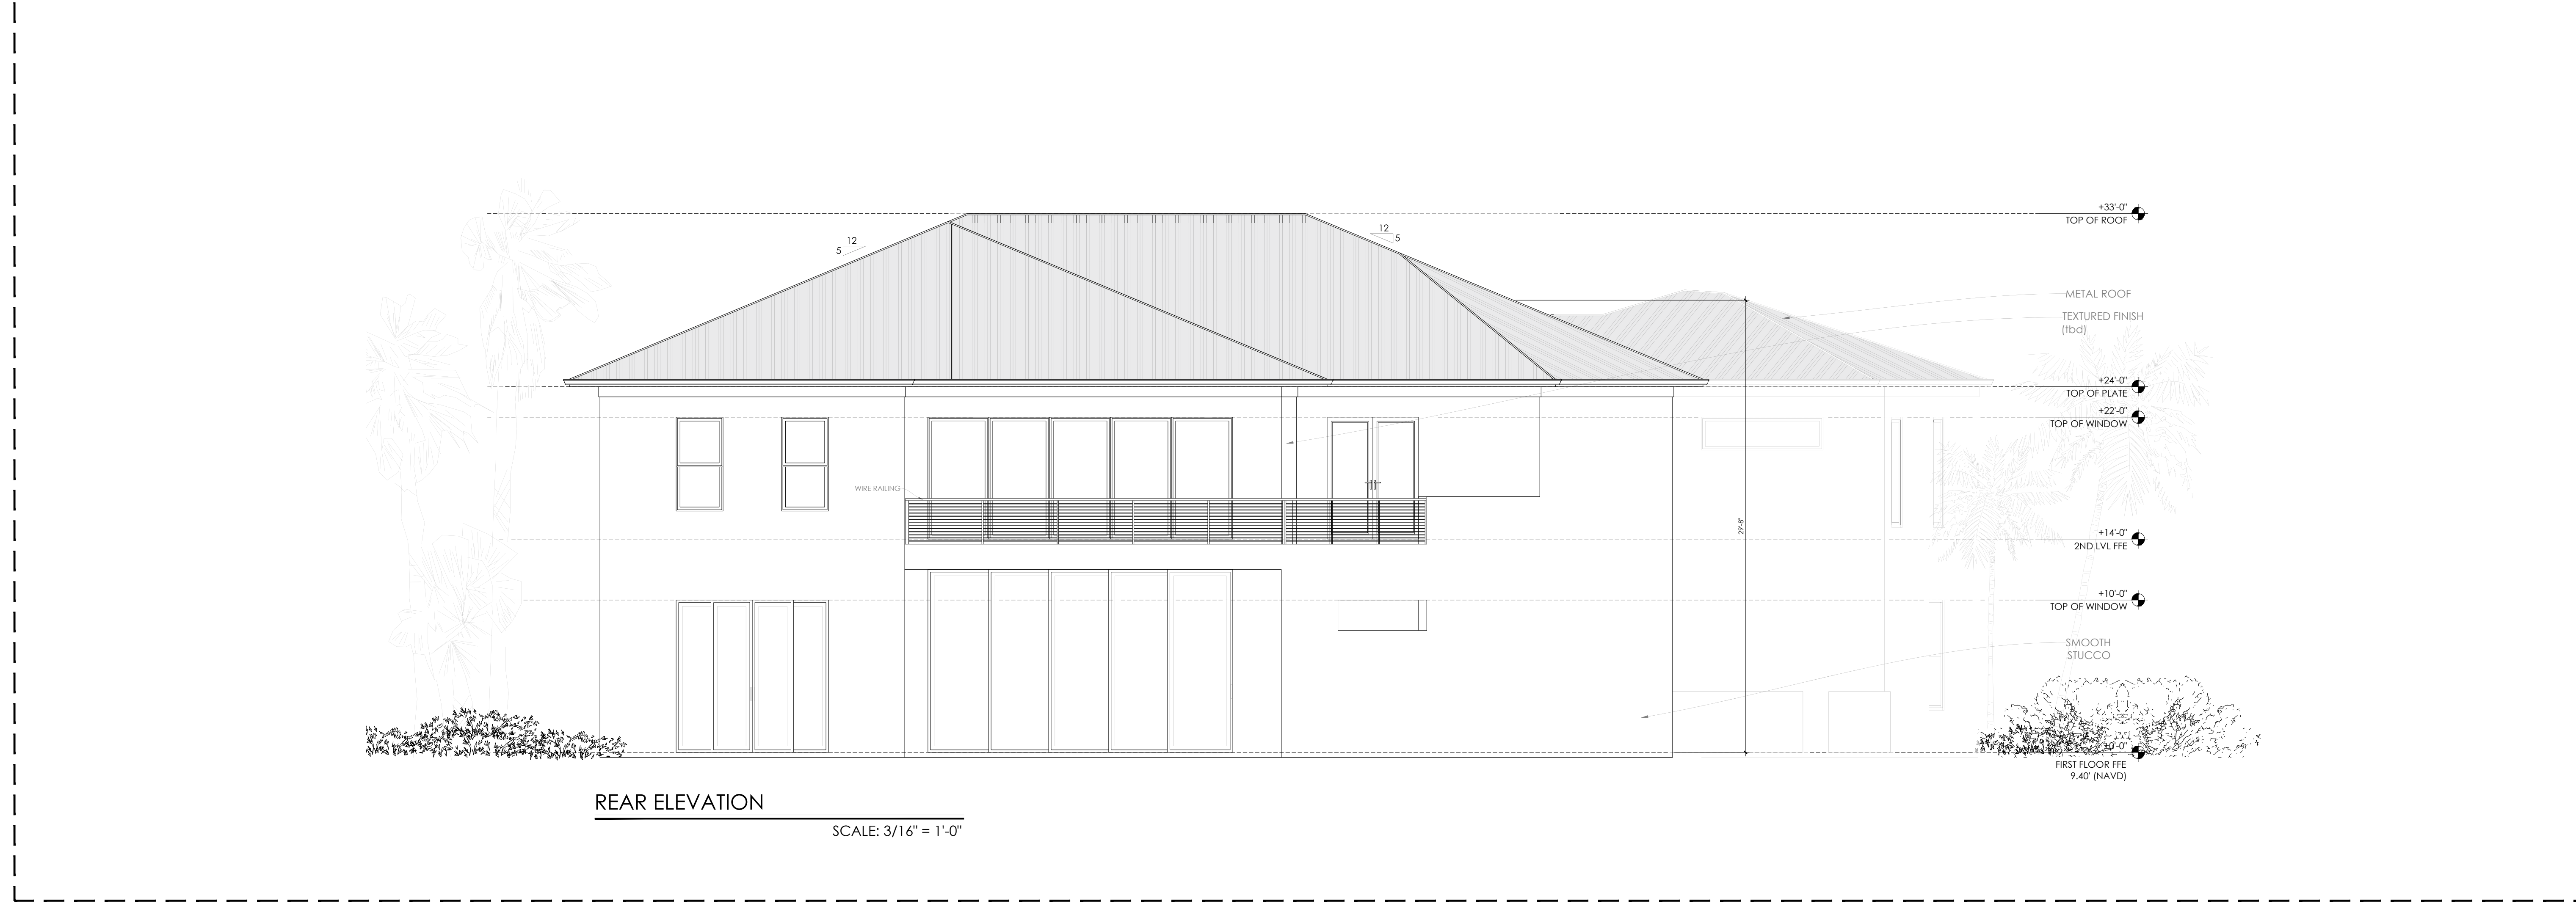

Date

JUNE 2025

Designed by

Drawn

Check by

Scale

3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THIS STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELAYED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

SEAL:
STATE OF FLORIDA
CESAR D. DURAN
AR 103304
REGISTERED ARCHITECT

Sign & Seal

Location

REVISION

Revision

Page

NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

A202

ELEVATIONS

MASONRY WALL REINFORCEMENT NOTES

1. WALL REINFORCEMENT SHALL BE DOWELED FROM FOUNDATION AND BE CONTINUOUS THROUGH SOLID GROUTED CELLS AND BE HOOKED OVER TOP REINFORCEMENT OF UPPER BEAMS. MINIMUM LAP SPICE SHALL BE 48 BAR DIAMETERS. FOR HORIZONTAL WALL REINFORCEMENT, @ EVERY OTHER COURSE.
2. WALL REINFORCEMENT IS AS FOLLOWS: #5 @ 48" O.C. PROVIDE 1 #5 AT ALL WALL INTERSECTIONS, CORNERS, & EACH SIDE OF OPENINGS AND 2 #5 EACH SIDE OF OPENINGS LARGER THAN 4'-0".
3. WALL SEGMENTS BELOW AND ABOVE THE OPENINGS SHALL BE REINFORCED SAME AS WALL.
4. MASONRY GROUT = 2000 PSI.
5. MASONRY WALL COMPRESSIVE STRENGTH OF f_m = 1500 PSI.
6. MORTAR TYPE M OR S WITH 1900 PSI COMPRESSIVE STRENGTH.

FOUNDATION/GROUND FLOOR NOTES


1. FLOOR SLAB IS A 4" CONC. SLAB-ON-GRADE (f_c =3000 psi) WITH 6 X 6 W1.4 X W1.4 W.W.F. @ MID-DEPTH OR SYNTHETIC FIBER REINFORCEMENT (NOT SHOWN) ON WELL COMPACTED & TREATED SOIL OVER 6 MIL. VAPOR BARRIER. REFER TO DETAIL. SOIL SHALL BE COMPACTED TO 95% MODIFIED PROCTOR PER ASTM D 1557 IN LIFTS NOT TO EXCEED 12".
2. FOUNDATIONS ARE DESIGNED FOR 2000 PSF. GENERAL CONTRACTOR SHALL VERIFY THE VALIDITY OF THIS ASSUMPTION.
3. CENTER OF LOAD SHALL COINCIDE WITH CENTER OF FOOTING U.N.O.
4. ALL CONCRETE TO HAVE A MINIMUM 3000 PSI COMPRESSIVE STRENGTH WITH THE WATER/CEMENT RATIO OF 0.5 MAXIMUM. INDICATES ADDITIONAL #5 IN CMU WALLS.
5. INDICATES ADDITIONAL #5 IN CMU WALLS.
6. ALL REINFORCEMENT SHALL BE GRADE 60.

FOUNDATION NOTES:

1. FOR MISSED REBAR DRILL AND 8"X3/4" HOLE IN CONCRETE. CLEAN HOLE FREE OF ALL DUST AND DEBRIS. FILL WITH EPOXY, THEN INSERT No.5 BAR WITH A MINIMUM 25" LAP.
2. FOR MISSED J-BOLT DRILL 5/8" HOLE X DEPTH APPROPRIATE ANCHOR. CLEAN HOLE FREE OF ALL DUST AND DEBRIS. INSERT 5/8" X 5" REDHEADS UNLESS NOTED OTHERWISE ON PLANS.
3. FOOTING DOWEL BARS SHALL BE PROVIDED FOR ALL REQUIRED REINFORCEMENT IN THE FOLLOWING LOCATIONS:
 - A.) AT ALL CORNERS.
 - B.) AT EACH SIDE OF ALL OPENINGS.
 - C.) AT ALL OTHER REINFORCING LOCATIONS (AS NOTED ON PLANS).
 - D.) AT ALL GIRDER BEARING LOCATIONS.
 - E.) AT 4 FEET ON CENTER MAXIMUM.
4. CONTRACTOR AND OR SUB-CONTRACTOR SHALL REVIEW THE TRUSS PLACEMENT PLANS AND CONSTRUCTION PLANS TO COORDINATE PLACEMENT OF FOOTINGS, DOWELS AND VERTICAL REINFORCEMENT PRIOR TO ANY CONCRETE POUR.
5. ISOLATED PADS TO HAVE A 12 INCHES MINIMUM COVER OVER CONCRETE.
6. ALL FOUNDATIONS TO HAVE DOWEL RODS OR EMBEDDED RODS PER ARCHITECTURAL OR STRUCTURAL PLANS.
7. BARS TO BE EVEN AND UNIFORMLY SPACED BASED ON MINIMUM COVER REQUIREMENTS.
8. PAD FOOTING STEEL TO BE INDEPENDENT OF OTHER REINFORCING.
9. EDGE OF SLAB TO BE RECESSED FOR GARAGE DOORS, EXTERIOR DOORS, AND SLIDING GLASS DOORS AS NOTED ON PLANS.

CONCRETE:


1. CONCRETE SHALL HAVE A MINIMUM COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS. UNLESS NOTED OTHERWISE.
2. FILL UNDER CONCRETE SLABS SHALL BE CLEAN AND FREE FROM DEBRIS AND OTHER DELETERIOUS MATERIAL. FILL SHALL BE COMPACTED TO A DENSITY OF AT LEAST 95% OF STANDARD PROCTOR MAXIMUM DRY DENSITY (ASTM D1557)
3. FOOTINGS SHALL BEAR UPON UNDISTURBED SOLID SOIL OR UPON SOLID COMPACTED TO A DENSITY OF AT LEAST 95% OF STANDARD PROCTOR MAXIMUM DRY DENSITY (ASTM D1557) FOR A DEPTH OF AT LEAST THREE FEET BELOW THE BASE OF THE FOOTING.
4. WHERE SHOWN, CORES OF BLOCK MASONRY SHALL BE FILLED WITH GROUT OR PEA GRAVEL CONCRETE WITH A MIN. COMPRESSIVE STRENGTH OF 3,000 PSI AT 28 DAYS.
5. REINFORCING STEEL SHALL BE No.5 OR No.4 BARS. ASTM A-615 GRADE 60 DEFORMED NEW BILLET STEEL CONFORMING TO ACI 301, ACI 315, ACI 318 AND CRSI MANUAL OF STANDARD PRACTICE, LATEST EDITIONS.
6. R606.9.2 SPLICING. SPLICES SHALL BE LAP SPLICES. NON-CONTACT LAP SPLICES SHALL BE PERMITTED PROVIDED REINFORCING BARS ARE NOT SPACED FARTHER APART THAN 5 INCHES. SPICE LENGTHS SHALL BE IN ACCORDANCE WITH THE TABLE R606.9.2 AND SHALL BE A MINIMUM OF 25 INCHES FOR No.5 BARS AND 20 INCHES FOR No.4 BARS.
7. CONCRETE COVER OF REINFORCING STEEL SHALL BE AS FOLLOWS:
 - FOOTINGS: 3" BOTT. AND SIDES, 2" TOP
 - BEAM: 1.5" BOTT. SIDES AND TOP
 - COLUMNS 1.25"
 - SLABS ON GRADE: 3" BOTT. 1" TOP
8. R606.9.1 BUNDLING. BUNDLING SHALL BE PERMITTED WHEN TWO BARS ARE REQUIRED AT THE SAME LOCATION IN A WALL OR IN A BOND BEAM.
9. (R606.9.9.1) OFFSET REINFORCEMENT. VERTICAL REINFORCEMENT SHALL BE PERMITTED TO BE OFFSET BETWEEN FLOOR LEVELS. REINFORCEMENT FOR THE LOWER STORY SHALL BE ANCHORED INTO THE UPPER FLOOR LEVEL BOND BEAM AND REINFORCEMENT FOR THE UPPER STORY SHALL BE ANCHORED INTO THE BOND BEAMS ABOVE AND BELOW IN ACCORDANCE WITH SECTION R606.9.8 AND FIGURES R606.9A AND R606.9B.
10. (R606.9.10) METAL ACCESSORIES. JOINT REINFORCEMENT, ANCHORS, TIES AND WIRE FABRIC SHALL CONFORM TO THE FOLLOWING: ASTM A 82 FOR WIRE ANCHORS AND TIES; ASTM A 36 FOR PLATE, HEADED AND BENT-BAR ANCHORS; ASTM A 510 FOR CORRUGATED SHEET METAL ANCHORS AND TIES; ASTM A 951 FOR JOINT REINFORCEMENT; ASTM B 227 FOR COPPER-CLAD STEEL WIRE TIES; OR ASTM A 167 FOR STAIN-LESS STEEL HARDWARE.
11. R606.10.1 CORROSION PROTECTION. MINIMUM CORROSION PROTECTION OF JOINT REINFORCEMENT, ANCHOR, TIES AND WIRE FABRIC FOR USE IN MASONRY WALL CONSTRUCTION SHALL CONFORM TO TABLE R606.9.10.1

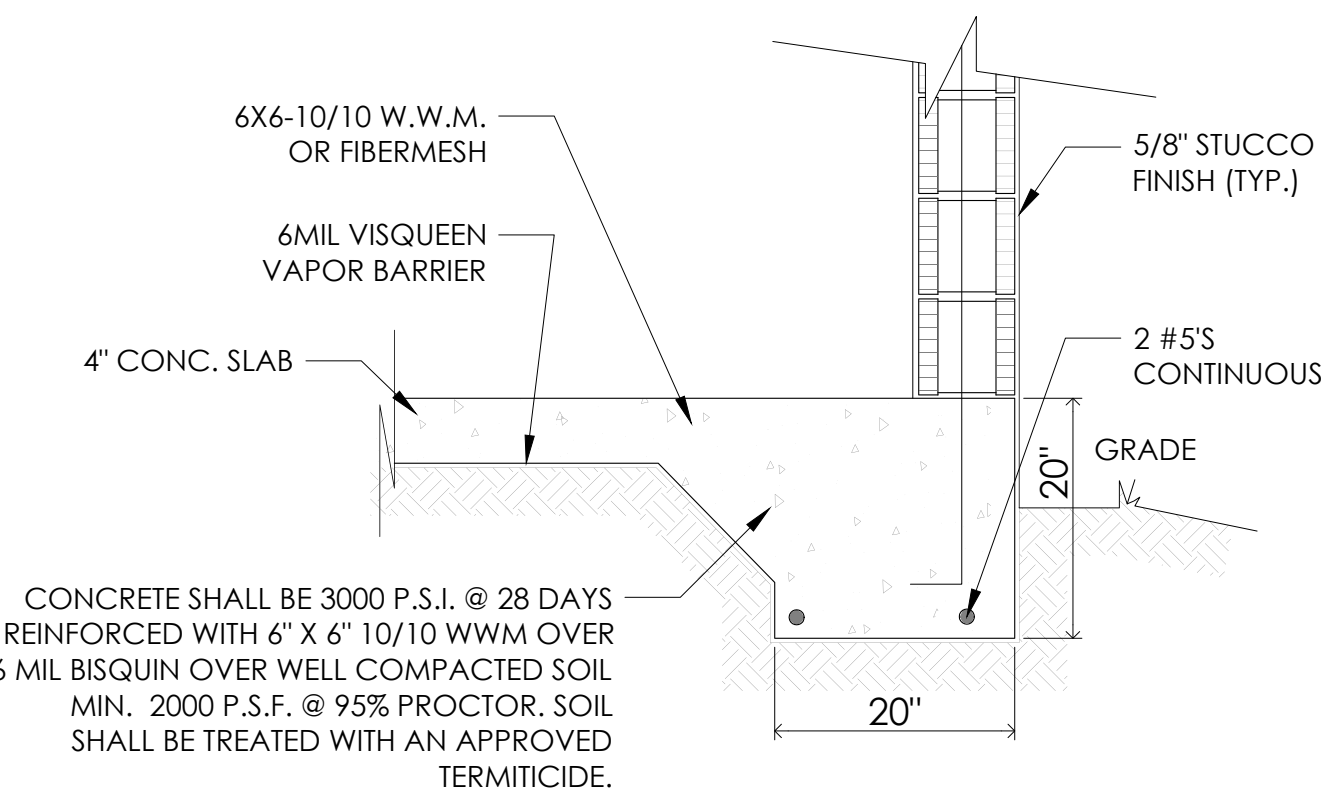

1
S101

TYP FOOTING DETAIL


SCALE: 3/4" = 1'-0"

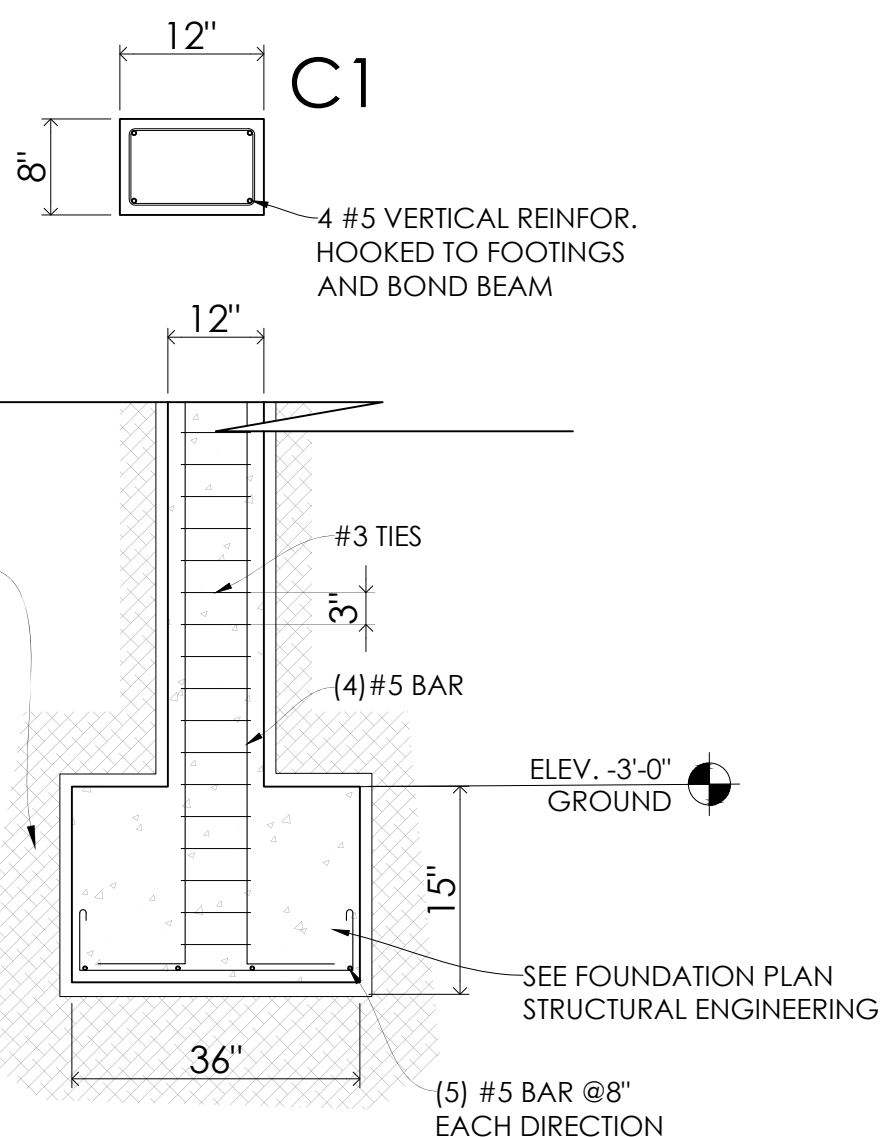

4
S101


COLUMN FOOTER DETAIL

SCALE: 3/4" = 1'-0"

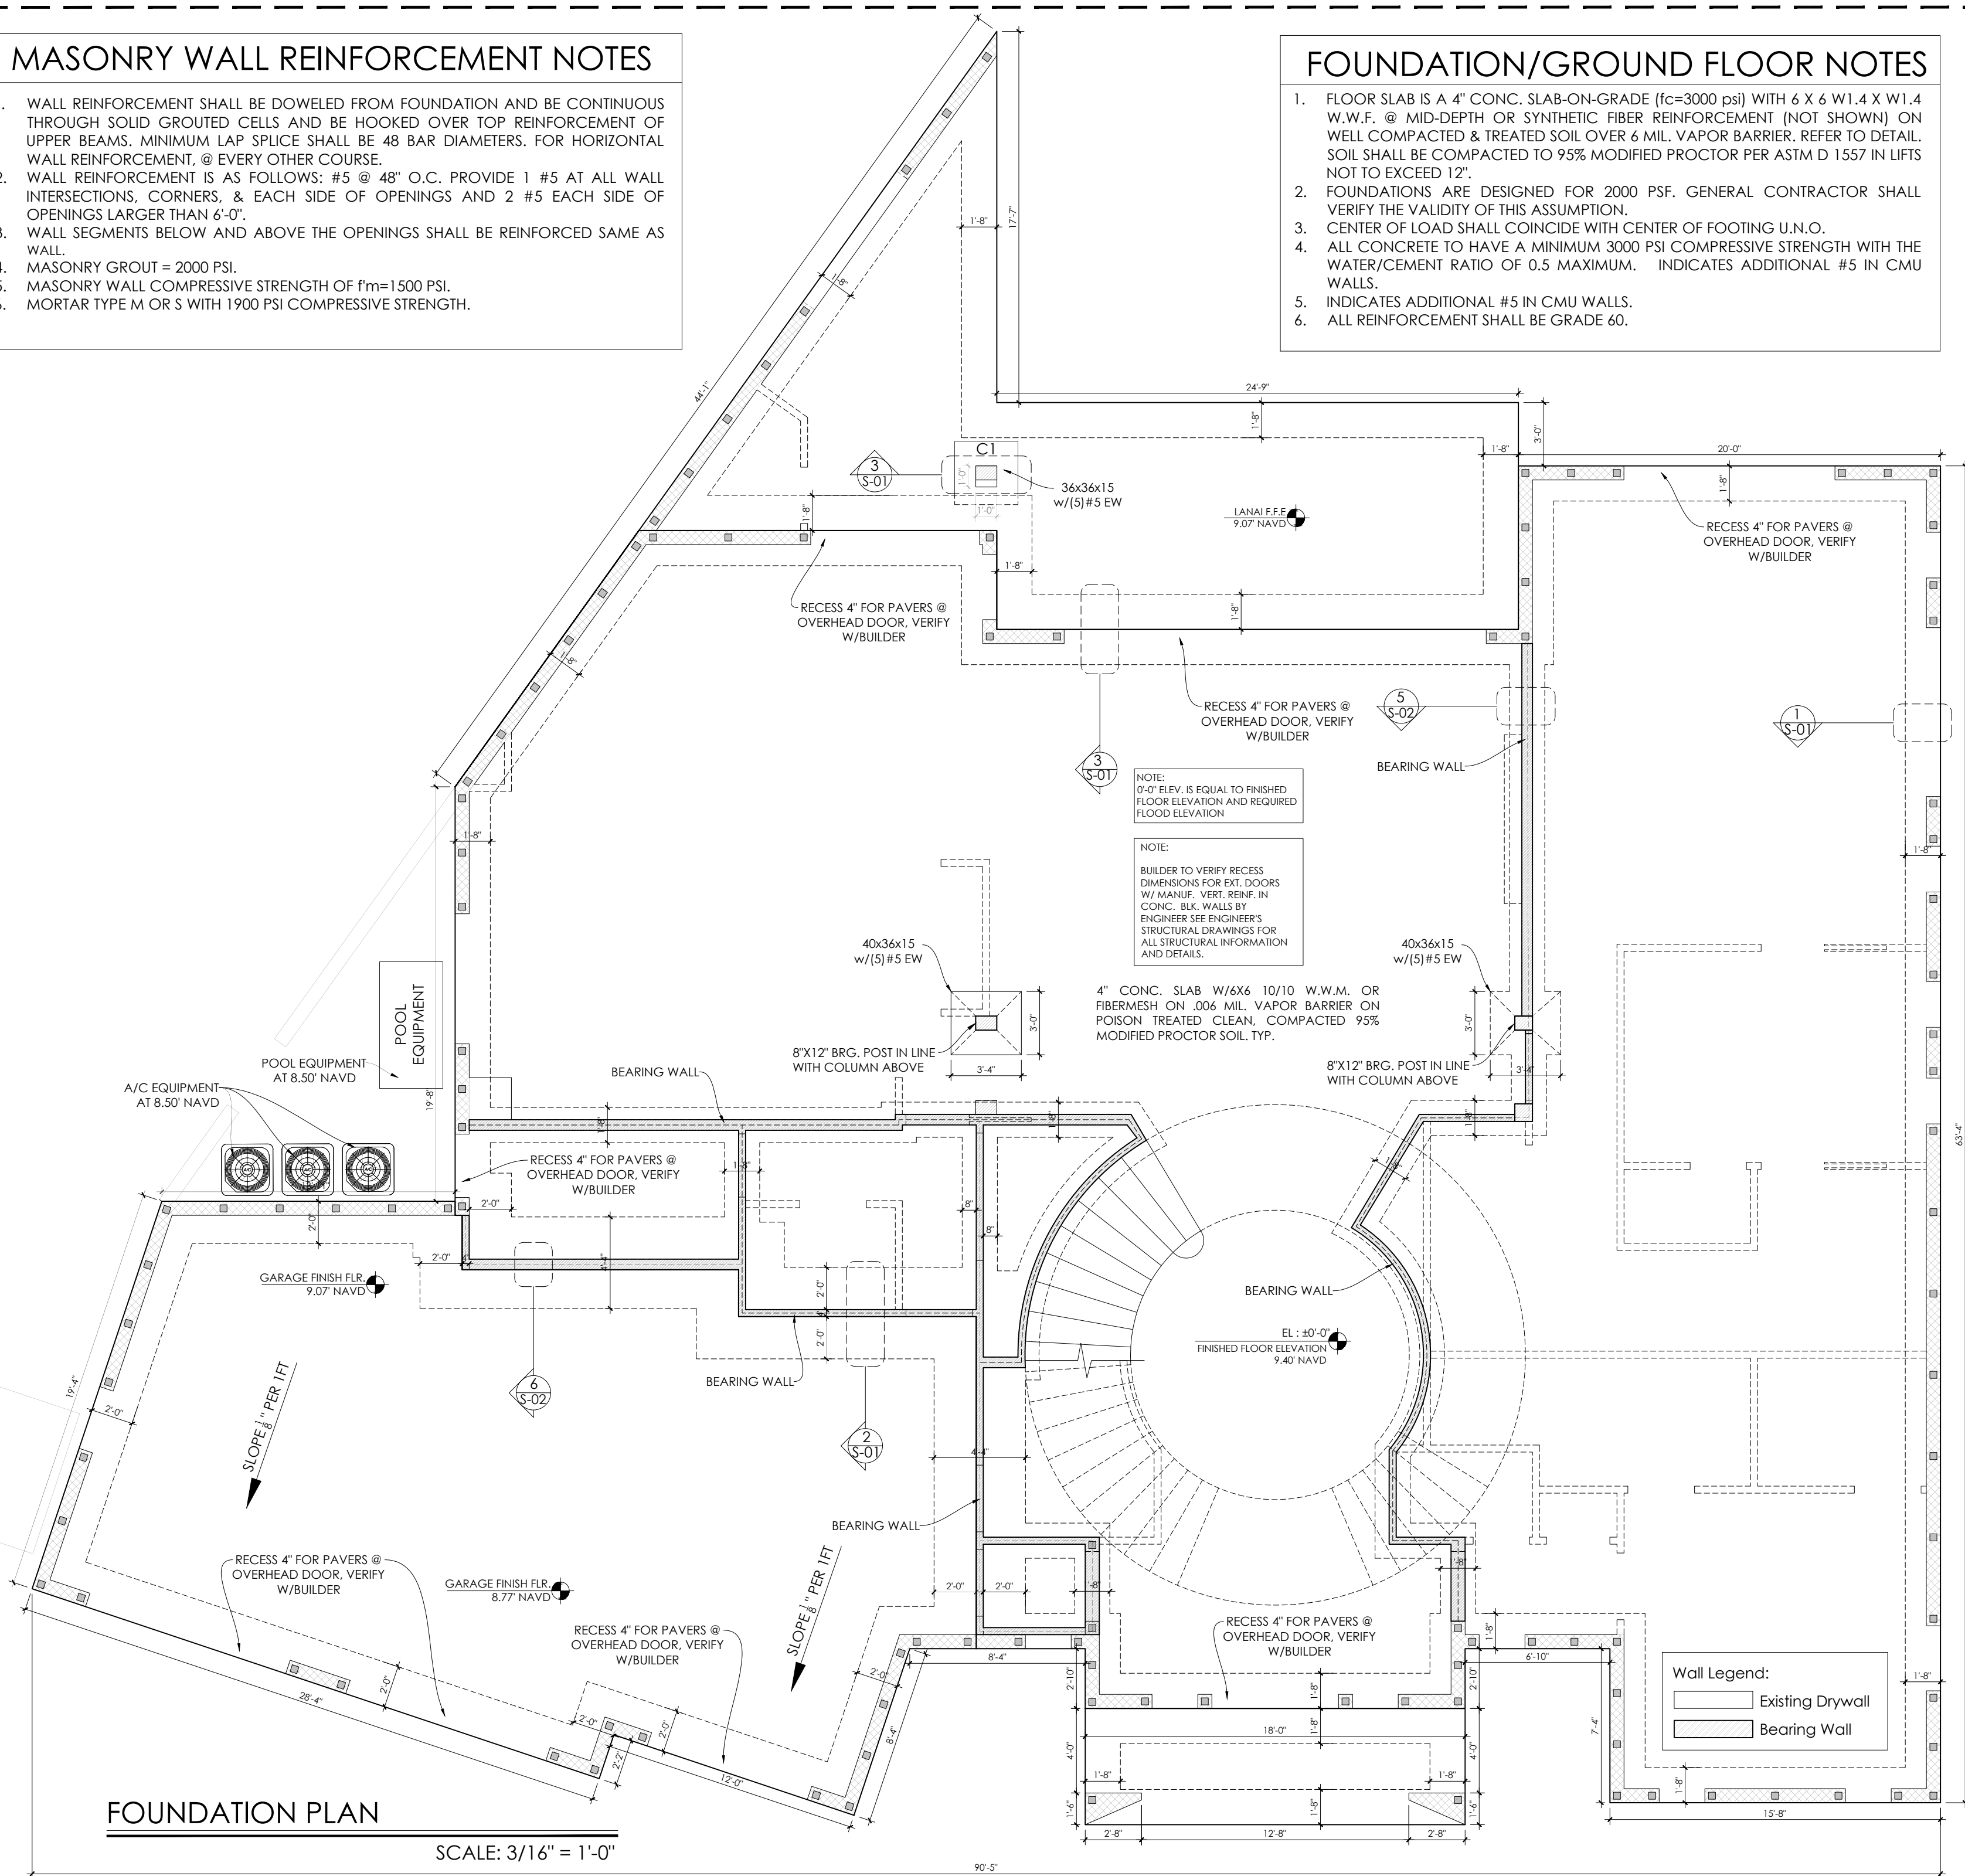

FOUNDATION PLAN


SCALE: 3/16" = 1'-0"

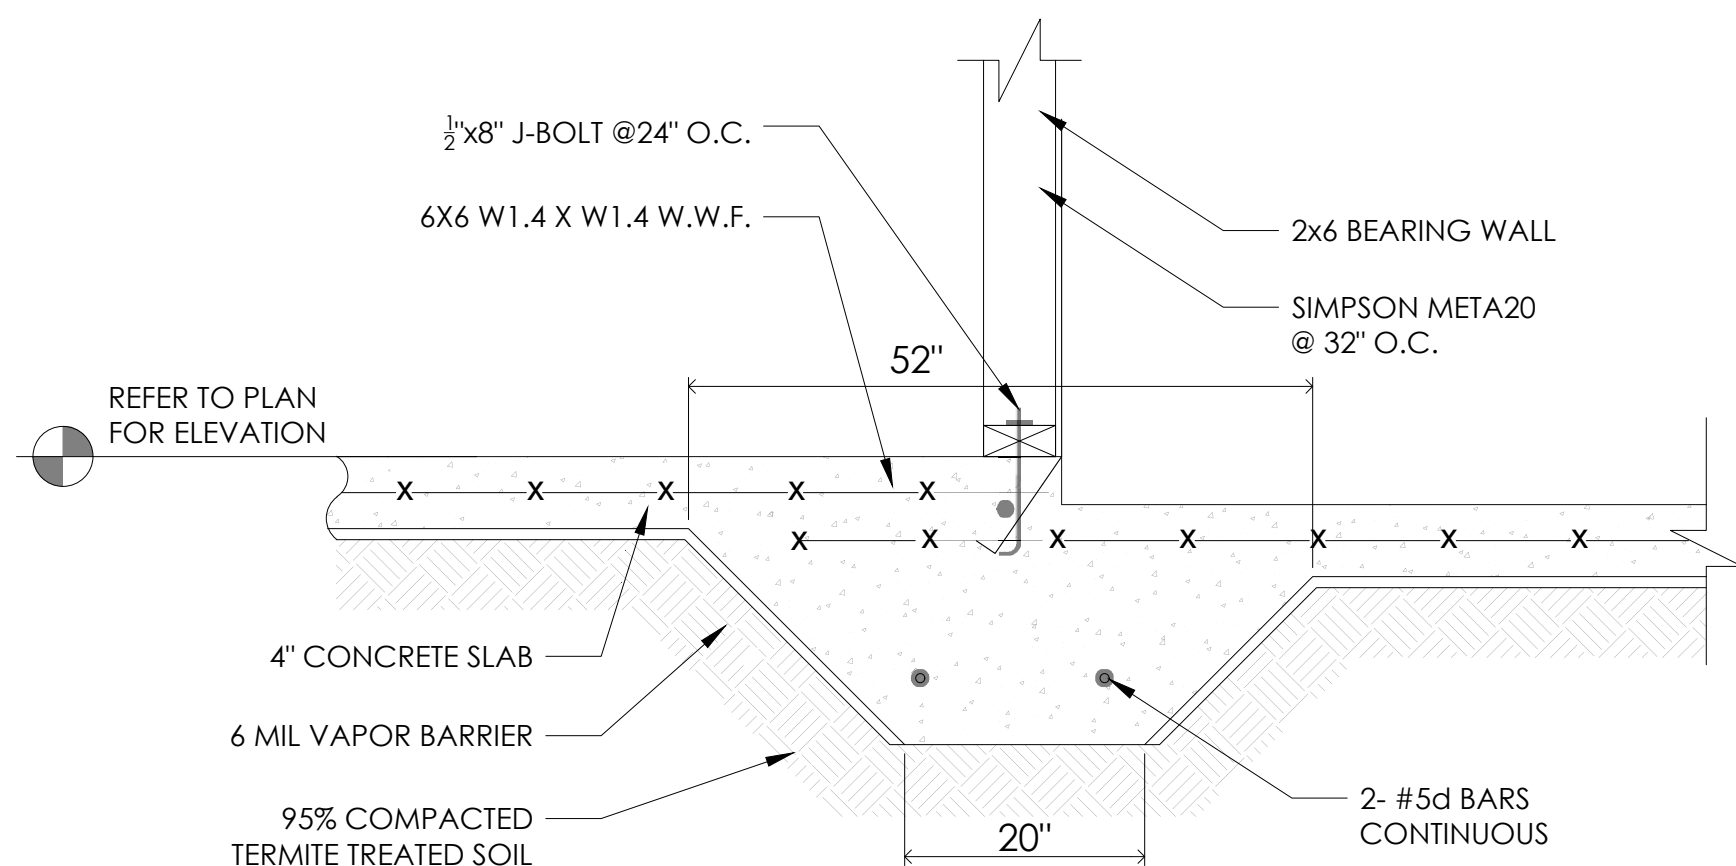

2
S101

GARAGE FOOTING DETAIL

SCALE: 3/4" = 1'-0"

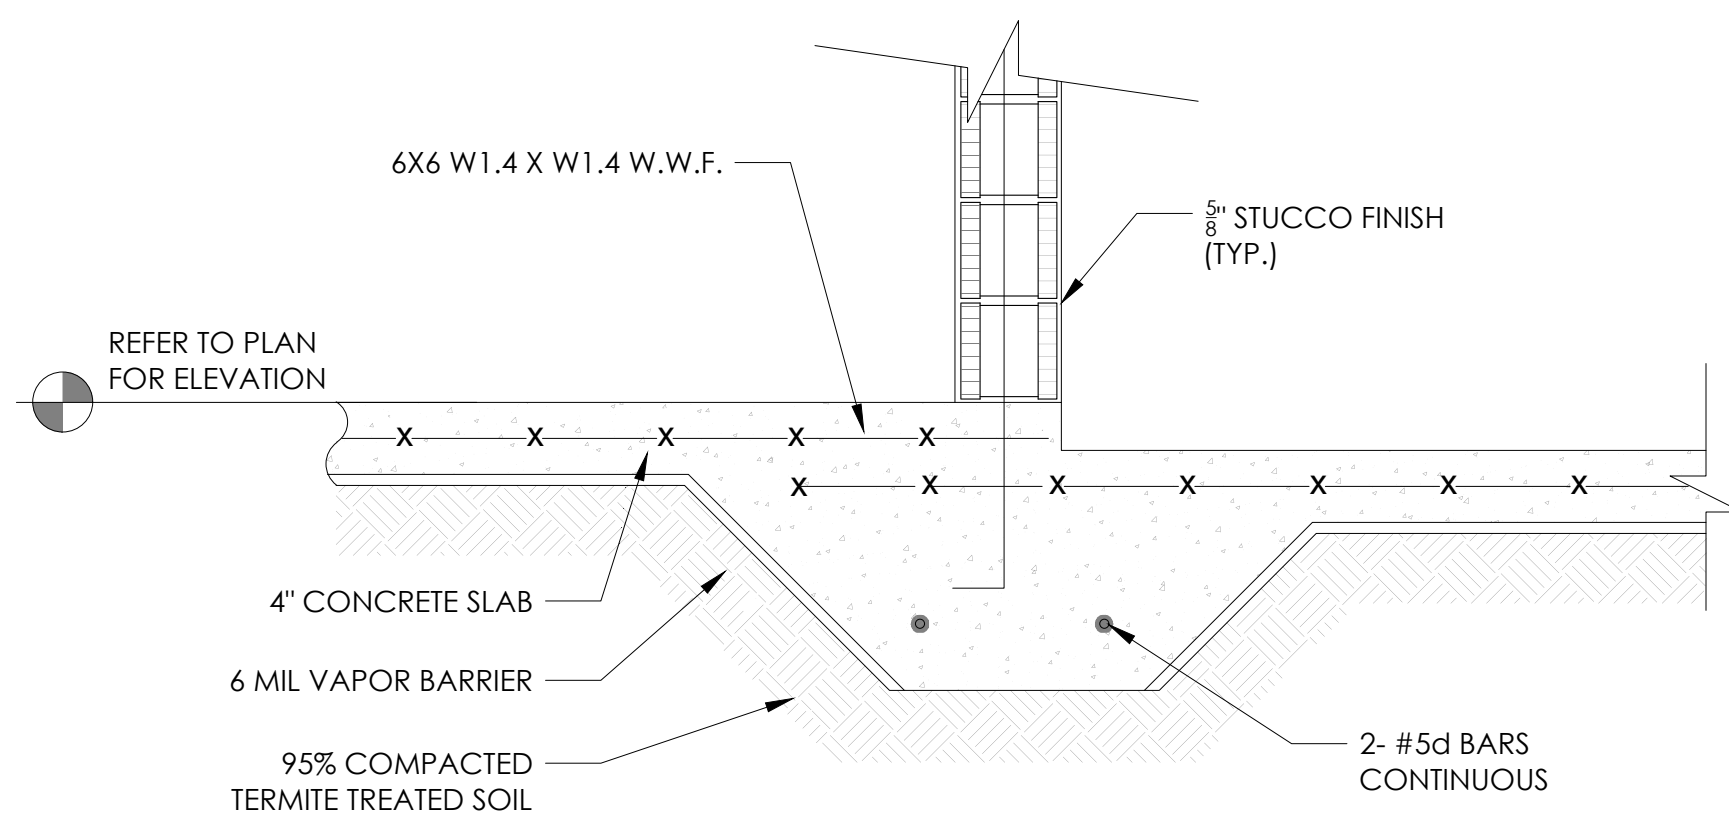

3
S101

LANAI FOOTING DETAIL

SCALE: 3/4" = 1'-0"


Date	JUNE 2025
Designed by	
Drawn	Check by
Scale	3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORROBORATE THE DESIGN OF THIS STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

D DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304
SEAL:

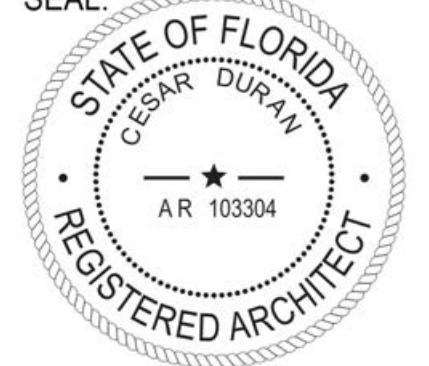

Sign & Seal

R E V I S I O N
N E W S I N G L E F A M I L Y
R E S I D E N C E
8849 L E L Y I S L A N D C I R
N A P L E S , F L , 3 4 1 1 3

Location


Revision

Page

FOUNDATION PLAN

S101

Page S102 LINEL PLAN	Revision	Location
		R E V I S I O N
		NEW SINGLE FAMILY
		R E S I D E N C E
		8849 LELY ISLAND CIR NAPLES, FL, 34113

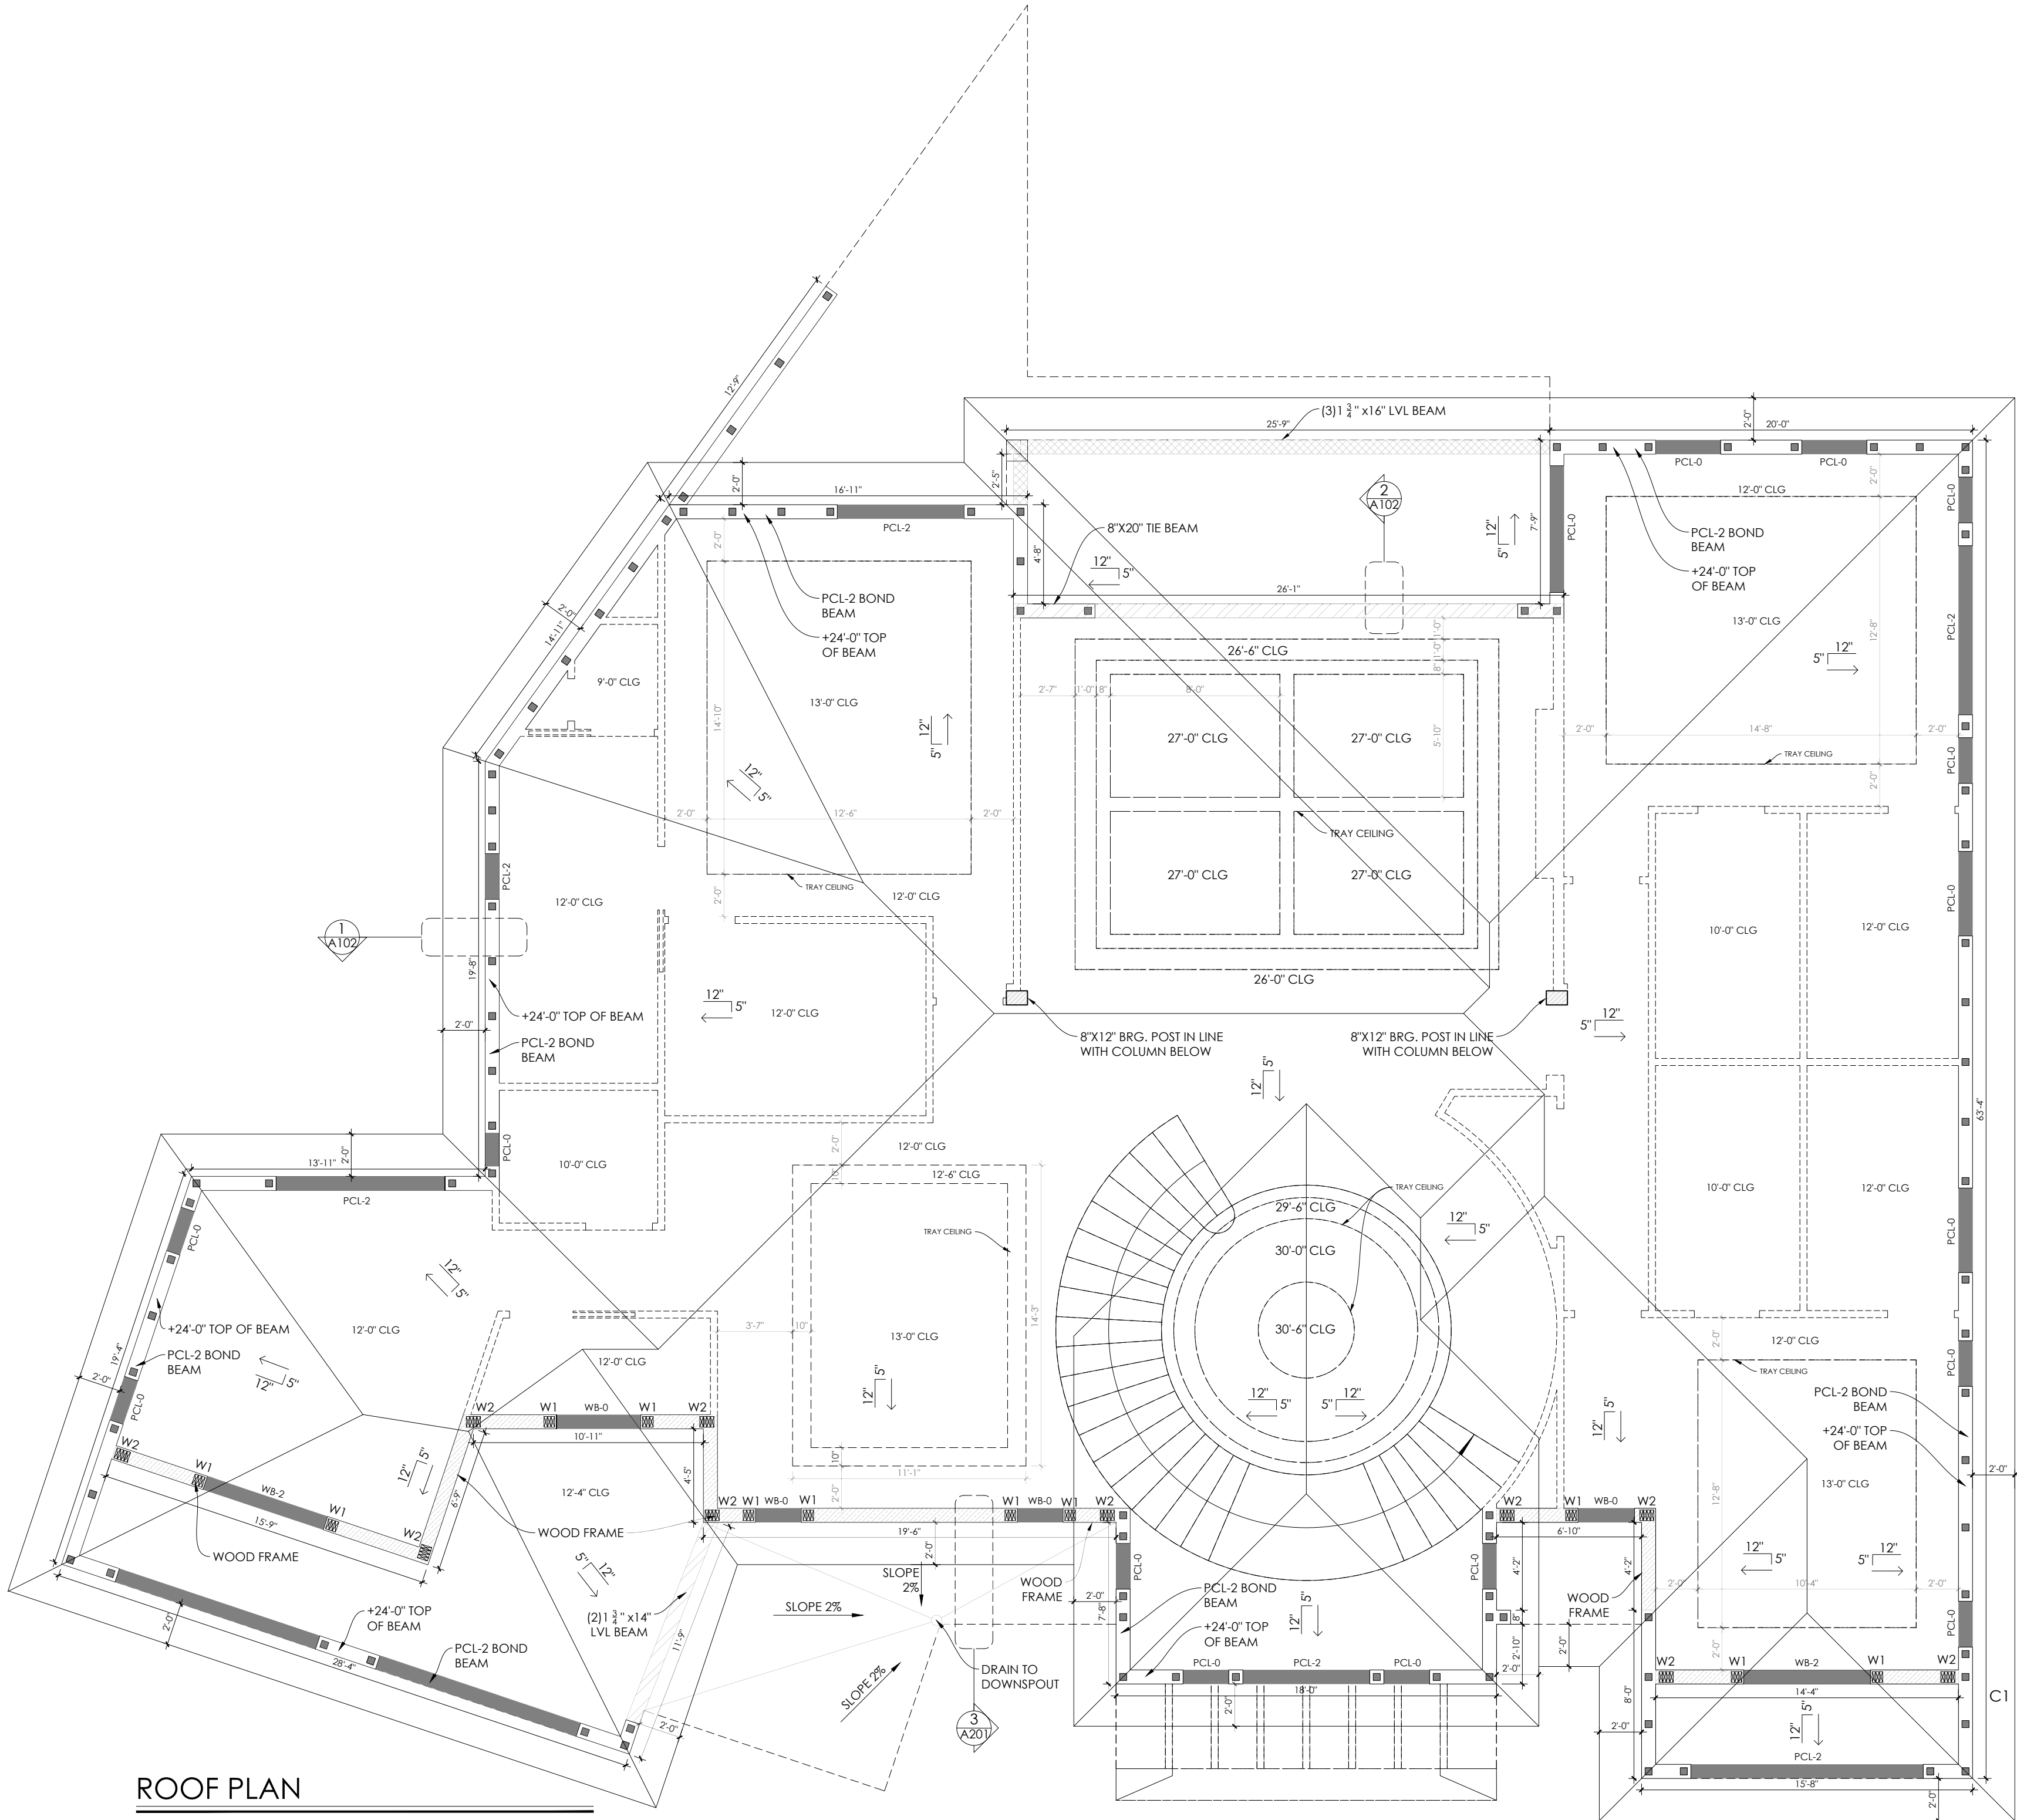

ROOF PLAN
SCALE: 3/16" = 1'-0"

ROOF NOTES

- THIS BUILDING/STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH 8TH EDITION (2023) FLORIDA BUILDING CODE AND SECTION 1609 FOR DESIGN PRESSURES GENERATED BY A DESIGN WIND VELOCITY OF 170 MPH.
- PROVIDE GYPSUM BOARD 1/2" MIN FOR 16" O.C. FRAMING AND FROM 1/2" TO 5/8" FOR 24" O.C. FRAMING OR 1/2" SAG-RESISTANT GYPSUM CEILING BOARD PER FBC R702.5.
- LANAI & ENTRY CEILINGS SHALL HAVE A 1/2" CD EXTERIOR PLYWOOD LAID PERPENDICULAR TO TRUSS BOTTOM CHORDS AND NAILED W/ 10d NAILS @ 6" O.C.


COMPONENT AND CLADDING DESIGN PRESSURES		
V _{ult} = 170 MPH ULTIMATE DESIGN WIND SPEED COMPONENT AND CLADDING (BASED ON V _{ult}) EXPOSURE C ULTIMATE DESIGN PRESSURES (LRFD) PSF		
ROOF ZONE	AREA	APPLIED DESIGN PRESSURE
ZONE 1	10 SF	+39.9 / -44.5 PSF
	20 SF	+33.9 / -42.9 PSF
	50 SF	+29.5 / -40.6 PSF
	100 SF	+26.2 / -38.9 PSF
ZONE 2	10 SF	+37.1 / -108.2 PSF
	20 SF	+33.9 / -96.6 PSF
	50 SF	+29.5 / -83.6 PSF
	100 SF	+26.2 / -75.5 PSF
ZONE 3	10 SF	+37.1 / -162.8 PSF
	20 SF	+33.9 / -142.0 PSF
	50 SF	+29.5 / -128.9 PSF
	100 SF	+26.2 / -119.1 PSF
WALL ZONE	AREA	APPLIED DESIGN PRESSURE
ZONE 4	10 SF	+64.5 / -70.0 PSF
	20 SF	+61.6 / -67.1 PSF
	50 SF	+57.7 / -63.1 PSF
	100 SF	+54.9 / -60.3 PSF
	101 + SF	+48.0 / -53.5 PSF
ZONE 5	10 SF	+64.5 / -86.4 PSF
	20 SF	+61.6 / -80.5 PSF
	50 SF	+57.7 / -72.8 PSF
	100 SF	+54.9 / -67.1 PSF
	101 + SF	+48.0 / -53.5 PSF

NOTE: ALL DOORS & WINDOWS ARE TO BE PROTECTED WITH A APPROVED IMPACT RESISTANT GLASS OR SHUTTERS.
FOR WOOD FRAME DOUBLE TOP PLATE, TOP PLATE SPLICE REQUIREMENT MINIMUM LAP IS 36". FASTEN LAPS WITH (2) ROWS 1/4"x3" SCREWS AT 6" O.C.

COMPONENT AND CLADDING DESIGN PRESSURES		
V _{asd} = 132 MPH NOMINAL DESIGN WIND SPEED (V _{ult} = 170 MPH) COMPONENT AND CLADDING (BASED ON V _{asd}) EXPOSURE C GARAGE DOORS & WINDOWS INCLUDED PRESSURES CALCULATED USING (V _{ult} x 0.6) WHICH IS EQUIVALENT TO V _{asd} ALLOWABLE STRESS DESIGN PRESSURE (ASD) PSF		
AREA OPENING	INTERIOR ZONE	END ZONE
0 - 10 SF	+38.8 / -42.0 PSF	+38.8 / -51.8 PSF
11 - 20 SF	+37.0 / -40.2 PSF	+37.0 / -48.3 PSF
21 - 50 SF	+34.6 / -37.8 PSF	+34.6 / -43.7 PSF
51 - 100 SF	+32.9 / -36.3 PSF	+32.9 / -40.2 PSF
101 + SF	+28.8 / -32.1 PSF	+28.8 / -32.1 PSF
V _{asd} = 132 MPH NOMINAL DESIGN WIND SPEED COMPONENT AND CLADDING (BASED ON V _{asd}) EXPOSURE C GARAGE DOORS DESIGN PRESSURE ALLOWABLE STRESS DESIGN PRESSURE (ASD) PSF		
AREA OPENING		
0 - 110 SF	+41.6 / -46.5 PSF	
111 + SF	+38.6 / -43.4 PSF	

NOTE: ALL DOORS & WINDOWS ARE TO BE PROTECTED WITH A APPROVED IMPACT RESISTANT GLASS OR SHUTTERS.

WIND LOAD REQUIREMENTS:
1. THE STRUCTURAL SYSTEMS FOR THE DRAWINGS PRESENTED WERE DESIGNED PER THE LOADING PRESENTED IN THE FLORIDA BUILDING CODE 2023 8TH EDITION. THE DESIGN WIND SPEED IS (V_{ult} = 170 MPH.) AND (V_{asd} = 132 MPH).
2. IMPORTANCE FACTOR I_w = 1.0 OF THE FLORIDA BUILDING CODE 8TH EDITION.
3. EXPOSURE CATEGORY B.
4. INTERNAL PRESSURE COEFFICIENT (ASCE 7-10) +0.18 / -0.18 ENCLOSED BUILDING OPENINGS ARE PROTECTED FROM FLYING DEBRIS WITH IMPACT GLASS AND/OR SHUTTERS.

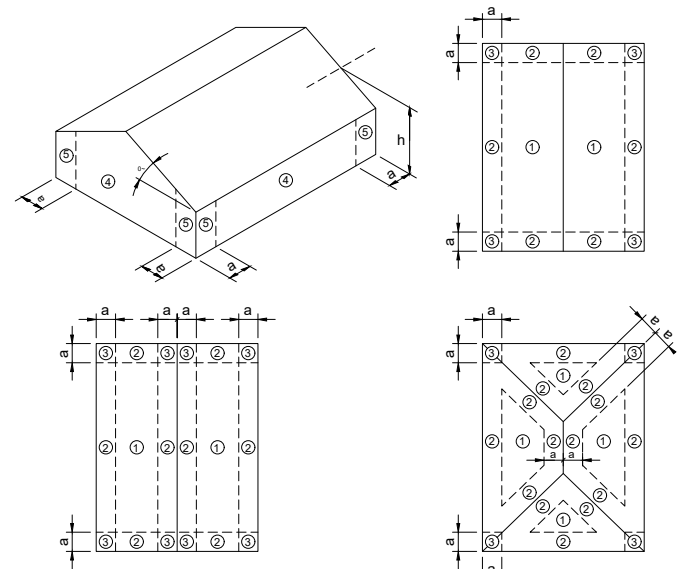

COMPONENT AND CLADDING LOADING
DIAGRAM FIGURE 1

NOTES:

1) IS REQUIRED UNLESS AT LEAST 40 PERCENT AND NOT MORE THAN 50 PERCENT OF THE REQUIRED VENTILATING AREA IS PROVIDED BY VENTILATORS LOCATED IN THE UPPER PORTION OF THE ATTIC OR RAFTER SPACE. UPPER VENTILATORS SHALL BE LOCATED NO MORE THAN 3 FEET (914 mm) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE, MEASURED VERTICALLY. WITH THE BALANCE OF THE REQUIRED VENTILATION PROVIDED BY EAVE OR CORNICE VENTS. WHERE THE LOCATION OF WALL OR ROOF FRAMING MEMBERS CONFLICTS WITH THE INSTALLATION OF UPPER VENTILATORS. INSTALLATION MORE THAN 3 FEET (914 mm) BELOW THE RIDGE OR HIGHEST POINT OF THE SPACE SHALL BE PERMITTED.

DISCRETE ROOF AREAS TO HAVE PERCENTAGE OF TOTAL VENTING PROPORTIONAL TO THE PERCENTAGE OF AREA. SMALL ROOF AREAS SUCH AS ENTRY TOWERS MAY BE VENTED W/SOFFIT VENTS ONLY PROVIDED VENTILATION IS BASED ON THE 2x INCREASE IN NET FREE AREA.

ROOF VENTS SHOWN ARE BASED ON OFF RIDGE VENTS HAVING A MINIMUM NET FREE AREA OF 130 SQ. INCHES & PERFORATED SOFFIT MATERIAL HAVING A MIN. NET FREE ARE OF 11.74 SQ. INCHES CONTRACTOR REQUIRED TO VERIFY ALL ROOF VENTING PER THE CALCULATION IN FBC R806.2.

LOCATE ALL ROOF VENT PENETRATIONS MIN. 18" FROM RIDGES OR VALLEYS.

MINIMUM ROOF VENT AREA PER FBC R806.2

AREA: 2,641.00 SQ FT
VENTING REQUIRED: 2,641.00 x 144 SQ IN/SQ FT x 1/300 SQ IN VENT/ SQ IN ROOF= 1,268.00 SQ FT

ROOF TRUSSES NOTES

- ROOF TRUSSES SHALL BE DESIGNED BY TRUSS MANUFACTURER. SHOP DRAWINGS SHALL BE SUBMITTED TO THE PROJECT ENGINEER FOR REVIEW PRIOR TO PRODUCTION.
- TRUSS MANUFACTURER SHALL PROVIDE UPLIFT & REACTION VALUES FOR INDIVIDUAL TRUSSES. REFER TO THE TRUSS DRAWING FOR LAYOUT.
- ROOF SHEATHING SHALL CONSIST OF 19/32" MIN.PLYWD. 4-PLY CDX OR 19/32" 4-PLY OSB LAID PERPENDICULAR TO TRUSSES NAILED @ 4" O.C. ALONG BOUNDARY O.C. EDGES. 6" O.C. ALONG EDGES AND 10" INTERMEDIATE W/ 10d COMMONS.
- BRACE TRUSSES PER T.P.J. H.I.B-91, AS REVISED
- THE TRUSS LAYOUT BY SOUTHWEST STRUCTURAL SYSTEMS, INC. (JOB: # 17325). HAS BEEN COORDINATED WITH THE FOUNDATION AND ROOF PLAN.
- PROVIDE SIMPSON HETA20 W/16 10d X 1 1/2" FOR UPLIFTS UP TO 1890 LBS.
- ALL CHANGES TO THE TRUSS LAYOUT SHALL BE APPROVED BY THE ENGINEER.
- IMPROPERLY LOCATED OR MISSING TRUSS TIE DOWNS USE SIMPSON HTSM20 TWIST STRAPS AT EACH LOCATION AS REQUIRED.

ROOF NOTES

- THIS BUILDING/STRUCTURE HAS BEEN DESIGNED IN ACCORDANCE WITH 8TH EDITION (2023) FLORIDA BUILDING CODE AND SECTION 1609 FOR DESIGN PRESSURES GENERATED BY A DESIGN WIND VELOCITY OF 170 MPH.
- THE SEPARATION OF THE GARAGE AND ITS ATTIC AREA SHALL BE NOT LESS THAN 1/2 INCH GYPSUM BOARD APPLIED TO THE GARAGE SIDE. GARAGES BENEATH HABITABLE ROOMS BY NOT LESS THAN 1/2"-INCH GYPSUM BOARD OR EQUIVALENT PER FBC R309.1, R309.2.
- PROVIDE GYPSUM BOARD 1/2" MIN FOR 16" O.C. FRAMING AND FROM 1/2" TO 5/8" FOR 24" O.C. FRAMING OR 1/2" SAG-RESISTANT GYPSUM CEILING BOARD PER FBC R702.5.
- LANAI & ENTRY CEILINGS SHALL HAVE A 1/2" CD EXTERIOR PLYWOOD LAID PERPENDICULAR TO TRUSS BOTTOM CHORDS AND NAILED W/ 10d NAILS @ 6" O.C.

SOFFIT VENT CALCULATION PER FBC R806.2

AREA ATTIC (IN SQ. FT.):	4,427 SQ. FT.
NET FREE VENTILATION AREA REQUIRED (IN SQ. FT.):	1/300
REQUIRED VENTILATION AREA:	4,427/300 = 14.75
VENTILATION AREA X SQ. INCHES PER FT.(144) :	2,125 SQ. IN.
MIN. REQUIRED VENTILATION:	0.5 X 2,125 SQ. IN.
IN UPPER PORTION OF ATTIC:	1,062 SQ. IN.
OFF RIDGE VENTILATION OF AREA: 115 SQ. FT. PER VENT	560/115
TOTAL OF # VENTS REQUIRED:	9.23
TOTAL OF # VENTS PROVIDED:	10
SQ FOOT SOFFIT VENT AREA:	644 SQ FT
ALUMINIUM VENT AREA REQUIRED	644 /2
TOTAL SQ FT OF SOFFIT VENTING REQUIRED:	322 SQ FT
WIDTH OF OVERHANG (IN FEET):	2'-0"
SOFFIT SIZE:	24" WIDE
SOFFIT VENTILATION STYLE:	PARTIAL VENTED

Date
JUNE 2025

Designed by

Drawn
Check by

Scale
3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

SEAL: STATE OF FLORIDA
CESAR D. DURAN
AR 103304
REGISTERED ARCHITECT

Sign & Seal

REVISION
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

Location

Revision
○ ○ ○ ○

Page

S103
ROOF PLAN

STRUCTURAL NOTES

DESIGN CRITERIA :

THE MAIN WIND-FORCE RESISTANCE SYSTEM AND COMPONENTS AND CLADDING HAVE BEEN DESIGNED IN ACCORDANCE WITH THE 8TH EDITION (2023) FLORIDA BUILDING CODE, TO WITHSTAND WIND PRESSURES GENERATED BY A MINIMUM BASIC WIND SPEED OF 170 MPH FOUNDATION: THE FOUNDATION HAS BEEN DESIGNED FOR A SAFE LOAD BEARING CAPACITY OF 2000 PSF . THE CONTRACTOR SHALL VERIFY SOIL BEARING PRESSURES.

CONCRETE:

ALL CONCRETE WORK SHALL CONFORM TO SPECIFICATIONS FOR ALL STRUCTURAL CONCRETE FOR BUILDINGS (A.C.I.-301). CONCRETE SHALL ATTAIN A MINIMUM COMPRESSIVE STRENGTH OF 3000 PSI IN 28 DAYS. CONCRETE CLEAR COVER: FOUNDATIONS: 3" BEAMS: 1.50" TO STIRRUP 0.75" SLABS NOT EXPOSED TO THE WEATHER: SLABS EXPOSED TO THE WEATHER: 1.50"

REINFORCING STEEL:

ALL REINFORCING STEEL BARS SHALL CONFORM TO ASTM 615 SPECIFICATIONS AND SUPPLEMENTARY REQUIREMENTS S1.FOR DEFORMED BILLET STEEL WITH 60,000 PSI MINIMUM YIELD STRENGTH, PROVIDE DOWELS IN FOUNDATIONS TO MATCH REINFORCING ABOVE.

PRE-ENGINEERED WOOD ROOF TRUSSES:

PRE-ENGINEERED WOOD ROOF TRUSSES SHALL BE DESIGNED FOR THE FOLLOWING LOADS: LL, TOP CHORD D.L. TOP CHORD D.L. BOTTOM CHORD TRUSS MANUFACTURER SHALL SUBMIT SIGNED AND SEALED PLAN VIEW SHOP DRAWINGS W/ ENGINEERED PROFILES AND CALCULATIONS SHOWING ALL REQUIRED TIE DOWNS PRIOR TO GENERAL CONSTRUCTION: ALL ROOF TRUSSES SHALL BE DESIGNED FOR A MIN. BASIC WIND SPEED OF 170 MPH PER THE 8TH EDITION (2023) FLORIDA BUILDING CODE.

MASONRY:

SHALL CONFORM TO ASTM C-90. UNITS SHALL BE ERECTED IN INTERLOCKED RUNNING BOND PATTERN. MORTAR SHALL BE TYPE "M" OR "S" AND MEET ASTM C-270. PROVIDE GAUGE 9 HORIZONTAL JOINT REINFORCEMENT EVERY OTHER COURSE. $f_m = 1500$ PSI. GROUT SHALL HAVE A MINIMUM 28 DAY COMPRESSIVE STRENGTH OF 2000 PSI & CONFORM TO ASTM C-476.

SOLID SAWN LUMBER:

TOP AND BOTTOM PLATES, SAWN LUMBER, BEAMS, HEADERS, SOLID AND BUILT UP POSTS SHALL BE #2 SOUTHERN YELLOW PINE WITH THE FOLLOWING MINIMUM PROPERTIES: 1200 PSI $F_b = 90$ PSI F_v = E = 1.5 X 10⁶ PSI

LAMINATED VENEER LUMBER:

L.V.L. & P.S.L. INDICATES LAMINATED LUMBER AS MANUFACTURED BY TRUSS JOIST McMILLANT CORPORATION. ALL DESIGN DATA FOR THIS MATERIAL DIVISION SHALL BE AS SPECIFIED BY THE MANUFACTURER -ALL ATTACHMENTS, FILLERS ETC. AND INSTALLATION PROCEDURES SHALL IN STRICT ACCORDANCE W/ THE MANUFACTURERS SPECS.

LINTELS: DOOR OR WINDOW OPENINGS IN MASONRY WALLS SHALL HAVE CONCRETE LINTELS. WHERE THE HEAD OF THE OPENING IS WITHIN 16" OF THE TIE BEAM, OR SLAB, LINTELS SHALL BE POURED INTEGRAL WITH THE TIE BEAMS, OR SLAB, ADD 2 #5 BOTTOM BARS FOR EVERY 8" DROP OF THE TIE BEAM, WHERE PRECAST LINTELS ARE USED, THEY SHALL BEAR MINIMUM OF 8" ON THE SUPPORT AND HAVE THE FOLLOWING SIZE AND REINFORCEMENT: - SPANS UP TO 6'-0" USE 8" X 8" PRECAST U LINTELS - SPANS UP TO 12'-0" USE 8" X 8" - PRE-STRESSED U LINTELS REINFORCE AS SHOWN

ROOF SHEATHING:

WOOD STRUCTURAL ROOF SHEATHING DIAPHRAGM SHALL BE 19/32" THICK (A.P.A. RATED) C. D. EXTERIOR INSTALLED PERPENDICULAR TO SUPPORTS AND SECURED W/ 10d NAILS AT 6" O/C ALL PANEL EDGES AND AT 10" O/C ALONG ALL INTERMEDIATE SUPPORTS - (4) PLY MATERIAL TO BE USED - SPAN RATING SHALL BE 32 /16.

WALL SHEATHING:

WALL SHEATHING DIAPHRAGM SHALL BE 15/32" TH. (A.P.A. RATED) C. D. EXT. INSTALLED PERPENDICULAR TO SUPPORTS AND SECURED W/ 8d NAILS AT 6" O/C ALL PANEL EDGES - PROVIDE 2 X 4" BLKG. BETWEEN STUDS W/ 3-1/2" FACE SET VERTICAL AT ALL PANEL EDGES - ALL INTERMEDIATE SUPPORTS SHALL BE NAILED W/ 8d NAILS AT 12" O/C -SPAN RATING SHALL BE 32/16.

METAL FASTENERS / CONNECTORS:

ALL HANGERS, CLIPS, STRAPS, TO BE MANUFACTURED BY "SIMPSON STRONG TIE" (UNLESS NOTED OTHERWISE) - REFER TO PLAN & TIE DOWN SCHEDULE FOR ALL SPECIFIED FASTENER NUMBERS - CONSULT MFGS. CATALOG #C "WOOD CONSTRUCTION CONNECTORS" AND "HIGH WIND-RESISTANT CONST. CONNECTORS" CATALOG # C-HW - INSTALL ALL STRAPS PER MFGS. SPECIFICATIONS WITH DISTANCE OF STRAP BEING EQUAL FROM POINT OF CONN. ALL STRAPS SHALL BE Z-MAX. BELOW CONNECTION (LE) BEAM TO POST INTERFACE) ALL CONNECTORS SHALL HAVE ALL NAIL HOLES FILLED WITH APPROPRIATE SIZE NAILS PER SIMPSON'S SPECS. ALL FLAT STRAPS OR TWIST STRAPS SHALL BE APPLIED WITH EQUAL LENGTHS OF STRAP TO HEADER OR BEAM AND COLUMN, ETC., WHERE (2) STRAPS ARE INDICATED, APPLY ONE (1) AT EACH SIDE OF CONNECTION. FILL ALL HOLES WITH SPECIFIED NAIL COUNT.

GENERAL:


CONTRACTOR SHALL VERIFY ALL DIMENSIONS PRIOR TO COMMENCING WITH CONSTRUCTION. THE CONTRACTOR SHALL NOTIFY THE ENGINEER OF ANY FIELD CONDITION WHICH MAY NOT BE IN ACCORDANCE WITH DESIGN CONDITIONS. THE CONTRACTOR SHALL BE RESPONSIBLE FOR THE JOB SITE CONSTRUCTION SAFETY. FOR FINISHED FLOOR ELEVATIONS, SLOPES, STEPS AND RECESSES, REFER TO ARCHITECTURAL PLANS. FOR SIZE AND LOCATION OF MECHANICAL SLEEVES AND OPENINGS, REFER TO MECHANICAL AND ARCHITECTURAL PLANS.

FORM WORK AND SHORING:

SHORES AND RESHORES SHALL MEET THE REQUIREMENTS AS SET FORTH IN THE CURRENT A.C.I. 347 AND A.C.I. 301 LATEST EDITIONS. FORM WORK AND SHORING SHALL BE DESIGNED BY A FLORIDA REGISTERED ENGINEER.


SLABS ON FILL:

EXTERIOR SLABS ON FILL SHALL BE 4" THICK, UNLESS OTHERWISE NOTED ON PLANS. REINFORCED WITH 6" X 6" W/1.4 W/1.4 W/1.4. FILL MATERIAL UNDER SLAB SHALL BE CLEAN SAND AND/OR ROCK AND SHALL BE COMPACTED TO 95% (MIN.) OF ASTM D 1557 IN LIFTS NOT TO EXCEED 12" IN DEPTH. SLAB ON FILL SHALL BE POURED AGAINST APPROVED VAPOR BARRIER FIBER REINFORCED CONCRETE SLABS SHALL CONTAIN SYNTHETIC FIBER REINFORCEMENT. FIBER LENGTH SHALL BE 1/2" TO 2". DOSEAGE AMOUNTS SHOULD BE FROM 0.75 TO 1.5 LBS PER CUBIC YARD IN ACCORDANCE WITH THE MANUFACTURER'S RECOMMENDATIONS. SYNTHETIC FIBERS SHALL COMPLY WITH ASTM C1116.

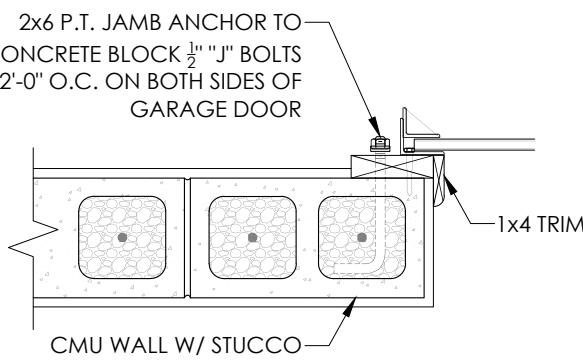


GARAGE DOOR JAMB DETAIL

SCALE: N.T.S.

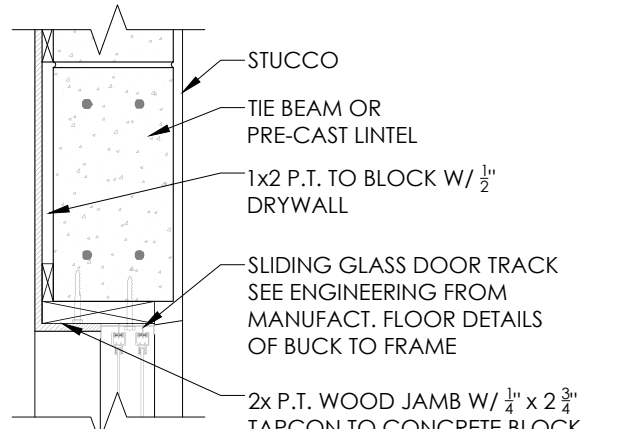


SLIDING GLASS DOOR HEAD DETAIL

SCALE: N.T.S.

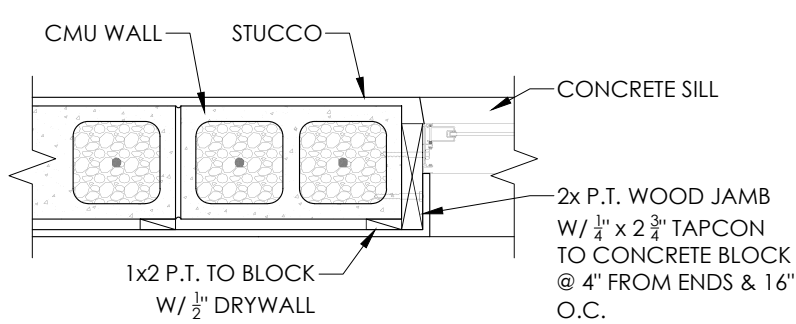


SLIDING GLASS DOOR JAMB DETAIL

SCALE: N.T.S.

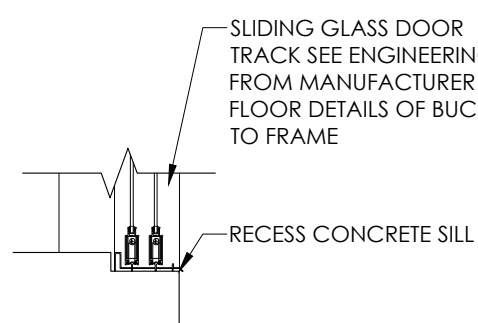

SLIDING GLASS DOOR SILL DETAIL

SCALE: N.T.S.

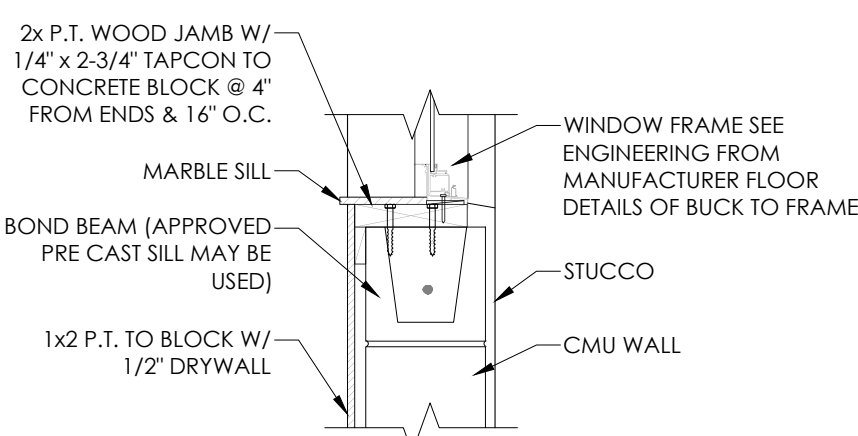


WINDOW SILL DETAIL

SCALE: N.T.S.


ALTERNATE WINDOW / DOOR JAMB ATTACHMENT

WINDOW JAMBS SHALL CONSIST OF 1X3 (MIN.) PRESSURE TREATED ATTACHED TO MASONRY WITH 3/16" X 2 1/2" TAPCONS AT 4" FROM EA. END AND 16" O.C. FOR OPENINGS UP TO 6'-8". PROVIDE 3/16" X 2 1/2" TAPCONS AT 12" O.C. FOR OPENINGS GREATER THAN 6'-8" TO 8'-0" HIGH. ANCHORS SHALL NOT BE IN THE BEVELED AREA. SLIDING DOORS OR WINDOWS UP TO 8'-0" HIGH REQUIRING BUCKING WIDER THAN 4" UP TO 8" SHALL BE ATTACHED TO THE MASONRY WALL WITH (2) ROWS OF 3/16" X 2 1/2" AT 16" O.C. FOR 1X BUCKS AND 1/4" X 3 1/2" AT 16" O.C. FOR 2X BUCKS. WINDOW ATTACHMENT SHALL BE PER MANUFACTURER'S SPECIFICATIONS AND SHALL BE ATTACHED DIRECTLY TO THE MASONRY WALL THROUGH THE BUCKING IF USING 1" THICK BUCKSTRIPS. MASONRY CELLS ON EACH SIDE OF THE OPENING SHALL BE FILLED SOLID WITH 1 #5 REBAR EACH CELL IN ACCORDANCE WITH THE MASONRY NOTES.

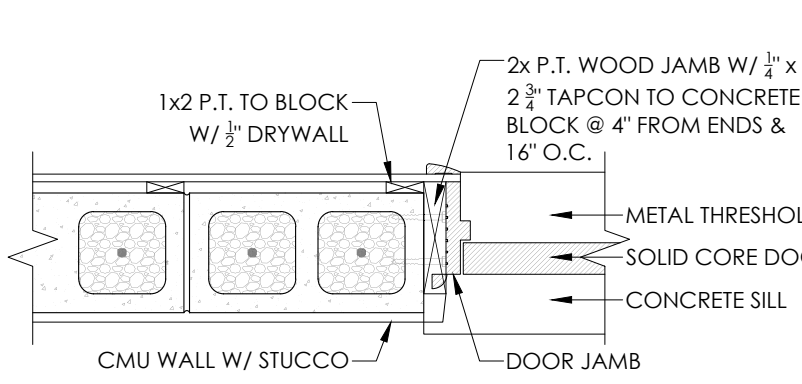


DOOR JAMB TO BLOCK DETAIL

SCALE: N.T.S.

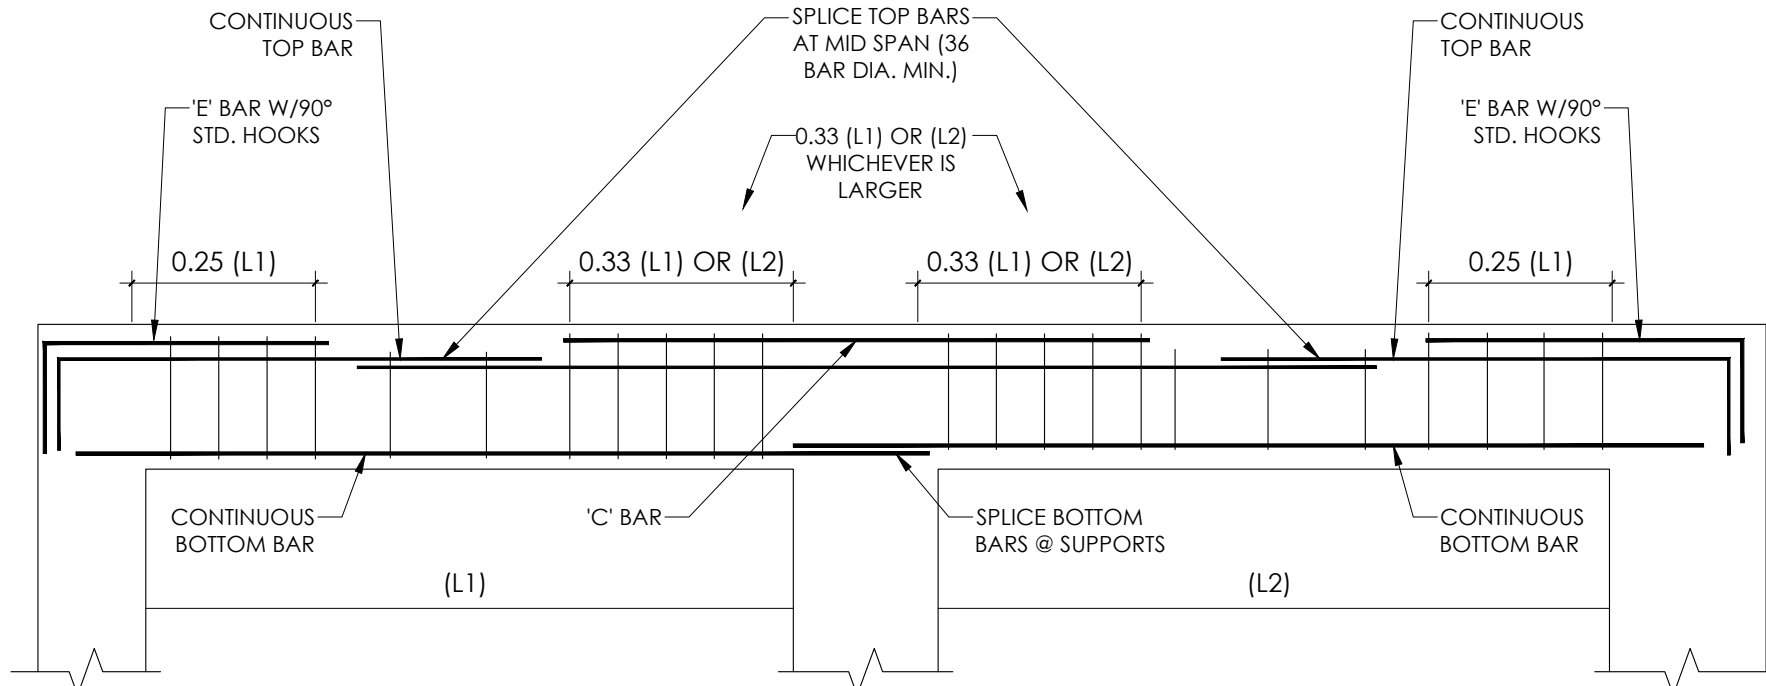


BEAM BAR DIAGRAM

SCALE: N.T.S.

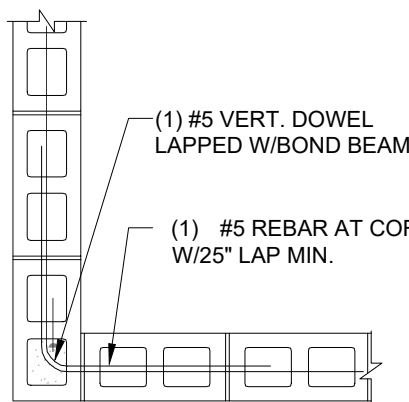


TYP. REBAR LAP AT LINTEL CORNERS

SCALE: N.T.S.

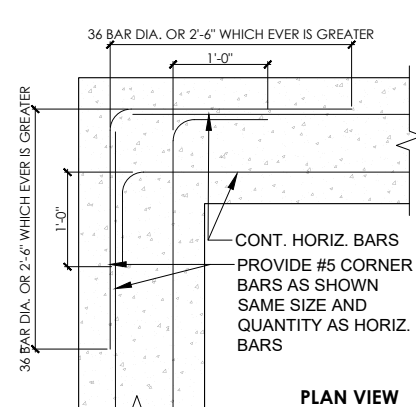


TIE BEAMS, AND WALLS (TYP.)

SCALE: N.T.S.

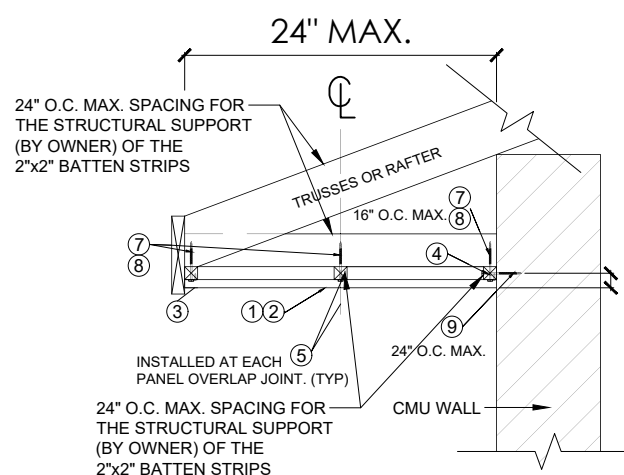


TYP. INSTALLATION ON A CMU WALL

SCALE: N.T.S.

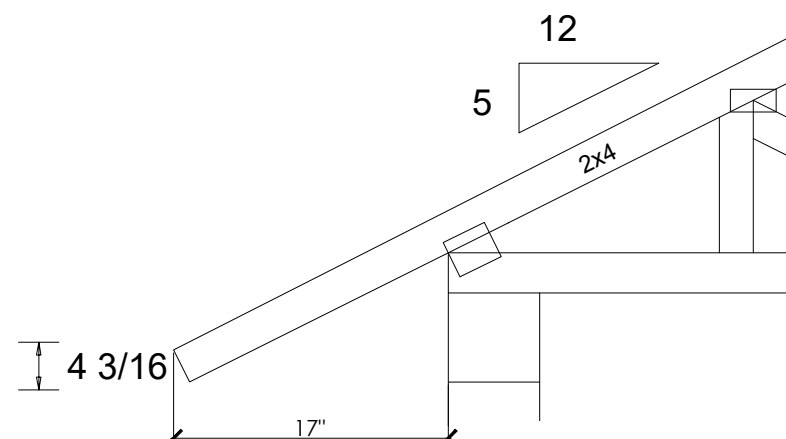


TYPICAL END SQUARE CUT

SCALE: N.T.S.

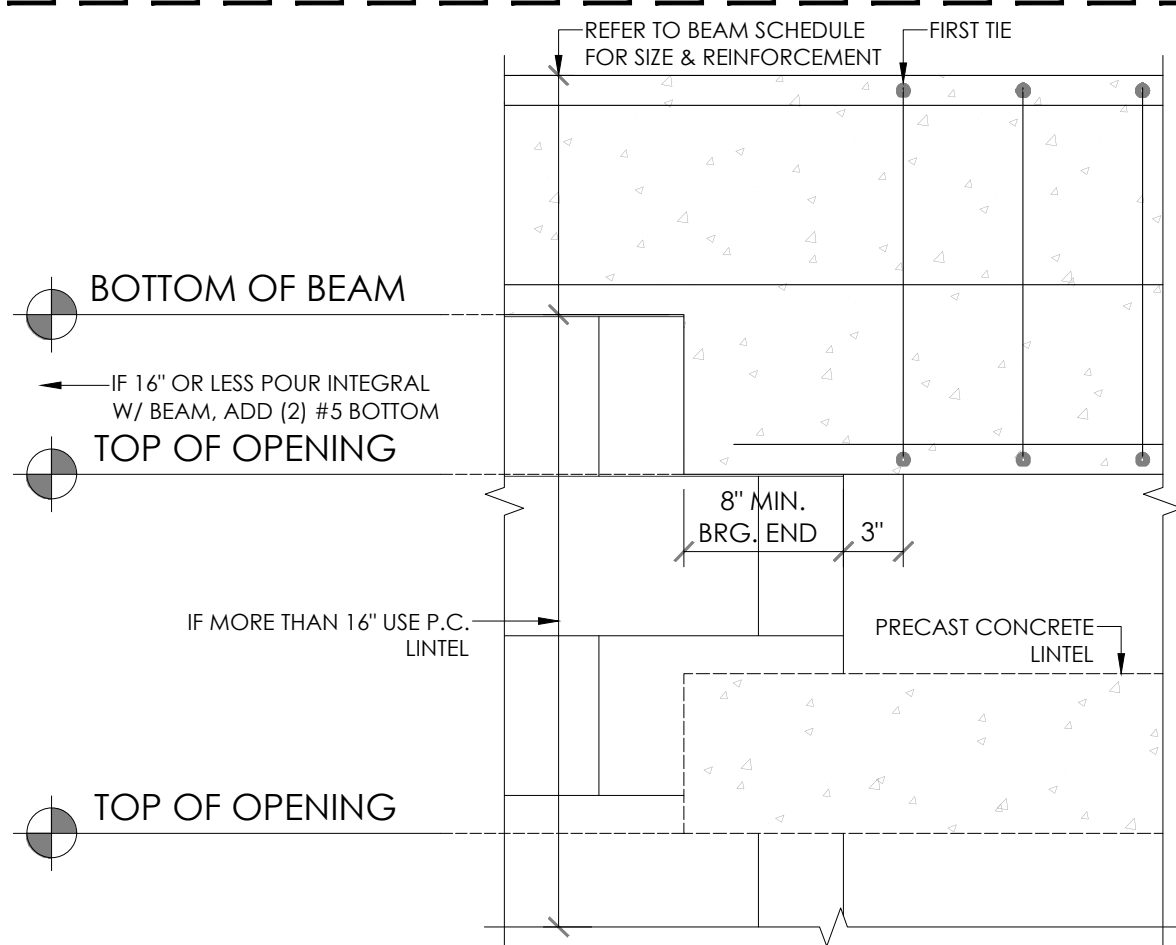


TYPICAL BEAM/LINTEL OVER OPENING

SCALE: N.T.S.

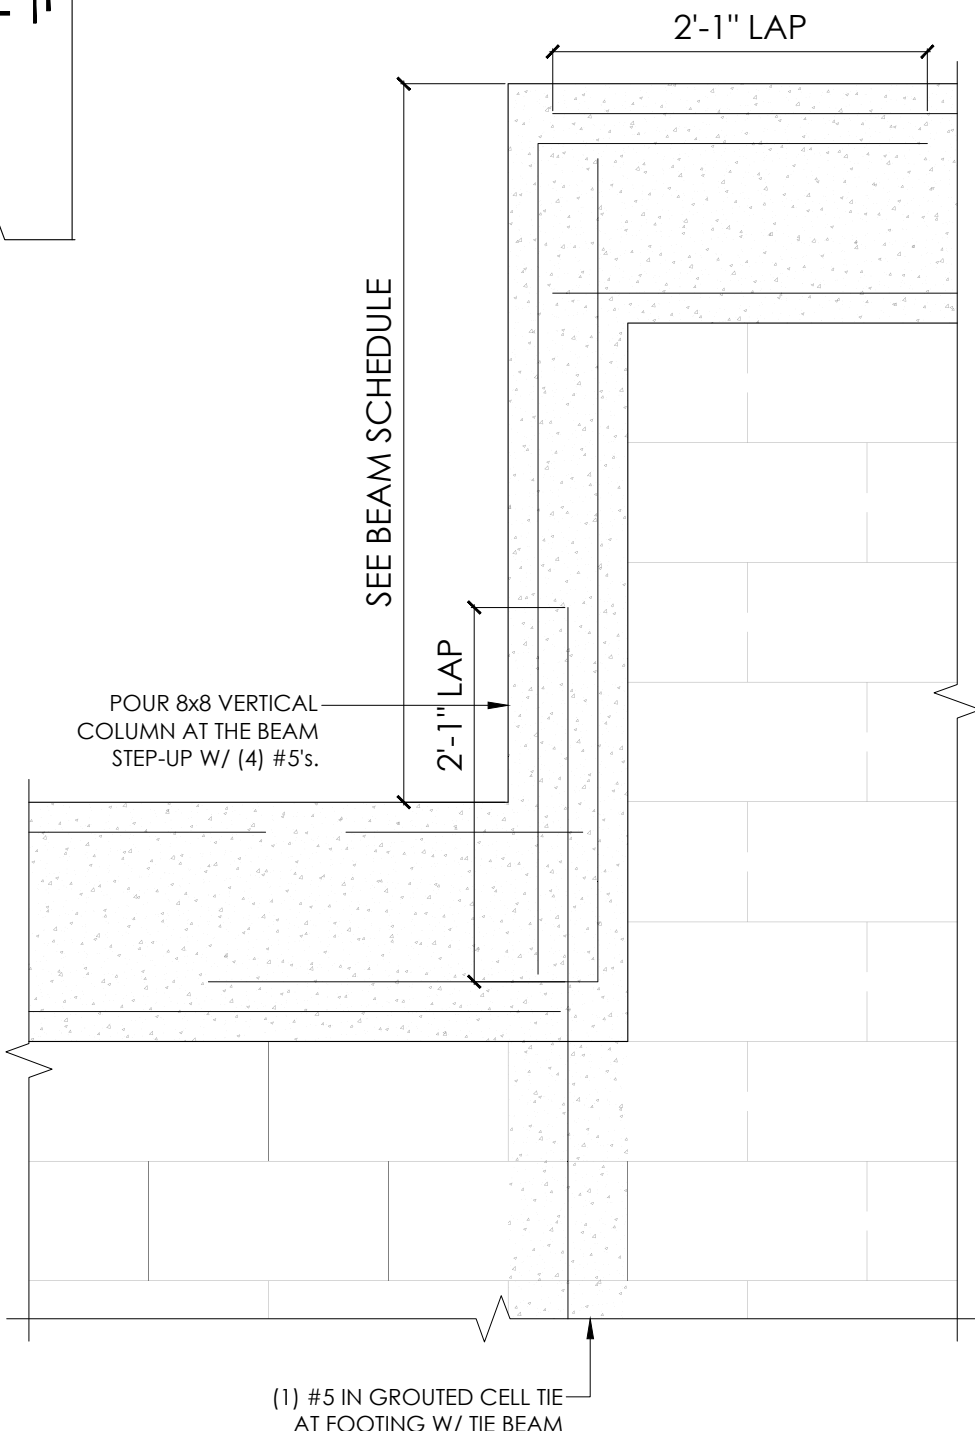

STEP-UP TIE BEAM DETAIL

SCALE: N.T.S.

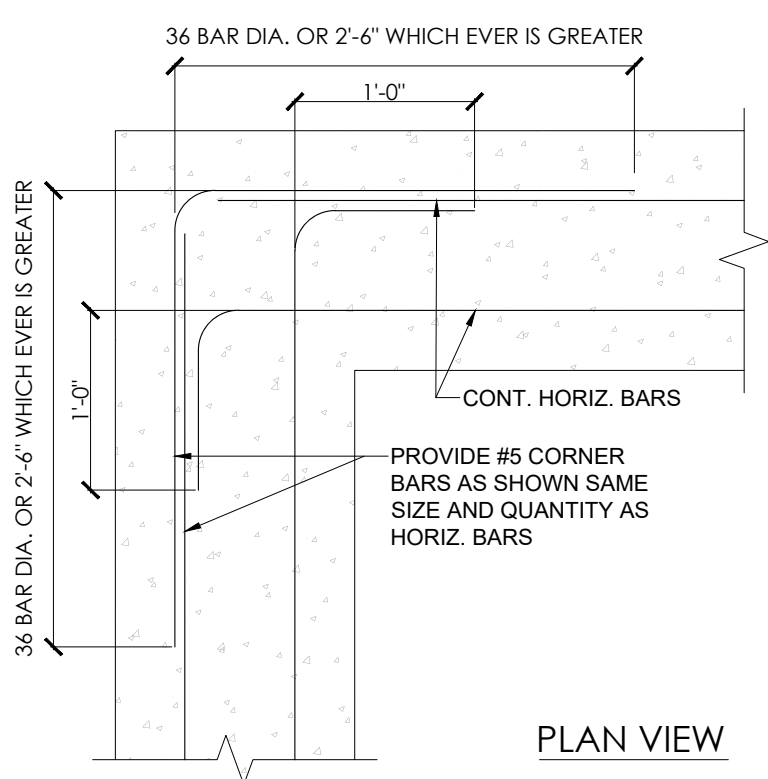

DETAIL FOR FOOTINGS, TIE BEAMS, AND WALLS (TYP.)

SCALE: N.T.S.

Date

JUNE 2025

Designed by

Drawn

Check by

Scale

3/16" = 1'-0"

NOTE: IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORROBORATE THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION. ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN
ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

SEAL:



Sign & Seal

RESIDENCE
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113


Location

Revision

Page


DETAILS

S501

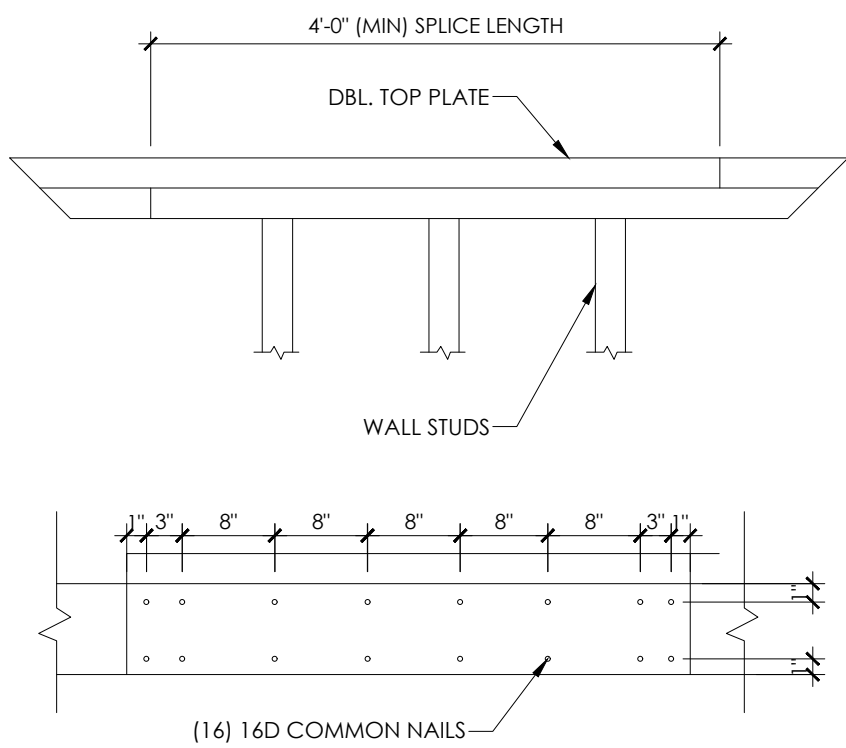


TOP PLATE SPLICE

SCALE: N.T.S.

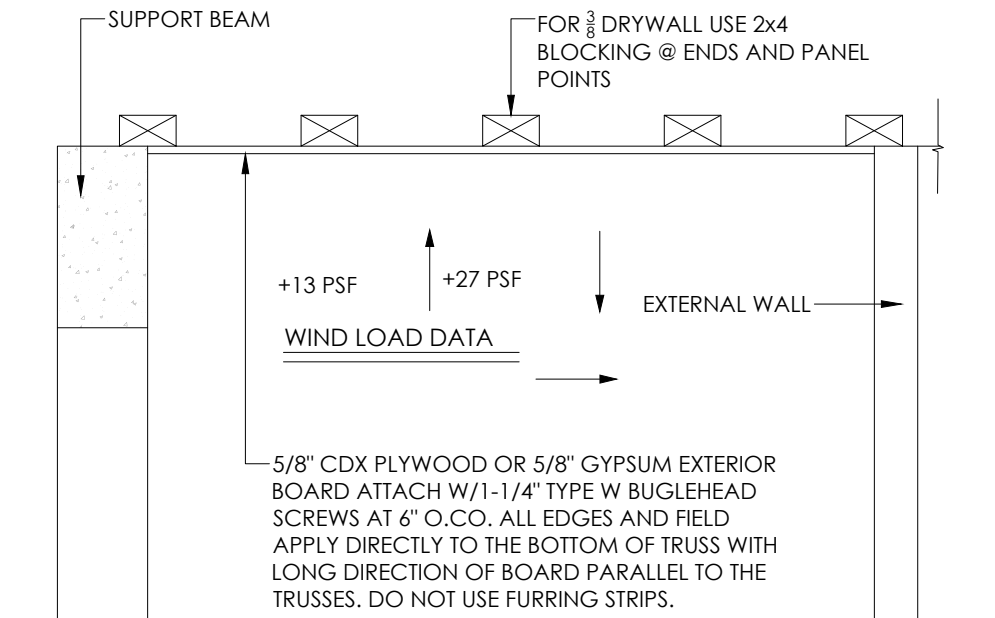


EXPOSED CEILING ATTACHMENT DETAIL

SCALE: N.T.S.

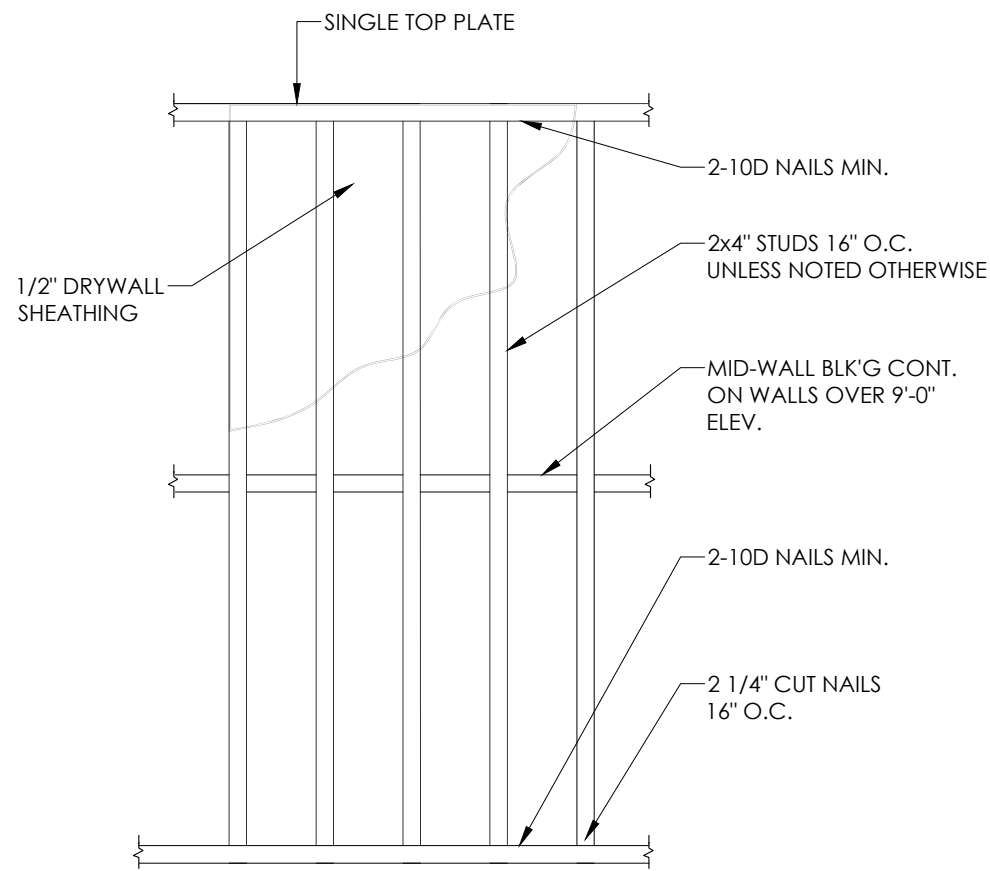


NON. BRG. WALL ANCHORING

SCALE: N.T.S.

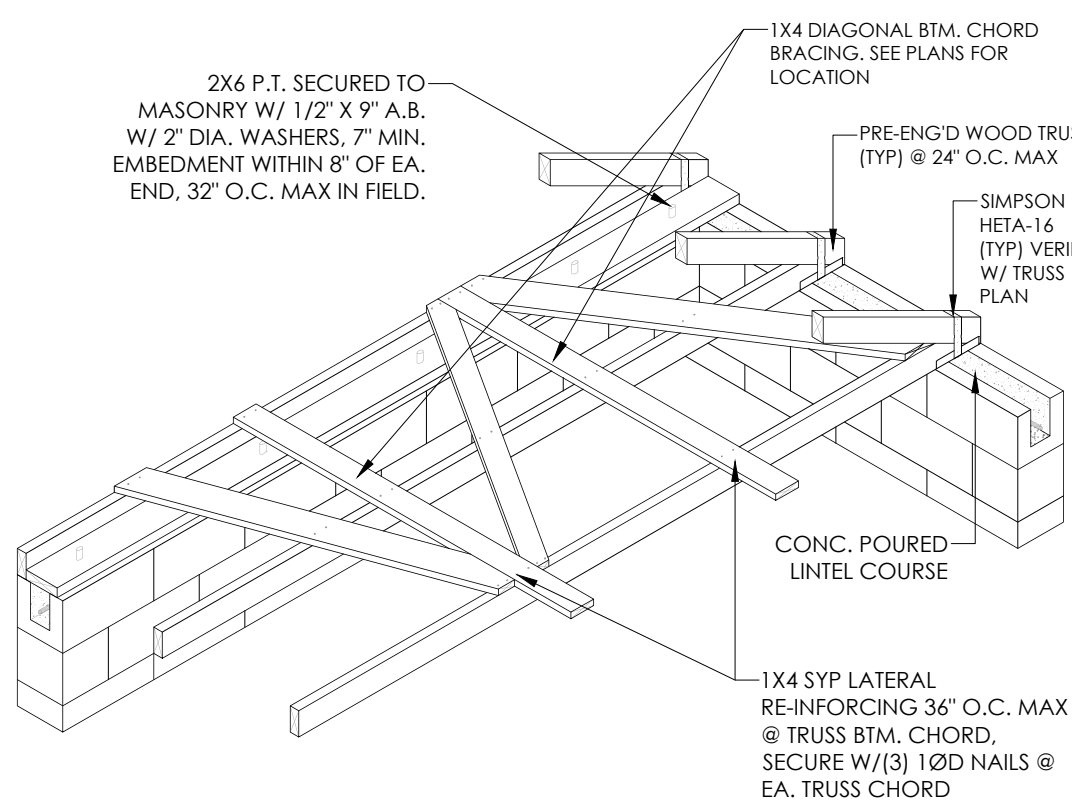


GABLE END BRACING

SCALE: N.T.S.

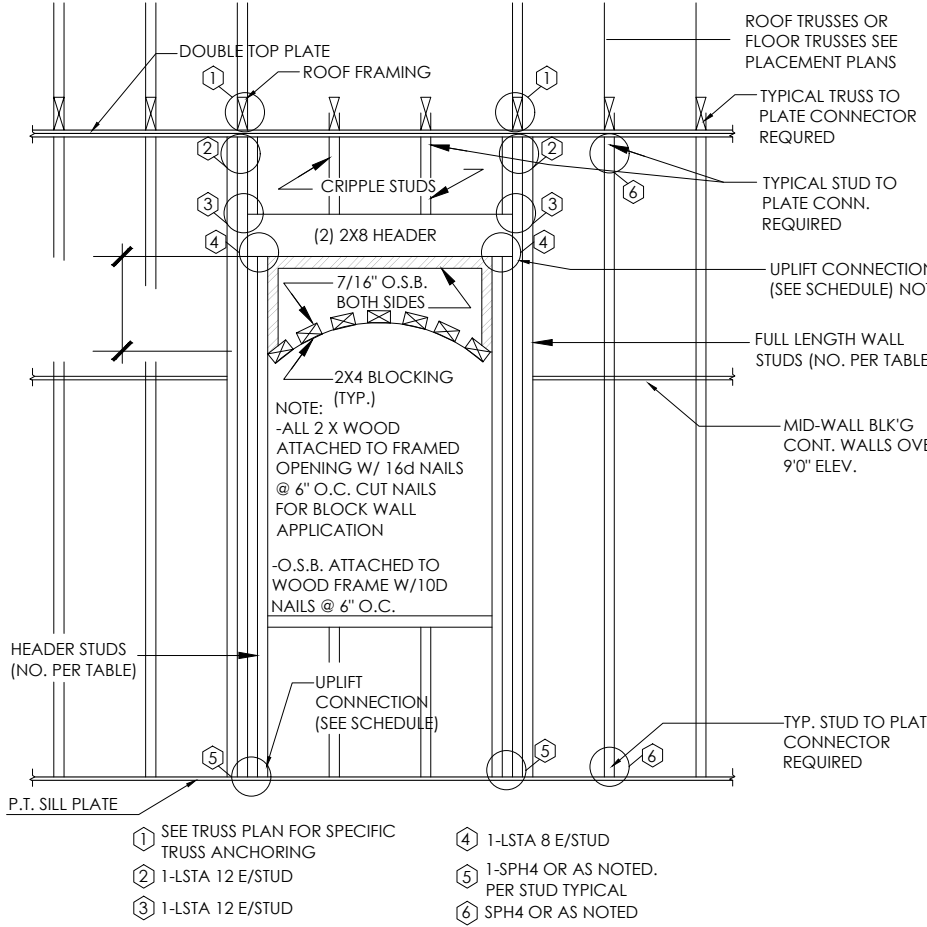


TYP. FRAMING AND CONNECTIONS
FOR LOAD BEARING OPENINGS

SCALE: N.T.S.

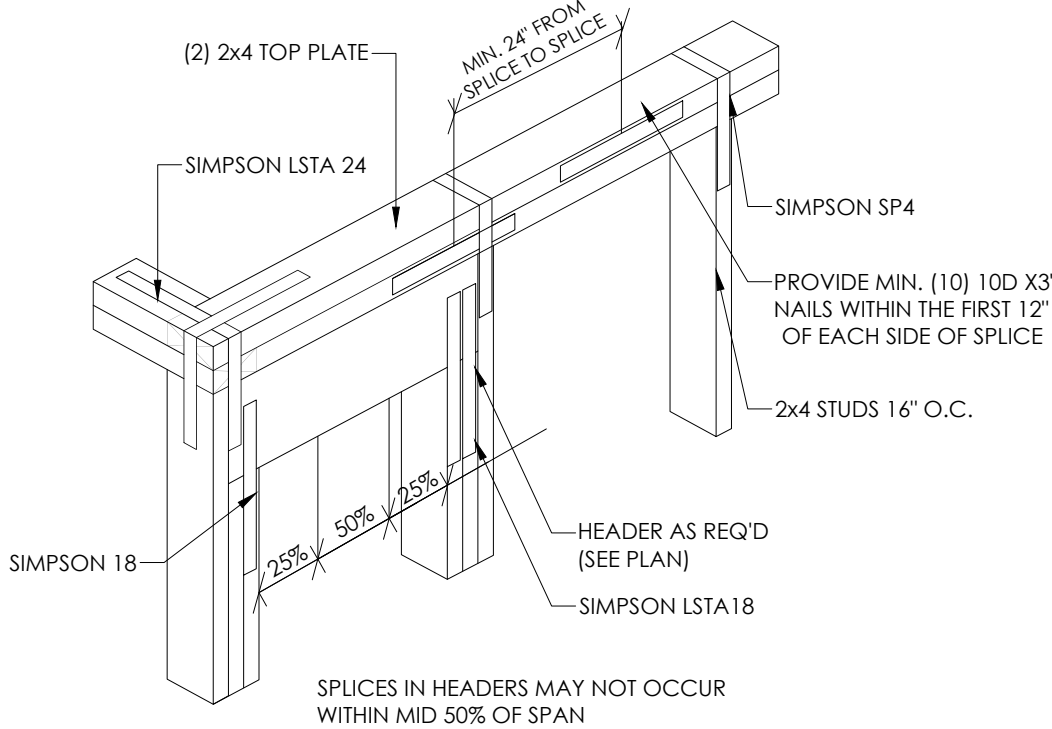


WOOD FRAME SPLICING DETAIL

SCALE: N.T.S.

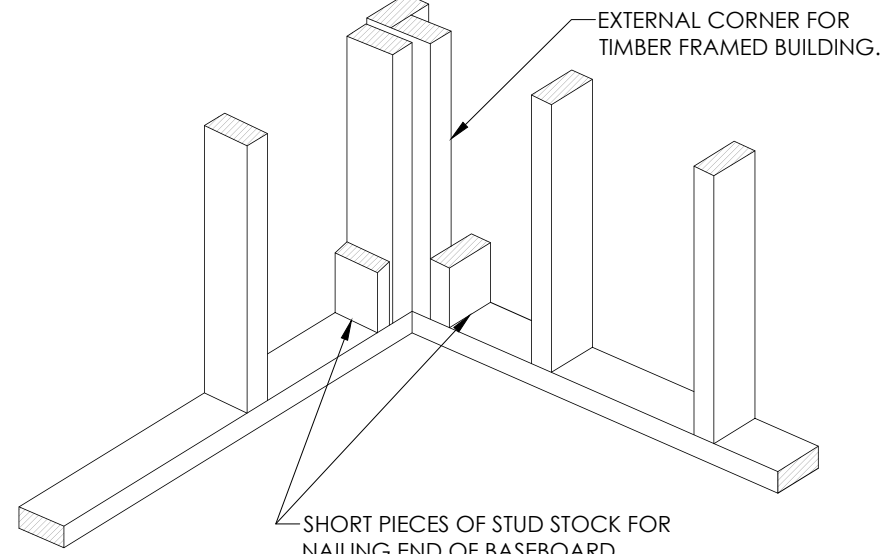


EXTERNAL CORNER DETAIL

SCALE: N.T.S.

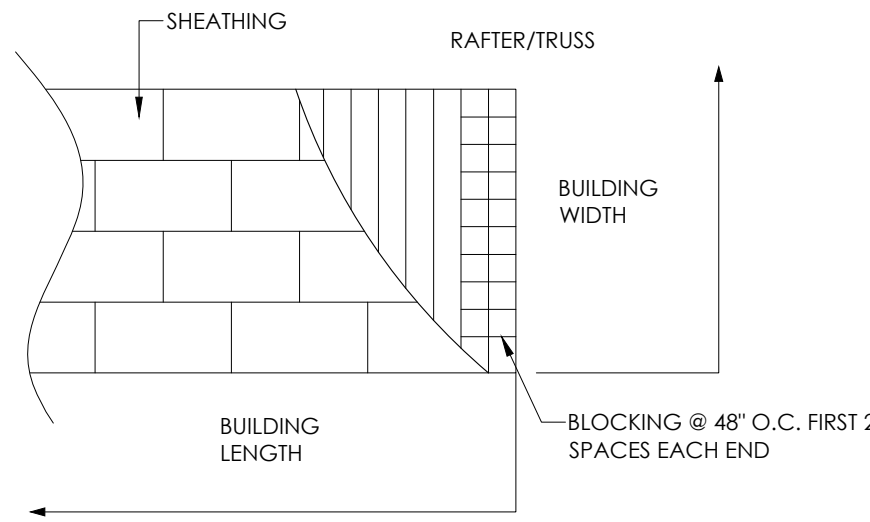


ROOF SHEATHING LAYOUT

SCALE: N.T.S.

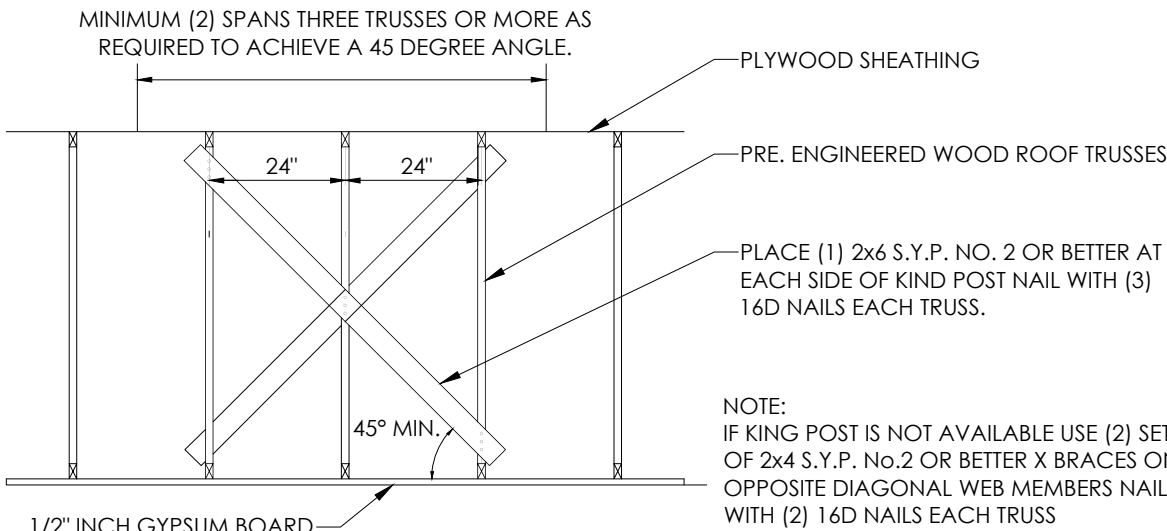


INTERMEDIATE TRUSS BRACING

SCALE: N.T.S.

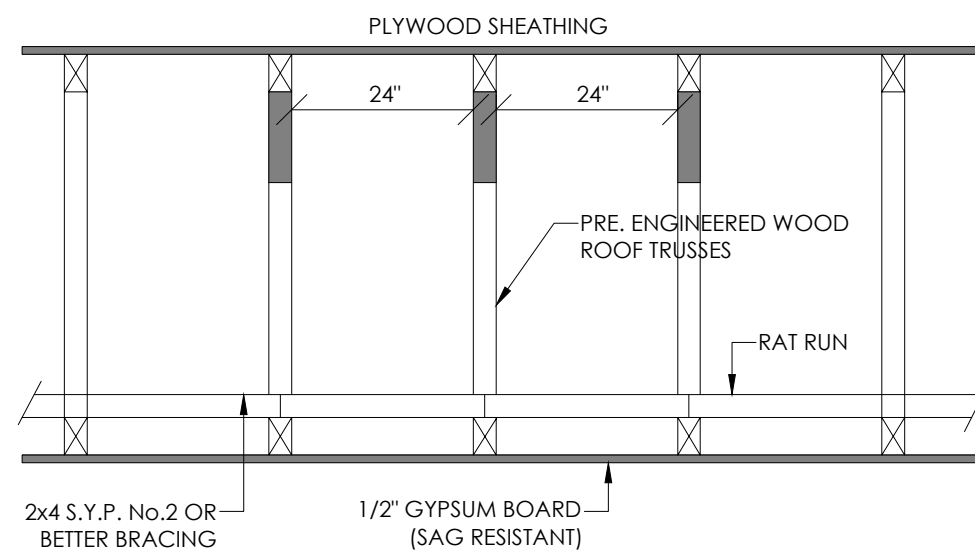


TRUSS BRACING

SCALE: N.T.S.

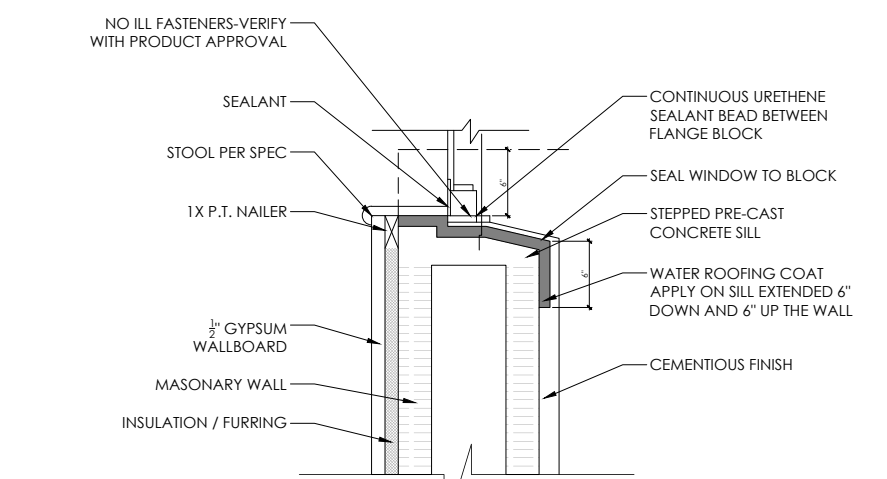


SH WINDOW SILL - CMU

SCALE: N.T.S.

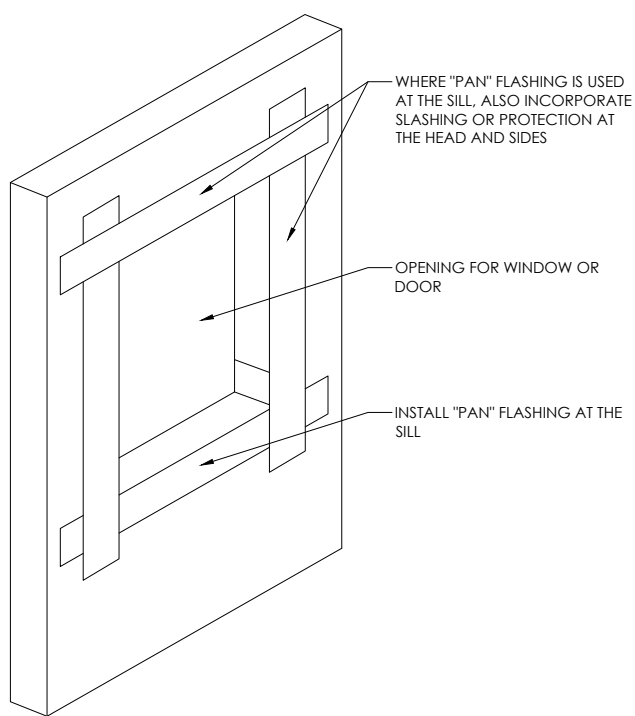


SH WINDOW SILL - CMU

SCALE: N.T.S.

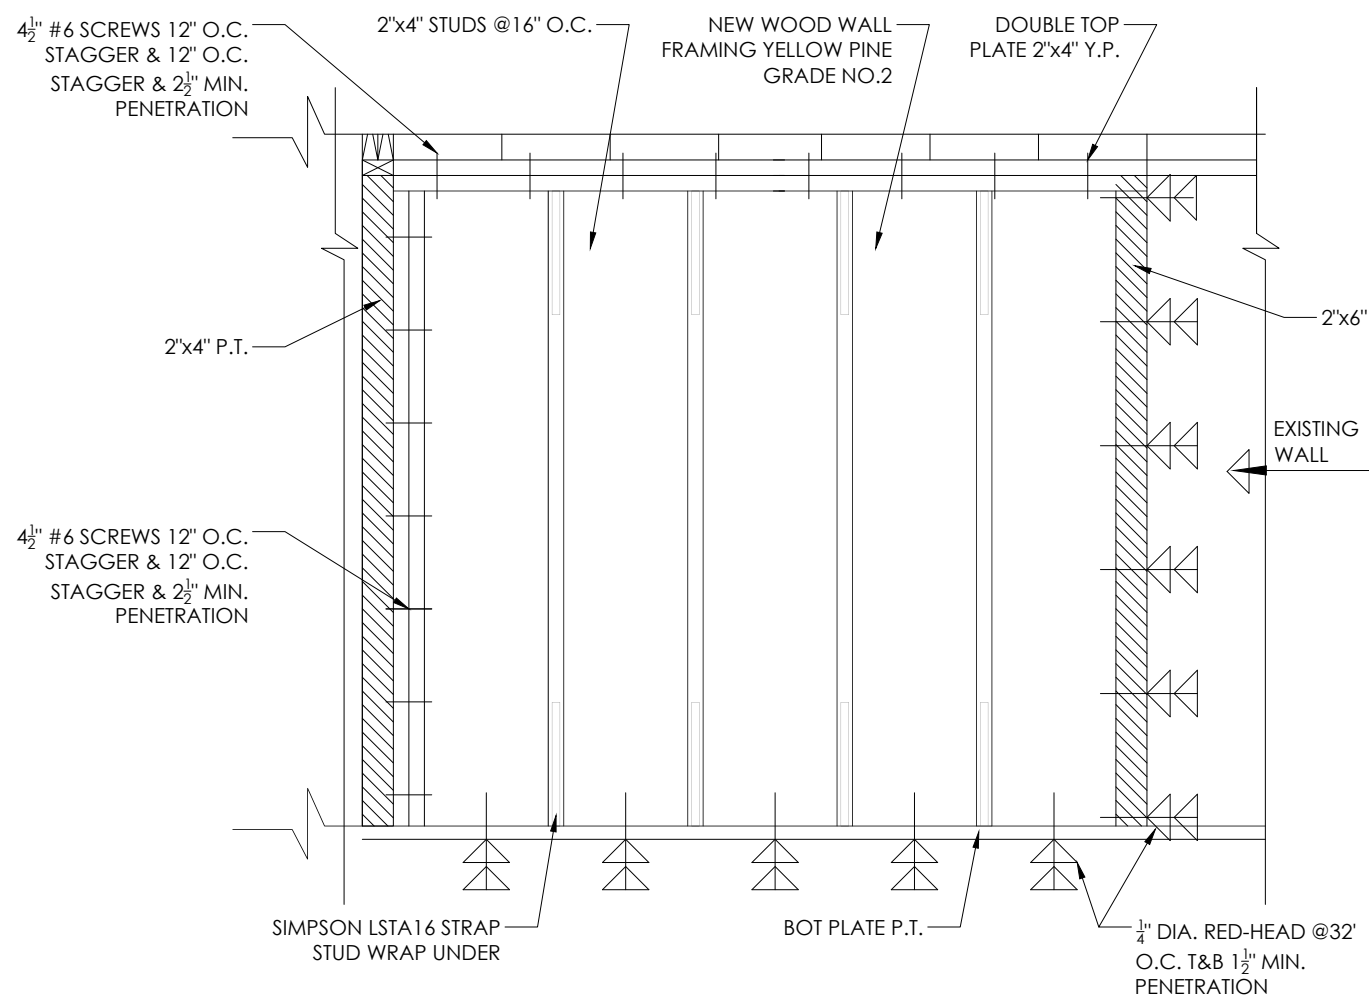


NEW WOOD WALL DETAIL

SCALE: N.T.S.

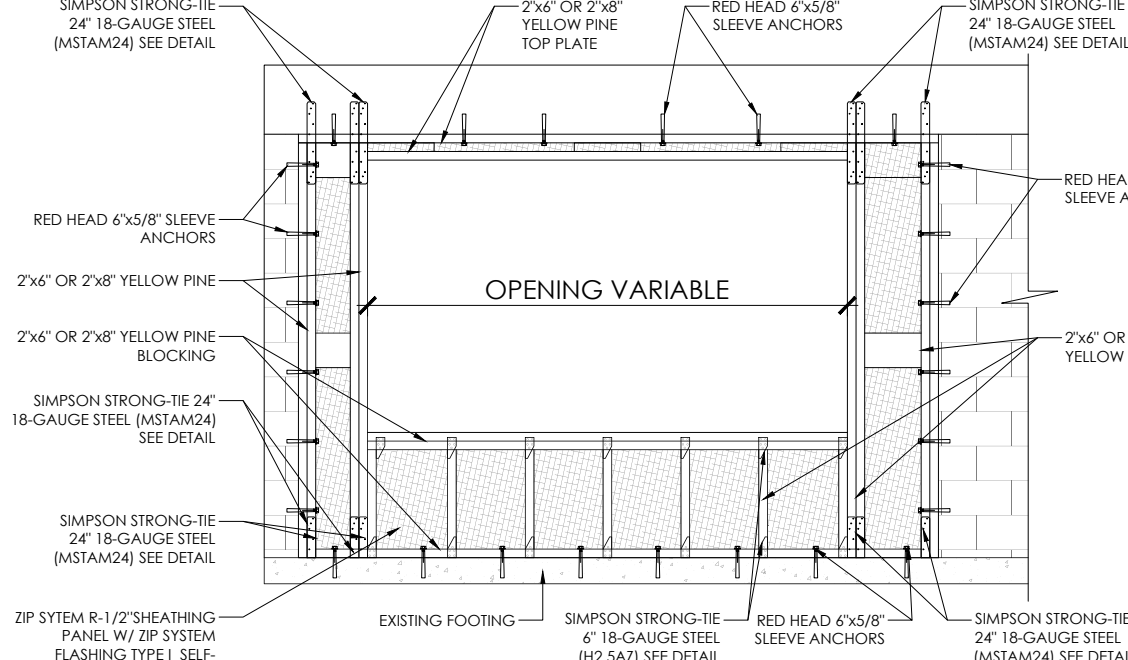


FRAMING WALL DETAIL-A

SCALE: N.T.S.

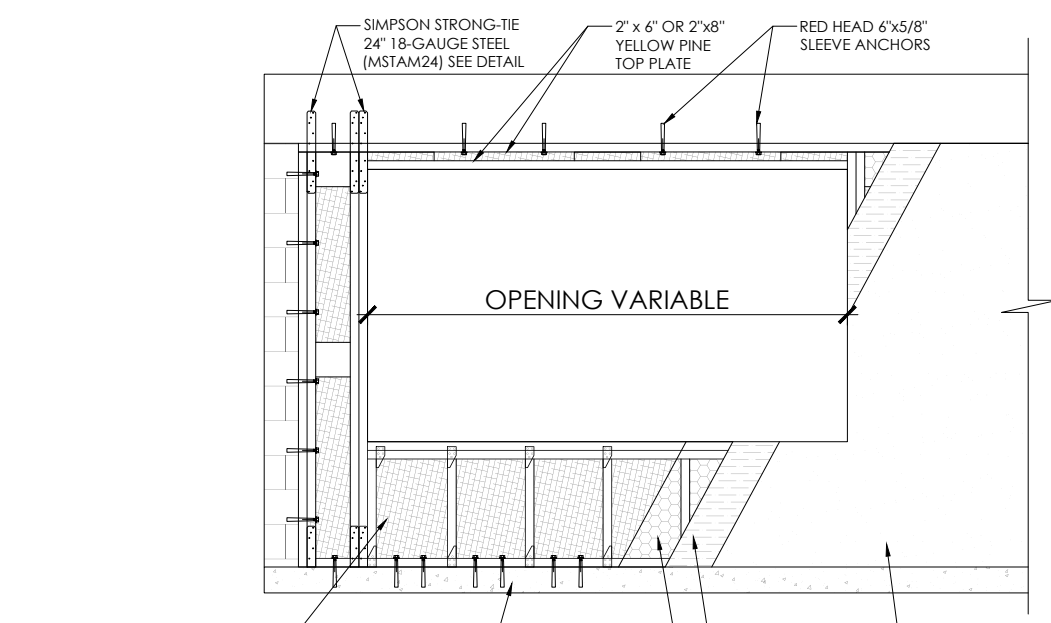


ELEVATION DETAIL-A

SCALE: N.T.S.

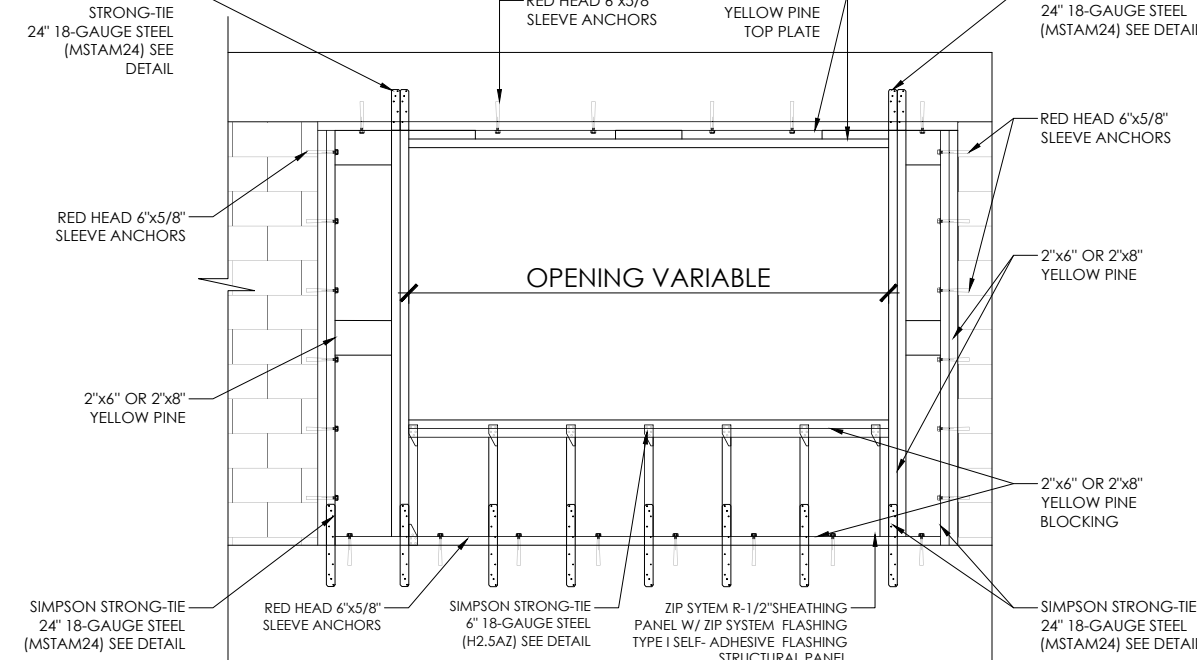

FRAMING WALL DETAIL-B

SCALE: N.T.S.

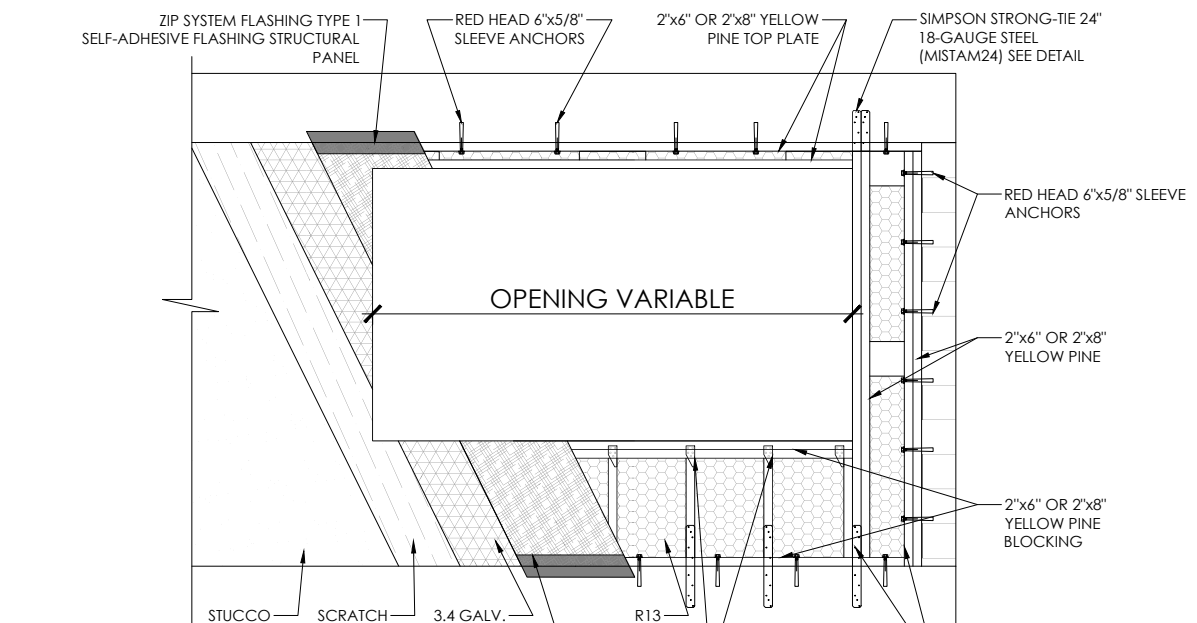

ELEVATION DETAIL-B

SCALE: N.T.S.

Date
JUNE 2025


Designed by

Drawn

Check by

Scale
3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION. ANY DISCREPANCIES ARE TO BE RELATED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

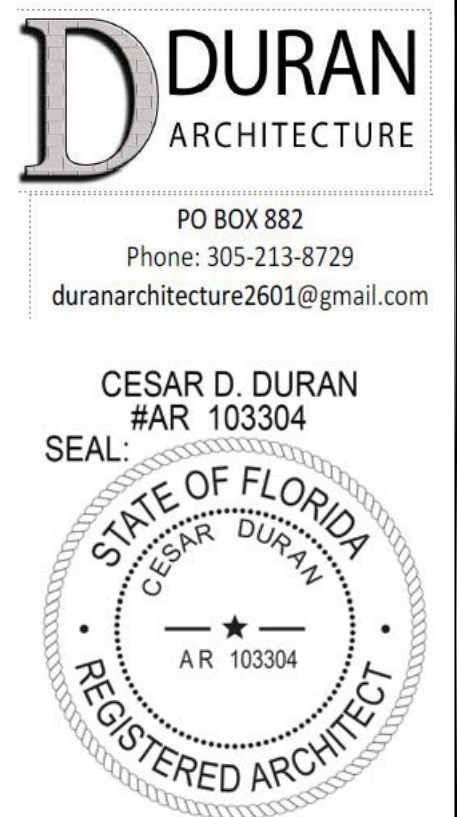

Sign & Seal

REVISION
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113


Location

Revision

Page

S502

DETAILS

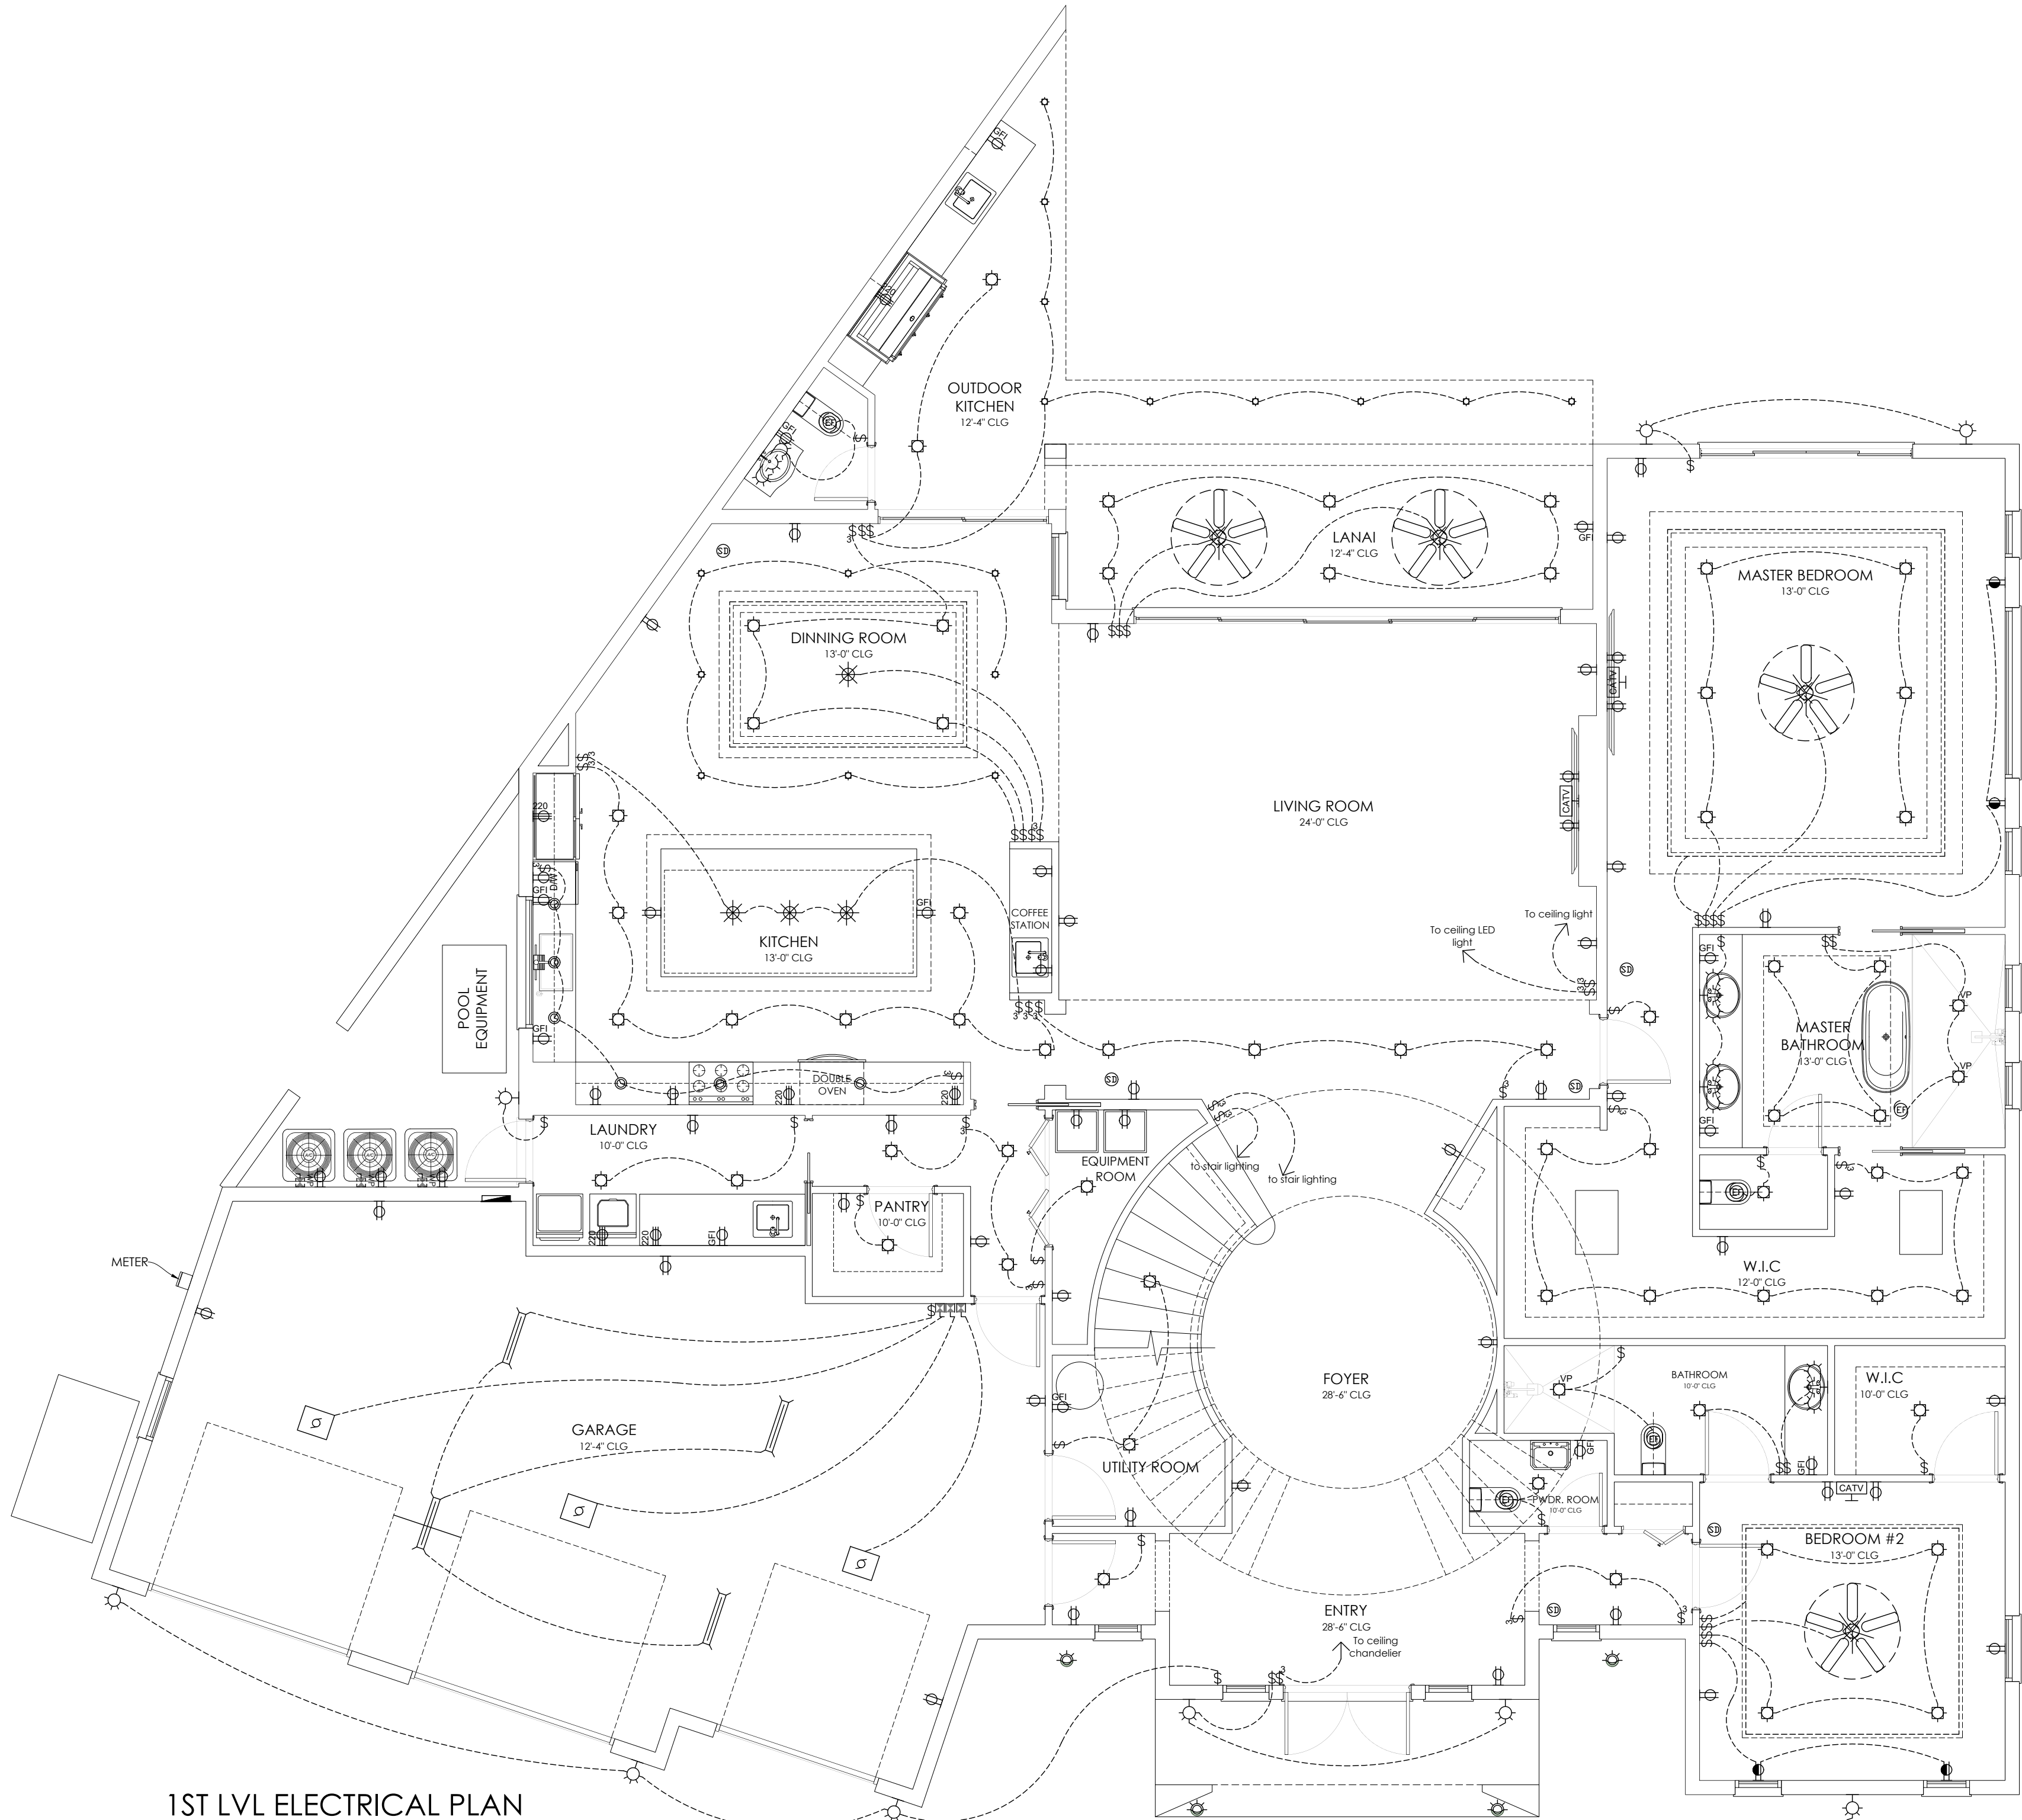

1ST LVL ELECTRICAL PLAN
SCALE: 3/16" = 1'-0"

ELECTRICAL NOTES

IT IS THE INTENT OF THE DESIGNER THAT THE ELECTRICAL SUBCONTRACTOR IS TO BID AND INSTALL ALL ELECTRICAL ITEMS AS REQUIRED PER APPLICABLE ELECTRICAL BUILDING CODES.

- ALL EXTERIOR OUTLETS AND OUTLETS IN KITCHEN, BATHROOMS AND UTILITY TO BE ON GFI CIRCUITS.
- VERIFY POWER HOOK UP LOCATION AND TYPE OF SERVICE (UNDERGROUND OR OVERHEAD) WITH RESPECT TO SUBDIVISION REQUIREMENTS.
- ALL SMOKE DETECTORS ARE TO BE HARD WIRED AND INTERCONNECTED WITH BATTERY BACKUP.
- ALL FIXTURES SHALL BE APPROVED BY THE OWNER PRIOR TO PURCHASE AND INSTALLATION.
- ALL 120V, SINGLE PHASE, 15 AND 20 AMP BRANCH CIRCUITS SUPPLYING OUTLETS INSTALLED IN ALL LIVING AREAS SHALL BE PROTECTED BY A LISTED ARC-FAULT CIRCUIT INTERRUPTER, COMBINATION-TYPE, INSTALLED TO PROVIDE PROTECTION OF THE BRANCH CIRCUIT
- 1)RISER DIAGRAM AND ITS INSTALLATION SHALL BE APPROVED AND COORDINATED WITH F.P.&L. (FLORIDA POWER AND LIGHT).
- 2)ALL INSTALLATIONS SHALL USE MOST STRINGENT GUIDE INCLUDING THOSE SUPPLIED BY F.P.&L. (FLORIDA POWER AND LIGHT).
- 3)ELECTRICAL CONTRACTOR SHALL CONFORM W/UNITED TELEPHONE SERVICE OR TELEPHONE SERVICE INVOLVED IN THIS CONSTRUCTION
- 4)COORDINATE INSTALLATION OF ELECTRICAL AND DEVICES W/OTHER TRADES, BEFORE INDIVIDUAL INSTALLATIONS CAN BEGIN (INCLUDING THE A/C SUB CONTRACT.
- 5)VERIFY ALL OUTLET HEIGHTS (AND THEIR LOCATIONS INCLUDING FLOOR OUTLETS/ JACKS) W/INTERIOR DESIGNER AND OTHER INVOLVED DESIGN PARTIES SUCH AS THE CABINET MAKER/OWNER/DEVELOPER/ GENERAL CONTRACTOR.
- MINIMUM WIRE SIZE SHALL BE #14 AWG, INSULATION FOR WIRE SIZE #6 AND SMALLER SHALL BE THWN,#14 AND LARGER SHALL THNN, ALL CONDUCTORS #10 AND SMALLER SHALL BE SOLID, #8 AND LARGER SHALL STRANDED (ROMEX MAY BE USED WERE APPROVED).
- CIRCUIT LOCATION AND LOAD DATA ARE BASED ON INFORMATION GATHERED FROM THE CONTRACTOR. THE ELECTRICIAN SHALL VERIFY ALL DATA BEFORE CONSTRUCTION BEGIN-INCLUDING PANEL SIZE/METER SIZE AND LOCATION/WIRE SIZES AND ALL MECHANICAL EQUIPMENT INC. POOL AND A/C.
- ALL 120V SINGLE PHASE 15A AND 20A KITCHEN ISLAND AREA/BATHROOMS/EXTERIOR/GARAGE OUTLETS SHALL BE G.F.I.-NOTE: GARAGE AND EXTERIOR OUTLETS SHALL HAVE AN ADDITION TO G.F.I. WATERPROOF COVER
- CALCULATIONS ARE BASED ON COPPER CONDUCTORS.
- ELECT. CONTRACTOR SHALL VERIFY ALL LOADING (BREAKERS) AND WIRE SIZES BEFORE INSTALLATION WILL BEGIN. PANEL ARRANGEMENT IS FOR DEMONSTRATION PURPOSES ONLY AND THE ELECTRICAL CONTRACTOR AT HIS OR HER DISCRETION MAY PLACE BREAKERS AND LOADS IN A DIFFERENT POSITION.

ELECTRICAL LEGEND

	NEW DUPLEX OUTLET 110V
	NEW HALF-HOT DUPLEX OUTLET 110V
	NEW GFI DUPLEX OUTLET 110V
	NEW WATER-PROOF DUPLEX OUTLET 110V
	NEW DUPLEX OUTLET 220V
	NEW SINGLE-POLE SWITCH
	NEW 3-WAY SWITCH
	NEW 4-WAY SWITCH
	NEW DIMMER SWITCH
	NEW TIMER SWITCH
	EXISTING DUPLEX OUTLET 110V
	EXISTING HALF-HOT DUPLEX OUTLET 110V
	EXISTING GFI DUPLEX OUTLET 110V
	EXISTING WATER-PROOF DUPLEX OUTLET 110V
	EXISTING DUPLEX OUTLET 220V
	EXISTING SINGLE-POLE SWITCH
	EXISTING 3-WAY SWITCH
	EXISTING 4-WAY SWITCH
	EXISTING DIMMER SWITCH
	EXISTING TIMER SWITCH
	NEW CEILING-MOUNTED SMOKE DETECTOR
	EXISTING CEILING-MOUNTED SMOKE DETECTOR
	WALL-MOUNTED THERMOSTAT
	NEW RECESSED RESTROOM EXHAUST FAN
	EXISTING RECESSED RESTROOM EXHAUST FAN
	MOTION DETECTION SENSOR
	NEW SINGLE BULB WALL-MOUNTED LIGHT FIXTURE
	EXISTING SINGLE BULB WALL-MOUNTED LIGHT FIXTURE
	NEW TRIPLE BULB WALL-MOUNTED LIGHT FIXTURE
	SOLAR FLOOR SCONCE LIGHT
	WALL-MOUNTED SCONCE LIGHT
	NEW SINGLE-LAMP FLUORESCENT LIGHT FIXTURE
	EXISTING SINGLE-LAMP FLUORESCENT LIGHT FIXTURE
	NEW RECESSED LIGHT FIXTURE
	EXISTING RECESSED LIGHT FIXTURE
	NEW VAPOR-PROOF RECESSED LIGHT FIXTURE
	EXISTING VAPOR-PROOF RECESSED LIGHT FIXTURE
	NEW CEILING-MOUNTED LIGHT FIXTURE
	EXISTING CEILING-MOUNTED LIGHT FIXTURE
	CEILING-HANGING LIGHT FIXTURE
	EXTERIOR FLOOD LIGHT FIXTURE
	NEW DOOR-BELL
	EXISTING DOOR-BELL
	CABLE TV
	NEW CEILING FAN
	EXISTING CEILING FAN
	NEW CEILING FAN WITH LIGHT
	EXISTING CEILING FAN WITH LIGHT
	UNDER COUNTER PUCK LIGHT
	WIRING
	ELECTRICAL PANEL
	TELEPHONE JAX

Date

JUNE 2025

Designed by

DrawnCheck by

Scale

3/16" = 1'-0"

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CORRECT THE DESIGN OF THE STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELAYED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

DURAN ARCHITECTURE

PO BOX 882
Phone: 305-213-8729
duranarchitecture2601@gmail.com

CESAR D. DURAN
#AR 103304

SEAL:

STATE OF FLORIDA
CESAR D. DURAN
AR 103304
REGISTERED ARCHITECT

Sign & Seal

REVISION
NEW SINGLE FAMILY
RESIDENCE
8849 LELY ISLAND CIR
NAPLES, FL, 34113

Location

Revision

E101

Page

1ST LVL ELECTRICAL PLAN



ELECTRICAL LEGEND	
	NEW DUPLEX OUTLET 110V
	NEW HALF-HOT DUPLEX OUTLET 110V
	NEW GFI DUPLEX OUTLET 110V
	NEW WATER-PROOF DUPLEX OUTLET 110V
	NEW DUPLEX OUTLET 220V
	NEW SINGLE-POLE SWITCH
	NEW 3-WAY SWITCH
	NEW 4-WAY SWITCH
	NEW DIMMER SWITCH
	NEW TIMER SWITCH
	EXISTING DUPLEX OUTLET 110V
	EXISTING HALF-HOT DUPLEX OUTLET 110V
	EXISTING GFI DUPLEX OUTLET 110V
	EXISTING WATER-PROOF DUPLEX OUTLET 110V
	EXISTING DUPLEX OUTLET 220V
	EXISTING SINGLE-POLE SWITCH
	EXISTING 3-WAY SWITCH
	EXISTING 4-WAY SWITCH
	EXISTING DIMMER SWITCH
	EXISTING TIMER SWITCH
	NEW CEILING-MOUNTED SMOKE DETECTOR
	EXISTING CEILING-MOUNTED SMOKE DETECTOR
	WALL-MOUNTED THERMOSTAT
	NEW RECESSED RESTROOM EXHAUST FAN
	EXISTING RECESSED RESTROOM EXHAUST FAN
	MOTION DETECTION SENSOR
	NEW SINGLE BULB WALL-MOUNTED LIGHT FIXTURE
	EXISTING SINGLE BULB WALL-MOUNTED LIGHT FIXTURE
	NEW TRIPLE BULB WALL-MOUNTED LIGHT FIXTURE
	SOLAR FLOOR SCONCE LIGHT
	WALL-MOUNTED SCONCE LIGHT
	NEW SINGLE-LAMP FLUORESCENT LIGHT FIXTURE
	EXISTING SINGLE-LAMP FLUORESCENT LIGHT FIXTURE
	NEW RECESSED LIGHT FIXTURE
	EXISTING RECESSED LIGHT FIXTURE
	NEW VAPOR-PROOF RECESSED LIGHT FIXTURE
	EXISTING VAPOR-PROOF RECESSED LIGHT FIXTURE
	NEW CEILING-MOUNTED LIGHT FIXTURE
	EXISTING CEILING-MOUNTED LIGHT FIXTURE
	CEILING-HANGING LIGHT FIXTURE
	EXTERIOR FLOOD LIGHT FIXTURE
	NEW DOOR-BELL
	EXISTING DOOR-BELL
	CABLE TV
	NEW CEILING FAN
	EXISTING CEILING FAN
	NEW CEILING FAN WITH LIGHT
	EXISTING CEILING FAN WITH LIGHT
	UNDER COUNTER PUCK LIGHT
	WIRING
	ELECTRICAL PANEL
	TELEPHONE JAX

NOTE:
IT IS THE RESPONSIBILITY OF THE GENERAL CONTRACTOR TO REVIEW AND CONFIRM THE DESIGN OF THIS STRUCTURE, VERIFYING DIMENSIONS AND DETAILS THAT CONTRIBUTE TO OWNER SPECIFICATION.
ANY DISCREPANCIES ARE TO BE RELAYED TO DESIGNER AND ENGINEER OF RECORD. CONTRACTOR ASSUMES FULL RESPONSIBILITY FOR ANY & ALL COSTS RELATED TO CORRECTIONS OF THE PLANS.

R E V I S I O N
NEW SINGLE FAMILY
R E S I D E N C E
8849 LELY ISLAND CIR
NAPLES, FL, 34113

E102

2ND LVL ELECTRICAL PLAN