

### Description:

Sentry Sprinklers Model PI-6030 is a Wall Type Indicator Post that is installed in combination with a buried non-rising stem gate valve to indicate the buried valves opening position. The post sight window indicates whether the valve is in the open or shut position. The post can be field adjusted for the required depth for the buried valve. The Indicator Post is anti-corrosion with 10 mil (250 $\mu$ ) of fusion-bonded epoxy (FBE) coating on both inside & outside. All other components are made of corrosive resistance materials.




### Features:

- Suitable for sizes 4" - 12".
- Meets all requirements for UL789 and FM1110.
- Easy field adjustment, up to 26".
- Epoxy coated inside & outside.
- Casted 12" Faceplate Flange.

Model PI-6030  

### Dimensions:

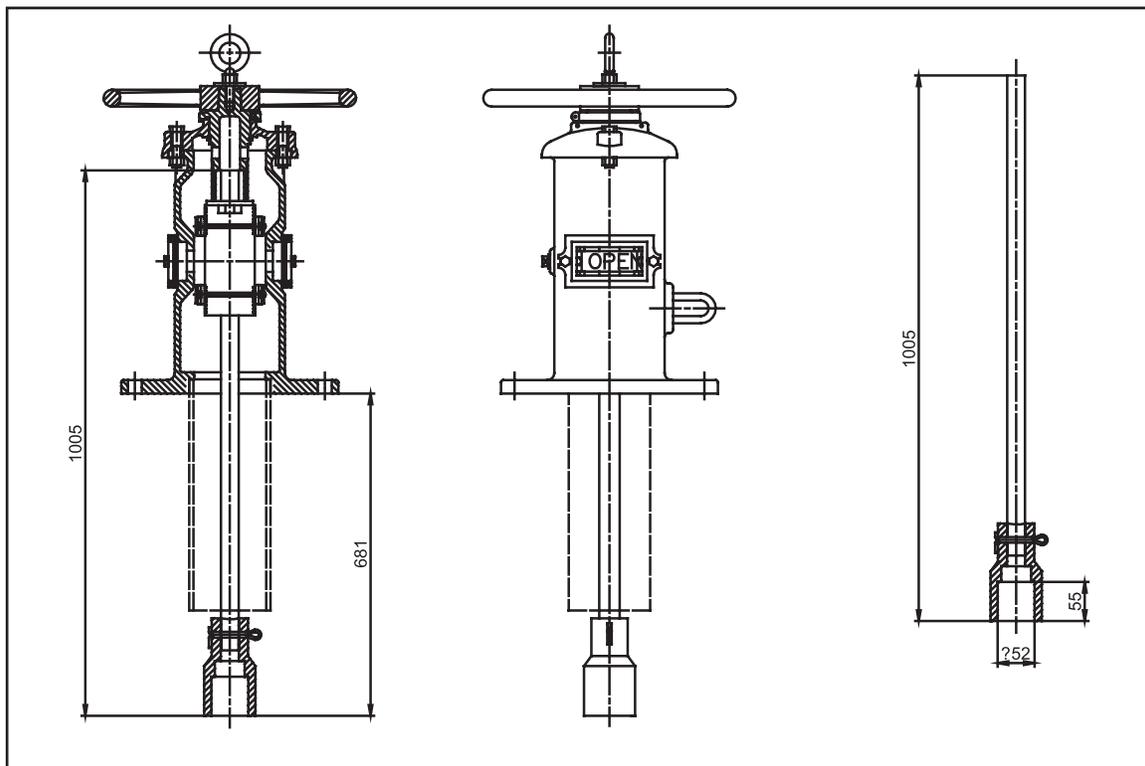

**Material List:**

| ITEM | NAME                | MATERIAL  |
|------|---------------------|-----------|
| 1    | Lifting Eye Bolt    | ASTM A105 |
| 2    | Hex Nut             | ASTM A105 |
| 3    | Washer              | ASTM A105 |
| 4    | Hand Wheel          | ASTM A536 |
| 5    | Operating Nut       | ASTM B62  |
| 6    | Hex Cap Screw       | ASTM A105 |
| 7    | Hex Nut             | ASTM A105 |
| 8    | Snap Ring           | AISI 066  |
| 9    | Target Carrier Nut  | ASTM B62  |
| 10   | Target              | ASTM B108 |
| 11   | Hex Cap Screw       | ASTM A105 |
| 12   | Window Glass        | LEXAN-UN  |
| 13   | Window Glass Gasket | PTFE      |

| ITEM | NAME                                  | MATERIAL   |
|------|---------------------------------------|------------|
| 14   | Hex Cap Screw                         | ASTM A105  |
| 15   | Hex Nut                               | ASTM A105  |
| 16   | Body                                  | ASTM A536  |
| 17   | Stand Pipe                            | ASTM A53   |
| 18   | Stem                                  | AISI 1045  |
| 19   | Cotter Pin                            | AISI 304   |
| 20   | Crane Coupling                        | ASTM A536  |
| 21   | Plug                                  | AISI 304   |
| 22   | Cover                                 | ASTM A126B |
| 23   | Cross Recessed Countersunk Head Screw | AISI 304   |
| 24   | Locking Nose                          | ASTM 307 B |
| 25   | Window Cover                          | ASTM A307B |
| -    | -                                     | -          |

**Field Adjustment:**

- Remove the top section from the top of the Indicator Post assembly.
- Set the “OPEN” and “SHUT” targets for the appropriate valve size.
- Reattach the top section to the top of the Indicator Post assembly.
- Design and materials are subject to change without notice.