

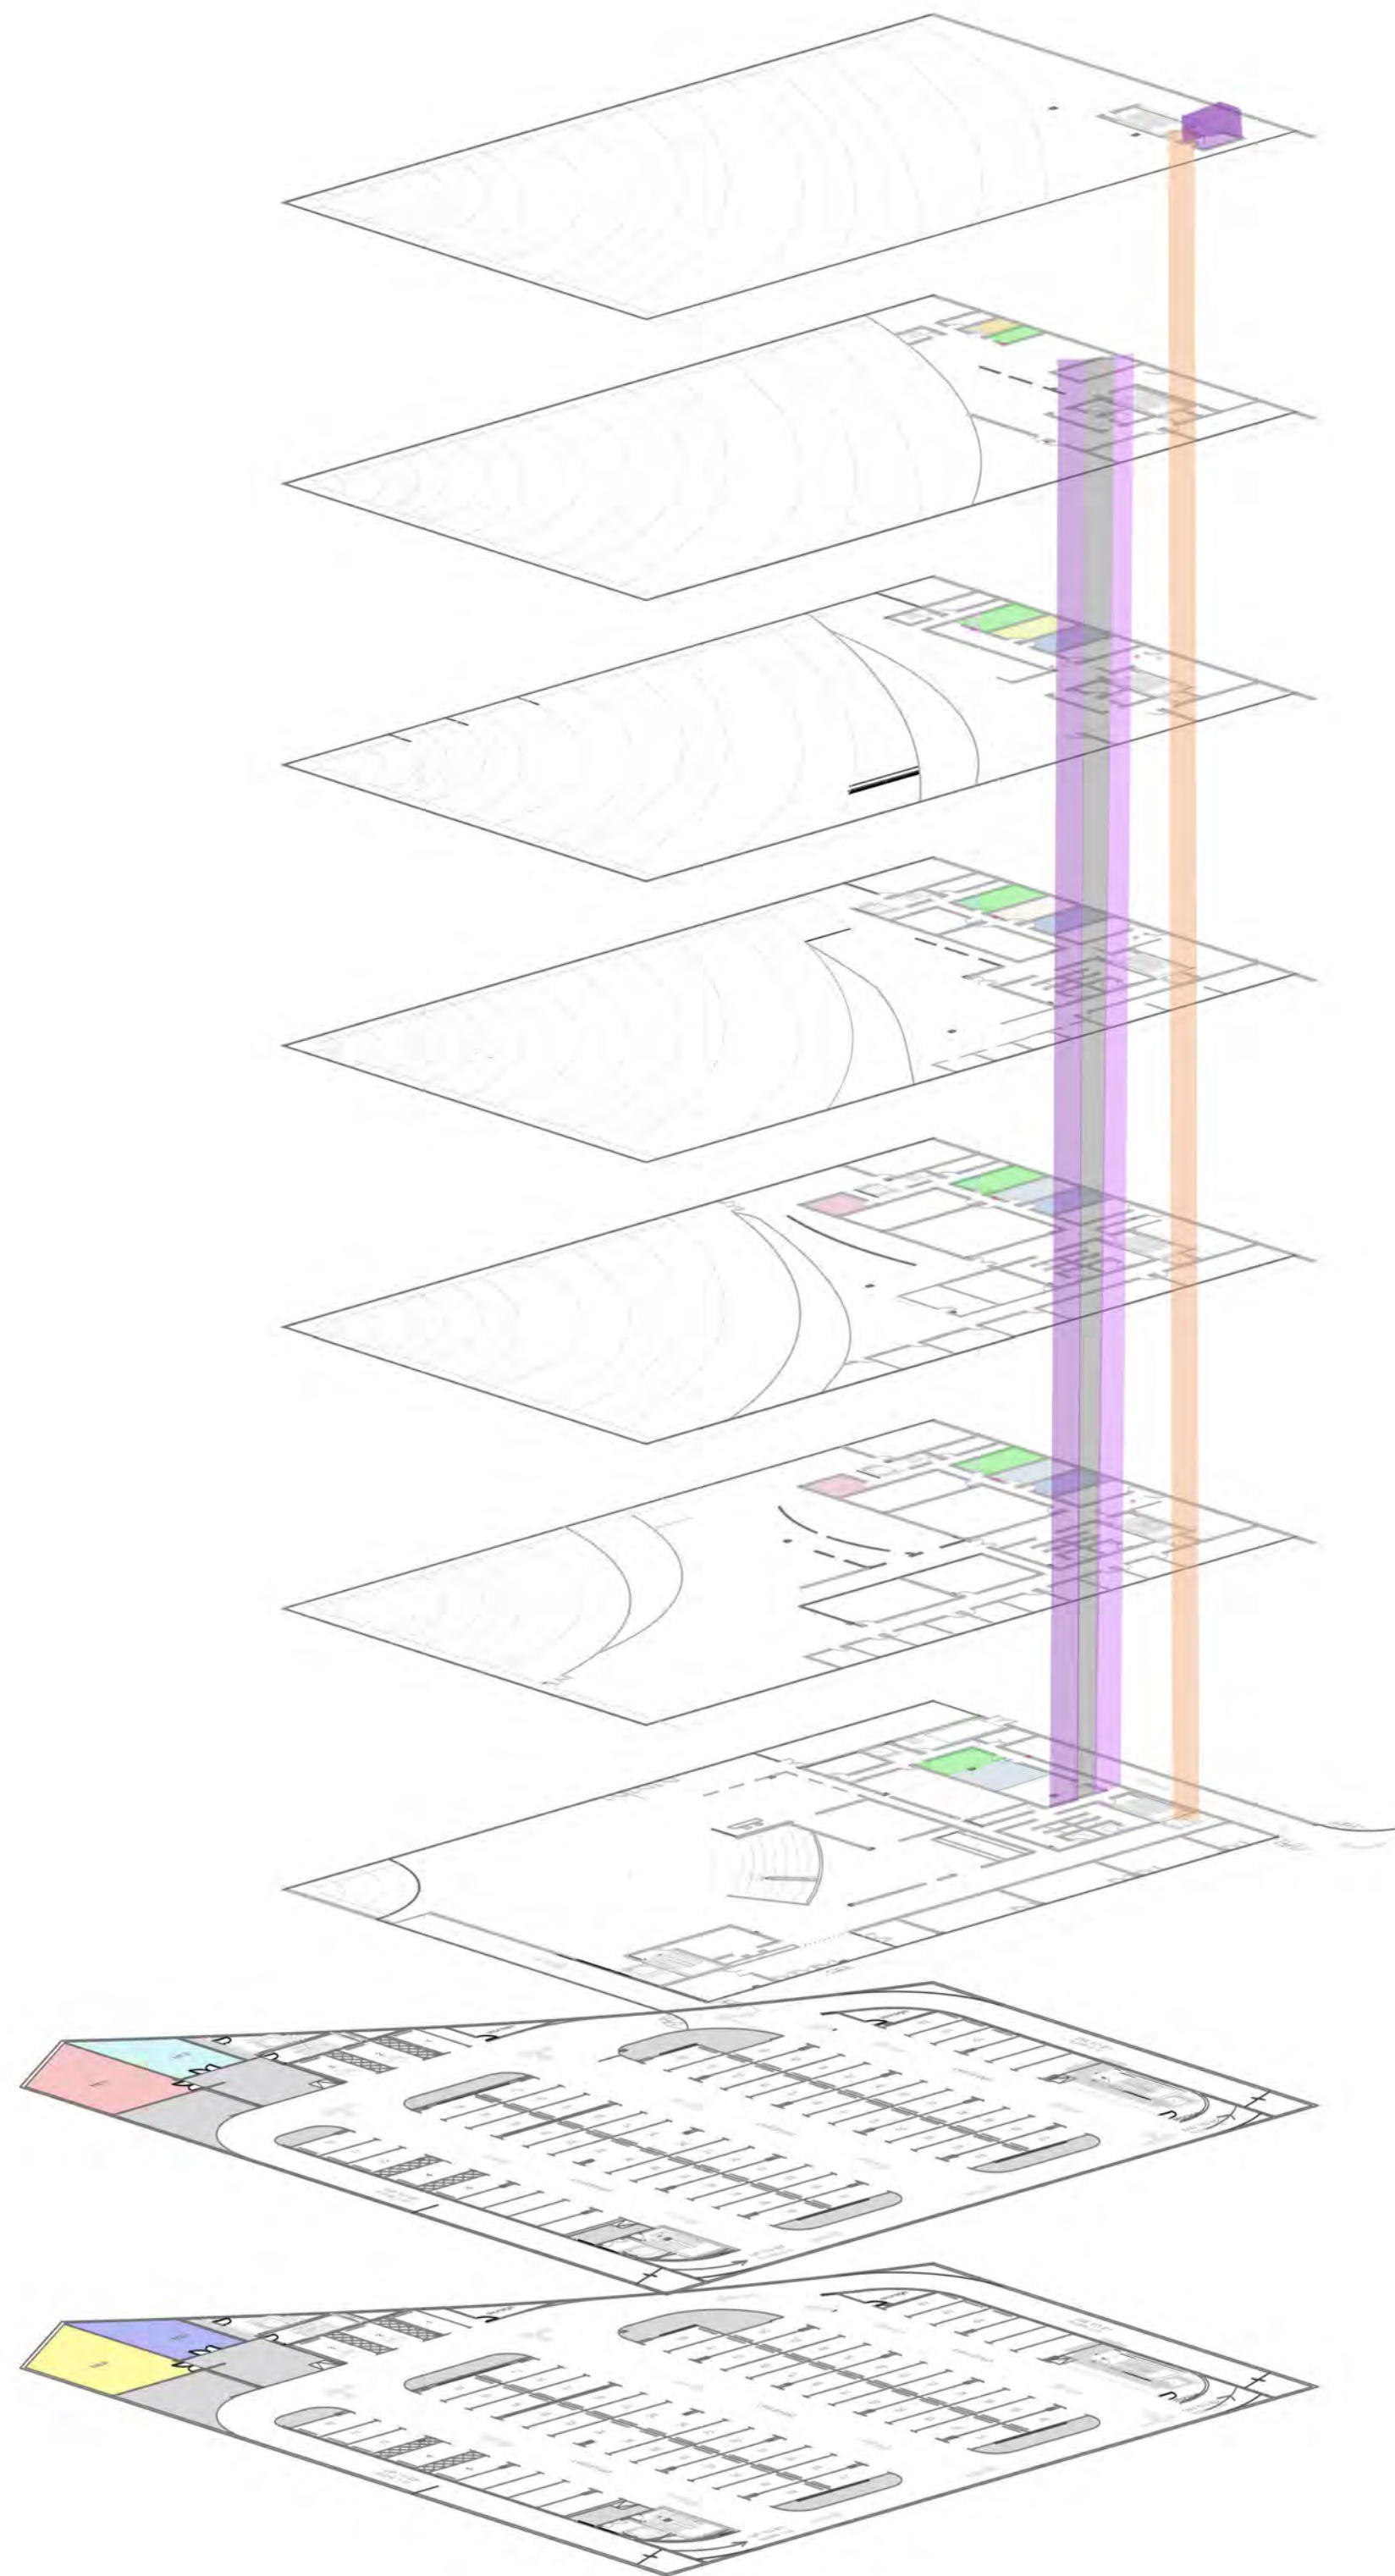






MEP General scheme

Pressurization shaft		Hire Hydrants	
Chiller Room		Electrical Rooms	
Cooling Tower		Telephone Rooms	
Air Handling Unit		Watermeter Room	
Fan Rooms		Generator Room	
Fire pump Room		Transformer Room	
Water Tank		LV Room	
Fire Hose Cabinet		GSM Room	
Telecom Room			

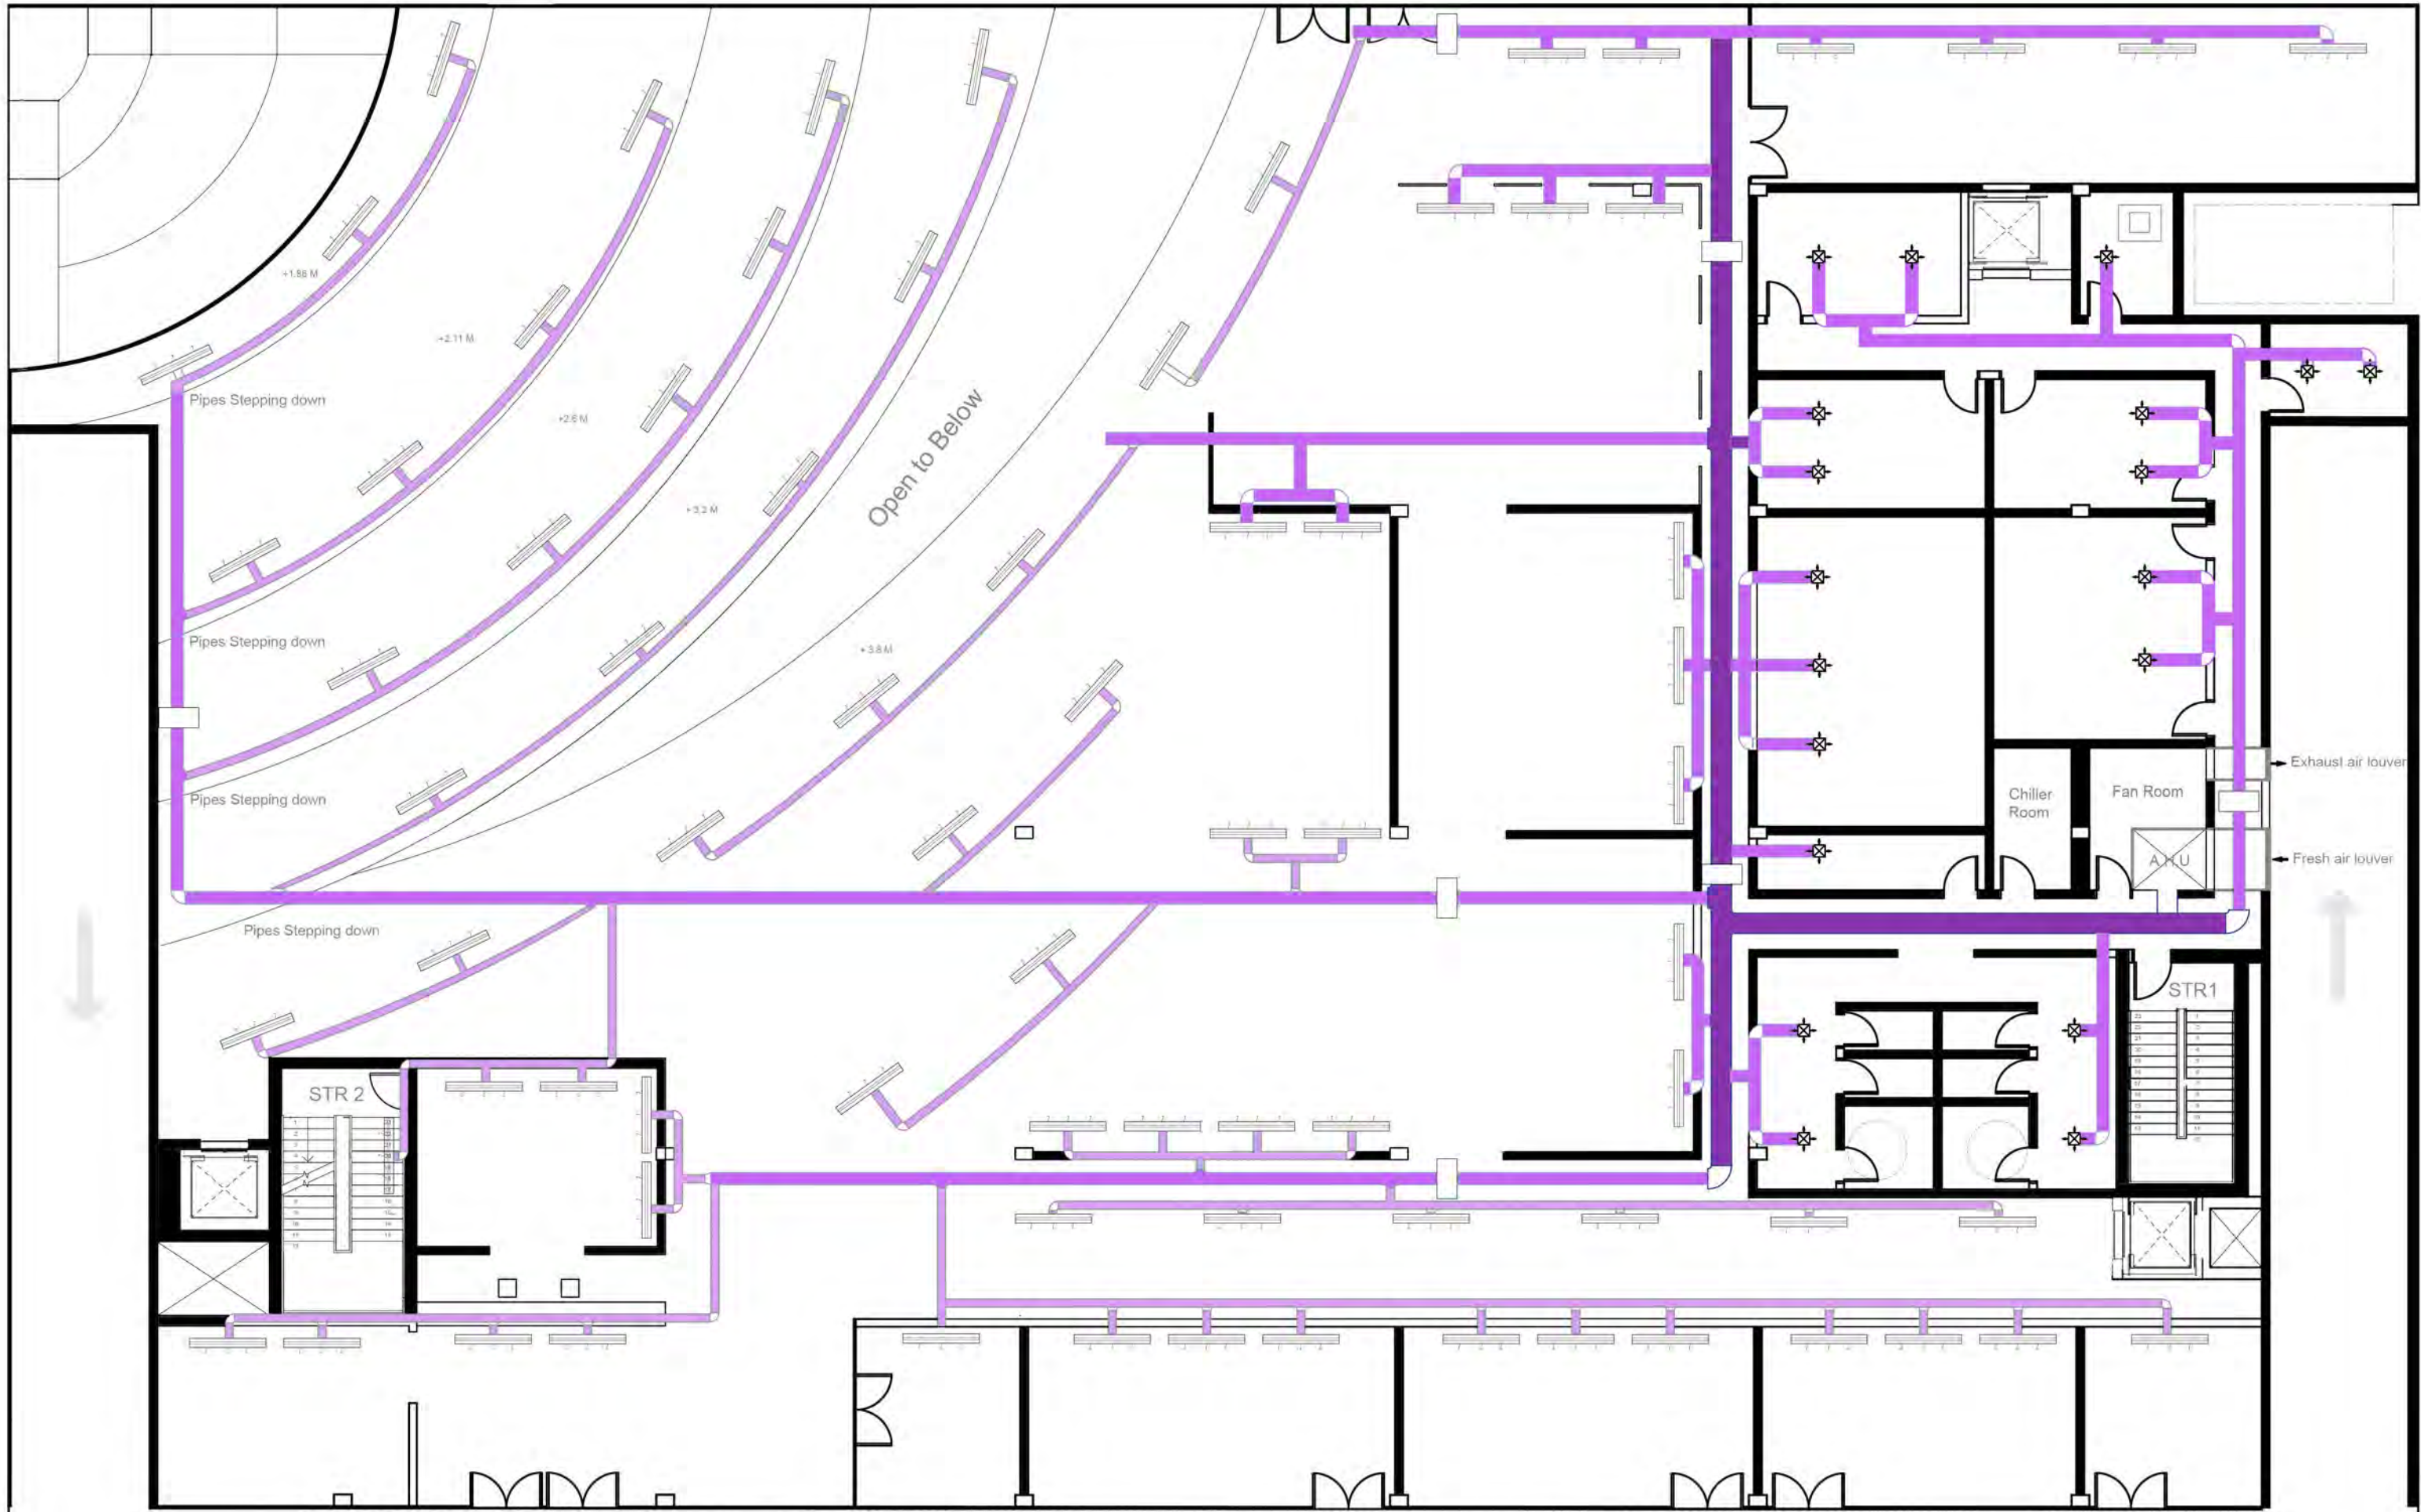

Legends and Symbols

- Supply Air Diffuser (Modular)
- Supply Air Diffuser
- Bellmouth
- Elbow
- 8" pipe
- 12" pipe
- 20" pipe
- V.A.V box

- Notes:
- Do not scale the drawings
 - The contract Documents are complementary. What is required by one is as binding as if required by all.
 - The contractor shall coordinate all portions of the work as described in the contract documents.
 - Notify the car for resolutions for all discrepancies prior to construction.
 - Unless otherwise indicated, plan dimensions are to column grid on cm nominal surface of masonry, face of studs and face concrete walls.
 - Line of existing grades, as shown on the building elevations and sections are approximate.
 - Verify all rough in dimensions for equipment provided in this contract, or by others.
 - Verify size location/location finish/fire rating, ect. page and provide complete all require opening through floors and walls, access doors, turring,curbs, anchors and inserts. Provided all bases and blocking required by the UL.

NORTH
KEY PLAN



NB	DATE	STATUS
1	21/04/2020	Progress
2	22/04/2020	Progress
3	23/04/2020	Final

WWW.AUD.EDU
04 399 9000
SHEIKH ZAYED RD. -DUBAI

Design Author:



Mahima Aswani
Api Mitra
Ahmed Hussein
mahima.aswani@mymail.aud.edu
Aparajita.mitra@mymail.aud.edu
Ahmed.hussein@mymail.aud.edu

Mahima, Aparajita and Ahmad



Phone no. 050 9488552
Address: Sheikh Zayed Rd., Al Wadi
Apartments, Street 23 e

Project:
**BUR DUBAI
CREEK OFFICE**


Status: Phase III

Title: HVAC layout Ground Floor

DB	CB	DATE	REV
Aparajita Mahima Ahmad	GY	3/5/2020	3/5/2020
SCALE @ A2 1:100		DWG NB M 03	

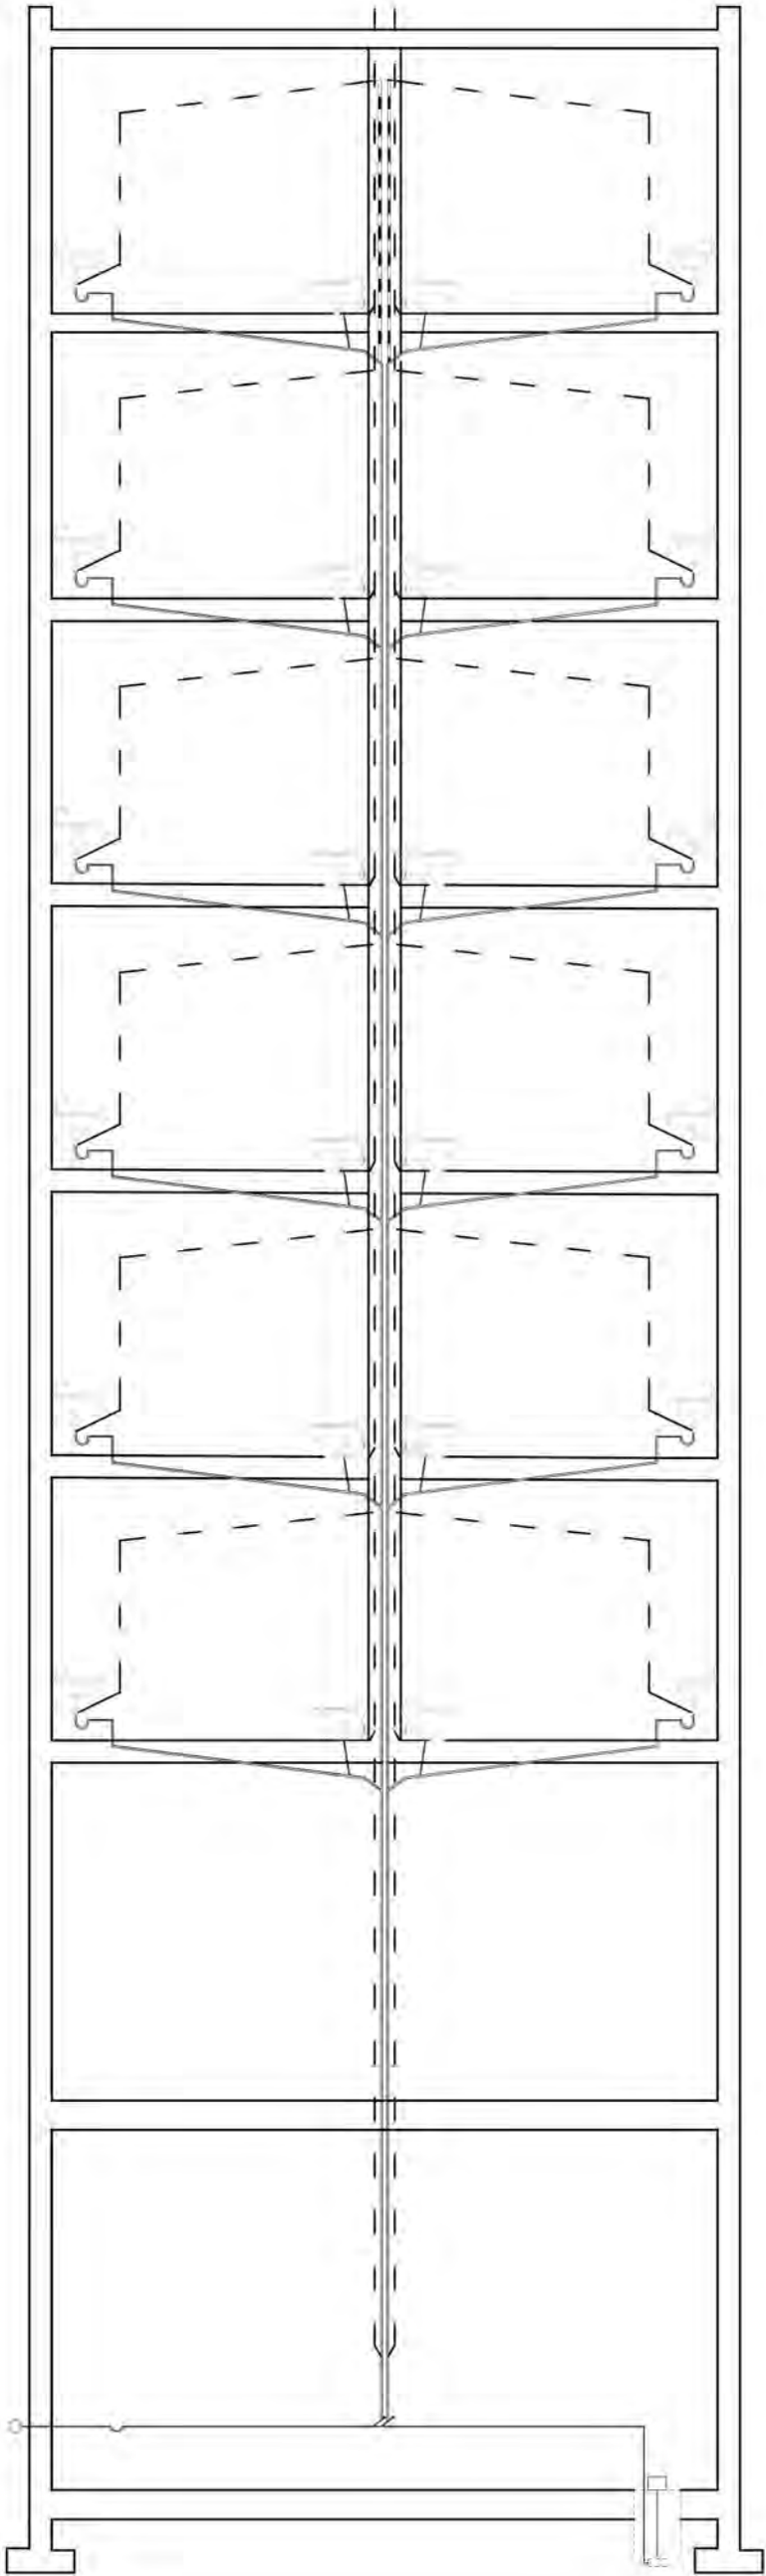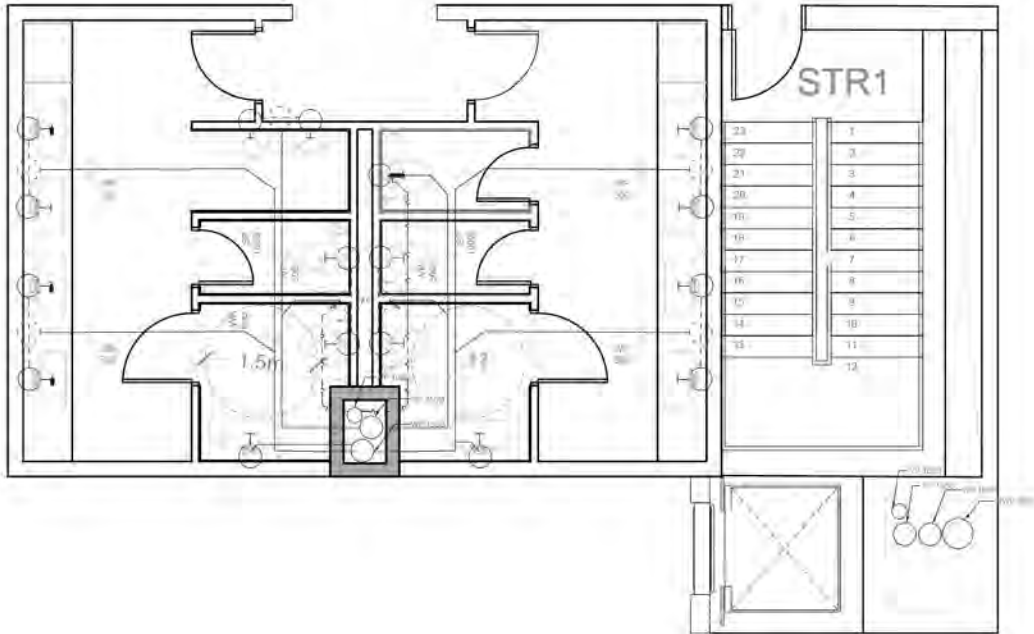

Legends and Symbol

-  Vent Pipe
-  Waste and Soil Pipe
-  Relief Vent
-  Building Trap
-  Sump Pump

- Notes:
- Do not scale the drawings
 - The contract Documents are complementary. What is required by one is as binding as if required by all.
 - The contractor shall coordinate all portions of the work as described in the contract documents.
 - Notify the car for resolutions for all discrepancies prior to construction.
 - Unless otherwise indicated, plan dimensions are to column grid on cm nominal surface of masonry, face of studs and face concrete walls.
 - Line of existing grades, as shown on the building elevations and sections are approximate.
 - Verify all rough in dimensions for equipment provided in this contract, or by others.
 - Verify size location/location finish/fire rating, ect. page and provide complete all require opening through floors and walls, access doors, turring,curbs, anchors and inserts. Provided all bases and blocking required by the UL.

NORTH
KEY PLAN



NB	DATE	STATUS
1	21/04/2020	Progress
2	22/04/2020	Progress
3	23/04/2020	Final

WWW.AUD.EDU
04 399 9000
SHEIKH ZAYED RD. -DUBAI

Design Author:



Mahima Aswani
Api Mitra
Ahmed Hussein

mahima.aswani@mymail.aud.edu
Aparajita.mitra@mymail.aud.edu
Ahmed.hussein@mymail.aud.edu

Mahima, Aparajita and Ahmad

Phone no. 050 9488552
Address: Sheikh Zayed Rd., Al Wadi
Apartments, Street 23 e

Project:
**BUR DUBAI
CREEK OFFICE**

Status: Phase III

Title: Bathroom Drainage

DB	CB	DATE	REV
Aparajita Mahima Ahmad	GY	3/5/2020	3/5/2020
SCALE @ A2 1:100		DWG NB P 02	