

Dear Landlord


___/___/ 2024

An electrical danger level evaluation determining my status of electrical danger resulting in death, shocks and property fire was conducted by Stop the Electric Silent Killer providing information which also incorporated a link to the Queensland Electrical Safety Office Website.

The evaluation ranks a property based on a series of factors (form provided), that provide a danger level starting from Level 1 – No danger, Level 2 – Risk of fire, Level 3 – Risk of death, shocks and property fire, Level 4 – High risk of death, shocks and property fire, Level 5 – Extreme High risk of death, shocks and property fire.

My Danger level was rated at _____.

Stop the Electric Silent Killer recommends for rental properties a Life & Fire Protection Plug-in System which places the risk at Level 1 – No danger.

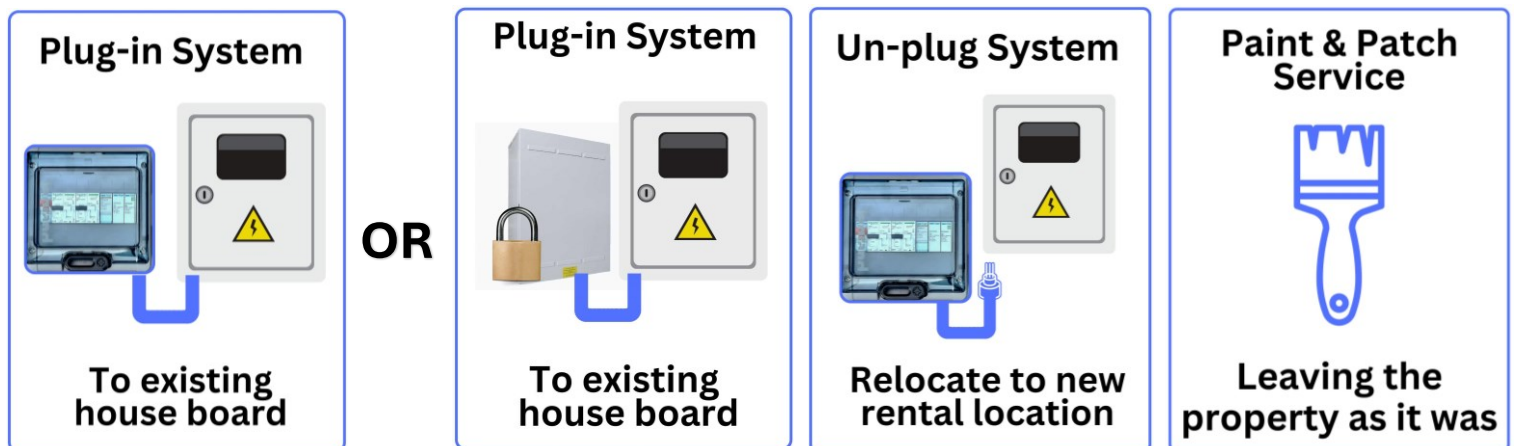

The options include a weatherproof or lockable Plug-in System for extra security as well as locating the system inside the home when a landlord purchases the system.

I would like to know if you are willing to pay for the Life & Fire Protection System and it will remain in your property to protect my family whilst we live here and future families from the risk of electrical death, shocks and property fire.

Alternately, if my budget permits I can purchase the Life & Fire Protection System myself and remove it on departing the property repairing any fixture damage leaving the property in its original state.

For more information you can contact Clem from Stop the Electric Silent Killer at electrisilentkiller.com or call Clem on 0419 313 460 or the Queensland Electrical Safety Office at www.electricalsafety.qld.gov.au

Please let me know within 7 days of your decision and thank you reading this letter.

Signed Tenant,