



ASHRAE PSYCHROMETRIC CHART NO.E


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 101.325 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL

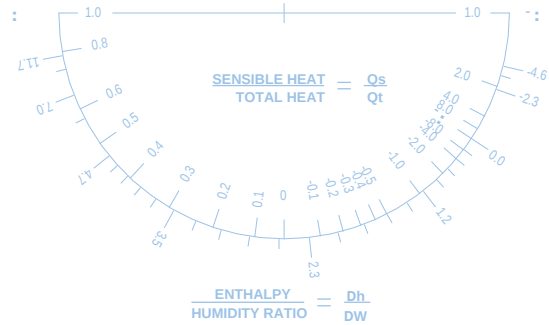

Quaternum
Solutions
Group

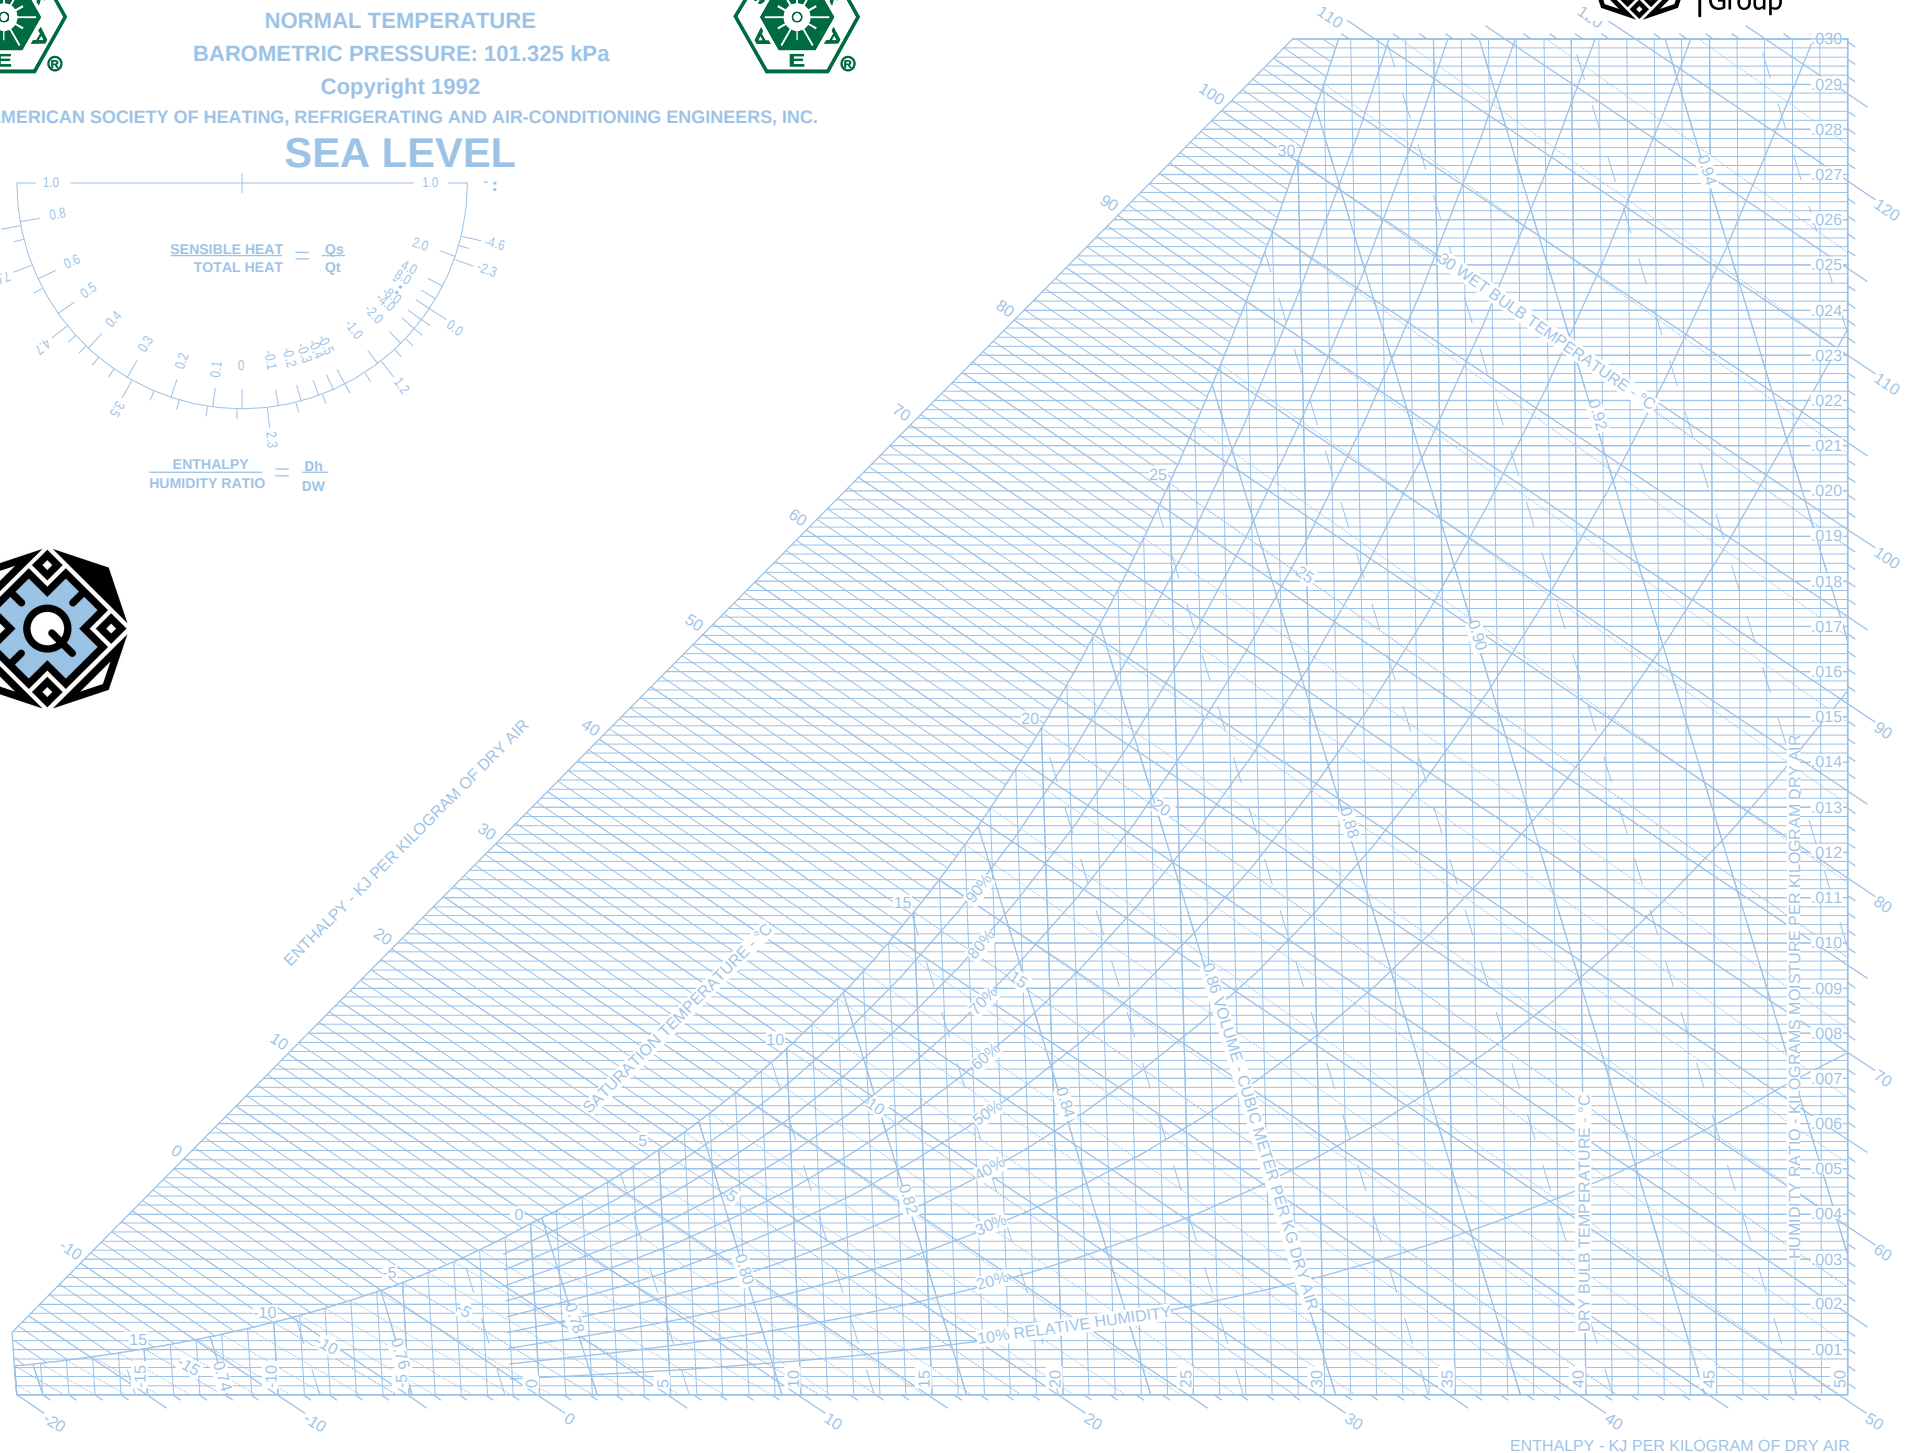



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 101.325 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

SEA LEVEL

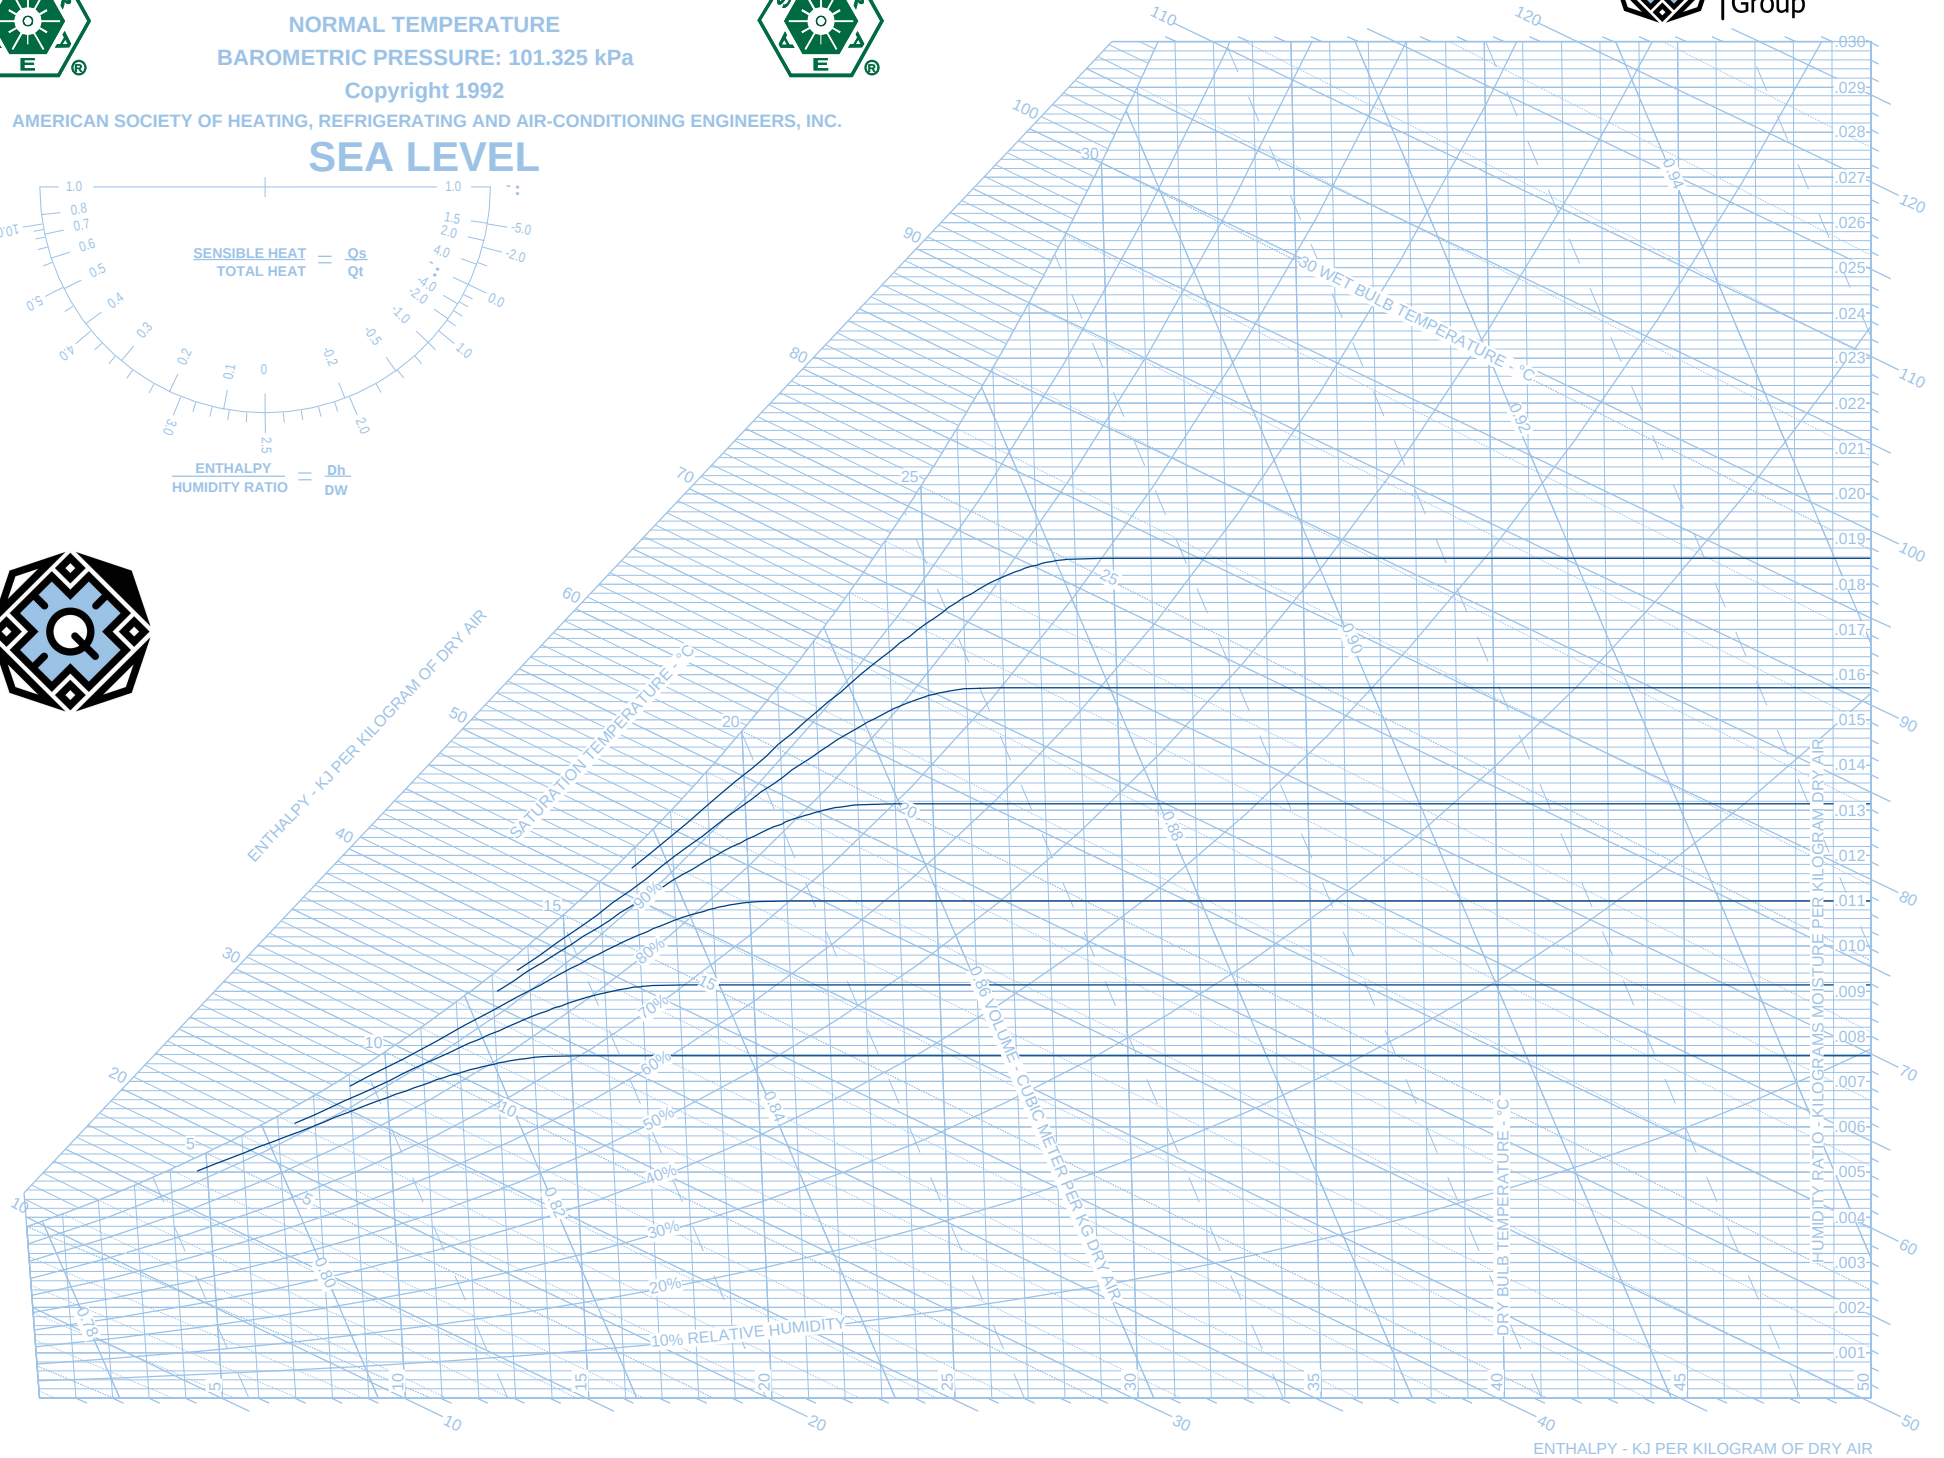



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 101.325 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

SEA LEVEL

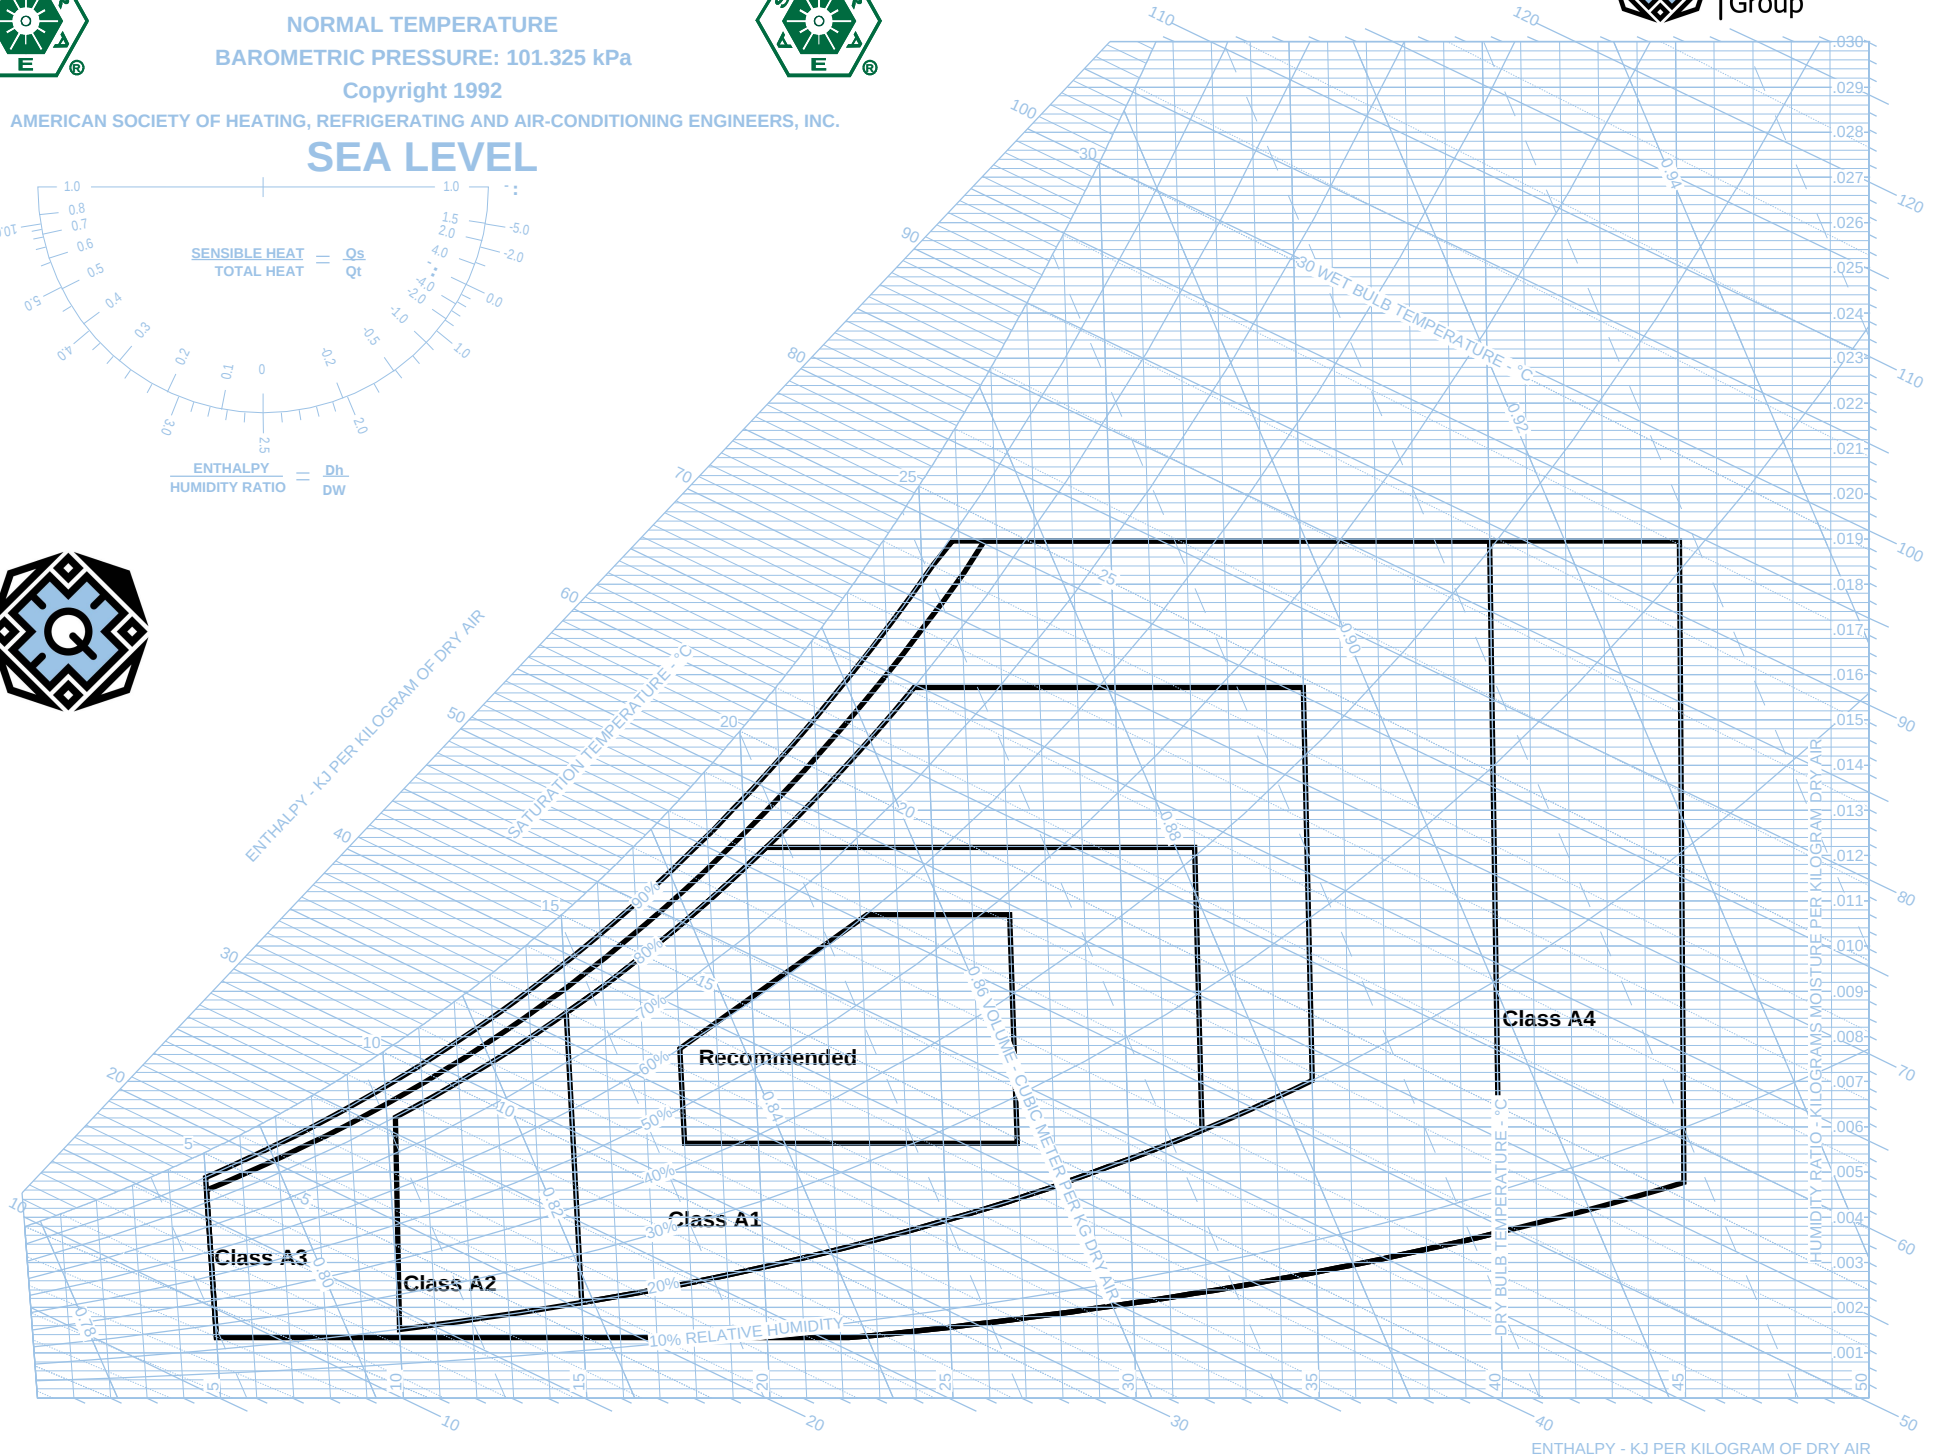



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 29.921 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL

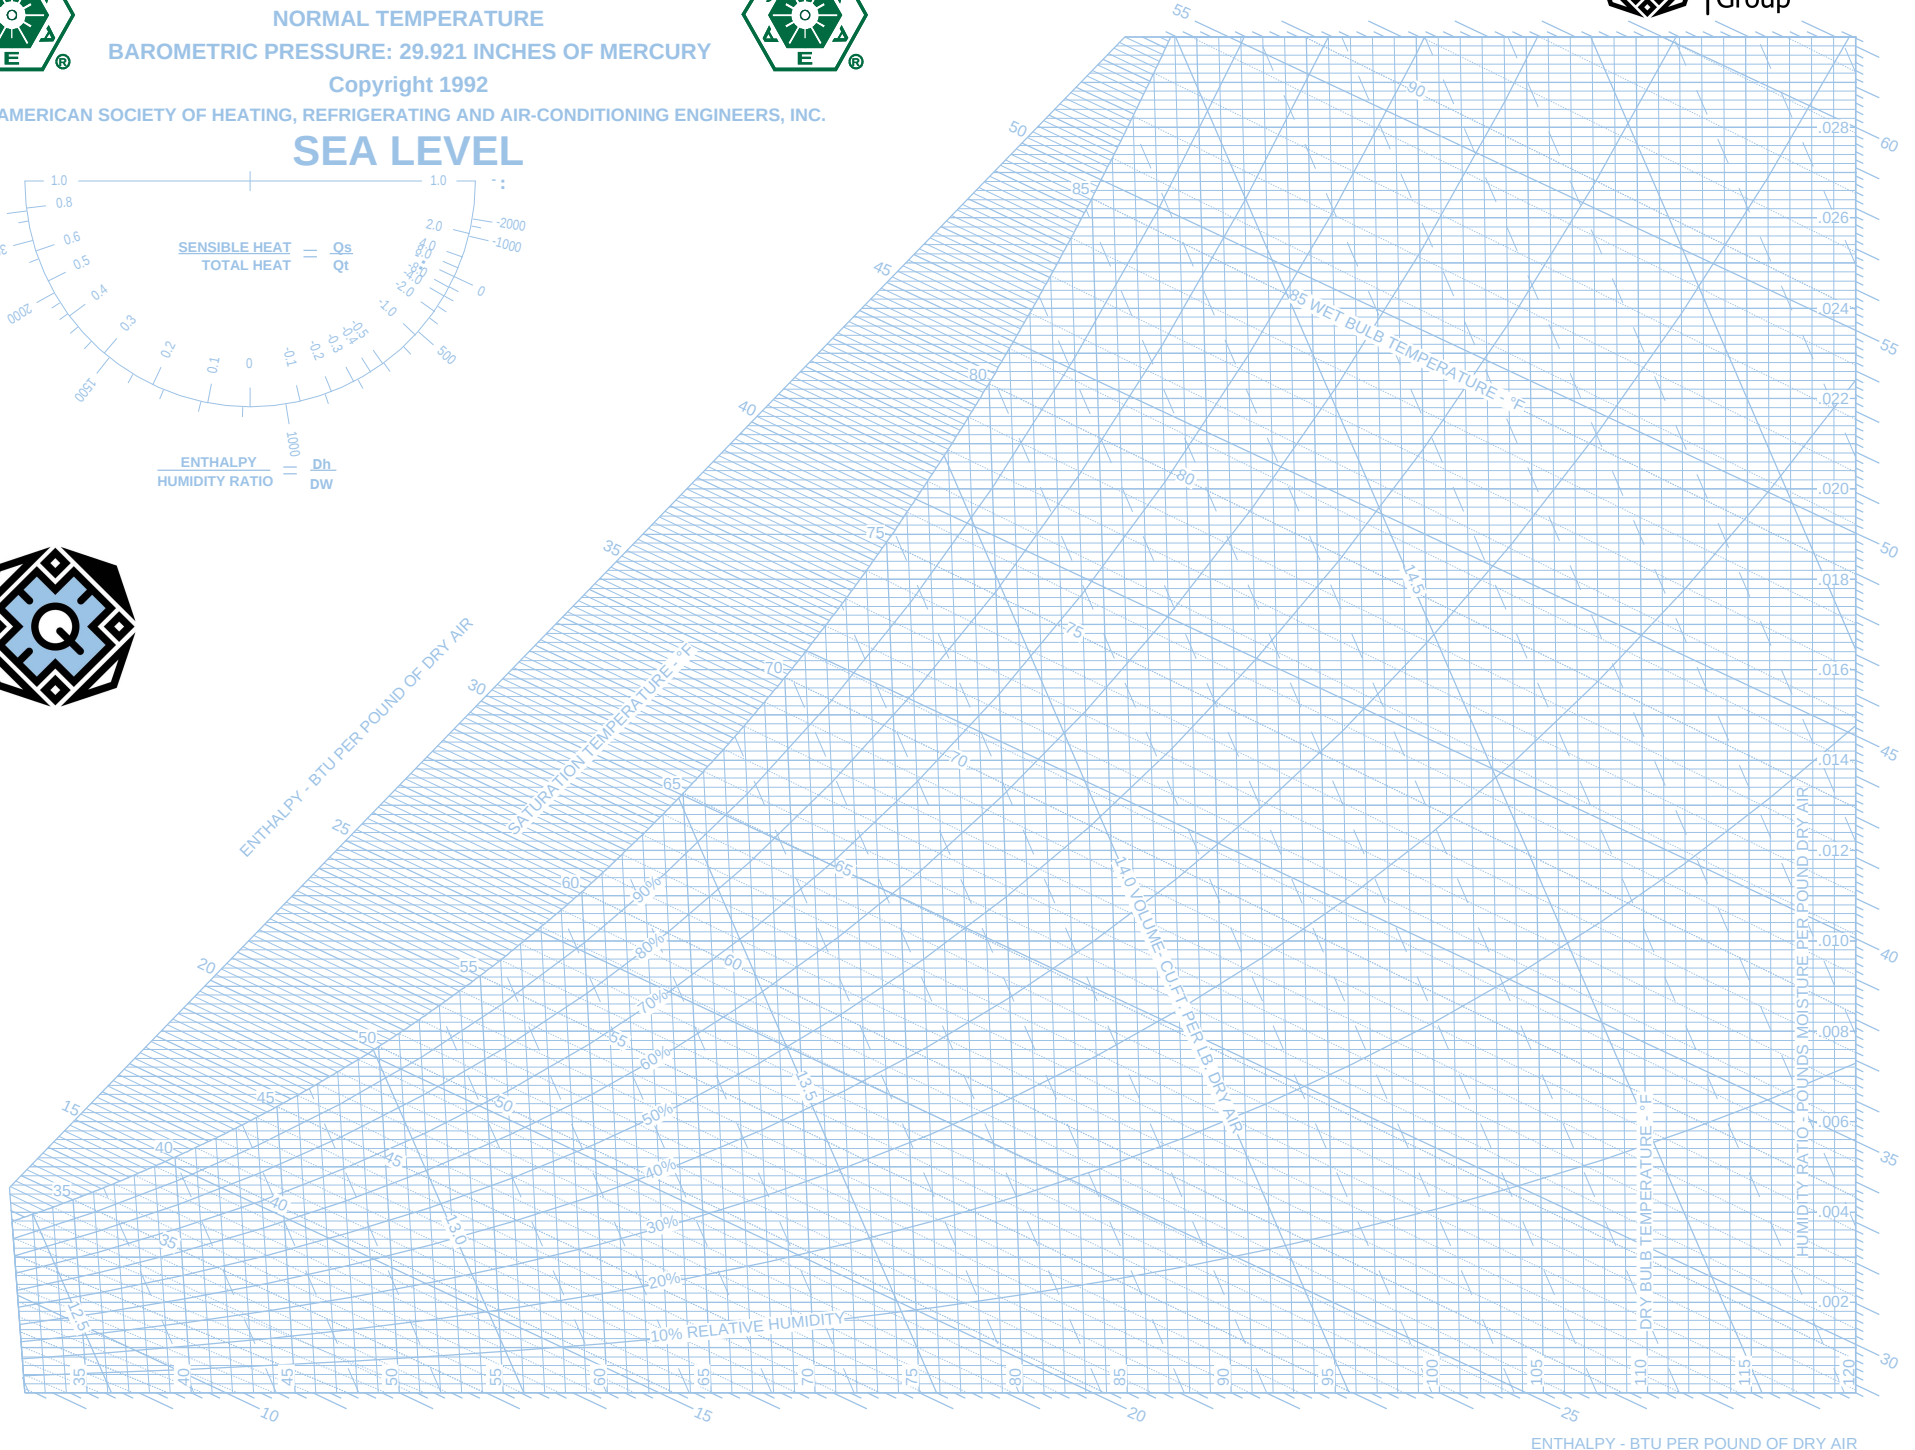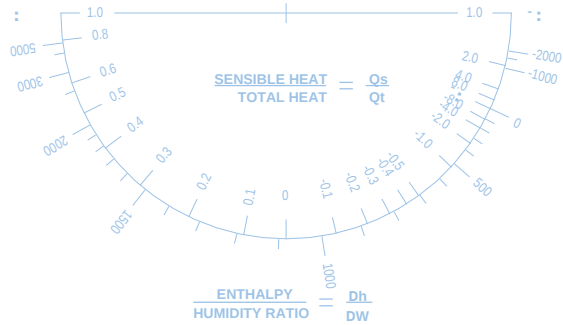



ASHRAE PSYCHROMETRIC CHART NO.2

Low Temperature

BAROMETRIC PRESSURE: 29.921 INCHES OF MERCURY



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

SEA LEVEL

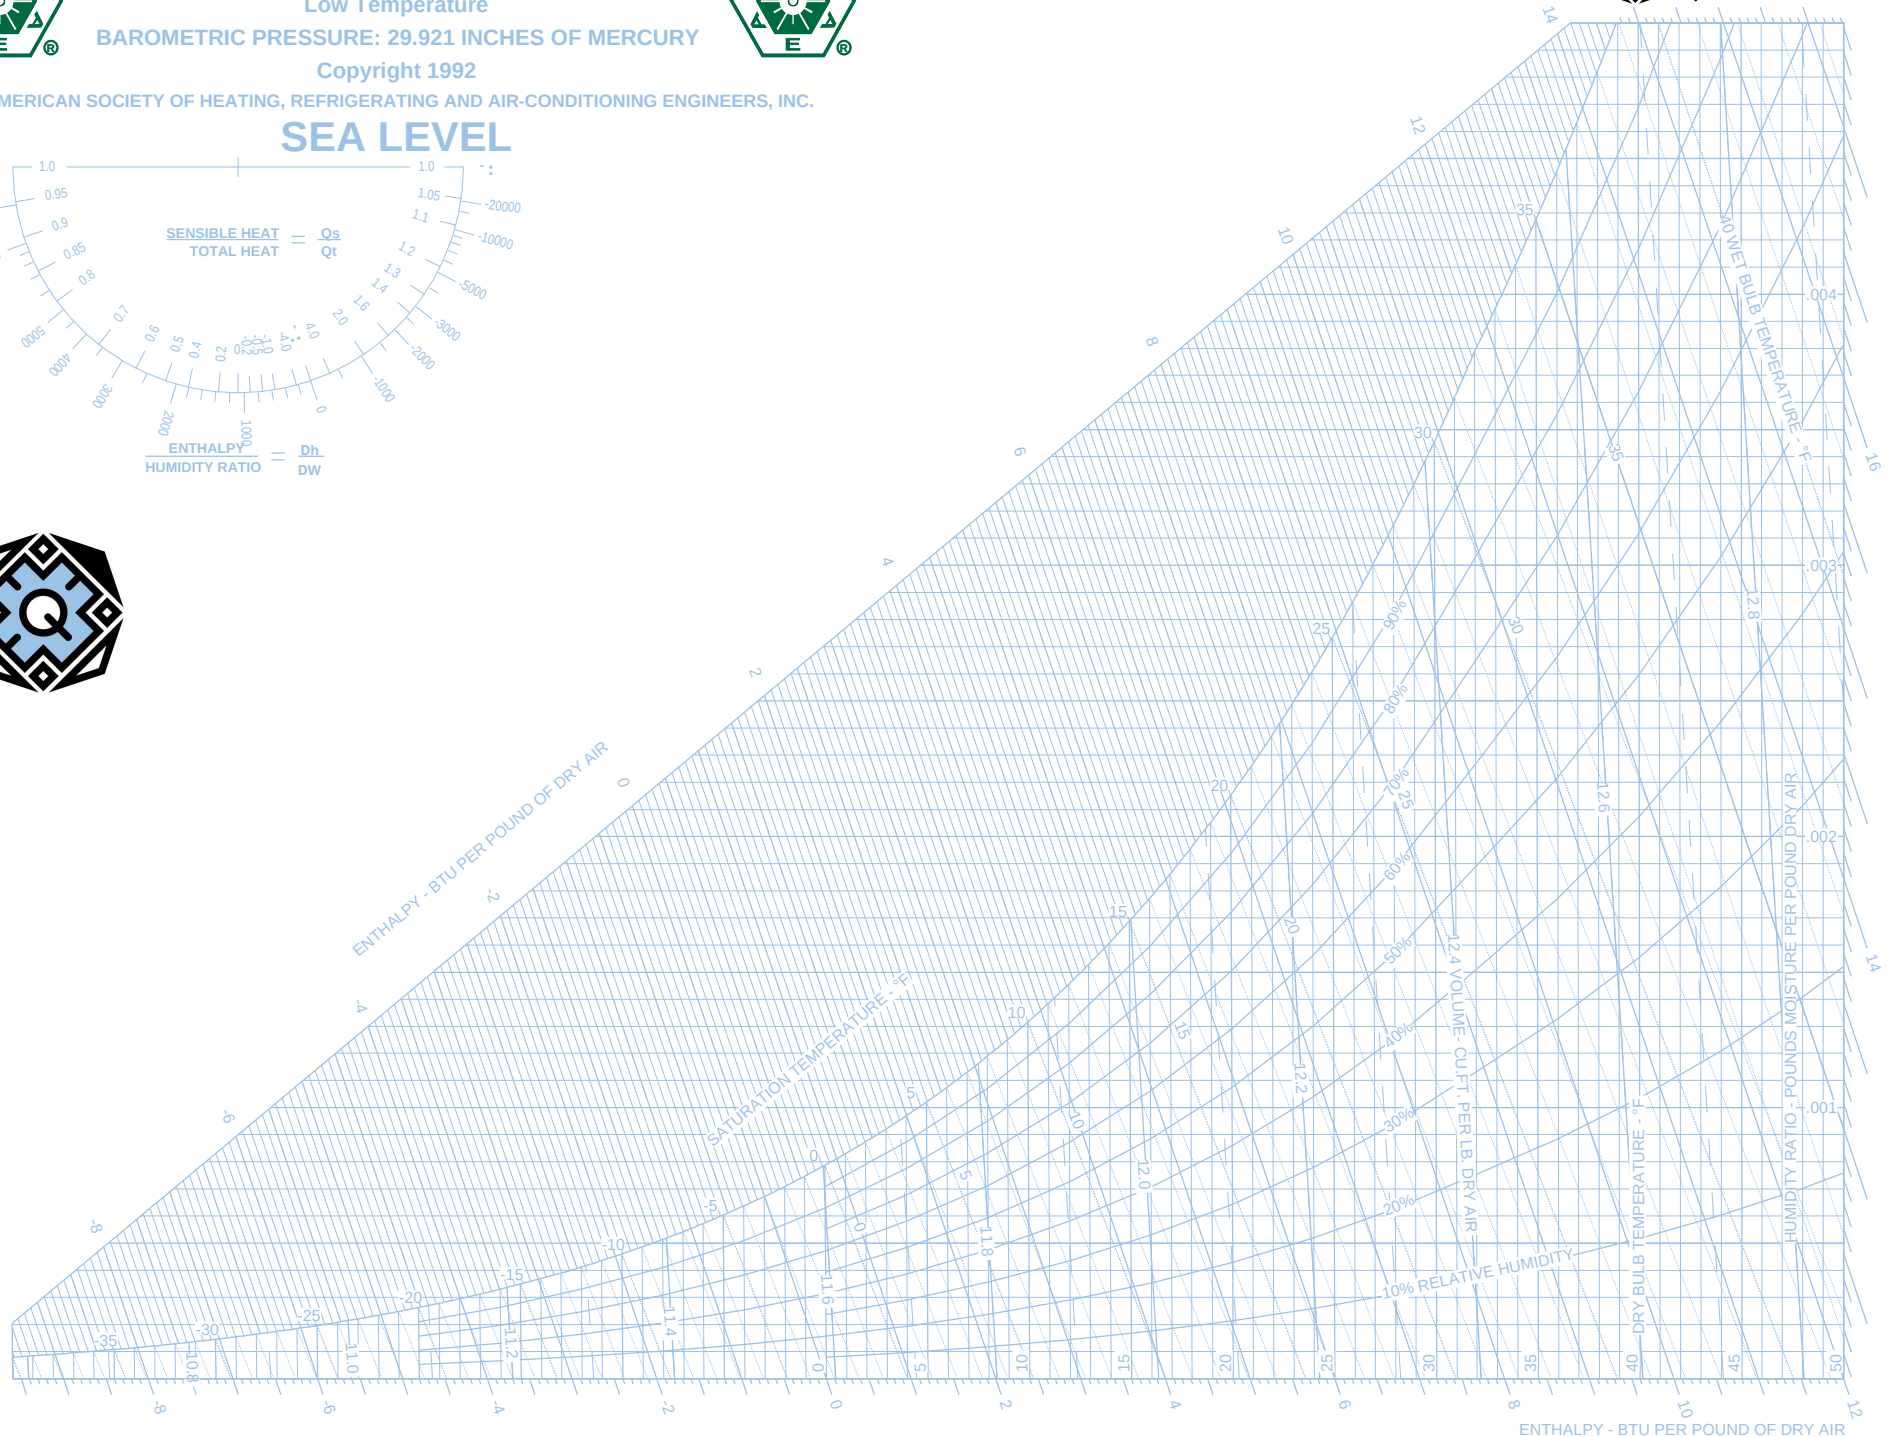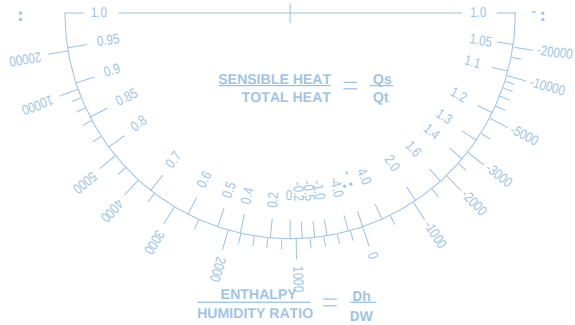



ASHRAE PSYCHROMETRIC CHART NO.3

HIGH TEMPERATURE
BAROMETRIC PRESSURE: 29.921 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL

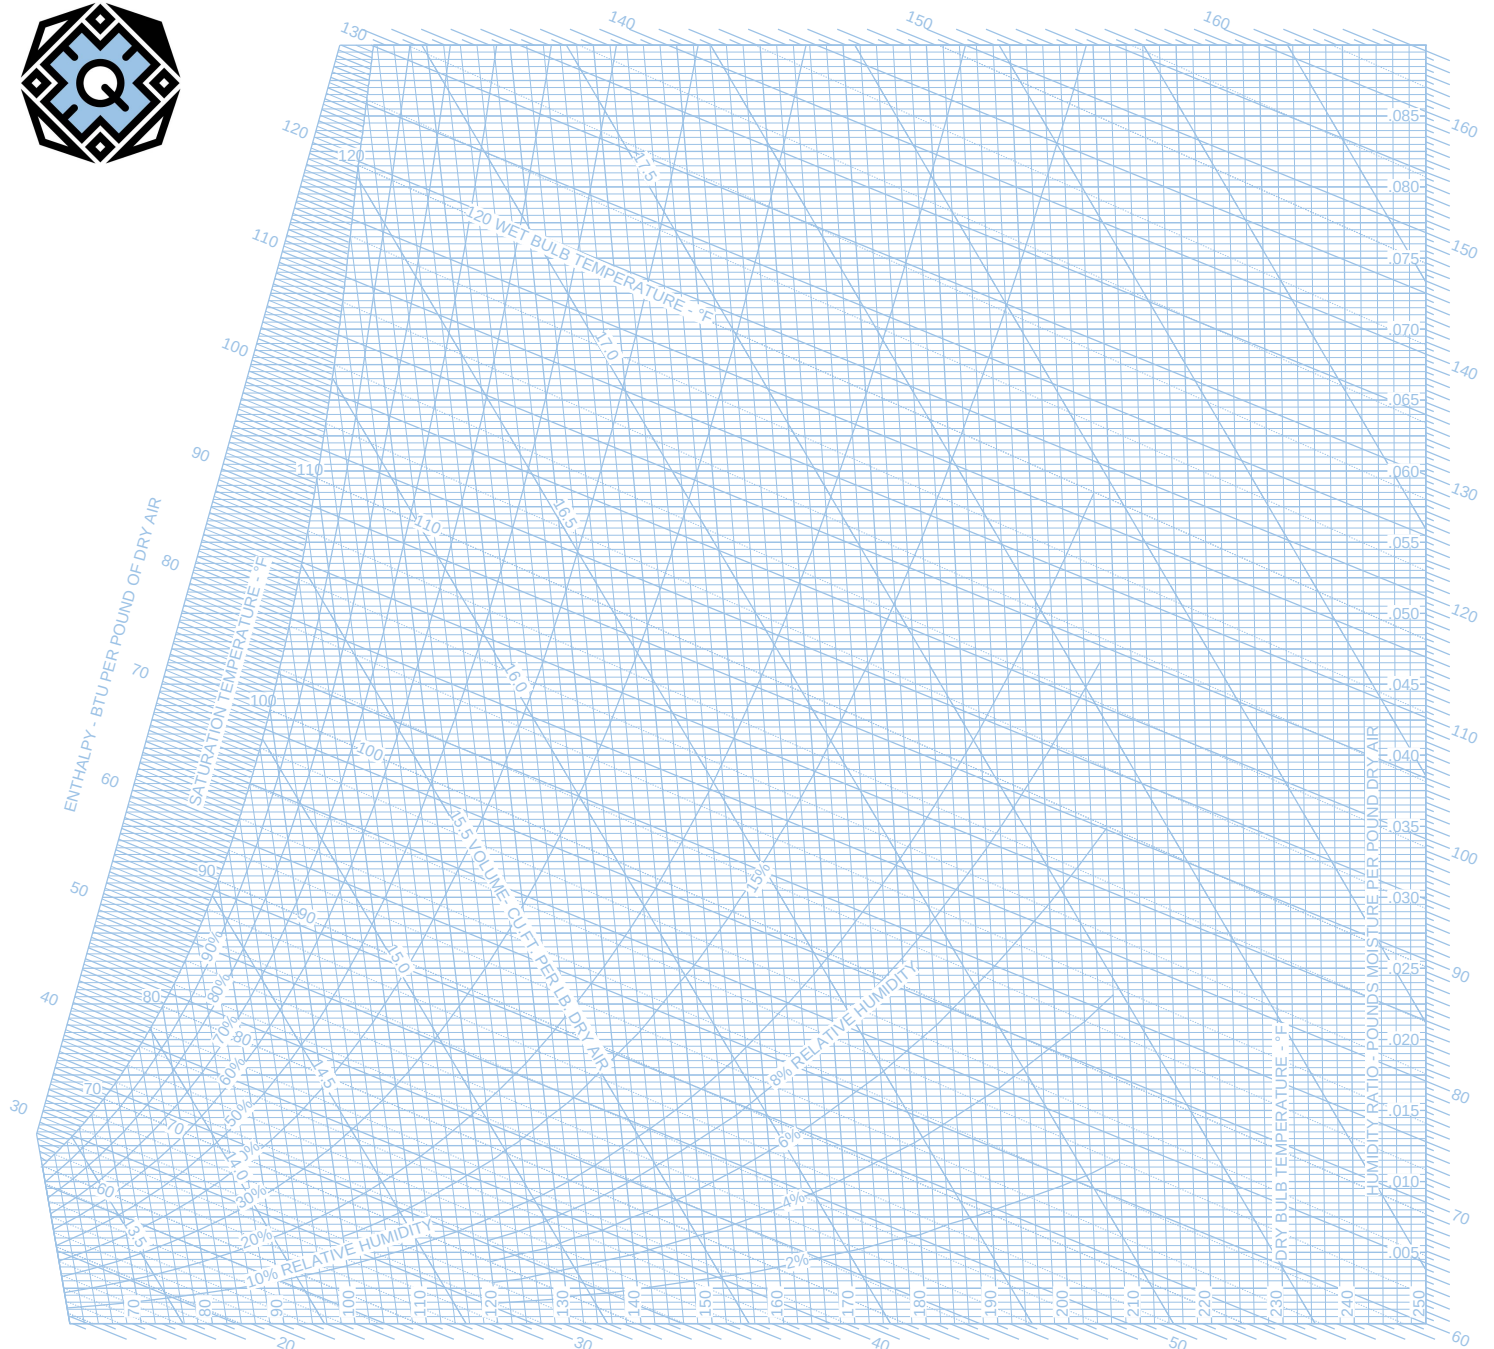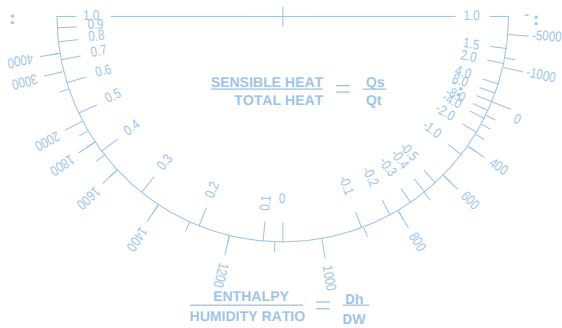



ASHRAE PSYCHROMETRIC CHART NO.4

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 24.896 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

5000 FEET

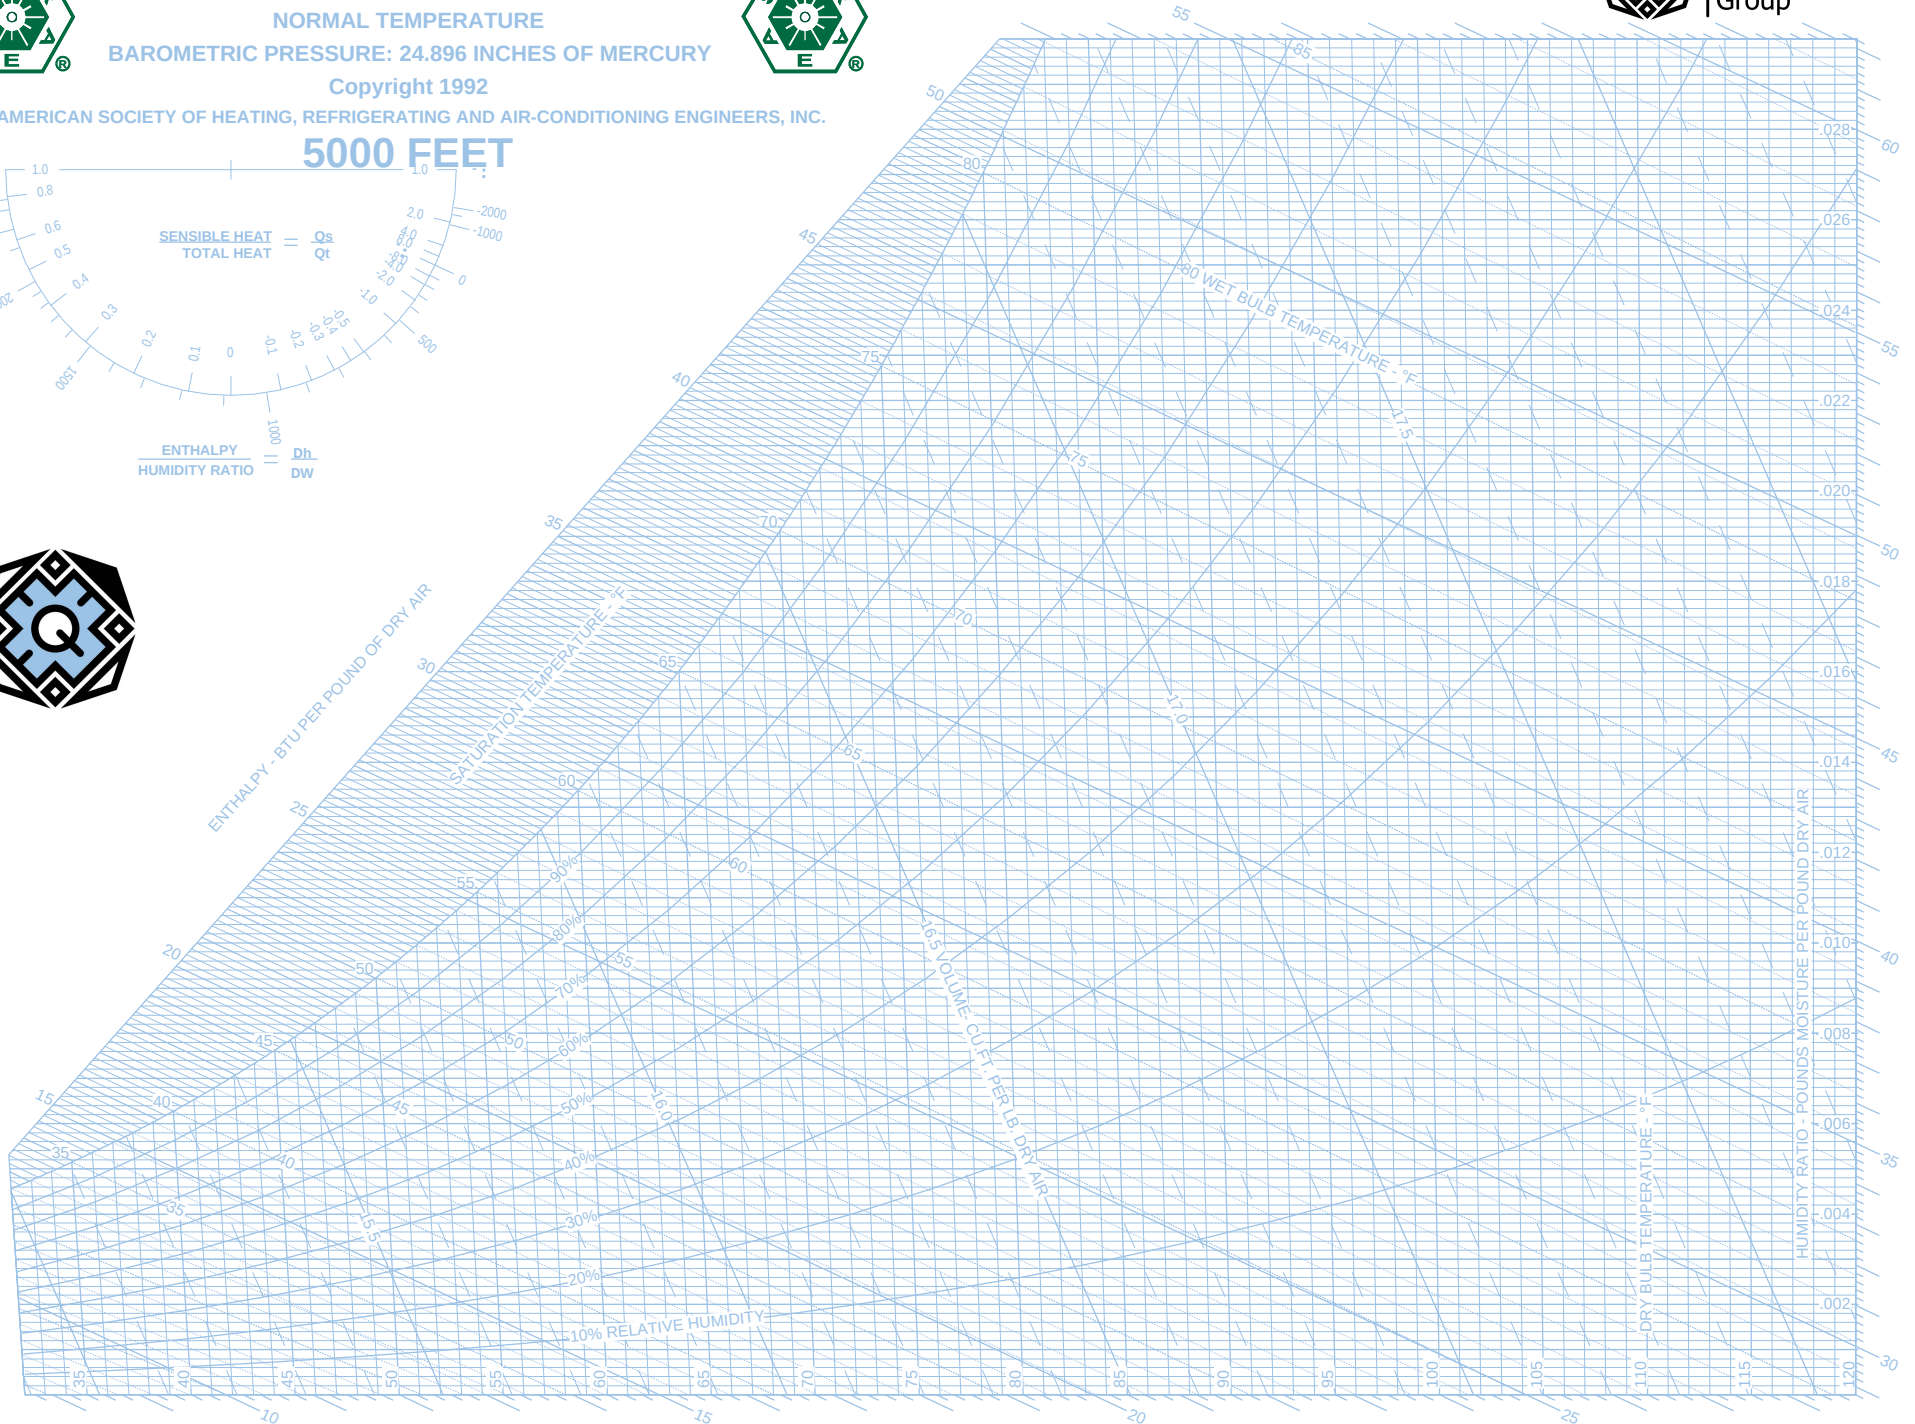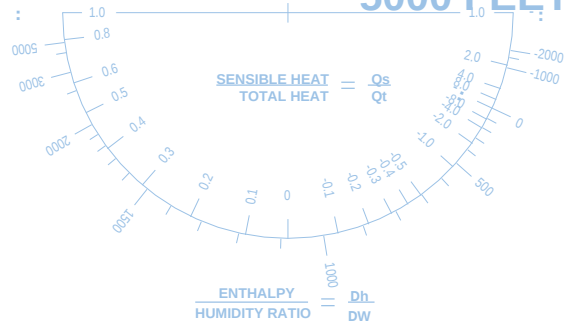

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.5

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 22.653 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

7500 FEET

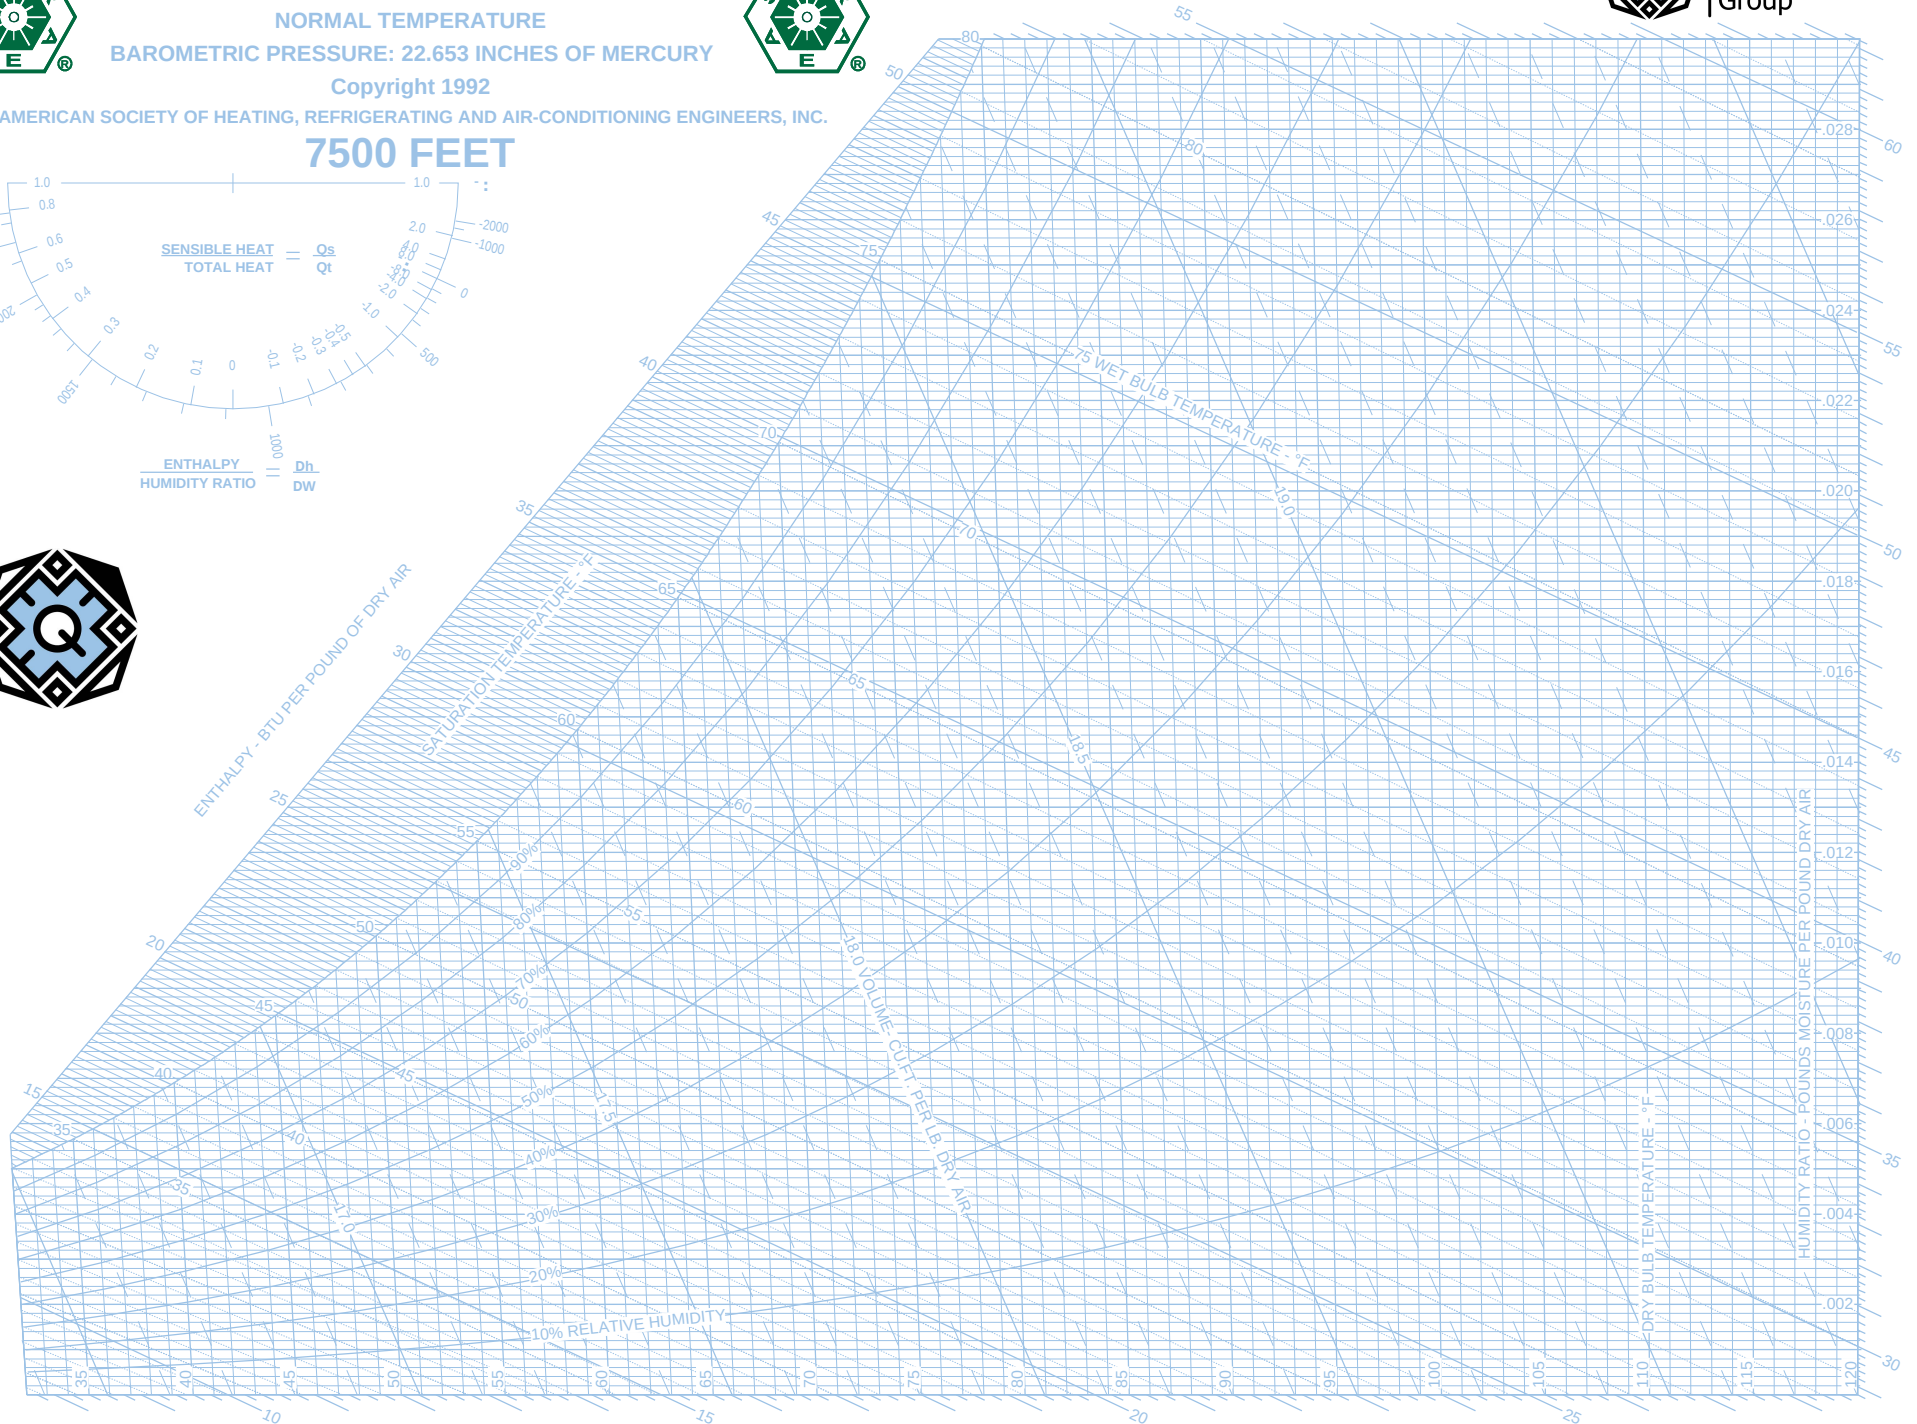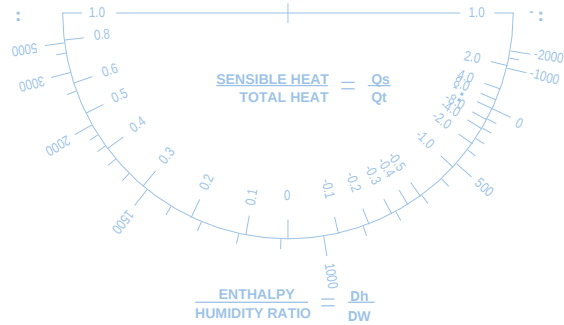

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.6

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 84.557 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

1500 METERS

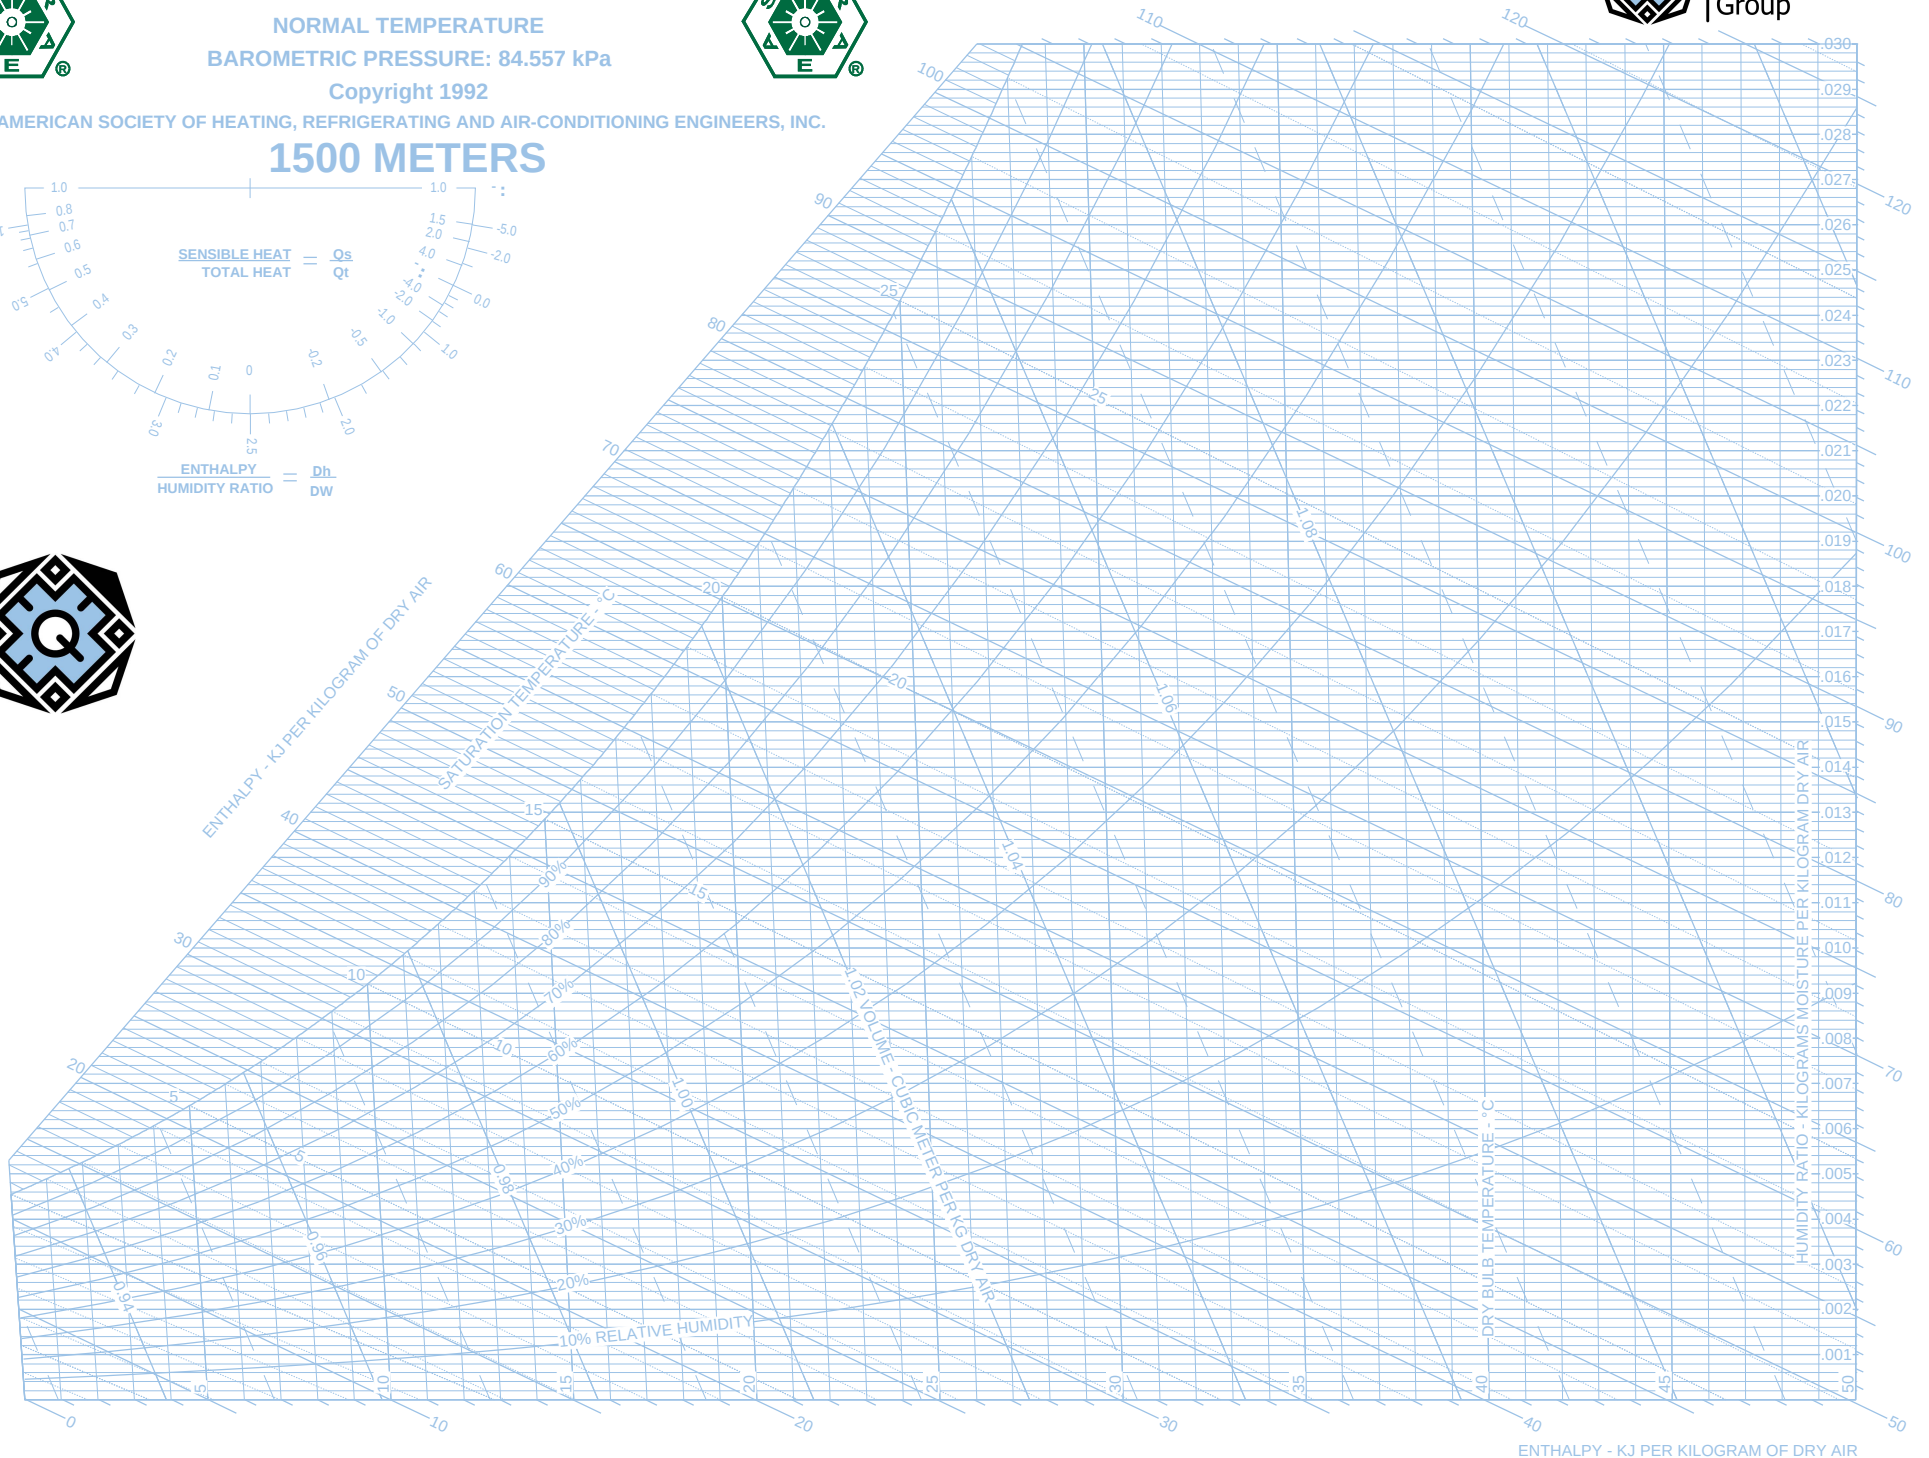



ASHRAE PSYCHROMETRIC CHART NO.7


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 77.062 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

2250 METERS

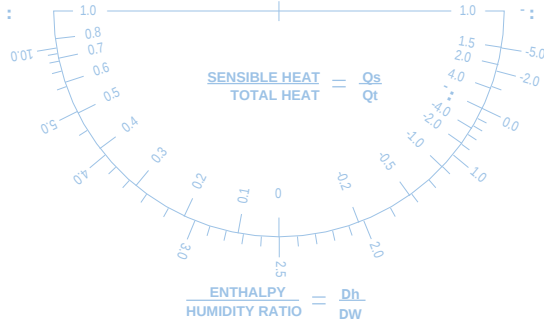

Quaternum
Solutions
Group

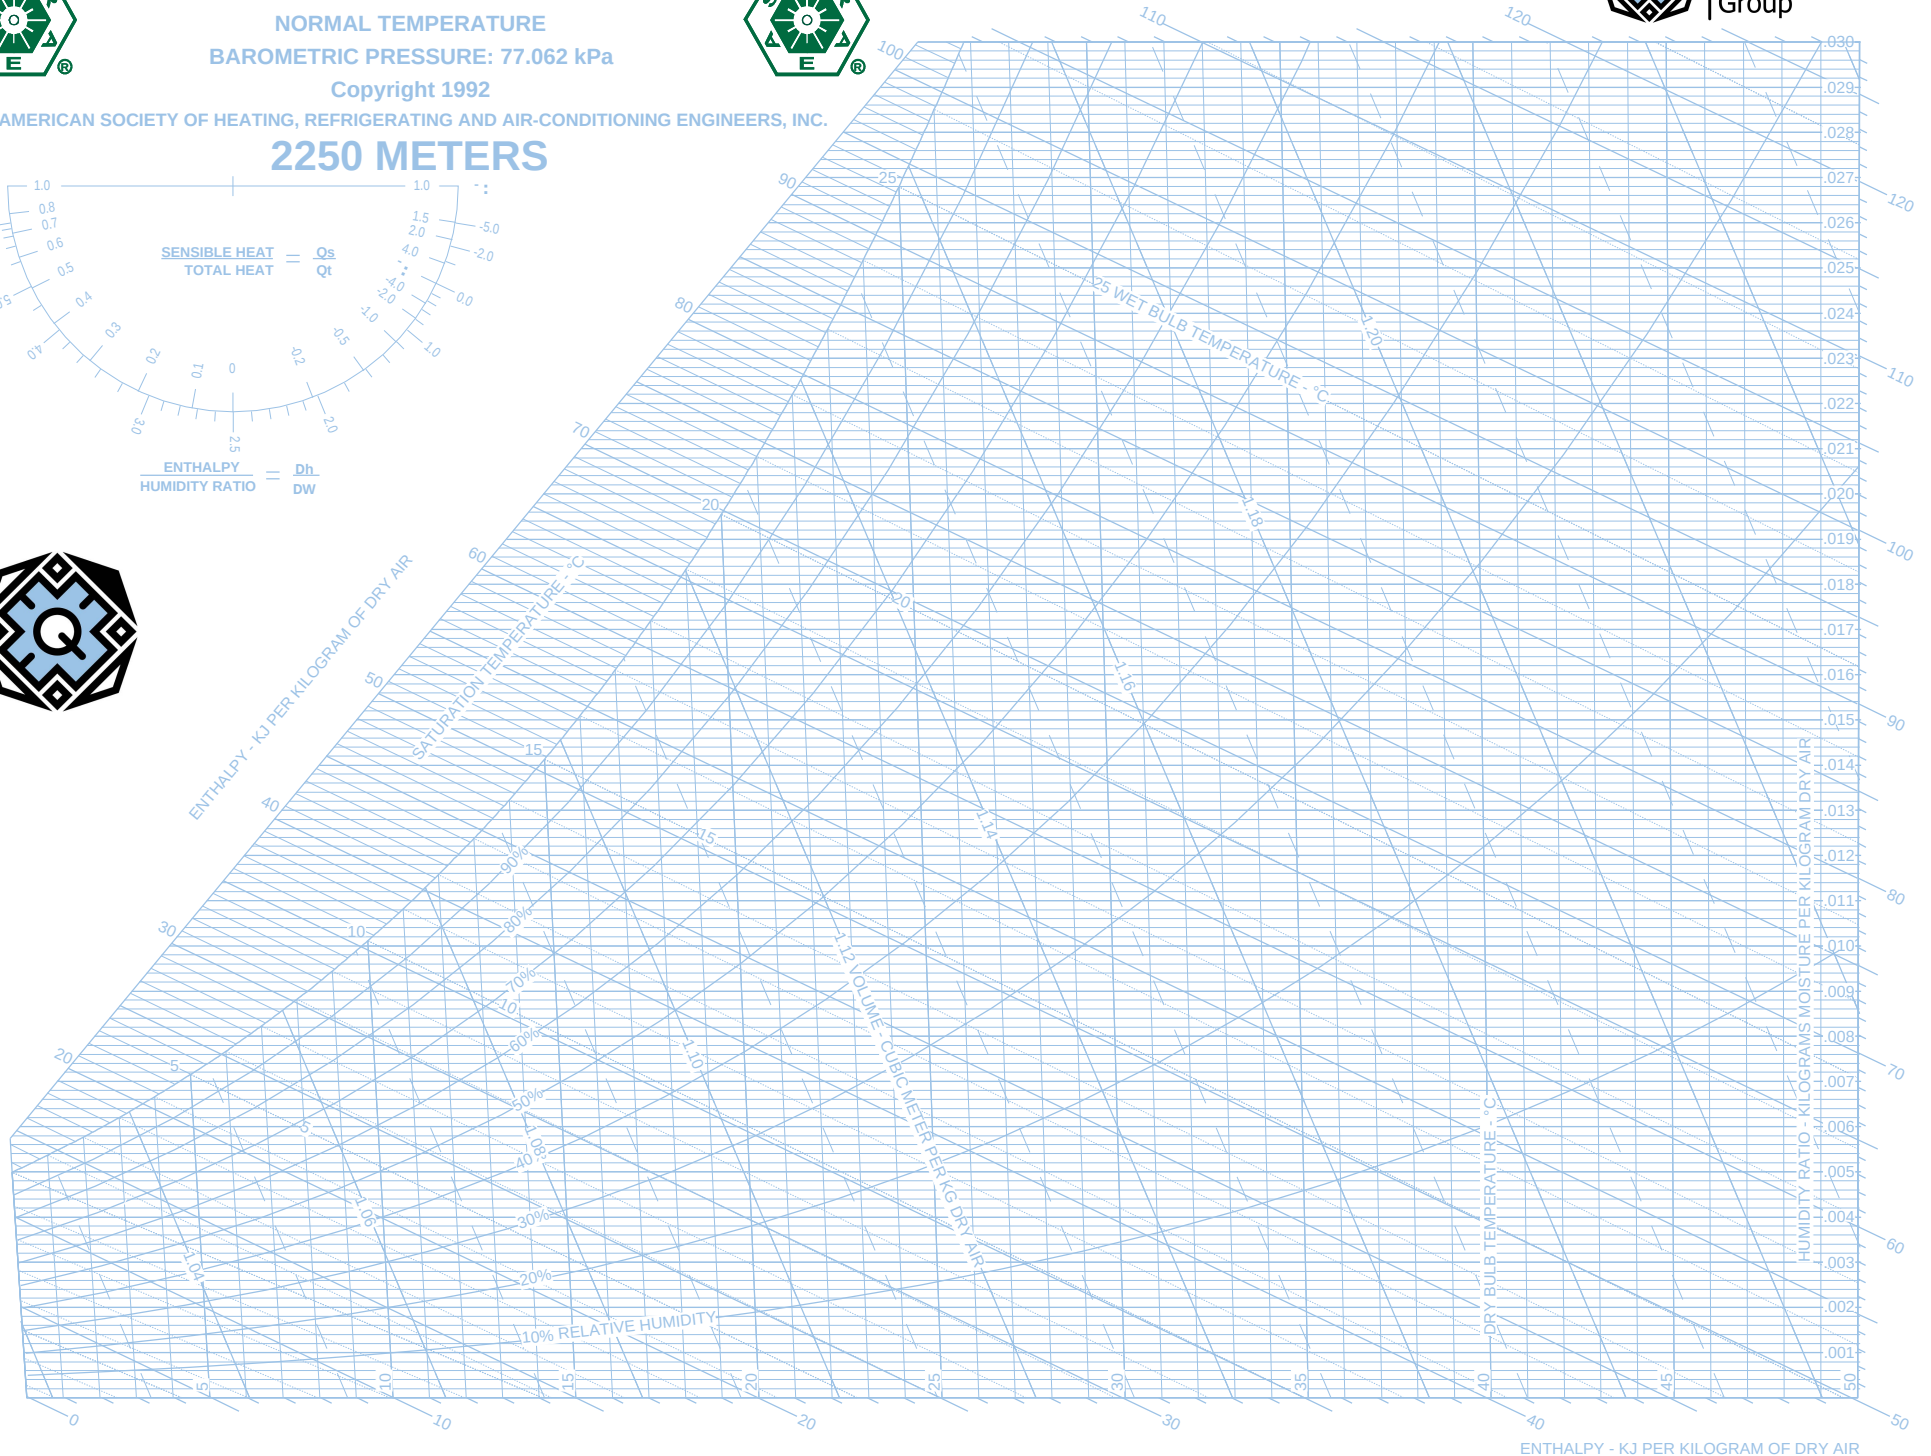



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 29.921 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL

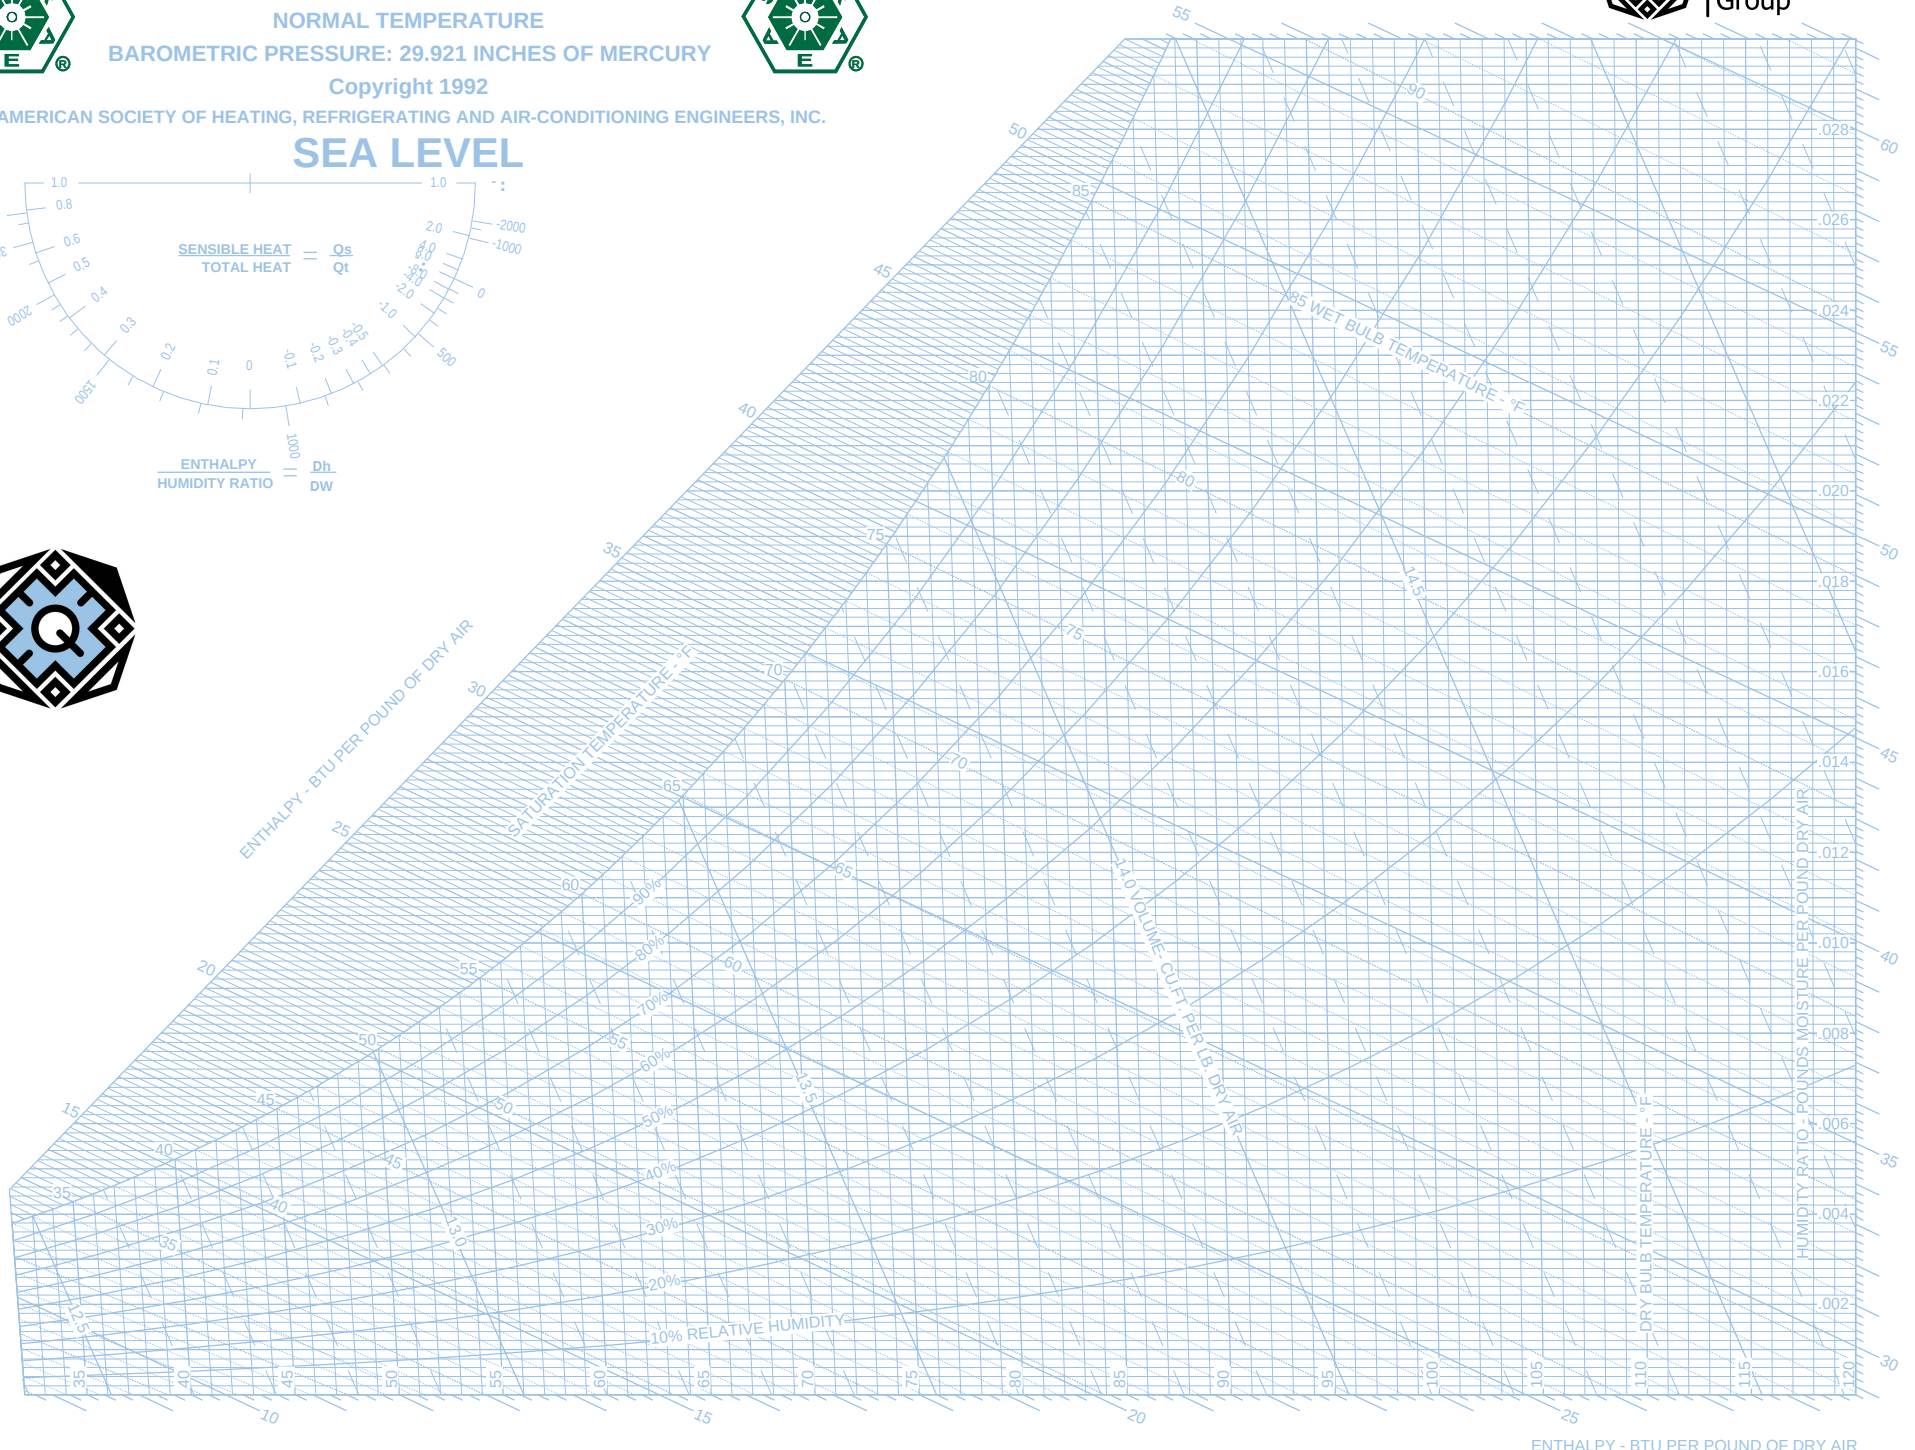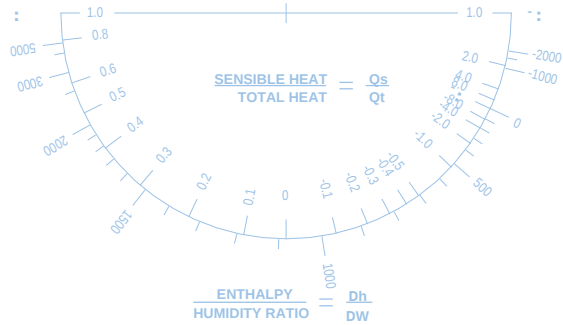



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 29.925 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

650 FEET

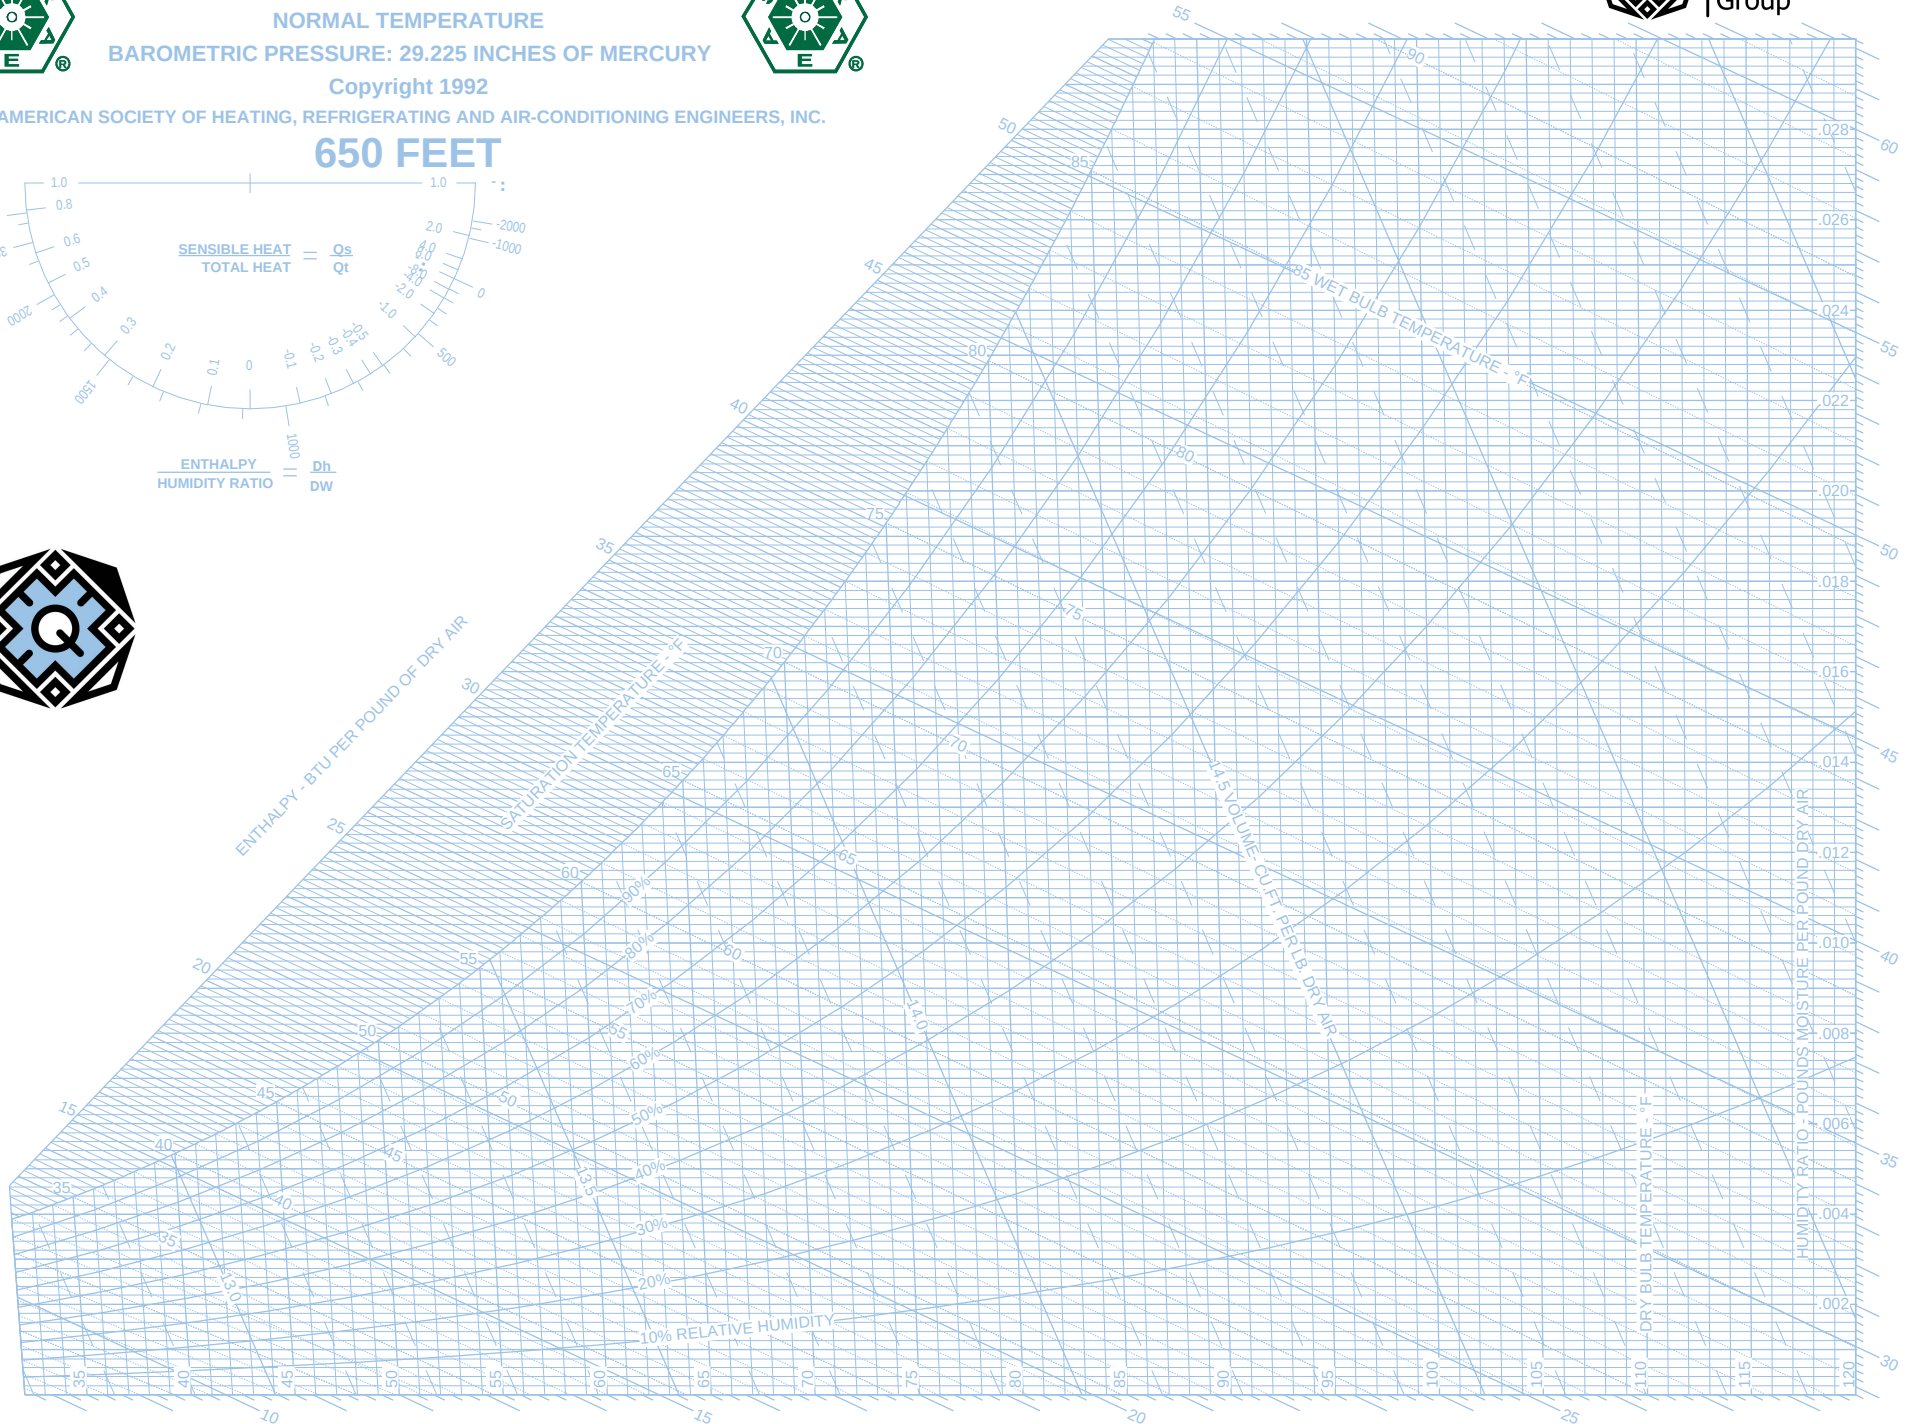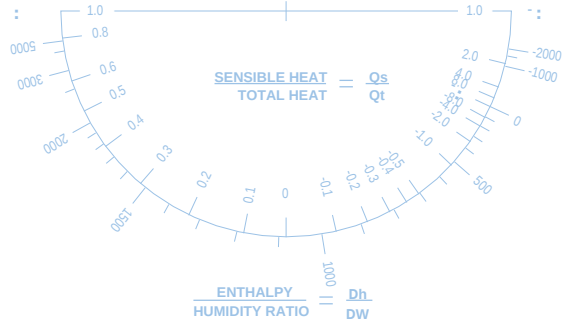

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 28.542 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

1300 FEET

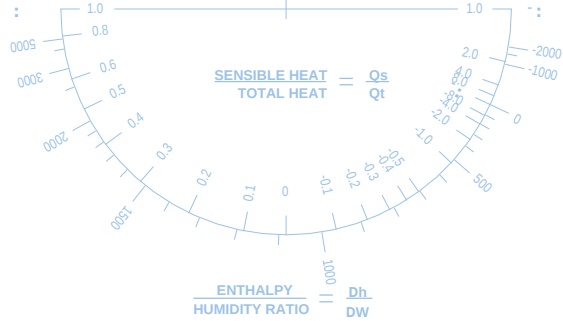

Quaternum
Solutions
Group

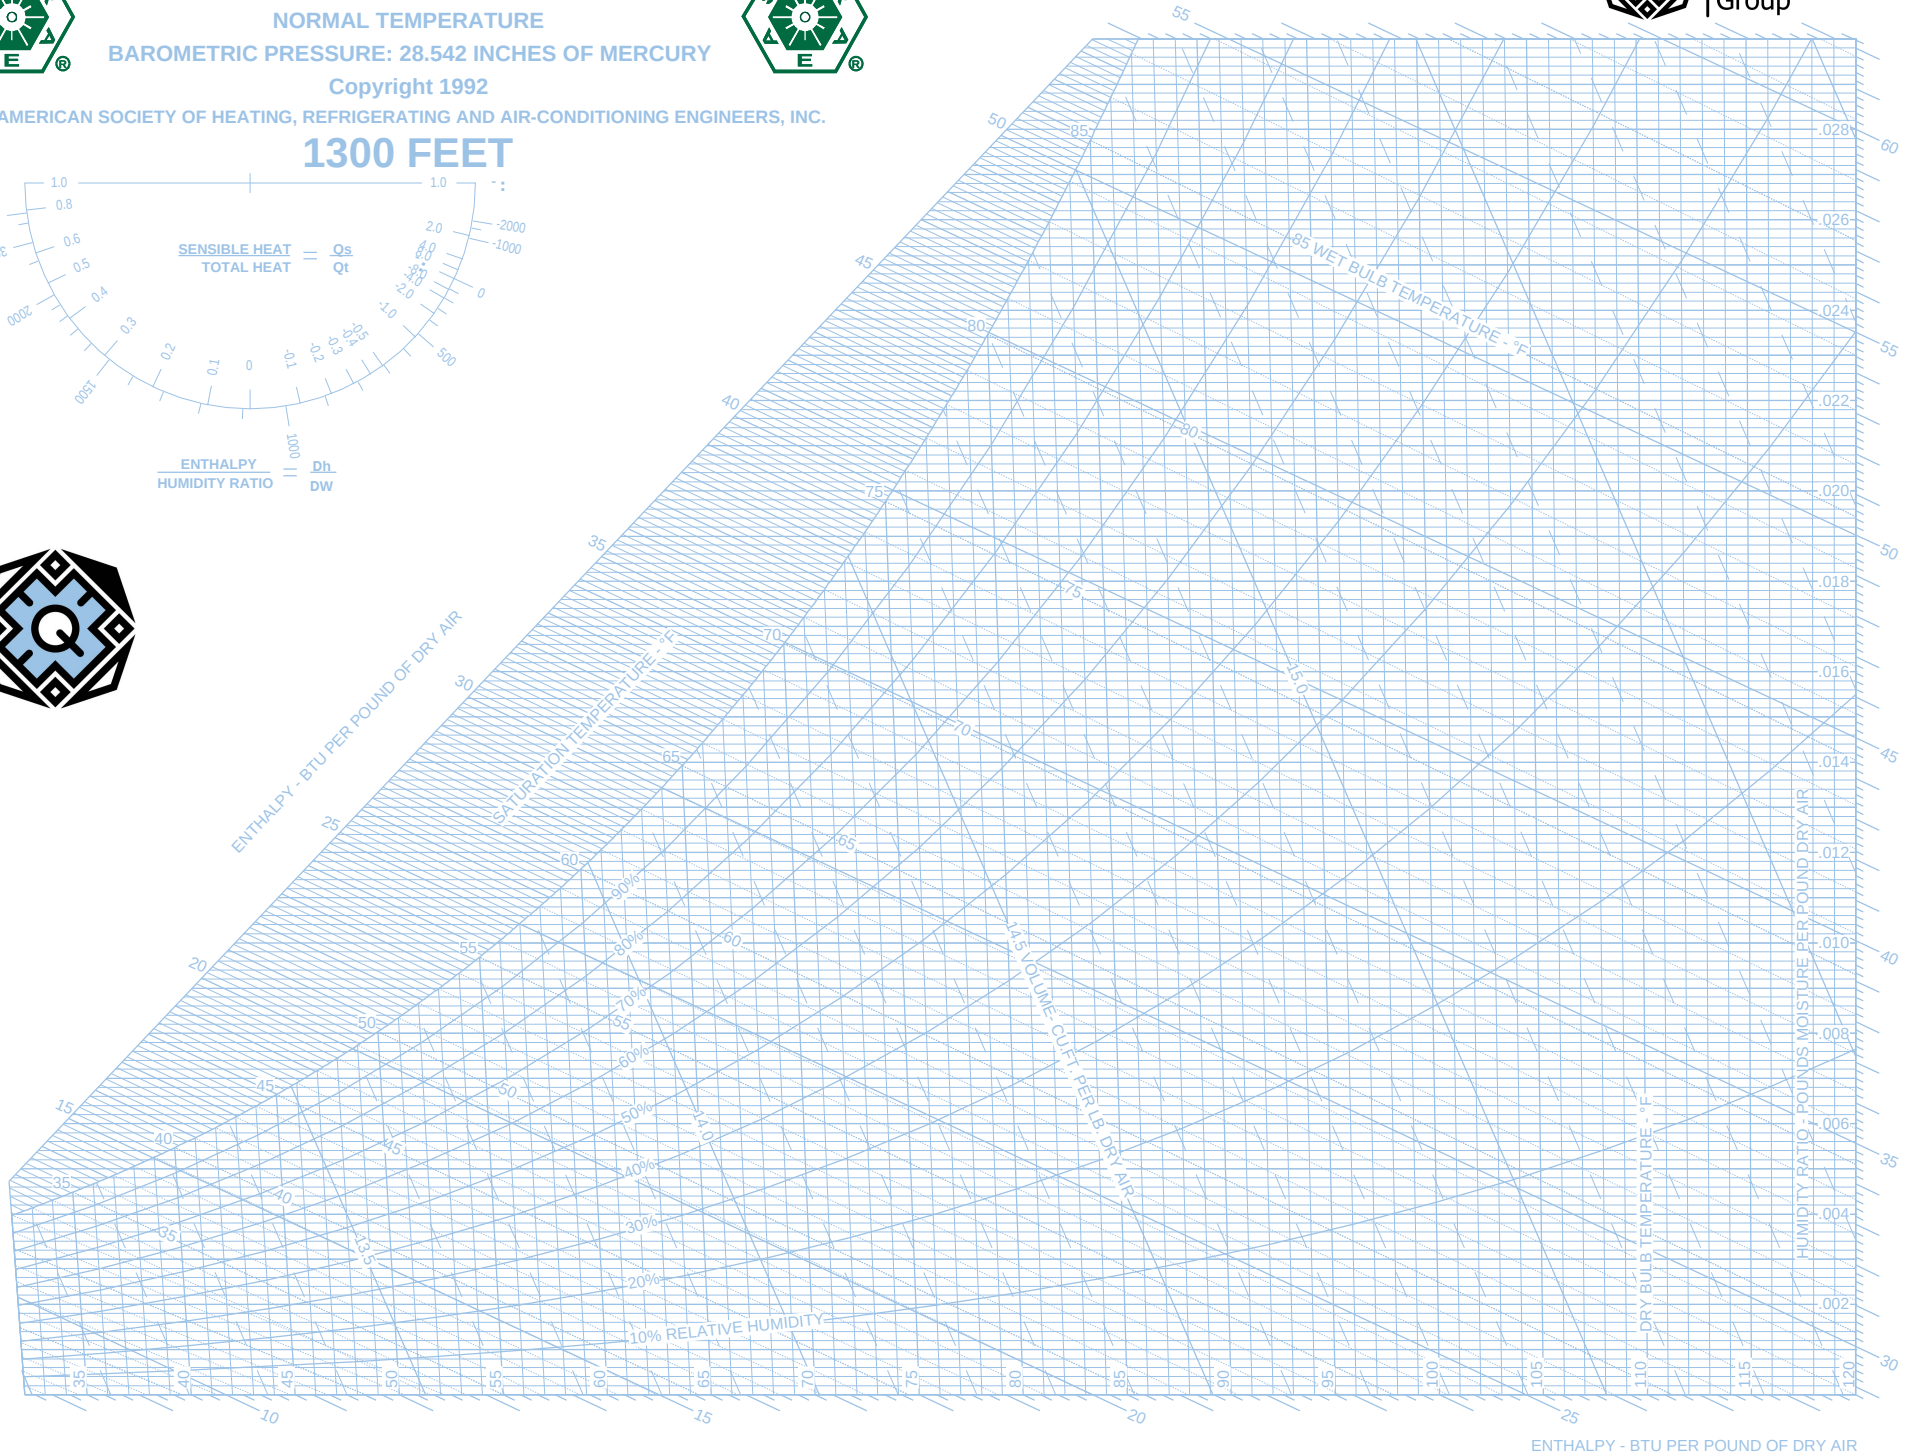



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 27.872 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

1950 FEET

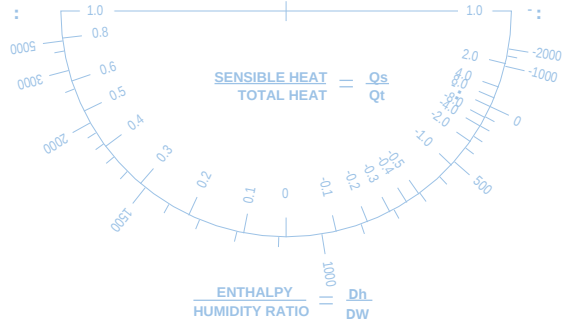

Quaternum
Solutions
Group

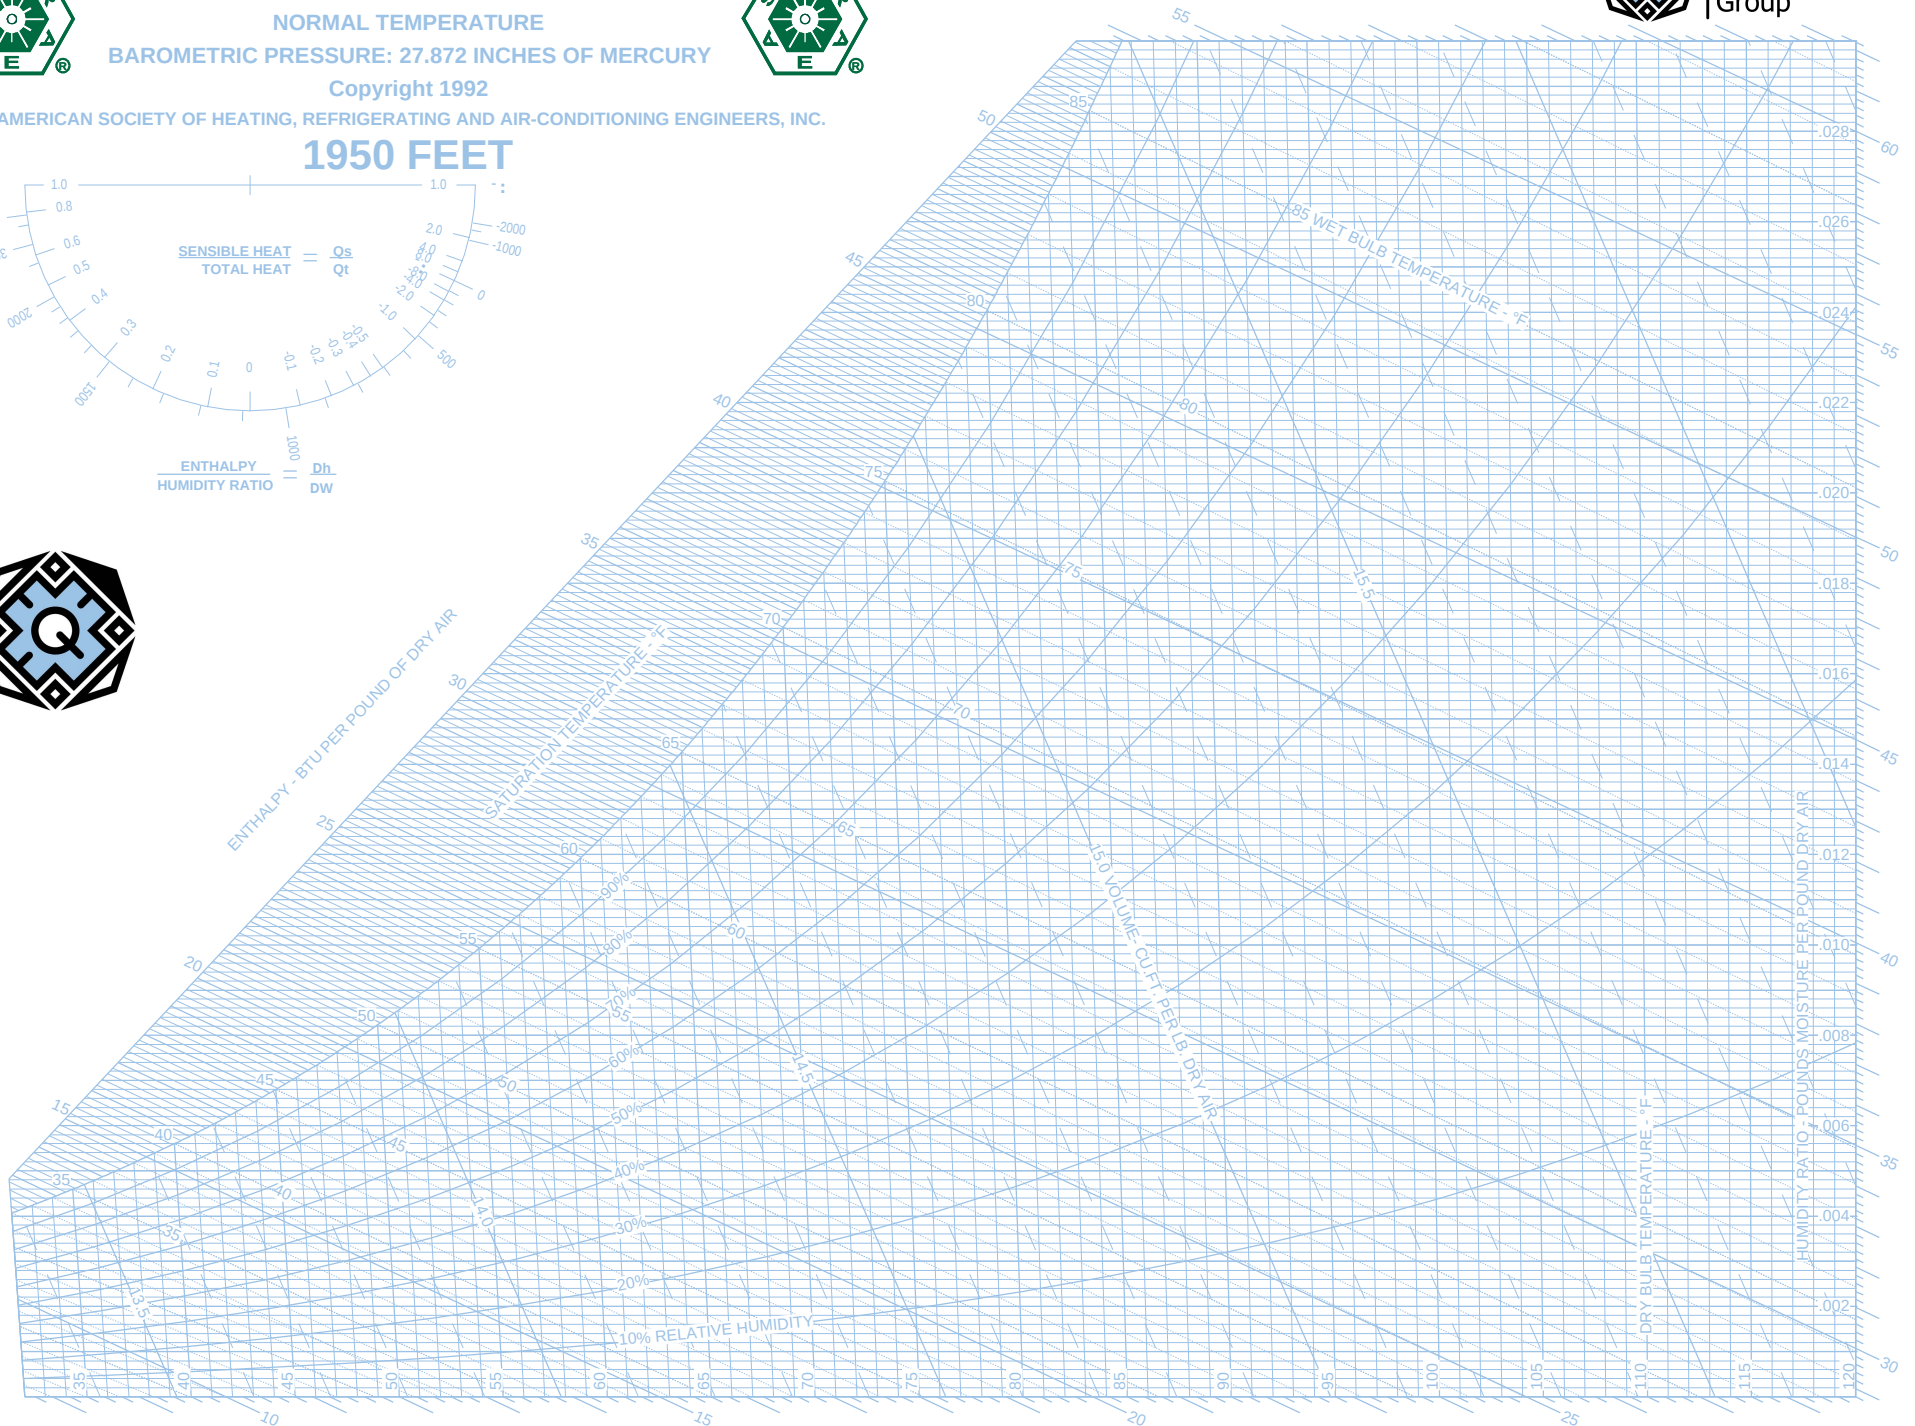

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 27.215 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

2600 FEET

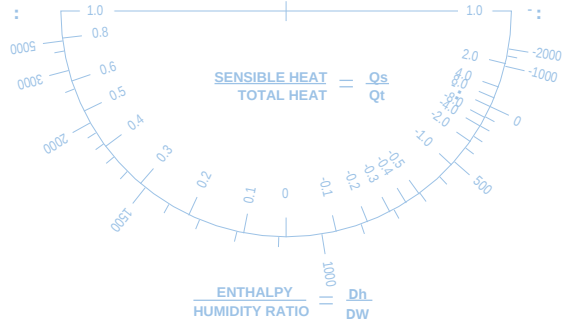

Quaternum
Solutions
Group

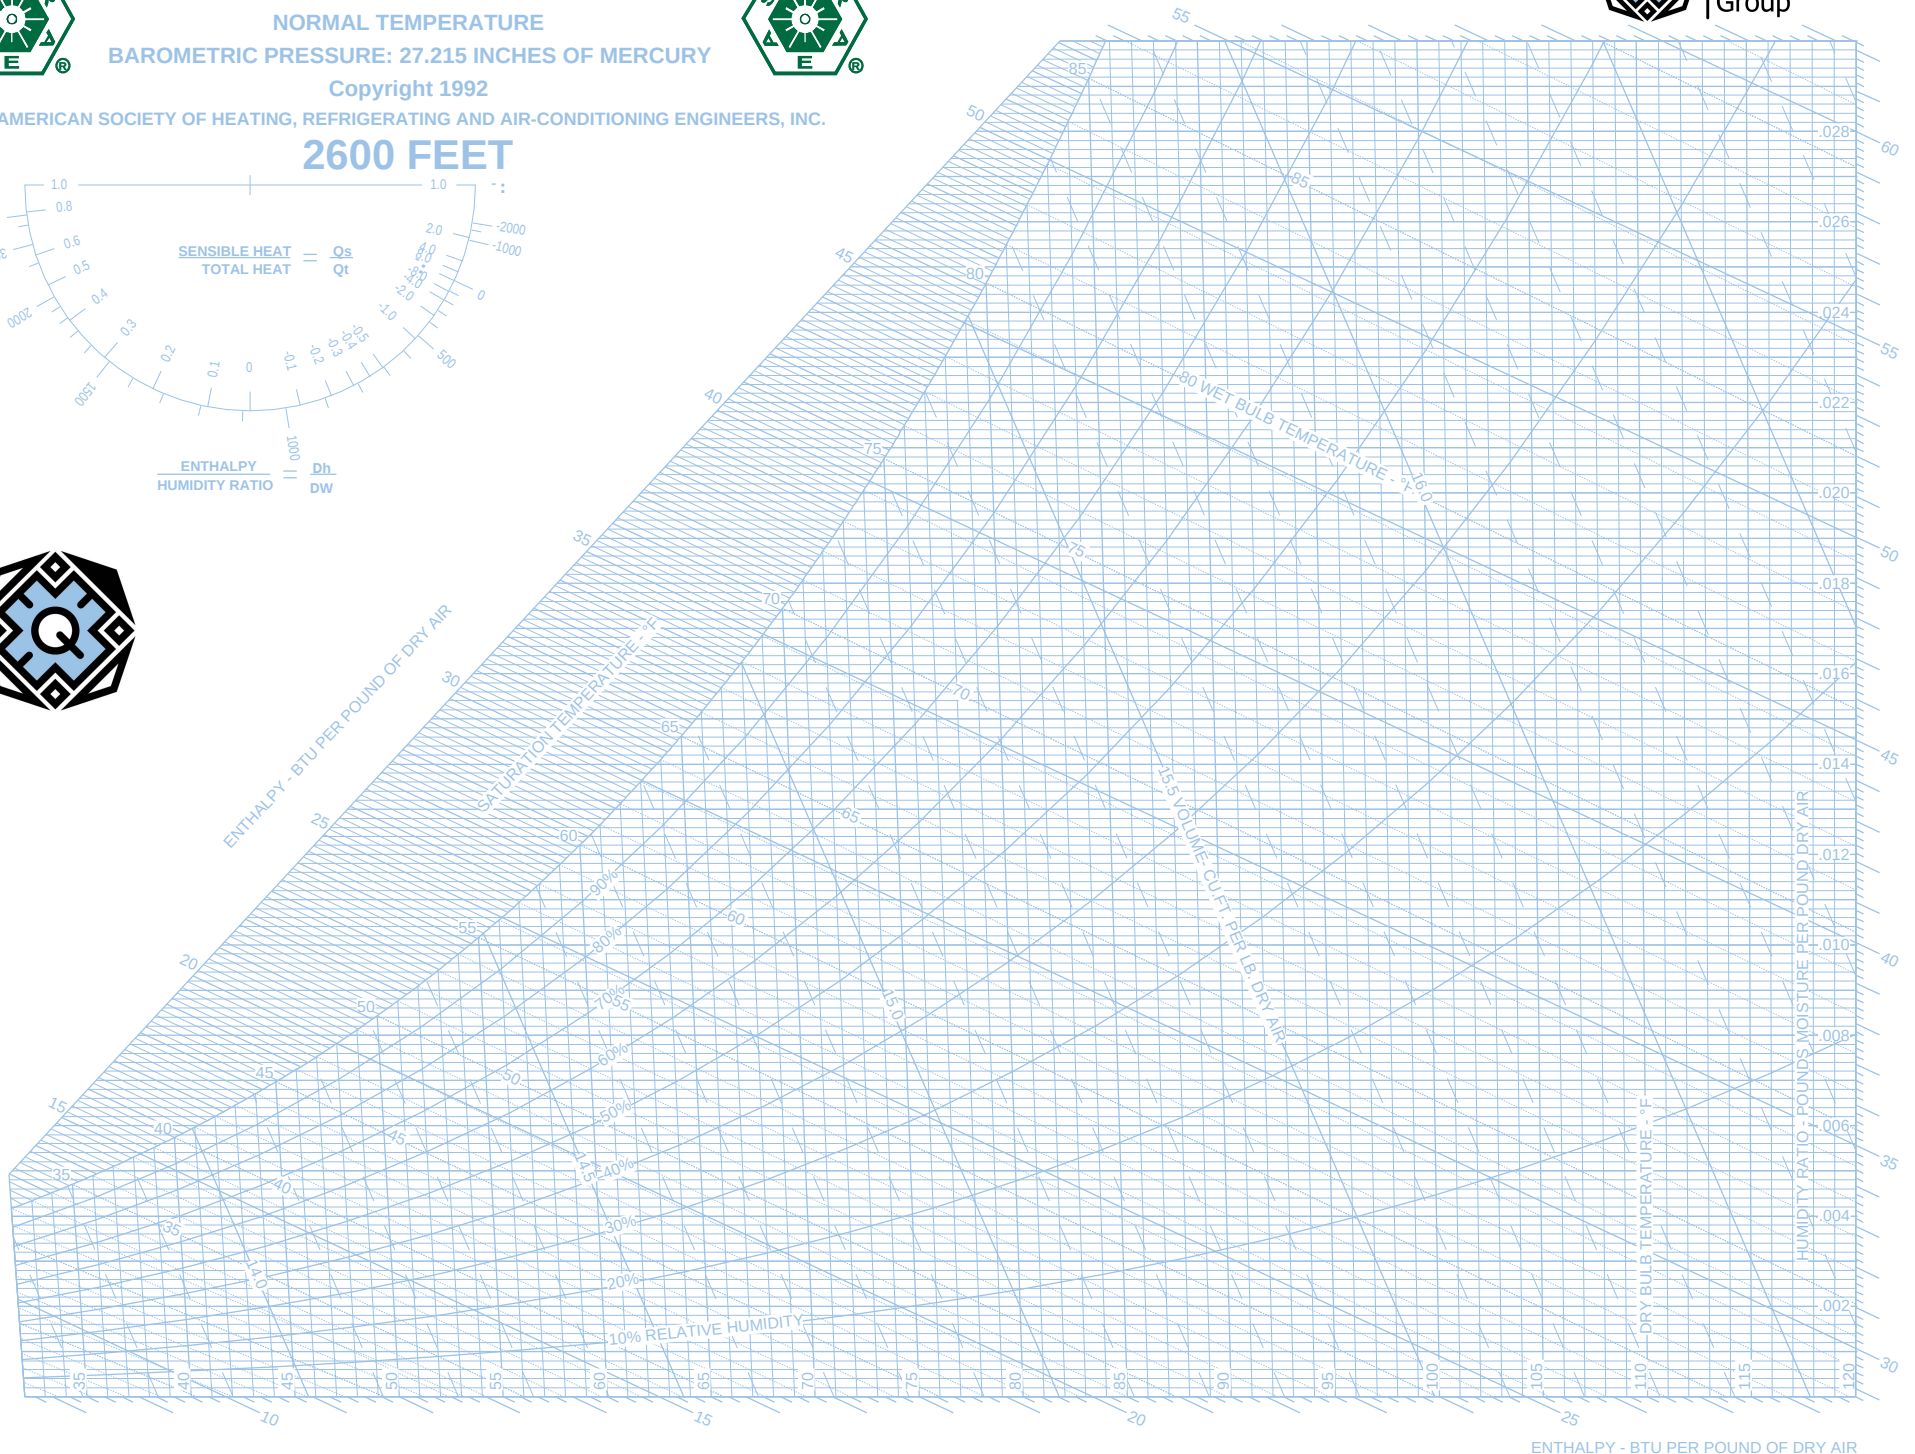



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 26.570 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

3250 FEET

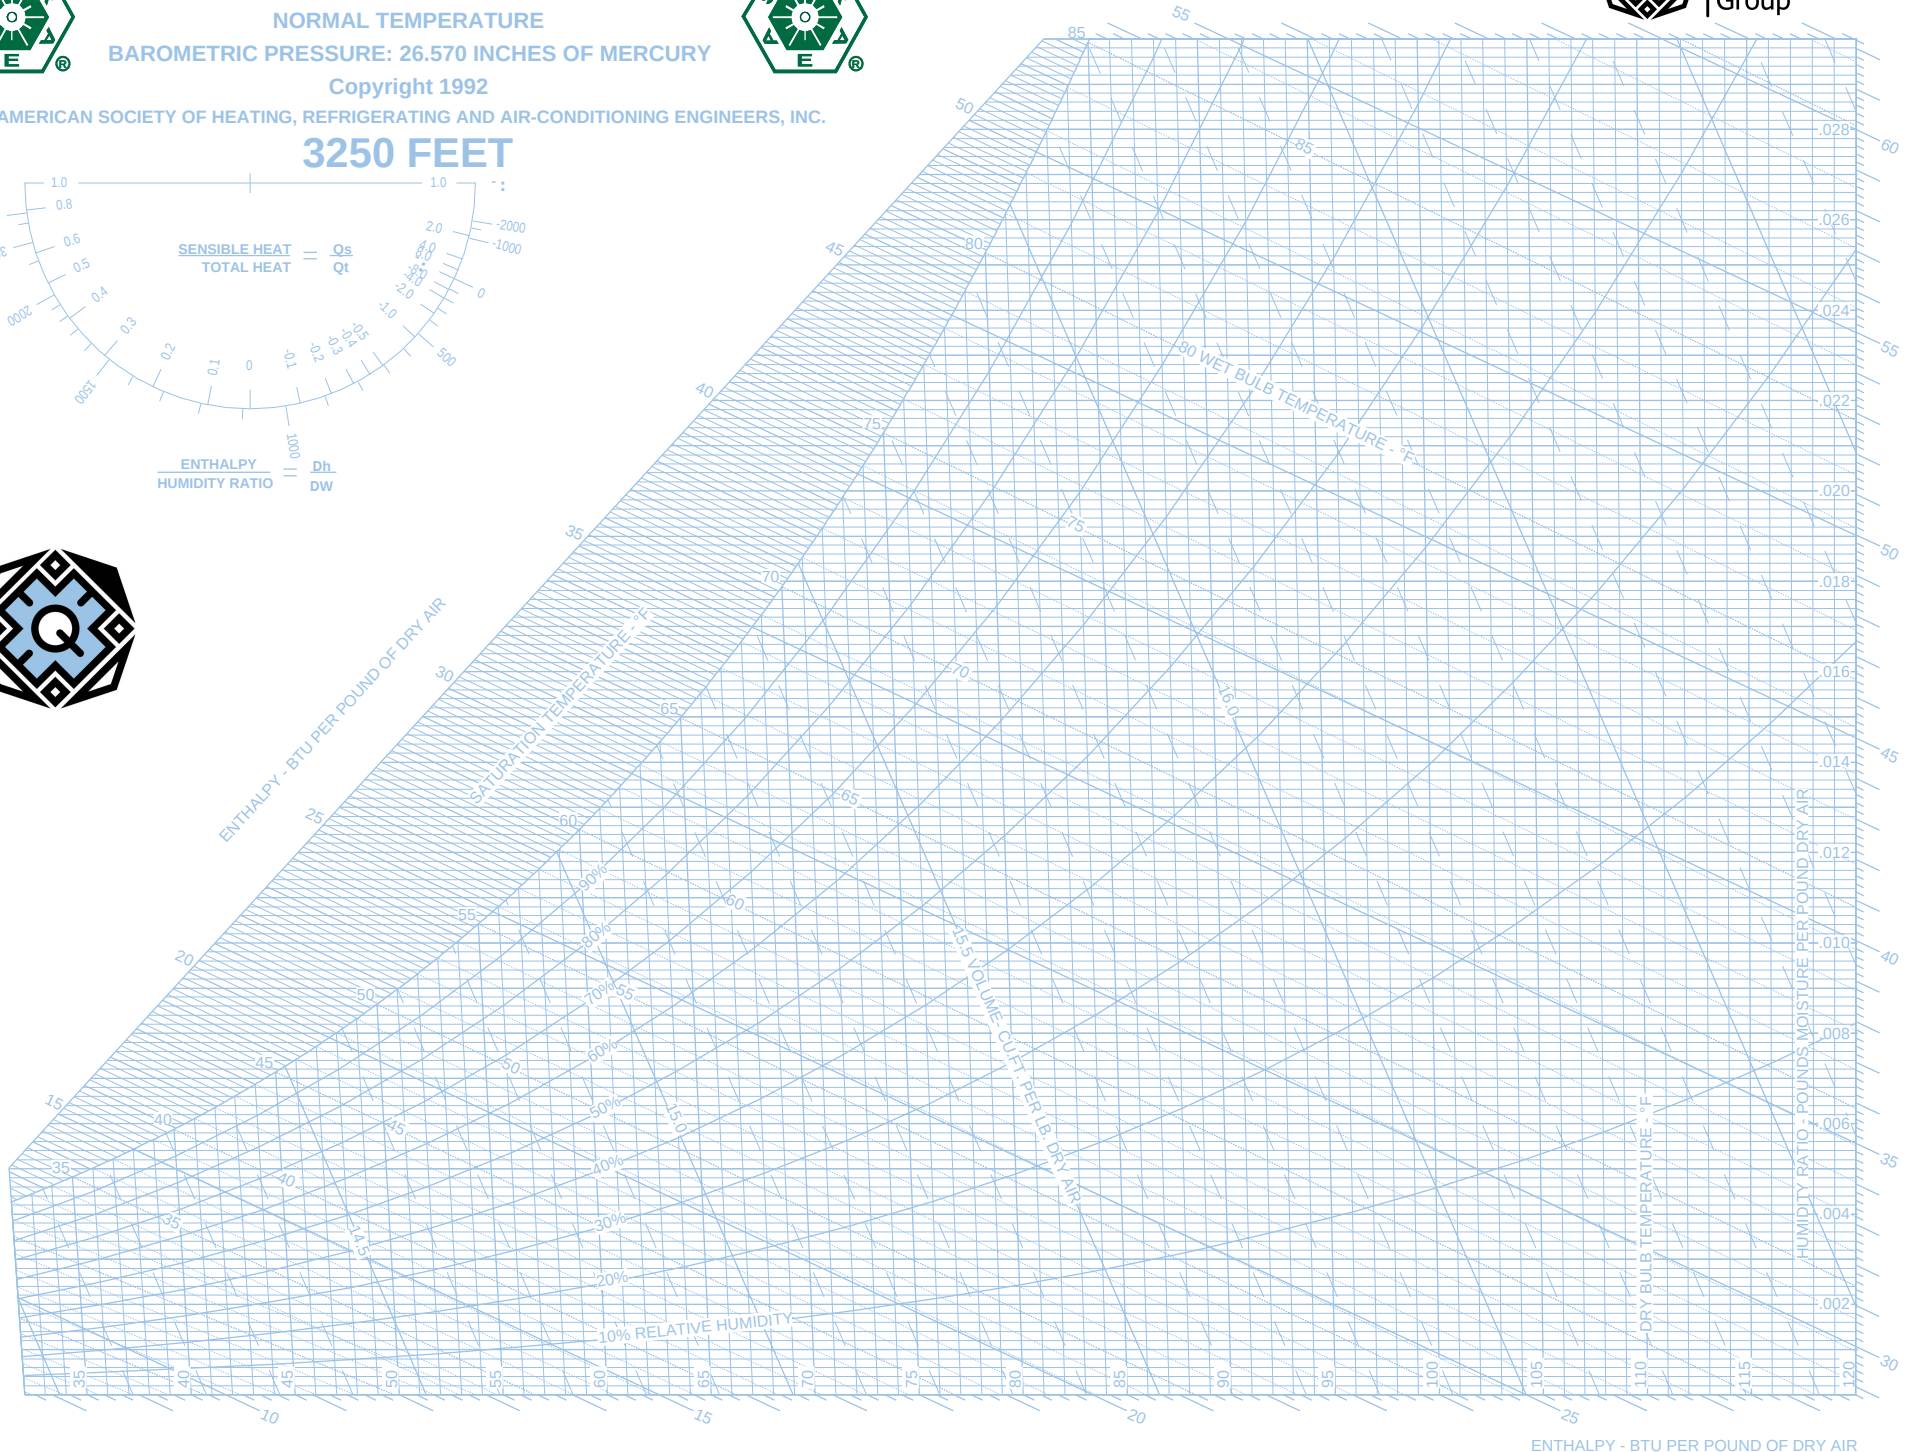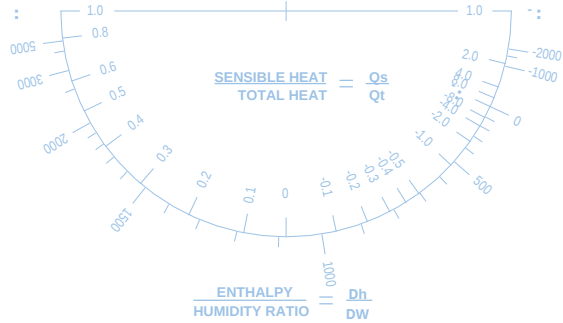

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 25.938 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

3900 FEET

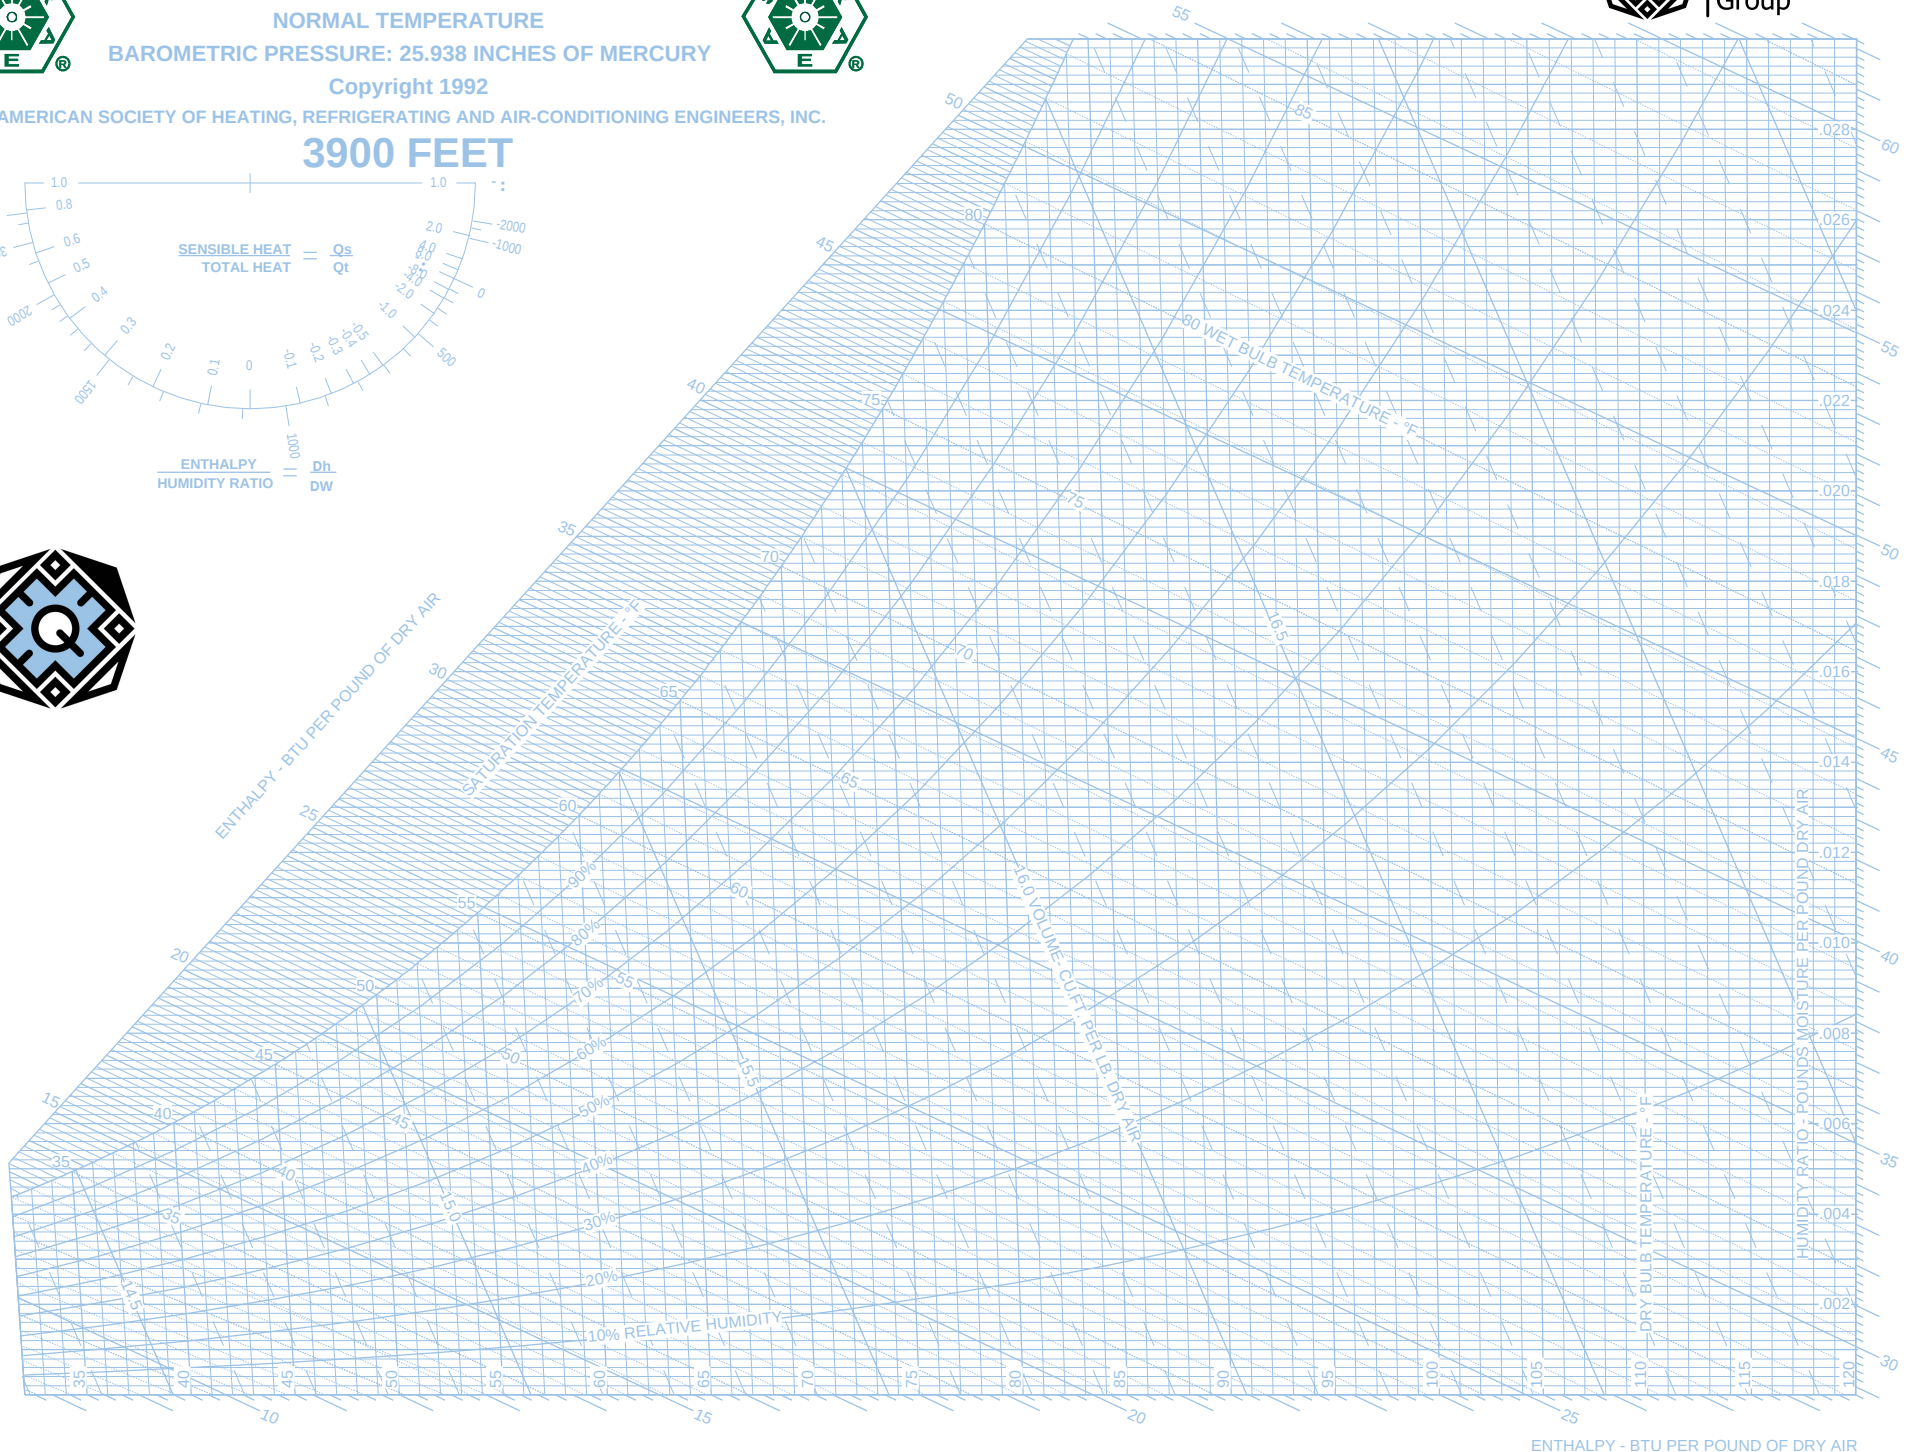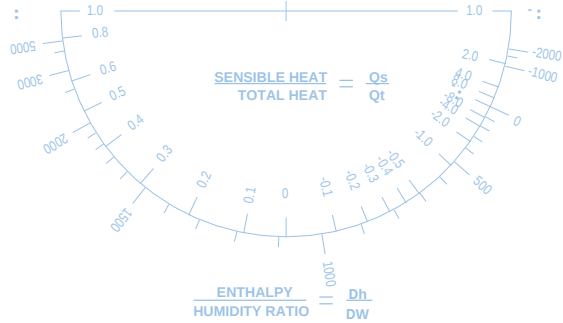

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 25.318 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

4550 FEET

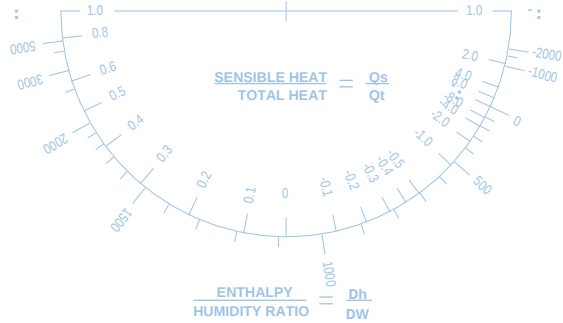

Quaternum
Solutions
Group

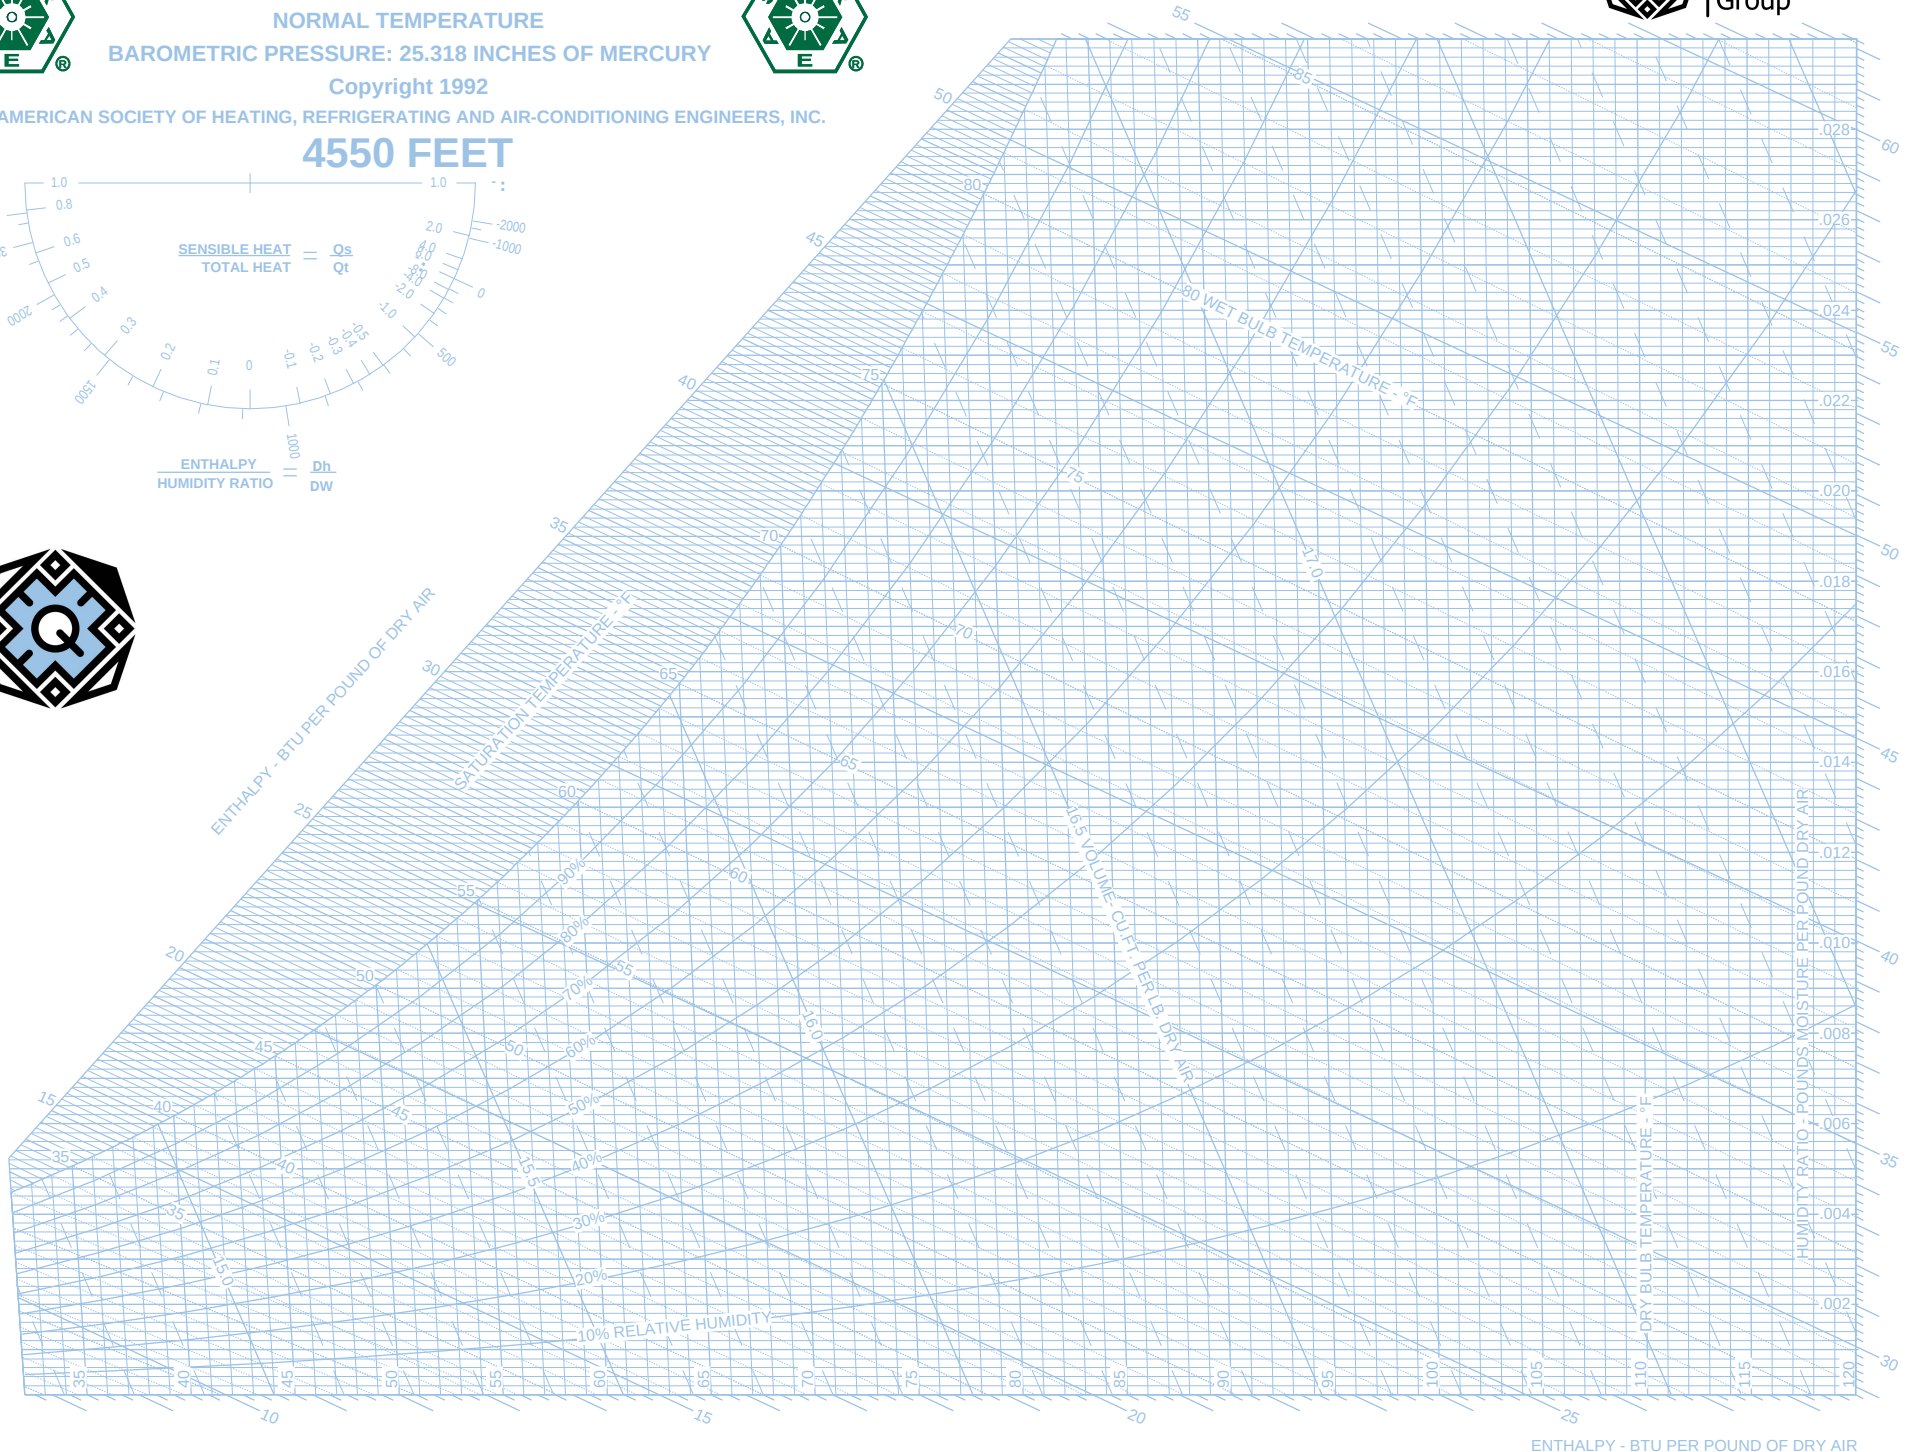



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 24.710 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

5200 FEET

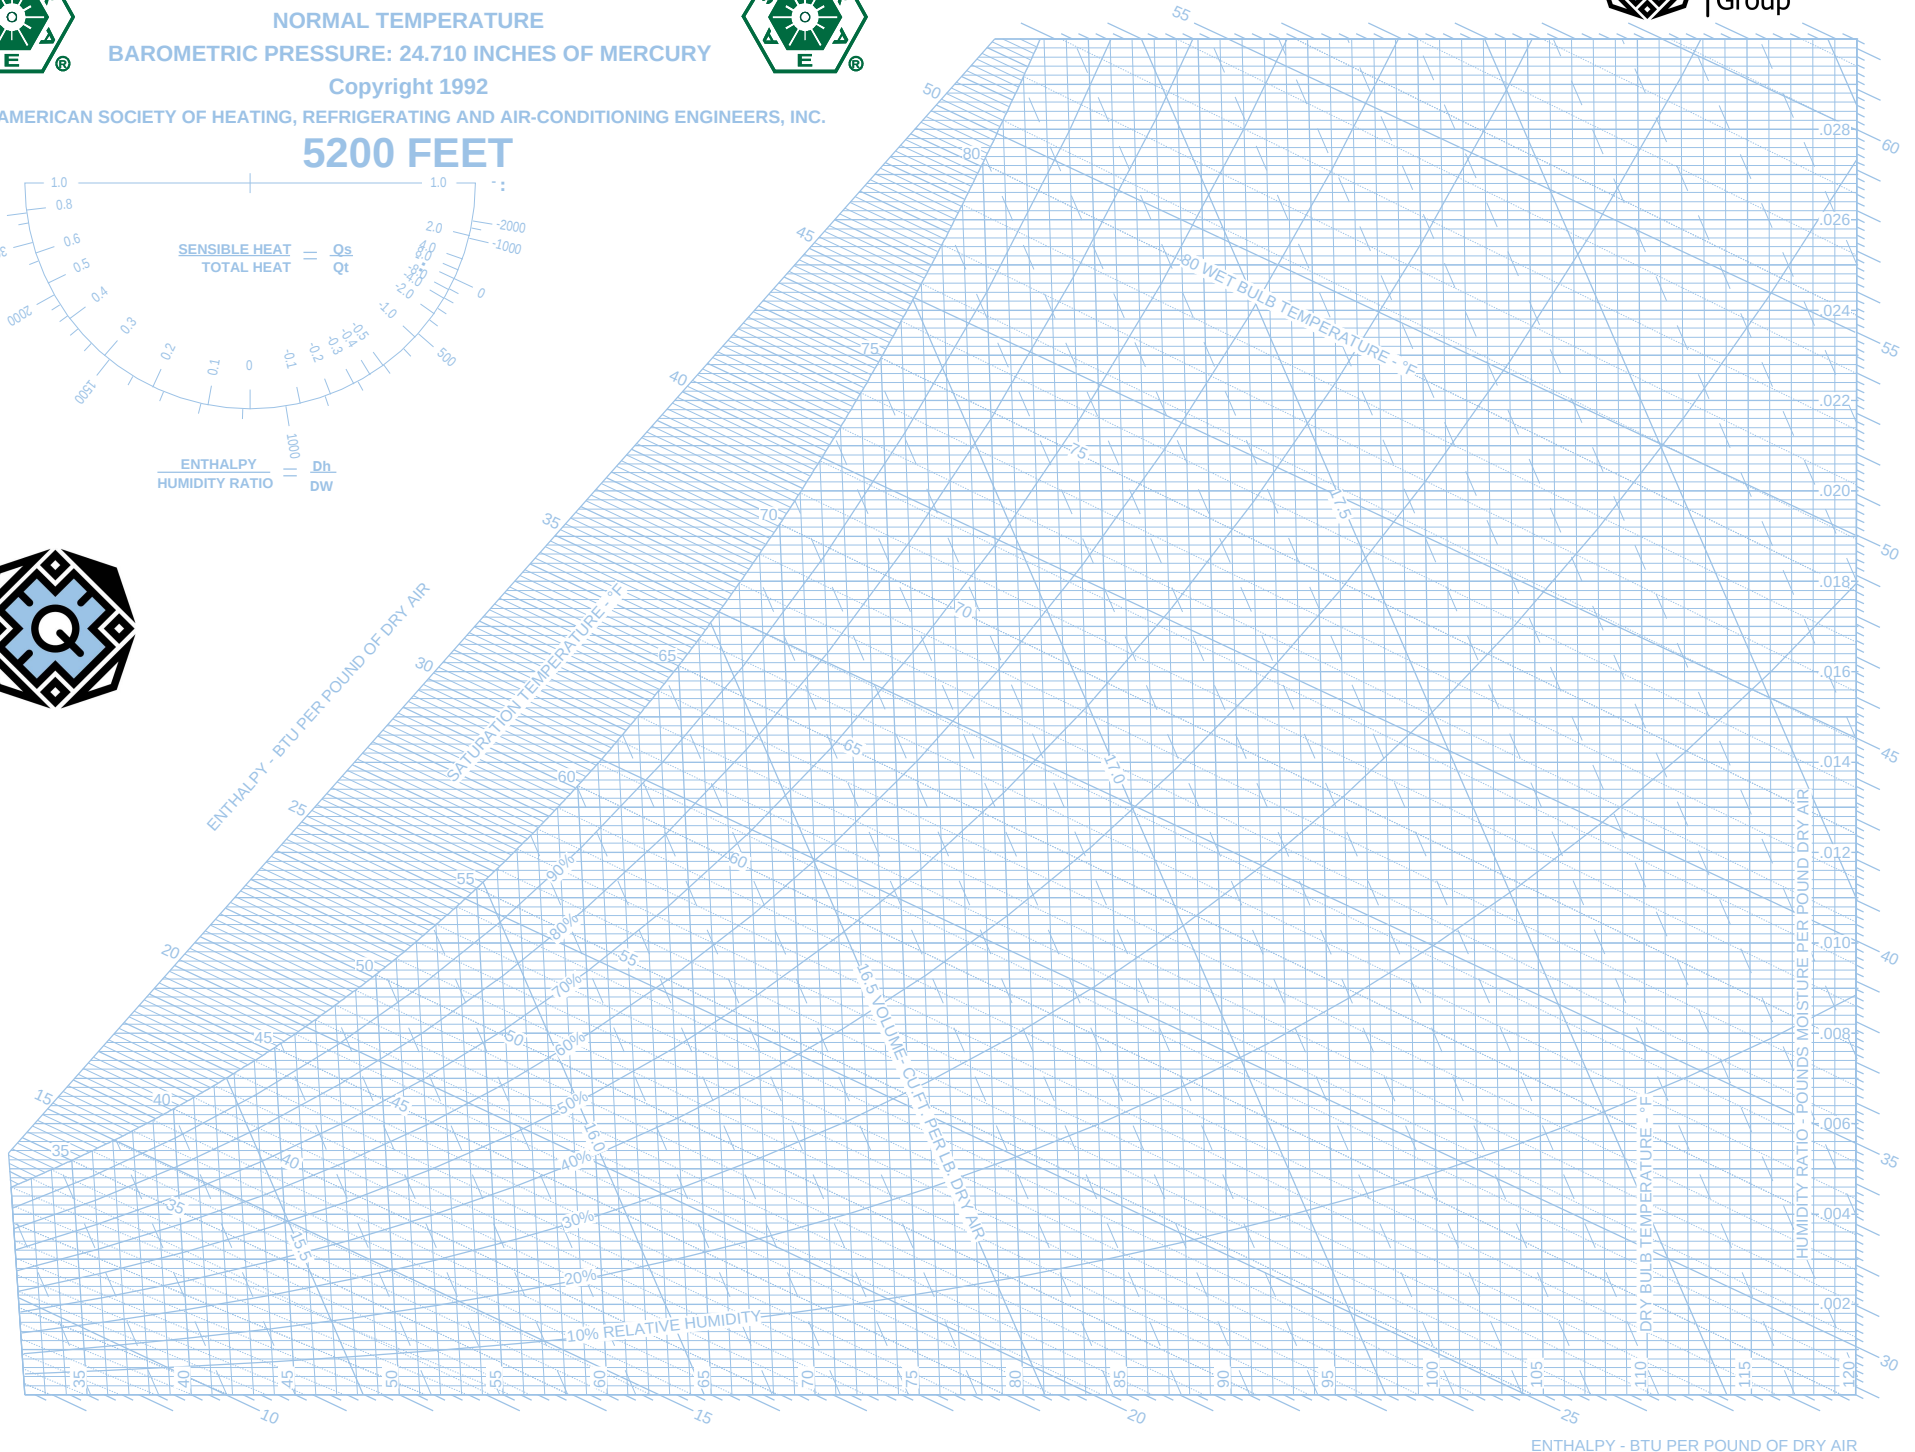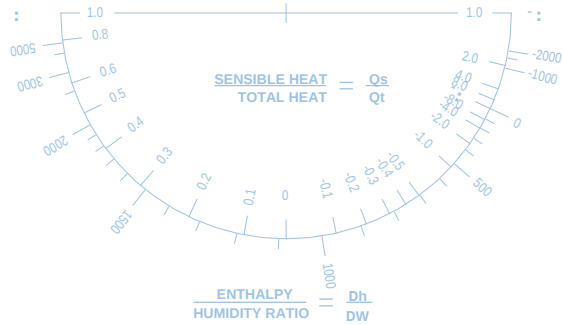



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 24.114 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

5850 FEET

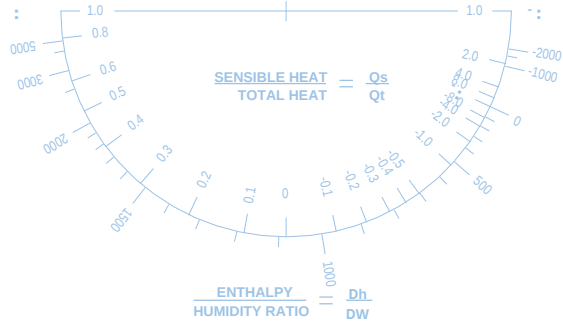

Quaternum
Solutions
Group

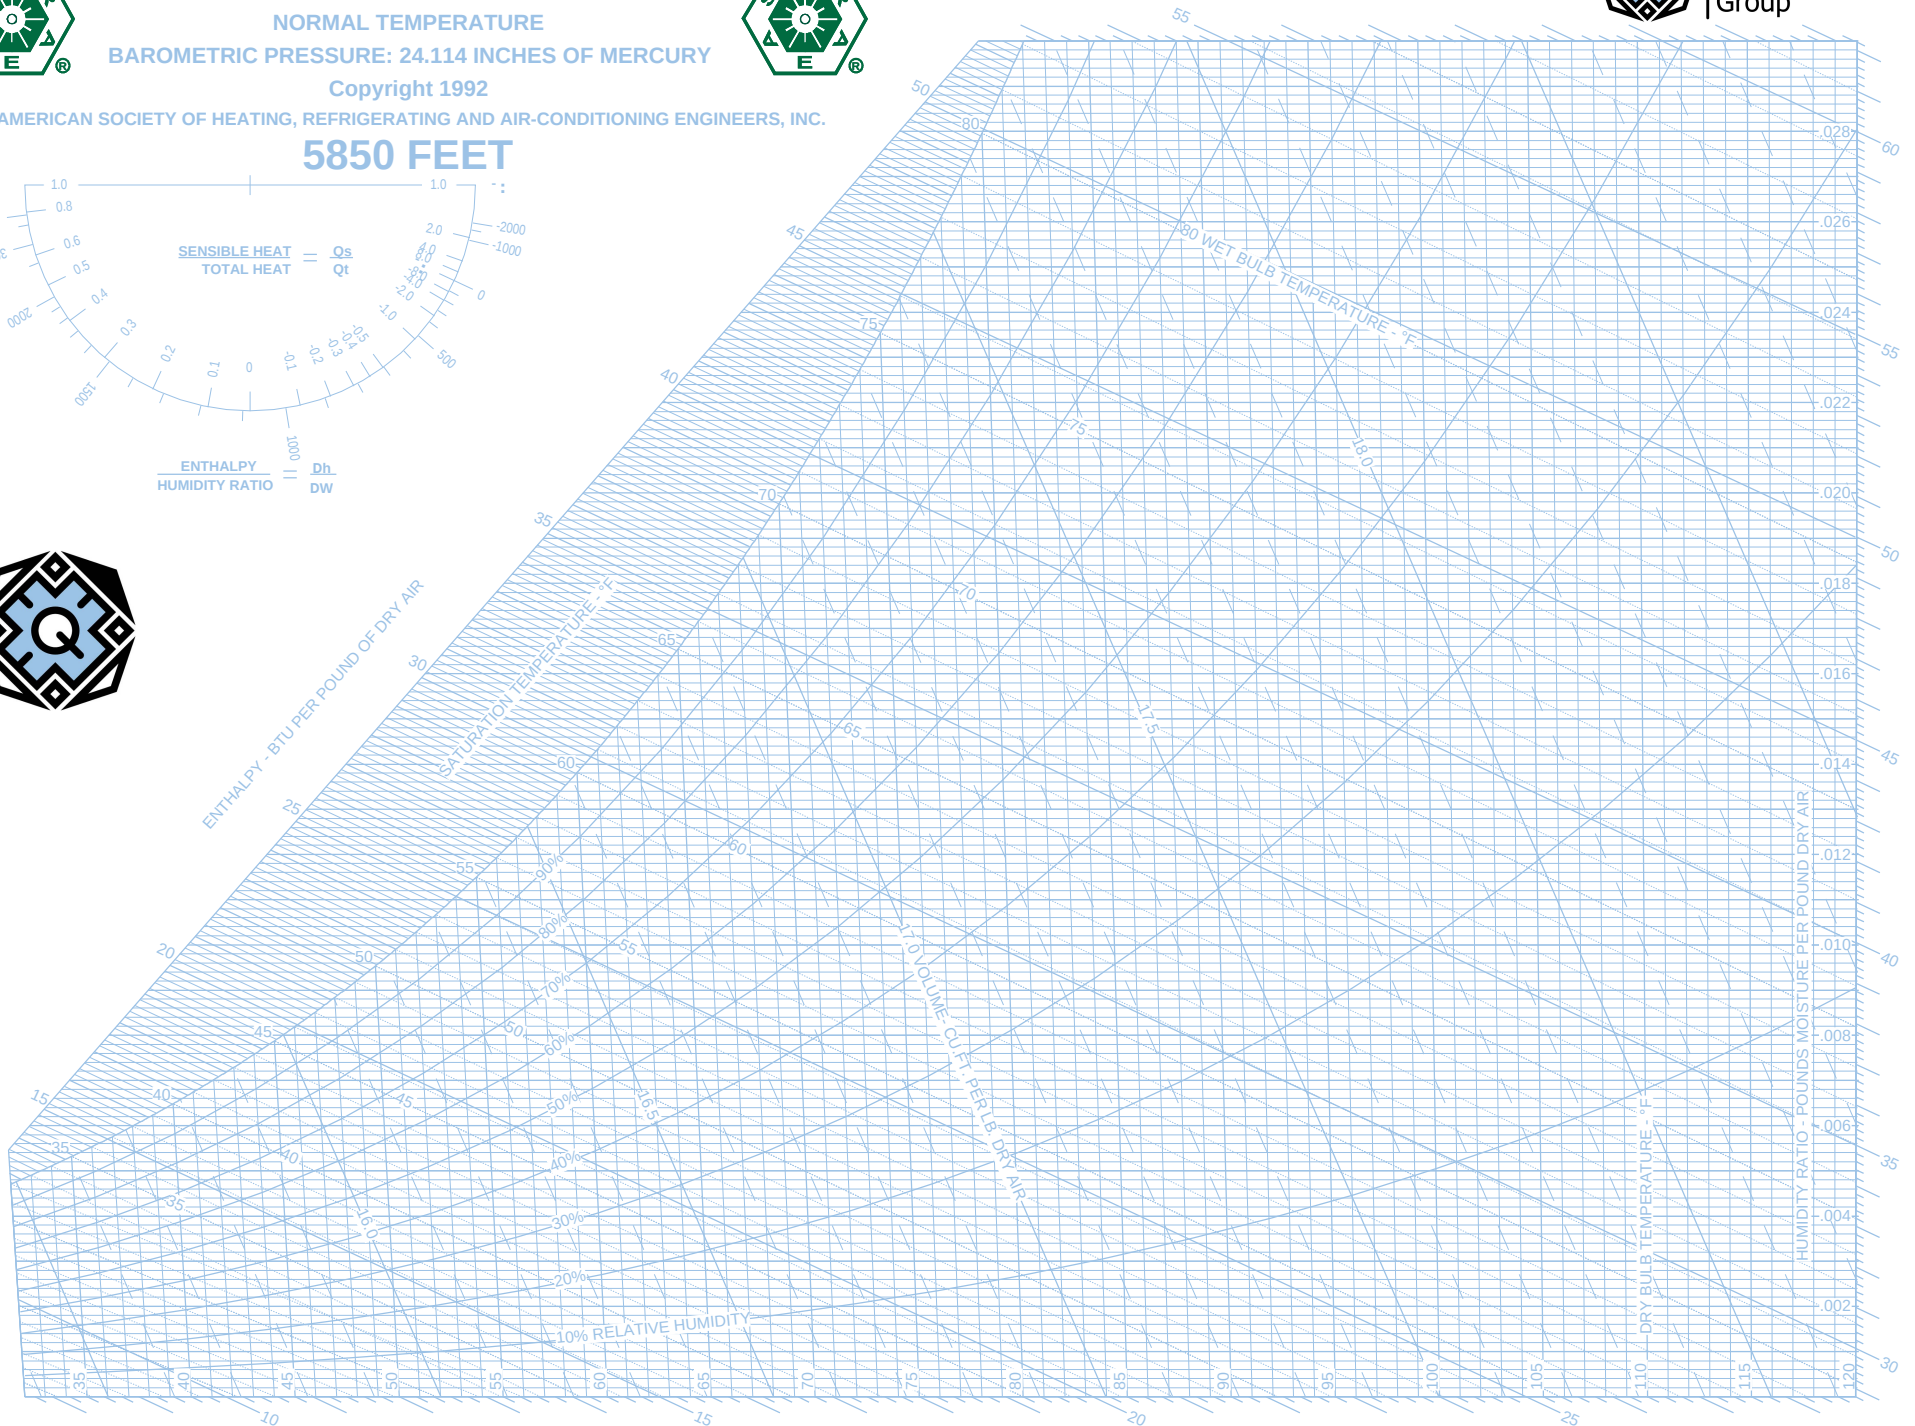

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 23.530 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

6500 FEET

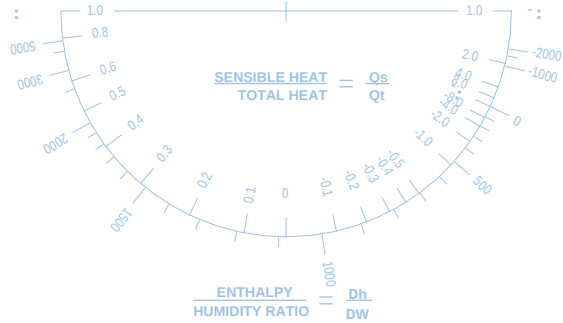

Quaternum
Solutions
Group

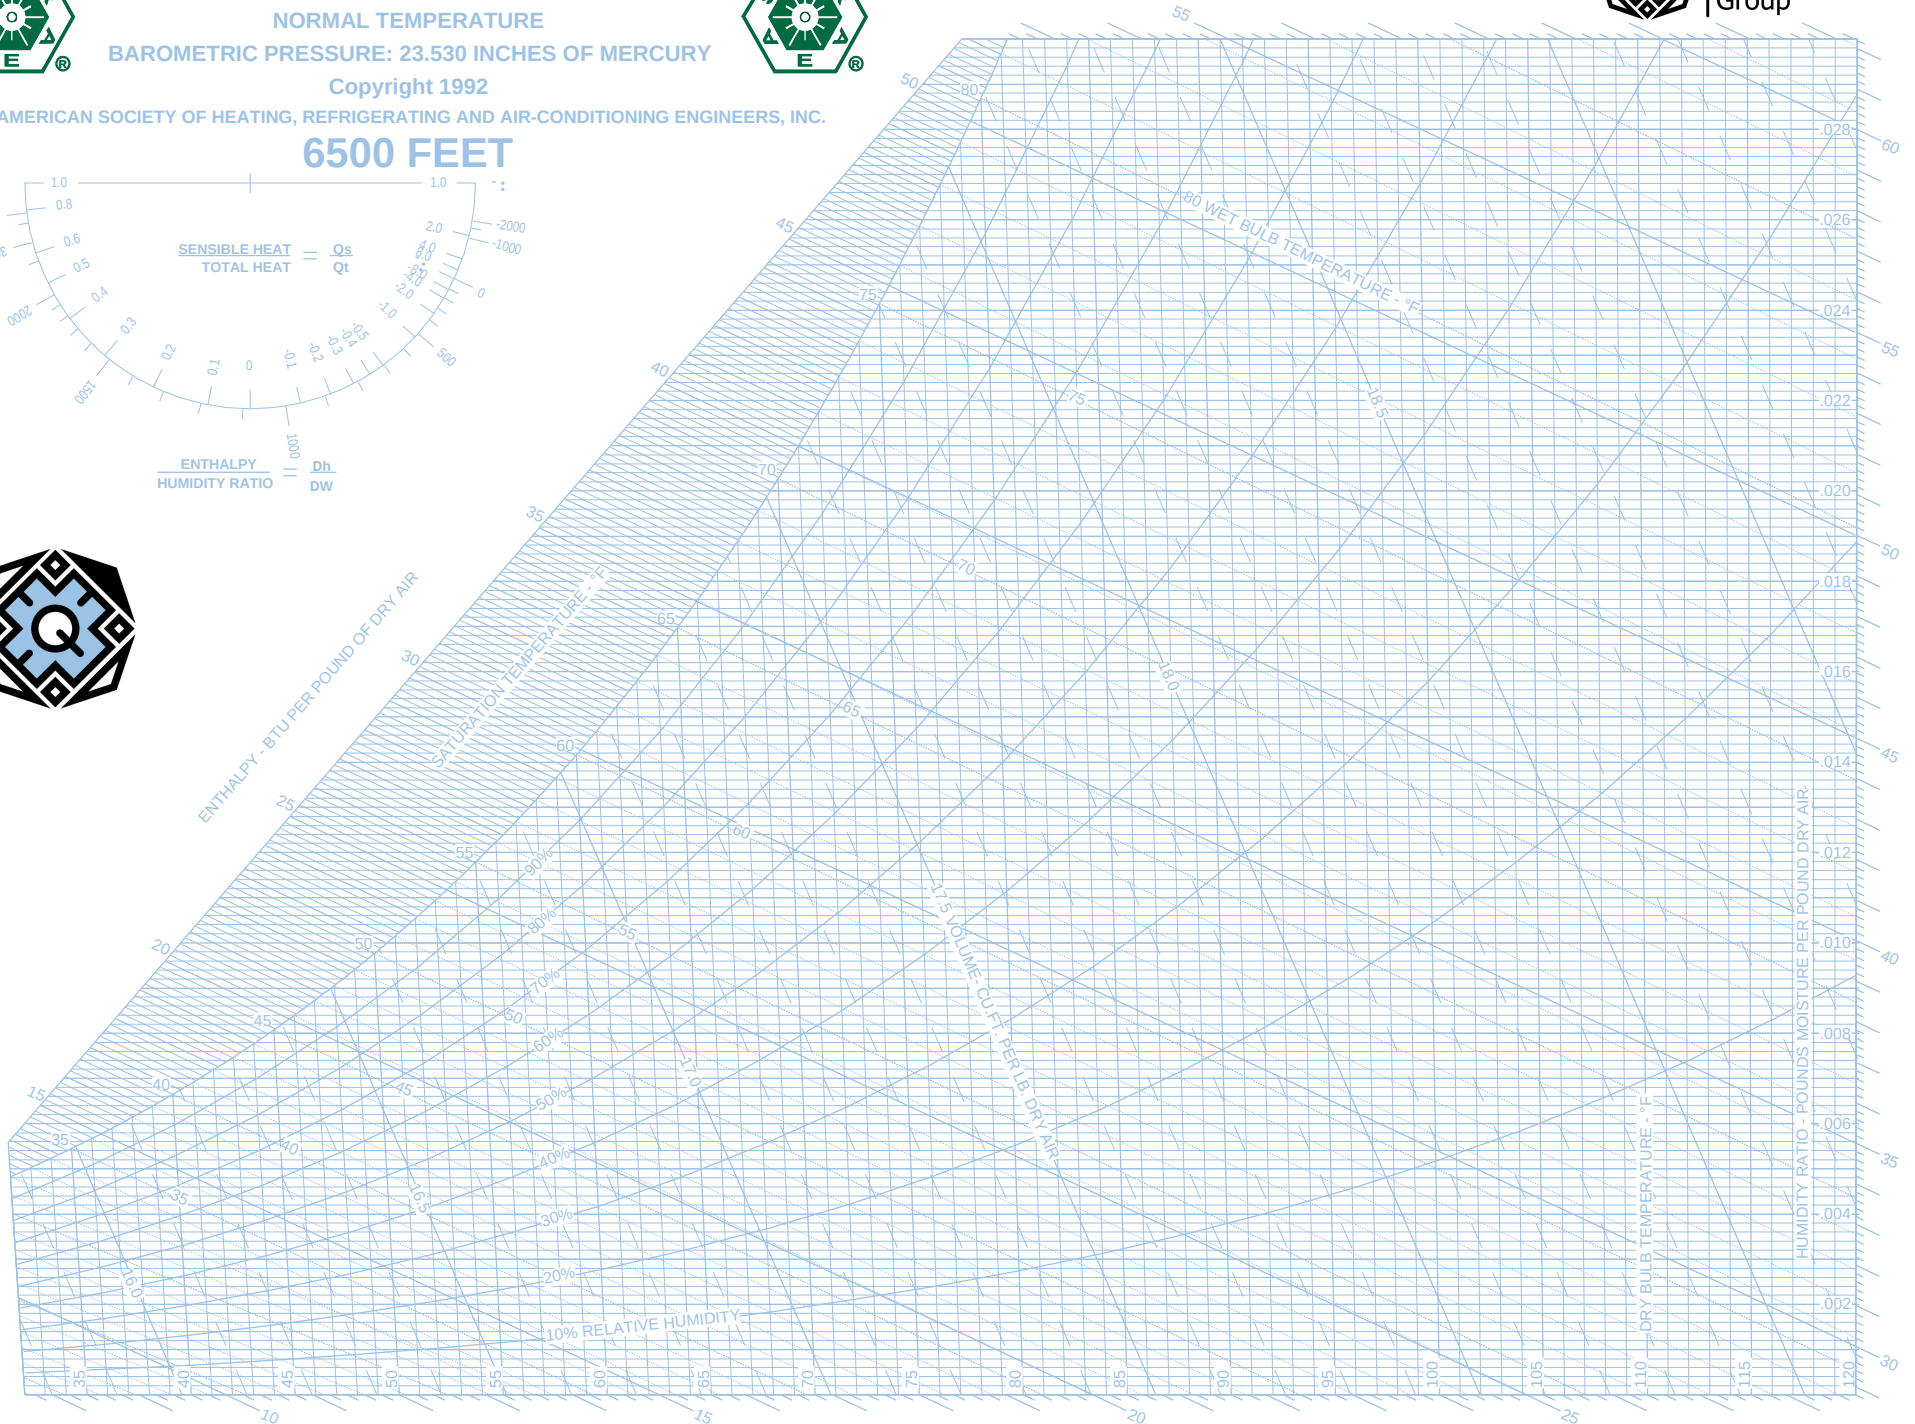

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE
BAROMETRIC PRESSURE: 22.957 INCHES OF MERCURY





Quaternum
Solutions
Group

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

7150 FEET

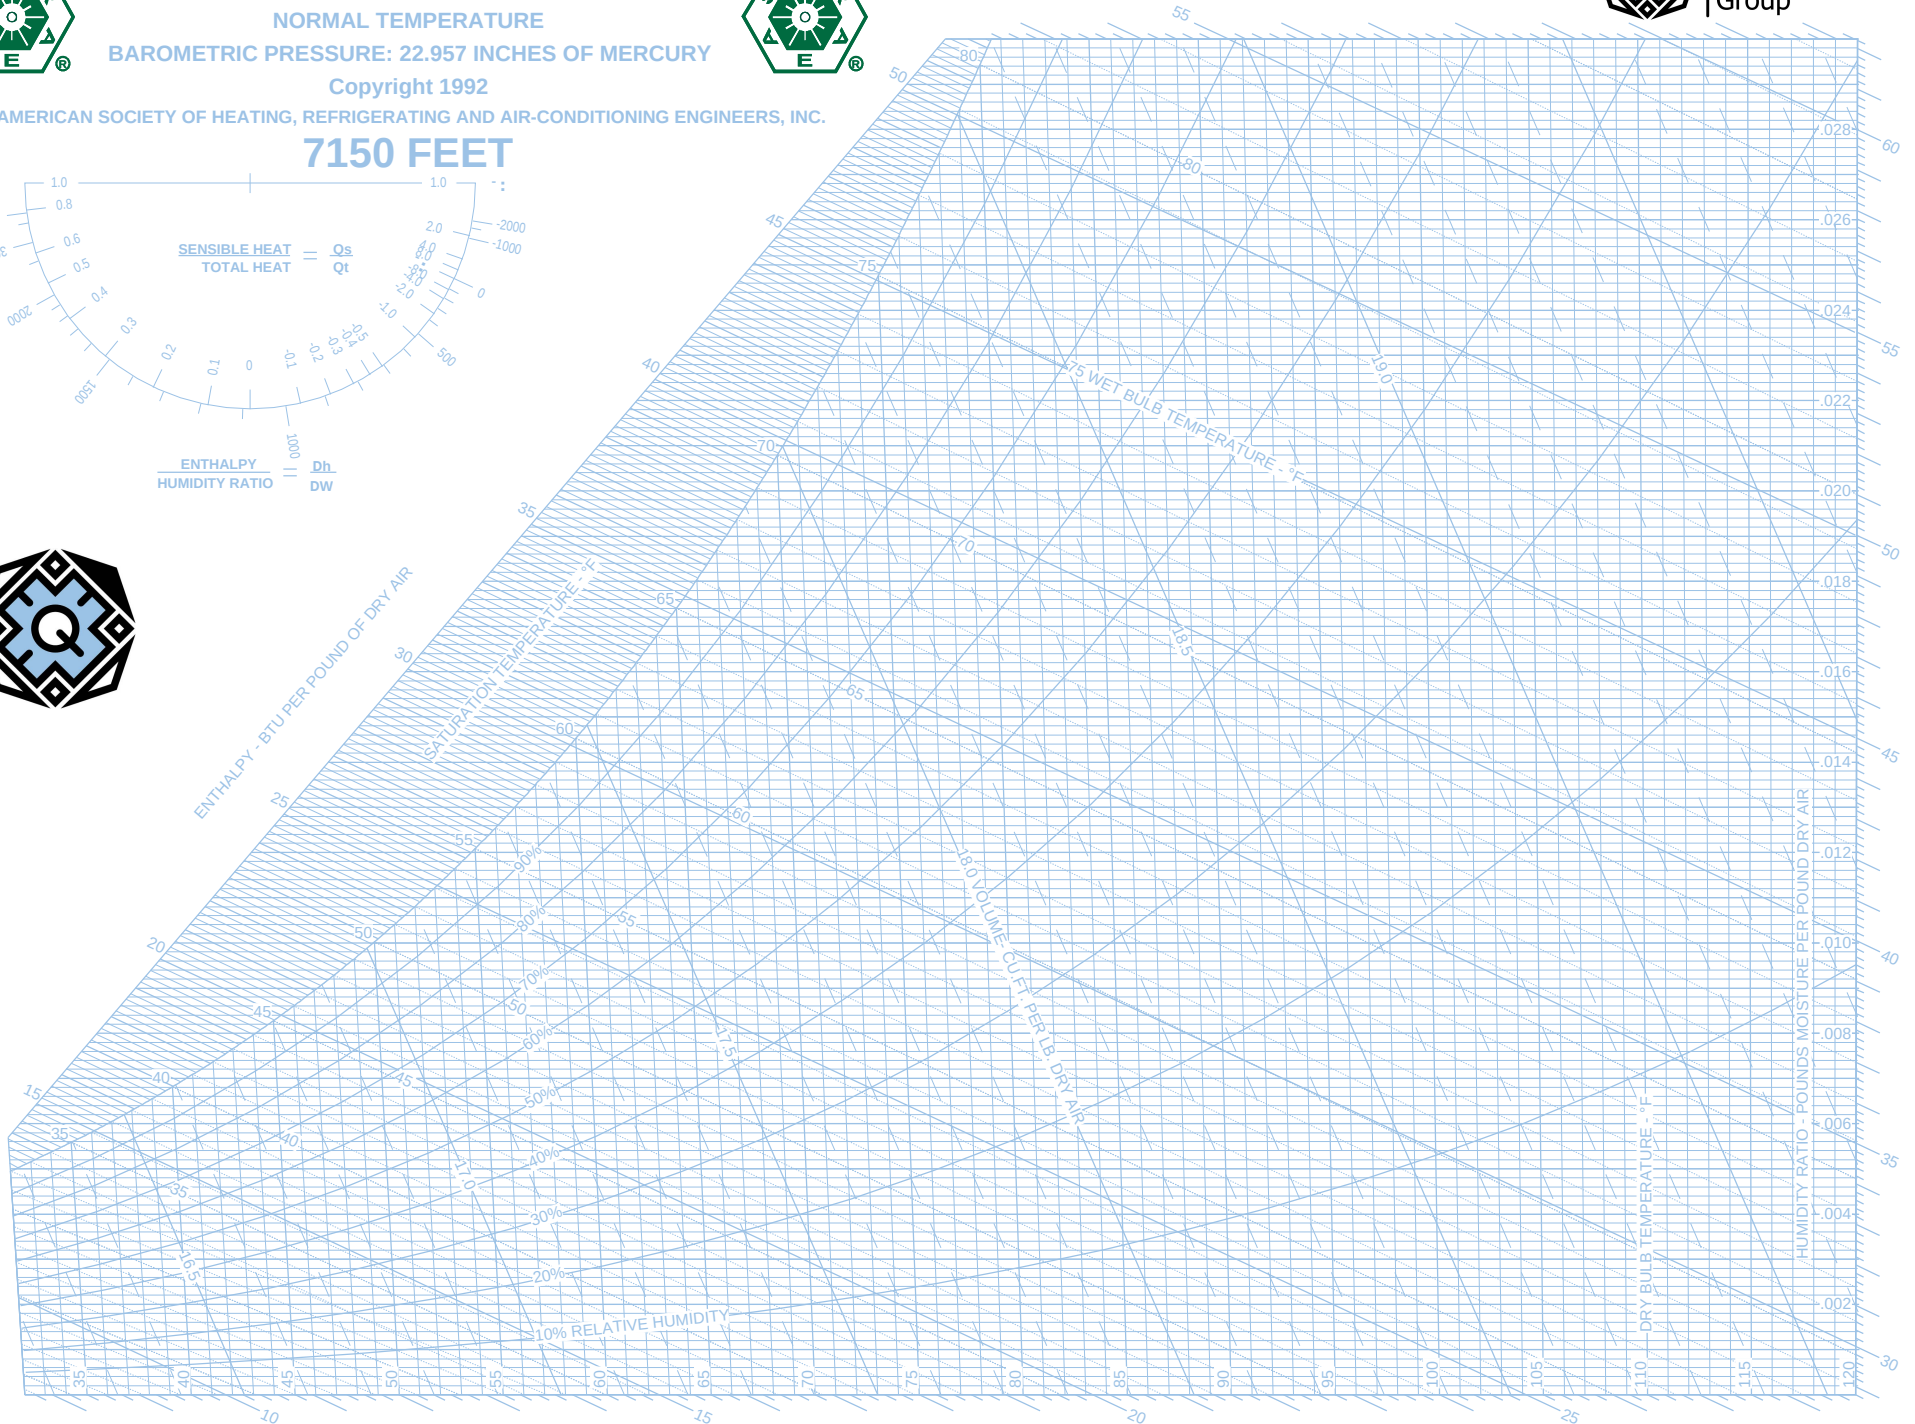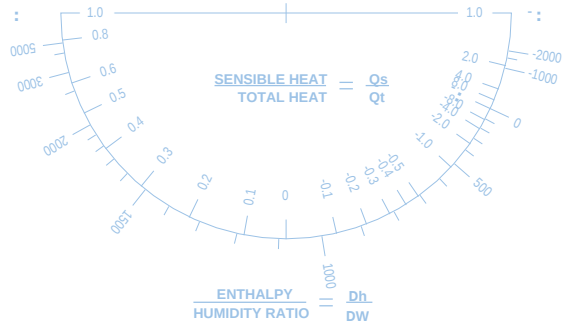

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 22.396 INCHES OF MERCURY


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

7800 FEET

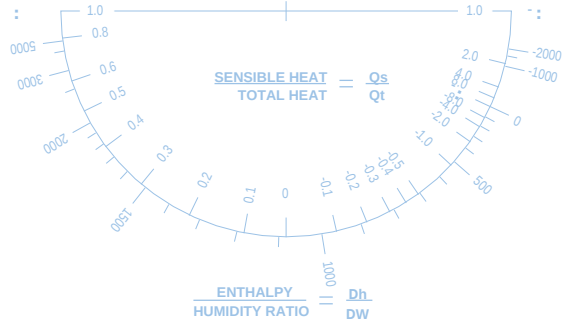

Quaternum
Solutions
Group

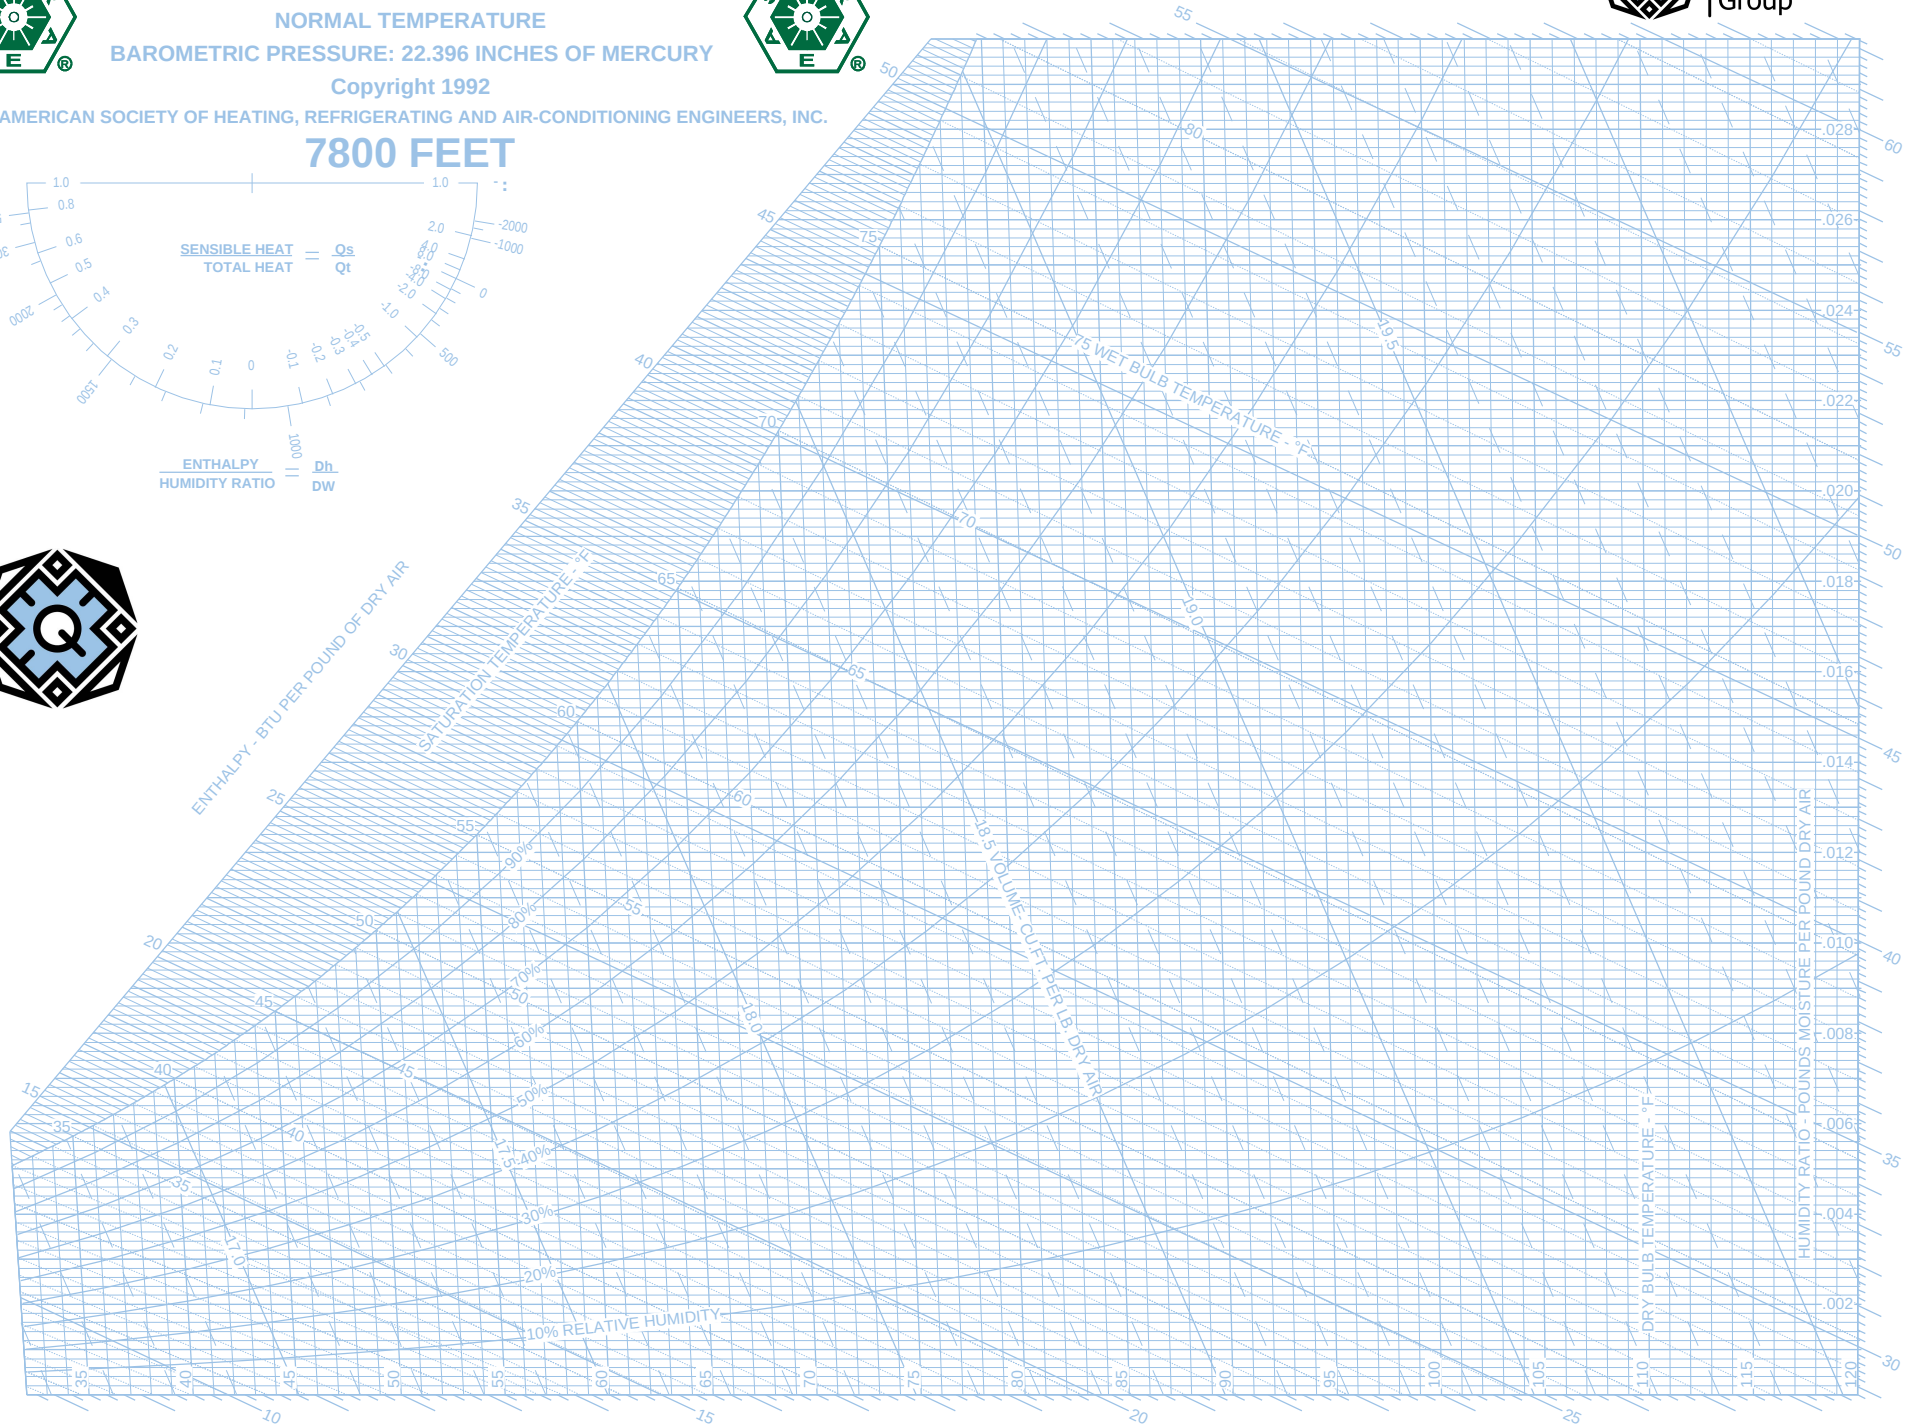

ENTHALPY - BTU PER POUND OF DRY AIR



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 101.325 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

SEA LEVEL



Quaternum
Solutions
Group

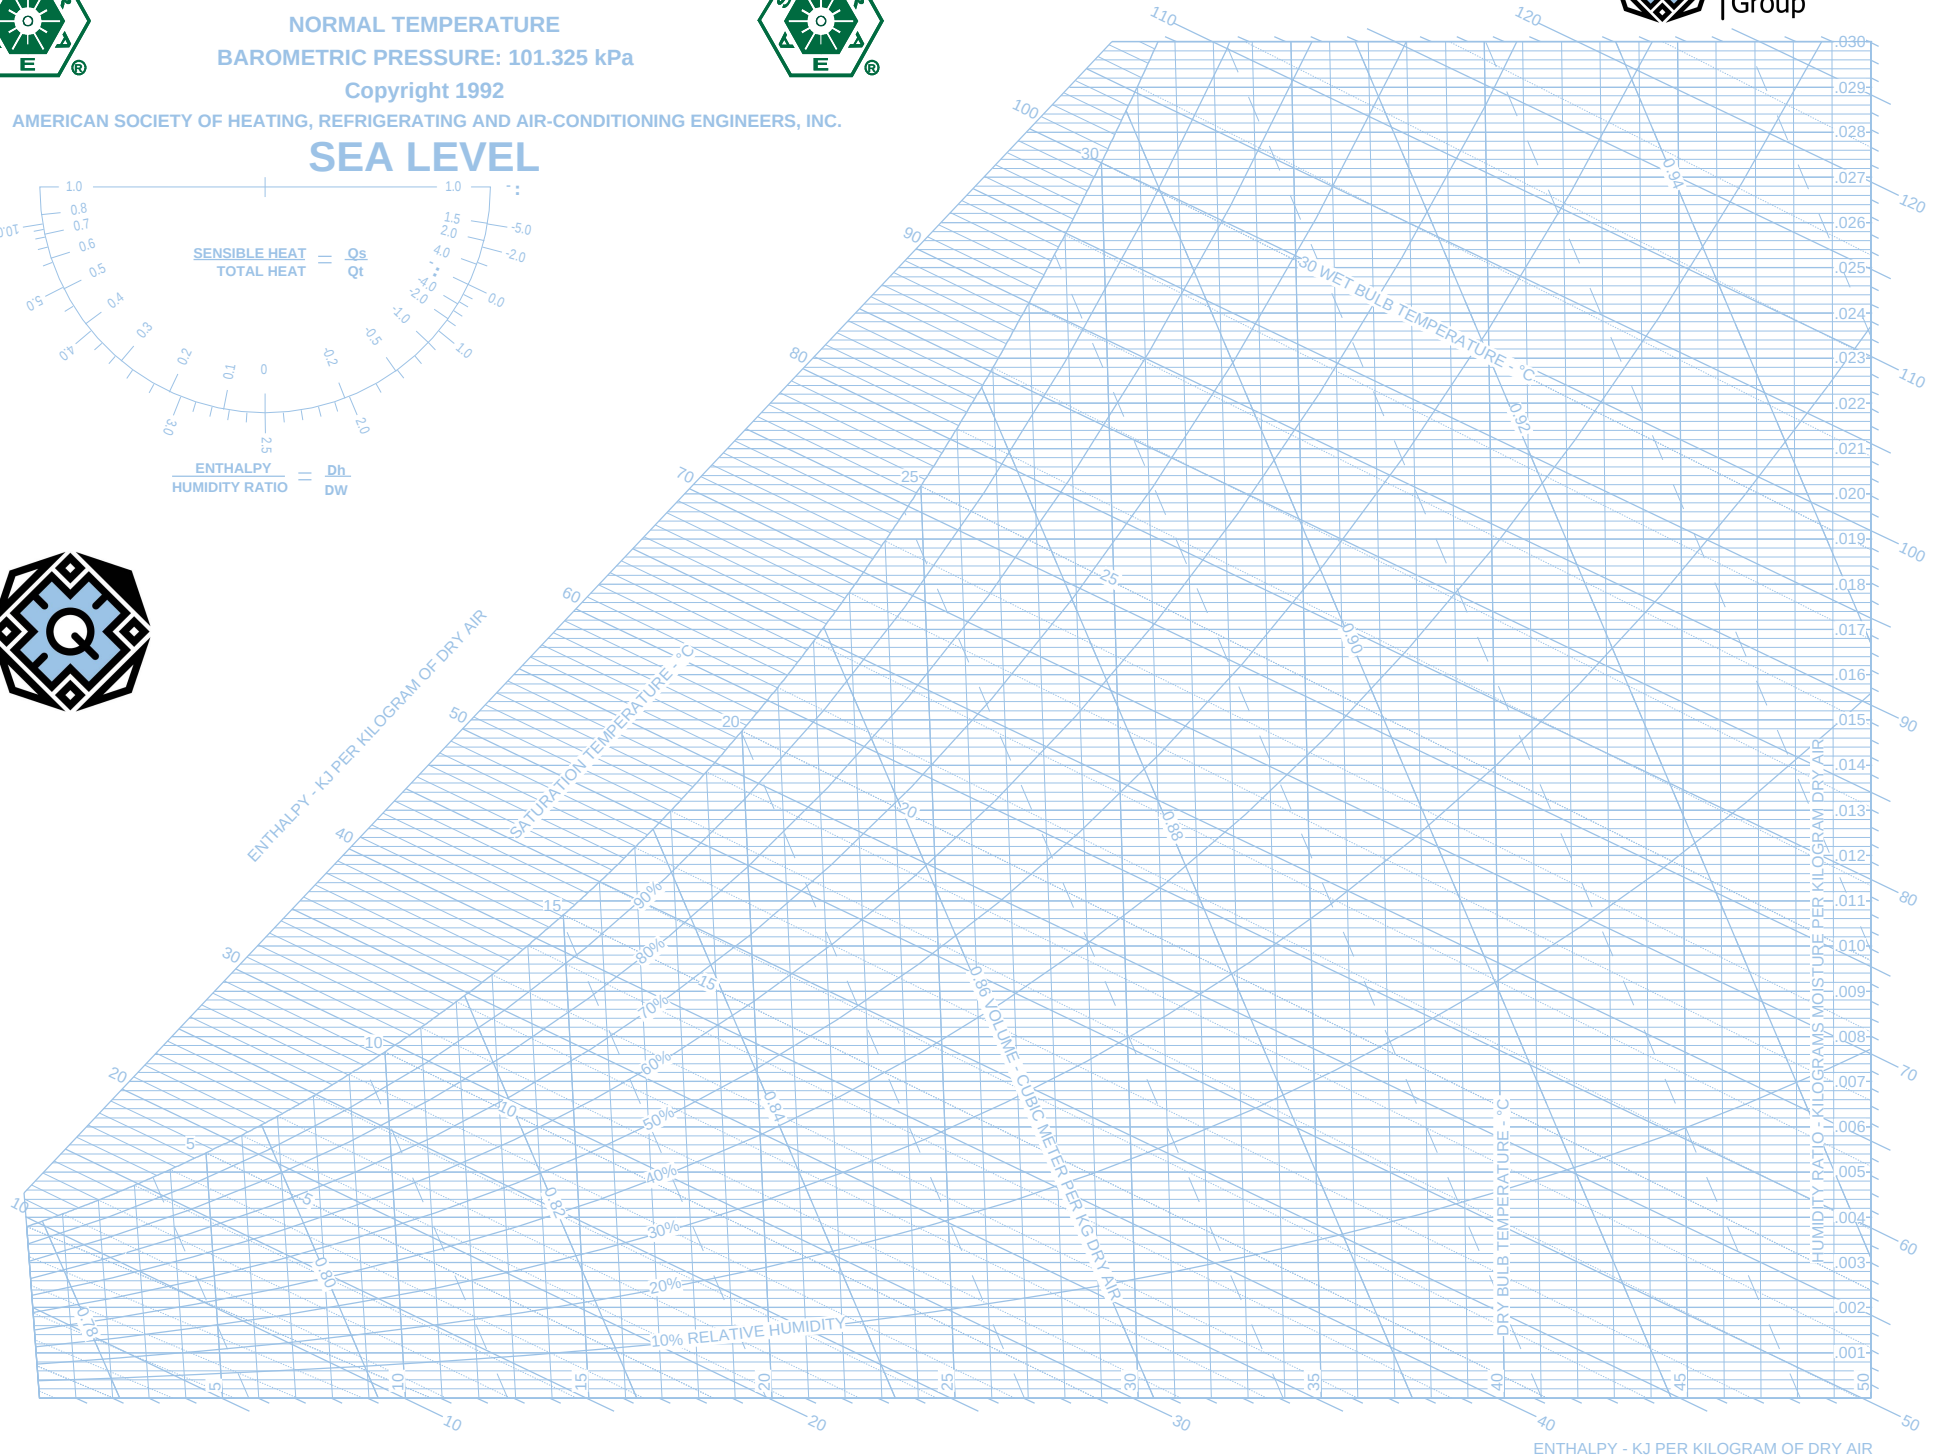



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 98.946 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

200 METERS

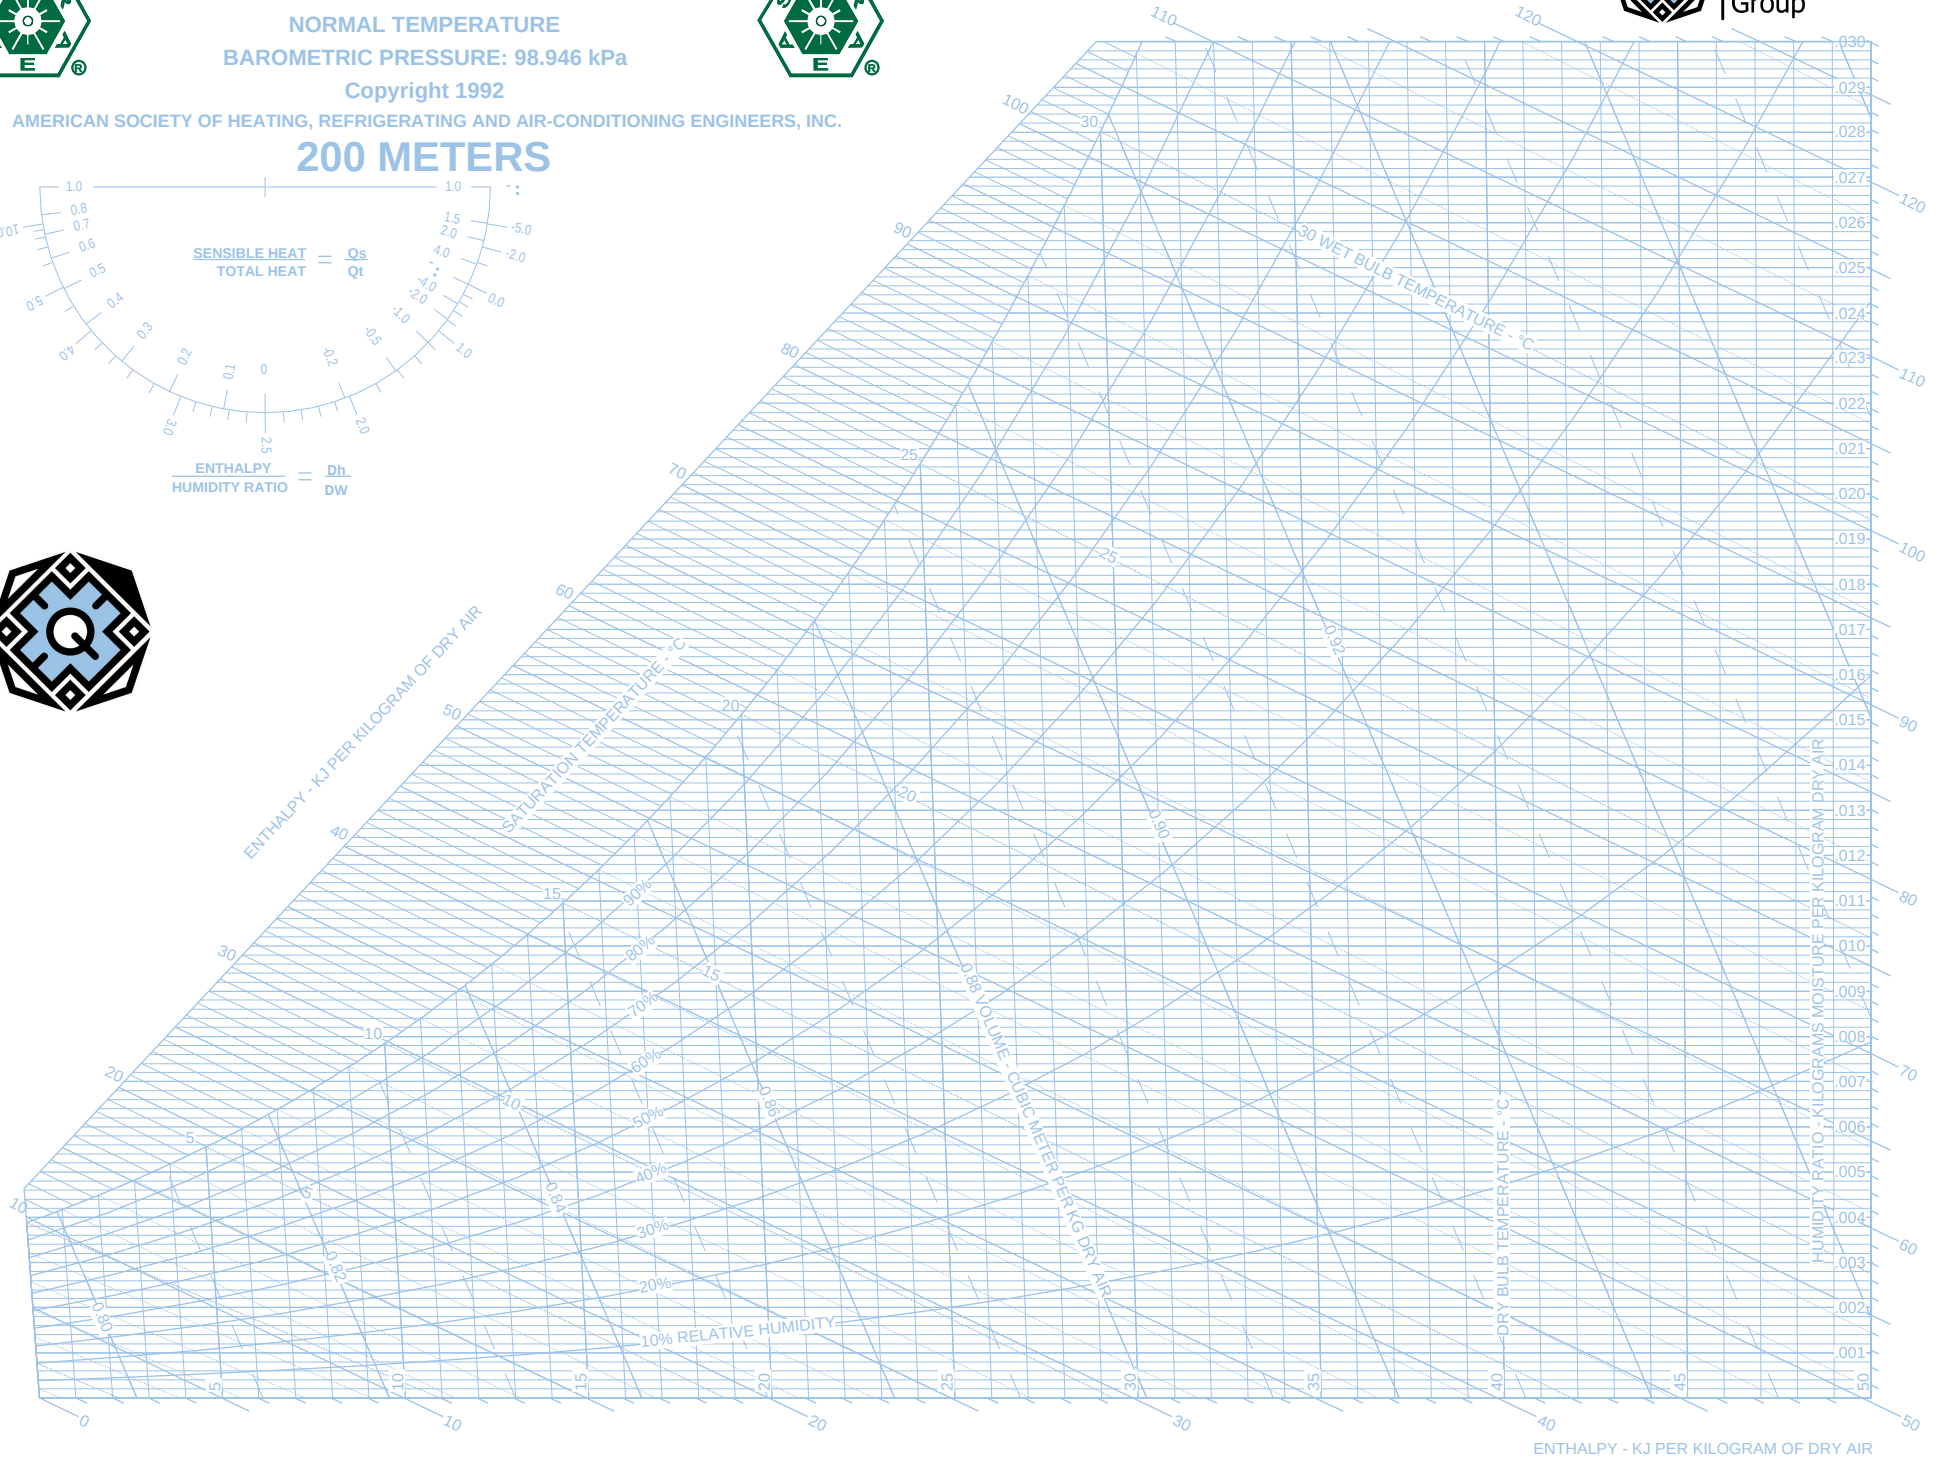



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 96.612 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

400 METERS

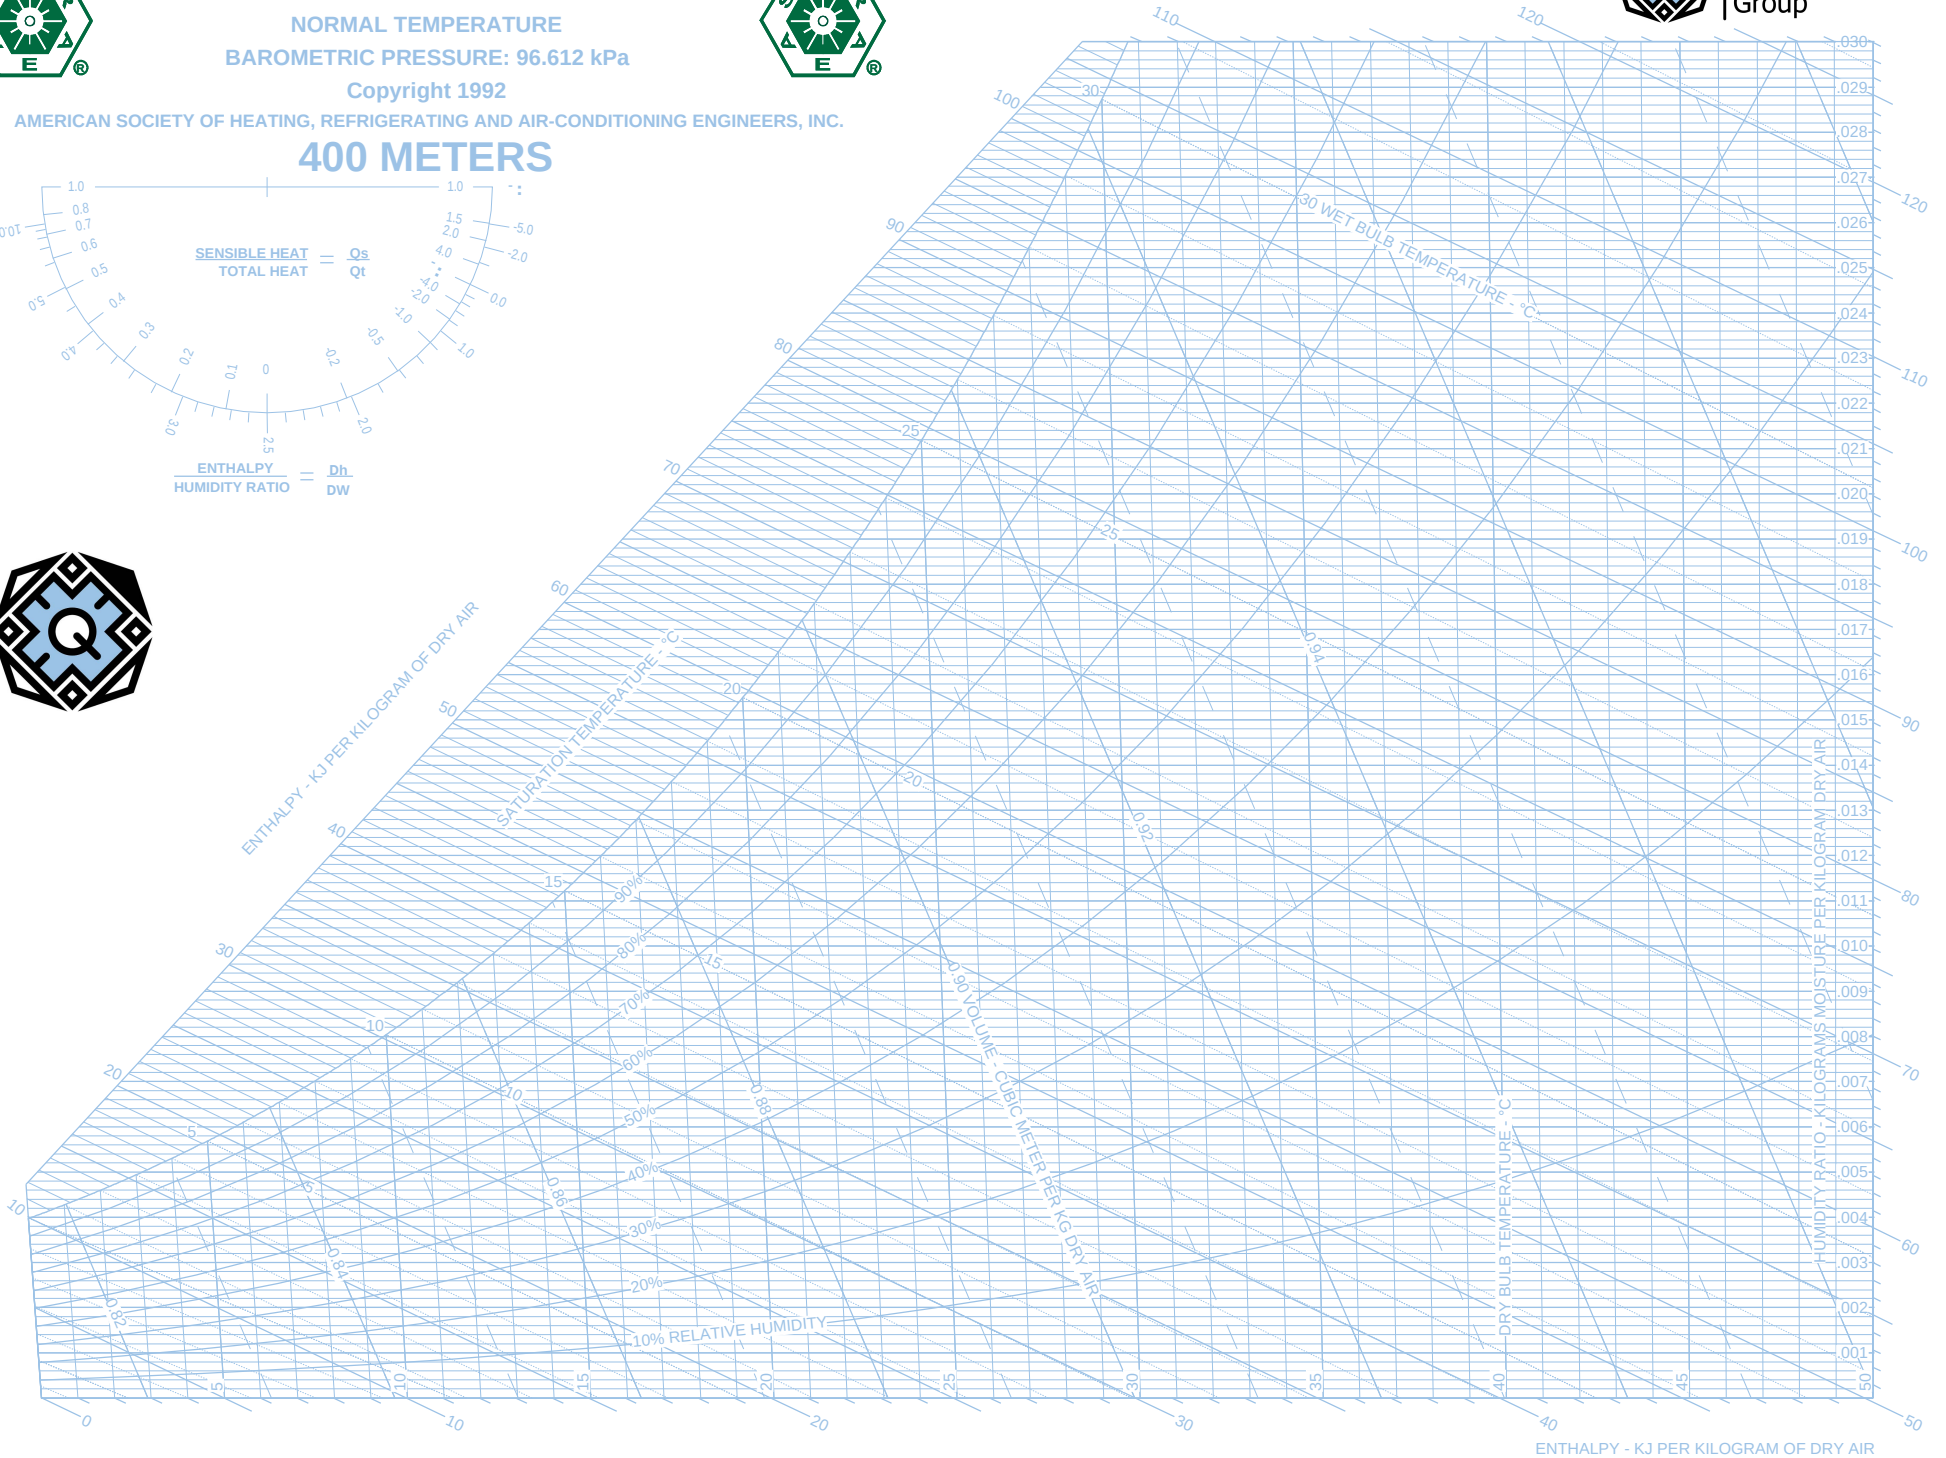



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 94.324 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

600 METERS

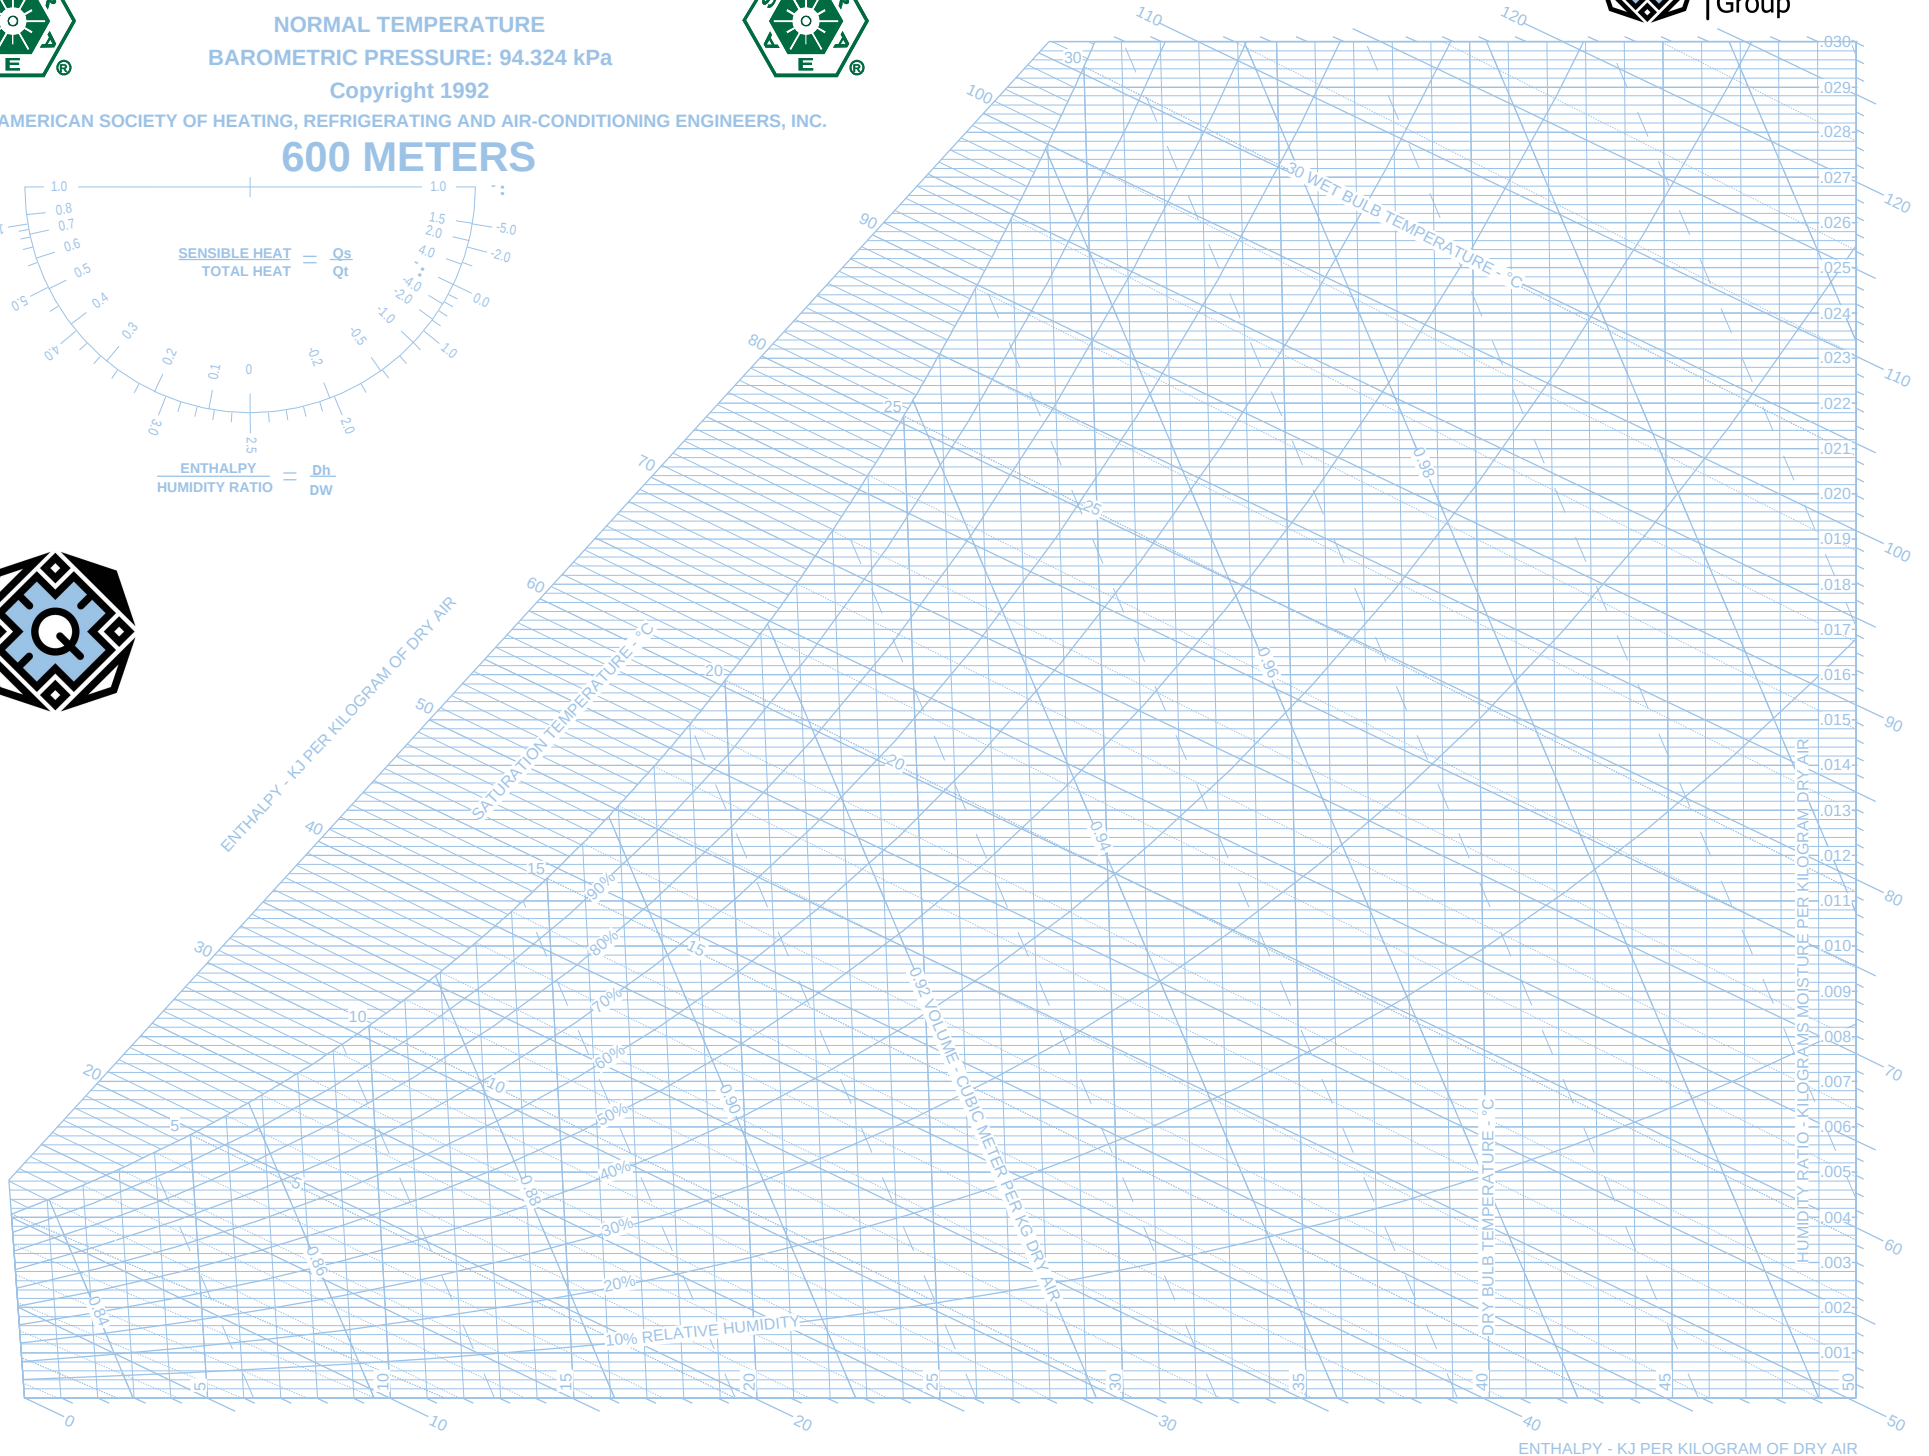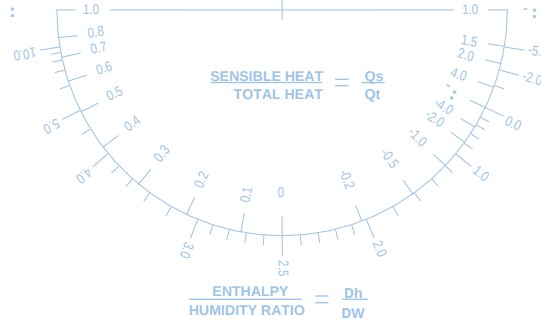



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 92.079 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

800 METERS

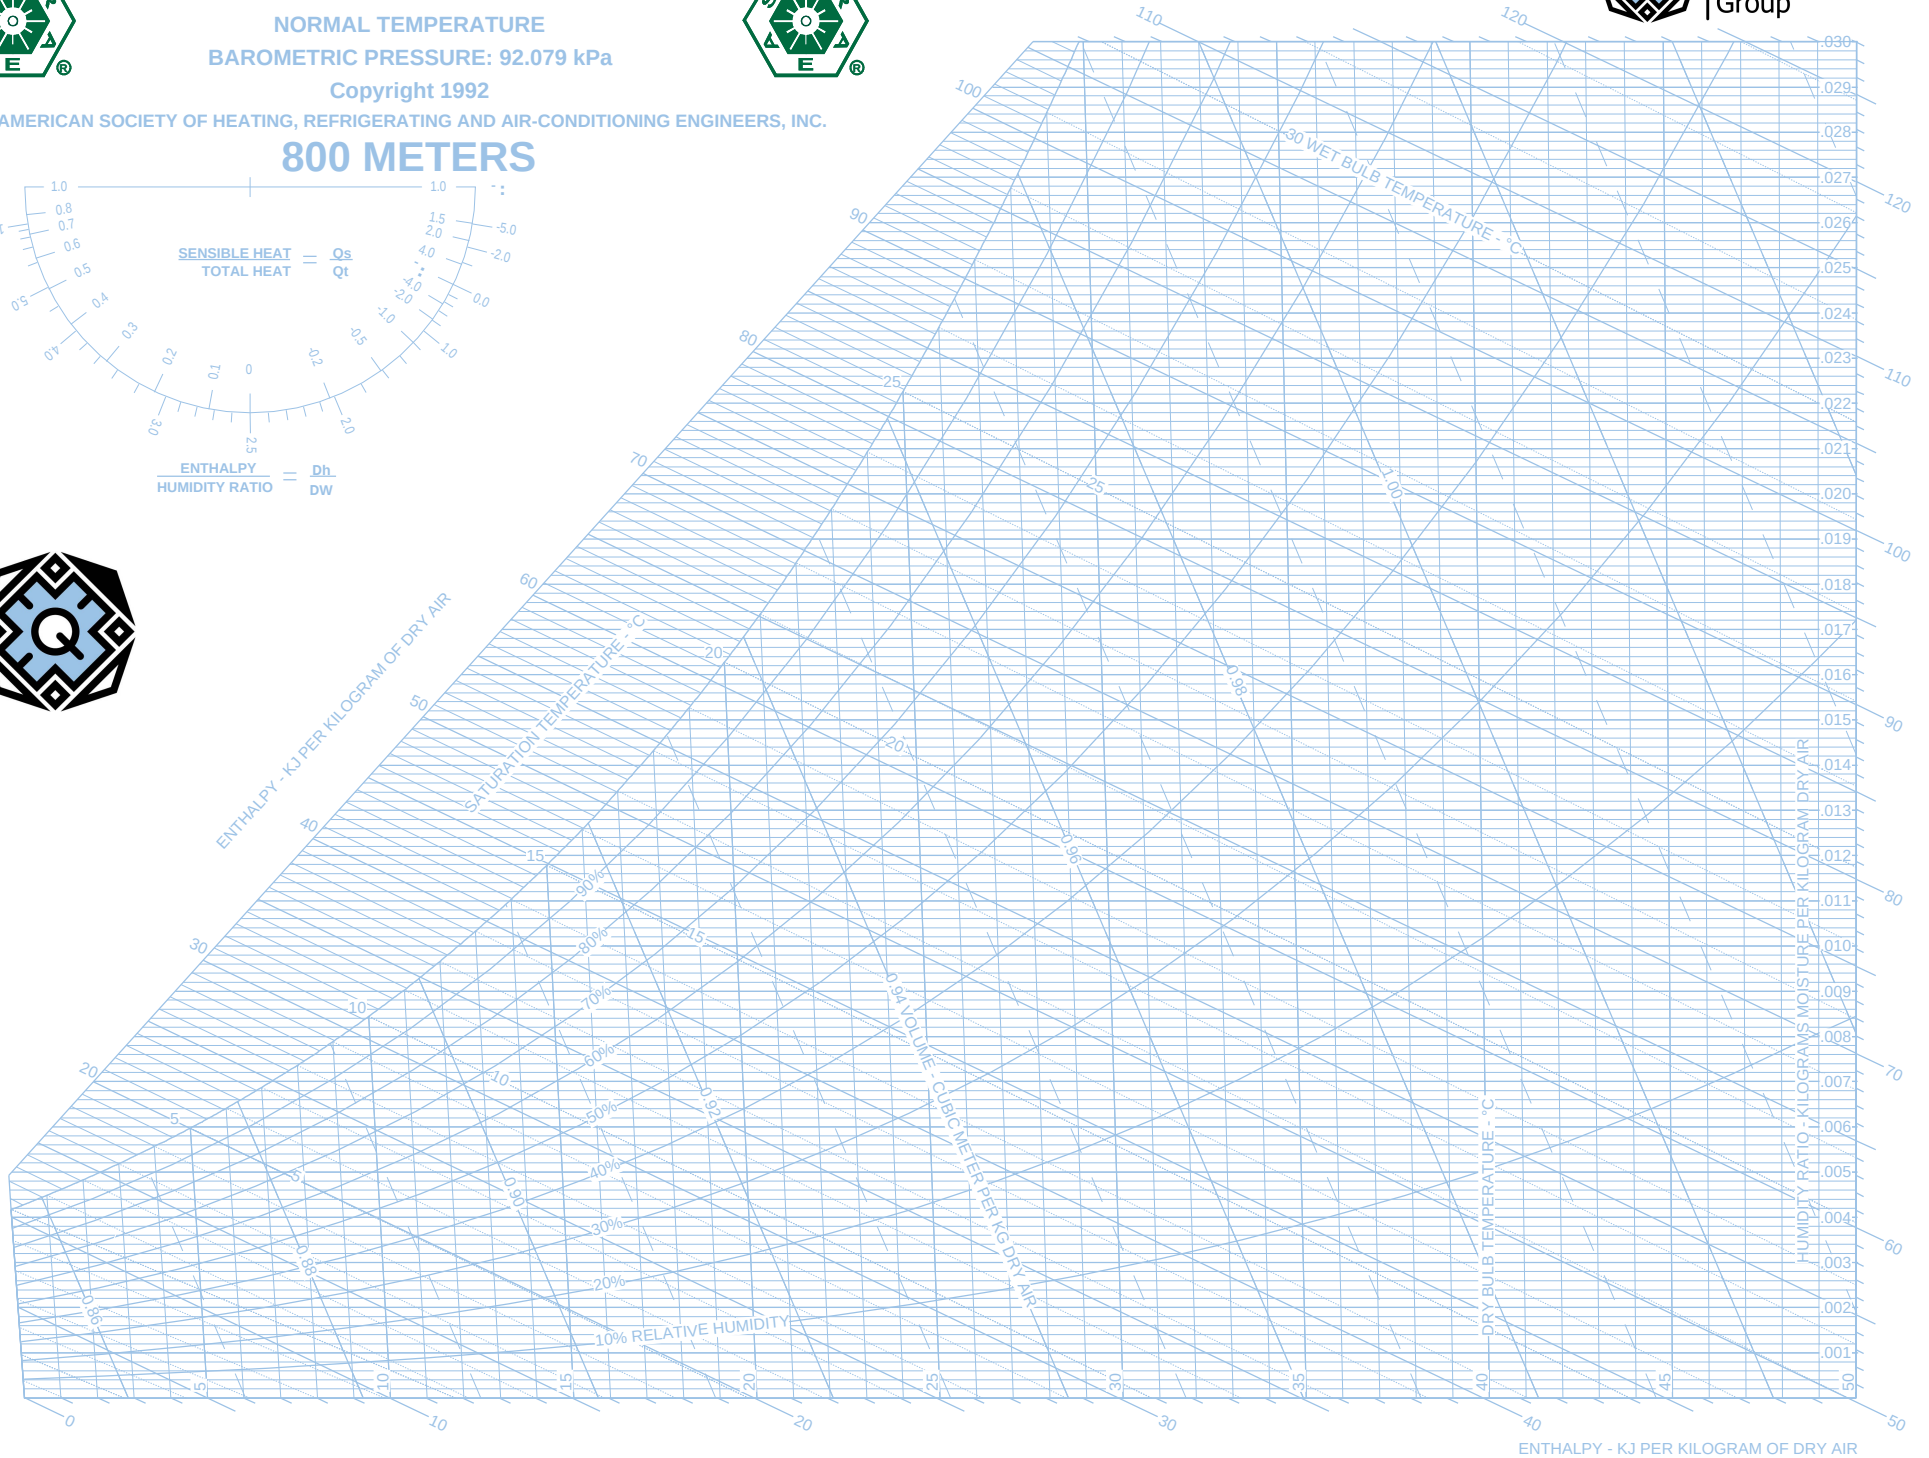



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 89.878 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

1000 METERS



Quaternum
Solutions
Group

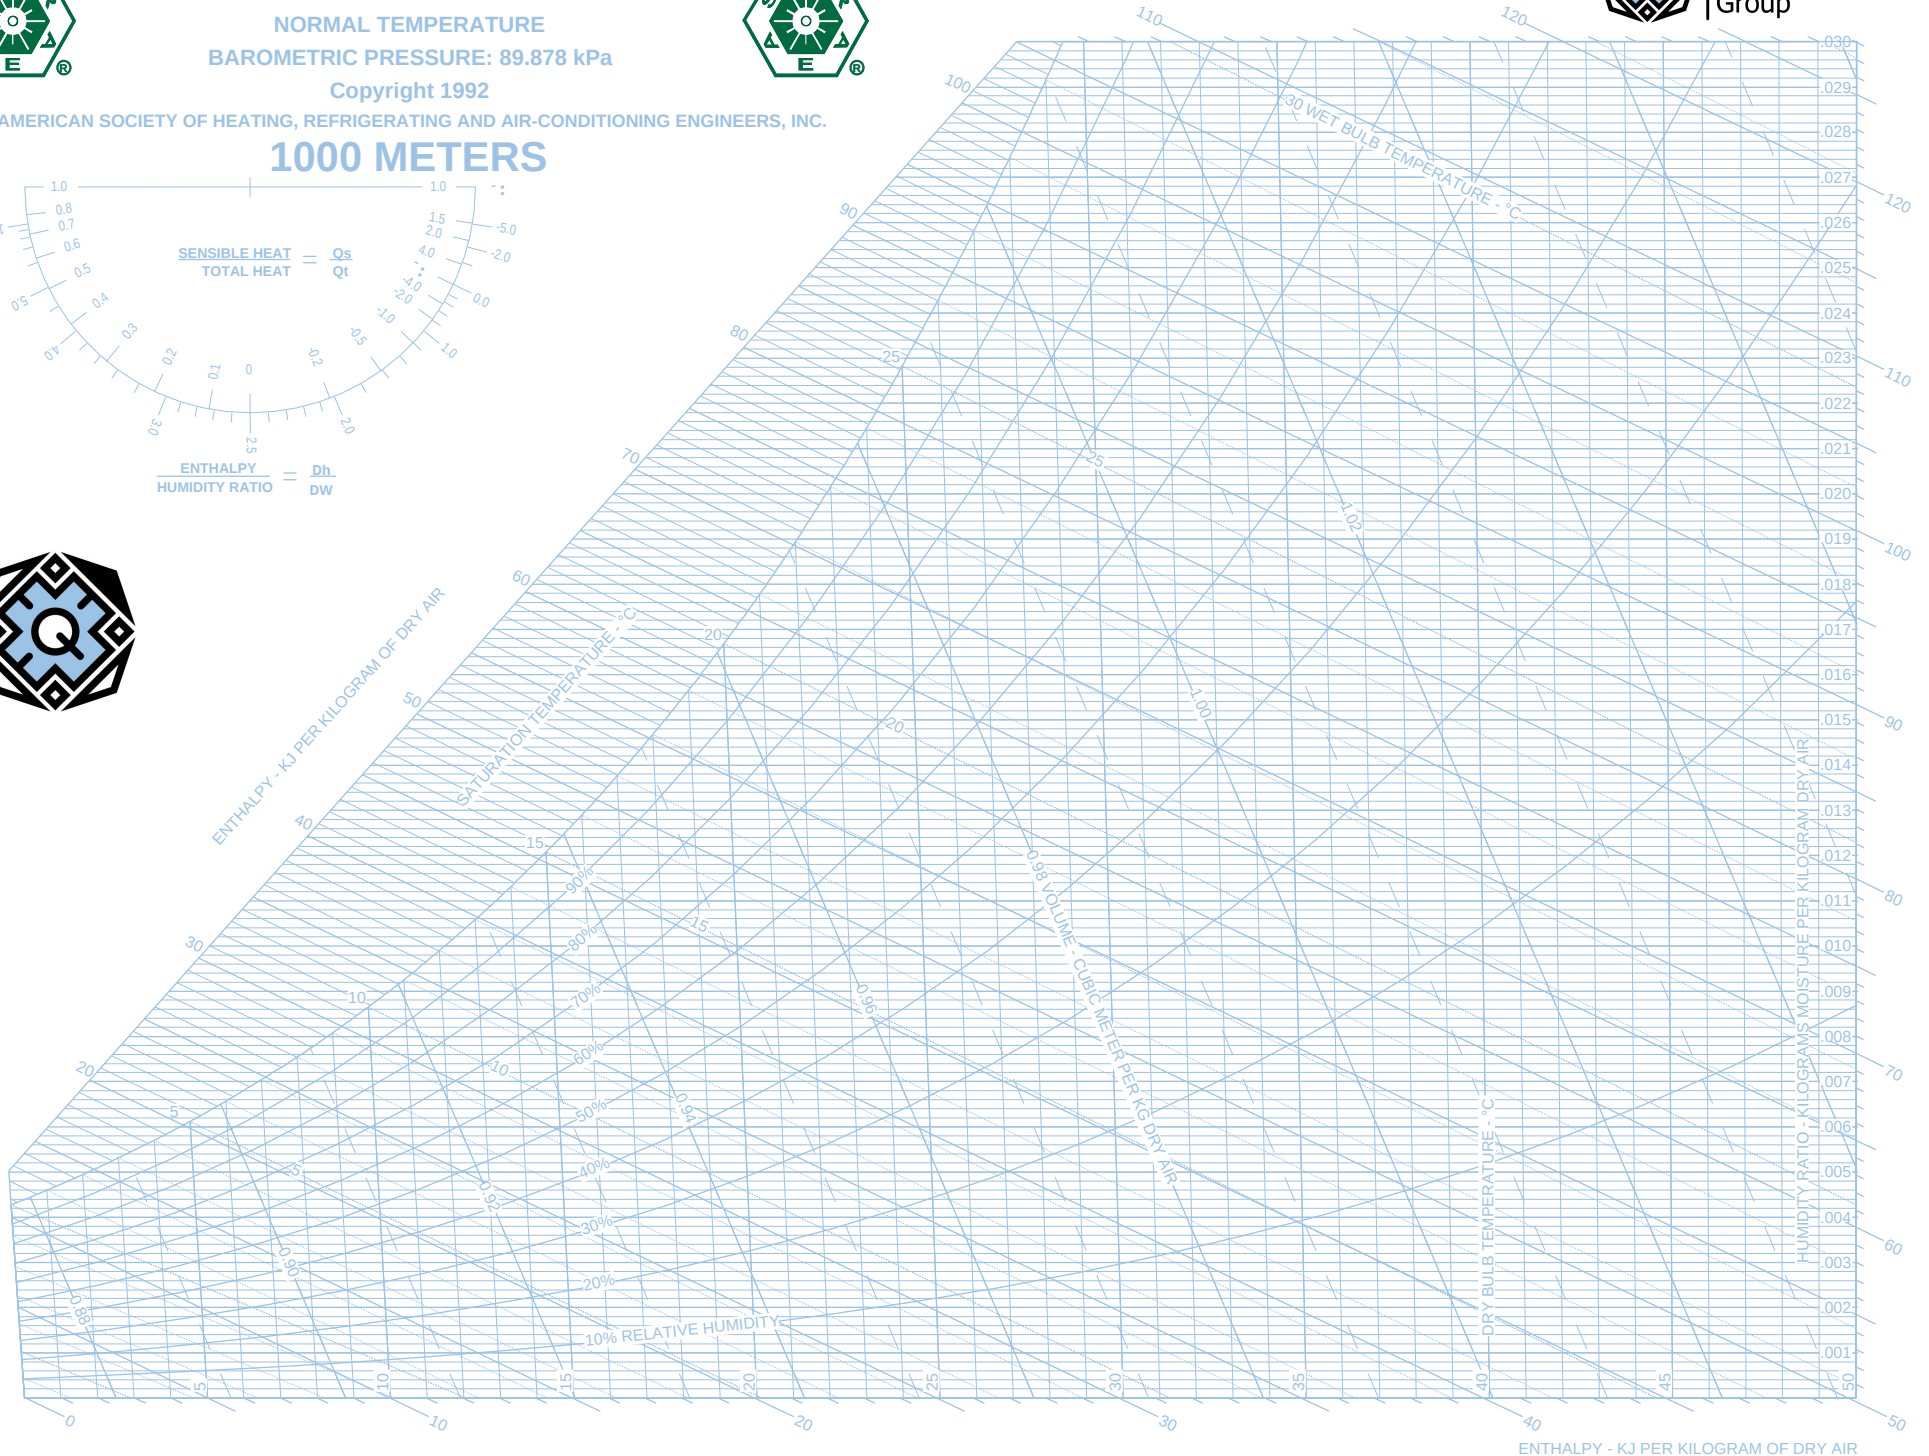



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 87.716 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

1200 METERS

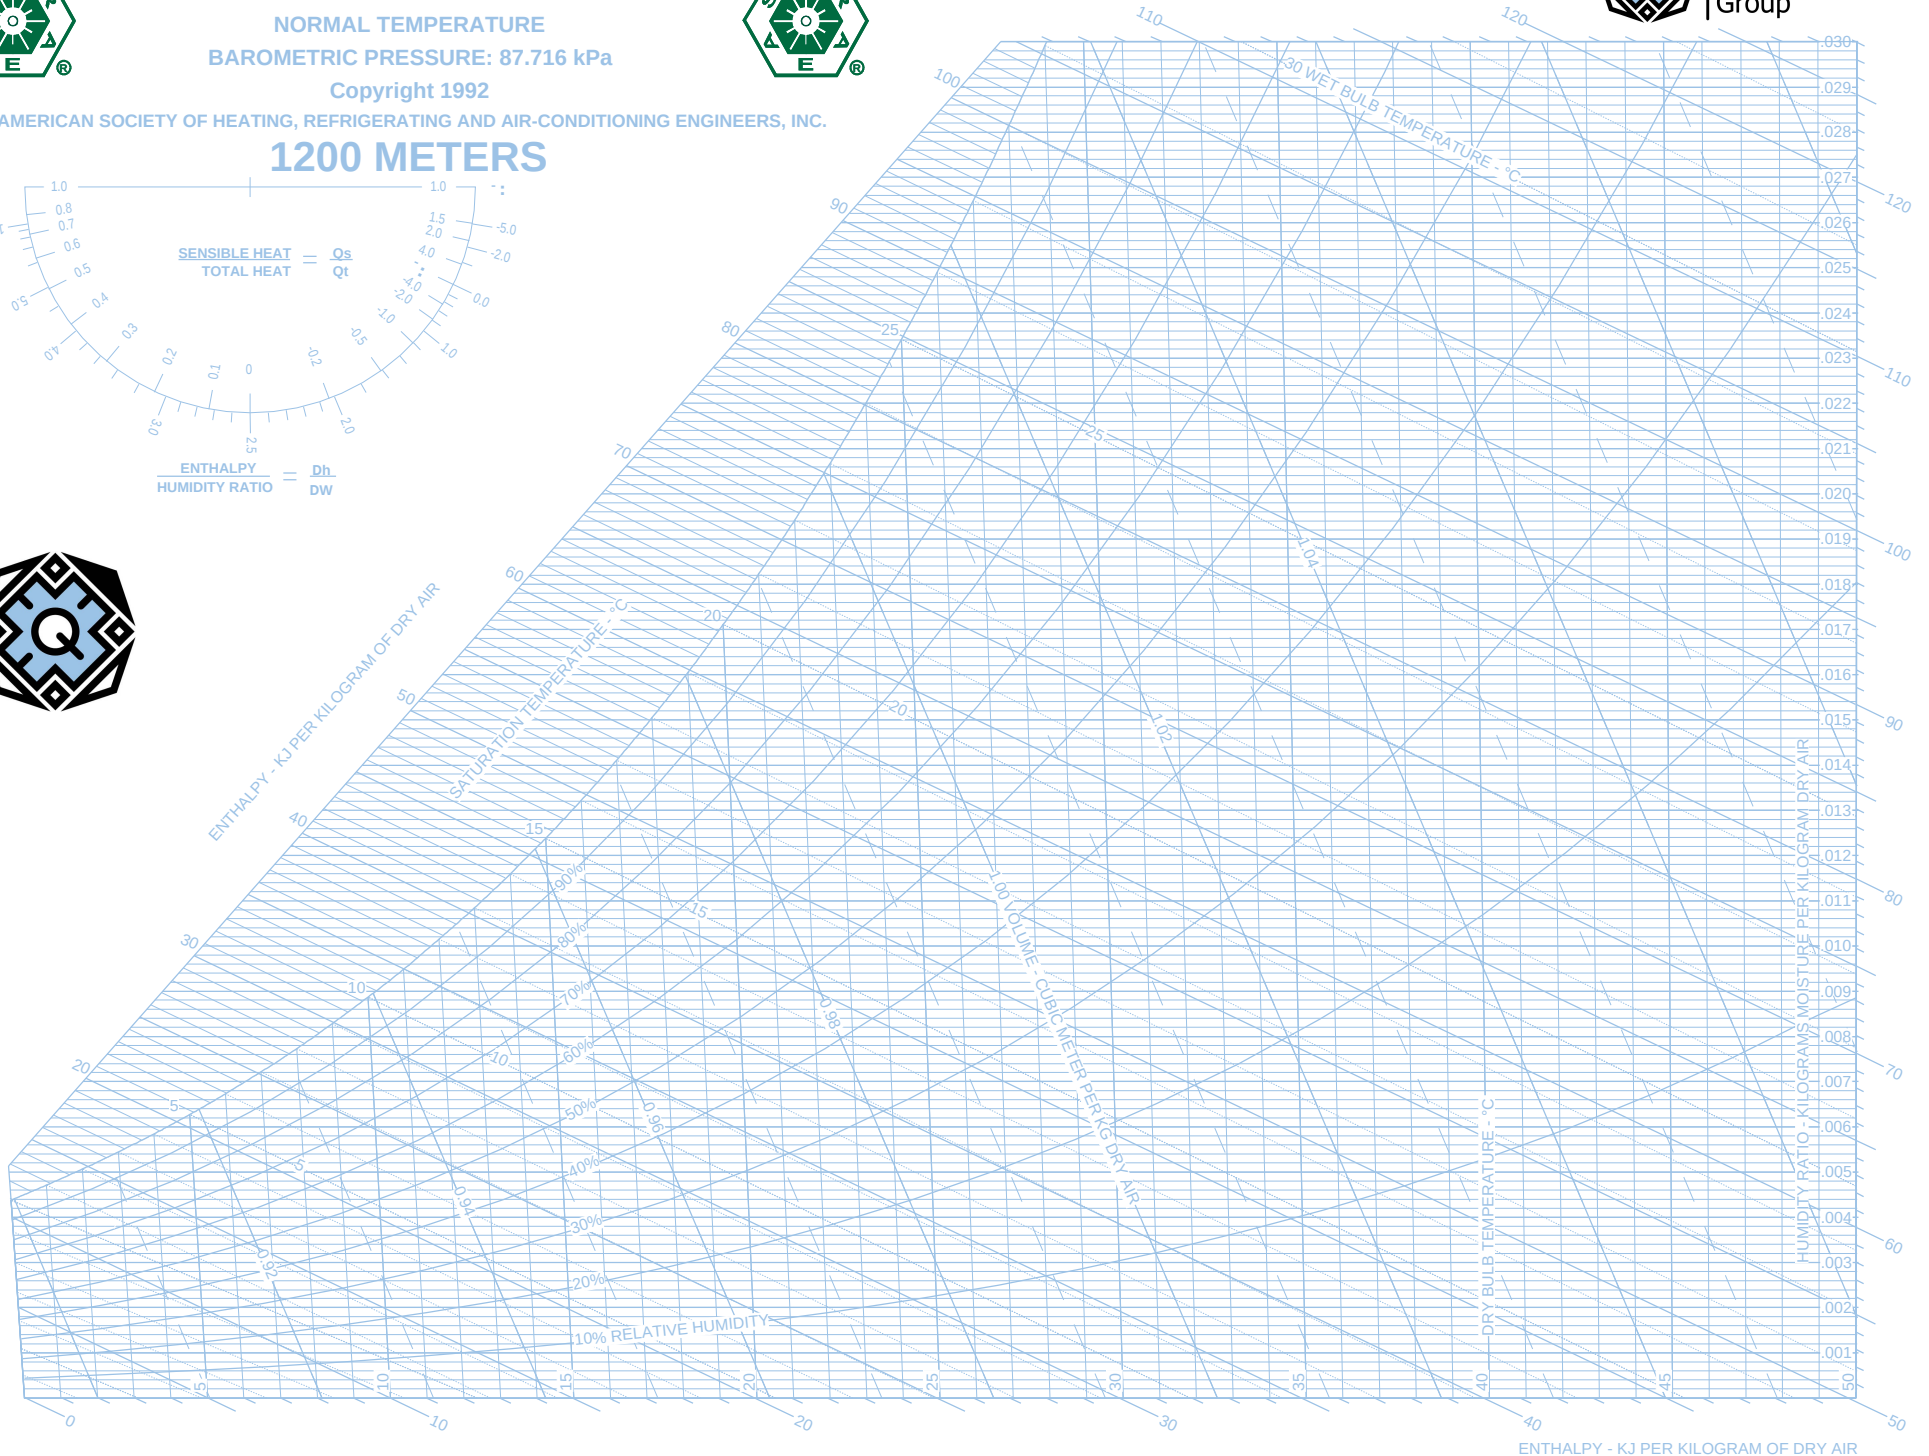



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 85.600 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

1400 METERS



Quaternum
Solutions
Group

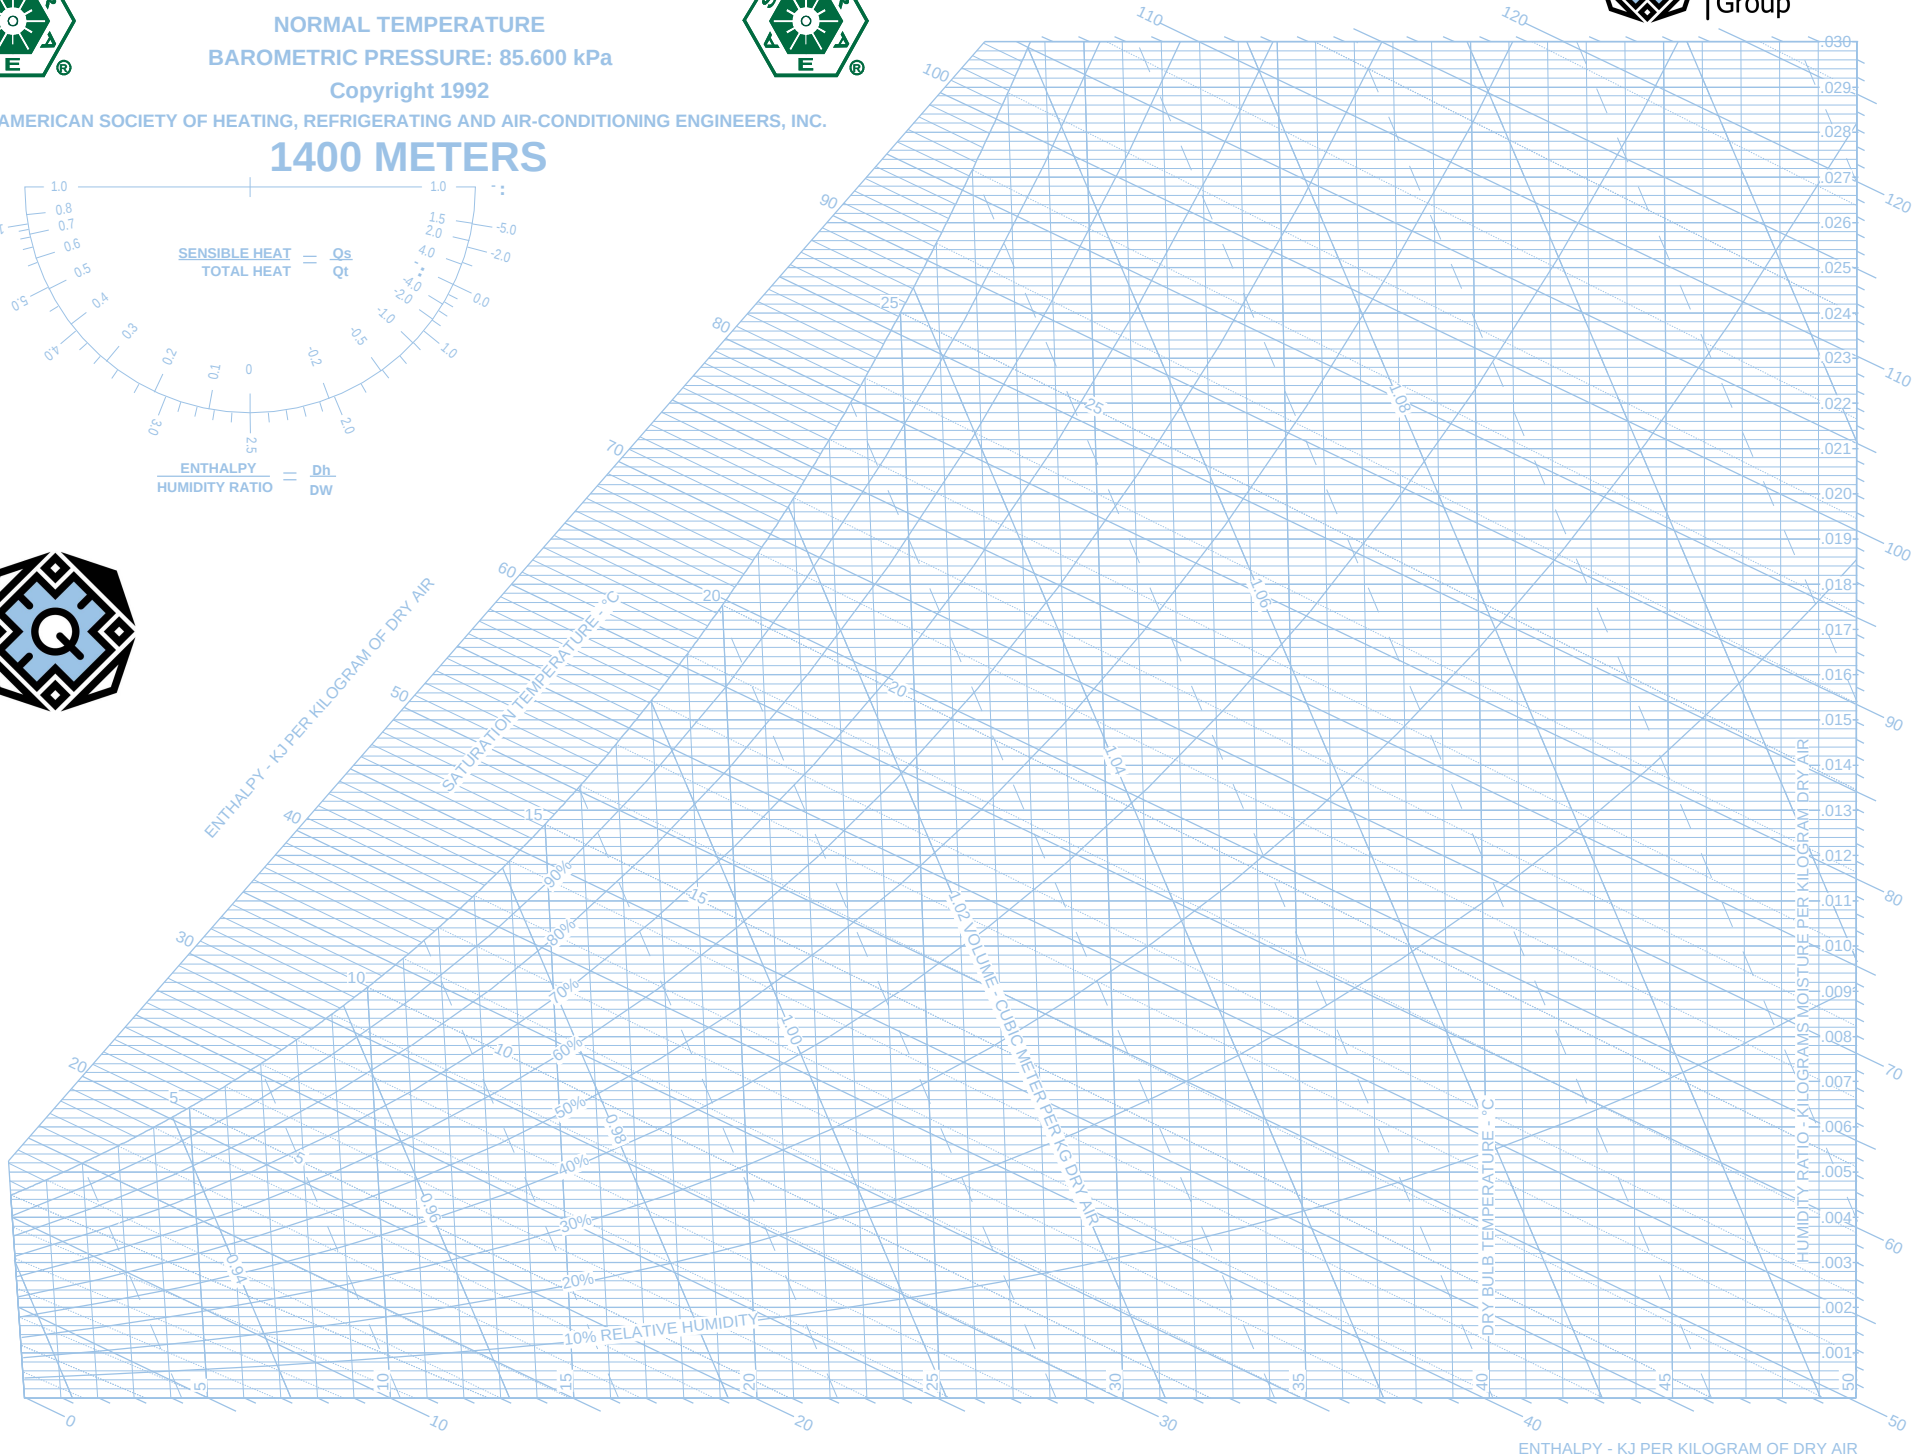



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 83.525 kPa


Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

1600 METERS



Quaternum
Solutions
Group

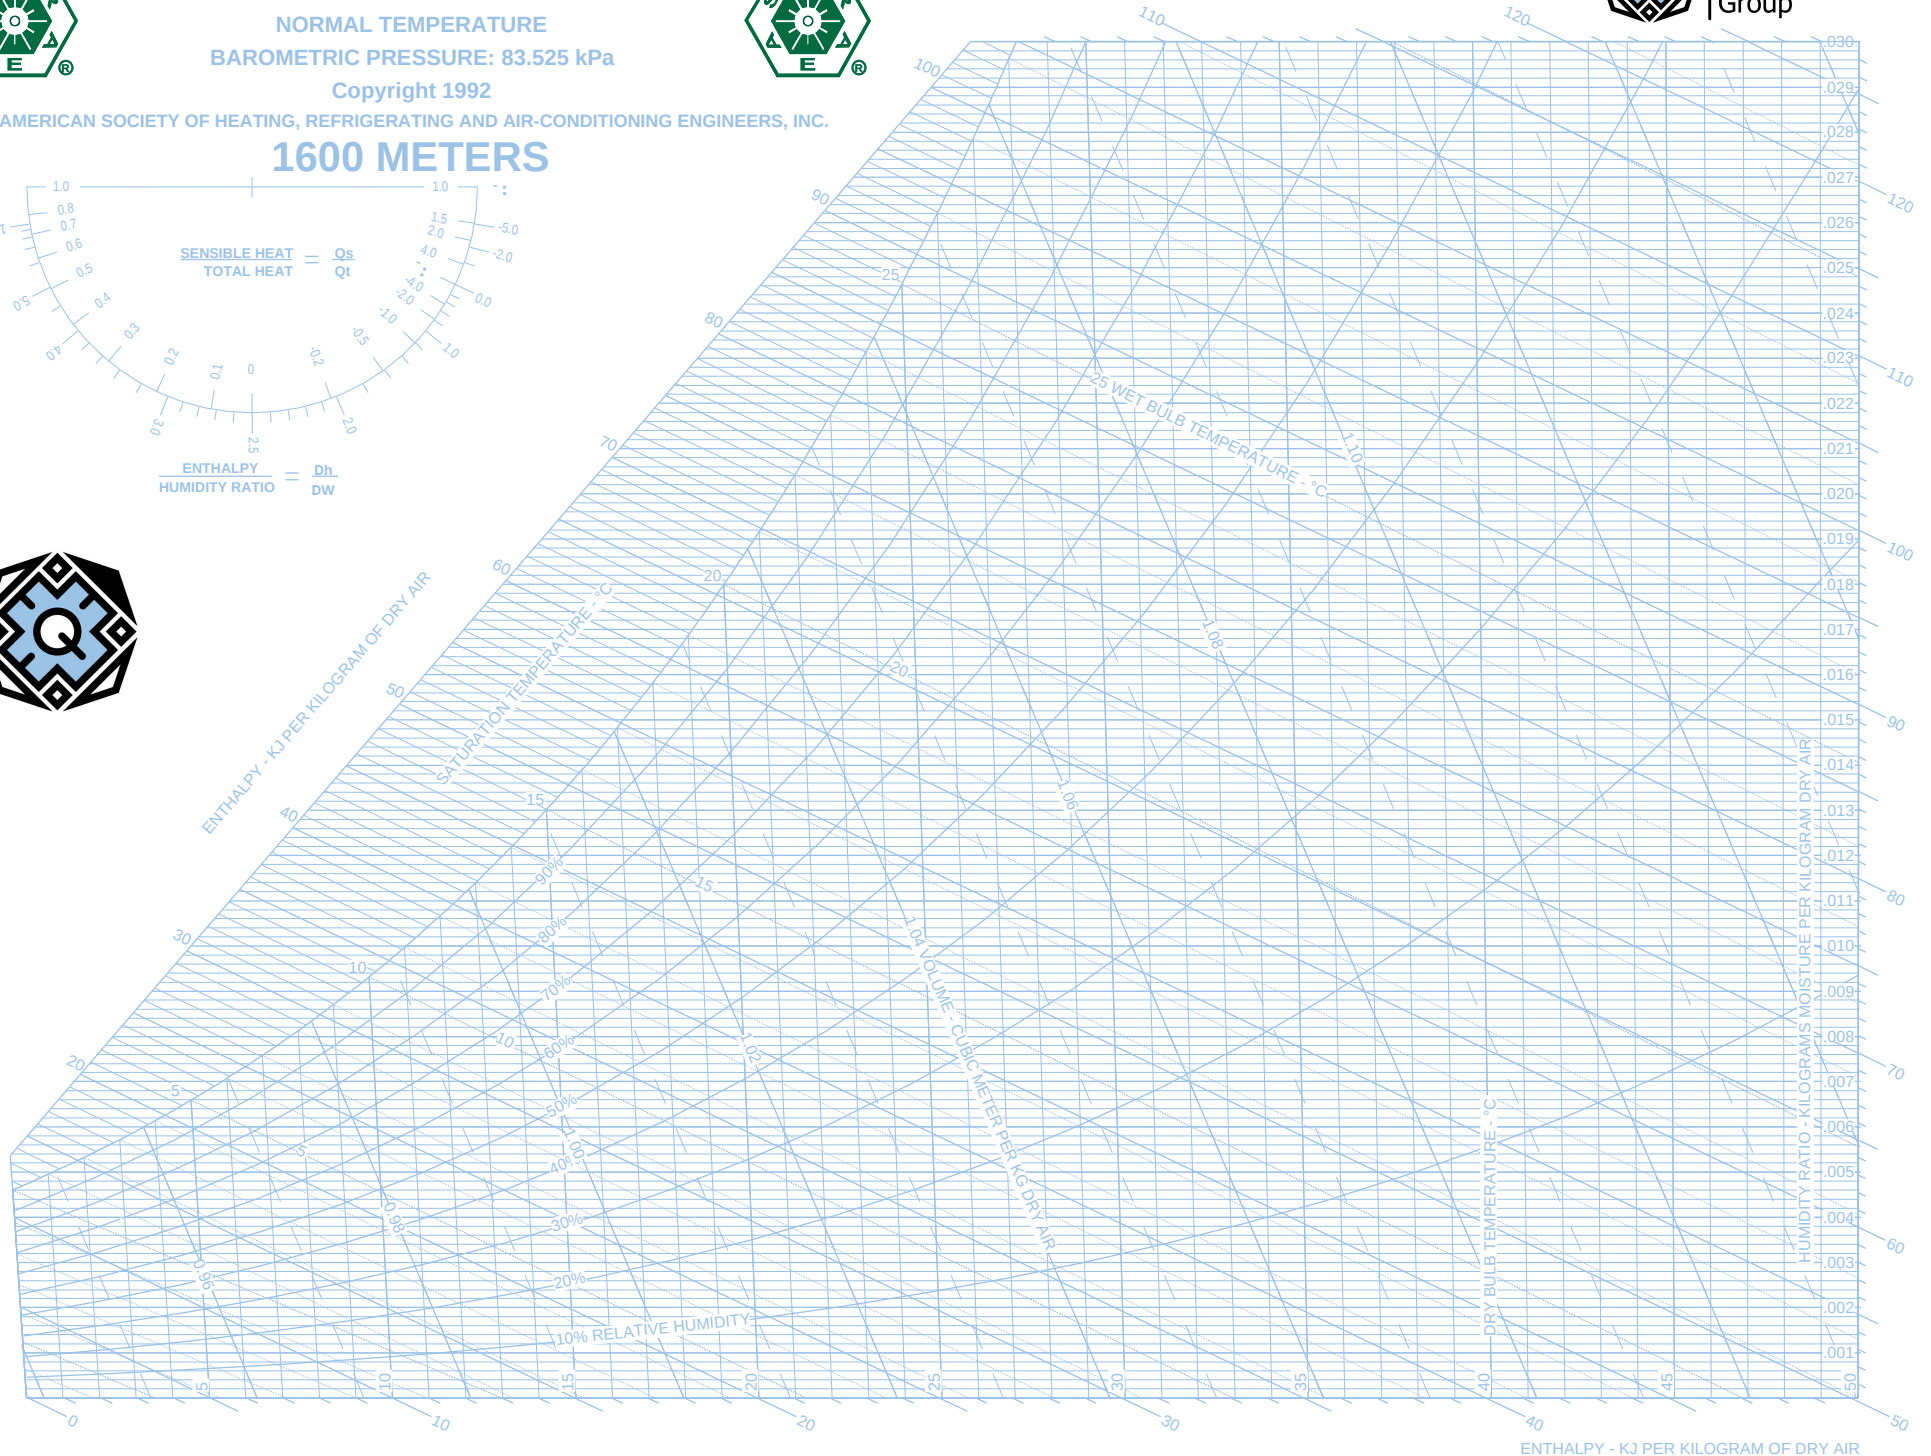



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 81.491 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

1800 METERS

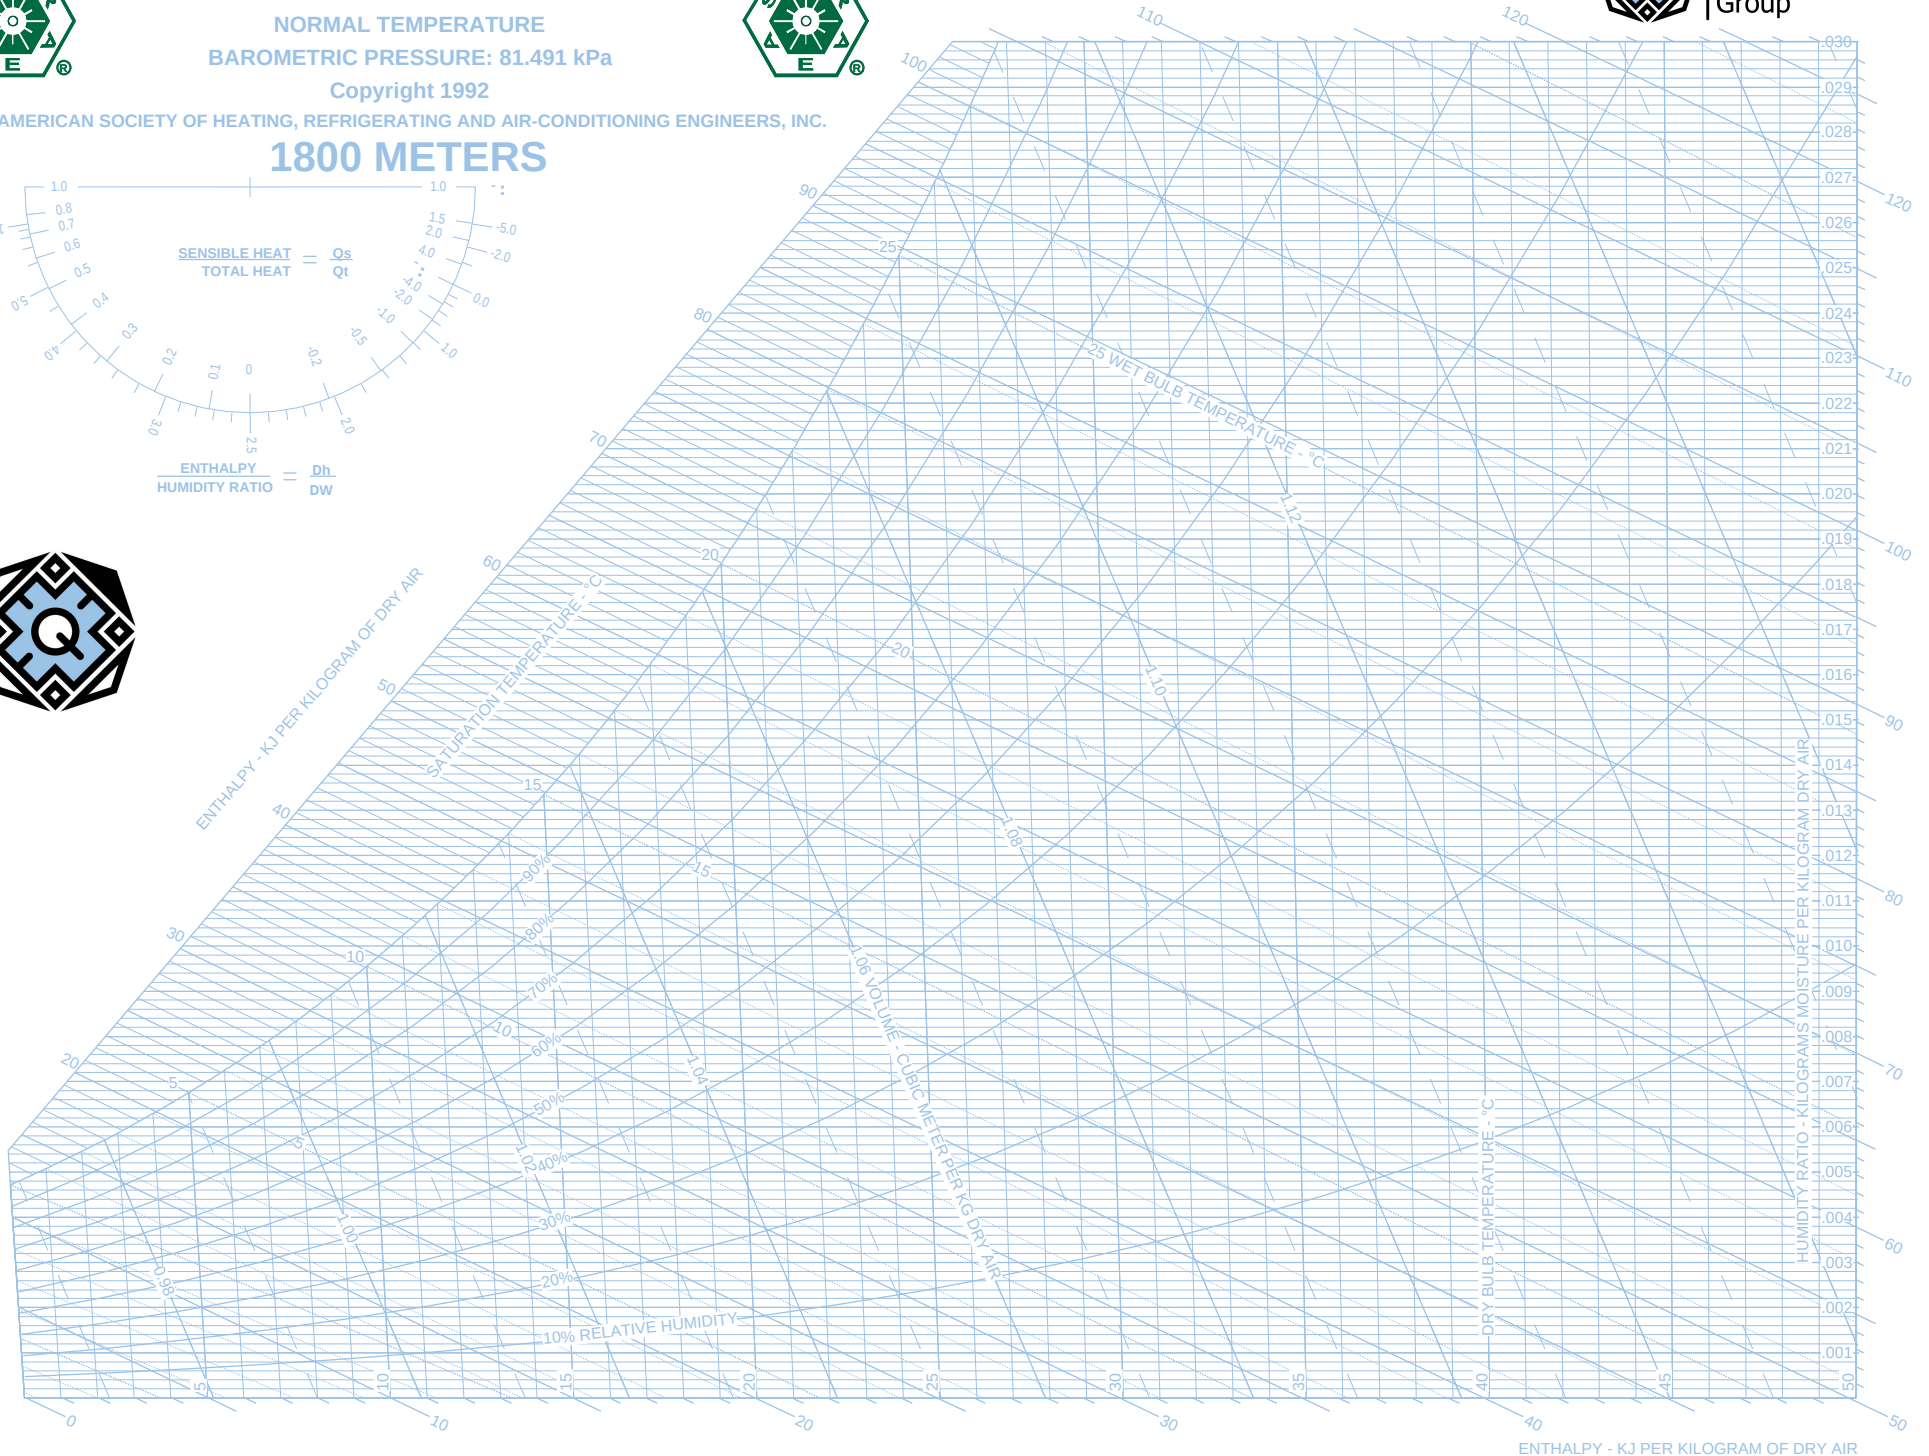



ASHRAE PSYCHROMETRIC CHART NO.1

NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 79.498 kPa



Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.



Quaternum
Solutions
Group

2000 METERS

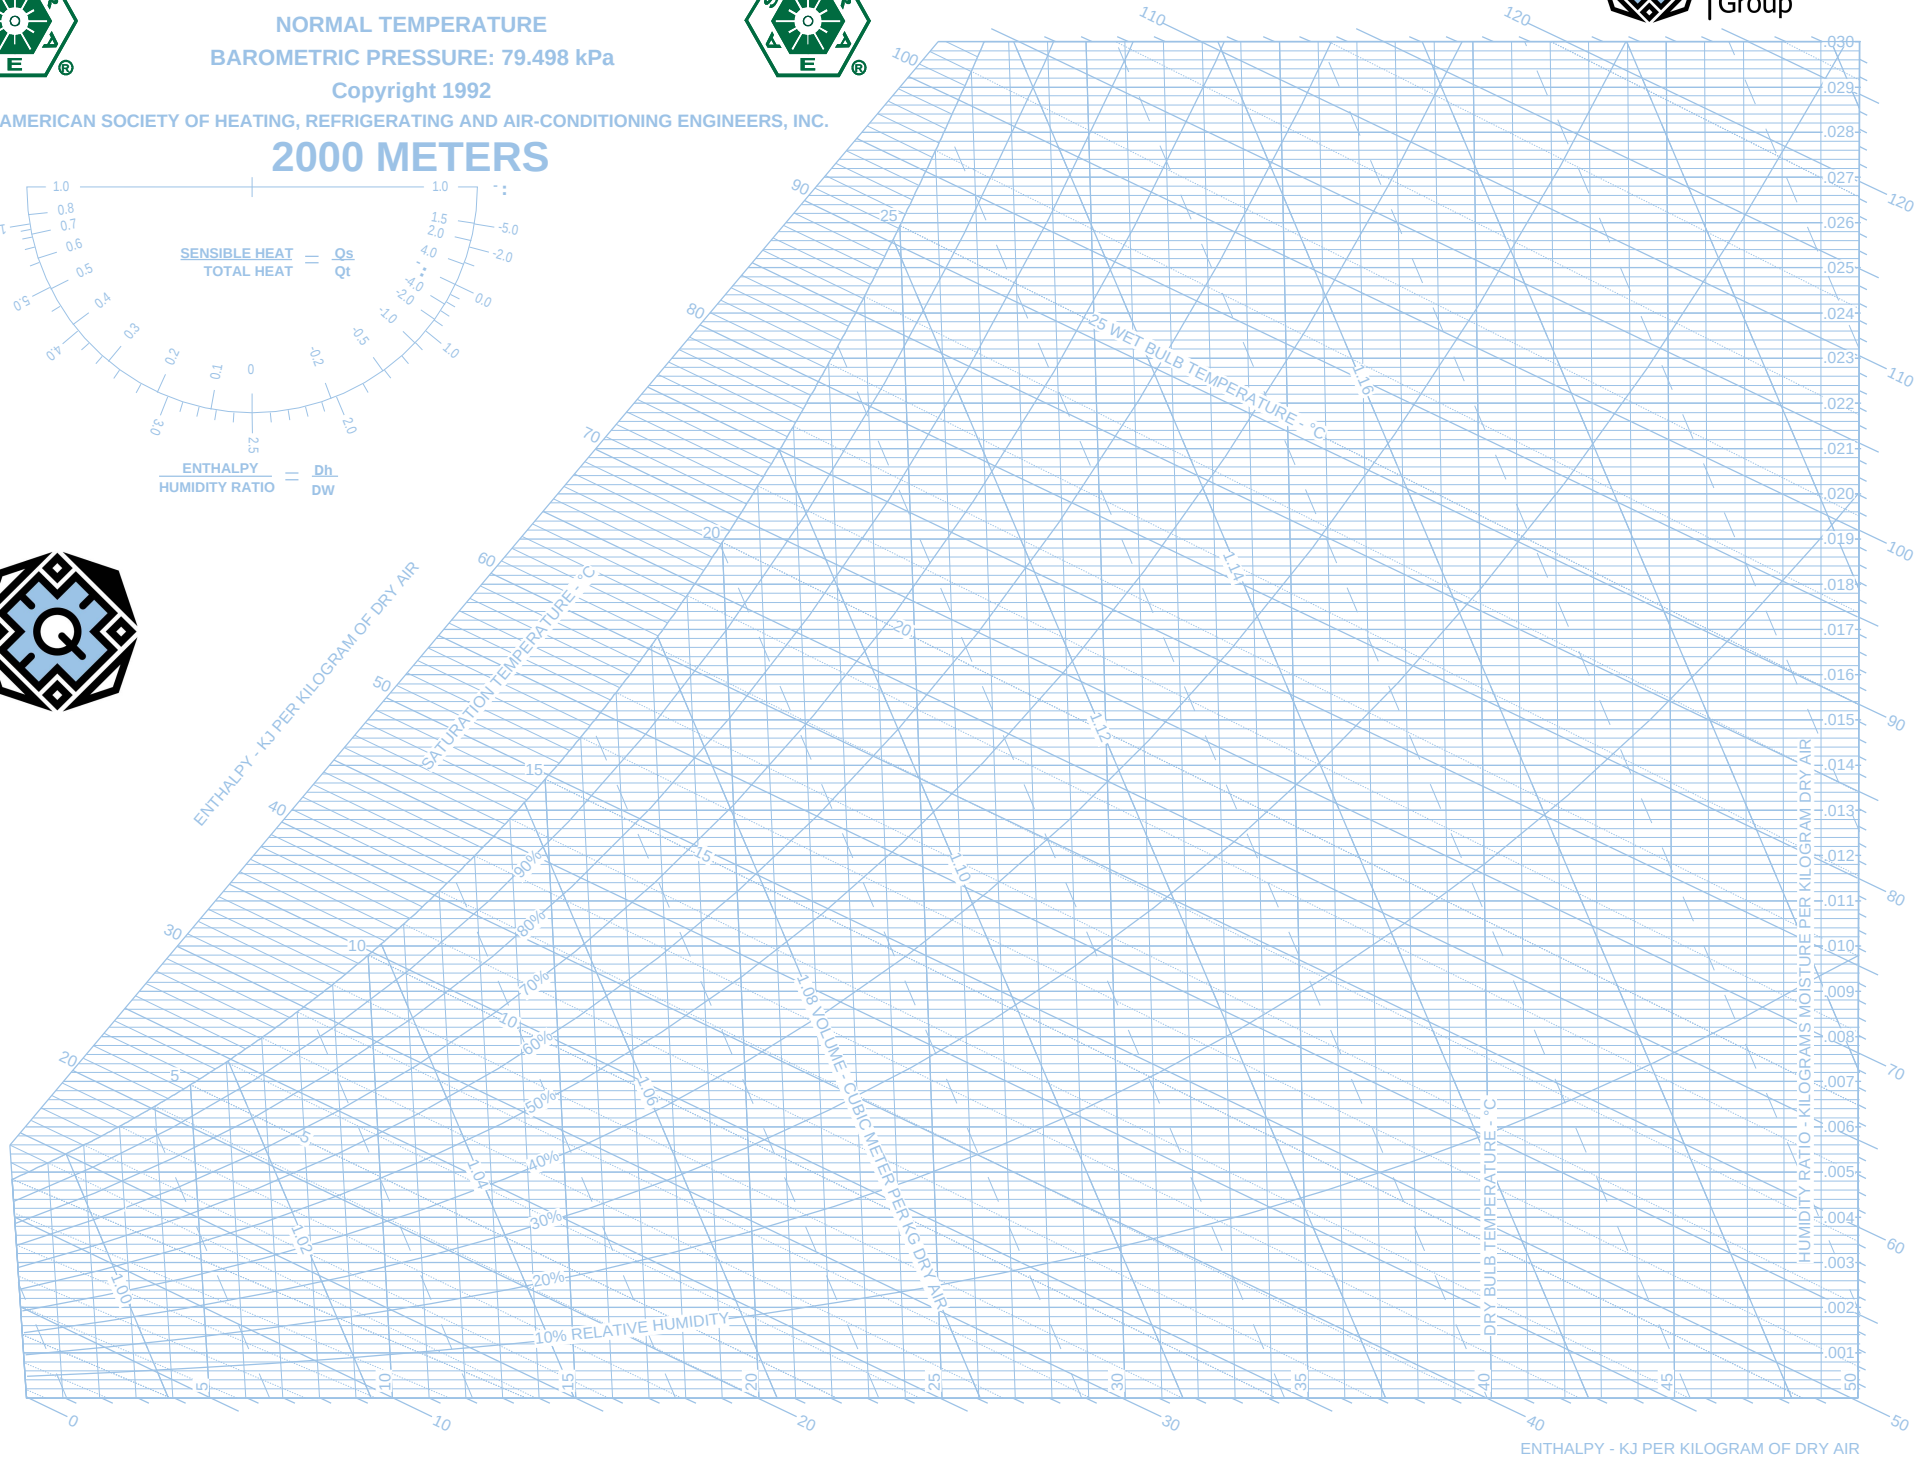



ASHRAE PSYCHROMETRIC CHART NO.1


NORMAL TEMPERATURE

BAROMETRIC PRESSURE: 75.627 kPa

Copyright 1992

AMERICAN SOCIETY OF HEATING, REFRIGERATING AND AIR-CONDITIONING ENGINEERS, INC.

2400 METERS



Quaternum
Solutions
Group

