

## Electrical Power Distribution

<b>CERTIFICATE OF COMPLIANCE</b>		<b>NRCC-ELC-E</b>
<i>This document is used to demonstrate compliance with mandatory requirements in 130.5, for electrical systems in newly constructed nonresidential and hotel/motel occupancies and 160.6 and 160.9 for electrical systems in newly constructed multifamily occupancies. Additions and alterations to electrical service systems in nonresidential and hotel/motel occupancies will also use this document to demonstrate compliance per 141.0(a) or 141.0(b)2P for alterations. For multifamily addition or alterations compliance will be documented per 180.1(a) or 180.2 (b)4Bvii</i>		
<b>Project Name:</b>	First Bank	<b>Report Page:</b> (Page 1 of 4)
<b>Project Address:</b>	4301 Macarthur Blvd.	<b>Date Prepared:</b> 6/20/2023

**A. GENERAL INFORMATION**

01	Project Location (city)	Newport Beach	02	Climate Zone	6
			03	Occupancy Types Within Project:	Office

**B. PROJECT SCOPE**

*This table includes electrical systems that are within the scope of the permit application.*

01	02	03	04	05	06	07
Electrical Service Designation/Description	Scope of Work <sup>1</sup>	Rating <sup>2</sup> (kVA)	Utility Provided Metering System Exception to 130.5(a)/160.6(a) <sup>3</sup>	System subject to CA Elec Code Article 517 Exception to 130.5(a) and (b)	Demand Response Controls	Provides power to dwelling units/common living areas only in multifamily occupancy
Main	Add/Alt to feeders and branch circuits only	50	<input type="checkbox"/>	<input type="checkbox"/>	Where required, demand response controls must be specified which are capable of receiving and automatically responding to at least one standards based messaging protocol which enables demand response after receiving a demand response signal. Sections 120.2/ 160.3, 130.1/ 160.5, and 130.3/ 160.5, and mechanical, indoor lighting, and sign lighting Certificate of Compliance documents will indicate when demand response controls are required.	<input type="checkbox"/>

<sup>1</sup> FOOTNOTES: Adding only new feeders and branch circuits triggers Voltage Drop 130.5(c)/160.6(c), no other requirements from 130.5/160.6 are required.

<sup>2</sup> If common use areas in a multifamily are submetered, rating is for submeter size serving common use areas.

<sup>3</sup> Applicable if the utility company is providing a metering system that indicates instantaneous kW demand and kWh for a utility-defined period.

Registration Number:

Generated Date/Time:

Documentation Software: EnergyPro

CA Building Energy Efficiency Standards - 2022 Nonresidential Compliance

 Report Version: 2022.0.000  
 Schema Version: rev 20220101

 Compliance ID:  
 EnergyPro-50207-0623-0564  
 Report Generated: 2023-06-20 16:07:34

CERTIFICATE OF COMPLIANCE			NRCC-ELC-E		
Project Name:		First Bank	Report Page:		(Page 2 of 4)
Project Address:		4301 Macarthur Blvd.	Date Prepared:		6/20/2023

C. COMPLIANCE RESULTS								
Results in this table are automatically calculated from data input and calculations in Tables F through J. Note: If any cell on this table says "COMPLIES with Exceptional Conditions" refer to Table D. Exceptional Conditions for guidance or see applicable Table referenced below.								
01	AND	02	AND	03	AND	04	05	06
Service Electrical Metering 130.5(a)/ 160.6(a) (See Table F)		Separation for Monitoring 130.5(b)/ 160.6(b) (See Table G)		Voltage Drop 130.5(c)/ 160.6(c) (See Table H)		Controlled Receptacles 130.5(d)/ 160.6(d) (See Table I)	Electric Ready 160.9 (See Table J)	Compliance Results
Yes		Yes		Yes		Yes	Yes	COMPLIES

D. EXCEPTIONAL CONDITIONS
This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

F. SERVICE ELECTRICAL METERING
This section does not apply to this project.

G. SEPARATION OF ELECTRICAL CIRCUITS FOR ENERGY MONITORING
This section does not apply to this project.

H. VOLTAGE DROP					
This table includes entirely new or complete replacement electrical power distribution systems, or alterations that add, modify or replace both feeders and branch circuits to demonstrate compliance with 130.5(c)/ 160.6(c). For alterations, only the altered circuits must demonstrate compliance per 141.0(b)2Piii/ 180.2(b)4Bviic.					
01	02	03	04	05	
Electrical Service Designation/Description	Combined Voltage Drop on Installed Feeder/Branch Circuit Conductors Compliance Method	Location of Voltage Drop Calculations <sup>1</sup>	Sheet Number for Voltage Drop Calculations in Construction Documents	Field Inspector	
				Pass	Fail

CERTIFICATE OF COMPLIANCE		NRCC-ELC-E
Project Name:	First Bank	Report Page: (Page 3 of 4)
Project Address:	4301 Macarthur Blvd.	Date Prepared: 6/20/2023

H. VOLTAGE DROP								
Main	<input checked="" type="checkbox"/>	Voltage drop less than 5%	<input type="checkbox"/>	Permitted by CA Elec Code (Exception to 130.5(c))*	Attached		<input type="checkbox"/>	<input type="checkbox"/>
* NOTES: If "Permitted by CA Elec Code *" is selected under Compliance Method above, please indicate where the exception applies in the space provided below.								
<sup>1</sup> FOOTNOTES: Voltage drop calculations may be attached to the permit application outside the construction documents if allowed by the Authority Having Jurisdiction. Select "attached" if applicable. If calculations will be the responsibility of the installing contractor, select "Contractor Responsible".								

I. CIRCUIT CONTROLS FOR 120-VOLT RECEPTACLES AND CONTROLLED RECEPTACLES
This section does not apply to this project.

J. ELECTRIC READY BUILDINGS
This section does not apply to this project.

K. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION
Form/Title
NRCI-ELC-E - Must be submitted for all buildings

CERTIFICATE OF COMPLIANCE		NRCC-ELC-E	
Project Name:	First Bank	Report Page:	(Page 4 of 4)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/20/2023

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: Mohamad Nohayli	Documentation Author Signature: <b>Mohamad Nohayli</b>
Company: InnoDez, Inc.	Signature Date: <b>2023.06.20</b>
Address:	CEA/ HERS Certification Identification (if applicable):
City/State/Zip:	Phone:
RESPONSIBLE PERSON'S DECLARATION STATEMENT	
I certify the following under penalty of perjury, under the laws of the State of California:	
<div><div>1.</div><div>The information provided on this Certificate of Compliance is true and correct.</div></div> <div><div>2.</div><div>I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)</div></div> <div><div>3.</div><div>The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.</div></div> <div><div>4.</div><div>The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.</div></div> <div><div>5.</div><div>I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.</div></div>	
Responsible Designer Name: Syed P. Alam	Responsible Designer Signature: <b>Syed Alam</b>
Company: Innodez Inc.	Date Signed: 2023-06-20
Address: 726 Foxbrough	License: 27087
City/State/Zip: Pleasanton CA 94566	Phone:

Indoor Lighting

CERTIFICATE OF COMPLIANCE		NRCC-LTI-E	
<i>This document is used to demonstrate compliance with requirements in 110.9, 110.12(c), 130.0, 130.1, 140.6 and 141.0(b)2 for indoor lighting scopes using the prescriptive path for nonresidential and hotel/motel occupancies. It is also used to document compliance with requirements in 160.5, 170.2(e) and 180.2(b)4 for indoor lighting scopes using the prescriptive path for multifamily occupancies. Multifamily includes dormitory and senior living facilities.</i>			
Project Name:		First Bank	Report Page: (Page 1 of 8)
Project Address:		4301 Macarthur Blvd.	Date Prepared: 6/27/2023

A. GENERAL INFORMATION					
01	Project Location (city)	Newport Beach	04	Total Conditioned Floor Area (ft²)	6,000
02	Climate Zone	6	05	Total Unconditioned Floor Area (ft²)	0
03	Occupancy Types Within Project (select all that apply):		06	# of Stories (Habitable Above Grade)	1
● Office					

B. PROJECT SCOPE					
<i>This table includes any lighting systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.6 / 170.2(e) or 141.0(b)2 / 180.2(b)4 for alterations.</i>					
Scope of Work		Conditioned Spaces		Unconditioned Spaces	
01		02	03	04	05
My Project Consists of (check all that apply):		Calculation Method	Area (ft²)	Calculation Method	Area (ft²)
<input type="checkbox"/> New Lighting System					
<input type="checkbox"/> New Lighting System - Parking Garage					
<input checked="" type="checkbox"/> Altered Lighting System		Area Category Method	6000	Area Category Method	0
Total Area of Work (ft²)		6000		0	

Indoor Lighting

CERTIFICATE OF COMPLIANCE				NRCC-LTI-E	
Project Name:		First Bank	Report Page:		(Page 2 of 8)
Project Address:		4301 Macarthur Blvd.	Date Prepared:		6/27/2023

C. COMPLIANCE RESULTS												
If any cell on this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D. for guidance.												
Lighting in conditioned and unconditioned spaces must not be combined for compliance per 140.6(b)1 / 170.2(e)	Allowed Lighting Power per 140.6(b) / 170.2(e) (Watts)						≥	Adjusted Lighting Power per 140.6(a) / 170.2(e) (Watts)				Compliance Results
	01	02	03	04	=	05		06	07	=	08	09
	Complete Building 140.6(c)1	Area Category 140.6(c)2 / 170.2(e)4	Area Category Additional 140.6(c)2G / 170.2(e)4Av ( + )	Tailored 140.6(c)3 / 170.2(e)4B ( + )		Total Allowed (Watts)		Total Designed (Watts)	Adjustments		Total Adjusted (Watts) *Includes Adjustments	05 must be >= 08 140.6 / 170.2(e)
									PAF Lighting Control Credits 140.6(a)2 / 170.2(e)1B ( - )			
									(See Table I)			
Conditioned		3,600	0		=	3,600	≥	2,206	0	=	2206	COMPLIES
Unconditioned					=		≥			=		
Controls Compliance (See Table H for Details)												COMPLIES
Rated Power Reduction Compliance (See Table Q for Details)												

D. EXCEPTIONAL CONDITIONS
This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

Indoor Lighting

CERTIFICATE OF COMPLIANCE					NRCC-LTI-E				
Project Name:			First Bank		Report Page:			(Page 3 of 8)	
Project Address:			4301 Macarthur Blvd.		Date Prepared:			6/27/2023	

F. INDOOR LIGHTING FIXTURE SCHEDULE										
This table includes all planned permanent and portable lighting other than dwelling unit/ hotel/ motel room lighting. Multifamily dwelling unit and hotel/motel room lighting is documented in Table T. If using Table T to document lighting in multifamily common use areas providing shared provisions for living, eating, cooking or sanitation, those luminaires are not included here.										
Designed Wattage: Conditioned Spaces										
01	02	03	04	05	06	07	08	09	10	
Name or Item Tag	Complete Luminaire Description	Modular (Track) Fixture	Small Aperture & Color Change <sup>1</sup>	Watts per luminaire <sup>2</sup>	How is Wattage determined	Total Number of Luminaires	Excluded per 140.6(a)3 / 170.2(e)2C	Design Watts	Field Inspector	
									Pass	Fail
L1	L1 - Recessed Round Light	No	NA	10.5	Mfr. Spec	1	No	10.5	<input type="checkbox"/>	<input type="checkbox"/>
L2	L2 - Surface Mounted 1x4	No	NA	38.9	Mfr. Spec	8	No	311.2	<input type="checkbox"/>	<input type="checkbox"/>
L3	L3 - Surface Mounted 2 x 4	No	NA	39	Mfr. Spec	46	No	1,794	<input type="checkbox"/>	<input type="checkbox"/>
L4	L4 - 4" Can light Halo	No	NA	10	Mfr. Spec	9	No	90	<input type="checkbox"/>	<input type="checkbox"/>
Total Designed Watts: CONDITIONED SPACES								2,206		

<sup>1</sup>FOOTNOTE: Design Watts for small aperture and color changing luminaires which qualify per 140.6(a)4B / 170.2(e)2D is adjusted to be 75% /80% of their rated wattage. Table F automatically makes this adjustment, the permit applicant should enter full rated wattage in column 05.

<sup>2</sup>Authority Having Jurisdiction may ask for Luminaire cut sheets to confirm wattage used for compliance per 130.0(c) / 160.5(b). Wattage used must be the maximum rated for the luminaire, not the lamp.

G. MODULAR LIGHTING SYSTEMS
This section does not apply to this project.

H. INDOOR LIGHTING CONTROLS (Not including PAFs)		
This table includes lighting controls for conditioned and unconditioned spaces.		
Building Level Controls		
01	02	03
Mandatory Demand Response 110.12(c)	Shut-off controls 130.1(c) / 160.5(b)4C	Field Inspector
		Pass Fail
Required >= 4,000W subject to multilevel	Whole Building Auto Time Switch	<input type="checkbox"/> <input type="checkbox"/>

## Indoor Lighting

CERTIFICATE OF COMPLIANCE			NRCC-LTI-E		
Project Name:		First Bank	Report Page:		(Page 4 of 8)
Project Address:		4301 Macarthur Blvd.	Date Prepared:		6/27/2023

## H. INDOOR LIGHTING CONTROLS (Not including PAFs)

## Area Level Controls

04	05	06	07	08	09	10	11	12	
Area Description	Complete Building or Area Category Primary Function Area	Manual Area Controls 130.1(a) / 160.5(b)4A	Multi-Level Controls 130.1(b) / 160.5(b)4B	Shut-Off Controls 130.1(c) // 160.5(b)4C	Primary/Sky lit Daylighting 130.1(d) / 160.5(b)4D	Secondary Daylighting 130.1(d) / 160.5(b)4D	Interlocked Systems 140.6(a)1/ 170.2(e)2A	Field Inspector	
								Pass	Fail
Main Bank Entry	Main Entry Lobby	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Waiting Area	Lounge	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Cash Vault	All Other Space Types	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Meeting Room	Convention, Conference, Multipurpose and Meeting Center	Readily Accessible	Dimmer	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Lobby ITM	Main Entry Lobby	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Manager's Office	Office ( <=250 square feet)	Readily Accessible	Dimmer	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Toilet Room	Restroom	Readily Accessible	NA: Restrooms	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Server	Electrical Mechanical Telephone Room	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Lockers	All Other Space Types	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Utility Room	Electrical Mechanical Telephone Room	Readily Accessible	NA: Enclosed area <100SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Safe Deposit Vault	Commercial Industrial Storage Shipping	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>

Registration Number:

Generated Date/Time:

Documentation Software: EnergyPro



Indoor Lighting

CERTIFICATE OF COMPLIANCE				NRCC-LTI-E			
Project Name:		First Bank	Report Page:		(Page 5 of 8)		
Project Address:		4301 Macarthur Blvd.	Date Prepared:		6/27/2023		

H. INDOOR LIGHTING CONTROLS (Not including PAFs)									
Open Office	Office ( >250 square feet)	Readily Accessible	Dimmer	See Building Level	Included	Included	No	<input type="checkbox"/>	<input type="checkbox"/>
Breakroom	Lounge	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	Included	Included	No	<input type="checkbox"/>	<input type="checkbox"/>
Large Meeting Room	Convention, Conference, Multipurpose and Meeting Center	Readily Accessible	Dimmer	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
Office Rooms	Office ( <=250 square feet)	Readily Accessible	NA: General Ltg <= 0.5W/SF	Occupancy Sensor	NA: Rm < 24sf Glazing	NA: Rm < 24sf Glazing	No	<input type="checkbox"/>	<input type="checkbox"/>
					13				
					Plan Sheet Showing Daylit Zones:				

I. LIGHTING POWER ALLOWANCE: COMPLETE BUILDING OR AREA CATEGORY METHODS						
Each area complying using the Complete Building or Area Category Methods per 140.6(b) are included in this table. Column 06 indicates if additional lighting power allowances per 140.6(c) or adjustments per 140.6(a) are being used .						
Conditioned Spaces						
01	02	03	04	05	06	
Area Description	Complete Building or Area Category Primary Function Area	Allowed Density (W/ft²)	Area (ft²)	Allowed Wattage (Watts)	Additional Allowance / Adjustment	
					Area Category	PAF
Office Building 01	Office ( >250 square feet)	0.6	4,500	2,700	No	No
Office Building 02	Office ( >250 square feet)	0.6	1,500	900	No	No
TOTALS:			6,000	3,600	See Tables J, or P for detail	

J. ADDITIONAL ALLOWANCE: AREA CATEGORY METHOD QUALIFYING LIGHTING SYSTEM
This section does not apply to this project.

CERTIFICATE OF COMPLIANCE		NRCC-LTI-E	
Project Name:	First Bank	Report Page:	(Page 6 of 8)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/27/2023

**K. TAILORED METHOD GENERAL LIGHTING POWER ALLOWANCE***This section does not apply to this project.***L. ADDITIONAL LIGHTING ALLOWANCE: TAILORED WALL DISPLAY***This section does not apply to this project.***M. ADDITIONAL LIGHTING ALLOWANCE: TAILORED FLOOR AND TASK LIGHTING***This section does not apply to this project.***N. ADDITIONAL LIGHTING ALLOWANCE: TAILORED DECORATIVE /SPECIAL EFFECTS***This section does not apply to this project.***O. ADDITIONAL LIGHTING ALLOWANCE: TAILORED VERY VALUABLE MERCHANDISE***This section does not apply to this project.***P. POWER ADJUSTMENT: LIGHTING CONTROL CREDIT (POWER ADJUSTMENT FACTOR (PAF))***This section does not apply to this project.***Q. RATED POWER REDUCTION COMPLIANCE FOR ONE-FOR-ONE ALTERATIONS***This section does not apply to this project.***R. 80% LIGHTING POWER FOR ALL ALTERATIONS - CONTROLS EXCEPTIONS***This section does not apply to this project.*

Indoor Lighting

CERTIFICATE OF COMPLIANCE		NRCC-LTI-E	
Project Name:	First Bank	Report Page:	(Page 7 of 8)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/27/2023

S. DAYLIGHT DESIGN POWER ADJUSTMENT FACTOR (PAF)
<i>This section does not apply to this project.</i>

T. DWELLING UNIT LIGHTING
<i>This section does not apply to this project.</i>

U. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION
Form/Title
NRCI-LTI-E - Must be submitted for all buildings

V. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE	
Form/Title	Systems/Spaces To Be Field Verified
NRCA-LTI-02-A - Must be submitted for occupancy sensors and automatic time switch controls.	Whole Building Time Switch; Main Bank Entry; Waiting Area; Cash Vault; Meeting Room; Lobby ITM; Manager's Office; Toilet Room; Server; Lockers; Utility Room; Safe Deposit Vault; Breakroom; Large Meeting Room; Office Rooms;
NRCA-LTI-03-A - Must be submitted for automatic daylight controls.	Open Office; Breakroom;
NRCA-LTI-04-A - Must be submitted for demand responsive lighting controls.	Whole Building Demand Response;

Indoor Lighting

CERTIFICATE OF COMPLIANCE		NRCC-LTI-E	
Project Name:	First Bank	Report Page:	(Page 8 of 8)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/27/2023

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: Mohamad Nohayli	Documentation Author Signature: Mohamad Nohayli
Company: InnoDez, Inc.	Signature Date: 2023-06-27
Address:	CEA/ HERS Certification Identification (if applicable):
City/State/Zip:	Phone:
RESPONSIBLE PERSON'S DECLARATION STATEMENT	
I certify the following under penalty of perjury, under the laws of the State of California:	
<div>1. The information provided on this Certificate of Compliance is true and correct.</div> <div>2. I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)</div> <div>3. The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.</div> <div>4. The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.</div> <div>5. I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.</div>	
Responsible Designer Name: Syed P. Alam	Responsible Designer Signature: Syed Alam
Company: Innodez Inc.	Date Signed: 2023-06-27
Address: 726 Foxbrough	License: 27087
City/State/Zip: Pleasanton CA 94566	Phone:

Mechanical Systems

CERTIFICATE OF COMPLIANCE		NRCC-MCH-E	
This document is used to demonstrate compliance for mechanical systems that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.4, or 141.0(b)2 for alterations.			
Project Name:		First Bank	Report Page: (Page 1 of 8)
Project Address:		4301 Macarthur Blvd.	Date Prepared: 6/20/2023

A. GENERAL INFORMATION					
01	Project Location (city)	Newport Beach	04	Total Conditioned Floor Area	6000
02	Climate Zone	6	05	Total Unconditioned Floor Area	0
03	Occupancy Types Within Project:		06	# of Stories (Habitable Above Grade)	1
• Office					

B. PROJECT SCOPE					
This table Includes mechanical systems or components that are within the scope of the permit application and are demonstrating compliance using the prescriptive path outlined in 140.4, 170.2(b) or 141.0(b)2 and 180.2(b)2 for alterations.					
01		02		03	
Air System(s)		Wet System Components		Dry System Components	
<input checked="" type="checkbox"/>	Heating Air System	<input type="checkbox"/>	Water Economizer	<input type="checkbox"/>	Air Economizer
<input checked="" type="checkbox"/>	Cooling Air System	<input type="checkbox"/>	Pumps	<input type="checkbox"/>	Electric Resistance Heat
Mechanical Controls		<input type="checkbox"/>	System Piping	<input type="checkbox"/>	Fan Systems
<input checked="" type="checkbox"/>	Mechanical Controls (existing to remain, altered or new)	<input type="checkbox"/>	Cooling Towers	<input type="checkbox"/>	Ductwork (existing to remain, altered or new)
		<input type="checkbox"/>	Chillers	<input checked="" type="checkbox"/>	Ventilation
		<input type="checkbox"/>	Boilers	<input type="checkbox"/>	Zonal Systems/ Terminal Boxes

Mechanical Systems

CERTIFICATE OF COMPLIANCE										NRCC-MCH-E					
Project Name:					First Bank					Report Page:					
Project Address:					4301 Macarthur Blvd.					Date Prepared:					

C. COMPLIANCE RESULTS															
Table C will indicate if the project data input into the compliance document is compliant with mechanical requirements. This table is not editable by the user. If this table says "DOES NOT COMPLY" or "COMPLIES with Exceptional Conditions" refer to Table D., or the table indicated as not compliant for guidance.															
01	AND	02	AND	03	AND	04	AND	05	AND	06	AND	07	AND	08	09
System Summary 110.1, 110.2, 140.4, 170.2(c)		Pumps 140.4(k), 170.2(c)4I		Fans/ Economizers 140.4(c), 140.4(e), 170.2(c)		System Controls 110.2, 120.2, 140.4(f), 170.2(c)		Ventilation 120.1, 160.2		Terminal Box Controls 140.4(d), 170.2(c)4B		Distribution 120.3, 140.4(l), 160.2, 160.3		Cooling Towers 110.2(e)2	Compliance Results
(See Table F)		(See Table G)		(See Table H)		(See Table I)		(See Table J)		(See Table K)		(See Table L)		(See Table M)	
	AND		AND		AND	Yes	AND	Yes	AND		AND		AND		COMPLIES
Mandatory Measures Compliance (See Table Q for Details)										COMPLIES					

D. EXCEPTIONAL CONDITIONS
This table is auto-filled with uneditable comments because of selections made or data entered in tables throughout the form.

E. ADDITIONAL REMARKS
This table includes remarks made by the permit applicant to the Authority Having Jurisdiction.

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)					
Space Conditioning System Information					
01	02	03	04	05	06
System Name	Quantity	System Serving	System Status	Space Type	Utilizing Recovered Heat

Mechanical Systems

CERTIFICATE OF COMPLIANCE					NRCC-MCH-E				
Project Name:			First Bank	Report Page:			(Page 3 of 8)		
Project Address:			4301 Macarthur Blvd.	Date Prepared:			6/20/2023		

F. HVAC SYSTEM SUMMARY (DRY & WET SYSTEMS)										
Dry System Equipment Sizing (includes air conditioners, condensers, heat pumps, VRF, furnaces and unit heaters and DOAS systems)										
01	02	03	04	05	06	07	08	09	10	11
Name or Item Tag	Equipment Category per Tables 110.2, 140.4(a)2 and 170.2(c)3a <sup>ii</sup>	Equipment Type per Tables 110.2 and Title 20	Smallest Size Available <sup>1</sup> 140.4(a) and 170.2(c)1	Equipment Sizing per Mechanical Schedule (kBtu/h) 140.4(a&b), 170.2(c)1 & 170.2(c)2						
				Heating Output <sup>2,3</sup>			Cooling Output <sup>2,3</sup>		Load Calculations <sup>3,4</sup>	
				Per Design (kBtu/h)	Rated (kBtu/h)	Supp. Heating Output (kBtu/h)	Sensible Per Design (kBtu/h)	Rated (kBtu/h)	Total Heating Load (kBtu/h)	Total Sensible Cooling Load (kBtu/h)

<sup>1</sup>FOOTNOTES: Equipment shall be the smallest size, within the available options of the desired equipment line, necessary to meet the design heating and cooling loads of the building per 140.4(a) and 170.2(c)1. Healthcare facilities are excepted.

<sup>2</sup>It is common practice to show rated output capacity on the equipment schedule. Sensible cooling output comes from specification sheet tables.

<sup>3</sup>If equipment is heating only, leave cooling output and load blank. If equipment is cooling only, leave heating output and load blank.

<sup>4</sup>Authority Having Jurisdiction may ask for load calculations used for compliance per 140.4(b) and 170.2(c).

G. PUMPS
This section does not apply to this project.

H. FAN SYSTEMS & AIR ECONOMIZERS
This section does not apply to this project.

Mechanical Systems

CERTIFICATE OF COMPLIANCE				NRCC-MCH-E			
Project Name:		First Bank		Report Page:		(Page 4 of 8)	
Project Address:		4301 Macarthur Blvd.		Date Prepared:		6/20/2023	

I. SYSTEM CONTROLS								
This table is used to demonstrate compliance with mandatory controls in 110.2 and 120.2 and prescriptive controls in 140.4(f) and (n), 170.2(c)4D 170.2(c)4L or requirements in 141.0(b)2E 180.2(b)2 for altered space conditioning systems.								
01	02	03	04	05	06	07	08	09
System Name	System Zoning	Conditioned Floor Area Being Served (ft²)	Thermostats 110.2(b) & (c) <sup>1</sup> , 120.2(a) 160.3(a)2A or 141.0(b)2E & 180.2(b)2	Shut-Off Controls 120.2(e) & 160.3(a)2D	Isolation Zone Controls 120.2(g) & 160.3(a)2F	Demand Response 110.12 120.2(b) & 160.3(a)2B	Supply Air Temp. Reset 140.4(f) & 170.2(c)4D	Window Interlocks per 140.4(n) & 170.2(c)4D

<sup>1</sup>FOOTNOTES: Gravity gas wall heaters, gravity floor heaters, gravity room heaters, non-central electric heaters, fireplaces or decorative gas appliances, wood stoves are not required to have setback thermostats.

J. VENTILATION AND INDOOR AIR QUALITY

This table is used to demonstrate compliance with mandatory ventilation requirements in 120.1 120.2(e)3B 140.4(p) and 140.4(q) for all nonresidential and hotel/motel and d:t24refnolink/]160.2, 160.3(a)3D, 170.2(a)4N, 170.2(a)4O for high-rise residential occupancies. For alterations, only ventilation systems being altered within the scope of the permit application need to be documented in this table. In lieu of this table, the required outdoor ventilation rates and airflows may be shown on the plans or the calculations can be presented in a spreadsheet.

01	<input type="checkbox"/>	Check the box if the project is showing ventilation calculations on the plans, or attaching the calculations instead of completing this table.						
02	<input checked="" type="checkbox"/>	Check this box if the project included Nonresidential, Hotel/Motel Spaces or Multifamily Common Use Spaces						
	<input type="checkbox"/>							
03	<input type="checkbox"/>	Check the box if the project is using natural ventilation in any nonresidential or hotel/motel spaces to meet required ventilation rates per 120.1(c)2.						

Nonresidential and Hotel/ Motel Multifamily Common Use Ventilation Systems

04			05		06		07		
System Name	RTU-01		System Design OA CFM Airflow <sup>1</sup>		675	System Design Transfer Air CFM		0	Air Filtration per 120.1(c) 141.0(b)2 and 160.2(c)21 <sup>2</sup>
									Provided
08	09		10	11	12	13	14	15	16



## Mechanical Systems

CERTIFICATE OF COMPLIANCE					NRCC-MCH-E				
Project Name:			First Bank		Report Page:			(Page 5 of 8)	
Project Address:			4301 Macarthur Blvd.		Date Prepared:			6/20/2023	

## J. VENTILATION AND INDOOR AIR QUALITY

Space Name or Item Tag	Mechanical Ventilation Required per 120.1(c)3 <sup>3</sup> & 160.2(c)3					Exh. Vent per 120.1(c)4 & 160.2(c)4		DCV or Sensor Controls per 120.1(d)3, 120.1(d)5, and 120.1(e)3 <sup>6</sup> 160.2(c)5D 160.2(c)5E 160.2(c)5D	
	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM		
Office Building 01	Office space	4500			675	0	0	DCV	NA: Not required per <a href="#">§120.1(d)3</a>
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				675	18	Ventilation for this System Complies?		Yes
04		05			06			07	
System Name	RTU-02	System Design OA CFM Airflow <sup>1</sup>		225	System Design Transfer Air CFM		0	Air Filtration per 120.1(c) 141.0(b)2 and 160.2(c)21 <sup>2</sup>	
								Provided	
08	09	10	11	12	13	14	15	16	
Space Name or Item Tag	Mechanical Ventilation Required per 120.1(c)3 <sup>3</sup> & 160.2(c)3					Exh. Vent per 120.1(c)4 & 160.2(c)4		DCV or Sensor Controls per 120.1(d)3, 120.1(d)5, and 120.1(e)3 <sup>6</sup> 160.2(c)5D 160.2(c)5E 160.2(c)5D	
	Occupancy Type <sup>4</sup>	Conditioned Floor Area (ft <sup>2</sup> )	# of Shower heads/ toilets	# of people <sup>5</sup>	Required Min OA CFM	Required Min CFM	Provided per Design CFM		
Office Building 02	Office space	1500			225	0	0	DCV	NA: Not required per <a href="#">§120.1(d)3</a>
								Occ Sensor	NA: Not required space type
17	Total System Required Min OA CFM				225	18	Ventilation for this System Complies?		Yes

<sup>1</sup> FOOTNOTES: System CFM should include both mechanical and natural ventilation for the zone/system<sup>2</sup> Air filtration requirements apply to the following three system types per 120.1(c)1A: space conditioning systems utilizing ducts to supply air to occupiable space; supply-only ventilation systems providing outside air to occupiable space; supply side of balanced ventilation systems including heat recovery and energy recovery ventilation systems providing outside air to occupiable space.<sup>3</sup> Uniform Mechanical Code may have more stringent ventilation requirements; the most stringent code requirement takes precedence.

Mechanical Systems

CERTIFICATE OF COMPLIANCE			NRCC-MCH-E		
Project Name:		First Bank	Report Page:		(Page 6 of 8)
Project Address:		4301 Macarthur Blvd.	Date Prepared:		6/20/2023

J. VENTILATION AND INDOOR AIR QUALITY

<sup>4</sup> See Standards Tables 120.1-A and 120.1-B.

<sup>5</sup> For lecture halls with fixed seating, the expected number of occupants shall be determined in accordance with the California Building Code.

<sup>6</sup> 120.2(e)3 requires systems serving rooms that are required by 130.1(c) to have lighting occupancy sensing controls to also have occupancy sensing zone controls for ventilation. Examples of spaces which require lighting occupancy sensors include offices 250ft<sup>2</sup> or smaller, multipurpose rooms less than 1,000 ft<sup>2</sup>, classrooms, conference rooms, restrooms, aisles and open areas in warehouses, library book stack aisles, corridors, stairwells, parking garages, and loading and unloading zones, unless excepted by 130.1(c).

Multifamily Dwelling Unit Ventilation Systems									
<input type="checkbox"/>	Check the box if the system is using continuous ventilation to meet the ventilation requirements per 160.2(b)2Aivb2								
19	20	21	22	23	24	25	26		27
Space Name or Item Tag	Mechanical Ventilation Required per 120.1(b) & 160.2(b)2				Ventilation per Design		Local Exhaust		Air Filtration per 120.1(c) & 160.2(b)1
	Conditioned Floor Area (ft²)	# of Bedrooms	# of Dwelling Units	Required Min OA CFM¹	Supply Air CFM	Exhaust CFM			
28	Is this a balanced system⁴				29	Meeting Outside Air Requirements?			

<sup>1</sup> FOOTNOTES: Uniform Mechanical Code may have more stringent ventilation requirements; the most stringent code requirement takes precedence.

<sup>2</sup> Kitchen range hood will be verified per NA7.18.1 to confirm model is rated by HVI or AHAM.

<sup>3</sup> Air filtration requirements apply to the following three system types per 120.1(c)1A: space conditioning systems utilizing ducts to supply air to occupiable space; supply-only ventilation systems providing outside air to occupiable space; supply side of balanced ventilation systems including heat recovery and energy recovery ventilation systems providing outside air to occupiable space.

<sup>4</sup> A balanced ventilation system provides ventilation airflow to each dwelling-unit at a rate equal to or greater than the required minimum rate, but not more than twenty percent.

K. TERMINAL BOX CONTROLS

This section does not apply to this project.

L. DISTRIBUTION (DUCTWORK and PIPING)

This section does not apply to this project.

Mechanical Systems

CERTIFICATE OF COMPLIANCE		NRCC-MCH-E	
Project Name:	First Bank	Report Page:	(Page 7 of 8)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/20/2023

M. COOLING TOWERS
<i>This section does not apply to this project.</i>

N. DECLARATION OF REQUIRED CERTIFICATES OF INSTALLATION
Form/Title
NRCI-MCH-01-E - Must be submitted for all buildings

O. DECLARATION OF REQUIRED CERTIFICATES OF ACCEPTANCE
<i>There are no NRCA forms required for this project.</i>

P. DECLARATION OF REQUIRED CERTIFICATES OF VERIFICATION
<i>There are no NRCV forms required for this project.</i>

Q. MANDATORY MEASURES DOCUMENTATION LOCATION		
<i>This table is used to indicate where mandatory measures are documented in the plan set or construction documentation.</i>		
01	02	
Compliance with Mandatory Measures documented through MCH Mandatory Measures Note Block	Yes	Plan sheet or construction document location
		M-Sheets

Mechanical Systems

CERTIFICATE OF COMPLIANCE		NRCC-MCH-E	
Project Name:	First Bank	Report Page:	(Page 8 of 8)
Project Address:	4301 Macarthur Blvd.	Date Prepared:	6/20/2023

DOCUMENTATION AUTHOR'S DECLARATION STATEMENT	
I certify that this Certificate of Compliance documentation is accurate and complete.	
Documentation Author Name: Mohamad Nohayli	Documentation Author Signature: <b>Mohamad Nohayli</b>
Company: InnoDez, Inc.	Signature Date: <b>2023.06.20</b>
Address:	CEA/ HERS Certification Identification (if applicable):
City/State/Zip:	Phone:
RESPONSIBLE PERSON'S DECLARATION STATEMENT	
I certify the following under penalty of perjury, under the laws of the State of California:	
<div><div>1.</div><div>The information provided on this Certificate of Compliance is true and correct.</div></div> <div><div>2.</div><div>I am eligible under Division 3 of the Business and Professions Code to accept responsibility for the building design or system design identified on this Certificate of Compliance (responsible designer)</div></div> <div><div>3.</div><div>The energy features and performance specifications, materials, components, and manufactured devices for the building design or system design identified on this Certificate of Compliance conform to the requirements of Title 24, Part 1 and Part 6 of the California Code of Regulations.</div></div> <div><div>4.</div><div>The building design features or system design features identified on this Certificate of Compliance are consistent with the information provided on other applicable compliance documents, worksheets, calculations, plans and specifications submitted to the enforcement agency for approval with this building permit application.</div></div> <div><div>5.</div><div>I will ensure that a completed signed copy of this Certificate of Compliance shall be made available with the building permit(s) issued for the building, and made available to the enforcement agency for all applicable inspections. I understand that a completed signed copy of this Certificate of Compliance is required to be included with the documentation the builder provides to the building owner at occupancy.</div></div>	
Responsible Designer Name: Syed P. Alam	Responsible Designer Signature: <b>Syed Alam</b>
Company: Innodez Inc.	Date Signed: 2023-06-20
Address: 726 Foxbrough	License: 27087
City/State/Zip: Pleasanton CA 94566	Phone:


# HVAC SYSTEM HEATING AND COOLING LOADS SUMMARY

Project Name First Bank	Date 6/20/2023
System Name RTU-01	Floor Area 4,500


ENGINEERING CHECKS		SYSTEM LOAD				
Number of Systems	1	COIL COOLING PEAK			COIL HTG. PEAK	
Heating System		CFM	Sensible	Latent	CFM	Sensible
Output per System	150,000	4,920	87,943	39,717	679	26,687
Total Output (Btuh)	150,000		0			
Output (Btuh/sqft)	33.3		4,397			1,334
Cooling System			0			0
Output per System	150,000	675	2,059	-1,755	675	26,054
Total Output (Btuh)	150,000		8,798			-8,798
Total Output (Tons)	12.5		4,397			1,334
Total Output (Btuh/sqft)	33.3					
Total Output (sqft/Ton)	360.0					
TOTAL SYSTEM LOAD			107,595	37,962		46,612

Air System		HVAC EQUIPMENT SELECTION				
CFM per System	5,000	RTU-01	120,659	34,415		150,000
Airflow (cfm)	5,000					
Airflow (cfm/sqft)	1.11					
Airflow (cfm/Ton)	400.0					
Outside Air (%)	13.5%	Total Adjusted System Output (Adjusted for Peak Design conditions)		120,659	34,415	150,000
Outside Air (cfm/sqft)	0.15	TIME OF SYSTEM PEAK		Sep 2 PM	Jan 1 AM	

## HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)

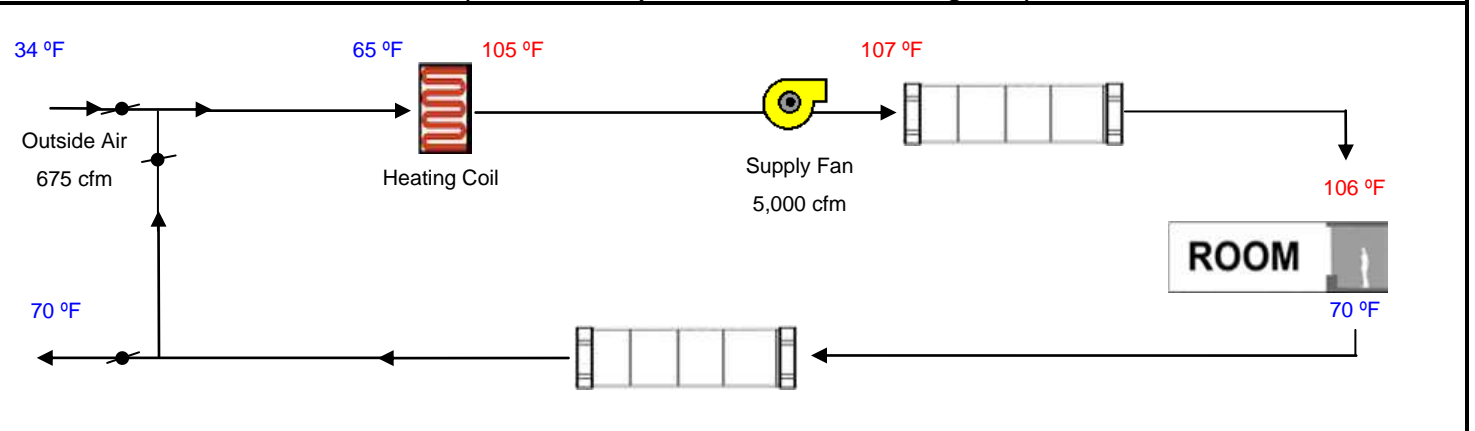

## COOLING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Cooling Peak)

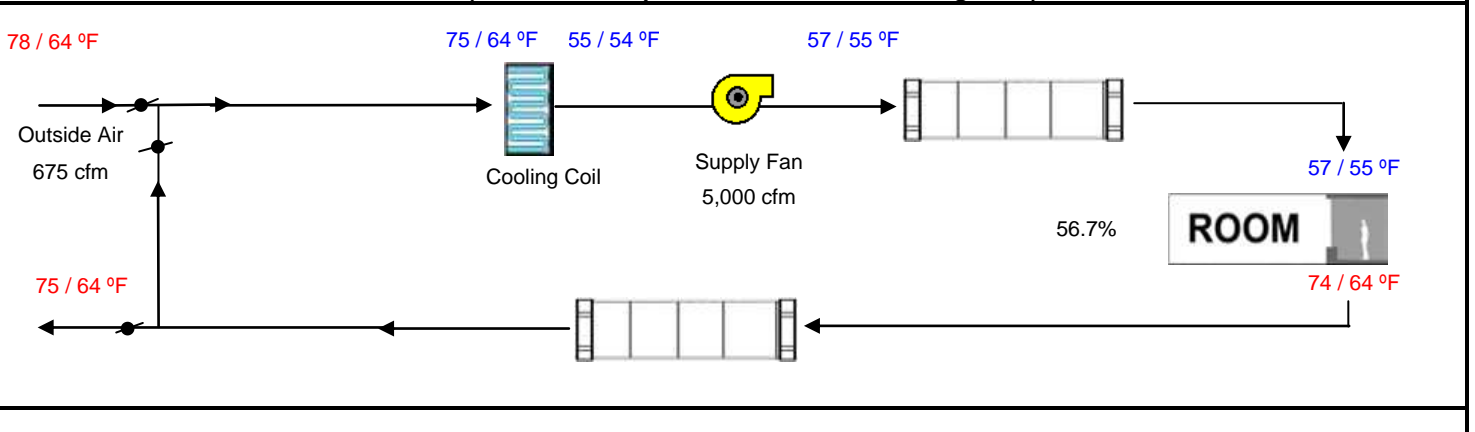

Project Name <b>First Bank</b>	Date <b>6/20/2023</b>
System Name <b>RTU-02</b>	Floor Area <b>1,500</b>

Air System							
CFM per System	2,000	HVAC EQUIPMENT SELECTION					
Airflow (cfm)	2,000	RTU-02	52,015	10,151		60,000	
Airflow (cfm/sqft)	1.33						
Airflow (cfm/Ton)	400.0						
Outside Air (%)	11.3%	Total Adjusted System Output (Adjusted for Peak Design conditions)	52,015	10,151		60,000	
Outside Air (cfm/sqft)	0.15						
Note: values above given at ARI conditions		TIME OF SYSTEM PEAK	Oct 2 PM		Jan 1 AM		

### HEATING SYSTEM PSYCHROMETRICS (Airstream Temperatures at Time of Heating Peak)

