



TWIN HEAT MODULE CONNECTION LAYOUT

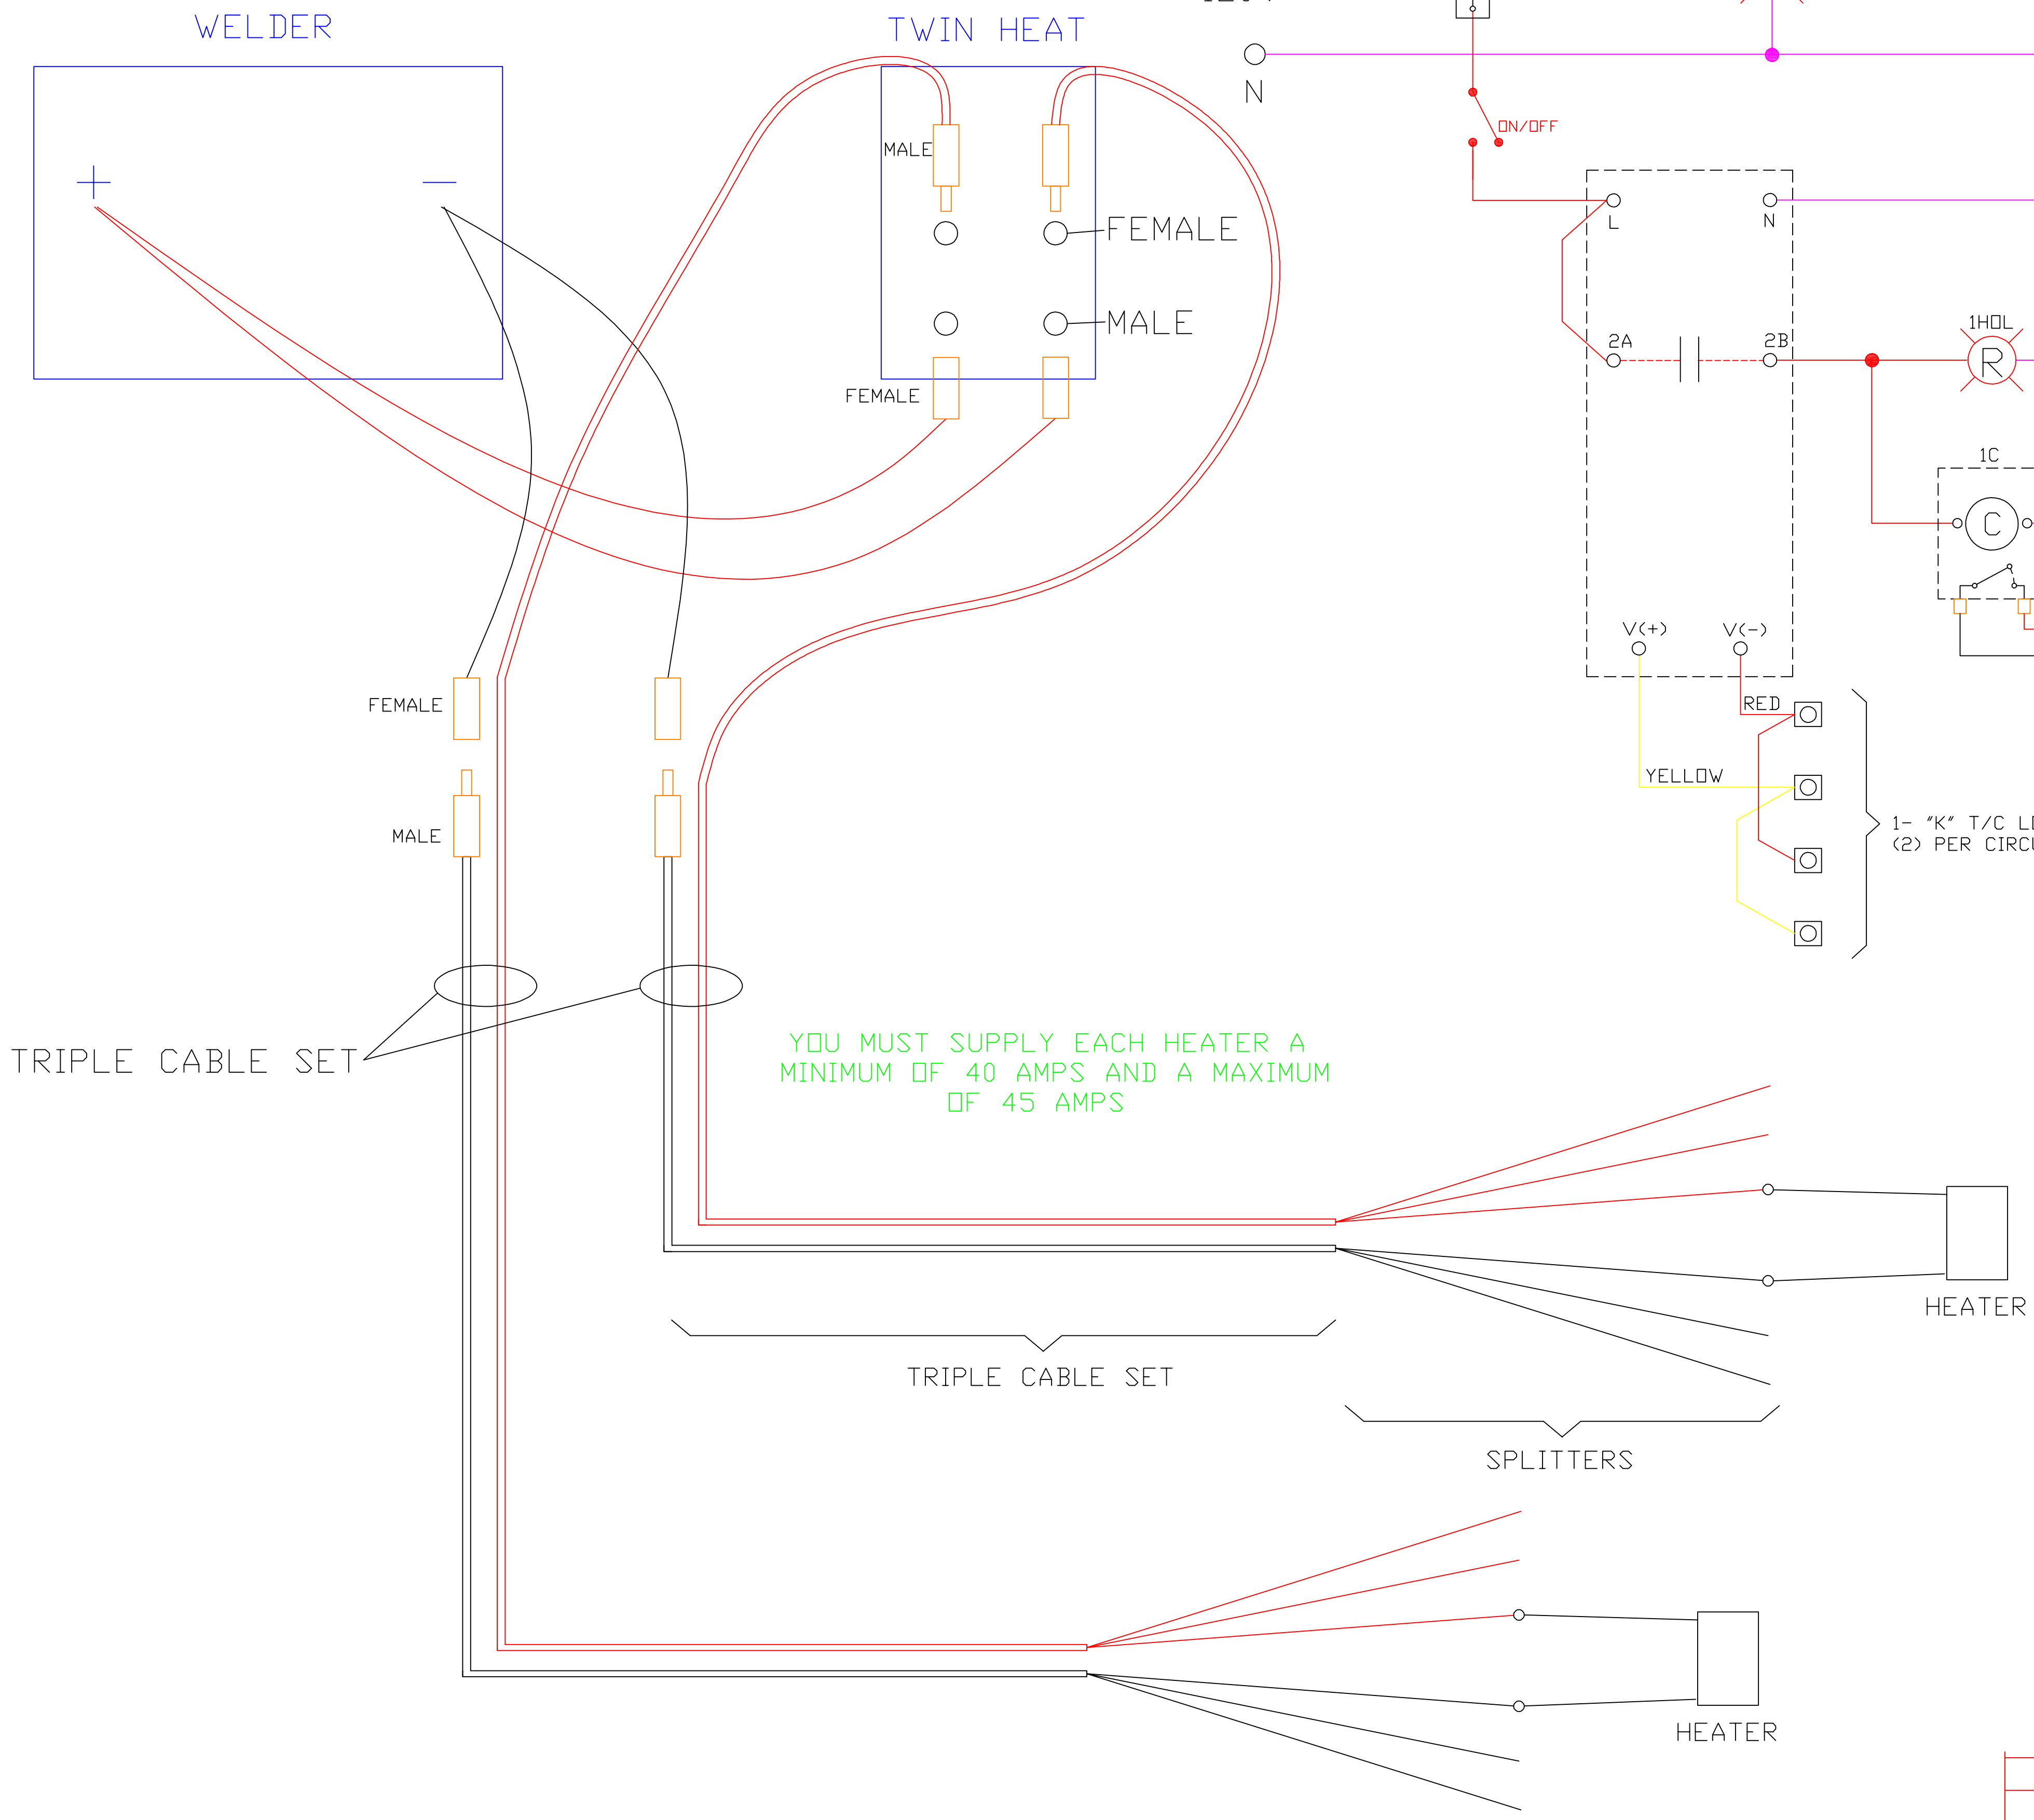

YOU MUST SUPPLY EACH HEATER A MINIMUM OF 40 AMPS AND A MAXIMUM OF 45 AMPS

SCHEMATIC

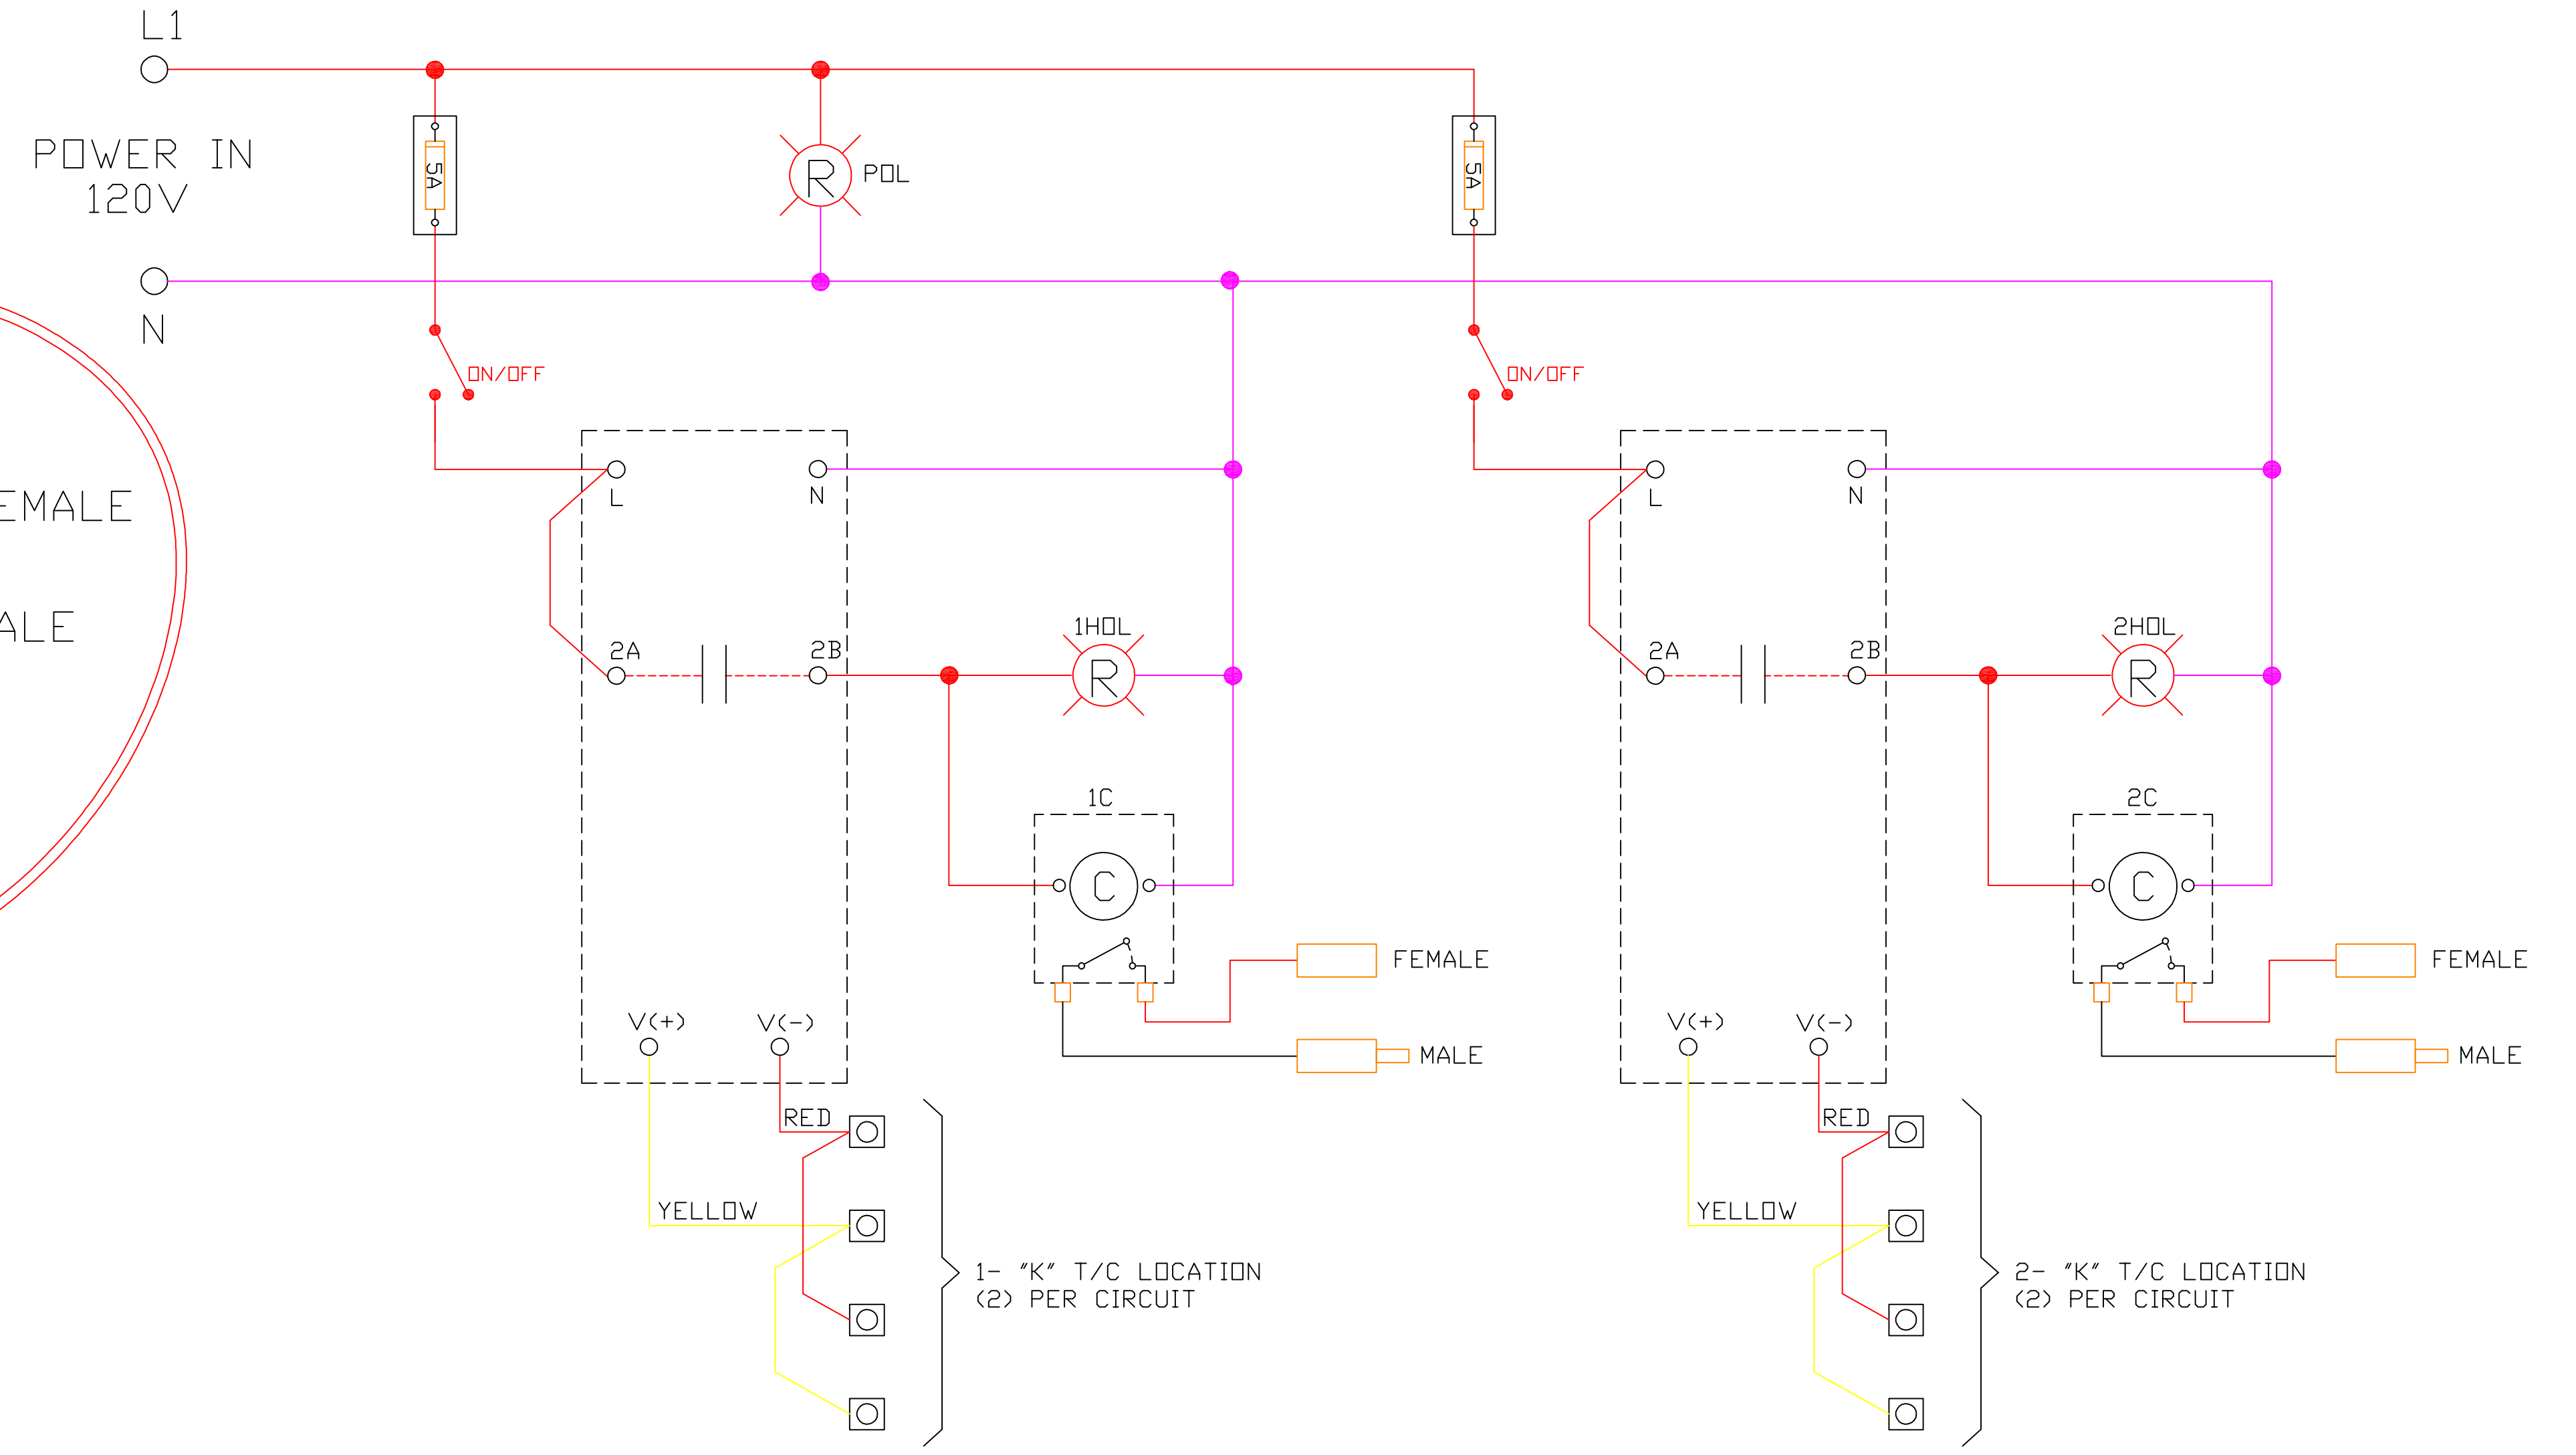

REV.	DESCRIPTION	DR.	DATE
1	HOOK-UPS	RJD	10/19/18

TWIN HEAT MODULE LAYOUT & SCHEMATIC

Thermal Tech & Temp
 880 North Madison Street,
 Crown Point, Indiana 46307
 info@thermaltechtemp.com www.thermaltechtemp.com
 sales@thermaltechtemp.com Main Office: 1.219.213.2093
1.800.674.9284

SCALE	N.T.S.
DRAWN BY	RJD
DATE	07/19/11
CHK'D.	
APP'D.	
JOB NO.	

TWIN HEAT MODULE LAYOUT & DETAILS		SHEET 1 OF 1
		DRAWING NO. D-6801 REV. 1