


Surge Protection Location and Inspection chart

Upon any large power event (Lightning) parts should be inspected



Check for an illuminated Green LED. If LED is Not Lit call For service



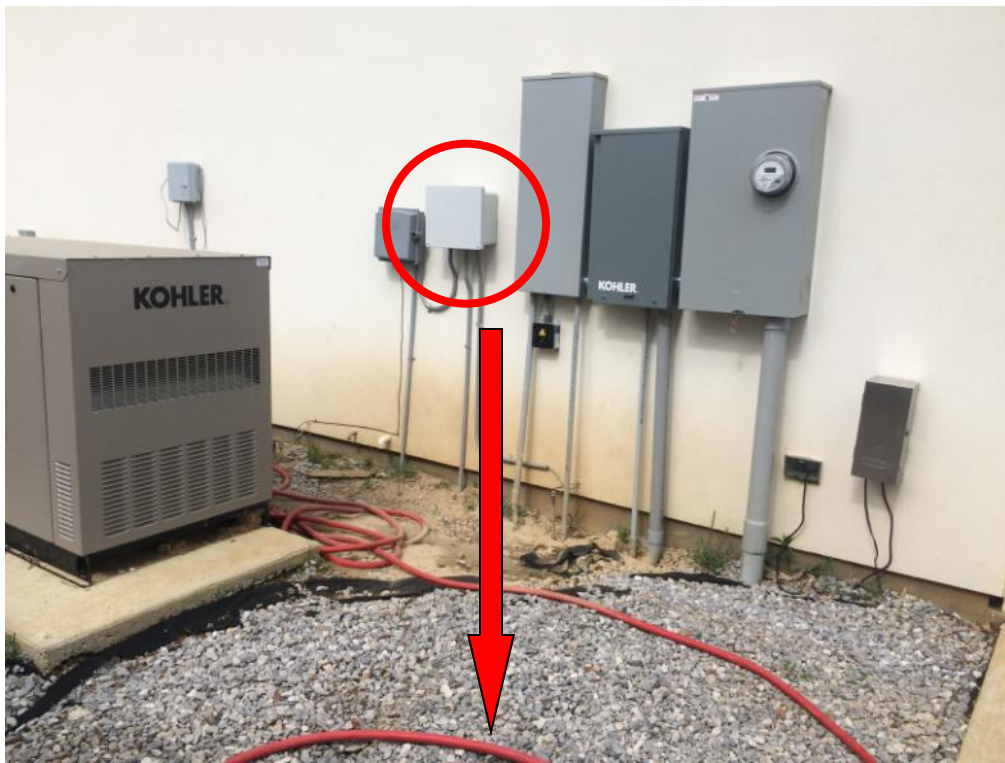


IF No Cablevision or internet, bypass coax with barrel connector

Speaker surge protector

Garage Attic



Check for green light.
2 surge protectors to
check in Garage attic. 1
air handler and 1 water
heater.

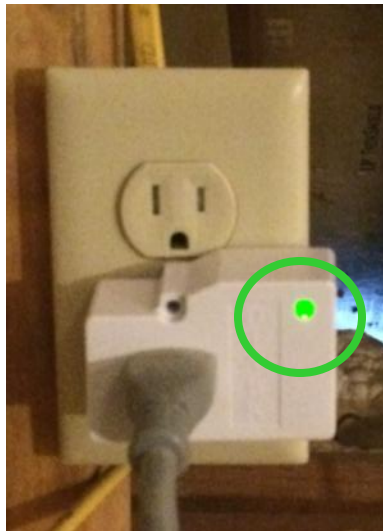

Top Floor Attic



Check for green light.
4 surge protectors to
check in upper attic. Both
air handlers and 2 water
heaters.

