

Professional Pickleball Association Jan. 2025: Palm Springs

On-Site Paddle Testing

The on-site testing at PPA Palm Springs event followed procedures derived from PPL's experience testing paddles at similar professional events and the United Pickleball Association leadership's preferences.


Testing Summary Analysis

There were a total of 679 paddles (50 models) made up from 20 manufacturers submitted for onsite testing at the PPA Palm Springs event.

Average ADF: 56.8

Total Fails: 10

Fail Rate: 1.4%

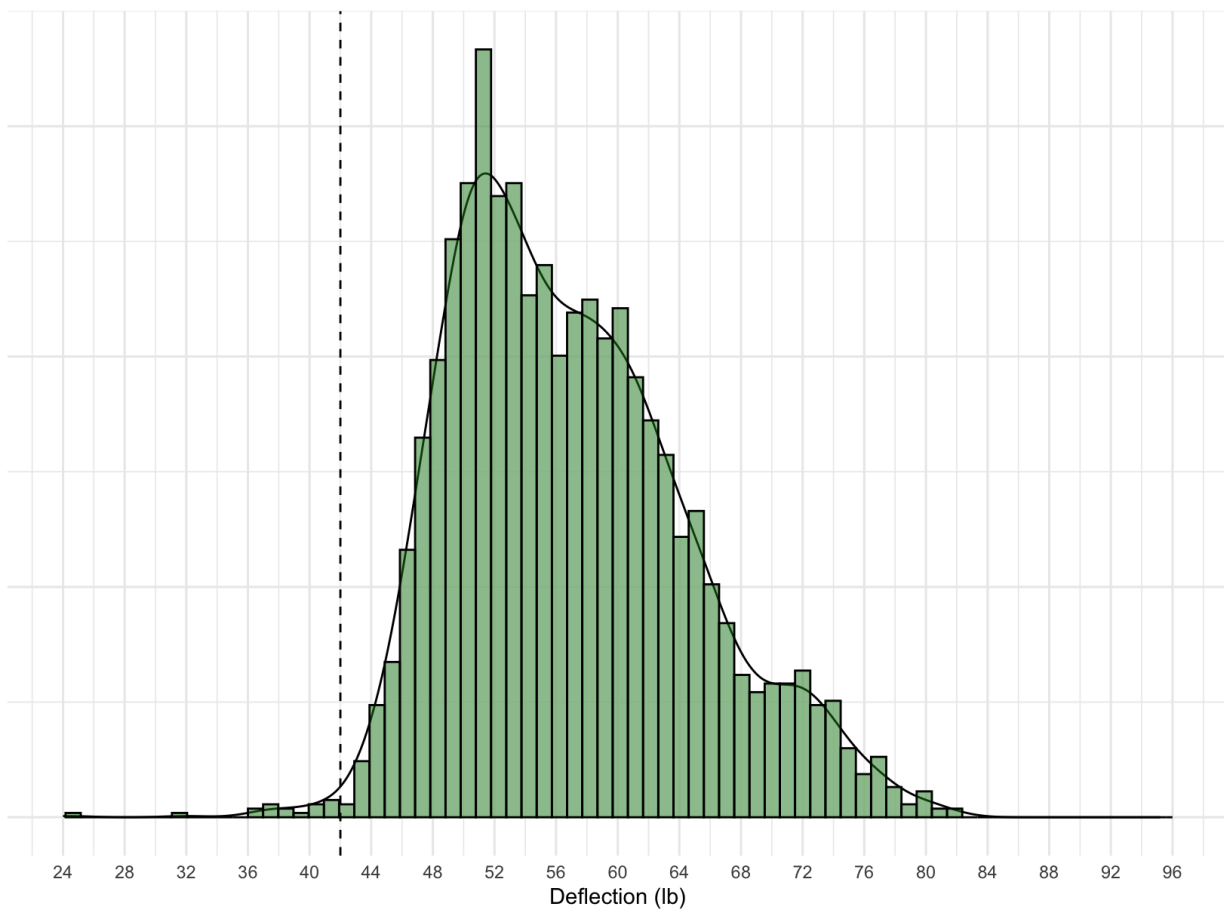

*On this report, average ADF is defined as the total average of all testing locations on the paddle