



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT

CHILLER INFORMATION

MODEL #: YLPA01155E46XBBBXTXH...44

TYPE: AIR-COOLED HEAT PUMP

BRAND: YORK

VOLTS/HZ/PH: 460/60/3

MAN. DATE: 5/18/2019

CHILLER DIMENSIONS:

S/N: 11551C95640844

CHILLER WEIGHT: 9,924 LBS (SHIPPING WEIGHT)

CHILLER OPERATING DATA

TEST RUN DATE: 1/20/2026

VOLTS L1/L2: 492 **L1/L3:** 491 **L2/L3:** 492

AMPS L1: 184 **L2:** 188 **L3:** 184.2

SYS 1. SUBCOOLING: 44°F **SUPERHEAT:** 12°F **EXV POSITION:** 33%

SYS 2. SUBCOOLING: 40°F **SUPERHEAT:** 12°F **EXV POSITION:** 32%

ID		COMPRESSOR MAKE/ MODEL				RUNNING AMPS	
C1	C2	CIRCUIT 1		CIRCUIT 2		C1	C2
1A	2A	MODEL #		MODEL #		36.4	36.1
		S/N		S/N		38.0	37.1
OIL: F	OIL: F	HOURS: 6,495	CCH:	HOURS: 6,396	CCH:	38.0	36.3
1B	2B	MODEL #		MODEL #		37.0	35.1
		S/N		S/N		38.8	36.2
OIL: F	OIL: F	HOURS: 6,492	CCH:	HOURS: 6,338	CCH:	37.9	36.0
OIL:	OIL:	HOURS:	CCH:	HOURS:	CCH:		

REFRIGERANT TYPE: R410A R407C R717 R134A R22 R404A

REFRIGERANT LEVEL:

AMBIENT TEMP: 33.7°F

PUMP 1 HP/AMPS: 25HP, 30.3/30.4/30.3

SETPOINT: 15°F

PUMP 2 HP/AMPS: NA

LEAVING CHILLER: 15.9°F

FLOW SWITCH: DIFF. PRESSURE SWITCH

ENTER/ RETURN: 18.4°F

HEAT EXCHANGER: SHELL & TUBE

MINIMUM SETPOINT: 8.5°F

METERING DEVICE: ELECTRONIC



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT


CONDENSER FANS

CONDENSER FIN CONDITION:

EXCEPTIONAL VERY GOOD GOOD OK

NUMBER OF FANS: 8

CONDENSOR FAN RUNNING AMPS						
CIRCUIT 1			CIRCUIT 2			
	L1	L2	L3	L1	L2	L3
A	3.2			3.3		
B	3.1			3.3		
C	6.5			6.75		
D						

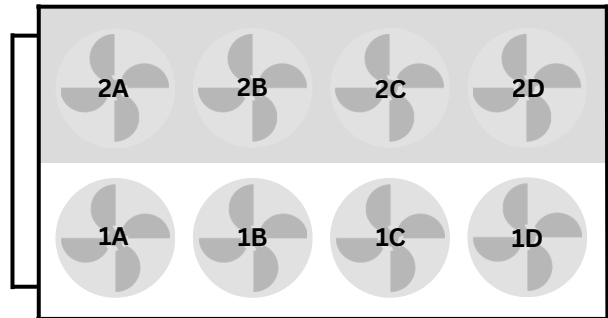

INSPECTION NOTES:

CONDENSER HAS EPOXY COATING
