



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT

CHILLER INFORMATION

MODEL #: YLAA01005E46XBF5XTXHXXBLXEXX44XEXXXHXXX4AXWXXXXXXXXXXNXXXXXX
TYPE: AIR COOLED
BRAND: YORK
MAN. DATE: 2018
S/N: 11551D86926832
VOLTS/HZ/PH: 460/60/3
CHILLER DIMENSIONS: W 7'6" x L 12' x H 8'
CHILLER WEIGHT: 4,570 LBS

CHILLER OPERATING DATA

TEST RUN DATE: 7/9/2025
VOLTS L1/L2: **L1/L3:** **L2/L3:**
AMPS L1: **L2:** **L3:**
SYS 1. SUBCOOLING: 20°F **SUPERHEAT:** 13°F **EXV POSITION:** 63.3%
SYS 2. SUBCOOLING: 12°F **SUPERHEAT:** 12°F **EXV POSITION:** 49%

ID		COMPRESSOR MAKE/ MODEL				RUNNING AMPS	
C1	C2	CIRCUIT 1		CIRCUIT 2		C1	C2
1A	2A	MODEL # GSD60182VAB411 S/N 2794301084		MODEL # GSD80385VAB462 S/N 2794201511		20	45
						19.8	46
OIL: F	OIL: 7/8	HOURS: 170	CCH: WORKING	HOURS: 1,994	CCH: WORKING	20.7	47
1B	2B	MODEL # GSD60182VAD412 S/N 2795201338		MODEL # GSD80385VAB462 S/N 2794201506		21.5	46.5
						21.6	46.9
OIL: 3/4	OIL: 7/8	HOURS: 3,967	CCH: WORKING	HOURS: 1,994	CCH: WORKING	22.7	47.8
1C		MODEL # GSD60182VAB411 S/N 2794301082				22.1	
						21.2	
OIL: 3/4	OIL:	HOURS: 1,370	CCH: WORKING	HOURS:	CCH:	22.5	

REFRIGERANT TYPE: ☒ R410A ☐ R407C ☐ R717 ☐ R134A ☐ R22 ☐ R404A
REFRIGERANT LEVEL: GOOD

AMBIENT TEMP: 75°F
SETPOINT: 40°F
LEAVING CHILLER: 42.2°F
ENTER/ RETURN: 46.6°F
MINIMUM SETPOINT: 10°F
PUMP 1 HP/AMPS:
PUMP 2 HP/AMPS:
FLOW SWITCH: ELECTRONIC
HEAT EXCHANGER: BRAZE PLATE
METERING DEVICE: EXV



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT


CONDENSER FANS

CONDENSER FIN CONDITION:

☒ EXCEPTIONAL ☐ VERY GOOD ☐ GOOD ☐ OK

NUMBER OF FANS: 5

CONDENSOR FAN						
RUNNING AMPS						
CIRCUIT 1				CIRCUIT 2		
	L1	L2	L3	L1	L2	L3
A	3.18	3.2	3.24	3.0	3.23	3.25
B	3.1	3.2	3.7	3.06	3.2	3.2
C				3.08	3.15	3.19

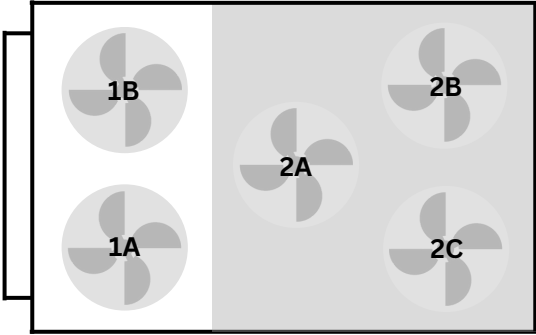

INSPECTION NOTES: