



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT

CHILLER INFORMATION

MODEL #: YLAA0100ZE46XBABXTXAXXBLXCXX44SE1XXXHXXXSAXXBXX5XXXXXXXXK1XXXX
TYPE: AIR COOLED
BRAND: YORK
MAN. DATE: 2017
S/N: 11551D76134036
VOLTS/HZ/PH: 460/60/3
CHILLER DIMENSIONS: W 8'4" x L 17' x H 8'6"
CHILLER WEIGHT: 11,000 LBS

CHILLER OPERATING DATA

TEST RUN DATE: 6/4/2025
VOLTS L1/L2: **L1/L3:** **L2/L3:**
AMPS L1: **L2:** **L3:**
SUBCOOLING SYSTEM 1: 21.8°F **SYSTEM 2:** 20°F
SUPERHEAT SYSTEM 1: 12°F **SYSTEM 2:** 10°F

ID		COMPRESSOR MAKE/ MODEL				RUNNING AMPS	
C1	C2	CIRCUIT 1		CIRCUIT 2		C1	C2
1A	2A	MODEL # ZP180KCE-TWD-222		MODEL # ZP385KCE-TED-251		19.4	37.9
		S/N 17B927327		S/N 24D057A0L		17.1	39.3
OIL: 1/8	OIL: F	HOURS: 2,565	CCH: WORKING	HOURS: 2,699	CCH: WORKING	20.4	39.3
1B	2B	MODEL # ZP180KCE-TWD-222		MODEL # ZP385KCE-TED-251		18.9	38.1
		S/N 17B926047		S/N 24D056A6L		18.3	39.7
OIL: 1/8	OIL: F	HOURS: 2,514	CCH: WORKING	HOURS: 2,617	CCH: WORKING	18.5	39.4
1C		MODEL # ZP180KCE-TWD-222				19.4	
		S/N 17B927328				19.5	
OIL: 1/8	OIL:	HOURS: 2,557	CCH: WORKING	HOURS:	CCH:	20.2	

REFRIGERANT TYPE: ☒ R410A ☐ R407C ☐ R717 ☐ R134A ☐ R22 ☐ R404A

REFRIGERANT LEVEL: GOOD

AMBIENT TEMP: 73.3°F

SETPOINT: 40°F

LEAVING CHILLER: 39.7°F

ENTER/ RETURN: 42.8°F

MINIMUM SETPOINT: 10°F

PUMP 1 HP/AMPS: 15.4 / 15.1 / 15.1

PUMP 2 HP/AMPS:

FLOW SWITCH: ELECTRONIC

HEAT EXCHANGER: SHELL & TUBE

METERING DEVICE: EXV



WEST COAST CHILLERS

INSPECTION & OPERATIONAL REPORT


CONDENSER FANS

CONDENSER FIN CONDITION:

☒ EXCEPTIONAL ☐ VERY GOOD ☐ GOOD ☐ OK

NUMBER OF FANS: 5

CONDENSOR FAN						
RUNNING AMPS						
CIRCUIT 1			CIRCUIT 2			
	L1	L2	L3	L1	L2	L3
A	3.19	3.16	3.28	2.99	2.88	3.01
B	3.40	3.46	3.30	2.91	3.09	2.96
C				3.07	3.02	2.99

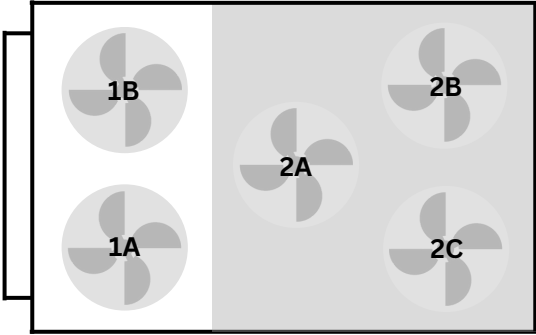

INSPECTION NOTES: