

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

Inspection Date: April 30, 2026		
Owner Information:		
Owner Name: Estate of Diane Devine		Contact Person:
Address: 2820 21st Lane, Vero Beach, FL 32960		Home Phone:
City: Vero Beach	Zip: 32960	Work Phone:
County: Indian River		Cell Phone:
Insurance Company:		Policy #:
Year of Home: 1982	# of Stories: 1	Email:

NOTE: Any documentation used in validating the compliance or existence of each construction or mitigation attribute must accompany this form. At least one photograph or document providing proof must accompany this form to validate each attribute marked in questions 2 through 9. A FORTIFIED Home® ☐Roof, ☐Silver, or ☐Gold Certificate may be used to validate the attributes marked in questions 4 through 6, and questions 8 through 9 (check type of certificate and attach photocopy). The insurer may ask additional questions regarding the mitigated feature(s) verified on this form.

1. Building Code: What version of the Florida Building Code “FBC” (FBC 2001 & 2004 OR FBC 2007 or later) OR for homes located in the High-Velocity Hurricane Zone (“HVHZ”) (Miami-Dade or Broward counties), South Florida Building Code (SFBC-94) was in force at the time of original permit application?

- ☐A. Code in force at time of permit application was the FBC 2001 & 2004: Year Built _____. For homes built in 2002/2003, provide a permit application with a date after 3/1/2002: Building Permit Application Date (MM/DD/YYYY) ____/____/____.
- ☐B. Code in force at time of permit application was the FBC 2007 and later: Year Built _____. For homes built in 2007/2008, provide a permit application with a date after 12/8/2006: Building Permit Application Date (MM/DD/YYYY) ____/____/____.
- ☐C. For the HVHZ Only: Code in force at time of permit application was the SFBC-94: Year Built _____. For homes built in 1994, 1995, and 1996, provide a permit application with a date after 9/1/1994: Building Permit Application Date (MM/DD/YYYY) ____/____/____.
- ☒D. Unknown or does not meet the requirements of Answer “A” or “B” or “C”.

2. Region: Location based on design windspeed. See ASCE 7-22 (700-year MRI) Risk Category 2 (www.ascehazardtool.org).

- ☐HVHZ ☒Region 1 (≥ 140 mph) ☐Region 2 (130 mph – 139 mph) ☐Region 3 (< 130 mph)

3. Roof Slope: For single-family homes with multiple slopes, indicate the slope that is at least two thirds of the main roof area when determining greater than or equal to 6:12, OR less than 6:12.

- ☐Greater than or equal to (≥ 6:12) ☐Less than (< 6:12).

4. Roof Covering: Select all roof covering types in use. Provide the permit application date OR FBC/MDC Product Approval number AND Year of Original Installation/Replacement OR indicate that no information was available to verify compliance for each roof covering identified.

4.1 Roof Covering Type:	Permit Application Date	FBC or MDC Product Approval #	Year of Original Installation or Replacement	No Information Provided for Compliance
☒ Asphalt/Fiberglass Shingle	3 / 01 / 2018	Permit 2018030047	2018	☐
☐ Concrete/Clay Tile	____/____/____	_____	_____	☐
☐ Synthetic/Composite Tile	____/____/____	_____	_____	☐
☐ Metal	____/____/____	_____	_____	☐
☐ Built Up	____/____/____	_____	_____	☐
☐ Membrane	____/____/____	_____	_____	☐
☐ Other _____	____/____/____	_____	_____	☐

Inspectors Initials DPQ Property Address 2820 21st Lane, Vero Beach, FL 32960

***This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.**

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

4.2 Product Approval Listing

- ☒ A. All roof coverings listed above meet the FBC with a FBC or Miami-Dade Product Approval listing current at the time of installation OR have a roofing permit application date on or after 3/1/02 OR the roof is original and built in 2004 or later.
- ☐ B. All roof coverings have a Miami-Dade Product Approval listing current at time of installation OR (for the HVHZ only) a roofing permit application after 9/1/1994 and before 3/1/2002 OR the roof is original and built in 1997 or later.
- ☐ C. One or more roof coverings do not meet the requirements of Answer "A" or "B."
- ☐ D. No roof coverings meet the requirements of Answer "A" or "B."

5. Roof Deck Attachment: What is the **WEAKEST** form of roof deck attachment?

- ☐ A. Plywood/Oriented strand board (OSB) roof sheathing with minimum thickness of 7/16" attached to the roof truss/rafter (spaced a maximum of 24" o.c.) by staples or 6d nails spaced at 6" along the edge and 12" in the field. **OR** Batten decking supporting wood shakes or wood shingles (max 24" truss/rafter spacing). **OR** Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that has an equivalent mean ultimate uplift resistance of at least 55 psf, but less than that required for Options B or C below. (NOTE: If the nailing or rafter spacing is greater than specified above, or the roof decking is less than specified above, select Answer F. Other.)
- ☐ B. Plywood/OSB roof sheathing with a minimum thickness of 7/16" attached to the roof truss/rafter (spaced a maximum of 24" o.c.) by 8d common nails spaced a maximum of 12" in the field. **OR** Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d nails spaced a maximum of 12" in the field (max 24" truss/rafter spacing) or has a mean ultimate uplift resistance of at least 103 psf.
- ☒ C. Plywood/OSB roof sheathing with a minimum thickness of 7/16" attached to the roof truss/rafter (spaced a maximum of 24" o.c.) by 8d common nails spaced a maximum of 6" in the field. **OR** Dimensional lumber/Tongue & Groove decking with a minimum of 2 nails per board (or 1 nail per board if each board is equal to or less than 6" in width). **OR** Any system of screws, nails, adhesives, other deck fastening system or truss/rafter spacing that is shown to have an equivalent or greater resistance than 8d common nails spaced a maximum of 6" in the field (max 24" truss/rafter spacing) or has a mean ultimate uplift resistance of at least 182 psf.
- ☐ D. Reinforced Concrete Roof Deck.
- ☐ E. Spray foam products with an uplift resistance of 110 PSF (FOS 1.5). (Spray foam must be installed along rafter deck intersections, all panel joints, etc.).
- ☐ F. Other: _____
- ☐ G. Unknown or unidentified.
- ☐ H. No attic access.

6. Roof to Wall Attachment: What is the **WEAKEST** roof to wall connection? (Do not include attachment of hip/valley jacks within five (5) feet of the inside or outside corner of the roof in determination of WEAKEST type).

- ☐ A. Toenails:
- ☐ Truss/rafter anchored to top plate of wall using nails driven at an angle through the truss/rafter and attached to the top plate of the wall, **OR**
 - ☐ Metal connectors or structural fasteners that are not installed as intended do not meet the minimal conditions or requirements of B, C, or D, **OR**
 - ☐ Other connection method documented to provide a substantiated wind allowable uplift capacity of 185 lbs. or greater.

Minimal conditions to qualify for categories B, C, or D. All verified connections are either: (Note: All retrofit connectors, or structural fasteners, must meet option 3).

- ☒ 1. Metal connectors secured to truss/rafter with a minimum of three (3) nails, and attached to the side and/or bottom of the wall framing top plate, or embedded into the bond beam, with less than 1/2" gap from the blocking or truss/rafter, and blocked no more than 1 1/2" from the truss/rater, and free of visible severe corrosion, **OR**
- ☐ 2. Metal connectors consisting of a single strap that wraps over the truss/rafter, are secured to the side of the wall and/or bottom of the top plate with a minimum of three nails on each side and free of visible severe corrosion, **OR**
- ☐ 3. Purpose-made metal connector(s) or structural fastener(s) installed per the manufacturer's installation specifications to meet the substantiated wind allowable capacity detailed below.

Inspectors Initials DPO Property Address 2820 21st LANE

*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

☐ B. Clips:

- ☐ Metal connectors that do not wrap over the truss/rafter, **OR**
- ☐ Metal connectors with a minimum of one (1) strap that wraps over the truss/rafter and does not meet the nail position requirements of C or D but is secured with a minimum of three (3) nails, **OR**
- ☐ Purpose-made metal connector(s) or structural fastener(s) with a substantiated wind allowable uplift capacity of 386 lbs. or greater installed per the manufacturer's installation specifications (requires site-specific documentation).

☒ C. Single Wraps:

- ☒ Metal connectors consisting of a single strap that wraps over the truss/rafter and are secured with a minimum of two (2) nails on one side and a minimum of one (1) nail on the opposing side, **OR**
- ☐ Purpose-made metal connector(s) or structural fastener(s) with a substantiated wind allowable uplift capacity of 535 lbs. or greater installed per the manufacturer's installation specifications (requires site-specific documentation).

☐ D. Double Wraps:

- ☐ Metal Connectors consisting of two (2) separate straps, one on either side of the truss/rafter where each strap wraps over the truss/rafter and is secured with a minimum of two (2) nails on one side, and a minimum of one (1) nail on the opposing side, **OR**
- ☐ Metal connectors consisting of a single strap that wraps over the truss/rafter, are secured to the side of the wall and/or bottom of the top plate with a minimum of three (3) nails on each side, **OR**
- ☐ Purpose-made metal connector(s) or structural fastener(s) with a substantiated wind allowable uplift capacity of 891 lbs. or greater installed per the manufacturer's installation specifications (requires site-specific documentation).

☐ E. Structural: Anchor bolts structurally connected or reinforced concrete roof.

☐ F. Other: _____

☐ G. Unknown or unidentified.

☐ H. No attic access.

☐ I. Connection(s) not installed as intended.

7. Roof Geometry: What is the roof shape? (Do not consider roofs of porches or carports that are attached only to the fascia or wall of the host structure over unenclosed space in the determination of roof perimeter or roof area for roof geometry classification).

☐ A. Hip Roof: Hip roof with no other roof shapes greater than 10% of the total roof system perimeter.

Total length of non-hip features: _____ feet; Total roof system perimeter: _____ feet.

☐ B. Flat Roof: Roof on a building with five (5) or more units where at least 90% of the main roof area has a roof slope of less than 2:12. Roof area with slope less than 2:12 _____ sq ft; Total roof area _____ sq ft.

☒ C. Other Roof: Any roof that does not qualify as either (A) or (B) above.

8. Sealed Roof Deck/Secondary Water Resistance (SWR): Applied as a supplemental means to protect the dwelling from water intrusion in the event of roof covering loss. Standard underlayment or hot-mopped felts do not qualify as an SWR.

☒ A. Sealed Roof Deck (also called SWR)

☒ Fully adhered polymer-modified bitumen roofing underlayment complying with ASTM D1970.

☐ Tape over roof deck seams with felt or synthetic. (A minimum 3.75-inch-wide (95 mm) strip of self-adhering polymer-modified bitumen membrane complying with ASTM D1970 or self-adhering flexible flashing tape complying with AAMA 711, Level 3 [for exposure up to 176°F (80°C)]).

☐ Double layer of felt or synthetic with no tape. (Two layers of ASTM D226 Type II, ASTM D4869 Type III or Type IV or ASTM D8257 underlayment).

☐ Spray foam products. (Spray foam must be installed along rafter deck intersections, all panel joints, etc.).

☐ Check here if entire roof deck underside covered.

☐ B. No Sealed Roof Deck.

☐ C. Unknown or undetermined.

9. Opening Protection: What is the **WEAKEST** form of wind-borne debris protection installed on the structure? This category includes all openings in the wall and roof including windows, doors, sliding glass doors, skylights, and garage doors. Gable roof vents and other roof vents are not included. All openings (windows, doors, and skylights) must be in good condition. Buildings with

Inspectors Initials DPQ Property Address 2820 21st Lane, Vero Beach, FL 32960

***This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.**

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

openings that need replacement do not qualify for wind mitigation rate differentials, regardless of the presence/absence of other features.

Opening Protection Level Chart Place an "X" in each row to identify all forms of protection in use for each opening type. Check only one answer below (N/A through Z), based on the weakest form of protection (lowest row) for any of the glazed openings and indicate the weakest form of protection (lowest row) for non-glazed openings.		Glazed Openings				Non-Glazed Openings	
		Windows or Entry Doors	Garage Doors	Skylights	Glass Block	Entry Doors	Garage Doors
N/A	Not applicable – there are no openings of this type on the structure	☐	☒	☒	☒	☒	☐
A	Verified cyclic pressure & large missile (9 lb. for windows, doors/4.5 lb. for skylights)	☐	☐	☐	☐	☐	☐
B	Verified cyclic pressure & large missile (4-8 lb. for windows, doors/2 lb. for skylights)	☐	☐	☐	☐	☐	☐
C	Verified plywood/OSB meeting Table 1609.1.2 of the FBC 2007	☐	☐	☐	☐	☐	☐
D	Verified Non-Glazed Entry or Garage Doors indicating compliance with ASTM E 330, ANSI/DASMA 108, or PA/TAS 202 for wind pressure resistance	☐	☐	☐	☐	☐	☐
N	Opening Protection products that appear to be A or B but are not verified	☐	☐	☐	☐	☐	☐
	Other protective coverings that cannot be identified as A, B, or C	☐	☐	☐	☐	☐	☐
X	No Windborne Debris Protection	☒	☐	☐	☐	☐	☒
Z	Damaged openings in need of repair/replacement	☐	☐	☐	☐	☐	☐

☐ **A. Exterior Openings Cyclic Pressure and 9-lb. Large Missile (4.5 lb. for skylights only):** All glazed openings are protected, at a minimum, with impact resistant coverings or products listed as wind borne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level A in the table above and Hurricane in the factor table).

- Miami-Dade County PA 201, 202, and 203
- Florida Building Code Testing Application Standard (TAS) 201, 202, and 203
- American Society for Testing and Materials (ASTM) E 1886 and ASTM E 1996
- Southern Standards Technical Document (SSTD) 12
- For Skylights Only: ASTM E 1886 and ASTM E 1996
- For Garage Doors Only: ANSI/DASMA 115

☐ A.1 All non-glazed openings classified as A in the table above, or no non-glazed openings exist.

☐ A.2 One or more non-glazed openings classified as Level D in the table above, and no non-glazed openings classified as Level B, C, N, or X in the table above.

☐ A.3 One or more non-glazed openings is classified as Level B, C, N, X, or Z in the table above.

☐ **B. Exterior Opening Protection- Cyclic Pressure and 4 to 8-lb. Large Missile (2-4.5 lb. for skylights only):** All glazed openings are protected, at a minimum, with impact resistant coverings or products listed as windborne debris protection devices in the product approval system of the State of Florida or Miami-Dade County and meet the requirements of one of the following for "Cyclic Pressure and Large Missile Impact" (Level B in the table above and Hurricane in the factor table):

- ASTM E 1886 and ASTM E 1996 (Large Missile – 4.5 lb.)
- SSTD 12 (Large Missile – 4 lb. to 8 lb.)
- For Skylights Only: ASTM E 1886 and ASTM E 1996 (Large Missile – 2 to 4.5 lb.)

☐ B.1 All non-glazed openings classified as A or B in the table above, or no non-glazed openings exist.

Inspectors Initials DPQ Property Address 2820 21st Lane, Vero Beach, FL 32960

***This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.**

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

☐ B.2 One or more non-glazed openings classified as Level D in the table above, and no non-glazed openings classified as Level C, N, or X in the table above.

☐ B.3 One or more non-glazed openings is classified as Level C, N, X, or Z in the table above.

☐ C. **Exterior Opening Protection – Wood Structural Panels meeting FBC 2007:** All glazed openings are covered with:

☐ Plywood **OR** ☐ OSB, meeting the requirements of Table 1609.1.2 of the FBC 2007 (Level C in the table above and Plywood or OSB in secondary factors table).

☐ C.1 All non-glazed openings classified as A, B, or C in the table above, or no non-glazed openings exist.

☐ C.2 One or more non-glazed openings classified as Level D in the table above, and no non-glazed openings classified as Level N or X in the table above.

☐ C.3 One or more non-glazed openings is classified as Level N, X, or Z in the table above.

☐ N. **Exterior Opening Protection (unverified shutter systems with no documentation):** All glazed openings are protected with protective coverings not meeting the requirements of Answer “A,” “B,” or “C” or systems that appear to meet Answer “A” or “B” with no documentation of compliance (Level N in the table above and Ordinary in secondary factors table).

☐ N.1 All non-glazed openings classified as Level A, B, C, or N in the table above, or no non-glazed openings exist.

☐ N.2 One or more non-glazed openings classified as Level D in the table above, and no non-glazed openings classified as Level X in the table above.

☐ N.3 One or more non-glazed openings is classified as Level X or Z in the table above.

☒ X. **None or Some Glazed Openings:** One or more glazed openings classified. (Level X or Z in the table above and None in the factor table).

☐ Z. **Damaged Openings:** One or more openings are damaged and in need of repair or replacement. (Any opening(s) meeting Level Z in the table above).

MITIGATION INSPECTIONS MUST BE CERTIFIED BY A QUALIFIED INSPECTOR.

Section 627.711(2), Florida Statutes, provides a listing of individuals who may sign this form.

Qualified Inspector Name: Denni P Quigley	License Type: Home Inspector	License or Certificate #: HI 181
Inspection Company: Windstorm Retrofit, LLC		Phone: (772) 539-2909

Qualified Inspector – I hold an active license as a: (check one)

☒ Home inspector licensed under Section 468.8314, Florida Statutes, who has completed the statutory number of hours of hurricane mitigation training approved by the Construction Industry Licensing Board and completion of a proficiency exam.

☐ Building code inspector certified under Section 468.607, Florida Statutes.

☐ General, building, or residential contractor licensed under Section 489.111, Florida Statutes.

☐ Professional engineer licensed under Section 471.015, Florida Statutes.

☐ Professional architect licensed under Section 481.213, Florida Statutes.

☐ Any other individual or entity recognized by the insurer as possessing the necessary qualifications to properly complete a uniform mitigation verification form pursuant to Section 627.711(2), Florida Statutes.

Inspectors Initials DPQ Property Address 2820 21st Lane, Vero Beach, FL 32960

***This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.**

Uniform Mitigation Verification Inspection Form

Maintain a copy of this form and any documentation provided with the insurance policy.

Individuals other than licensed contractors licensed under Section 489.111, Florida Statutes, or professional engineer licensed under Section 471.015, Florida Statutes, must inspect the structures personally and not through employees or other persons. Licensees under Sections 471.015 or 489.111, Florida Statutes, may authorize a direct employee who possesses the requisite skill, knowledge, and experience to conduct a mitigation verification inspection.

I, Denni P Quigley, am a qualified inspector and I personally performed the inspection or (*licensed*
(print name)
contractors and professional engineers only) I had my employee, _____, perform the inspection, and I
(print name of inspector)
agree to be responsible for his/her work.

Qualified Inspector Signature: Dennis P Quigley Digitally signed by Dennis P Quigley
Date: 2026.05.13 19:34:50 -04'00' Date: May 14, 2026

An individual or entity who knowingly or through gross negligence provides a false or fraudulent mitigation verification form is subject to investigation by the Criminal Investigations Division – Bureau of Insurance Fraud and may be subject to administrative action by the appropriate licensing agency or to criminal prosecution (Section 627.711(4)-(7), Florida Statutes). The Qualified Inspector who certifies this form shall be directly liable for the misconduct of employees as if the authorized mitigation inspector personally performed the inspection.

Homeowner to complete: I certify that the named Qualified Inspector, or his or her employee, did perform an inspection of the residence identified on this form and that proof of identification was provided to me or my Authorized Representative.

Signature: _____ Date: _____

An individual or entity who knowingly provides or utters a false or fraudulent mitigation verification form with the intent to obtain or receive a discount on an insurance premium to which the individual or entity is not entitled commits a misdemeanor of the first degree (Section 627.711(7), Florida Statutes).

The definitions on this form are for inspection purposes only and cannot be used to certify any product or construction feature as offering protection from hurricanes.

Inspectors Initials DPQ Property Address 2820 21st Lane, Vero Beach, FL 32960

*This verification form is valid for up to five (5) years provided no material changes have been made to the structure or inaccuracies found on the form. Some items listed may not qualify for a discount.



MGOC-Search Permit Result Export

Project Number: 2018030047		Project Address: 2820 21ST LN , VERO BEACH FL 32960		Project Description: RE-ROOF - ASPHALT SHINGLES TO ASPHALT SHINGLES, 35 SQS, SLOPE 5:12	
Jurisdiction: Indian River County		Project Name: RR RE-ROOF		Work Type:	
Project Type Name:		Status: FINAL	Created Date: 3/1/2018	Subdivision: MCANSH GROVE SUB	Unit: Lot: 00014.0
Parcel Number: 33-39-03-00039-0000-00014.0		Designation: Specific Use: VERO BEACH			
Inspection Details:					
999RR - FINAL RE-ROOF		Scheduled: 3/29/2018	Completed: 3/29/2018	Inspection Result: Final Approved	
154 - ROOF FLASHING		Scheduled: 3/28/2018	Completed: 3/28/2018	Inspection Result: Partial Approved	
603 - ROOF DRY-IN		Scheduled: 3/28/2018	Completed: 3/28/2018	Inspection Result: Approved	
606 - INTERMEDIATE ROOF COVERING		Scheduled: 3/28/2018	Completed: 3/28/2018	Inspection Result: Approved	
0021 - REROOF AFFIDAVIT		Scheduled: 3/1/2018	Completed: 3/21/2018	Inspection Result: For the Record	

REPORT SUMMARY

Site Information

Address:	2820 21st Ln, Vero Beach, Florida, 32960
Elevation:	22 ft (NAVD 88)
Lat:	27.640887
Long:	-80.415209
Standard:	ASCE/SEI 7-22
Risk Category:	II
Soil Class:	Default

Wind

Wind Speed	156 Vmph
10-year MRI	79 Vmph
25-year MRI	105 Vmph
50-year MRI	117 Vmph
100-year MRI	128 Vmph
300-year MRI	144 Vmph
700-year MRI	156 Vmph
1,700-year MRI	167 Vmph
3,000-year MRI	178 Vmph
10,000-year MRI	188 Vmph
100,000-year MRI	211 Vmph
1,000,000-year MRI	231 Vmph

ASCE Hazards Report

Standard: ASCE/SEI 7-22



Risk Category: II

Soil Class: Default

Latitude: 27.640887

Longitude: -80.415209

Elevation: 22.20387448348984 ft
(NAVD 88)

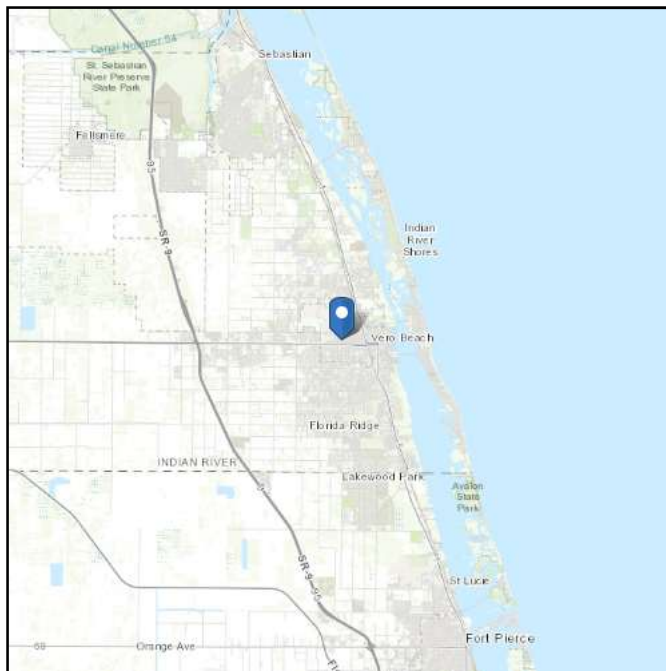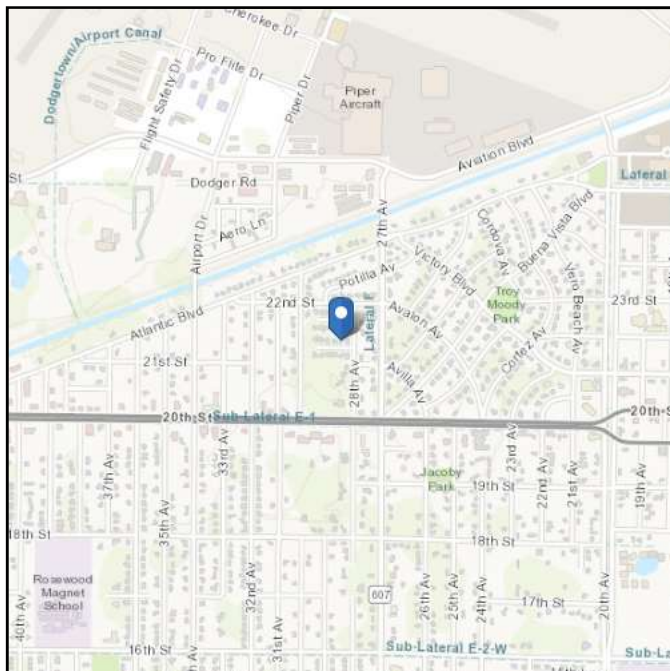

Wind

Results:

Wind Speed	156 Vmph
10-year MRI	79 Vmph
25-year MRI	105 Vmph
50-year MRI	117 Vmph
100-year MRI	128 Vmph
300-year MRI	144 Vmph
700-year MRI	156 Vmph
1,700-year MRI	167 Vmph
3,000-year MRI	178 Vmph
10,000-year MRI	188 Vmph
100,000-year MRI	211 Vmph
1,000,000-year MRI	231 Vmph

Data Source: ASCE/SEI 7-22, Fig. 26.5-1B and Figs. CC.2-1–CC.2-4, and Section 26.5.2

Date Accessed: Wed May 13 2026



Value provided is 3-second gust wind speeds at 33 ft above ground for Exposure C Category, based on linear interpolation between contours. Wind speeds are interpolated in accordance with the 7-22 Standard. Wind speeds correspond to approximately a 7% probability of exceedance in 50 years (annual exceedance probability = 0.00143, MRI = 700 years). Values for 10-year MRI, 25-year MRI, 50-year MRI and 100-year MRI are Service Level wind speeds, all other wind speeds are Ultimate wind speeds.

Site is in a hurricane-prone region as defined in ASCE/SEI 7-22 Section 26.2. Glazed openings shall be protected against wind-borne debris as specified in Section 26.12.3.

The ASCE Hazard Tool is provided for your convenience, for informational purposes only, and is provided “as is” and without warranties of any kind. The location data included herein has been obtained from information developed, produced, and maintained by third party providers; or has been extrapolated from maps incorporated in the ASCE standard. While ASCE has made every effort to use data obtained from reliable sources or methodologies, ASCE does not make any representations or warranties as to the accuracy, completeness, reliability, currency, or quality of any data provided herein. Any third-party links provided by this Tool should not be construed as an endorsement, affiliation, relationship, or sponsorship of such third-party content by or from ASCE.

ASCE does not intend, nor should anyone interpret, the results provided by this Tool to replace the sound judgment of a competent professional, having knowledge and experience in the appropriate field(s) of practice, nor to substitute for the standard of care required of such professionals in interpreting and applying the contents of this Tool or the ASCE standard.

In using this Tool, you expressly assume all risks associated with your use. Under no circumstances shall ASCE or its officers, directors, employees, members, affiliates, or agents be liable to you or any other person for any direct, indirect, special, incidental, or consequential damages arising from or related to your use of, or reliance on, the Tool or any information obtained therein. To the fullest extent permitted by law, you agree to release and hold harmless ASCE from any and all liability of any nature arising out of or resulting from any use of data provided by the ASCE Hazard Tool.



Front



Right



Back



Left



Re-Roof 3/01/18, Permit 2018030047



SWR



Roof to wall attachment - Single wrap



Roof to wall attachment - Single wrap



Roof pitch



Roof deck - 3/4" planks



Roof deck



Roof deck nail spacing - 4 nails per bd



Roof deck attachment - 8d nails



No protection



OHGD is not rated