

Office of the
Chief Fire Officer
Karnataka State Fire and
Emergency Services.
HUBLI-25.

CNO :04:CFO:HBL:2012

Date : 23-06-2012

TO,

V.Sivaprakasam
Chief Executive Officer(Group)
Nirani Sugars Ltd. Kulali Cross,
Jamakhandi Road, Ta/Mudhol
Di/ Bagalkot.

Sir,

Sub:- Issue of Advice/NOC from Fire and Emergency Services
Department – Regarding.

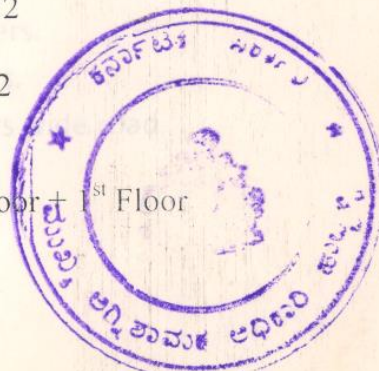
Ref :- CNO:221:RFO:HUBLI:2012 Date:-23-06-2012

*_*_*_*_*_*_*_*_*_*_*_*_*_*_*_**

With reference to your letter cited above. **The Regional Fire Officer, Hubli Range**, from Fire Prevention, Fire Fighting and evacuation point of view, has inspected the School building. The following are the particulars:-

A.Details of premises:-

- 1.Name & Address of the applicant : V.Sivaprakasam
Chief Executive Officer(Group)
Nirani Sugars Ltd. Kulali Cross,
Jamakhandi Road, Ta/Mudhol
Di/ Bagalkot.
2. Name & Address of the premises : Vijay School,Sy.No.143,
MRN International Education Trust.
Kulali Road, Ta/Mudhol, Di/Bagalkot.
3. Date of receipt of memo for inspection : 10-06-2012
4. Date of inspection : 12-06-2012
5. Number of Block/Building : One (01)
6. Number of floors in each Blocks building : Ground Floor + 1st Floor



17. Canopy or balcony projections : No canopy provided
7. Floor wise details of the occupancy : Enclosed.
 Ground Floor : 7 Classrooms, Hall with Stage & Dress room, Office room, Principal room, Library, Board room, Staff room.
18. Arrangements for parking the cars
19. If Basement provided numbers of Ramps basement and it's location : 10 Class rooms, Hall with Stage & Dress room, Computer room.
20. Numbers of staircases
8. Height of the blocks/building : 7.30 mtrs.
21. Location of the staircases (extended or terminated) : 04 Acres
9. Site area
10. Built-up area of the each floor :
 Ground floor : 1314.50 sq.f
 1st floor : 1314.50 sq.f
22. Width of the stairs
11. Total built area : 2656.10 sq.ft
23. Width of Treads
12. Surrounding properties :
 East : Open Play ground.
 West : Open space.
 North : Open then parking area.
 South : 10 meters wide road
24. Height of rises
25. Numbers of lifts in a flight
26. Height of land
13. Width of the abutting road/roads & Condition (hard surfaced or not) : 10.00 mtr wide pakka(Hard Surface) Road on the Western Side.
27. Head room clearance
28. Point & from the dead-end of the road
14. Number of entrance and with of each entrance to : One Entrance of 6 mtrs & one Exit of 6 mtrs Located on the Western Side.
29. Capacity of over head/underground tank
15. Height clearance over the entrance : Open to the Sky.
16. Width of Open space
30. Capacity of main supply standby Pump Required
31. Nearest fire station phone number
- Front (West) : 10 Meters.
 Rear (East): : 100 Meters.
 Side (North) : 20 Meters.
 Side (South) : 10 Meters wide road.

17. Canopy or balcony projections : No canopy provided
 Provided if so at what height
18. Arrangements for parking the cars : Proposed to provide space for car
 Parking at Northern side.
19. If Basement is provided numbers of : Not Basements.
 Ramps basement and it's location
20. Numbers of staircases. : 02.
21. Location of the staircases (extended : 02 staircases. One is Located on the
 to the basement or terminated Northern Side. And the another on is
 ground level) Southern Side.
22. Width of the staircases : 1.5 M.
23. Width of Treads : 30 CM.
24. Height of rises : 15 CM.
25. Numbers of risers in a flight : 14
26. Height of hand rails : 1.5 M.
27. Head room clearance. : 2.4 M.
28. Travels distance from the farthest : Maximum 24 mtrs from the farthest
 point & from the dead-end of the point.
 corridor to the staircases.
29. Capacity of over head/under ground : Over head 100000 ltrs capacity.
 Tank Required One Bore Well.
30. Capacity of main pump/standby : 5 HP
 Pump Required
31. Nearest fire station and telephone number: Mudhol Fire Station.
 Telephone No. 283101

B. On inspection of the site and examine of the plan. The following fire prevention Fire fighting and evacuation measures are recommended and they are absolutely essential.

1. 9. Nos of 5 KG ABC Extinguishers have been provided.
2. 7 Nos of 4.5 KG CO2 Extinguishers & 3 Nos of 2 KG CO2 Extinguishers & 8 Nos Fire Buckets have been provided.
3. Petroleum products like LPG, Petrol, etc. shall not be stored in the school Building.
4. An awareness program of fire fighting and safety to be conducted in your school for school children and teachers in this regard the management or The Principal of the school should contact the Chief fire Officer Hubli Zone.
5. No thatched houses shall be erected in the school premises.
6. If kitchen of canteen is provided, it should be in a separate building minimum 15 mts away from school building.
7. Jump wires and loose connection of electric wirings and inflammable are prohibited.
8. Combustible material shall not be stored in the school premises.
9. All the equipments have to be periodically checked up by the trained staff of school.
10. 4 staff member should be trained at R.A.Mundakur Fire Service Academy Bangalore so as to operate the extinguishers in case of emergency.
11. If management not fulfill the above condition this certificate shall be cancelled immediately.

Hence, this advice cum safety certificate is granted to **Vijay School, Sy.No.143, MRN International Education Trust, Kulali Road, Ta/Mudhol, Di/Bagalkot** valid for a period of one year from the date of issue of this letter and **It's renewable.**



M. S. Reddy
Chief Fire Officer 23/06.
Karnataka State Fire and
Emergency Services,
HUBLI-25.

ಕ. ಅ. ಸಂ. 2

Hubli

ನರಸೀಪುರ

ಕರ್ನಾಟಕ ಸರ್ಕಾರ





SBI

ಬ್ಯಾಂಕ್ / ಖಜಾನೆಯಲ್ಲಿ

ಮೂಲ ಪತ್ರಿಕೆ

ಪಾವತಿಸಿದೆ.

ನಗದು ಹಣದ ಚಲನ್

ಖಜಾನೆ ಕೋಡು	ವ್ಯ. ಅ. ಕೋಡು	ದಿನಾಂಕ	ಚಲನ್ ಸಂ.
310000	017236	12	
ಪಾವತಿದಾರನ ಹೆಸರು:	Chief Executive Officers (Group) Vijaya School MRN Institutions and Education Trust Kuvalli Road Muddholi		
ವಿಳಾಸ:	Issue of School Building Fire Safety Certificate		
ವಾಪಸಿಯ ಉದ್ದೇಶ:	ಸರಿಯಾಗಿದ ಪರಿ ಸ್ವೀಕರಿಸಿ		
ಲೆಕ್ಕದ ಬಾಬಿನ ವಿವರ	0070-Other Administrative Service 60-Other Services 109-Fire Protection & Control 002-Other Items	 ಮುಖ್ಯ ಅಧಿಕಾರಿ ಅಧಿಕಾರಿ ಕರ್ನಾಟಕ ರಾಜ್ಯ ಅಧಿಕಾರಿ ಮುಖ್ಯ ಮಂತ್ರಿ ಸಚಿವರು ಬೆಂಗಳೂರು-25 ನಂ ರೂ.	
ಪಾವತಿಯ ವಿವರ	ಲೆಕ್ಕ ತೀರಿಸಿಕೆ ಕೋಡ್	10,000.00	
1)	0070-Other Administrative Service	10,000.00	
2)	60-Other Services		
3)	109-Fire Protection & Control		
4)	002-Other Items		
		ಒಟ್ಟು ಮೊತ್ತ	10,000.00
ಪದಗಳಲ್ಲಿ	Ten thousand only		
ತಾರೀಖು: 23/6/12	ರೂಪಾಯಿಗಳು ಮಾತ್ರ,		
ಸ್ಥಳ: Hubli	 ಪಾವತಿದಾರನ ಸಹಿ		
ರೂ. 10,000 (ಪದಗಳಲ್ಲಿ)	ರೂಪಾಯಿಗಳು ಮಾತ್ರ, ಸ್ವೀಕರಿಸಿದೆ.		
ಖಜಾನೆ	 ಖಜಾನೆ / ಬ್ಯಾಂಕ್ ಅಧಿಕಾರಿ.		 STATE BANK OF INDIA VIDYANAGAR, HUBLI (09297) 3125726 - Savings Account 123 JUN 2012

ಕಾ.ಸಂ. 200 - ಸ.ವಿ.ಮು.ಧಾ. - 100 ಪಾಲಿಸಿಗಳ 2010 ಕಟ್ಟಡಗಳು - ಉಪವಿ 21194