



LEVEL ACCESS NOTES: (FOR RAMP)


- 1. RAMPS TO BE READILY APPARENT OR CLEARLY SIGN POSTED.
- 2. 1500MM WIDTH WITH VISUALLY CONTRASTING 100MM EDGE KERB.
- 3. LEVEL LANDINGS TO TOP AND BOTTOM MIN 1200MM AND CLEAR OF ANY DOOR SWINGS.
- 4. INTERMEDIATE LANDINGS MIN 1500MM AND CLEAR OF ANY DOOR SWINGS.
- 5. PASSING PLACES / INTERMEDIATE LANDINGS (1800MM X 1800MM) WHERE END OF RAMP OUT OF SIGHT AND WHERE 3 OR MORE CONSECUTIVE RAMP FLIGHTS.
- 6. LANDINGS TO BE LEVEL - MAX 1:60 GRADIENT ALONG LENGTH AND MAX 1:40 CROSS FALL GRADIENT.
- 7. GRADIENT BETWEEN 1:12 AND 1:20.
- 8. MAXIMUM RAMP LENGTH 10M, MAXIMUM RAMP RISE 500MM FOR MAX GRADIENT OF 1:20.
- 9. MAXIMUM RAMP LENGTH 5M, MAXIMUM RAMP RISE 333MM FOR MAX GRADIENT OF 1:15.
- 10. MAXIMUM RAMP LENGTH 2M, MAXIMUM RAMP RISE 166MM FOR MAX GRADIENT OF 1:12.
- 11. SURFACES TO BE DURABLE, SLIP RESISTANT AND RAMP SLOPE TO VISUALLY CONTRAST WITH LANDINGS.
- 12. CLEARLY SIGN POSTED STEPS REQUIRED AS WELL AS RAMP WHERE RISE EXCEEDS 300MM.
- 13. ALTERNATIVE ACCESS METHOD WHERE TOTAL RISE IS GREATER THAN 2M. AN EXTERNAL LIFT IS TO BE PROVIDED.

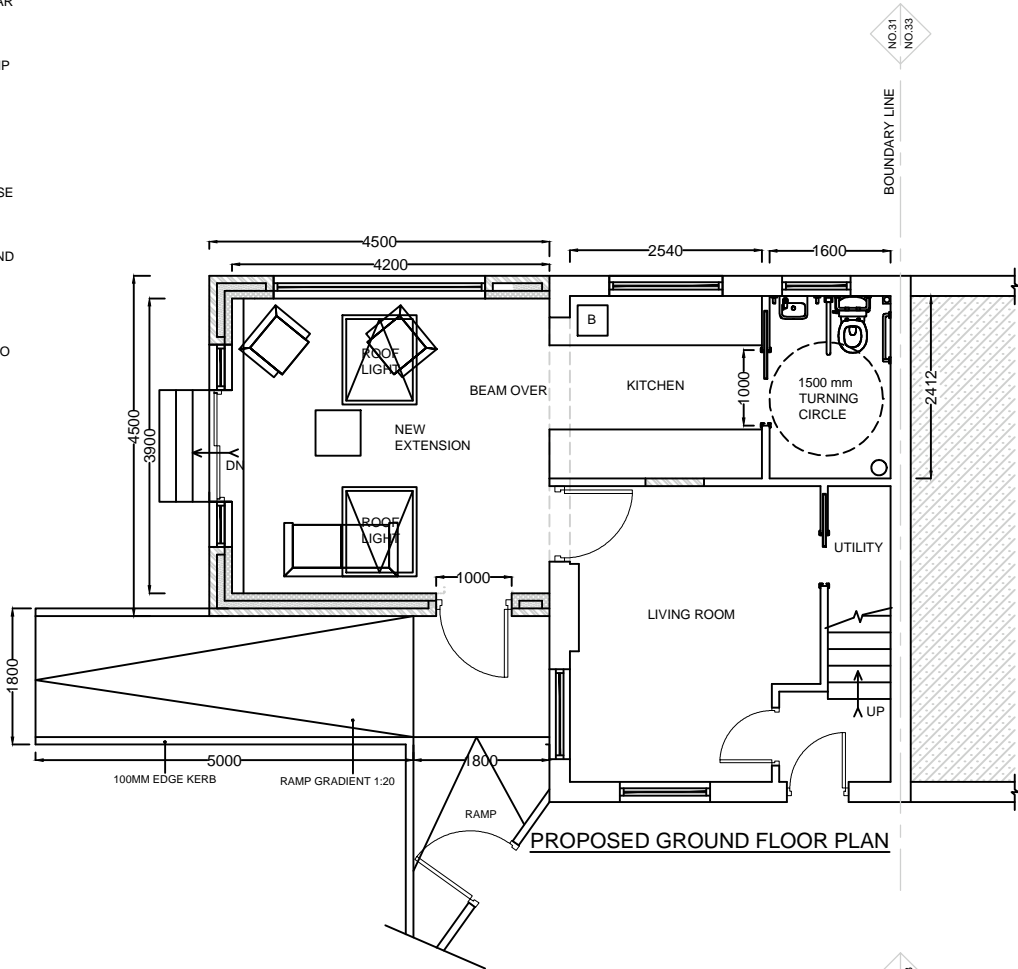

PROPOSED GROUND FLOOR PLAN

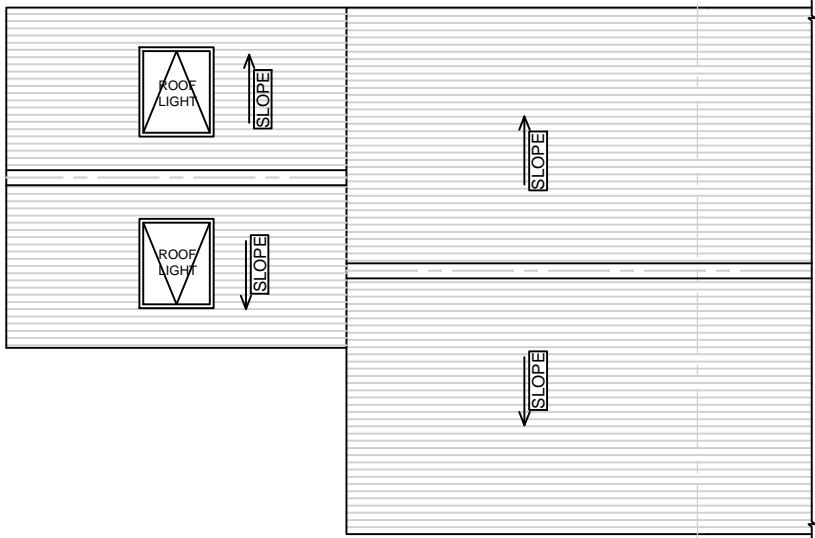

PROPOSED ROOF PLAN

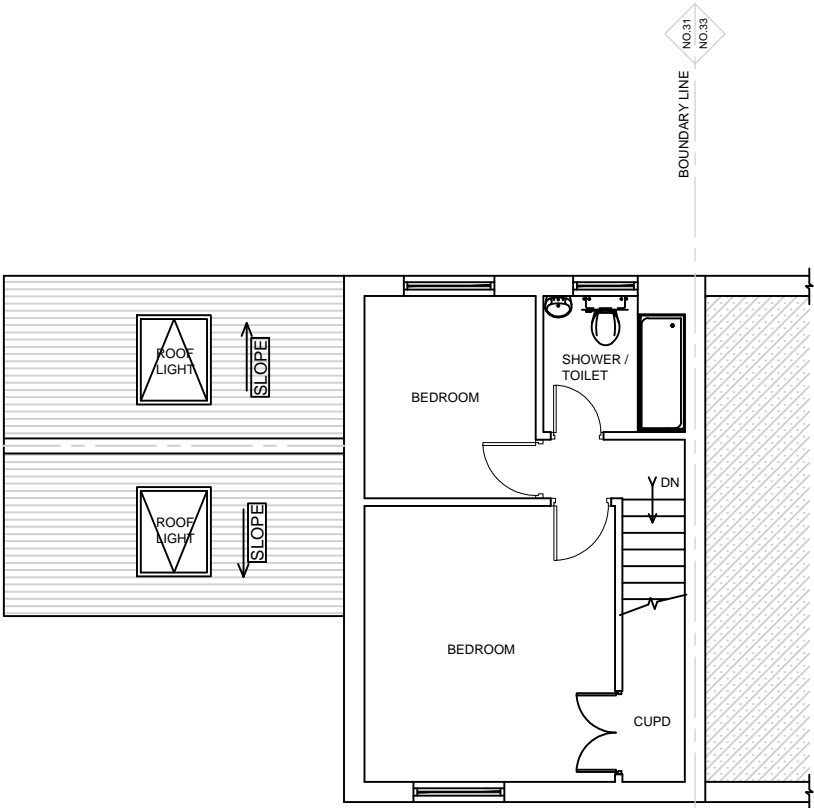

PROPOSED FIRST FLOOR PLAN

