


08 PLUMBING RISER
NO SCALE

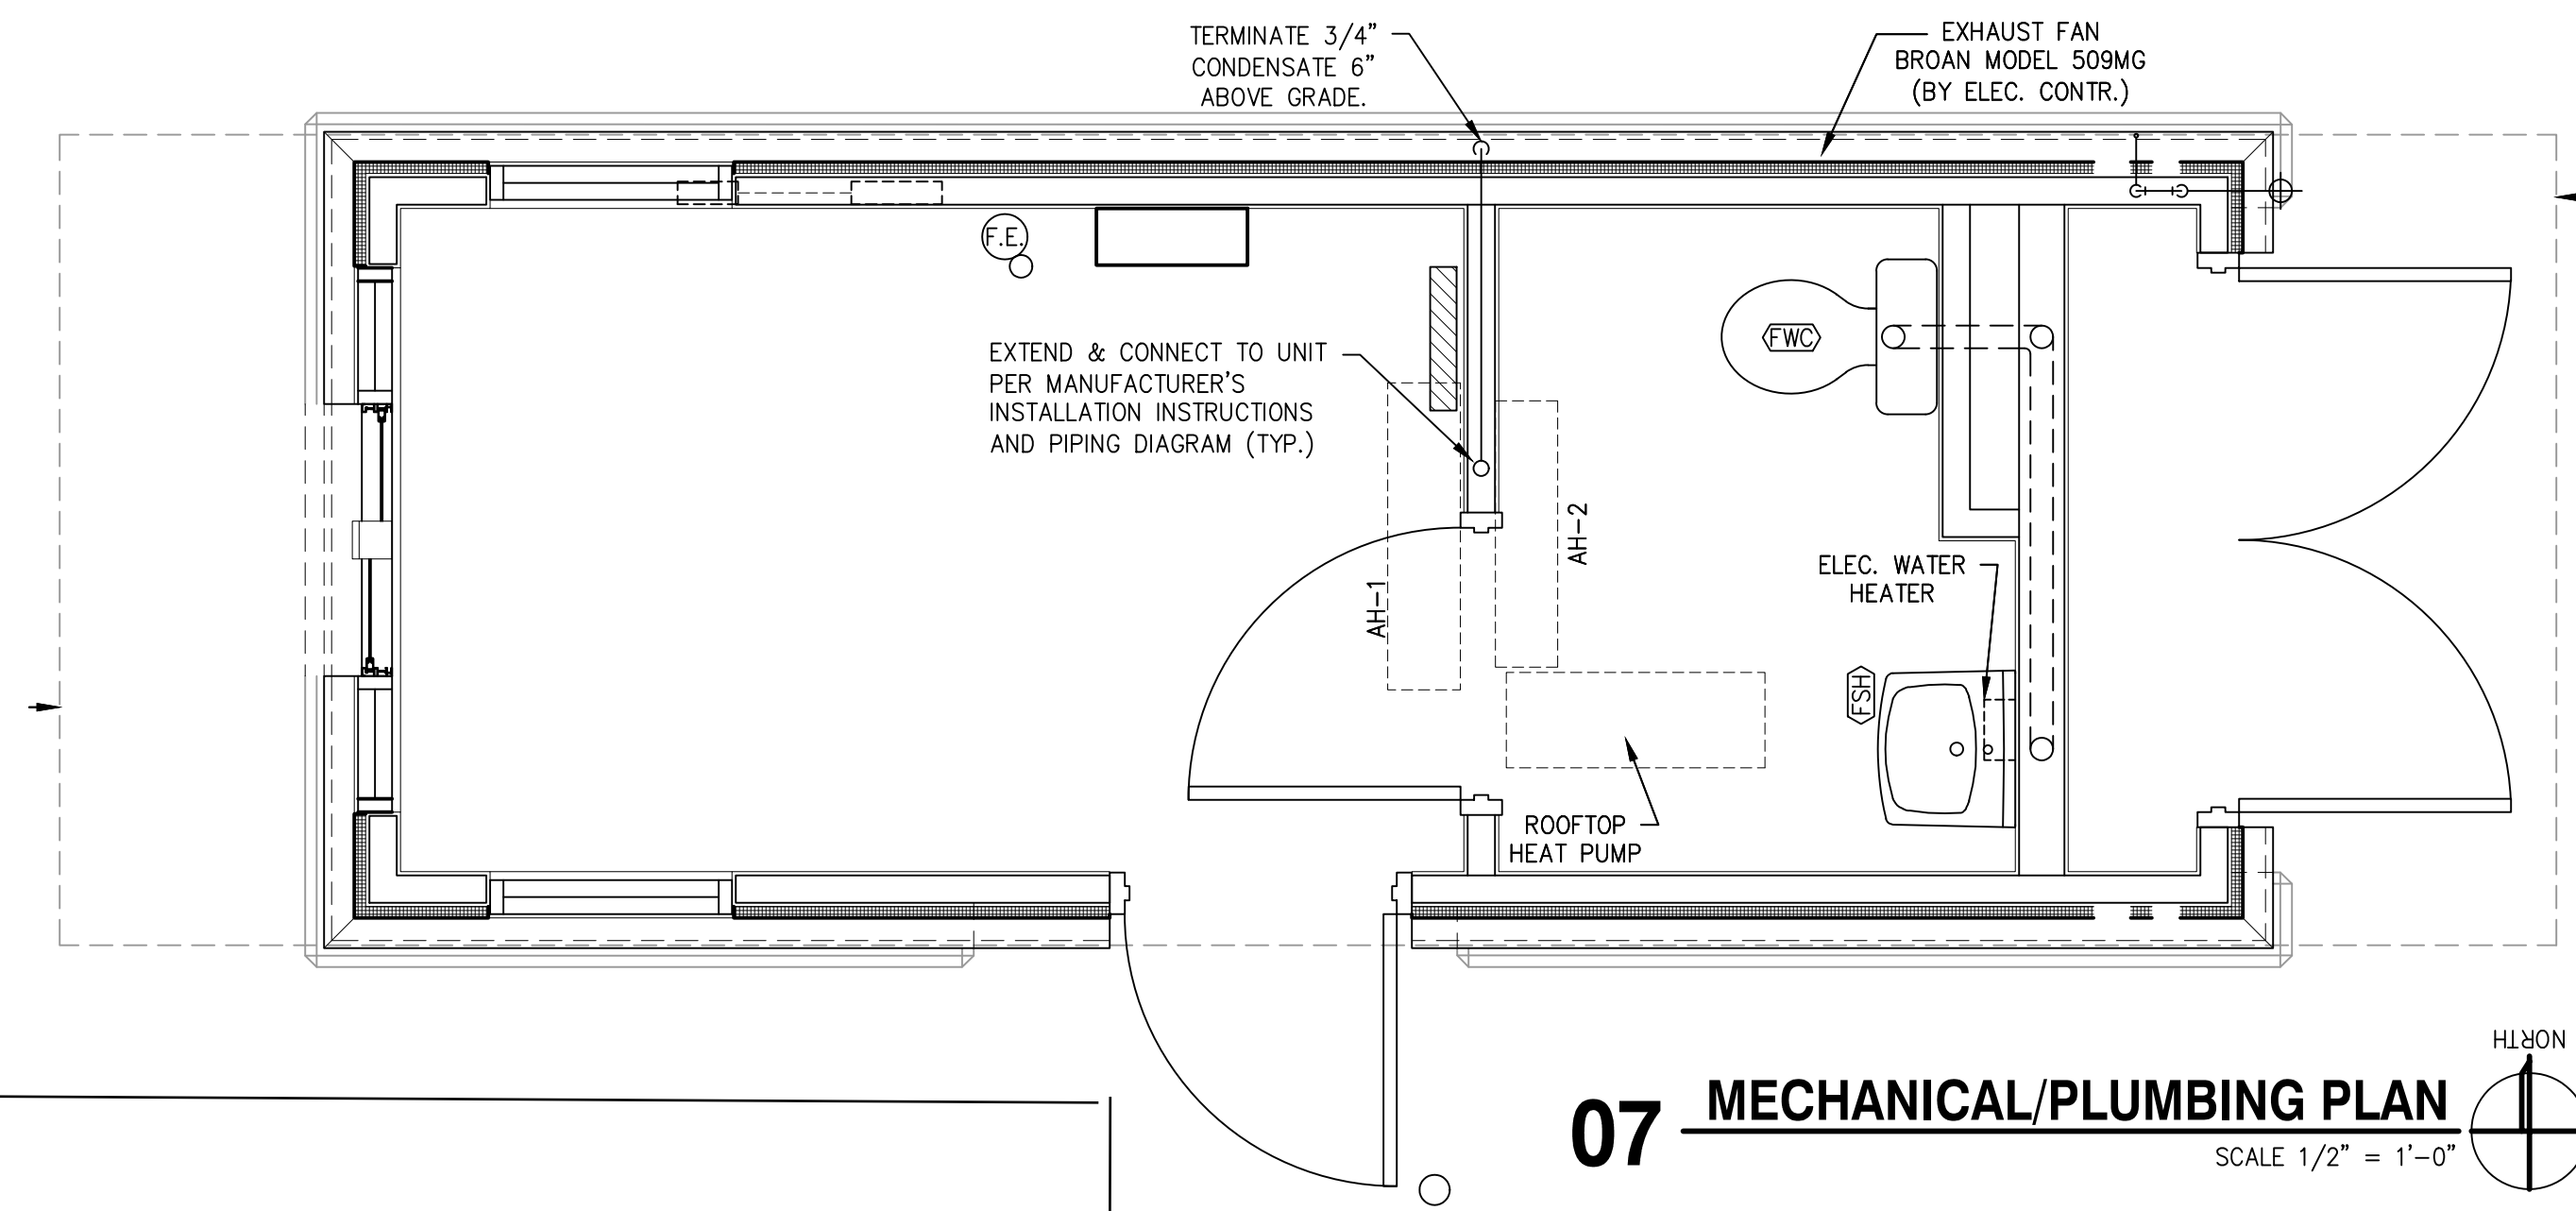



07 MECHANICAL/PLUMBING PLAN
SCALE 1/2" = 1'-0"

HVAC EQUIPMENT


AIR HANDLER 1 (AH-1) - FRIEDRICH MW18Y3J WALL MOUNTED DUCTLESS FAN COIL, 230/208-60-1, TOP OF UNIT 6" BELOW CEILING.
 AIR HANDLER 2 (AH-2) - FRIEDRICH MW09Y3J WALL MOUNTED DUCTLESS FAN COIL, 230/208-60-1, TOP OF UNIT 6" BELOW CEILING.
 CONDENSER - FRIEDRICH MR240Y3.M HEAT PUMP, 230/208-60-1, MCA 15 AMPS.
 THERMOSTAT - FRIEDRICH DW1
 AH1 & AH-2 POWERED FROM CONDENSER/HEAT PUMP SYSTEM, E.C. TO PROVIDE AND INSTALL 30A/2P/240V/NEMA3R/25AF DISCONNECT SWITCH MOUNTED WITH/ON UNIT.

SCOPE: HVAC & PLUMBING


GPD Group, Professional Corporation
Texas Registration No. 16477

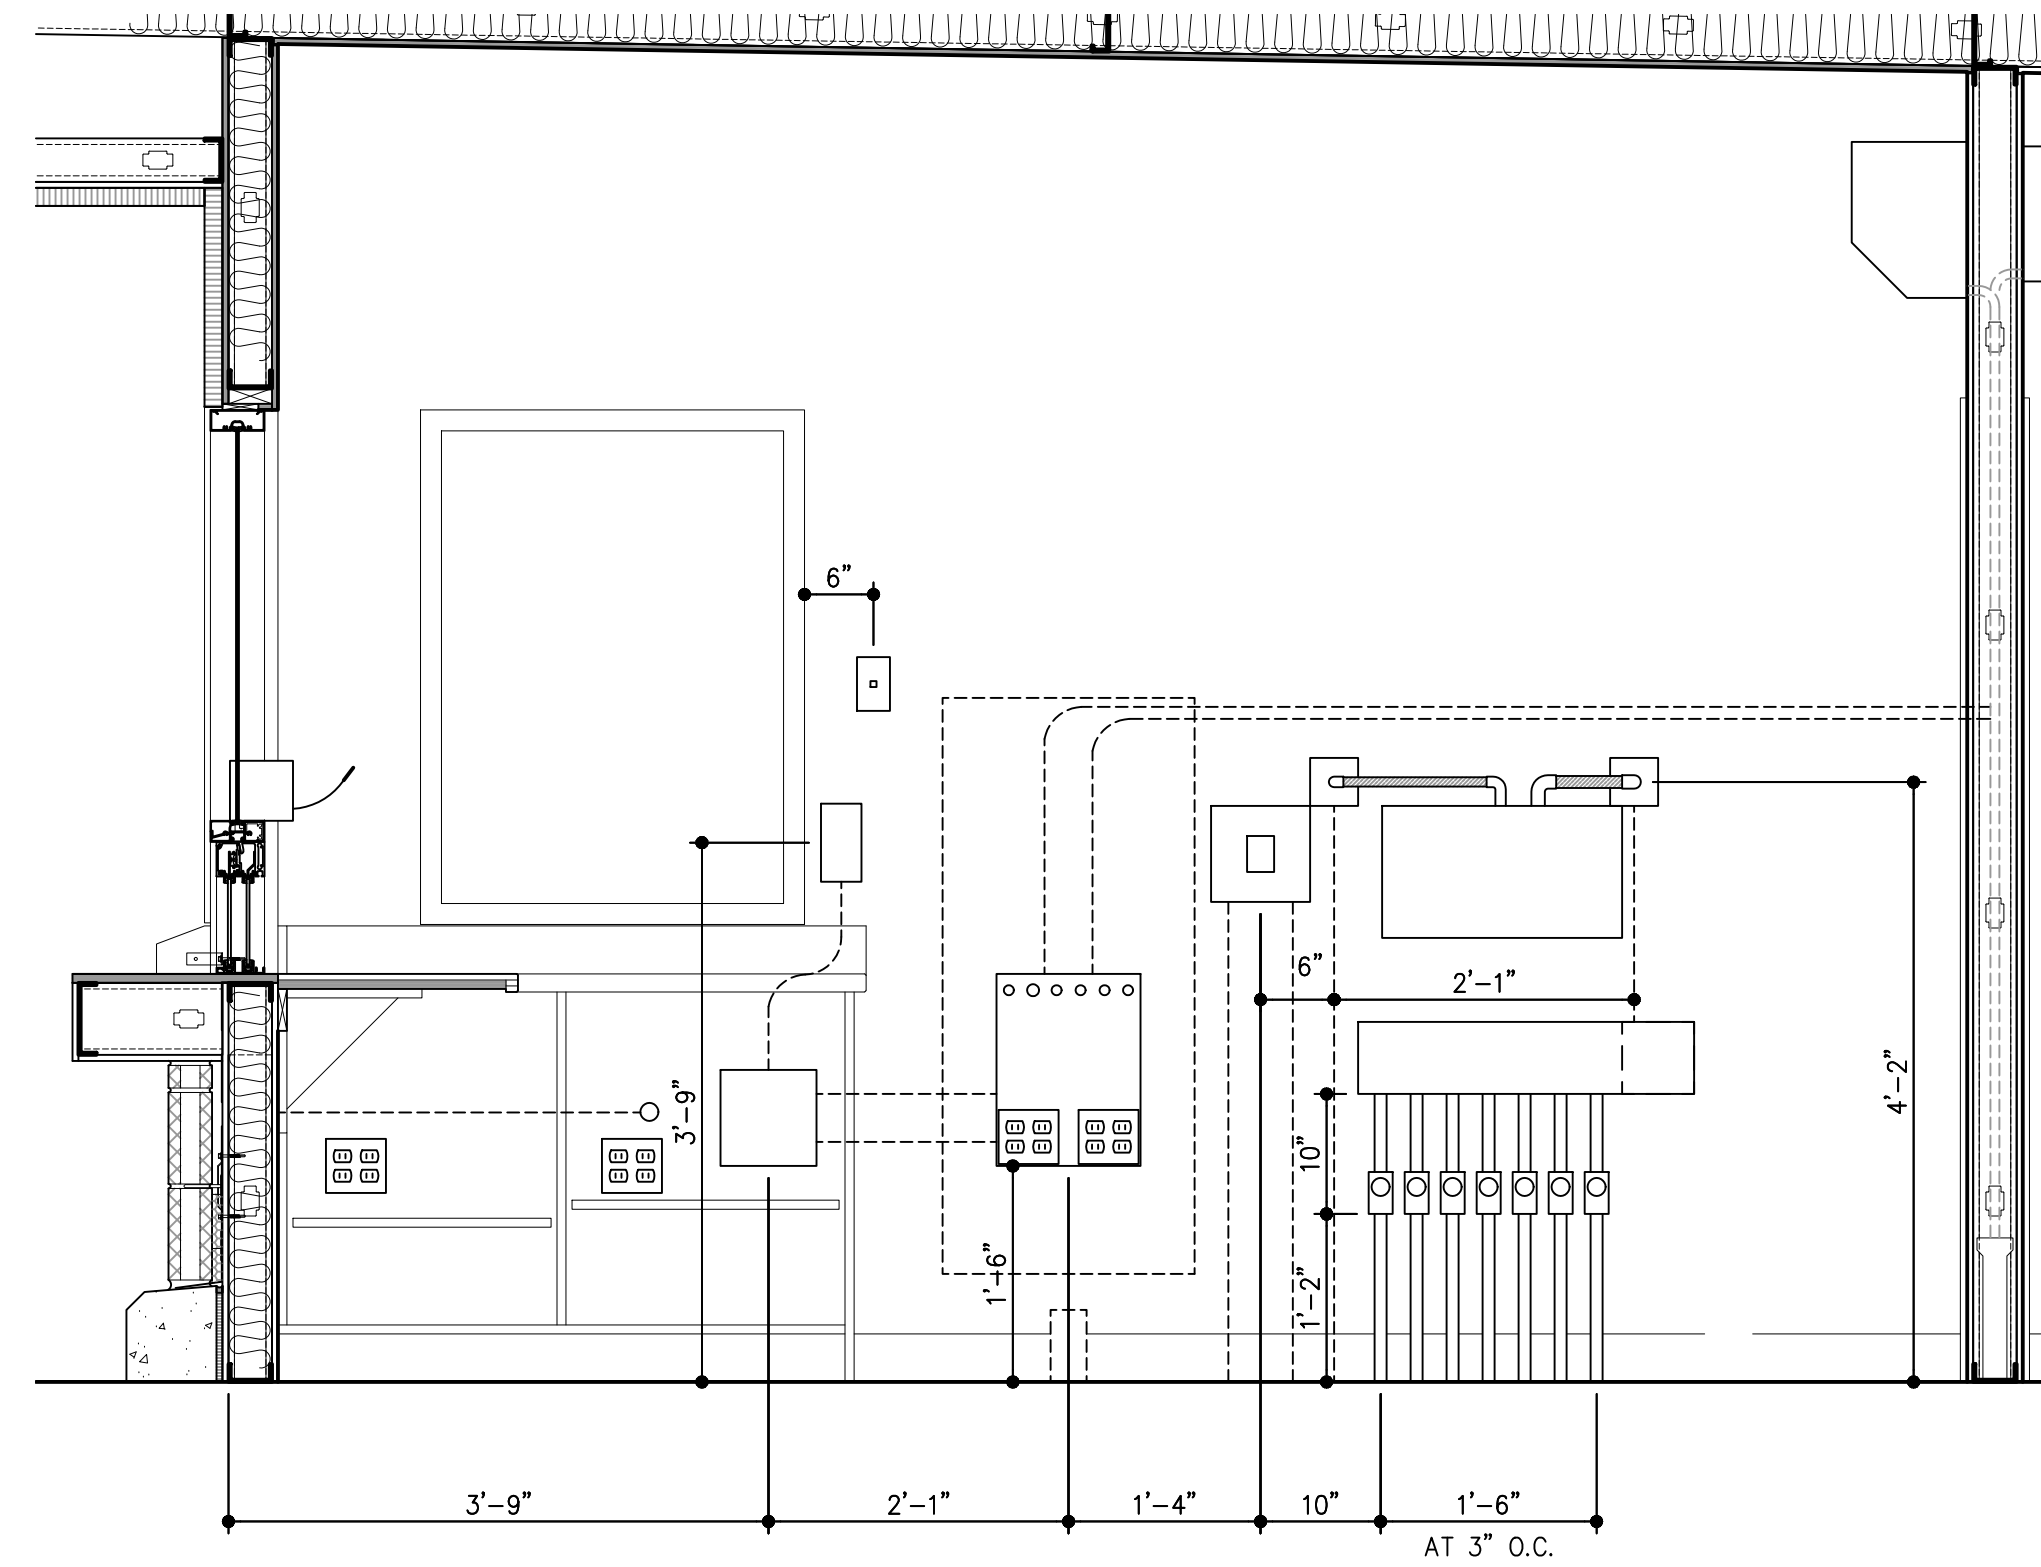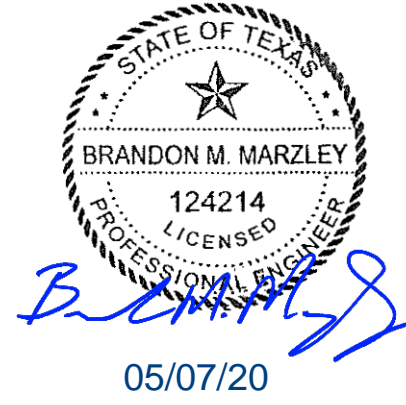


06 ELECTRIC DIMENSION DETAIL
SCALE 3/4" = 1'-0"

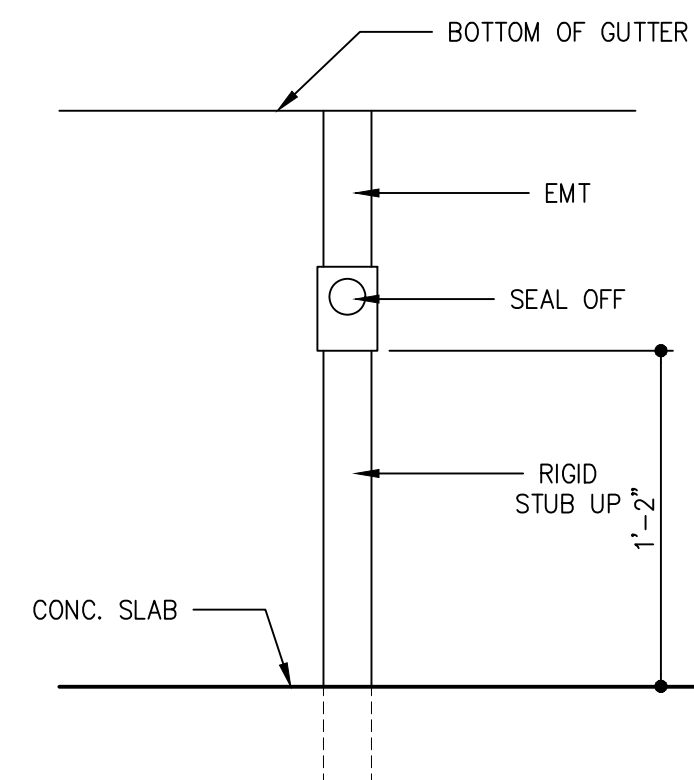


05 STUB-UP DETAIL
NO SCALE

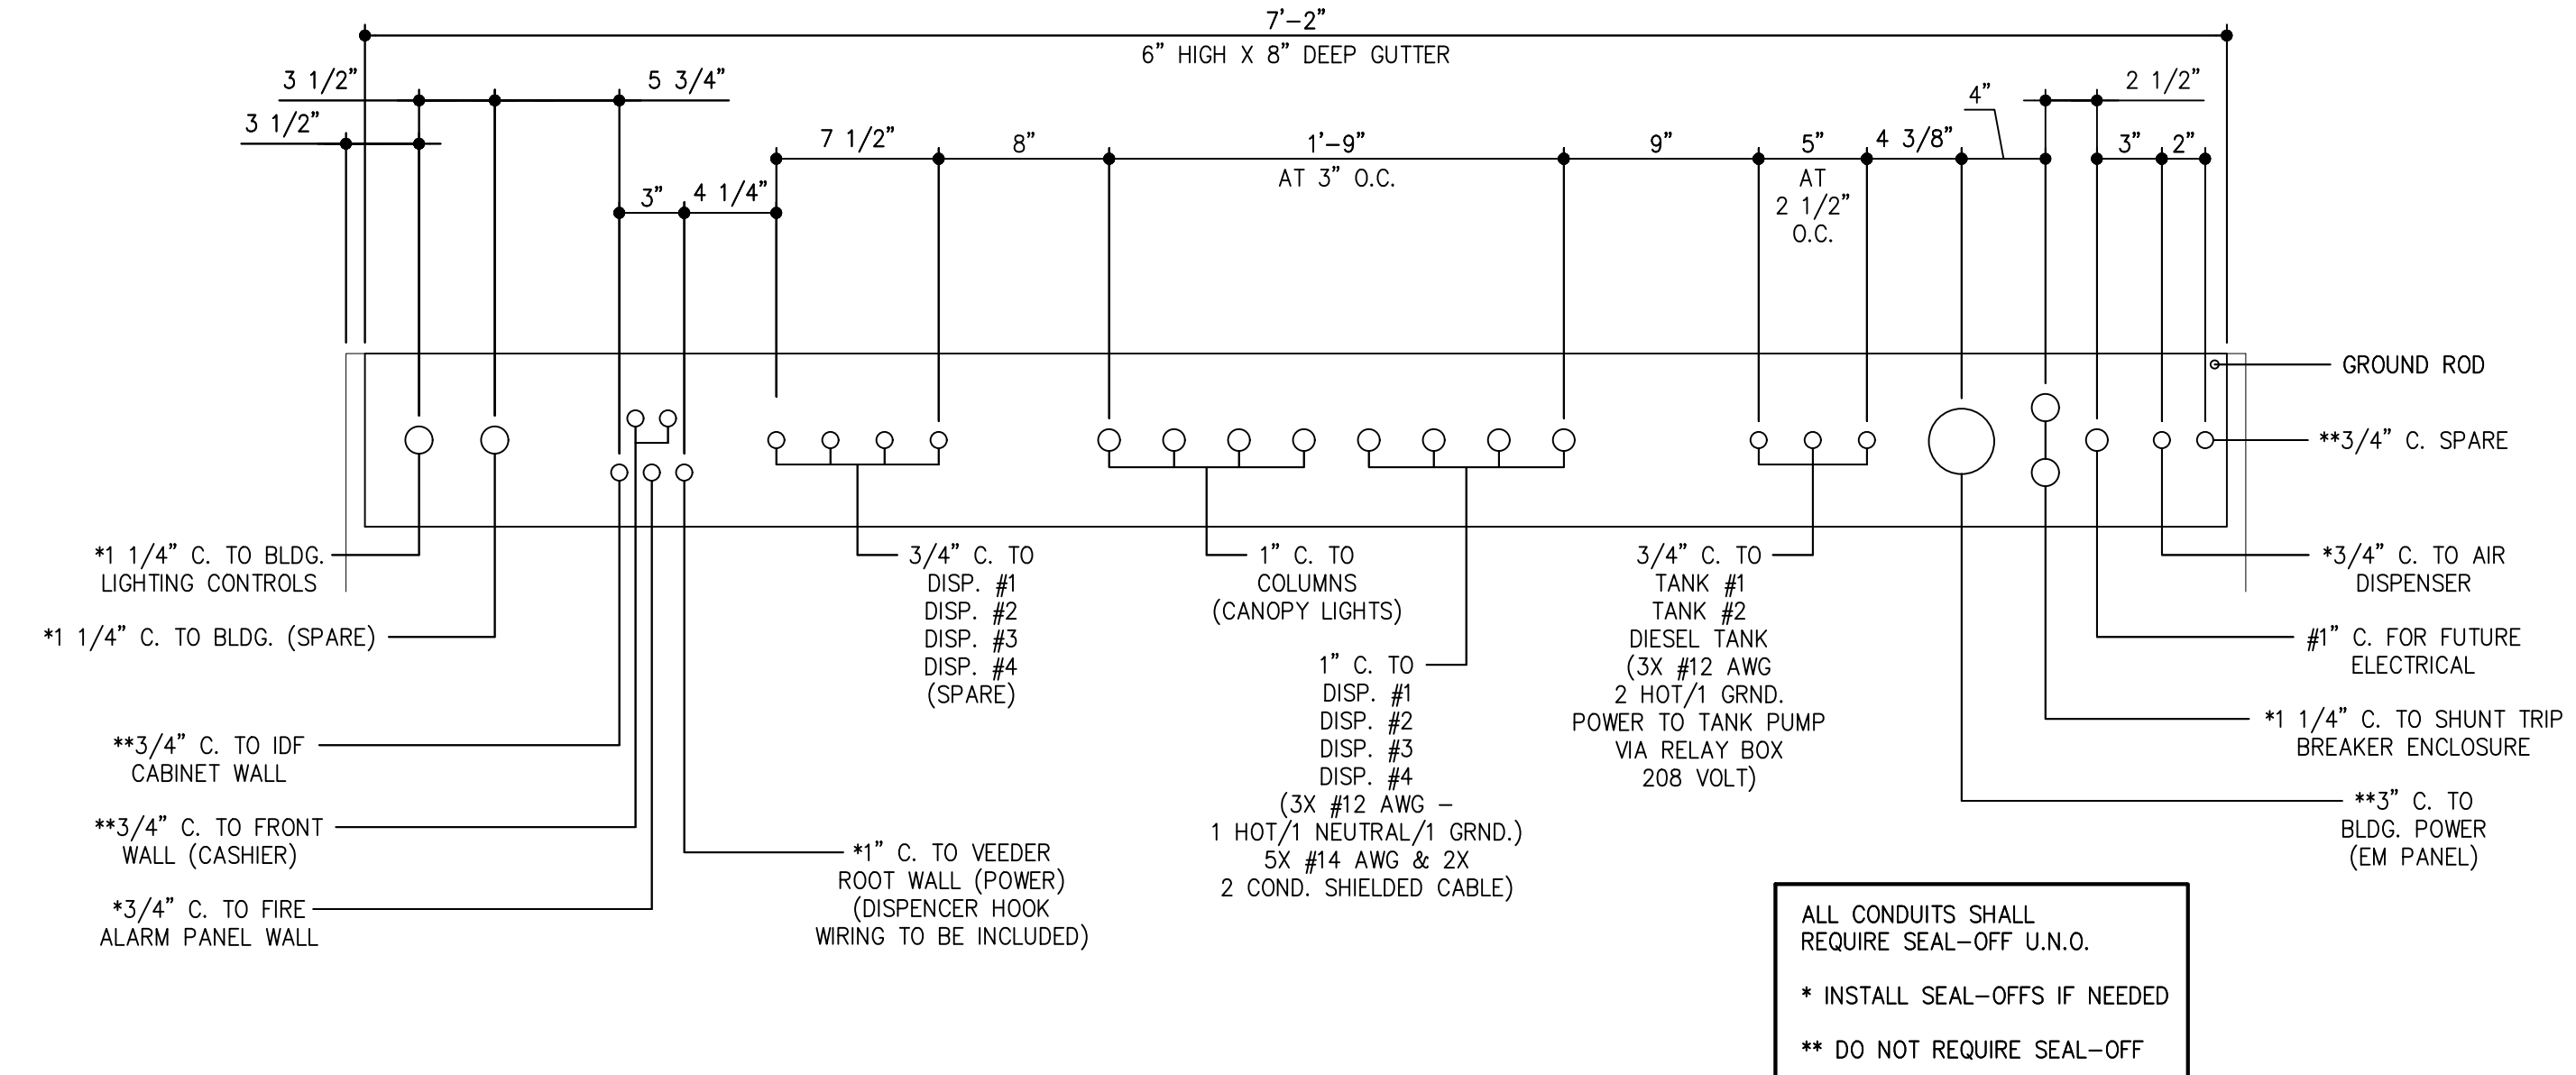


04 GUTTER / CONDUIT STUB-UPS
SCALE 1 1/2" = 1'-0"

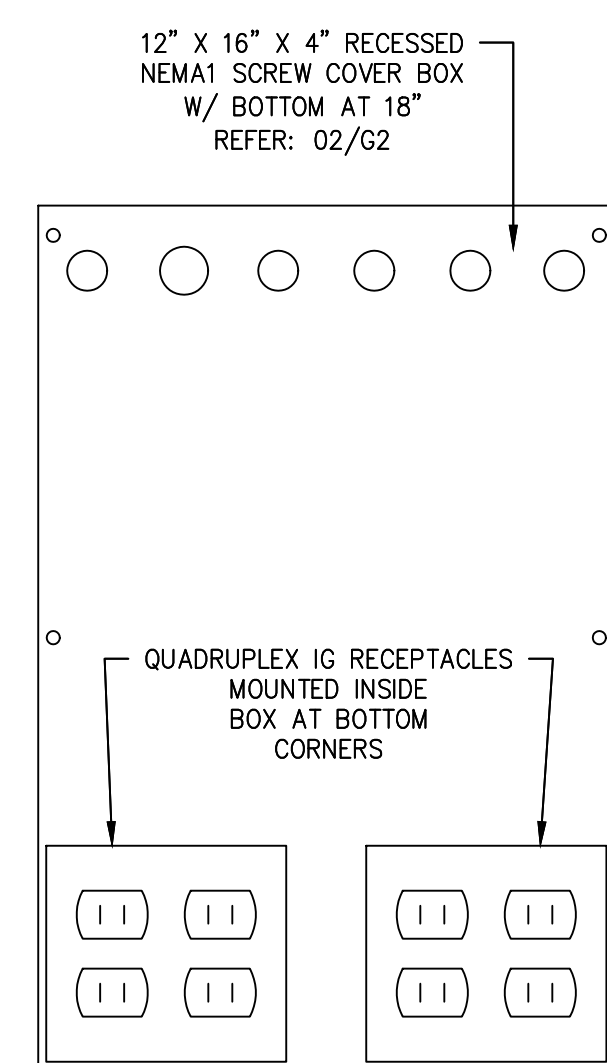

03 RECESSED BOX ELEV.
NO SCALE

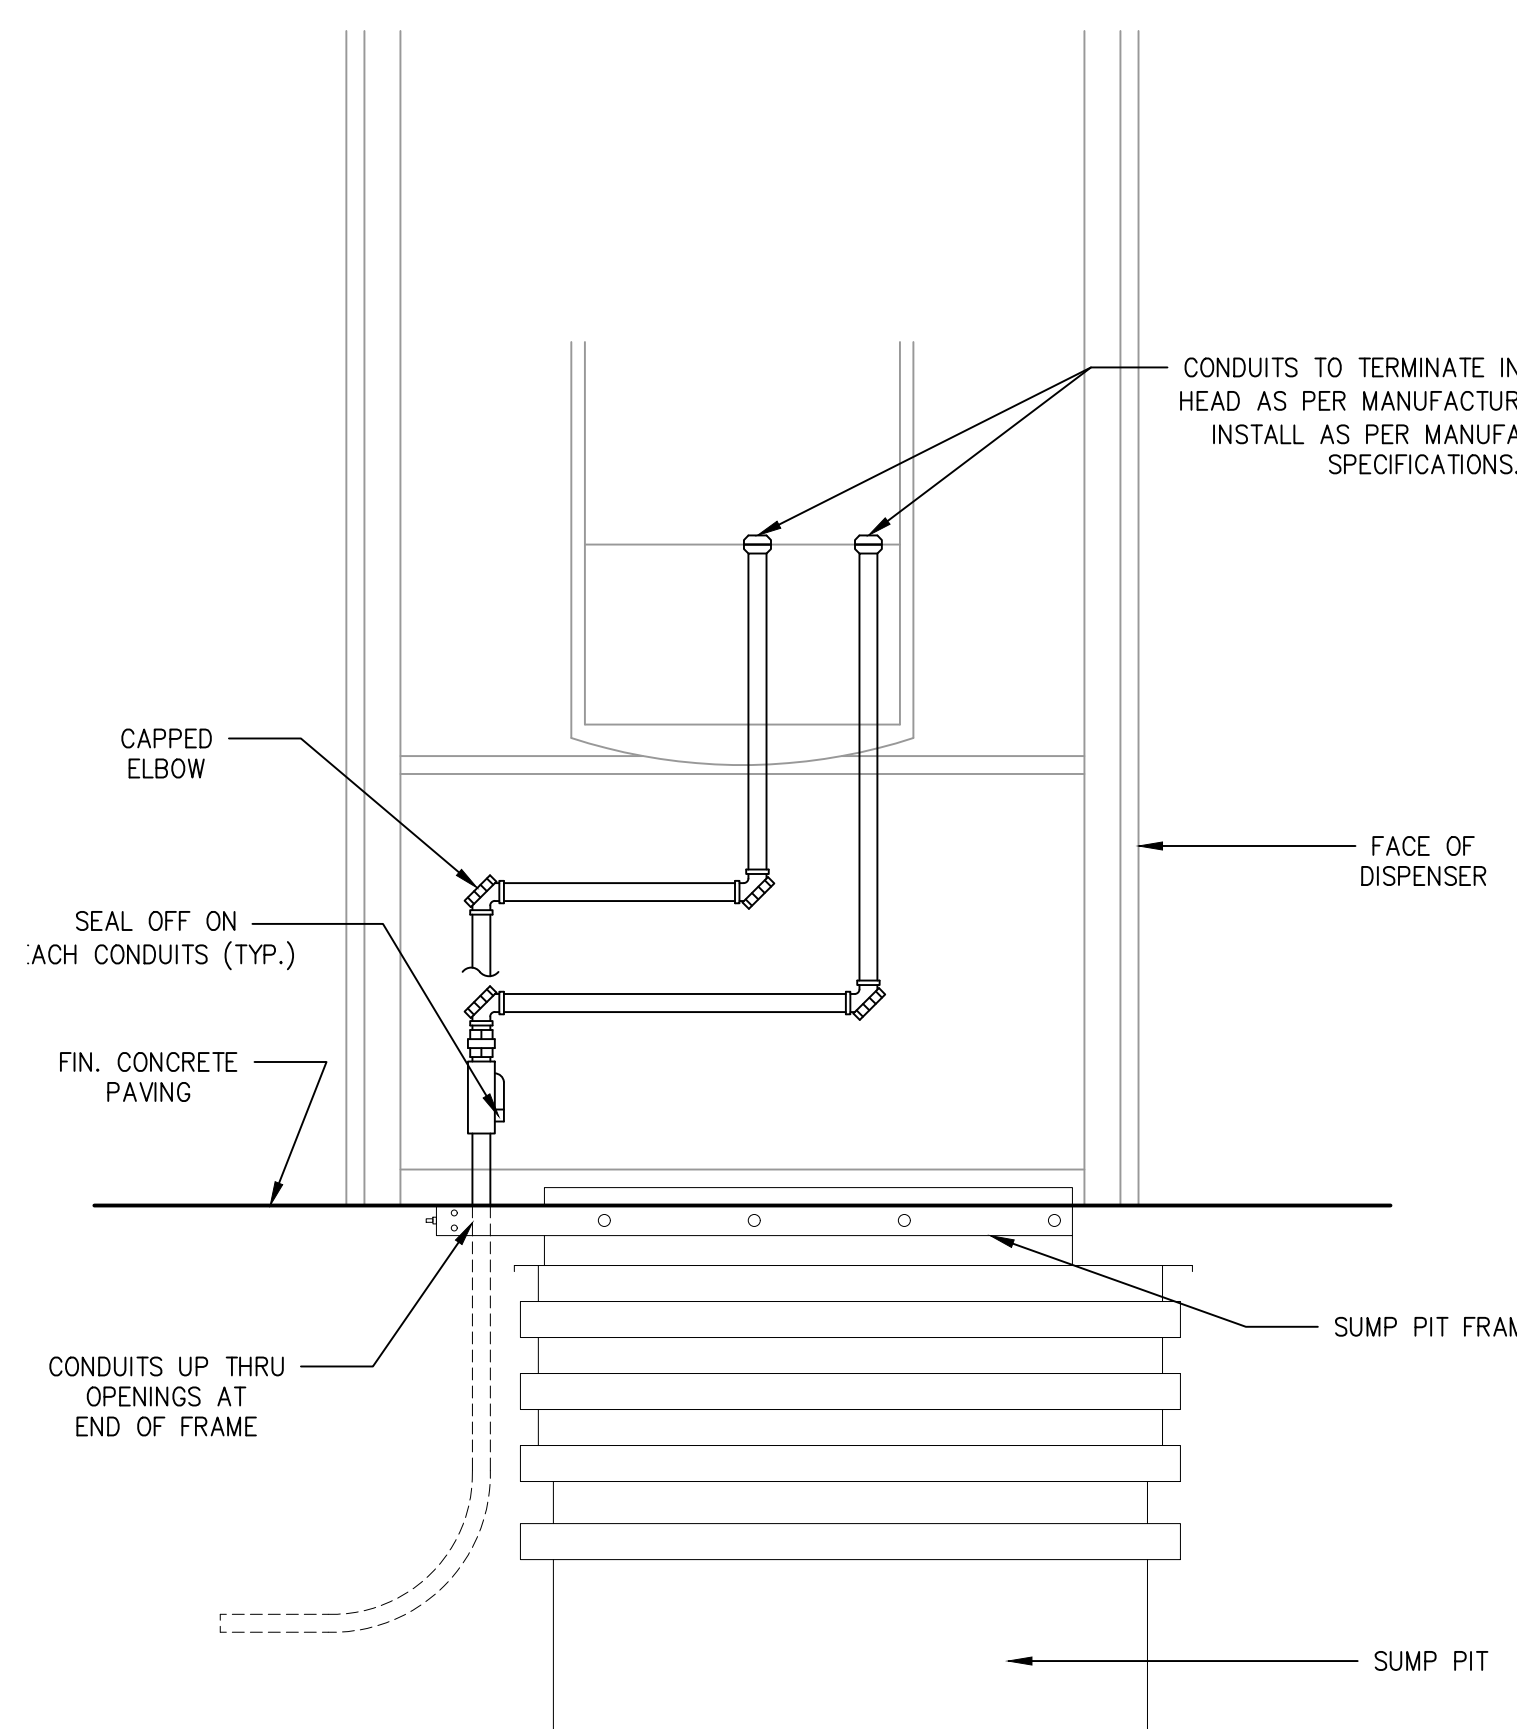


02 DISPENSER SUMP CONDUIT DETAIL
SCALE 3/4" = 1'-0"

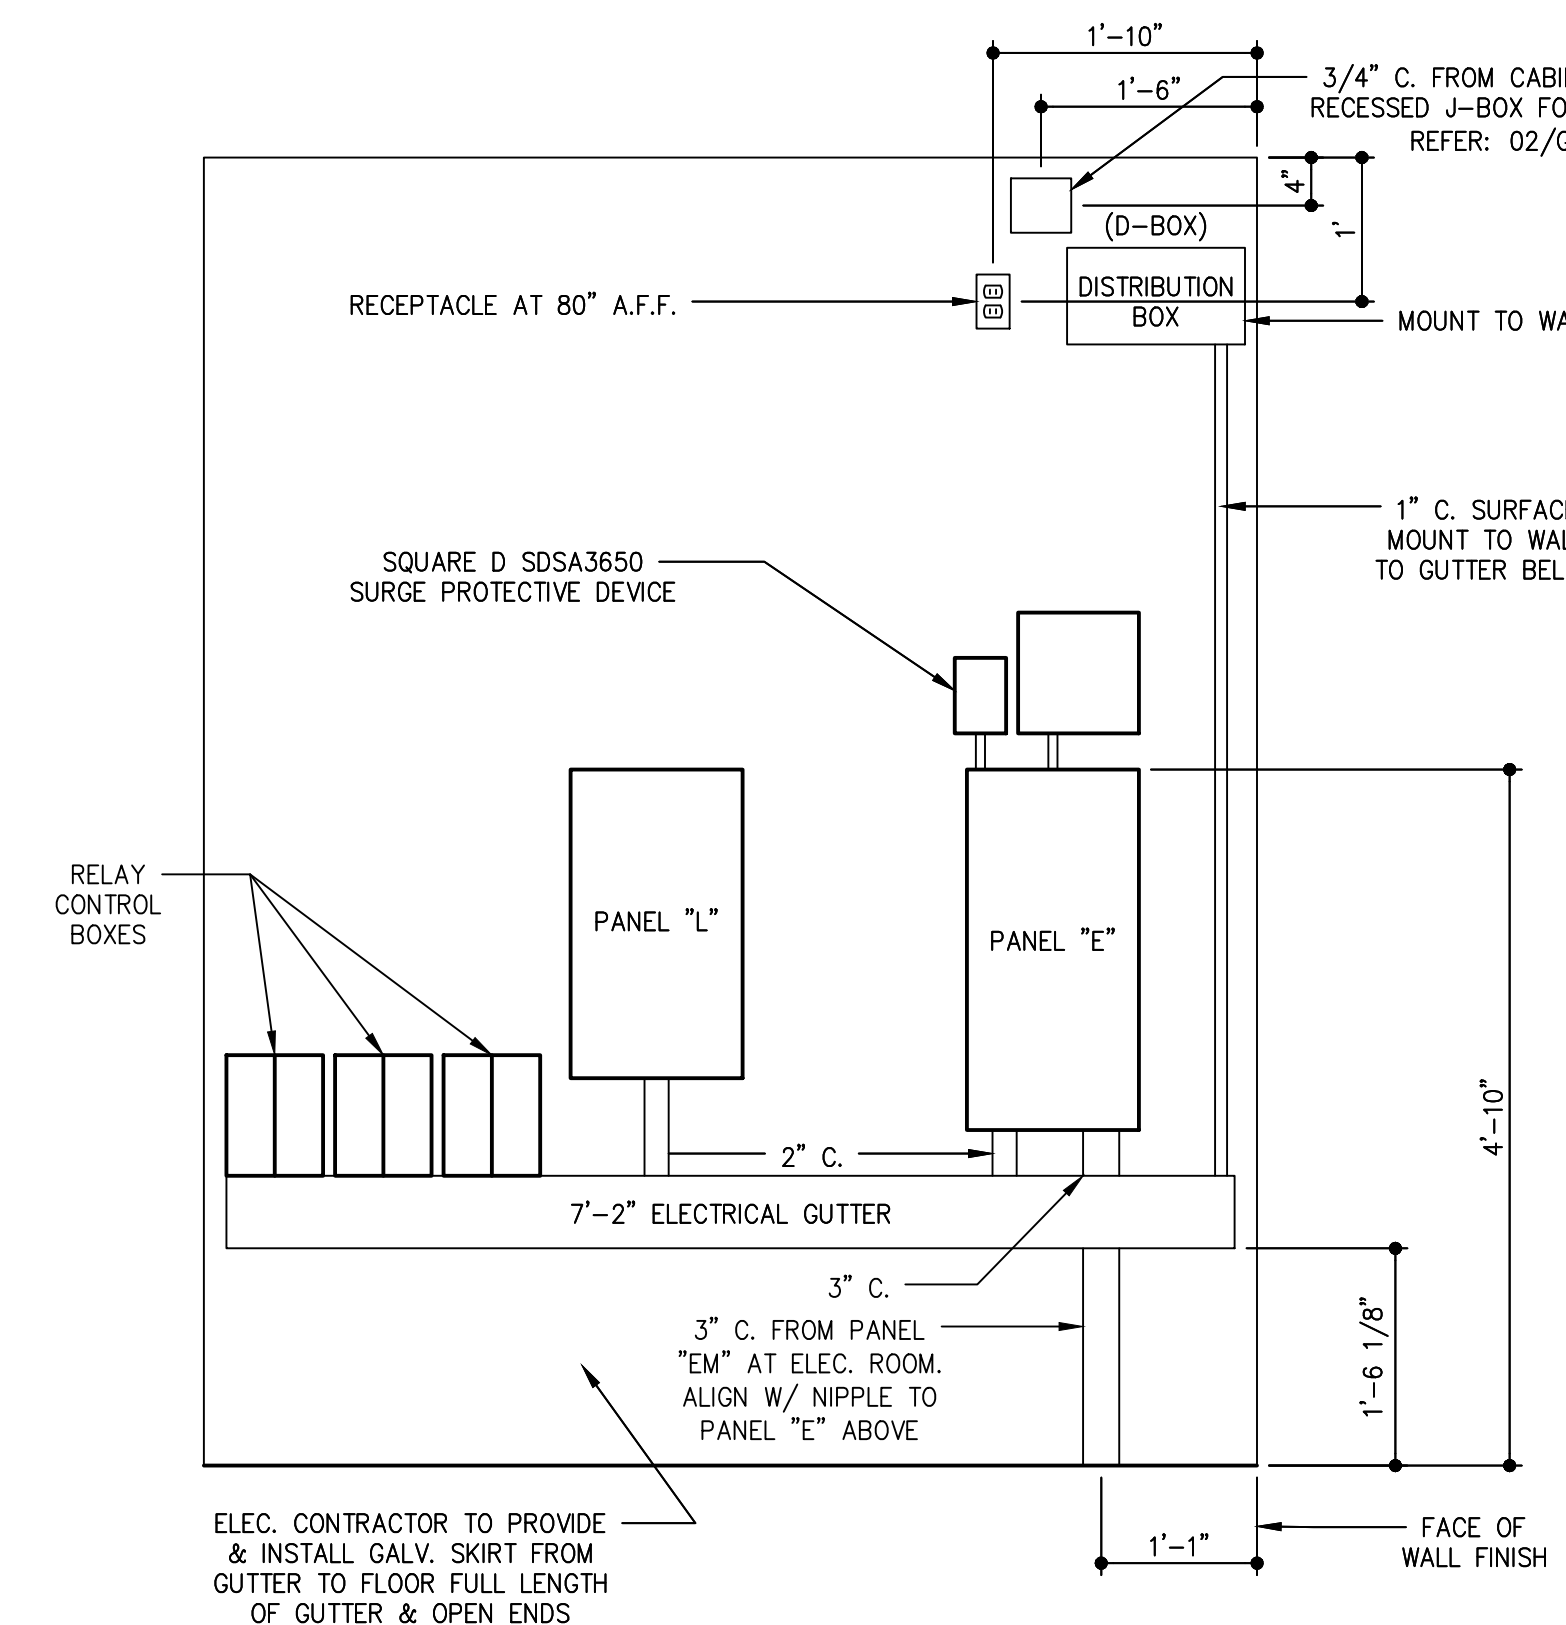

01 INTERIOR ELEVATION
SCALE 3/4" = 1'-0"

SCOPE: ELECTRICAL
GPD Group, Professional Corporation
Texas Registration No. 16477

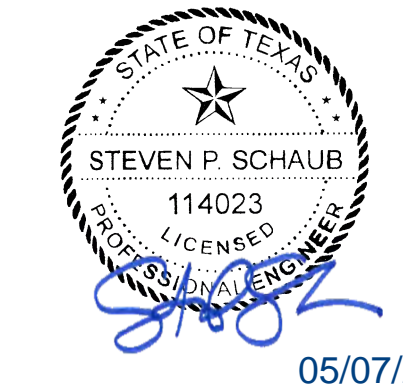


05/07/20

| NO. | DATE | REVISION DESCRIPTION |
|-----|------|----------------------|
| | | |


| | |
|-------------|---------------------------------------|
| ISSUED FOR: | <input type="checkbox"/> PRELIMINARY |
| | <input type="checkbox"/> REVIEW |
| | <input type="checkbox"/> PERMIT |
| | <input type="checkbox"/> BIDDING |
| | <input type="checkbox"/> CONSTRUCTION |

DATE
04/20
PROJECT NO.
4000600-0
STORE NO.
006
SHEET NO.


AS OF: 04/30/20

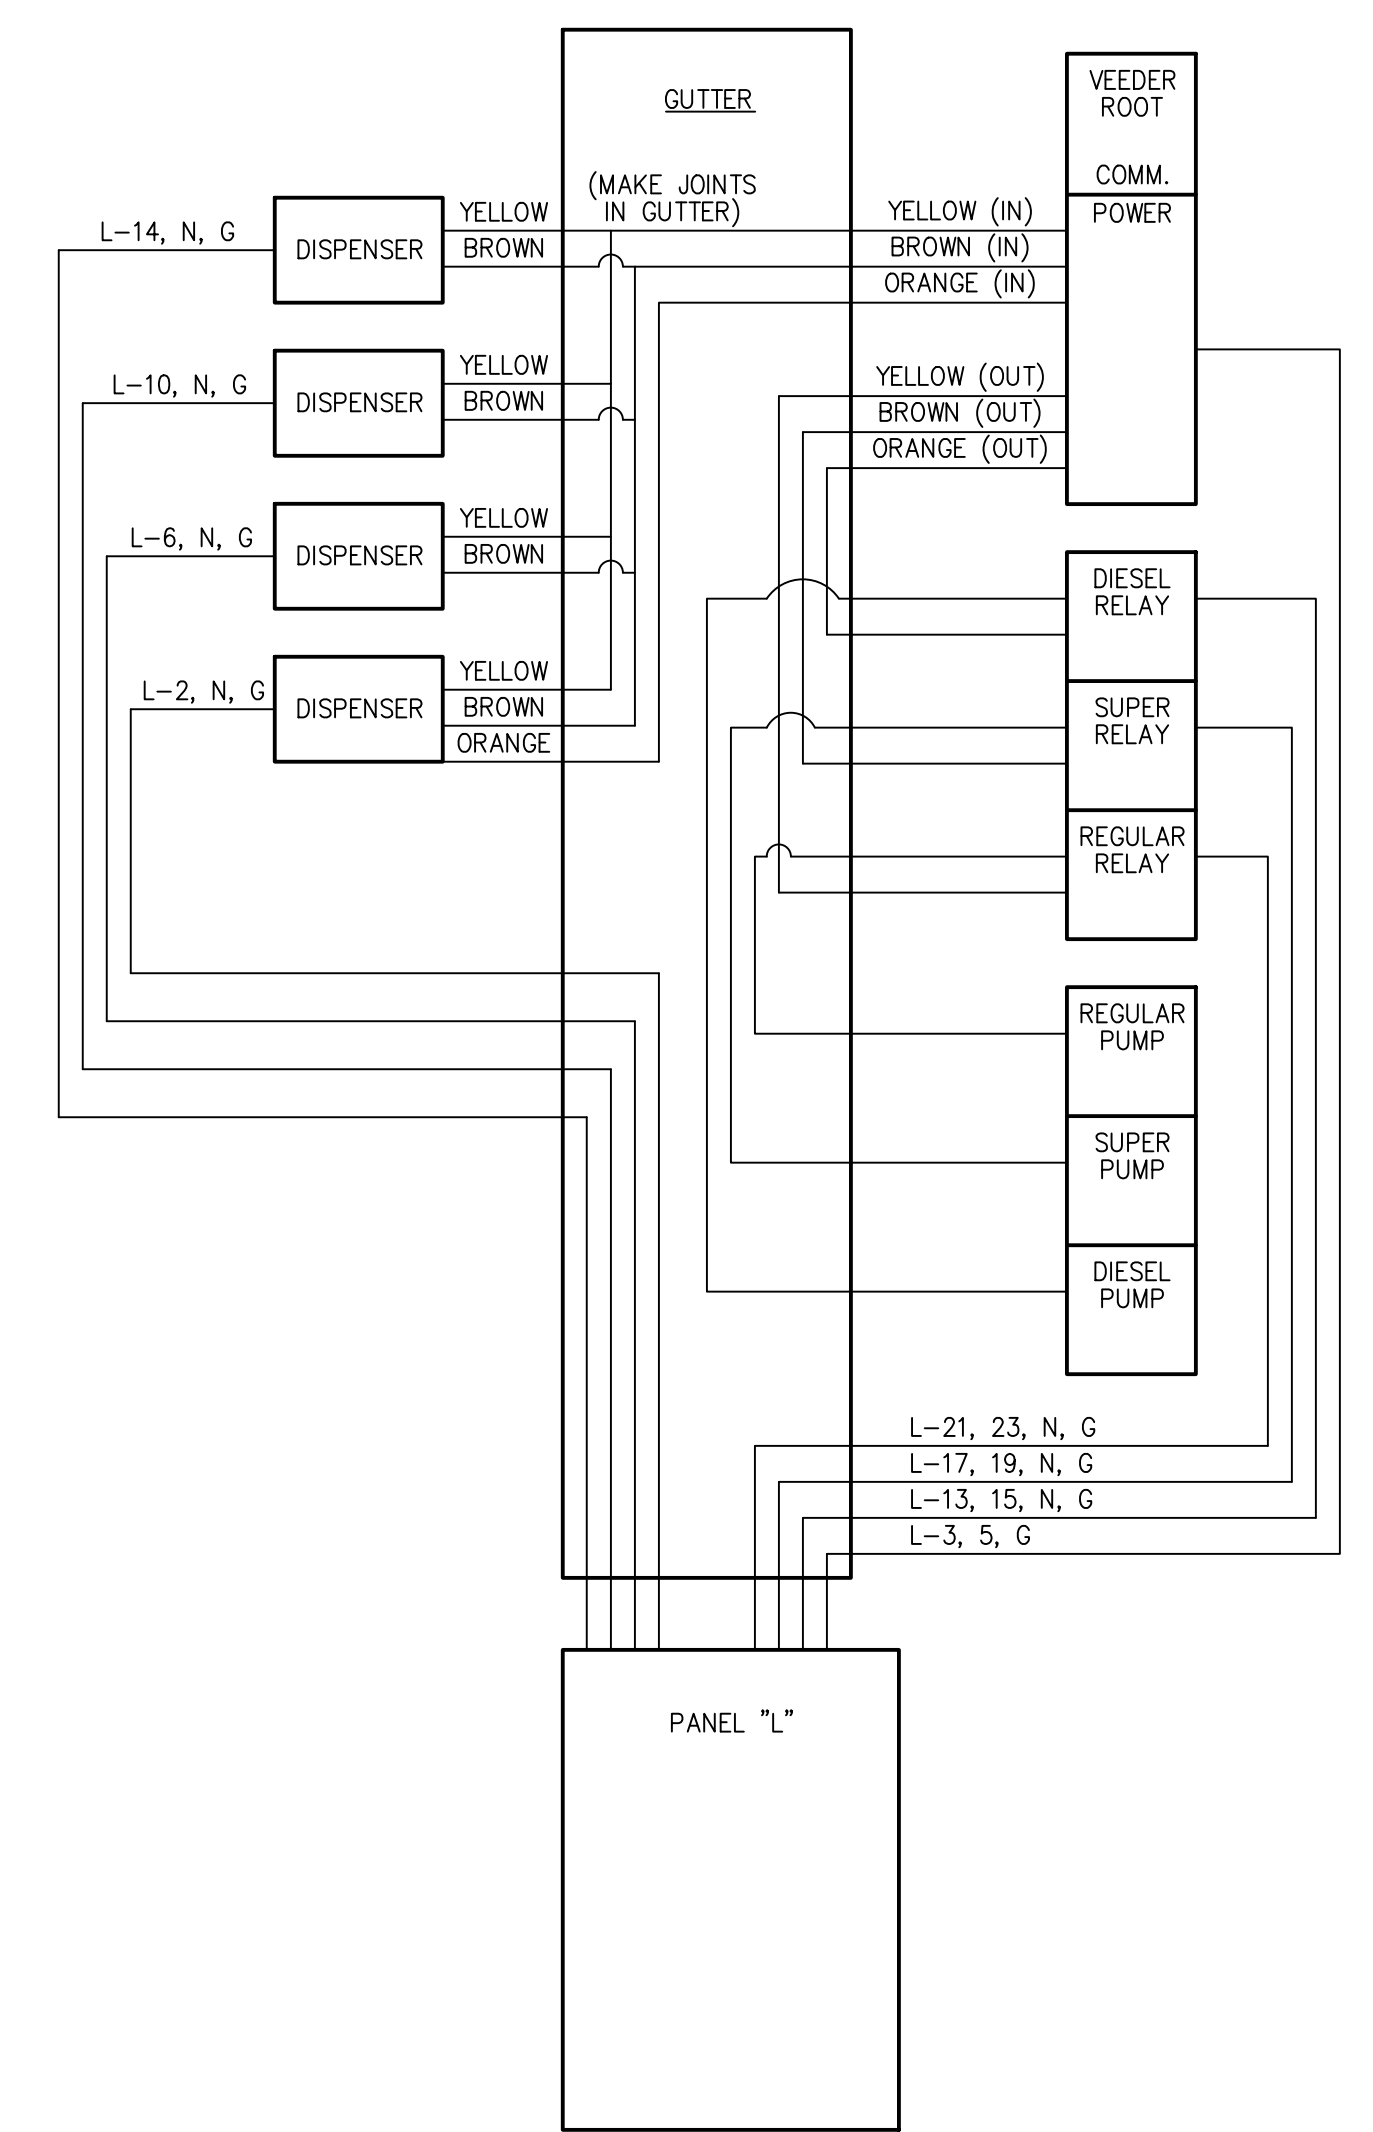

04 POWER SCHEMATIC
NO SCALE

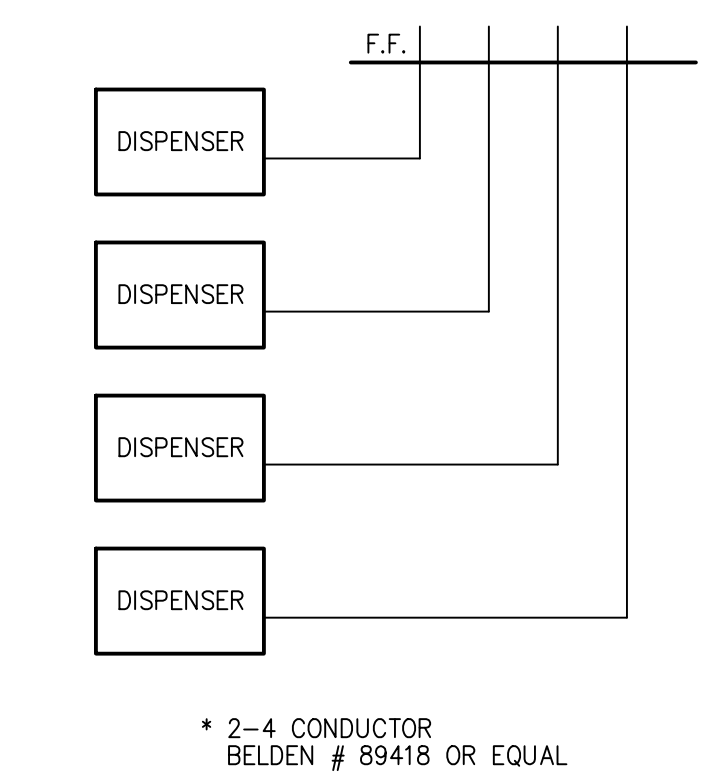


03 INTERCOMM CABLES
NO SCALE

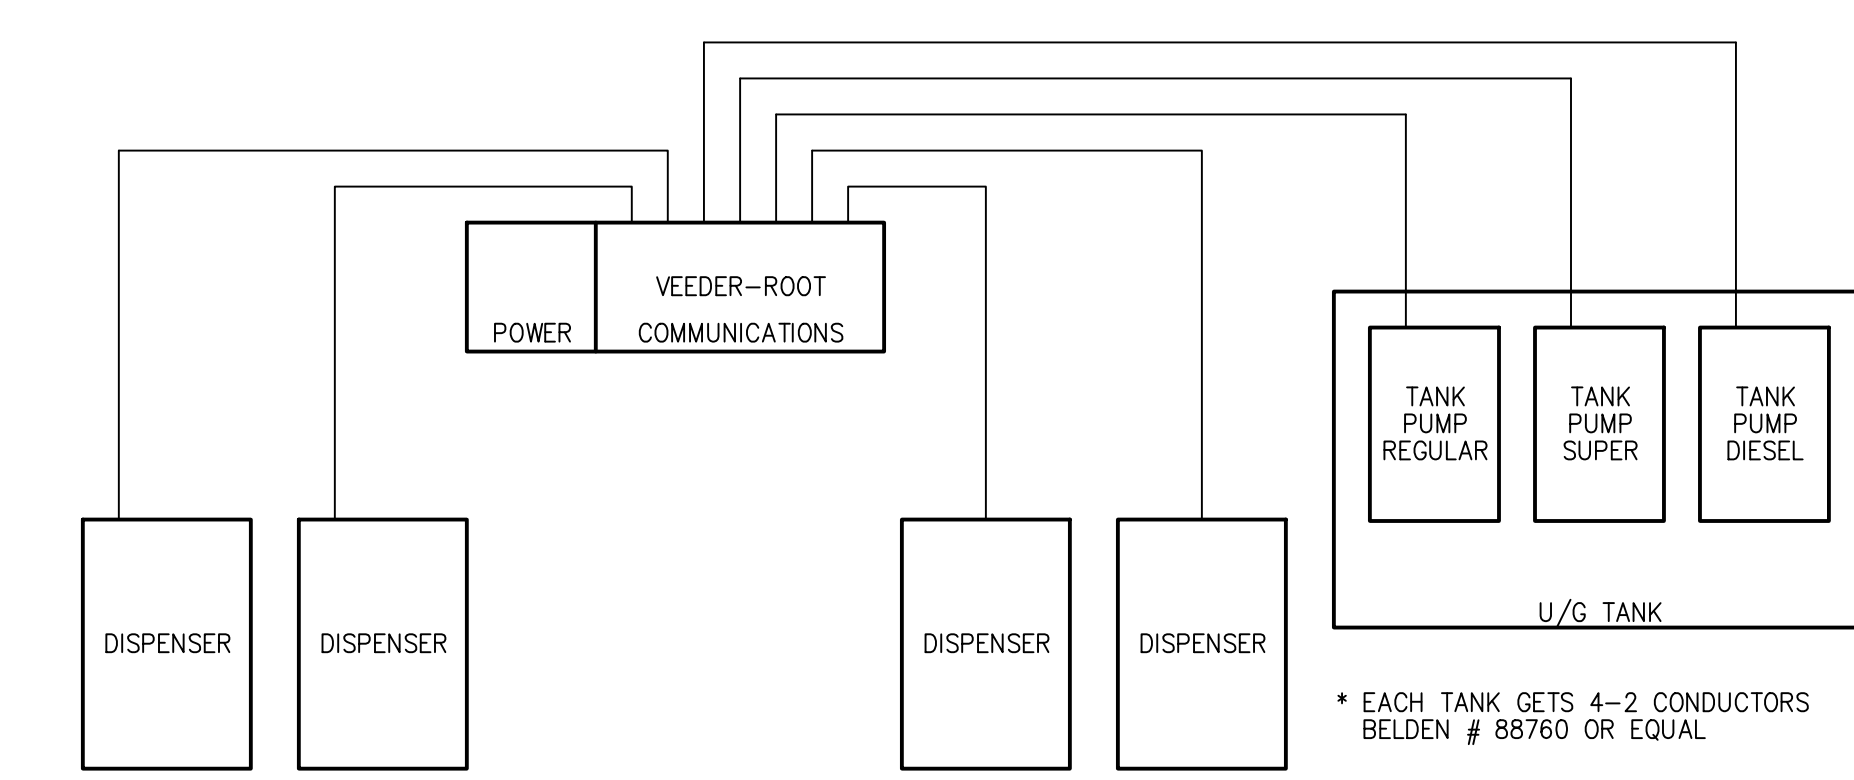

02 VEEDER-ROOT SENSOR CABLE SCHEMATIC
NO SCALE

- NOTES:**
- AIR DISPENSER ON CIRCUIT E-33.
 - ALL RELAY CONTROL BOX WIRING SHALL BE BLACK, RED, BROWN, ORANGE AND YELLOW.
 - INSTALL EXPLOSION PROOF BOX APPLETON - GR575 OR APPROVED EQUAL AT EACH DISPENSER PIT FOR SUMP PUMP SENSOR.
 - CABLES: #1 - PRESSURE LINE LEAK DETECTOR
#2 - SUMP SENSOR
#3 - TANK INVENTORY GAUGE
#4 - INTERSTITIAL ON TANK #1, SPARE ON #2 & DIESEL

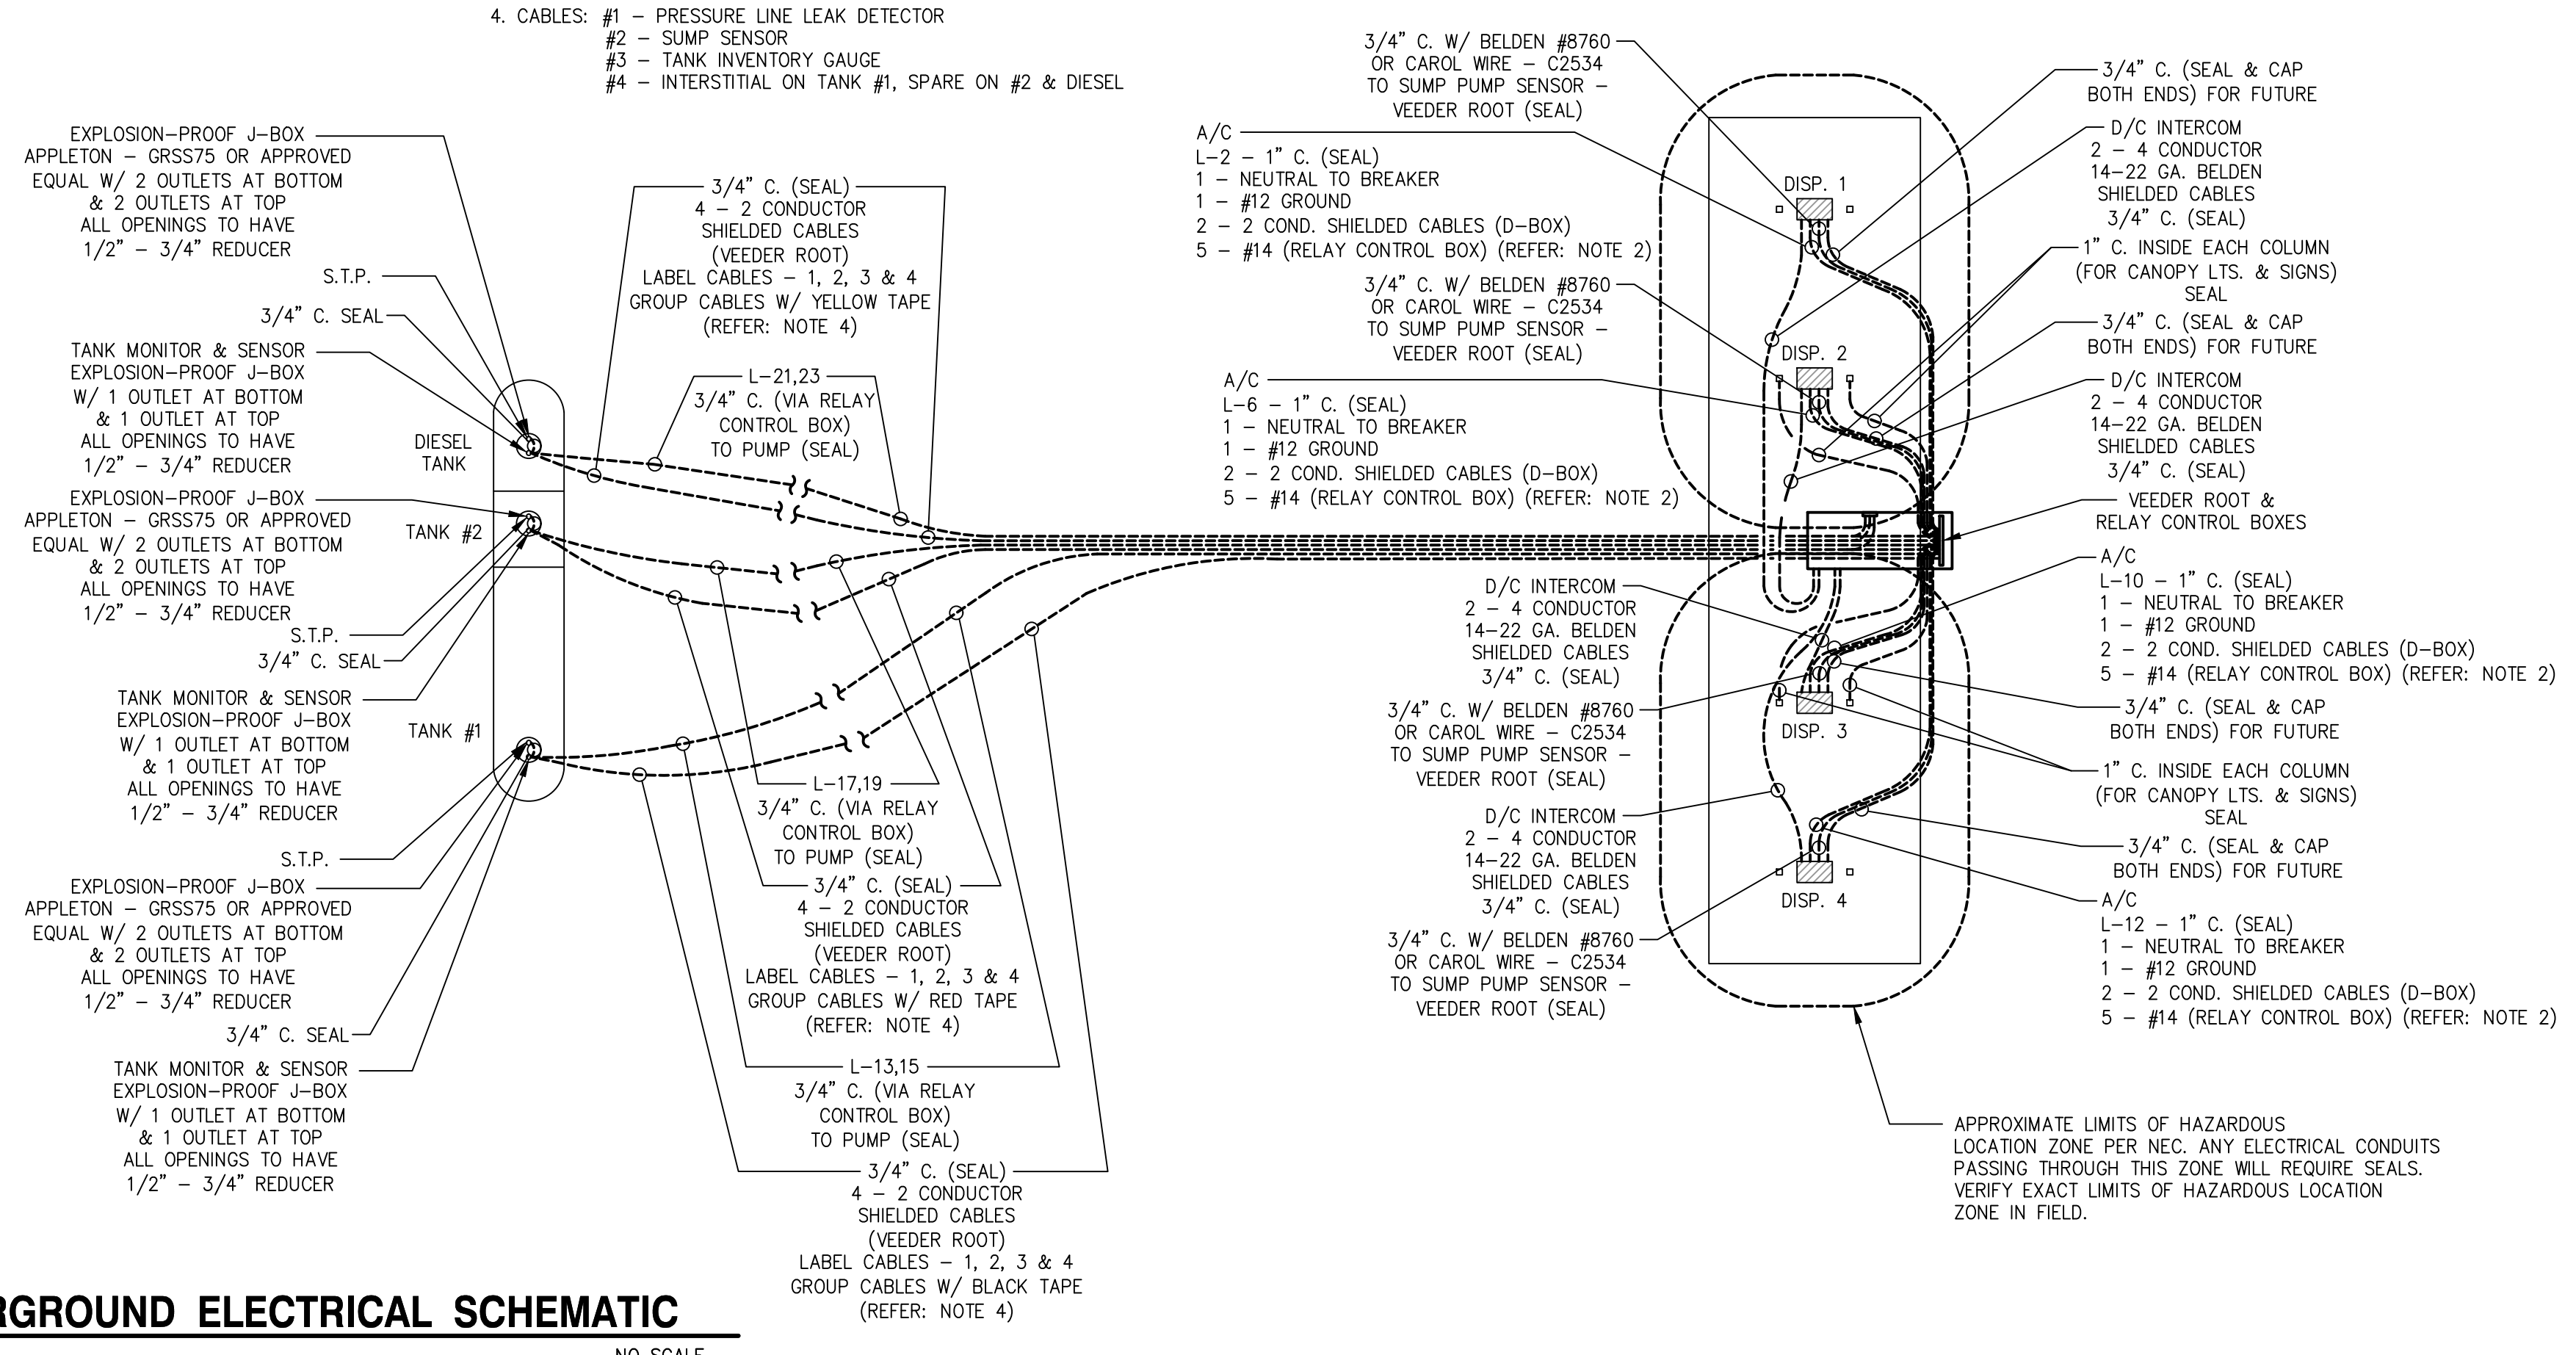

01 UNDERGROUND ELECTRICAL SCHEMATIC
NO SCALE

| NO. | DATE | REVISION DESCRIPTION |
|-----|------|----------------------|
| | | |

FOR REFERENCE ONLY

| | | | | | |
|-------------|--------------------------------------|---------------------------------|---------------------------------|----------------------------------|---------------------------------------|
| ISSUED FOR: | <input type="checkbox"/> PRELIMINARY | <input type="checkbox"/> REVIEW | <input type="checkbox"/> PERMIT | <input type="checkbox"/> BIDDING | <input type="checkbox"/> CONSTRUCTION |
|-------------|--------------------------------------|---------------------------------|---------------------------------|----------------------------------|---------------------------------------|

DATE
04/20
PROJECT NO.
4000600-0
STORE NO.

006
SHEET NO.

GMEP3

AS OF: 04/30/20