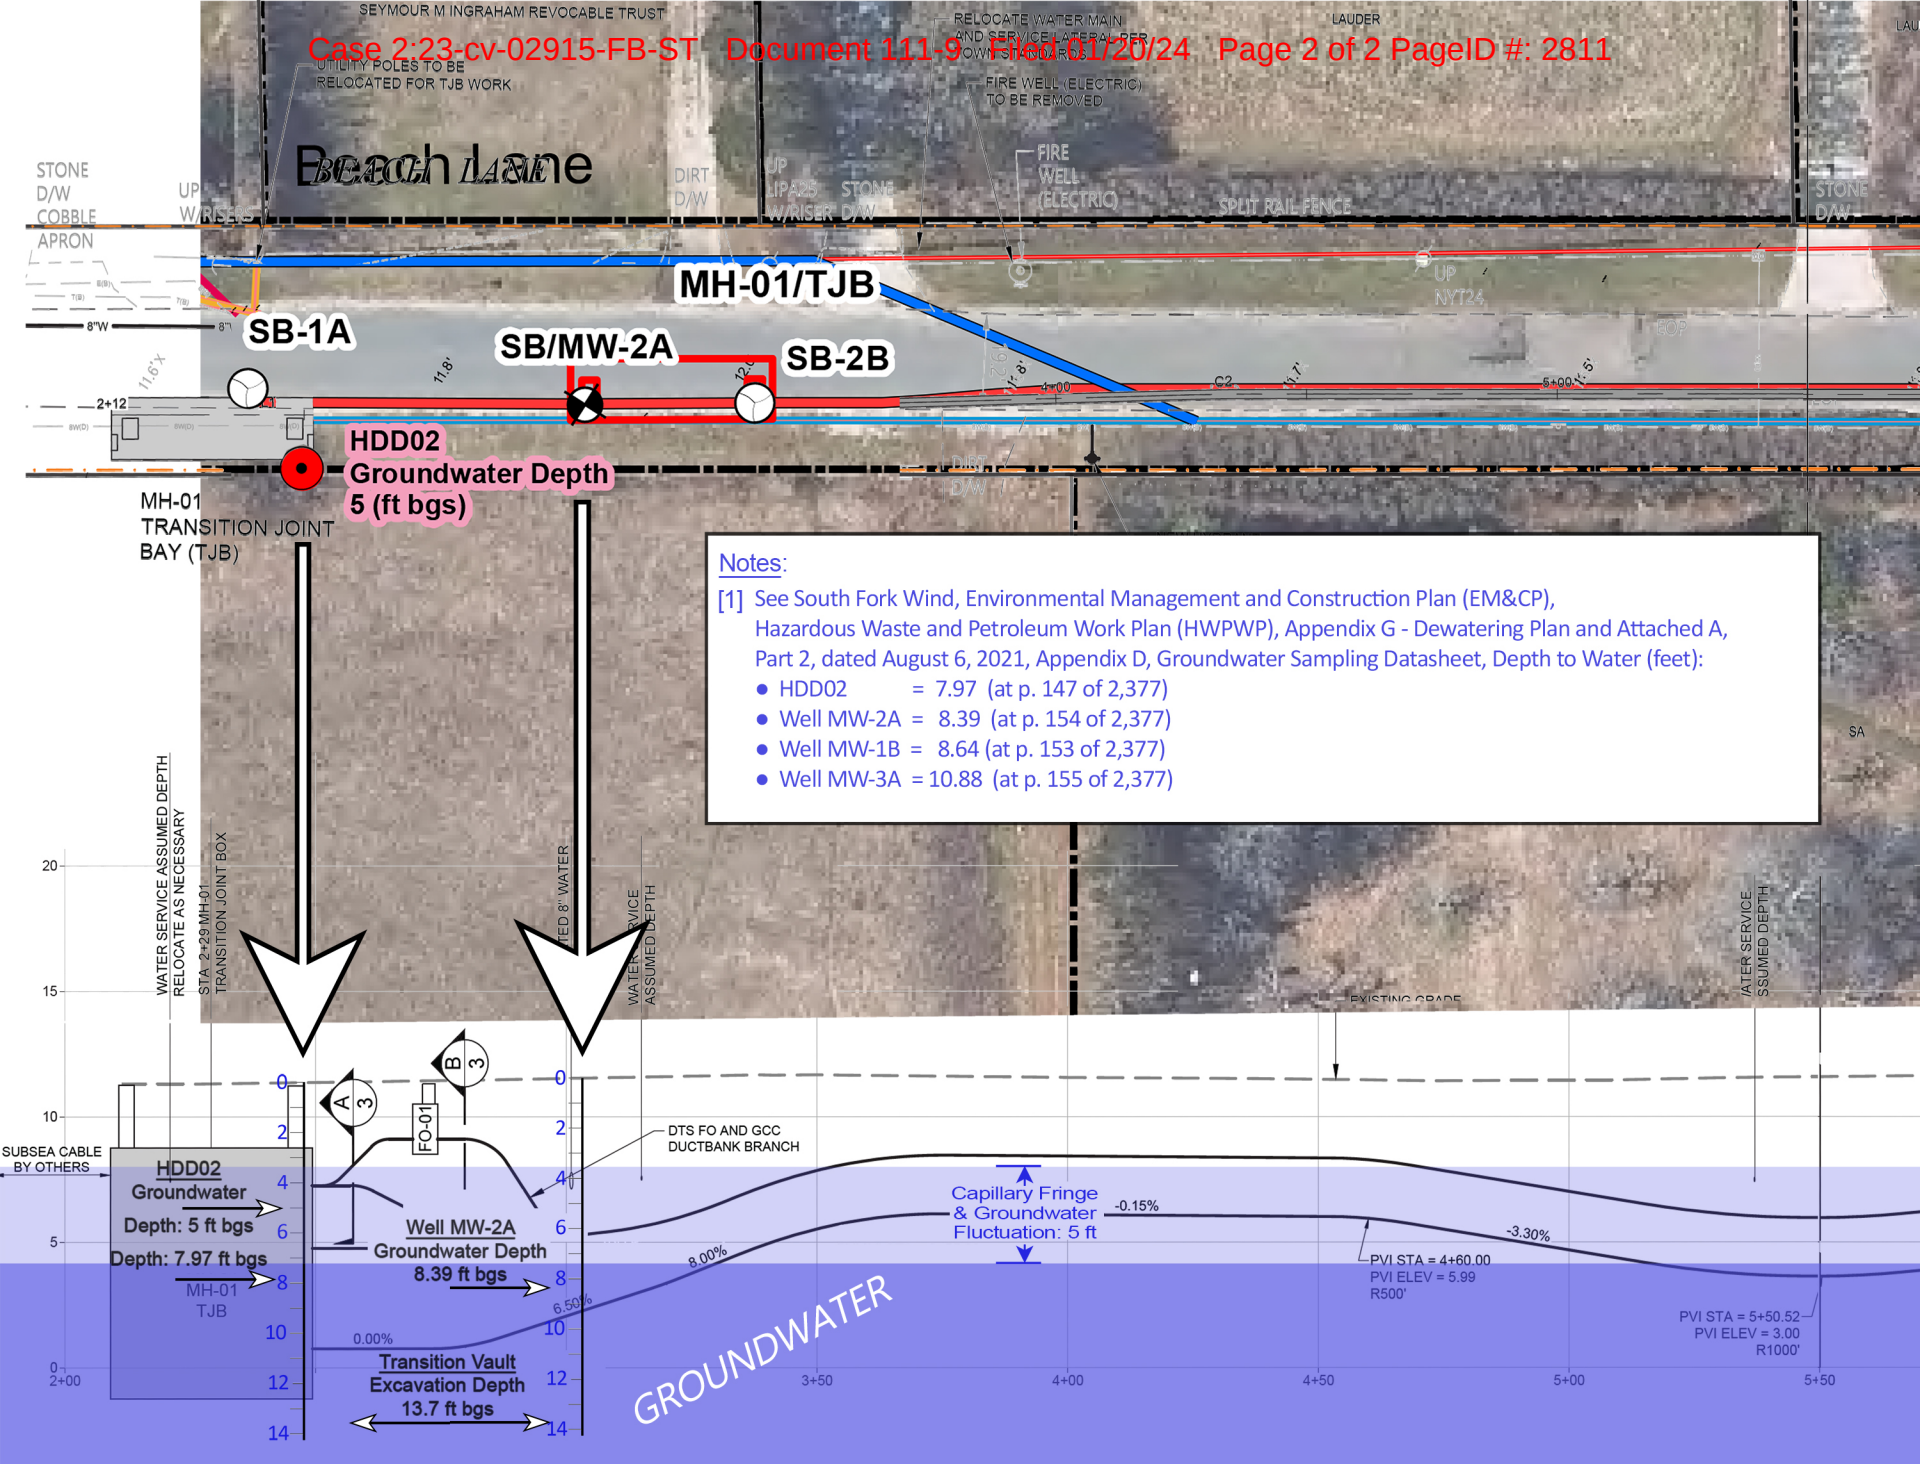
SEYMOUR M INGRAHAM REVOCABLE TRUST
UTILITY POLES TO BE RELOCATED FOR TJB WORK
RELOCATE WATER MAIN AND SERVICE LATERAL PER TOWN STANDARDS
FIRE WELL (ELECTRIC) TO BE REMOVED
Beach Lane
STONE D/W COBBLE APRON
DIRT D/W
FIRE WELL (ELECTRIC)
SPLIT RAIL FENCE
MH-01/TJB
SB-1A
SB/MW-2A
SB-2B
HDD02
Groundwater Depth
5 (ft bgs)
MH-01
TRANSITION JOINT
BAY (TJB)
Notes:
[1] See South Fork Wind, Environmental Management and Construction Plan (EM&CP), Hazardous Waste and Petroleum Work Plan (HWPWP), Appendix G - Dewatering Plan and Attached A, Part 2, dated August 6, 2021, Appendix D, Groundwater Sampling Datasheet, Depth to Water (feet):
HDD02 = 7.97 (at p. 147 of 2,377)
Well MW-2A = 8.39 (at p. 154 of 2,377)
Well MW-1B = 8.64 (at p. 153 of 2,377)
Well MW-3A = 10.88 (at p. 155 of 2,377)
WATER SERVICE ASSUMED DEPTH
RELOCATE AS NECESSARY
STA 2+29 MH-01 TRANSITION JOINT BOX
EXISTING GRADE
SUBSEA CABLE BY OTHERS
HDD02 Groundwater Depth: 5 ft bgs
Depth: 7.97 ft bgs
MH-01 TJB
Well MW-2A Groundwater Depth 8.39 ft bgs
Transition Vault Excavation Depth 13.7 ft bgs
DTS FO AND GCC DUCTBANK BRANCH
FO-01
Capillary Fringe & Groundwater Fluctuation: 5 ft
-0.15%
-3.30%
8.00%
6.50%
0.00%
PVI STA = 4+60.00
PVI ELEV = 5.99
R500'
PVI STA = 5+50.52
PVI ELEV = 3.00
R1000'
GROUNDWATER
2+00
3+50
4+00
4+50
5+00
5+50