


Wainscott PFAS Contamination (private drinking-drinking wells)

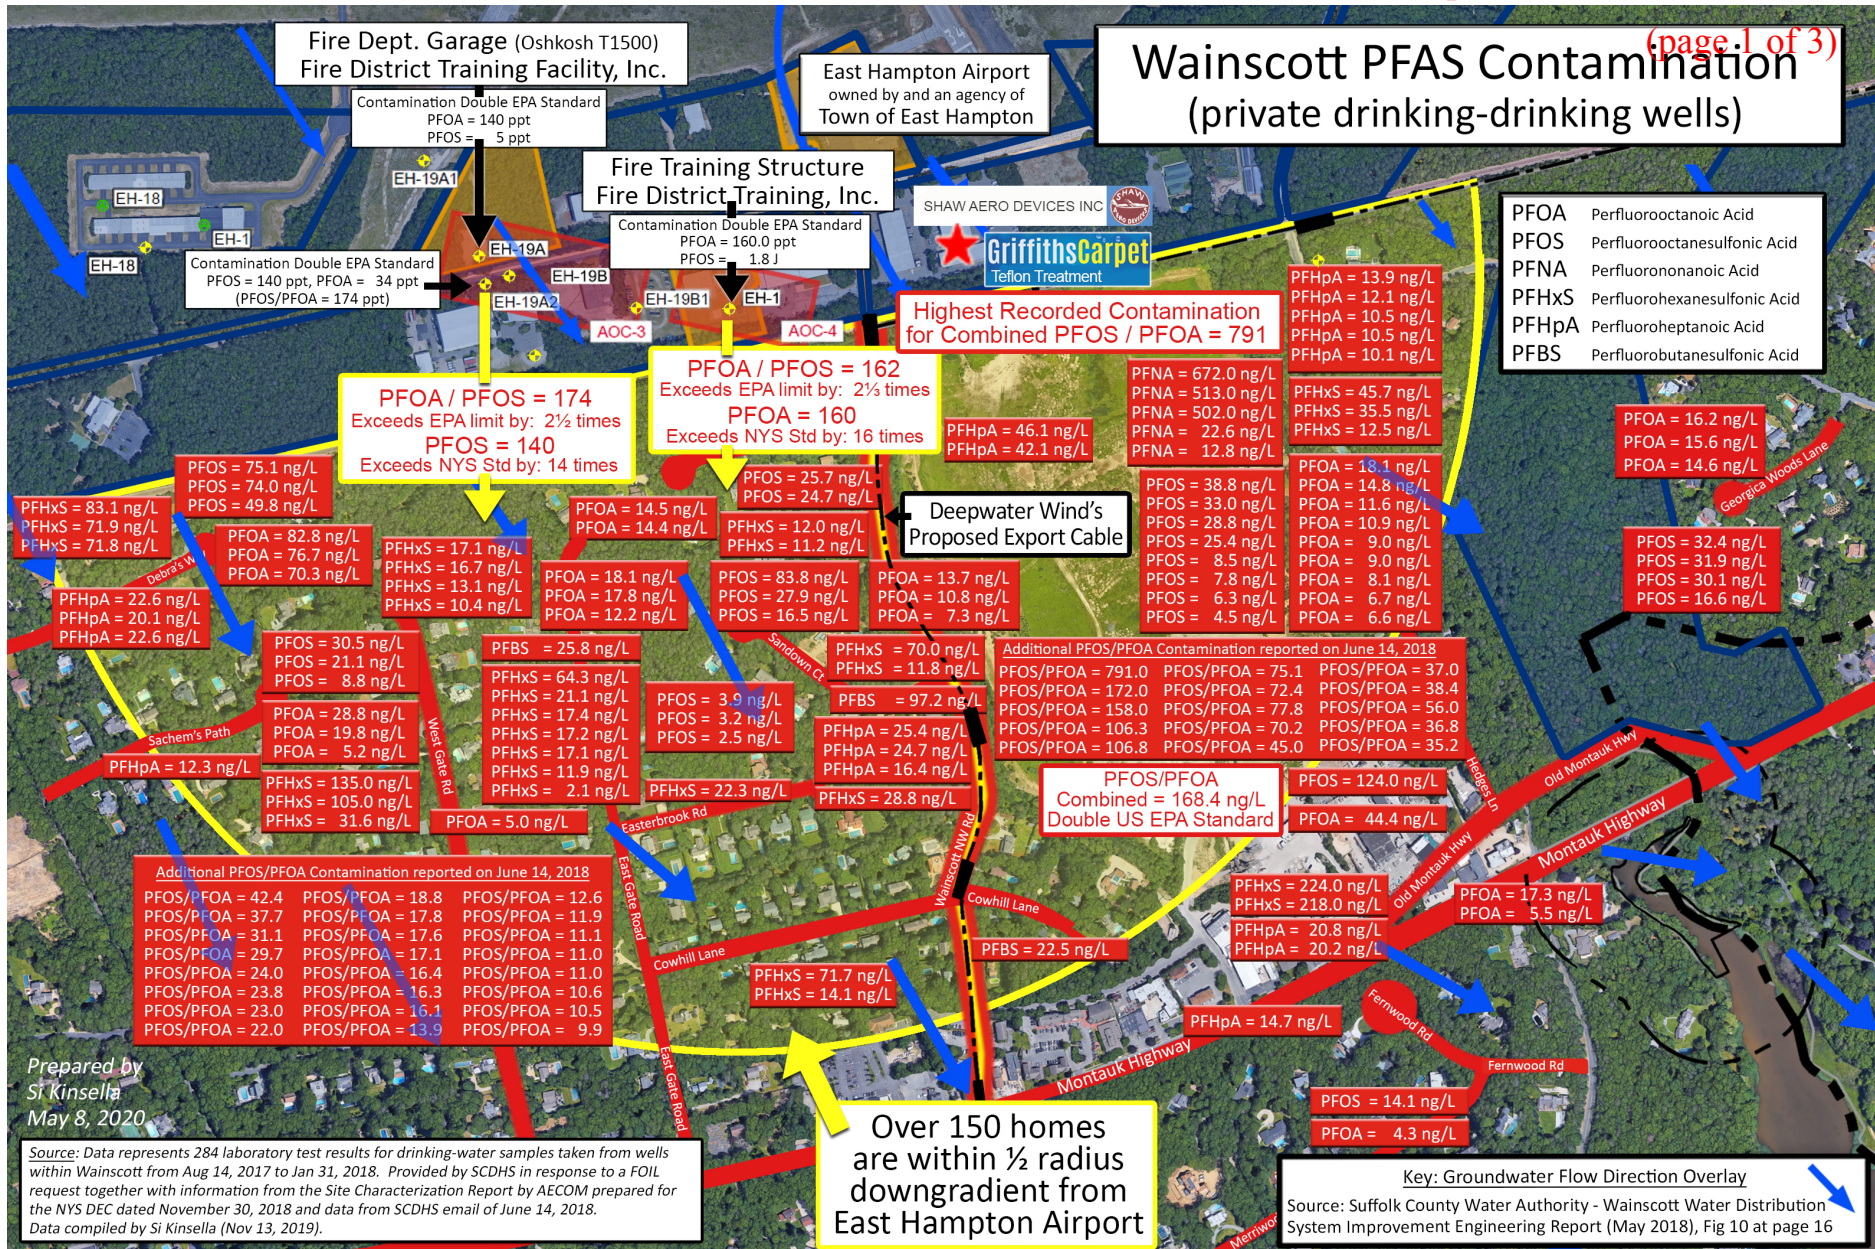

Fire Dept. Garage (Oshkosh T1500)
Fire District Training Facility, Inc.

East Hampton Airport
owned by and an agency of
Town of East Hampton

Fire Training Structure
Fire District Training, Inc.

SHAW AERO DEVICES INC
Griffiths Carpet
Teflon Treatment

- PFOA Perfluorooctanoic Acid
- PFOS Perfluorooctanesulfonic Acid
- PFNA Perfluorononanoic Acid
- PFHxS Perfluorohexanesulfonic Acid
- PFHpA Perfluoroheptanoic Acid
- PFBS Perfluorobutanesulfonic Acid

Highest Recorded Contamination
for Combined PFOS / PFOA = 791

PFOA / PFOS = 174
Exceeds EPA limit by: 2½ times
PFOS = 140
Exceeds NYS Std by: 14 times

PFOA / PFOS = 162
Exceeds EPA limit by: 2½ times
PFOA = 160
Exceeds NYS Std by: 16 times

PFNA = 672.0 ng/L
PFNA = 513.0 ng/L
PFNA = 502.0 ng/L
PFNA = 22.6 ng/L
PFNA = 12.8 ng/L

PFHpA = 13.9 ng/L
PFHpA = 12.1 ng/L
PFHpA = 10.5 ng/L
PFHpA = 10.5 ng/L
PFHpA = 10.1 ng/L

PFHxS = 45.7 ng/L
PFHxS = 35.5 ng/L
PFHxS = 12.5 ng/L

PFOA = 16.2 ng/L
PFOA = 15.6 ng/L
PFOA = 14.6 ng/L

PFOS = 32.4 ng/L
PFOS = 31.9 ng/L
PFOS = 30.1 ng/L
PFOS = 16.6 ng/L

Deepwater Wind's
Proposed Export Cable

Additional PFOS/PFOA Contamination reported on June 14, 2018
PFOS/PFOA = 791.0 PFOS/PFOA = 75.1 PFOS/PFOA = 37.0
PFOS/PFOA = 172.0 PFOS/PFOA = 72.4 PFOS/PFOA = 38.4
PFOS/PFOA = 158.0 PFOS/PFOA = 77.8 PFOS/PFOA = 56.0
PFOS/PFOA = 106.3 PFOS/PFOA = 70.2 PFOS/PFOA = 36.8
PFOS/PFOA = 106.8 PFOS/PFOA = 45.0 PFOS/PFOA = 35.2

PFOS/PFOA
Combined = 168.4 ng/L
Double US EPA Standard

PFOS = 124.0 ng/L
PFOA = 44.4 ng/L

Additional PFOS/PFOA Contamination reported on June 14, 2018
PFOS/PFOA = 42.4 PFOS/PFOA = 18.8 PFOS/PFOA = 12.6
PFOS/PFOA = 37.7 PFOS/PFOA = 17.8 PFOS/PFOA = 11.9
PFOS/PFOA = 31.1 PFOS/PFOA = 17.6 PFOS/PFOA = 11.1
PFOS/PFOA = 29.7 PFOS/PFOA = 17.1 PFOS/PFOA = 11.0
PFOS/PFOA = 24.0 PFOS/PFOA = 16.4 PFOS/PFOA = 11.0
PFOS/PFOA = 23.8 PFOS/PFOA = 16.3 PFOS/PFOA = 10.6
PFOS/PFOA = 23.0 PFOS/PFOA = 16.1 PFOS/PFOA = 10.5
PFOS/PFOA = 22.0 PFOS/PFOA = 13.9 PFOS/PFOA = 9.9

Over 150 homes
are within ½ radius
downgradient from
East Hampton Airport

Key: Groundwater Flow Direction Overlay
Source: Suffolk County Water Authority - Wainscott Water Distribution
System Improvement Engineering Report (May 2018), Fig 10 at page 16

Prepared by
Si Kinsella
May 8, 2020

Source: Data represents 284 laboratory test results for drinking-water samples taken from wells
within Wainscott from Aug 14, 2017 to Jan 31, 2018. Provided by SCDHS in response to a FOIL
request together with information from the Site Characterization Report by AECOM prepared for
the NYS DEC dated November 30, 2018 and data from SCDHS email of June 14, 2018.
Data compiled by Si Kinsella (Nov 13, 2019).

| | |
|--------------------------------------|---------------|
| Sample: | WSG-MW-6-10-0 |
| Date: | 11/6/2019 |
| Depth (ft): | 6 |
| Perfluorobutanesulfonic Acid (PFBS) | 2.5 |
| Perfluorodecanoic Acid (PFDA) | 92.3 |
| Perfluoroheptanoic Acid (PFHpA) | 50 |
| Perfluorohexanesulfonic Acid | 58.9 B |
| Perfluorohexanoic Acid (PFHxA) | 61.1 |
| Perfluorononanoic Acid (PFNA) | 2850 |
| Perfluorotridecanoic Acid (PFTriA) | 1.49 J |
| Perfluoroundecanoic Acid (PFUnA) | 333 |
| Perfluorooctane Sulfonic Acid (PFOS) | 151 |
| Perfluorooctanoic acid (PFOA) | 26.1 |
| Total PFOA and PFOS | 177.1 |
| Total PFAS | 3626.39 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW5-13-0 |
| Date: | 11/7/2019 |
| Depth (ft): | 13 |
| Perfluorobutanesulfonic Acid (PFBS) | 4.58 |
| Perfluoroheptanoic Acid (PFHpA) | 2.95 |
| Perfluorohexanesulfonic Acid | 566 B |
| Perfluorohexanoic Acid (PFHxA) | 12 |
| Perfluorononanoic Acid (PFNA) | 1.64 J |
| Perfluorooctane Sulfonic Acid (PFOS) | 877 |
| Perfluorooctanoic acid (PFOA) | 69.4 |
| Total PFOA and PFOS | 946.4 |
| Total PFAS | 1533.57 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW3-10-0 |
| Date: | 11/7/2019 |
| Depth (ft): | 10 |
| Perfluorobutanesulfonic Acid (PFBS) | 3.66 |
| Perfluoroheptanoic Acid (PFHpA) | 2.27 |
| Perfluorohexanesulfonic Acid | 306 B |
| Perfluorohexanoic Acid (PFHxA) | 9.53 |
| Perfluorononanoic Acid (PFNA) | 2.2 |
| Perfluorooctane Sulfonic Acid (PFOS) | 1010 |
| Perfluorooctanoic acid (PFOA) | 27.5 |
| Total PFOA and PFOS | 1037.5 |
| Total PFAS | 1361.16 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW4-10-0 |
| Date: | 11/7/2019 |
| Depth (ft): | 10 |
| Perfluorobutanesulfonic Acid (PFBS) | 2.11 |
| Perfluoroheptanoic Acid (PFHpA) | 1.09 J |
| Perfluorohexanesulfonic Acid | 43.4 B |
| Perfluorohexanoic Acid (PFHxA) | 5.06 |
| Perfluorononanoic Acid (PFNA) | 0.8 J |
| Perfluorooctane Sulfonic Acid (PFOS) | 232 |
| Perfluorooctanoic acid (PFOA) | 5.57 |
| Total PFOA and PFOS | 237.57 |
| Total PFAS | 280.03 |



| | |
|--------------------------------------|---------------|
| Sample: | WSG-MW-7-10-0 |
| Date: | 11/6/2019 |
| Depth (ft): | 7 |
| Perfluorobutanesulfonic Acid (PFBS) | 0.23 J |
| Perfluorodecanoic Acid (PFDA) | 0.4 EMPC |
| Perfluoroheptanoic Acid (PFHpA) | 0.85 J |
| Perfluorohexanoic Acid (PFHxA) | 0.76 J |
| Perfluorononanoic Acid (PFNA) | 4.55 |
| Perfluorooctane Sulfonic Acid (PFOS) | 15 |
| Perfluorooctanoic acid (PFOA) | 3.9 |
| Total PFOA and PFOS | 18.9 |
| Total PFAS | 25.69 |

Monitoring Well Sampling Locations

Site Boundary

Notes:

1. Only exceedances of the New York State PFAS Guidelines are shown.
2. B qualifier indicates contamination was detected in the associated blank sample.
3. EMPC (estimated maximum possible concentration) qualifier indicates that a peak is detected but did not meet all the method required criteria.
4. J qualifier indicates the result is estimated.
5. All results are given in ng/l.

| Analyte | MYS 703.5 TOGS Class GA |
|--------------------------------------|-------------------------|
| PFCS | ng/l |
| Perfluorobutanesulfonic Acid | 100 |
| Perfluorononanoic Acid (PFNA) | 100 |
| Perfluoroundecanoic Acid (PFUnA) | 100 |
| Perfluorooctane Sulfonic Acid (PFOS) | 10 |
| Perfluorooctanoic acid (PFOA) | 10 |
| Total PFOA and PFOS | 10 |
| Total PFAS | 500 |

0 Miles 0.07

Exhibit 3-2 - PFAS Heat Map of SCDHS Lab Results (page 2 of 3)

| | |
|--------------------------------------|-------------|
| Sample: | WSG-MW1-8-0 |
| Date: | 11/7/2019 |
| Depth (ft): | 8 |
| Perfluorobutanesulfonic Acid (PFBS) | 0.91 J |
| Perfluorodecanoic Acid (PFDA) | 0.7 J |
| Perfluoroheptanoic Acid (PFHpA) | 3.46 |
| Perfluorohexanesulfonic Acid | 2.38 B |
| Perfluorohexanoic Acid (PFHxA) | 4.46 |
| Perfluorononanoic Acid (PFNA) | 1.33 J |
| Perfluorooctane Sulfonic Acid (PFOS) | 11.6 |
| Perfluorooctanoic acid (PFOA) | 4.87 |
| Total PFOA and PFOS | 16.47 |
| Total PFAS | 29.71 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW2-10-0 |
| Date: | 11/6/2019 |
| Depth (ft): | 10 |
| Perfluorobutanesulfonic Acid (PFBS) | 9.33 |
| Perfluorodecanoic Acid (PFDA) | 2.32 |
| Perfluoroheptanoic Acid (PFHpA) | 35 |
| Perfluorohexanesulfonic Acid | 23.9 B |
| Perfluorohexanoic Acid (PFHxA) | 35.5 |
| Perfluorononanoic Acid (PFNA) | 58.2 |
| Perfluorooctane Sulfonic Acid (PFOS) | 36.3 |
| Perfluorooctanoic acid (PFOA) | 47.6 |
| Total PFOA and PFOS | 83.9 |
| Total PFAS | 248.15 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW8-25-0 |
| Date: | 11/6/2019 |
| Depth (ft): | 25 |
| Perfluorobutanesulfonic Acid (PFBS) | 5.16 |
| Perfluorodecanoic Acid (PFDA) | 0.47 J |
| Perfluoroheptanoic Acid (PFHpA) | 13.6 |
| Perfluorohexanesulfonic Acid | 26.2 B |
| Perfluorohexanoic Acid (PFHxA) | 25.1 |
| Perfluorononanoic Acid (PFNA) | 4.63 |
| Perfluorooctane Sulfonic Acid (PFOS) | 58.5 |
| Perfluorooctanoic acid (PFOA) | 37.5 |
| Total PFOA and PFOS | 96 |
| Total PFAS | 121.16 |

| | |
|--------------------------------------|--------------|
| Sample: | WSG-MW2-10-0 |
| Date: | 11/6/2019 |
| Depth (ft): | 10 |
| Perfluorobutanesulfonic Acid (PFBS) | 9.33 |
| Perfluorodecanoic Acid (PFDA) | 2.32 |
| Perfluoroheptanoic Acid (PFHpA) | 35 |
| Perfluorohexanesulfonic Acid | 23.9 B |
| Perfluorohexanoic Acid (PFHxA) | 35.5 |
| Perfluorononanoic Acid (PFNA) | 58.2 |
| Perfluorooctane Sulfonic Acid (PFOS) | 36.3 |
| Perfluorooctanoic acid (PFOA) | 47.6 |
| Total PFOA and PFOS | 83.9 |
| Total PFAS | 248.15 |

| | |
|--------------------------------------|--------------------|
| Sample: | WSG-MW8-25-1 (DUP) |
| Date: | 11/6/2019 |
| Depth (ft): | 25 |
| Perfluorobutanesulfonic Acid (PFBS) | 5.58 |
| Perfluorodecanoic Acid (PFDA) | 0.77 J |
| Perfluoroheptanoic Acid (PFHpA) | 12.2 |
| Perfluorohexanesulfonic Acid | 27.4 B |
| Perfluorohexanoic Acid (PFHxA) | 25.7 |
| Perfluorononanoic Acid (PFNA) | 3.81 |
| Perfluorooctane Sulfonic Acid (PFOS) | 56.4 |
| Perfluorooctanoic acid (PFOA) | 34.1 |
| Total PFOA and PFOS | 90.5 |
| Total PFAS | 165.96 |

| Sample Date: | WSG-GW1-9-0 11/14/2019 | WSG-GW1-9-1 (DUP) 11/14/2019 | WSG-GW1-19-0 11/14/2019 | WSG-GW1-29-0 11/14/2019 |
|--------------------------------------|---------------------------|---------------------------------|----------------------------|----------------------------|
| Depth (ft): | 9 | 9 | 19 | 29 |
| Perfluorobutanesulfonic Acid (PFBS) | 2.19 | 2.19 | 1.81 U | 14.6 |
| Perfluorodecanic Acid (PFDA) | 5.7 | 5.53 | 1.81 U | 0.91 J |
| Perfluoroheptanoic Acid (PFHpA) | 43.2 | 41.7 | 8.6 J | 8.65 |
| Perfluorohexanesulfonic Acid | 25.8 | 24.4 B | 1.81 U | 4.8 |
| Perfluorohexanoic Acid (PFHxA) | 23.7 | 24.7 | 0.95 J | 56.8 |
| Perfluorononanoic Acid (PFNA) | 333 | 343 | 0.93 J | 1.26 J |
| Perfluoroundecanoic Acid (PFUnA) | 2.19 | 1.89 | 8.99 | 1.83 U |
| Perfluorooctane Sulfonic Acid (PFOS) | 12.7 | 12.4 | 5.43 | 6.27 |
| Perfluorooctanoic acid (PFOA) | 64.6 | 62.9 | 0.89 J | 4.28 |
| Total PFOA and PFOS | 77.3 | 75.3 | 6.32 | 10.55 |
| Total PFAS | 512.28 | 516.71 | 17.79 | 96.77 |

| Sample Date: | WSG-GW2-9-0 11/8/2019 | WSG-GW2-19-0 11/8/2019 | WSG-GW2-29-0 11/8/2019 | WSG-GW2-29-1 (DUP) 11/8/2019 |
|--------------------------------------|--------------------------|---------------------------|---------------------------|---------------------------------|
| Depth (ft): | 9 | 19 | 29 | 29 |
| Perfluorobutanesulfonic Acid (PFBS) | 10.5 | 2.59 | 5.42 | 5.06 |
| Perfluorodecanic Acid (PFDA) | 0.38 J | 1.95 U | 1.88 U | 1.9 U |
| Perfluoroheptanoic Acid (PFHpA) | 8.7 | 1.61 J | 3.44 | 3.4 |
| Perfluorohexanesulfonic Acid | 229 B | 32.5 B | 50.1 B | 50.4 B |
| Perfluorohexanoic Acid (PFHxA) | 39.7 | 6.41 | 12.9 | 12.5 |
| Perfluorononanoic Acid (PFNA) | 15.5 | 4.8 | 13 | 12.9 |
| Perfluorooctane Sulfonic Acid (PFOS) | 84.6 | 37.9 | 52.1 | 52.1 |
| Perfluorooctanoic acid (PFOA) | 17.6 | 3.78 | 7.44 | 7.28 |
| Total PFOA and PFOS | 102.2 | 41.68 | 59.54 | 59.38 |
| Total PFAS | 405.98 | 89.59 | 144.4 | 143.64 |

● Probe Sampling Locations
 □ Site Boundary


- Notes:
1. Exceedances of the New York State PFAS Guidelines are shown in yellow. All detections are shown.
 2. B qualifier indicates contamination was detected in the associated blank sample.
 3. J qualifier indicates the result is estimated.
 4. U qualifier indicates the result is non-detect the result detection limit is shown.
 5. Results are given in ng/l.

| Analyte | MYS 763-S TOGS Class GA |
|--------------------------------------|-------------------------|
| PFCS | ng/l |
| Perfluorohexanesulfonic Acid | 100 |
| Perfluorononanoic Acid (PFNA) | 100 |
| Perfluoroundecanoic Acid (PFUnA) | 100 |
| Perfluorooctane Sulfonic Acid (PFOS) | 10 |
| Perfluorooctanoic acid (PFOA) | 10 |
| Total PFOA and PFOS | 18 |
| Total PFAS | 500 |

Exhibit 3-2 - PFAS Heat Map of SCDHS Lab Results (page 3 of 3)

| Sample Date: | WSG-GW9-6-0 11/12/2019 | WSG-GW9-16-0 11/12/2019 | WSG-GW9-26-0 11/12/2019 |
|--------------------------------------|---------------------------|----------------------------|----------------------------|
| Depth (ft): | 6 | 16 | 26 |
| Perfluorobutanesulfonic Acid (PFBS) | 0.84 J | 3.59 | 7.1 |
| Perfluorodecanic Acid (PFDA) | 1.13 J | 0.7 J | 0.56 J |
| Perfluoroheptanoic Acid (PFHpA) | 2.85 | 15.5 | 27.7 |
| Perfluorohexanesulfonic Acid | 21.8 B | 101 B | 274 B |
| Perfluorohexanoic Acid (PFHxA) | 3.4 | 17.2 | 27.3 |
| Perfluorononanoic Acid (PFNA) | 3.83 | 5.98 | 7.75 |
| Perfluorooctane Sulfonic Acid (PFOS) | 238 | 130 | 243 |
| Perfluorooctanoic acid (PFOA) | 41.2 | 118 | 200 |
| Total PFOA and PFOS | 279.2 | 248 | 443 |
| Total PFAS | 313.05 | 391.97 | 787.41 |

| Sample Date: | WSG-GW5-8-0 11/6/2019 | WSG-GW5-18-0 11/6/2019 | WSG-GW5-28-0 11/6/2019 |
|--------------------------------------|--------------------------|---------------------------|---------------------------|
| Depth (ft): | 8 | 18 | 28 |
| Perfluorobutanesulfonic Acid (PFBS) | 4.26 | 2.31 | 2.69 |
| Perfluorodecanic Acid (PFDA) | 0.33 J | 0.33 J | 0.35 J |
| Perfluoroheptanoic Acid (PFHpA) | 22.3 | 7.76 | 9.45 |
| Perfluorohexanesulfonic Acid | 20.2 B | 10.8 | 10.9 B |
| Perfluorohexanoic Acid (PFHxA) | 28.8 | 12.6 | 15.9 |
| Perfluorononanoic Acid (PFNA) | 3.2 | 1.85 J | 1.72 J |
| Perfluorotetradecanoic Acid (PFTeA) | 1.92 U | 0.31 B) | 1.9 U |
| Perfluorooctane Sulfonic Acid (PFOS) | 29.2 | 27.8 | 37.8 |
| Perfluorooctanoic acid (PFOA) | 40.6 | 12.7 | 11.2 |
| Total PFOA and PFOS | 69.8 | 40.5 | 49 |
| Total PFAS | 148.89 | 75.66 | 90.01 |

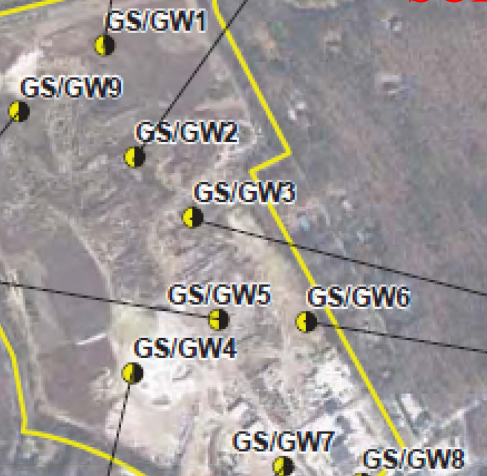

| Sample Date: | WSG-GW3-8-0 11/7/2019 | WSG-GW3-18-0 11/7/2019 | WSG-GW3-28-0 11/7/2019 |
|--------------------------------------|--------------------------|---------------------------|---------------------------|
| Depth (ft): | 8 | 18 | 28 |
| Perfluorobutanesulfonic Acid (PFBS) | 4.15 | 4.35 | 3.8 |
| Perfluoroheptanoic Acid (PFHpA) | 3.29 | 0.99 J | 0.25 J |
| Perfluorohexanesulfonic Acid | 21.4 B | 10.1 B | 4.99 B |
| Perfluorohexanoic Acid (PFHxA) | 6.68 | 2.81 | 1.89 U |
| Perfluorononanoic Acid (PFNA) | 2.4 | 2.43 | 0.46 J |
| Perfluorotetradecanoic Acid (PFTeA) | 1.9 U | 0.35 J | 1.89 U |
| Perfluorooctane Sulfonic Acid (PFOS) | 33.6 | 17.5 | 2.79 |
| Perfluorooctanoic acid (PFOA) | 5.7 | 2.45 | 0.83 J |
| Total PFOA and PFOS | 39.3 | 19.95 | 2.79 |
| Total PFAS | 77.22 | 40.98 | 13.12 |

| Sample Date: | WSG-GW6-9-0 11/11/2019 | WSG-GW6-19-0 11/11/2019 | WSG-GW6-29-0 11/11/2019 |
|--------------------------------------|---------------------------|----------------------------|----------------------------|
| Depth (ft): | 9 | 19 | 29 |
| Perfluorobutanesulfonic Acid (PFBS) | 3.81 | 2.79 | 2.93 |
| Perfluorodecanic Acid (PFDA) | 0.53 J | 0.65 J | 1.87 U |
| Perfluoroheptanoic Acid (PFHpA) | 12.9 | 8.65 | 6.64 |
| Perfluorohexanesulfonic Acid | 17.7 B | 16.4 B | 24.9 B |
| Perfluorohexanoic Acid (PFHxA) | 21 | 14 | 12 |
| Perfluorononanoic Acid (PFNA) | 8.24 | 10.7 | 8.43 |
| Perfluorooctane Sulfonic Acid (PFOS) | 36.2 | 44.2 | 31.8 |
| Perfluorooctanoic acid (PFOA) | 39.6 | 23.5 | 14.3 |
| Total PFOA and PFOS | 75.8 | 67.7 | 46.1 |
| Total PFAS | 140.01 | 120.89 | 101 |

| Sample Date: | WSG-GW4-5-0 11/7/2019 | WSG-GW4-15-0 11/6/2019 | WSG-GW4-25-0 11/6/2019 |
|--|--------------------------|---------------------------|---------------------------|
| Depth (ft): | 5 | 15 | 25 |
| N-Ethyl-N-[(heptadecafluorooctyl)sulfonyl] glycine | 3.93 J | 19.2 U | 19.3 U |
| Perfluorobutanesulfonic Acid (PFBS) | 0.42 J | 1.36 J | 1.25 J |
| Perfluorodecanic Acid (PFDA) | 2.49 | 1.92 U | 1.93 U |
| Perfluoroheptanoic Acid (PFHpA) | 2.14 | 1.5 J | 1.93 U |
| Perfluorohexanesulfonic Acid | 3.43 B | 27.8 | 19.4 B |
| Perfluorohexanoic Acid (PFHxA) | 2.82 | 2.69 | 1.93 U |
| Perfluorononanoic Acid (PFNA) | 1.92 J | 1.03 J | 0.97 J |
| Perfluorooctane Sulfonic Acid (PFOS) | 30.5 | 36.7 | 11.6 |
| Perfluorooctanoic acid (PFOA) | 5.69 | 4.78 | 1.93 U |
| Total PFOA and PFOS | 36.19 | 41.48 | 11.6 |

| Sample Date: | WSG-GW7-6-0 11/5/2019 | WSG-GW7-15-0 11/5/2019 |
|--------------------------------------|--------------------------|---------------------------|
| Depth (ft): | 6 | 15 |
| Perfluorobutanesulfonic Acid (PFBS) | 0.69 J | 2 |
| Perfluorodecanic Acid (PFDA) | 2.21 | 1.83 U |
| Perfluoroheptanoic Acid (PFHpA) | 5.1 | 0.54 J |
| Perfluorohexanesulfonic Acid | 7.84 B | 29.9 B |
| Perfluorohexanoic Acid (PFHxA) | 4.55 | 1.29 J |
| Perfluorononanoic Acid (PFNA) | 2.84 | 0.25 J |
| Perfluorotetradecanoic Acid (PFTeA) | 0.34 B) | 1.83 U |
| Perfluorooctane Sulfonic Acid (PFOS) | 22.5 | 24 |
| Perfluorooctanoic acid (PFOA) | 13.4 | 2.41 |
| Total PFOA and PFOS | 35.9 | 26.41 |

| Sample Date: | WSG-GW8-19-0 11/13/2019 | WSG-GW8-29-0 11/13/2019 | WSG-GW8-39-0 11/13/2019 |
|--------------------------------------|----------------------------|----------------------------|----------------------------|
| Depth (ft): | 19 | 29 | 39 |
| Perfluorobutanesulfonic Acid (PFBS) | 1.11 J | 0.89 J | 1.36 J |
| Perfluorodecanic Acid (PFDA) | 0.64 J | 0.73 J | 0.37 J |
| Perfluoroheptanoic Acid (PFHpA) | 3.69 | 2.11 | 1.64 J |
| Perfluorohexanesulfonic Acid | 2.15 B | 8.39 B | 12.7 B |
| Perfluorohexanoic Acid (PFHxA) | 4.48 | 3.64 | 2.4 |
| Perfluorononanoic Acid (PFNA) | 3.18 | 1.24 J | 0.55 J |
| Perfluorooctane Sulfonic Acid (PFOS) | 50.5 | 10.9 | 9.14 |
| Perfluorooctanoic acid (PFOA) | 7.95 | 5.8 | 5.06 |
| Total PFOA and PFOS | 58.45 | 16.7 | 14.2 |

