


**Zennergy**

# Measurement & Savings Verification

Indoor Waterpark and Resort  
Sandusky - OH

Since installing (4) Flow Management Devices with Zennergy LLC on 9/30/15, the property has realized a 10.34% reduction in average daily water consumption compared to the 24 month pre-installation period from 9/20/13 through 9/22/15. Also, the property has shown a daily average water cost reduction of 10.34%.

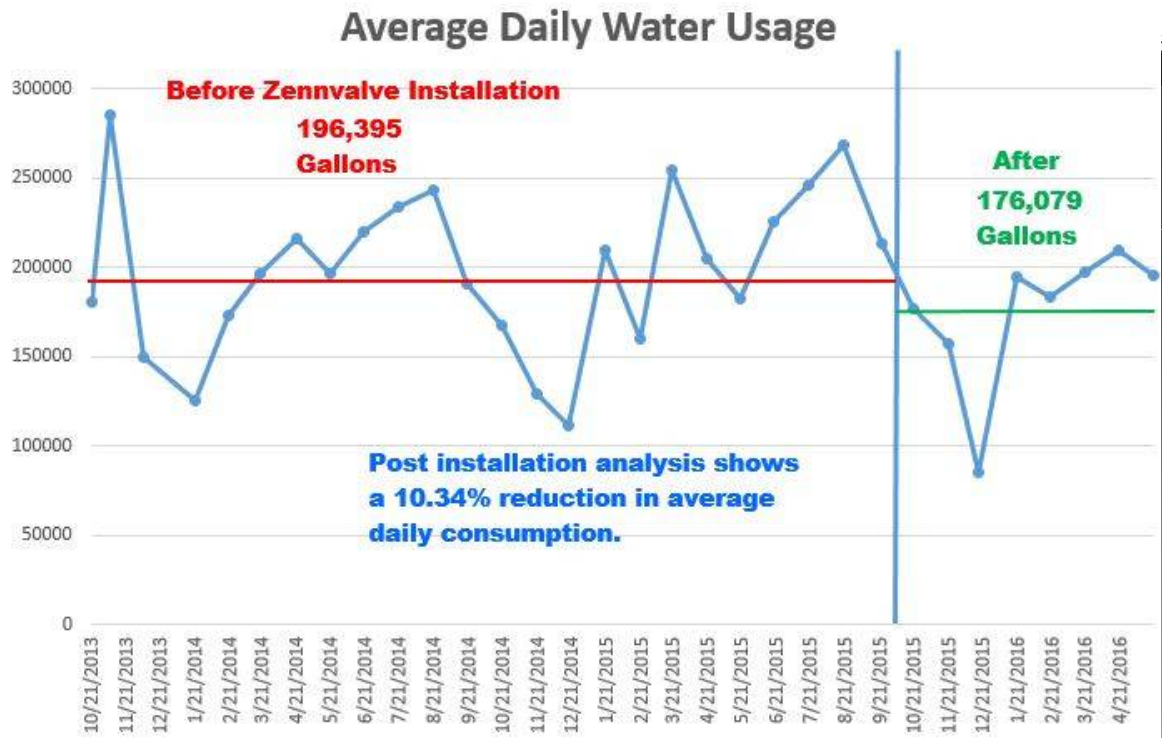

## Daily Average Water Cost Reduction Pre-Installation VS Post-Installation

