
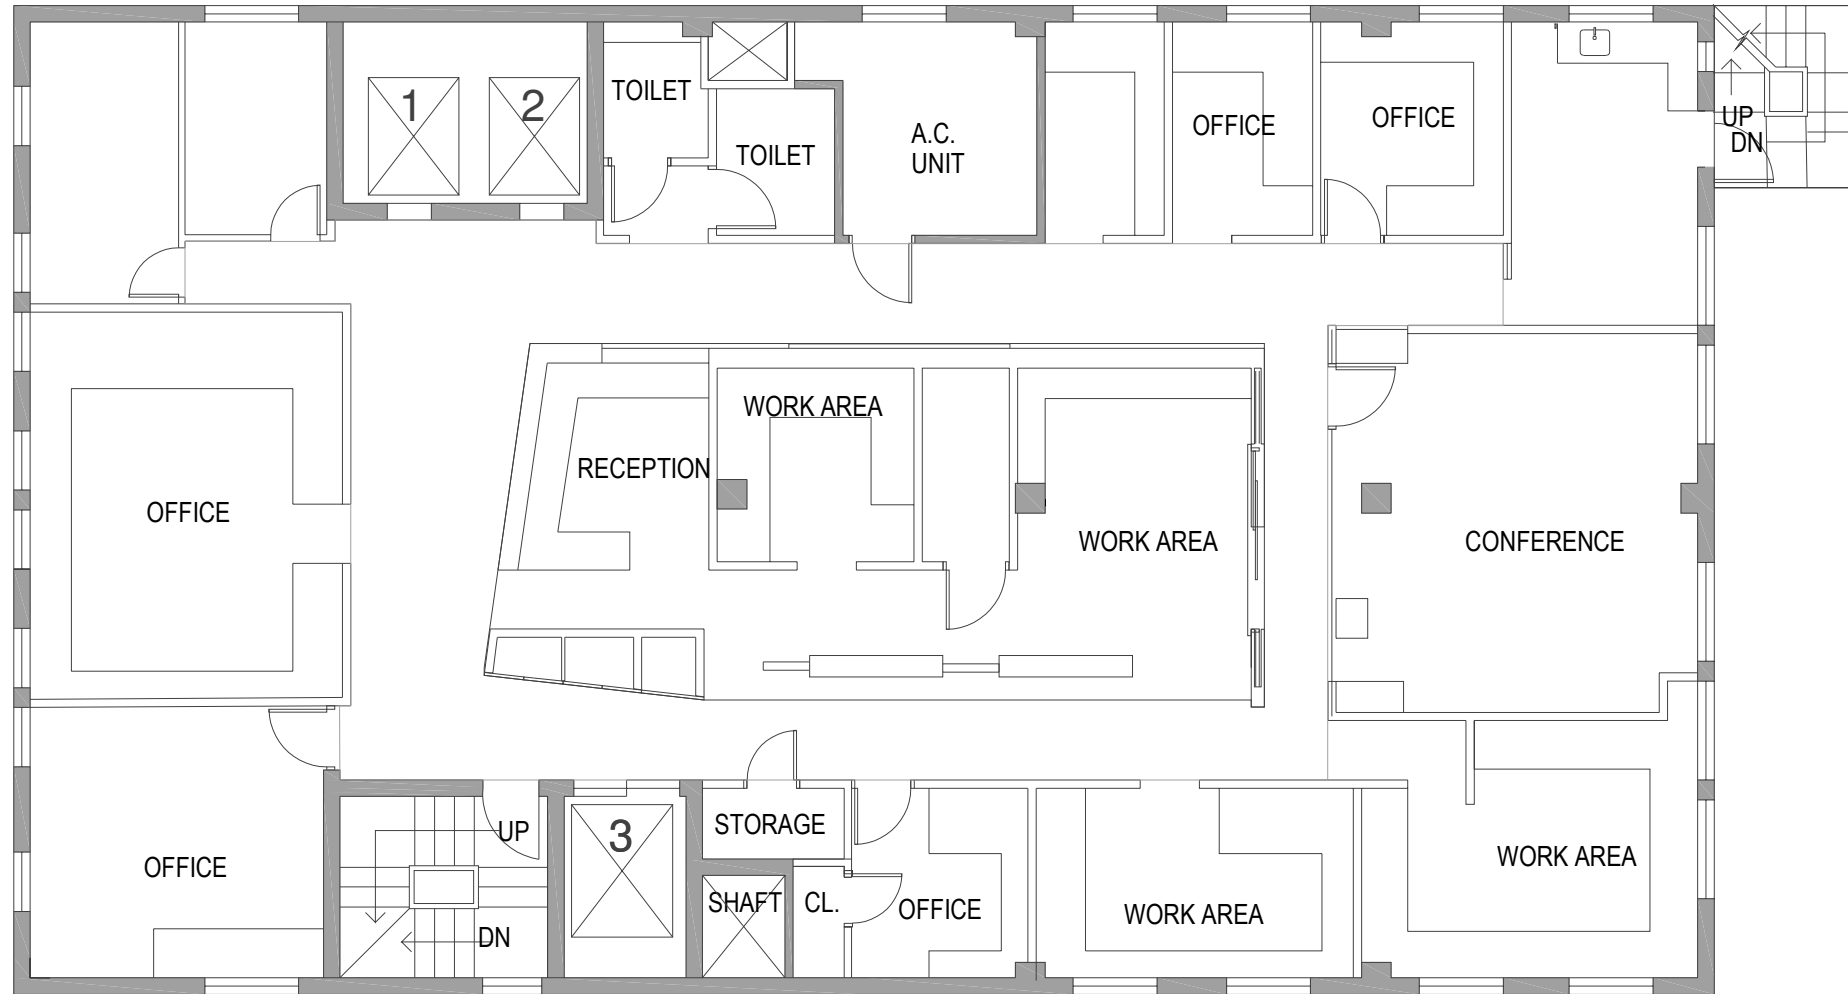


DISCLAIMER: THESE DRAWINGS WERE CREATED FOR **EAP AND/OR FIRE SAFETY** FILING ONLY. DRAWINGS ARE **NOT TO SCALE** & SHOULD NOT BE USED FOR CONSTRUCTION PURPOSES. EXISTING CONDITIONS MAY VARY.

EAST 32ND STREET



LEGEND

- FP** MANUAL PULL STATION
- SP** STANDPIPE HOSE OUTLET
- WS** FIRE WARDEN STATION
- FCS** FIRE COMMAND STATION
- FIRE DEPT. CONNECTION (SIAMESE CONNECTION)
- SP** STANDPIPE CONTROL VALVE
- S** SPRINKLER CONTROL VALVE
- DOMESTIC WATER MAIN CONTROL VALVE
- ←** EVACUATION ROUTE
- FURNITURE/EQUIPMENT
- NON-RATED PARTITION
- >2HR FIRE BARRIER
- NON-SPRINKLERED AREAS (SEE PLAN FOR LOCATION)
- IN-BUILDING RELOCATION AREAS (IBRA)

NO.	DATE:	NAME:	ISSUED/ COMMENTS:
1	12.13.19	RK	1st DRAFT: ISSUED FOR REVIEW.
2	03.01.20	RK	ISSUED FOR REVIEW.

DRAWN BY/DATE: RK CHECKED BY/DATE: JG

BUILDING ADDRESS:
31 East 32nd St.
 New York, NY 10016

DRAWING TITLE:
FL-7
7TH FLOOR

SURVEY BY: JG SURVEY DATE(S): 12.03.19

Full Sprinkler Coverage