

## Envelope Sealing Performed For:

██████████  
██████████  
██████████

AEROBARRIER CASE ID: 8340

SEAL DESCRIPTION: ██████████

HARDWARE: AeroBarrier Connect

TECHNICIAN: Kevin

**DATE:**  
9/24/2024

**BUILDING TYPE:**  
Single Family Detached

## Envelope Sealing Results:

### BEFORE SERVICE

**841.8 CFM of Leakage**, equivalent to a  
**101.4 Square Inch Hole**, or  
**1.46 Air Changes per Hour**

(for your 2009-ft<sup>2</sup> structure  
enclosing a volume of 34598 cubic feet)


### AFTER SERVICE

**342.8 CFM of Leakage**, equivalent to a  
**41.3 Square Inch Hole**, or  
**0.59 Air Changes per Hour**

This corresponds to a  
**59.3% Reduction**  
**in Envelope Leakage**

**NOTE:** Envelope leakage and air-change results are  
calculated at a standard pressure of 50 Pa.  
*Sealing time elapsed: 1:55:24*

## Envelope Sealing Progress:

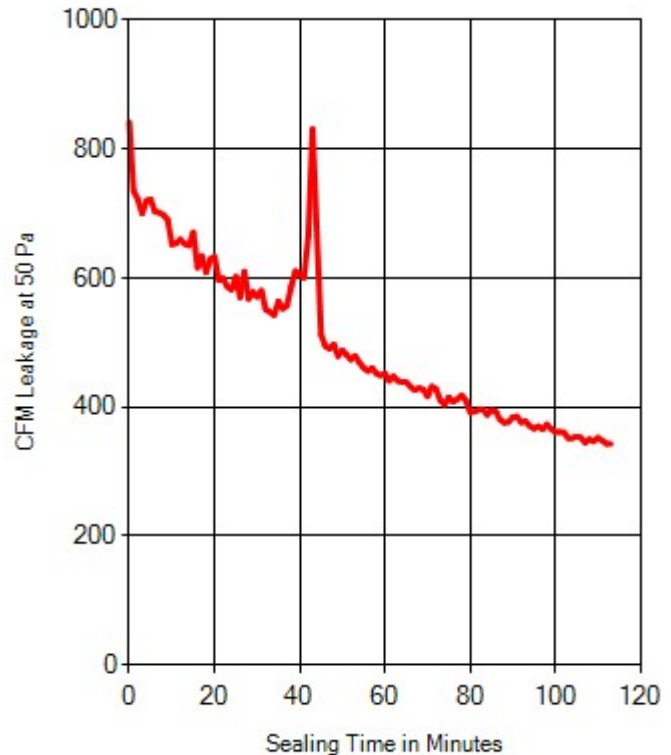

## Envelope Sealing Performed By:



**787 Development**

**NOTES:** a) A certified HVAC contractor or rater should be used to assess the need for enhanced/balanced mechanical equipment as the desired leakage is reduced. b) This certificate provides results based on an enclosure test, using positive pressure. A final blower door test may still be required.