

ENVELOPE SEALING REPORT

Envelope Sealing Performed For:

Austin, TX 78734

AEROBARRIER CASE ID: 8340

SEAL DESCRIPTION:

HARDWARE: AeroBarrier Connect

TECHNICIAN: Kevin

DATE:
6/5/2025

BUILDING TYPE:
Single Family Detached

Envelope Sealing Results:

BEFORE SERVICE

2033.5 CFM of Leakage, equivalent to a
244.8 Square Inch Hole, or
7.30 Air Changes per Hour

(for your 1968-ft² structure
enclosing a volume of 16704 cubic feet)


AFTER SERVICE

447.9 CFM of Leakage, equivalent to a
53.9 Square Inch Hole, or
1.61 Air Changes per Hour

This corresponds to a
78.0% Reduction
in Envelope Leakage

NOTE: Envelope leakage and air-change results are
calculated at a standard pressure of 50 Pa.
Sealing time elapsed: 4:20:40

Envelope Sealing Progress:

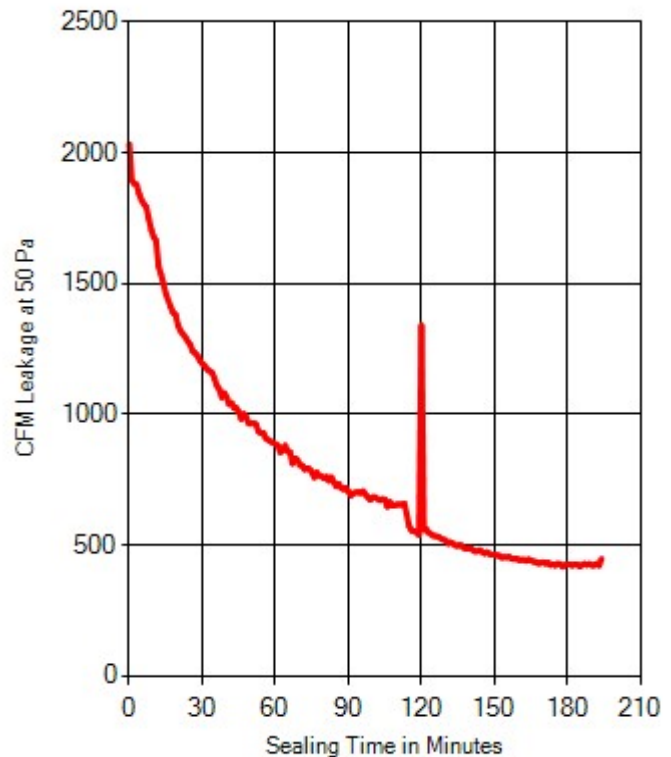

Envelope Sealing Performed By:



787 Development

NOTES: a) A certified HVAC contractor or rater should be used to assess the need for enhanced/balanced mechanical equipment as the desired leakage is reduced. b) This certificate provides results based on an enclosure test, using positive pressure. A final blower door test may still be required.