


Envelope Sealing Performed For:



AEROBARRIER CASE ID: 8340

SEAL DESCRIPTION: 

HARDWARE: AeroBarrier Connect

TECHNICIAN: Kevin

DATE:
1/17/2025

BUILDING TYPE:
Single Family Detached

Envelope Sealing Results:

BEFORE SERVICE

759.0 CFM of Leakage, equivalent to a
91.4 Square Inch Hole, or
12.65 Air Changes per Hour

(for your 401-ft² structure
enclosing a volume of 3600 cubic feet)


AFTER SERVICE

44.4 CFM of Leakage, equivalent to a
5.3 Square Inch Hole, or
0.74 Air Changes per Hour

This corresponds to a
94.1% Reduction
in Envelope Leakage

NOTE: Envelope leakage and air-change results are
calculated at a standard pressure of 50 Pa.
Sealing time elapsed: 4:42:26


Envelope Sealing Progress:

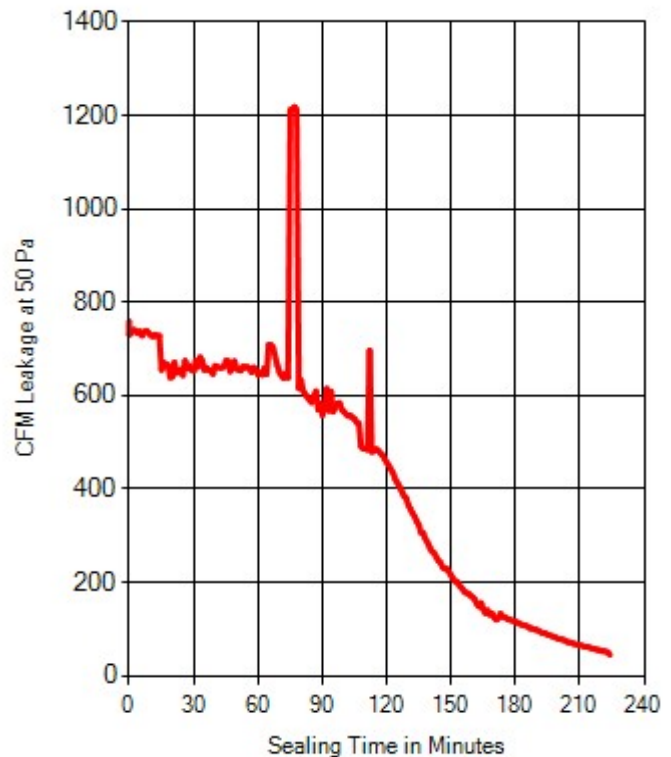

Envelope Sealing Performed By:



787 Development



NOTES: a) A certified HVAC contractor or rater should be used to assess the need for enhanced/balanced mechanical equipment as the desired leakage is reduced. b) This certificate provides results based on an enclosure test, using positive pressure. A final blower door test may still be required.