


SAN-AI ETHYLENE CONTROL



| Ethylene Control test | |
|-----------------------|-------------|
| Commodity | Mango |
| | マンゴー |
| Term | For 13 days |
| Room temp | 28°C |
| Humidity | 60% |


1st day

| Left | Right |
|---------|----------|
| Non ECI | With ECI |

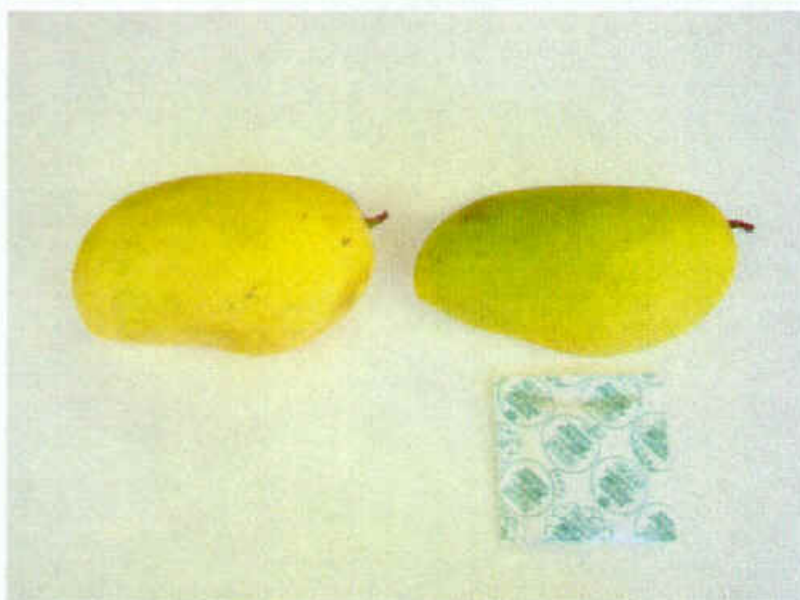

6 days after

| Left | Right |
|---------|----------|
| Non ECI | With ECI |

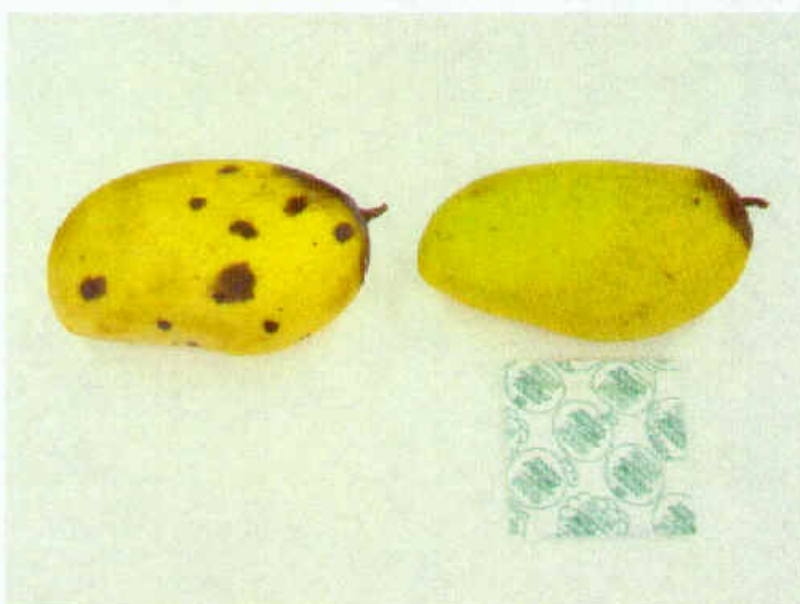

13 days after

| Left | Right |
|---------|----------|
| Non ECI | With ECI |