

SPECIFICATIONS

GENERAL

Aluminum framing shall be Marlin System 45T Center-Set thermally improved as manufactured by Marlin windows.

MATERIALS

All framing shall be aluminum extrusions of 6063-T5 alloy & temper. System 45T shall have a rigid polyurethane "thermal-barrier" as an integral contact between the interior and exterior aluminum sections including the door framing members utilizing a "thermal-break" door stop. Glazing gaskets shall be extruded E.P.D.M.

FINISH

Standard architectural Class II anodic color conforming to Aluminum Association AA-M12-C22-A34 for dark bronze or AA-M12-C22-A31 for clear anodized. (Architectural Class I and Class II anodic finishes and organic coatings available - specify).

CONSTRUCTION

Aluminum framing shall have a 2" face width and a depth of 4 ½" and provide for flush glazing without projecting stops. The system shall use a continuous sub sill. Optional thermally improved concealed project-out vent (Architect specify). Additional sight line shall not exceed 1 ⅜". (Consult factory for hardware and screen options.) **Maximum vent size 60" x 36"**.

GLAZING

Marlin System 45T CS shall accommodate 1" glazing as required. Provisions for 1/4" glazing shall be accommodated by use of an adapter.

PERFORMANCE

System 45T CS shall be tested in accordance with:

- AAMA 501
- ASTM E 283 for air infiltration
- ASTM E 331 for water penetration
- ASTM E 330 for structural performance.

Deflection of mullions shall be limited to $L/175$, with a maximum deflection of ½", when subjected to the project design pressure of ____ P.S.F. (Architect to specify).

System 45T NFRC Simulation test in accordance with:

- ANSI/NFRC 100 - Procedure for Determining Fenestration Product U-Factors
- ANSI/NFRC 200 - Procedure for Determining Fenestration Product Solar Heat Gain Coefficients at Normal Incidence
- NFRC 500 - Procedure for Determining Fenestration Product Condensation Resistance Values


INSTALLATION

Glass and framing shall be installed straight, plumb, and level without twisting and securely anchored in place. All joints between framing and the building exterior shall be sealed to provide a watertight installation.

PROTECTION AND CLEANING

The General Contractor shall provide adequate protection of the aluminum and glass surfaces from damage by grinding compound, lime, acids, cement or other contaminants. The General Contractor shall be responsible for final cleaning.

Scale


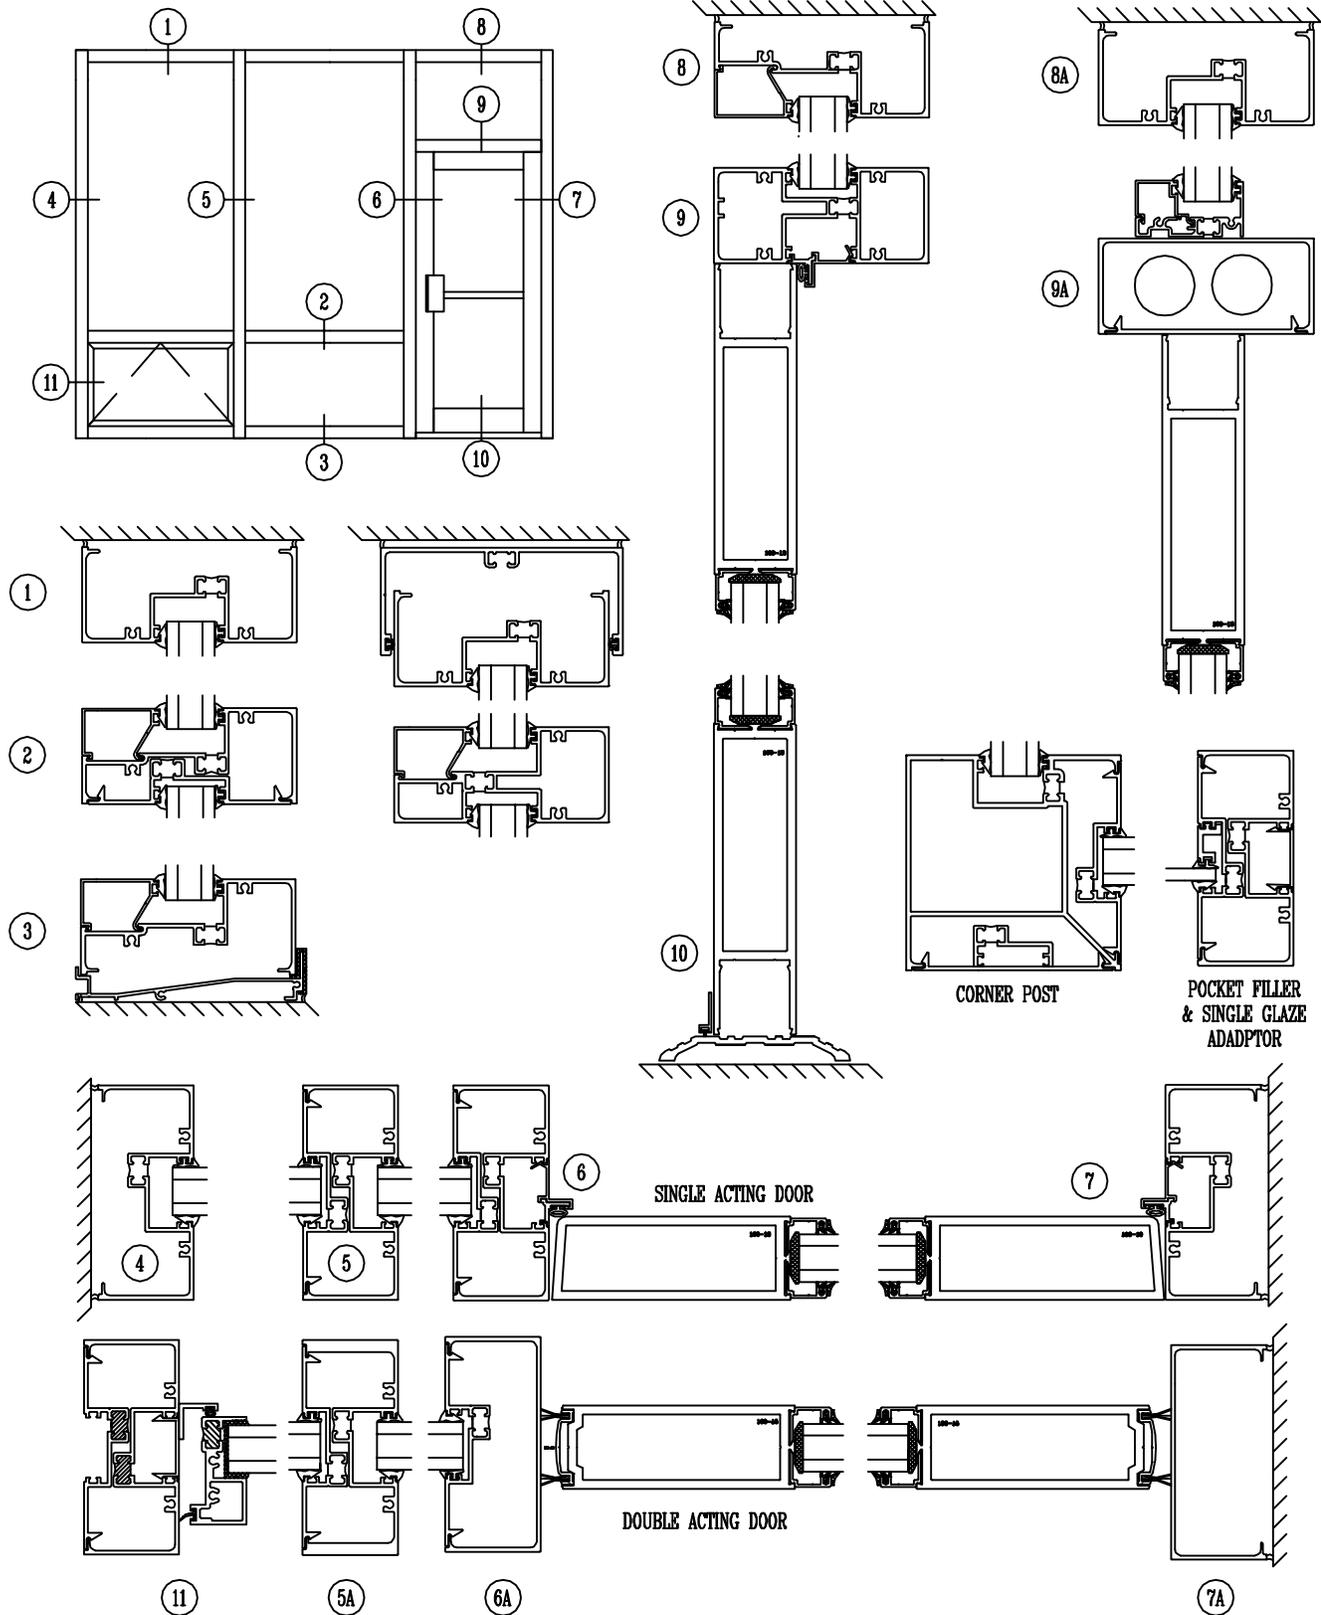


WIND LOAD CHARTS



DEFLECTION LIMITED TO L/175

- A = 15 PSF
- B = 20 PSF
- C = 25 PSF
- D = 30 PSF

I = 3.127
S = 1.366

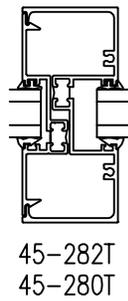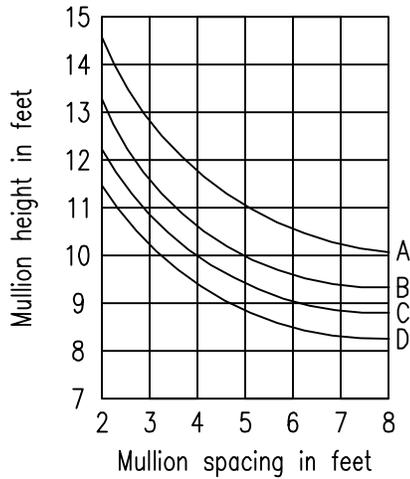



I = 5.979
S = 2.626

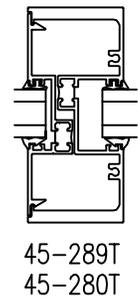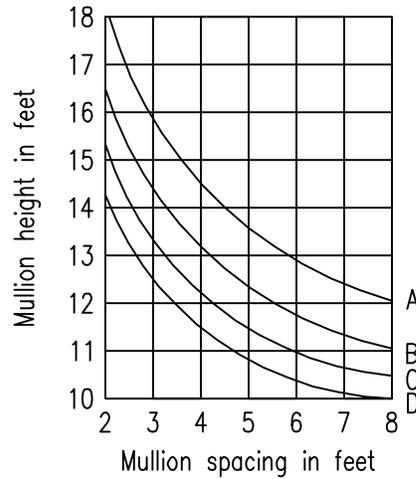



DEAD LOAD CHARTS

- 1/4 POINT LOADING (A)
- 1/8 POINT LOADING (B)


I = .254

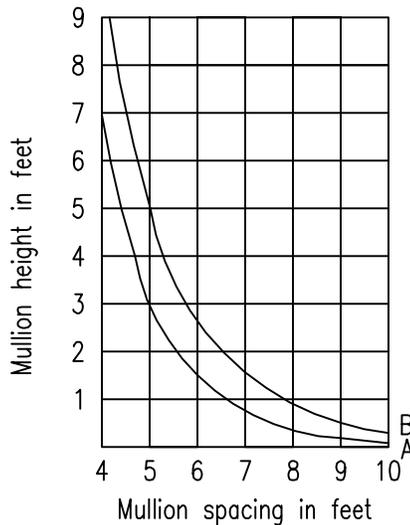


I = .469

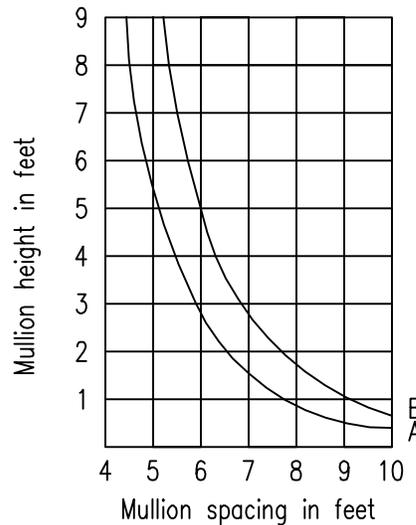


① HEAD

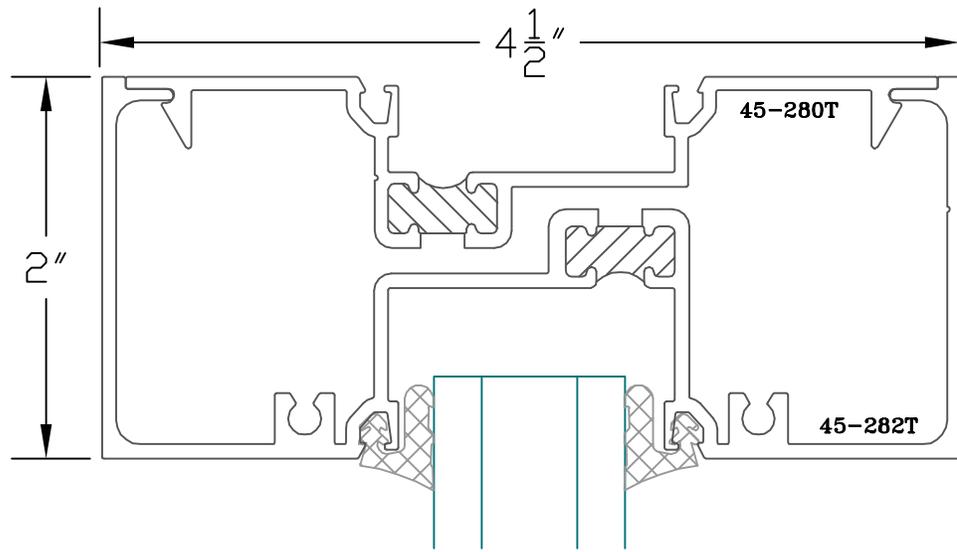


② HORIZONTAL

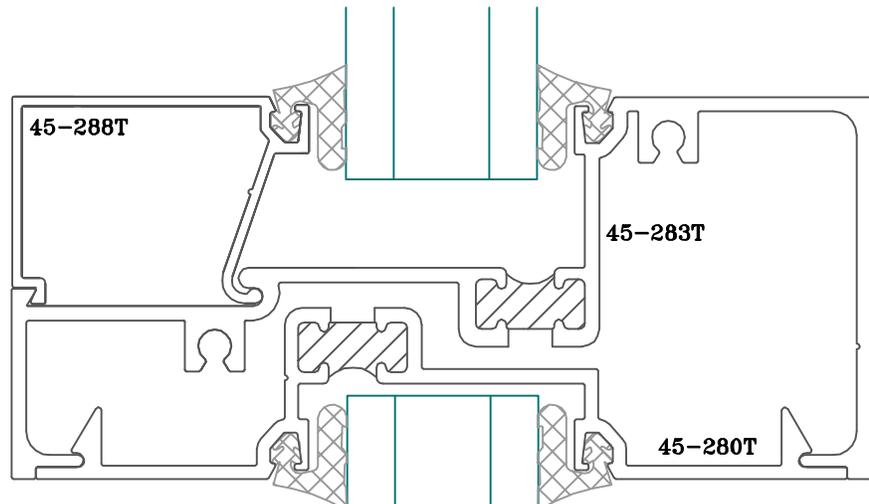


③ SILL

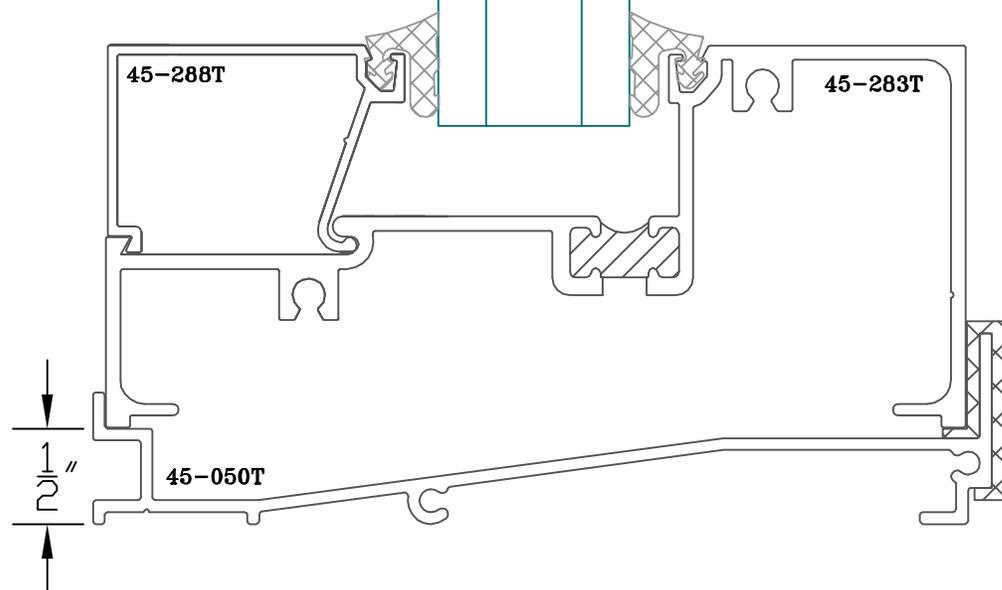


1A HEAD

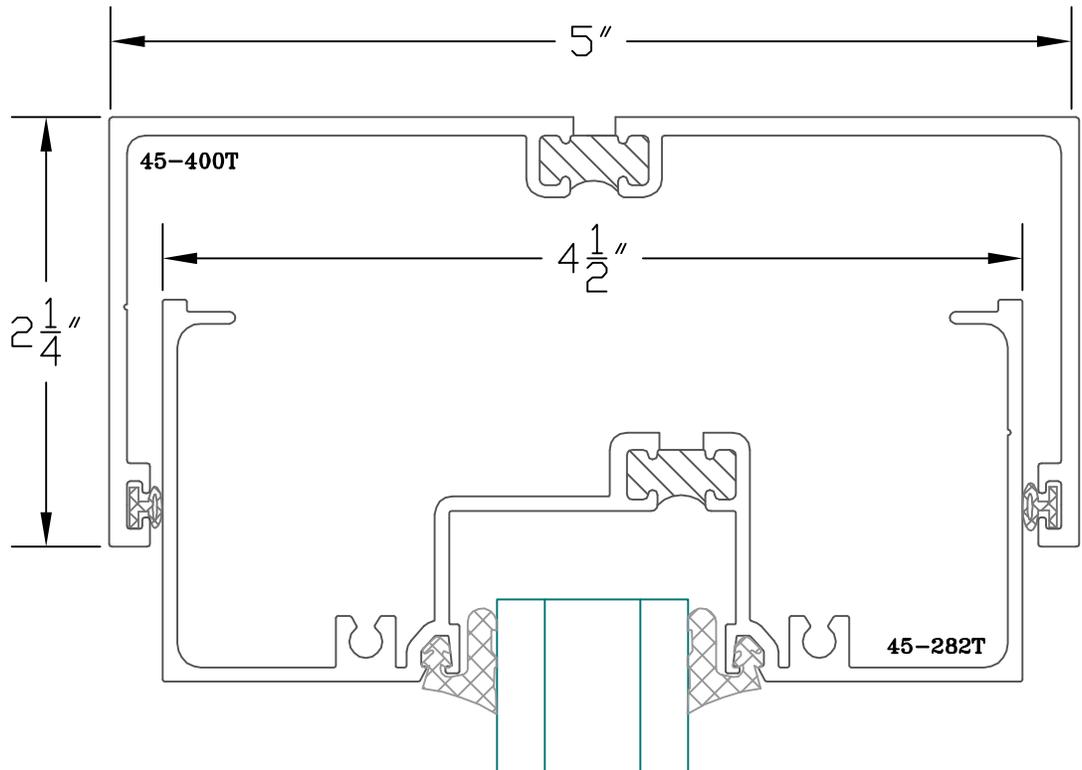


2A HORIZONTAL

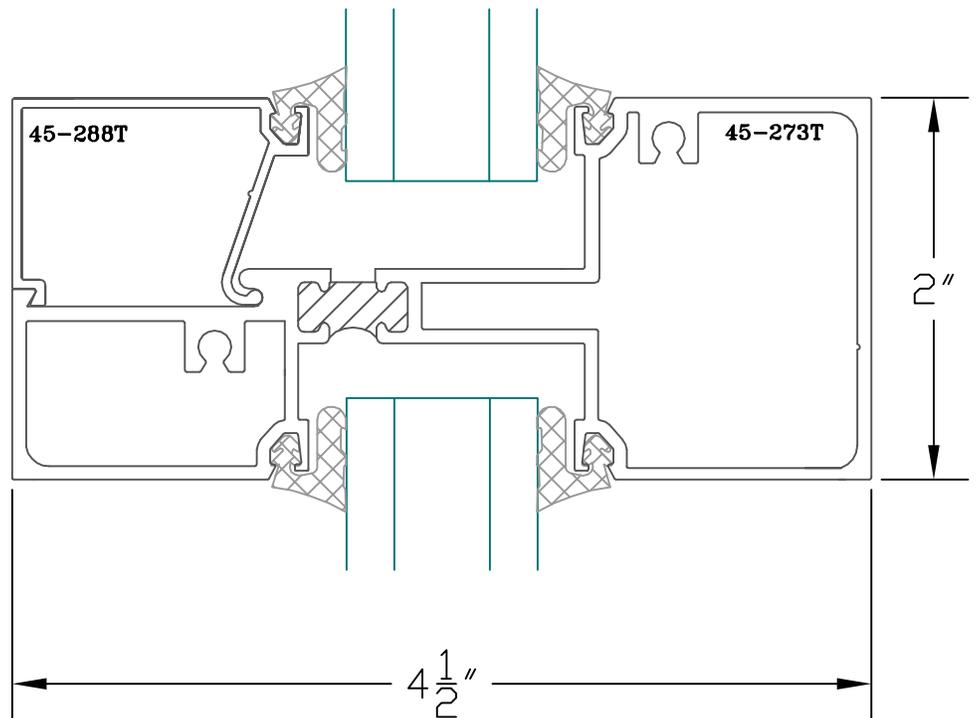


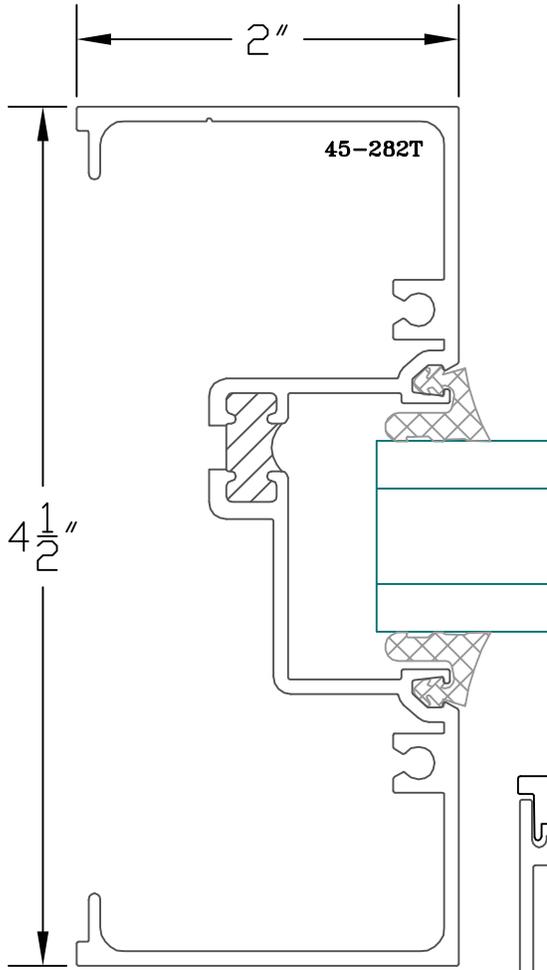


④ JAMB

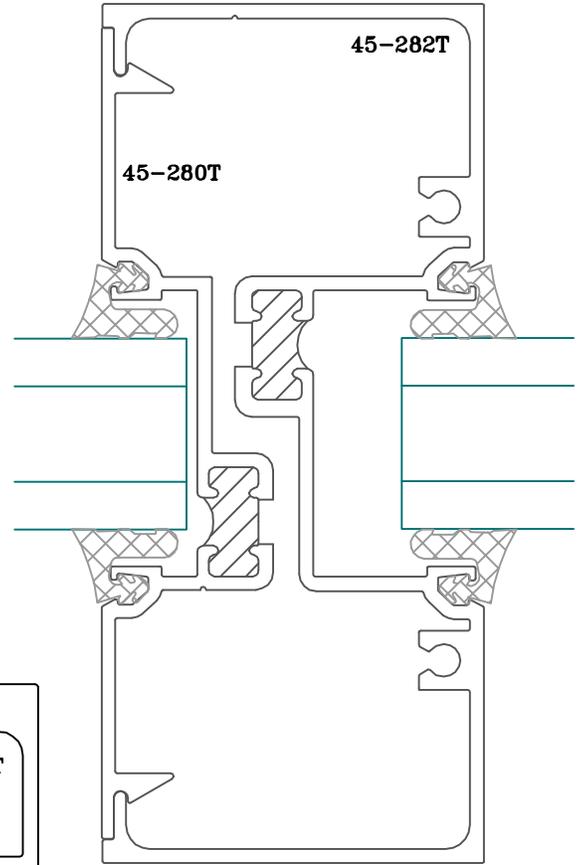



⑤ VERTICAL

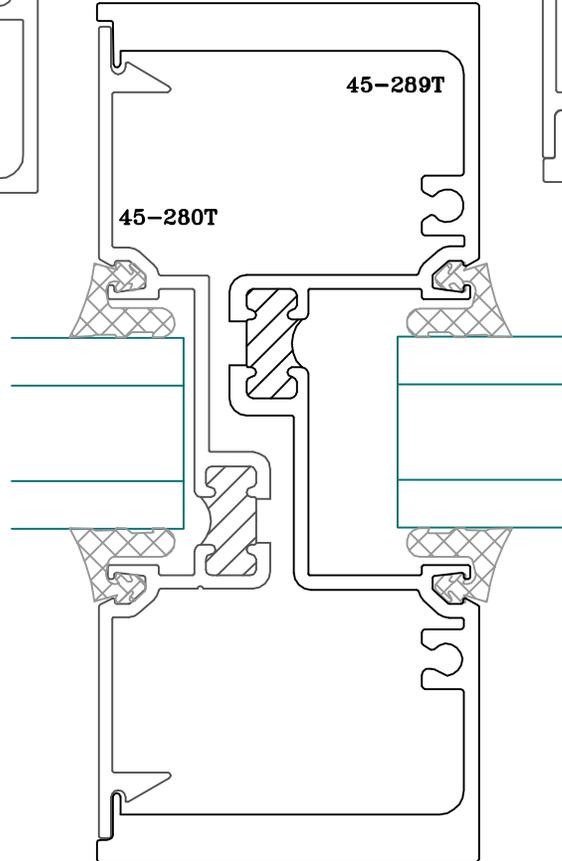


⑤A VERTICAL

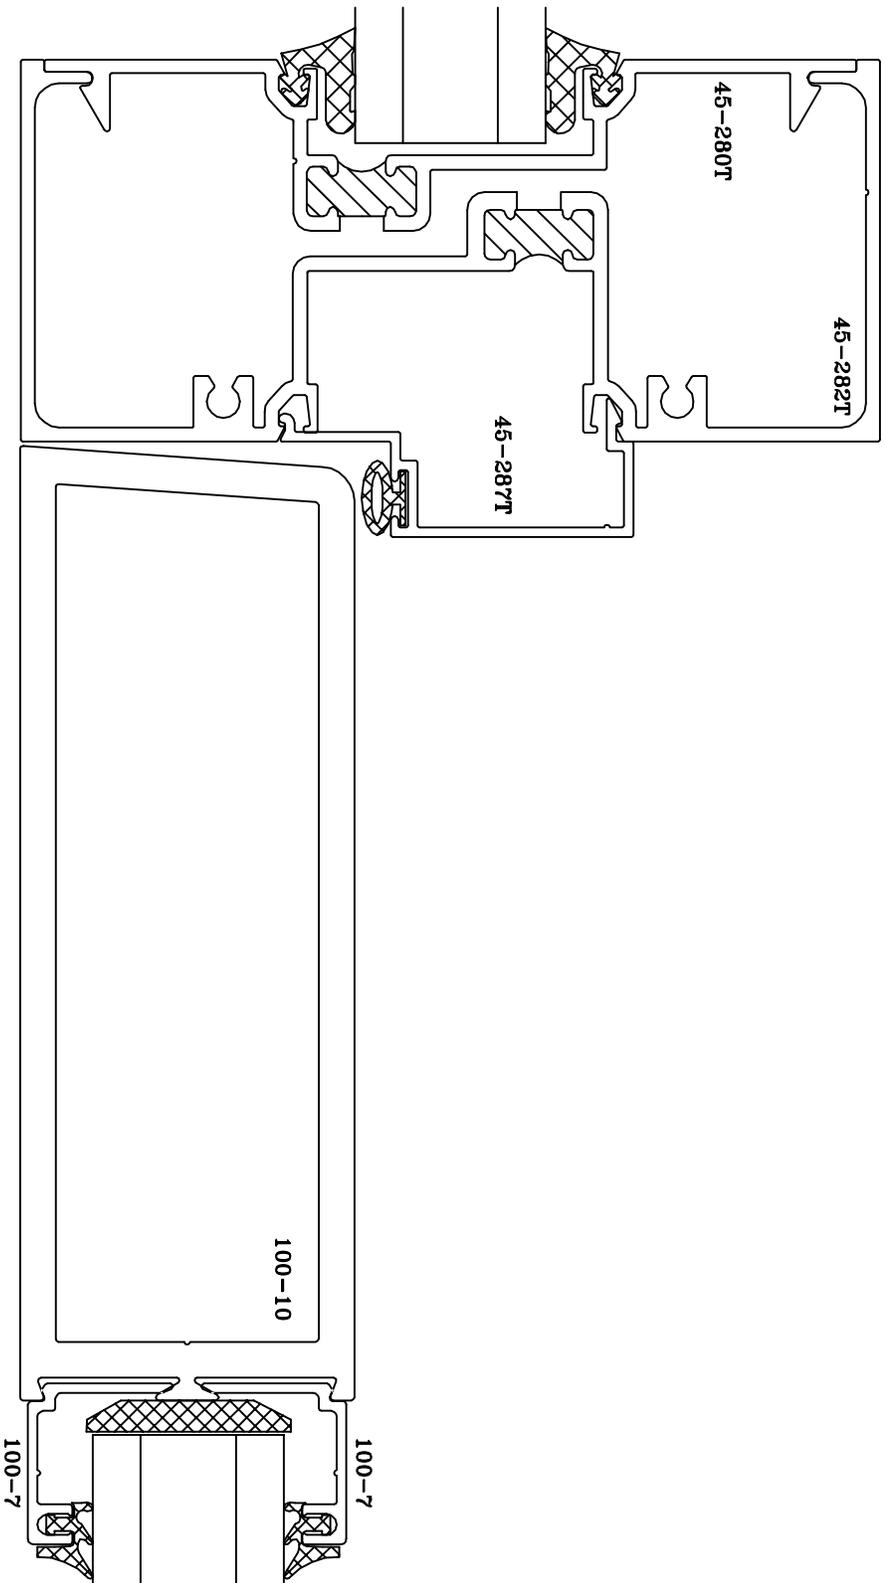


⑥ DOOR JAMB

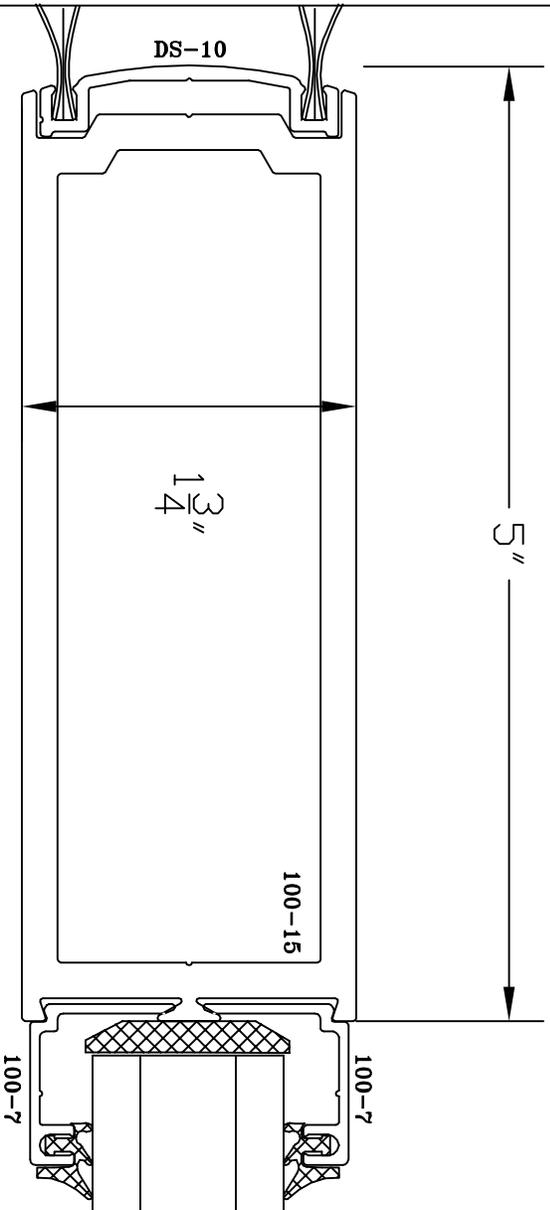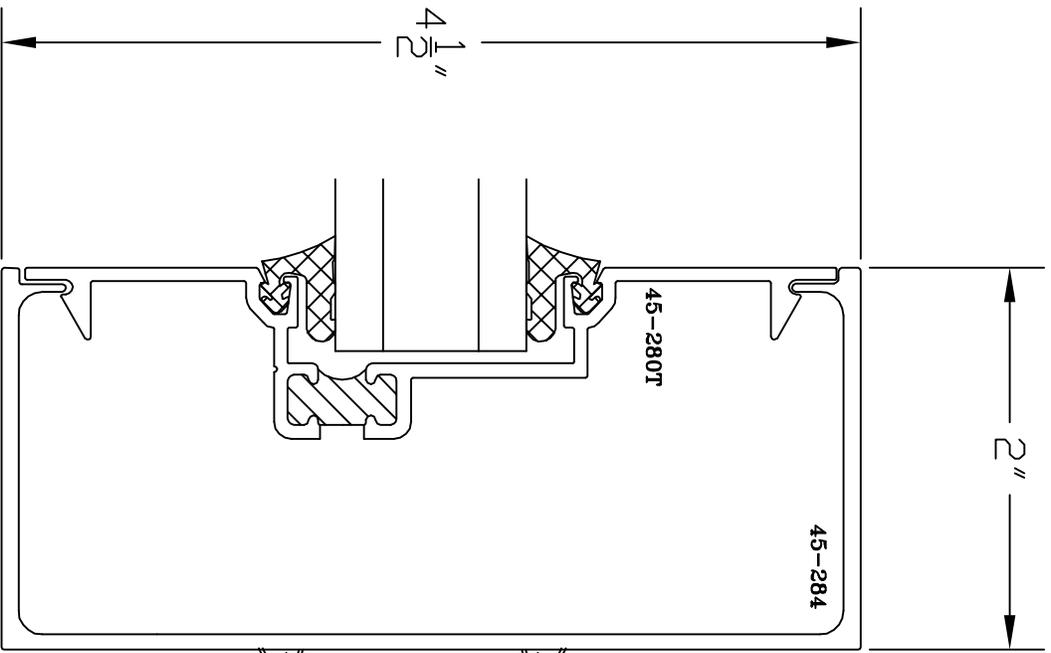

6A DOOR JAMB

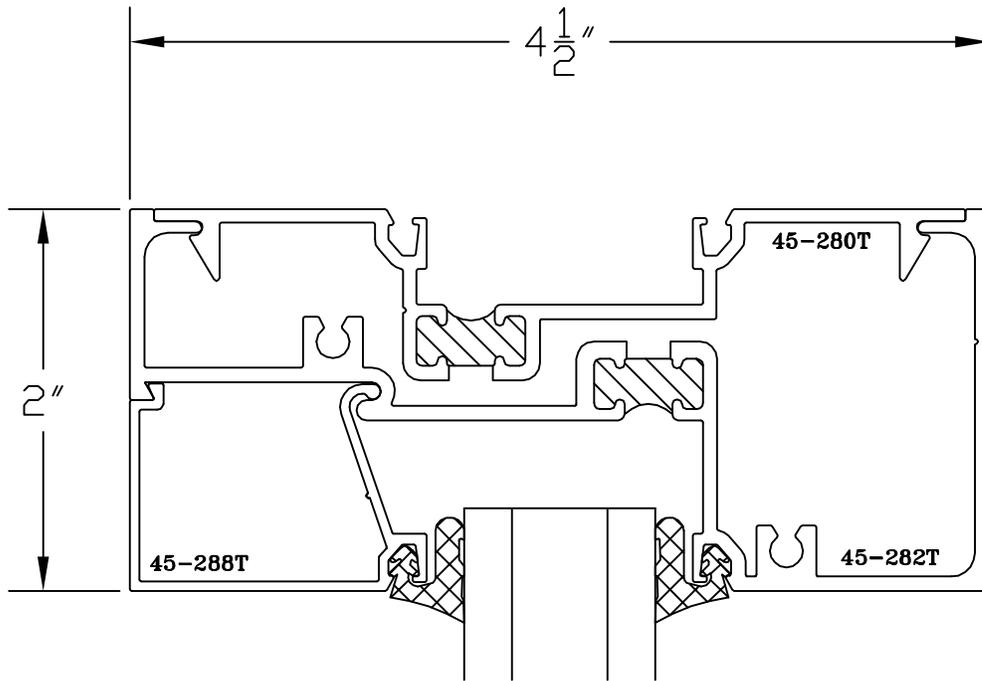

⑧ HEAD

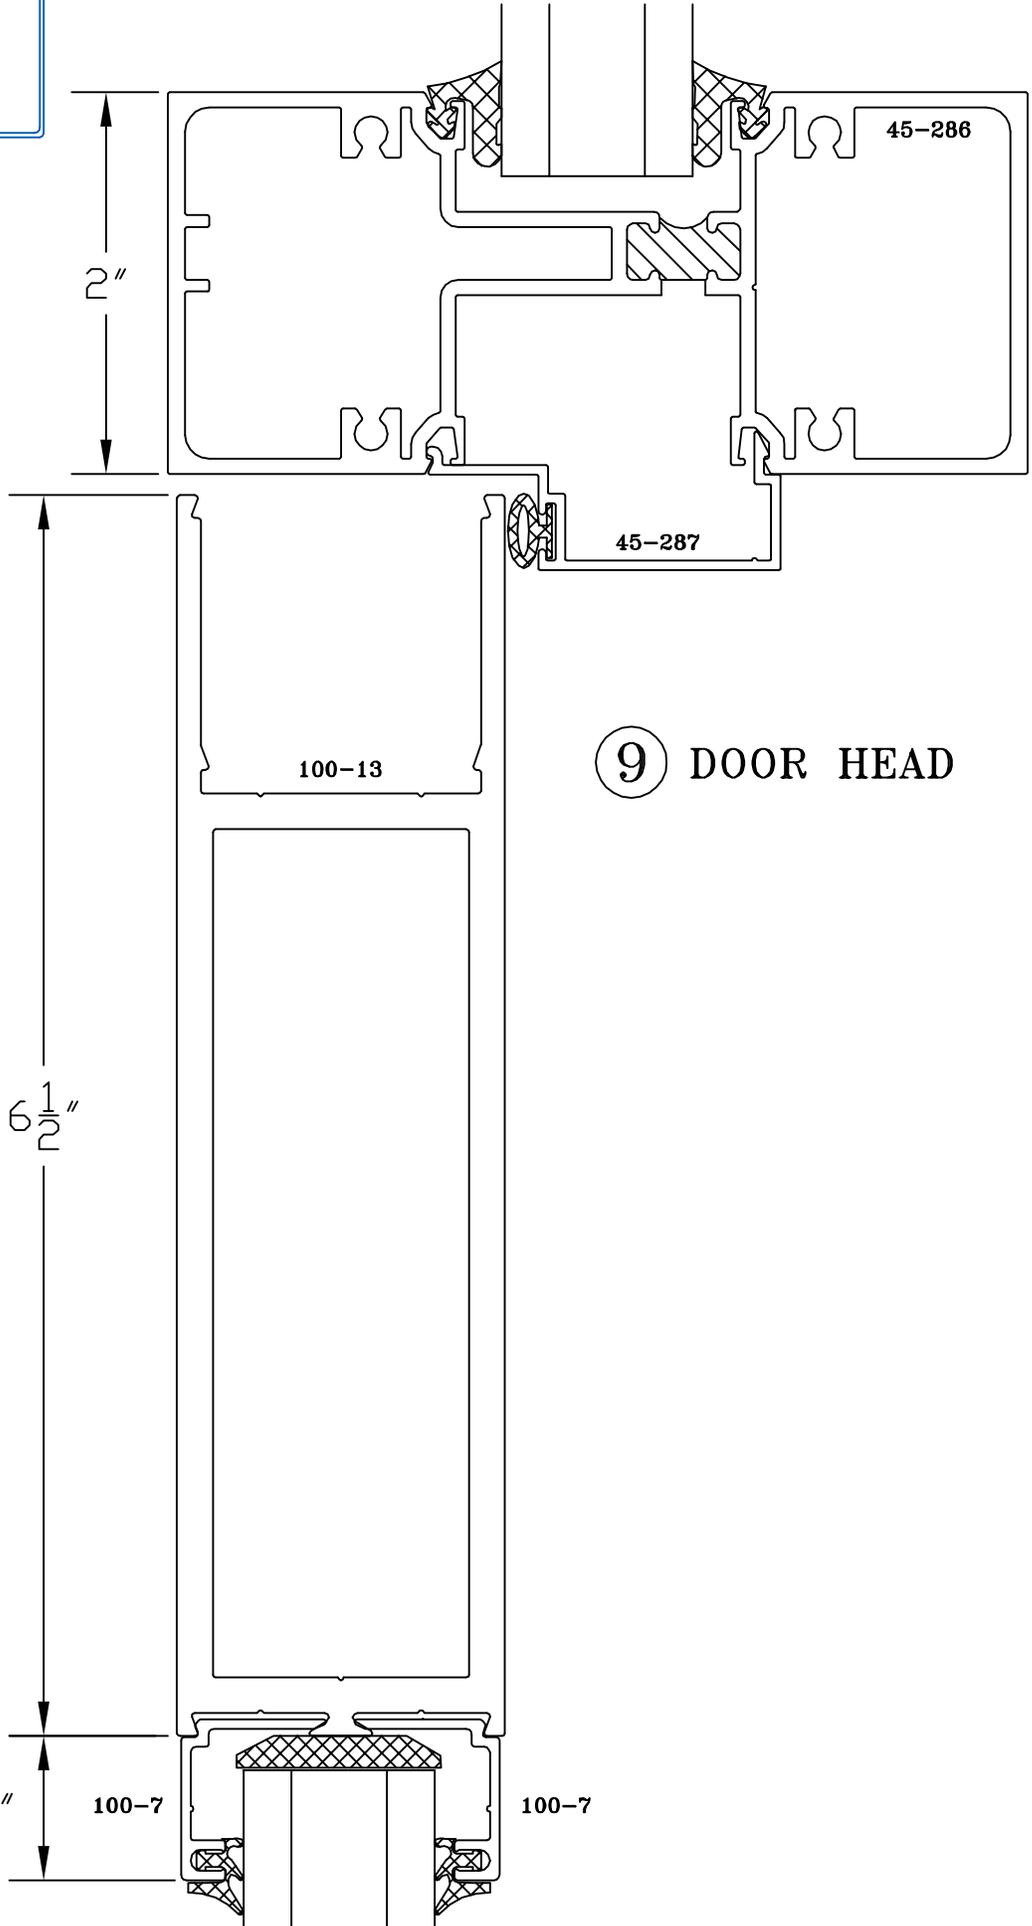

9 DOOR HEAD

4 1/8"

100-7

100-7


100-13

45-287

45-286

2"

6 1/2"

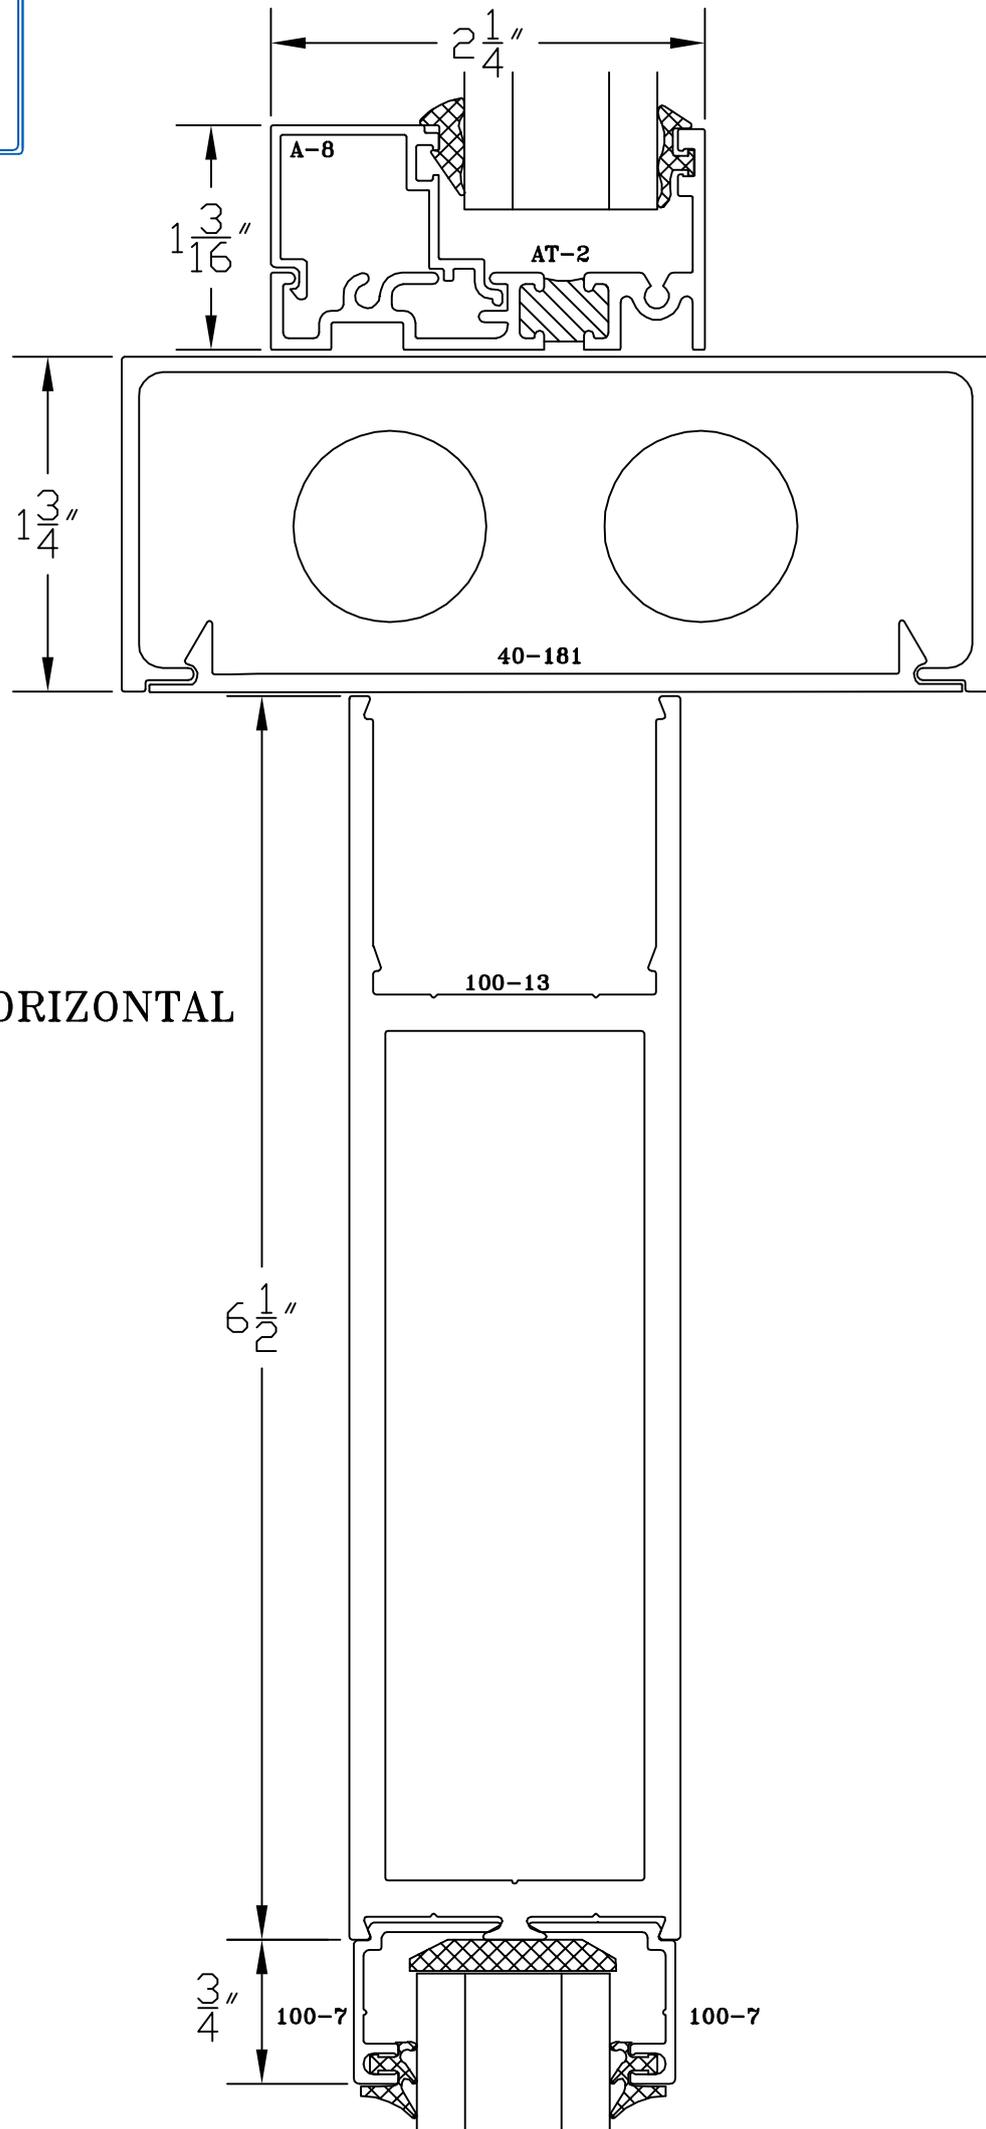

9A HORIZONTAL

