WYSSLING CONSULTING
CORPORATE EXPERIENCE WITH SMALL BUSINESS VALUE

Scott E. Wyssling, PE
Coleman D. Larsen, SE, PE
Gregory T. Elvestad, PE

76 North Meadowbrook Drive
Alpine, UT 84004
office (201) 874-3483
swyssling@wysslingconsulting.com

March 1, 2023

Current Insight
2852 W. Amini Way
South Jordan, UT 84095

Scott Wyssling, PE

Digitally signed by Scott Wyssling, PE
DN: C=US, S=Utah, L=Alpine, O=Wyssling Consulting, OU=Engineering, CN="Scott Wyssling, PE", E=swyssling@wysslingconsulting.com
Reason: I am the author of this document
Location: your signing location here
Date: 2023.03.01 11:49:28-07'00'
Foxit PDF Editor Version: 11.1.0

Re: Engineering Services
Piotter Residence
2841 Northwest 45th Place, Cape Coral, FL
6.400 kW System

To Whom It May Concern:

We have received information regarding solar panel installation on the roof of the above referenced structure. Our evaluation of the structure is to verify the existing capacity of the roof system and its ability to support the additional loads imposed by the proposed solar system.

A. Site Assessment Information

1. Site visit documentation identifying attic information including size and spacing of framing for the existing roof structure.
2. Design drawings of the proposed system including a site plan, roof plan and connection details for the solar panels. This information will be utilized for approval and construction of the proposed system.

B. Description of Structure:

Roof Framing:	Assumed 2x6 dimensional lumber at 24” on center.
Roof Material:	Composite Asphalt Shingles
Roof Slope:	23 degrees
Attic Access:	Inaccessible
Foundation:	Permanent

C. Loading Criteria Used

- **Dead Load**
  - Existing Roofing and framing = 7 psf
  - New Solar Panels and Racking = 3 psf
  - TOTAL = 10 PSF
- **Live Load** = 20 psf (reducible) – 0 psf at locations of solar panels
- **Ground Snow Load** = 0 psf
- **Wind Load** based on ASCE 7-16
  - Ultimate Wind Speed = 160 mph (based on Risk Category II)
  - Exposure Category C

Analysis performed of the existing roof structure utilizing the above loading criteria is in accordance with the FBC 2020, 7th Edition, including provisions allowing existing structures to not require strengthening if the new loads do not exceed existing design loads by 105% for gravity elements and 110% for seismic elements. This analysis indicates that the existing framing will support the additional panel loading without damage, if installed correctly.

D. Solar Panel Anchorage

1. The solar panels shall be mounted in accordance with the most recent IronRidge installation manual. If during solar panel installation, the roof framing members appear unstable or deflect non-uniformly, our office should be notified before proceeding with the installation.
2. The maximum allowable withdrawal force for a $^{5}/_{16}$" lag screw is 235 lbs per inch of penetration as identified in the National Design Standards (NDS) of timber construction specifications. Based on a minimum penetration depth of 2½", the allowable capacity per connection is greater than the design withdrawal force (demand). Considering the variable factors for the existing roof framing and installation tolerances, the connection using one $^{5}/_{16}$" diameter lag screw with a minimum of 2½" embedment will be adequate and will include a sufficient factor of safety.
3. Considering the wind speed, roof slopes, size and spacing of framing members, and condition of the roof, the panel supports shall be placed no greater than 48" on center.

Based on the above evaluation, this office certifies that with the racking and mounting specified, the existing roof system will adequately support the additional loading imposed by the solar system. This evaluation is in conformance with the FBC 2020, 7th Edition, current industry standards, and is based on information supplied to us at the time of this report.

Should you have any questions regarding the above or if you require further information do not hesitate to contact me.

Very truly yours,

Scott E. Wyssling, PE
Florida License No. 81558
Florida License RY34912

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SCOTT E WYSSLING
LICENSE
No. 81558
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

2841 PIOTTER RESIDENCE

PHOTOVOLTAIC SYSTEM
2841 NW 45TH PL,
CAPE CORAL , FL 33993

SYSTEM SIZE: 6.40 kW-DC | 3.84 kW-AC
MODULE: (16) Q.PEAK DUO BLK ML-G10+ [400W]
INVERTER: (16) ENPHASE IQ8-60-2-US [240V] MICROINVERTER

GOVERNING CODES

ALL MATERIALS, EQUIPMENT, INSTALLATION AND WORK SHALL COMPLY WITH THE FOLLOWING APPLICABLE CODES:

- 2017 FLORIDA ELECTRICAL CODE (NEC)
- 2020 FLORIDA BUILDING CODE (IBC)
- 2020 FLORIDA RESIDENTIAL CODE (IRC)
- 2020 FLORIDA FIRE CODE (IFC)
- 2020 FLORIDA MECHANICAL CODE
- IEEE STANDARD 929
- OSHA 29 CFR 1910.269
- WHERE APPLICABLE, RULES OF THE PUBLIC UTILITIES COMMISSION REGARDING SAFETY AND RELIABILITY
- THE AUTHORITY HAVING JURISDICTION
- MANUFACTURERS' LISTINGS AND INSTALLATION INSTRUCTIONS
- ANY OTHER LOCAL AMENDMENTS

VICINITY MAP

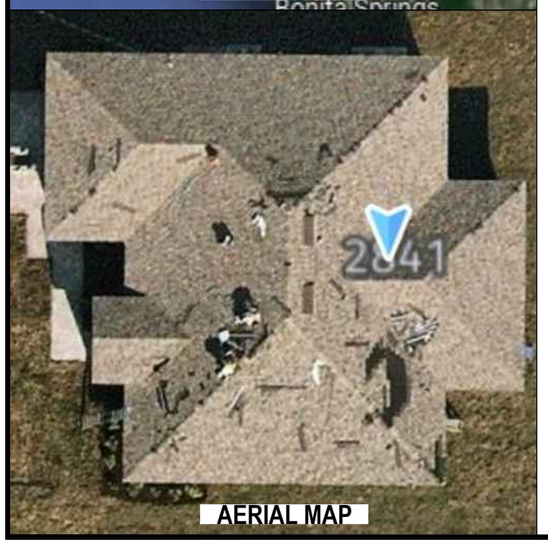

AERIAL MAP

GENERAL

1. UTILITY SHALL BE NOTIFIED BEFORE ACTIVATION OF PHOTOVOLTAIC SYSTEM.
2. 110.2 APPROVAL: ALL ELECTRICAL EQUIPMENT SHALL BE LABELED, LISTED, OR CERTIFIED BY A NATIONALLY RECOGNIZED TESTING LABORATORY ACCREDITED BY THE UNITED STATES OCCUPATIONAL SAFETY HEALTH ADMINISTRATION
3. CONTRACTOR SHALL FIELD VERIFY ALL DIMENSIONS PRIOR TO INITIATING CONSTRUCTION.
4. CONTRACTOR SHALL REVIEW ALL MANUFACTURER INSTALLATION DOCUMENTS PRIOR TO INITIATING CONSTRUCTION.
5. ALL EQUIPMENT AND ASSOCIATED CONNECTIONS, ETC, AND ALL ASSOCIATED WIRING AND INTERCONNECTIONS SHALL BE INSTALLED ONLY BY QUALIFIED PERSONNEL.
6. THE CONTRACTOR OR OWNER MUST PROVIDE ROOF ACCESS (LADDER TO ROOF) FOR ALL THE REQUIRED INSPECTIONS. LADDERS MUST BE OSHA APPROVED, MINIMUM TYPE I WITH A 250LB. RATING, IN GOOD CONDITION AND DESIGNED FOR ITS INTENDED USE.
7. CONTRACTOR SHALL VERIFY THAT THE ROOF STRUCTURE WILL WITHSTAND THE ADDITIONAL LOADS.
8. LAG SCREWS SHALL PENETRATE A MINIMUM 2" INTO SOLID SAWN STRUCTURAL MEMBERS AND SHALL NOT EXCEED MANUFACTURER RECOMMENDATIONS FOR FASTENERS INTO ENGINEERED STRUCTURAL MEMBERS.
9. AN ACCESS POINT SHALL BE PROVIDED THAT DOES NOT PLACE THE GROUND LADDER OVER OPENINGS SUCH AS WINDOWS OR DOORS ARE LOCATED AT STRONG POINTS OF BUILDING CONSTRUCTION AND IN LOCATIONS WHERE THE ACCESS POINT DOES NOT CONFLICT WITH OVERHEAD OBSTRUCTIONS SUCH AS TREE LIMBS, WIRES, OR SIGNS.
10. WHERE DC CONDUCTORS ARE RUN INSIDE BUILDING, THEY SHALL BE CONTAINED IN A METAL RACEWAY; THEY SHALL NOT BE INSTALLED WITHIN 10" OF THE ROOF DECKING OR SHEATHING EXCEPT WHERE COVERED BY THE PV MODULES AND EQUIPMENT.
11. ALL FIELD -INSTALLED JUNCTION, PULL AND OUTLET BOXES LOCATED BEHIND MODULES SHALL BE ACCESSIBLE DIRECTLY OR BY DISPLACEMENT OF A MODULE SECURED BY REMOVABLE FASTENERS.

ELECTRICAL

1. WIRING MATERIALS SHALL COMPLY WITH MAXIMUM CONTINUOUS CURRENT OUTPUT AT 25°C AND MAXIMUM VOLTAGE AT 600V; WIRE SHALL BE WET RATED AT 90°C.
2. EXPOSED PHOTOVOLTAIC SYSTEM CONDUCTORS ON THE ROOF WILL BE USE 2 OR PV-TYPE WIRE.
3. PHOTOVOLTAIC SYSTEM CONDUCTORS SHALL BE IDENTIFIED AND GROUPED. THE MEANS OF IDENTIFICATION SHALL BE PERMITTED BY SEPARATE COLOR-CODING, MARKING TAPE, TAGGING OR OTHER APPROVED MEANS.
4. ALL EXTERIOR CONDUIT, FITTINGS, AND BOXES SHALL BE RAIN-TIGHT AND APPROVED FOR USE IN WET LOCATIONS.
5. ALL METALLIC RACEWAYS AND EQUIPMENT SHALL BE BONDED AND ELECTRICALLY CONTINUOUS.
6. WHERE SIZES OF JUNCTION BOXES, RACEWAYS, AND CONDUITS ARE NOT SPECIFIED, CONTRACTOR SHALL SIZE THEM ACCORDING TO APPLICABLE CODES.
7. REMOVAL OF A UTILITY-INTERACTIVE INVERTER OR OTHER EQUIPMENT SHALL NOT DISCONNECT THE BUILDING CONNECTION BETWEEN THE GROUNDING ELECTRODE CONDUCTOR AND THE PV SOURCE AND/OR OUTPUT CIRCUIT GROUNDED CONDUCTOR.
8. FOR GROUNDED SYSTEMS, THE PHOTOVOLTAIC SOURCE AND OUTPUT CIRCUITS SHALL BE PROVIDED WITH A GROUND-FAULT PROTECTION DEVICE OR SYSTEM THAT DETECTS A GROUND FAULT, INDICATES THAT FAULT HAS OCCURED AND AUTOMATICALLY DISCONNECTS ALL CONDUCTORS OR CAUSES THE INVERTER TO AUTOMATICALLY CEASE SUPPLYING POWER TO OUTPUT CIRCUITS.
9. FOR UNGROUNDED SYSTEMS, THE INVERTER IS EQUIPPED WITH GROUND FAULT PROTECTION AND A GFI FUSE PORT FOR GROUND FAULT INDICATION.
10. PV MODULE FRAMES SHALL BE BONDED TO RACKING RAIL OR BARE COPPER GEC/GEC PER THE MODULE MANUFACTURER'S LISTED INSTRUCTION SHEET.
11. PV MODULE RACKING RAIL SHALL BE BONDED TO BARE COPPER GEC VIA WEEB LUG, ILSCO GBL-4DBT LAY-IN LUG, OR EQUIVALENT LISTED LUG.
12. THE PHOTOVOLTAIC INVERTER WILL BE LISTED AS UL 1741 COMPLIANT.
13. RACKING AND BONDING SYSTEM TO BE UL2703 RATED.
14. ANY REQUIRED GROUNDING ELECTRODE CONDUCTOR WILL BE CONTINUOUS, EXCEPT FOR SPLICES OR JOINTS AS BUS BARS WITHIN LISTED EQUIPMENT.
15. WHEN BACKFED BREAKER IS THE METHOD OF UTILITY INTERCONNECTION, THE BREAKERS SHALL NOT READ "LINE AND LOAD".
16. WHEN APPLYING THE 120% RULE, THE SOLAR BREAKER TO BE POSITIONED AT THE OPPOSITE END OF THE BUS BAR FROM THE MAIN BREAKER.
17. THE WORKING CLEARANCE AROUND THE EXISTING ELECTRICAL EQUIPMENT AS WELL AS THE NEW ELECTRICAL EQUIPMENT WILL BE MAINTAINED.

SCOTT E WYSSLING
LICENSE
No. 81551
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SHEET INDEX:

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

COVER PAGE

DATE: 2/28/2023
DRAWN BY: SN

REV #1:
REV #2:
REV #3:

PV-1

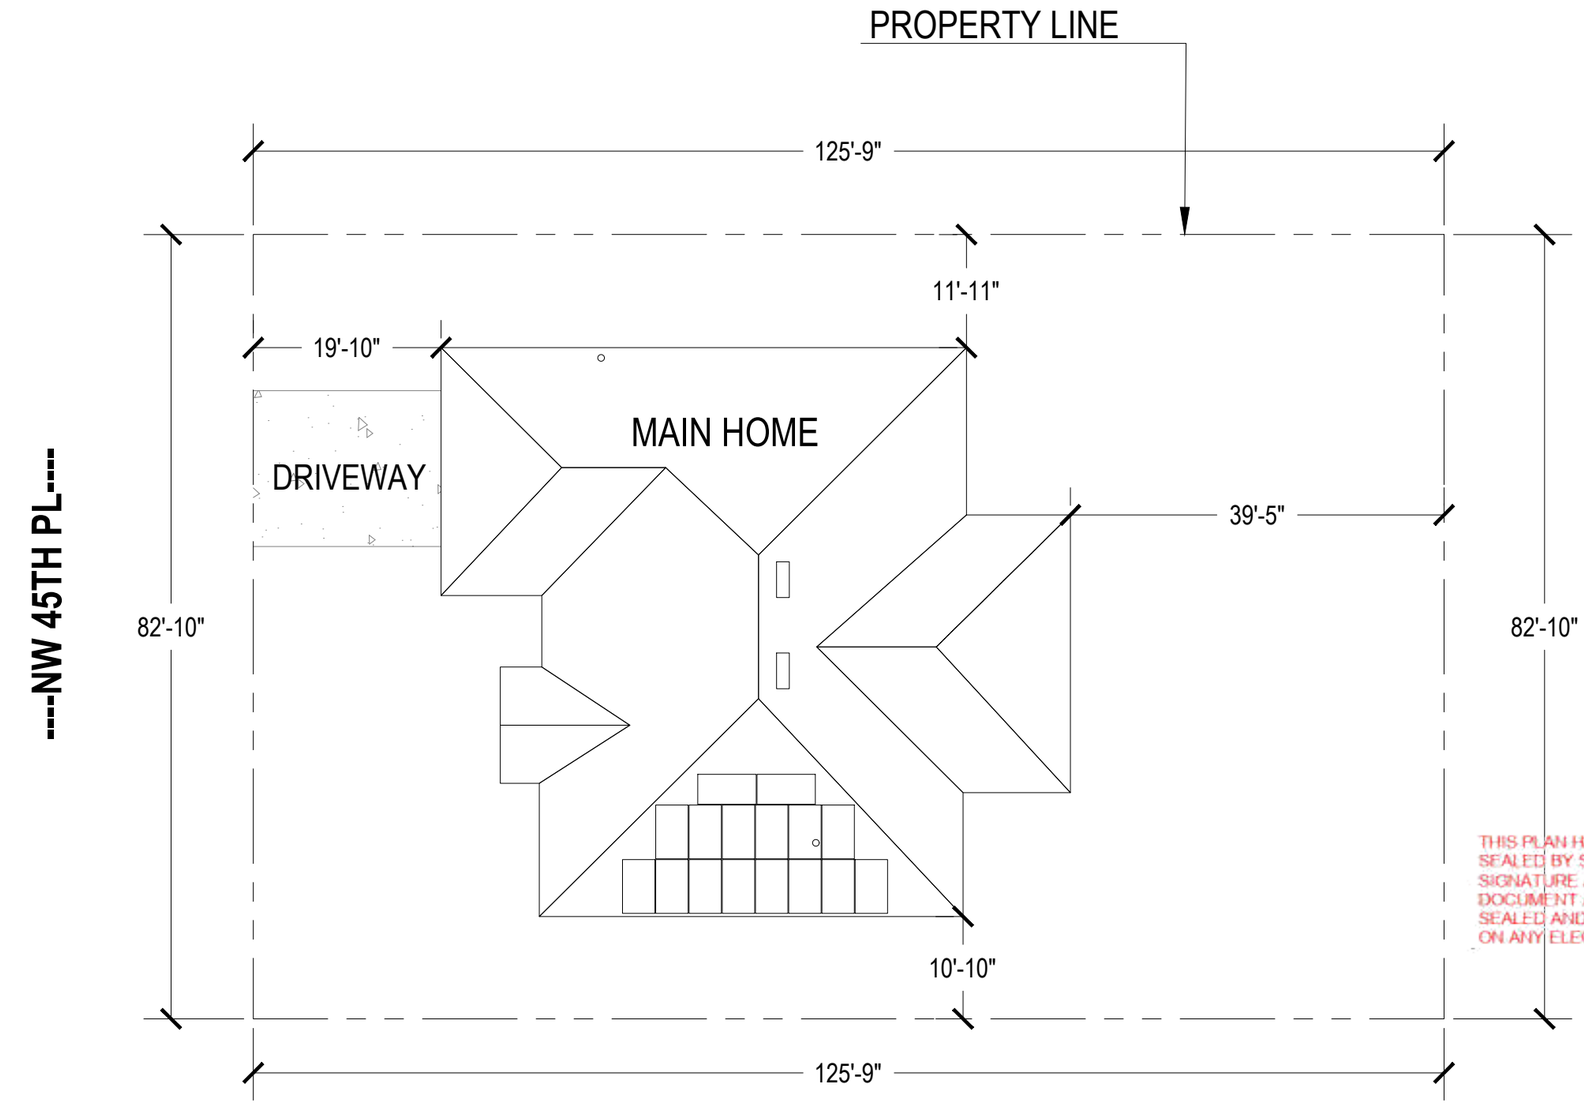

N

LEGEND:

PROPERTY LINE: ——— – – ———

DRIVEWAY: – — — — — — — — — —

APN: 254322C105189.0210

SCOTT E WYSSLING LICENSE No. 81555 STATE OF FLORIDA PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SCALE: 1/16" = 1'-0"

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors

BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

PROPERTY PLAN

DATE: 2/28/2023
DRAWN BY: SN

PV-2

ROOF DETAIL

ROOF TYPE: ASPHALT SHINGLE

ROOF SECTION 1: 16 MODULES
AZIMUTH: 180°
PITCH: 23°

1

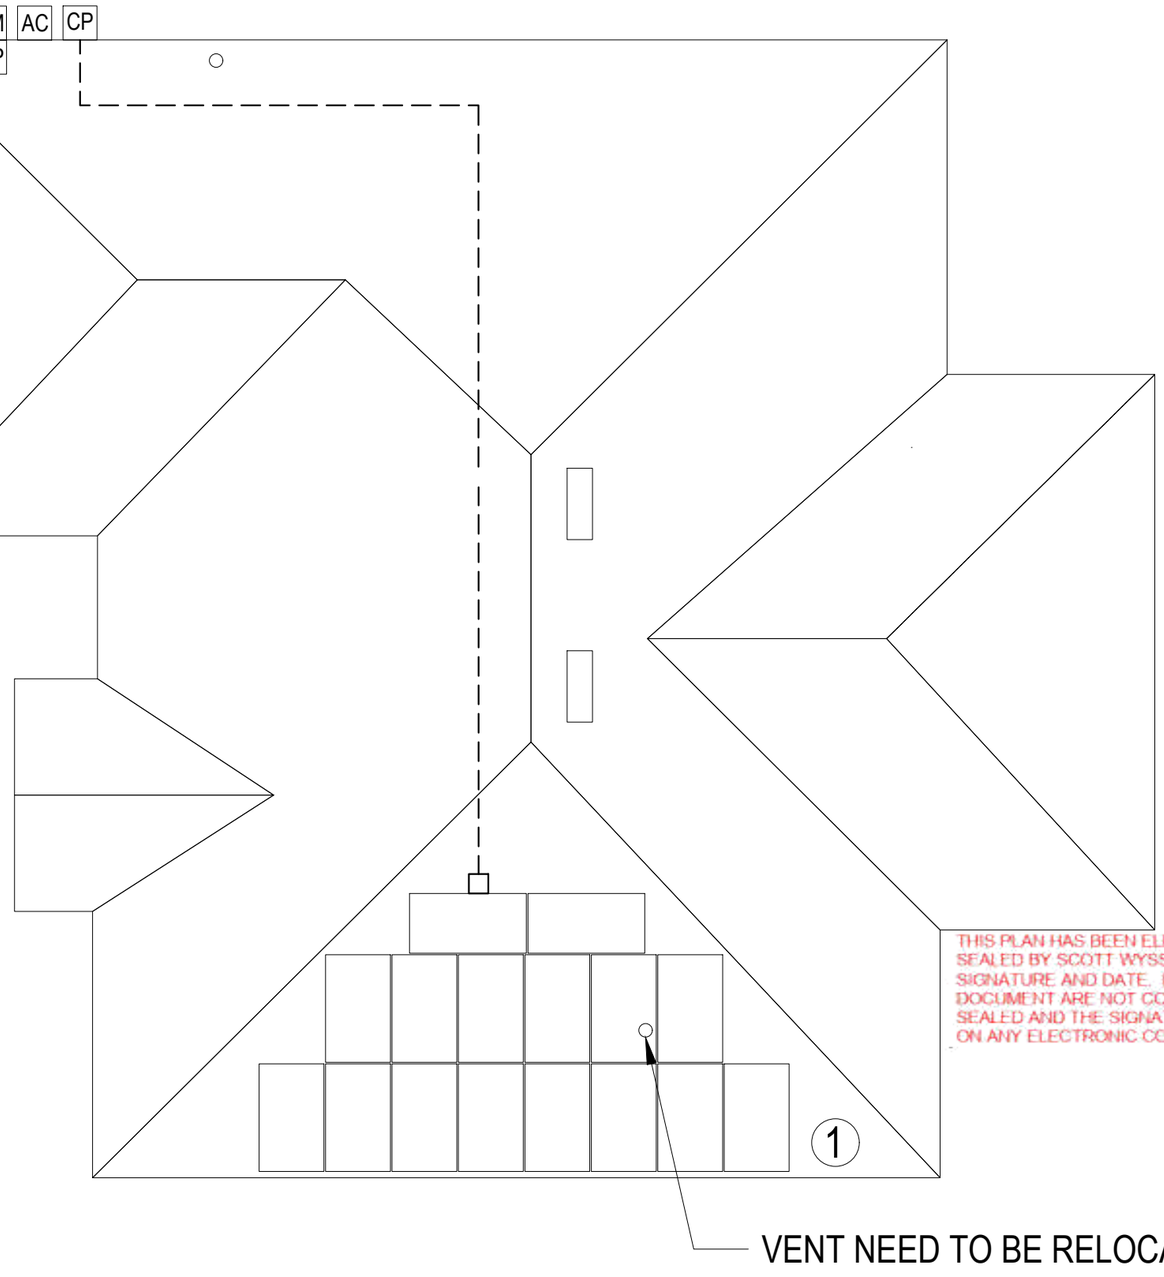

N

SYSTEM LEGEND

PHOTOVOLTAIC SYSTEM:
DC SYSTEM SIZE: 6.40 kW
AC SYSTEM SIZE: 3.84 kW

UM	MAIN SERVICE METER AND SERVICE POINT
MP	MAIN SERVICE PANEL
AC	UTILITY AC DISCONNECT
CP	ENPHASE IQ COMBINER BOX W/ MONITORING (X-IQ-AM1-240-4)
	(16) Q.PEAK DUO BLK ML-G10+ [400W] WITH (18) ENPHASE IQ8-60-2-US [240V] MICROINVERTERS MOUNTED UNDER EACH MODULE.
	JUNCTION BOX AND CONDUIT

CONDUIT RUN
CONDUIT TO BE RUN IN ATTIC IF POSSIBLE, OTHERWISE CONDUIT BLOCKS MIN. 1"/MAX 6" ABOVE ROOF SURFACE, CLOSE TO RIDGE LINES, AND UNDER EAVES; TO BE PAINTED TO MATCH EXTERIOR/EXISTING BACKGROUND COLOR OF ITS LOCATION; TO BE LABELED AT MAX 10' INTERVALS. CONDUIT RUNS ARE APPROXIMATE AND ARE TO BE DETERMINED IN THE BY THE INSTALLERS.

SCOTT E WYSSLING
LICENSE
No. 81558
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

SCALE: 1/8" = 1'-0"

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

SITE PLAN

DATE: 2/28/2023
DRAWN BY: SN

PV-3

ROOF DETAIL

ROOF TYPE: ASPHALT SHINGLE

ROOF SECTION 1: 16 MODULES
AZIMUTH: 180°
PITCH: 23°

1

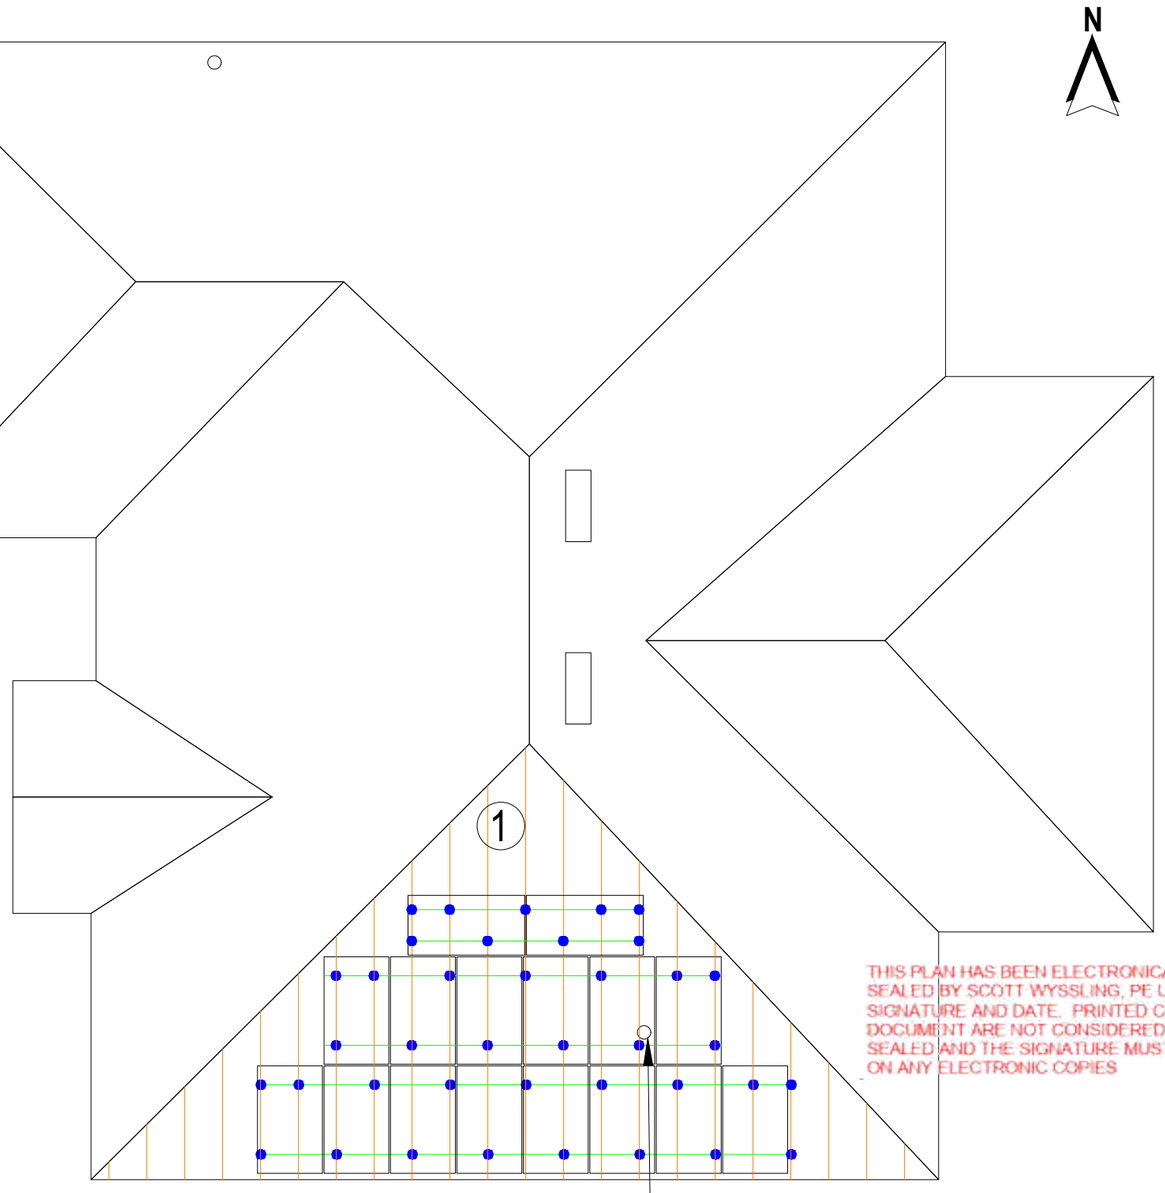

VENT NEED TO BE RELOCATED

MODULE MECHANICAL SPECIFICATIONS	
DESIGN WIND SPEED	160 MPH
DESIGN SNOW LOAD	0 PSF
# OF STORIES	1
ROOF PITCH	23°
TOTAL ARRAY AREA (SQ. FT)	345.92
TOTAL ROOF AREA (SQ. FT)	2950
ARRAY SQ. FT / TOTAL ROOF SQ. FT	11.73%

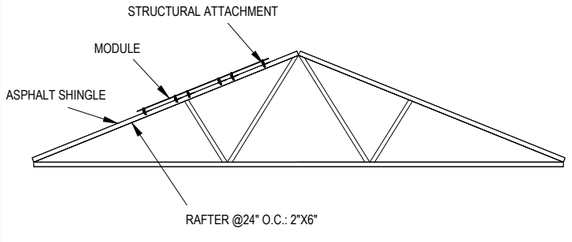

NTS

ELEVATION DETAIL

SYSTEM LEGEND

- ROOF ATTACHMENT POINT
- ROOF FRAMING (RAFTERS/TRUSS)
- RACKING
- FIRE CODE SETBACK (18" MIN. / 36" MAX.)

SCOTT E WYSSLING
LICENSE
No. 81558
STATE OF FLORIDA
PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

SCALE: 1/8" = 1'-0"

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

ROOF PLAN

DATE: 2/28/2023
DRAWN BY: SN

PV-3.1

CONDUCTOR AND CONDUIT SCHEDULE					
TAG	WIRE TYPE	WIRE SIZE	# OF CONDUCTORS	CONDUIT TYPE	MIN. CONDUIT SIZE
1	ENPHASE Q - CABLE	#12	2 - L1 L2	FREE AIR	N/A
1	BARE COPPER	#6	1 - BARE	FREE AIR	N/A
2	THWN-2	#10	2 - L1 L2	EMT	3/4"
2	THWN-2 EGC	#8	1 - GND	EMT	3/4"
3	THWN-2	#10	3 - L1 L2 N	EMT	3/4"
3	THWN-2 EGC	#8	1 - GND	EMT	3/4"

THE ENPHASE IQ8-60-2-US [240V] MICRO-INVERTERS HAVE INTEGRATED GROUND AND DOUBLE INSULATION, SO NO GEC OR EGC IS REQUIRED. THE DC CIRCUIT IS ISOLATED AND INSULATED FROM GROUND AND MEETS THE REQUIREMENTS OF NEC 690.35

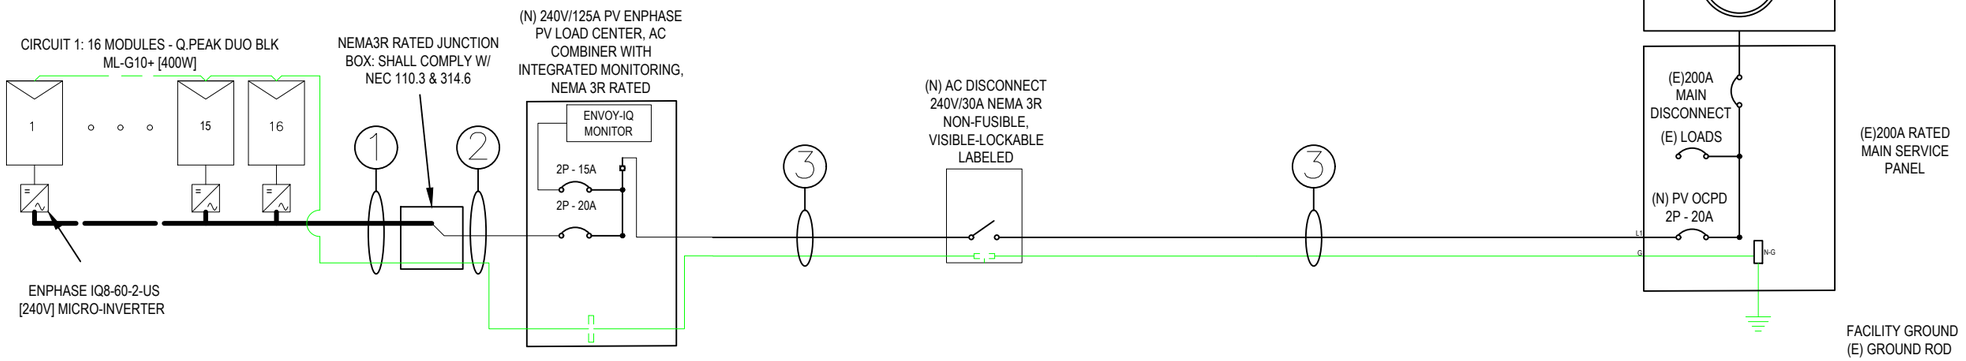

PHOTOVOLTAIC SYSTEM:
DC SYSTEM SIZE: 6.400 kW
AC SYSTEM SIZE: 3.84 kW
INVERTER: (16) ENPHASE IQ8-60-2-US [240V]
MODULE: (16) Q.PEAK DUO BLK ML-G10+ [400W]

NOTES:
1. MODULES ARE BONDED TO RAIL USING UL 2703 RATED BONDING SYSTEM - INTEGRATED BONDING MID-CLAMPS + DIRECT-BURIAL LAY-IN-LUGS; SEE ATTACHED FOR SPECIFICATIONS IF APPLICABLE
2. PV DC SYSTEM IS UNGROUNDED
3. PV ARRAY WILL HAVE A GROUNDING ELECTRODE SYSTEM IN COMPLIANCE WITH NEC 250.58 AND 690.47(A)
4. PV SOURCE, OUTPUT, AND INVERTER INPUT CIRCUIT WIRING METHODS SHALL COMPLY WITH NEC 690.1(G)
5. BACKFED PV BREAKER WILL BE INSTALLED AT OPPOSITE END OF THE BUS BAR FROM THE MAIN BREAKER. A PERMANENT WARNING LABEL TO BE INSTALLED PER SYSTEM SIGNAGE, PAGE
6. BARE COPPER IS TRANSITIONED TO THWN-2 VIA IRREVERSIBLE CRIMP; WHEN PRESENT, THE GEC TO BE CONTINUOUS
7. INVERTER(S) TO BE COMPLIANT WITH UL 1741 SUPPLEMENT A
8. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UP-SIZING AS REQUIRED BY FIELD CONDITIONS
9. CONDUIT AND CONDUCTOR SPECIFICATIONS ARE BASED ON MINIMUM CODE REQUIREMENTS AND ARE NOT MEANT TO LIMIT UPSIZING AS REQUIRED BY FIELD CONDITIONS.

SCOTT E WYSSLING LICENSE No. 81558 STATE OF FLORIDA PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

PV MODULE ELECTRICAL SPECIFICATIONS	
MODULE TYPE	Q.PEAK DUO BLK ML-G10+ [400W]
POWER MAX (P_{MAX})	370W
OPEN CIRCUIT VOLTAGE (V_{OC})	45.30V
SHORT CIRCUIT CURRENT (I_{SC})	11.14A
MAX POWER-POINT VOLTAGE (V_{MP})	37.13V
MAX POWER-POINT CURRENT (I_{MP})	10.77A
SERIES FUSE RATING	20A

INVERTER ELECTRICAL SPECIFICATIONS	
INVERTER TYPE	ENPHASE IQ8-60-2-US
MAX INPUT DC VOLTAGE	48V
MAX DC SHORT CIRCUIT CURRENT	15A
MAXIMUM OUTPUT POWER	240W
MAXIMUM CONT. OUTPUT CURRENT	1A
CEC EFFICIENCY	97%
MAX UNITS PER 20A CIRCUIT	16

SYSTEM OVER-CURRENT PROTECTION DEVICE (OCPD) CALCULATIONS	
INVERTER TYPE	ENPHASE IQ8-60-2-US
# OF INVERTERS	16
MAX CONTINUOUS OUTPUT CURRENT	1.0A
(# OF INVERTERS) X (MAX CONT. OUTPUT CURRENT) X 125% <= OCPD RATING	
(16 x 1A x 1.25)= 20.00A <= 20A, OK	

BUSBAR CALCULATIONS - PV BREAKER - 120% RULE	
MAIN BUS RATING	200
MAIN DISCONNECT RATING	200
PV BREAKER RATING	20
(MAIN BUS RATING x 1.2) - MAIN DISCONNECT RATING >= OCPD RATING	
(200A x 1.2) - 200A >= 20A, OK	

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

1-LINE DIAGRAM & CALCULATIONS

DATE: 2/28/2023
DRAWN BY: SN

PV-4

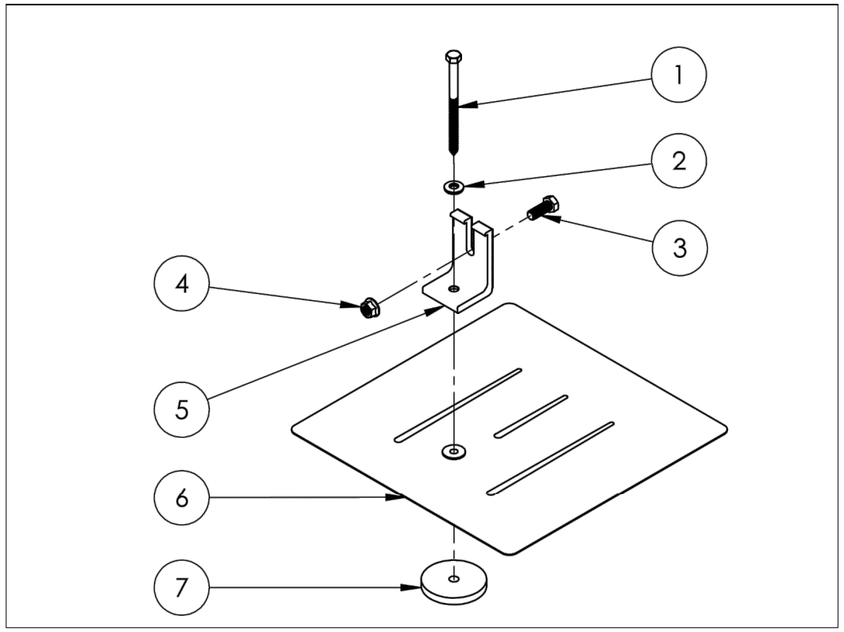

1 ATTACHMENT DETAILS
(N.T.S.)

ATTACHMENT TYPE: IRONRIDGE FLASHFOOT BLACK
WITH XR 100 BLACK RAILS
ROOF TYPE: ASPHALT SHINGLE , ROOF TILT: 23°

MODULE WEIGHT: 48.5 LBS
MODULE DIMENSIONS: 6.16' X 3.43'
MODULE WEIGHT/ SQ. FOOT: 2.29 LBS

TOTAL NO. OF MODULES: 16
TOTAL MODULE WEIGHT: 776 LBS

BILL OF MATERIAL		
EQUIPMENT	**MAKE**	**QUANTITY**
MODULE	Q.PEAK DUO BLK ML-G10+ [400W]	16
INVERTER	ENPHASE IQ8-60-2-US [240V]	16
END CLAMPS	MODULE END CLAMP STANDARD	12
MID CLAMPS	MODULE MIDDLE CLAMP SET STANDARD(INTEGRATED GROUNDING)	26
MOUNTING POINTS	IRONRIDGE FLASHFOOT BLACK	39
MOUNTING RAILS	XR 100 BLACK RAILS	12
UTILITY AC DISCONNECT	PV SYSTEM UTILITY AC DISCONNECT 30A RATED	1
COMBINER BOX	240V/125A PV ENPHASE PV LOAD CENTER, AC COMBINER WITH INTEGRATED MONITORING, NEMA 3R RATED	1
PV BREAKER	20A/2P	1

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

MOUNTING DETAILS AND BOM

DATE: 2/28/2023
DRAWN BY: SN

PV-5

SOLAR PV SYSTEM EQUIPPED WITH RAPID SHUTDOWN

TURN RAPID SHUTDOWN SWITCH TO THE "OFF" POSITION TO SHUTDOWN PV SYSTEM AND REDUCE SHOCK HAZARD IN ARRAY



LABEL 1
AT RAPID SHUTDOWN SYSTEM
[NEC 690.56(C)(1)(A)].

! WARNING !
ELECTRIC SHOCK HAZARD
TERMINALS ON THE LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION.
DC VOLTAGE IS ALWAYS PRESENT WHEN SOLAR MODULES ARE EXPOSED TO SUNLIGHT

LABEL 2
AT EACH DISCONNECTING MEANS FOR PHOTOVOLTAIC EQUIPMENT
[NEC 690.15]

! WARNING !
ELECTRIC SHOCK HAZARD
TERMINALS ON BOTH LINE AND LOAD SIDES MAY BE ENERGIZED IN THE OPEN POSITION.

LABEL 3
AT EACH DISCONNECTING MEANS FOR PHOTOVOLTAIC EQUIPMENT
[NEC 690.13 AND 690.15]

MAXIMUM VOLTAGE: 480 V DC
MAXIMUM CIRCUIT CURRENT: 27 A DC
MAX RATED OUTPUT CURRENT OF THE CHARGE CONTROLLER OR DC-TO-DC CONVERTER (IF INSTALLED): 27 A DC

LABEL 4
AT EACH DC DISCONNECTING MEANS
[NEC 690.53]

PHOTOVOLTAIC AC DISCONNECT
OPERATING CURRENT: 16 A AC
OPERATING VOLTAGE: 240 V AC

LABEL 5
AT POINT OF INTERCONNECTION, MARKED AT DISCONNECTING MEANS
[NEC 690.54]

RAPID SHUTDOWN SWITCH FOR SOLAR PV SYSTEM

LABEL 6
AT RAPID SHUTDOWN DISCONNECT SWITCH
[NEC 690.56(C)(3)].

! WARNING !
DUAL POWER SOURCES.
SECOND SOURCE IS PV SYSTEM

LABEL 7

! CAUTION !
PHOTOVOLTAIC SYSTEM CIRCUIT IS BACKFED

LABEL 8

AT POINT OF INTERCONNECTION; LABEL, SUCH AS LABEL 7 OR LABEL 8 MUST IDENTIFY PHOTOVOLTAIC SYSTEM
[NEC 705.12(B)(4)]

BI-DIRECTIONAL METER

LABEL 9
AT UTILITY METER
[NEC 690.56(B)]

PHOTOVOLTAIC DC DISCONNECT

LABEL 10
AT EACH DC DISCONNECTING MEANS
[NEC 690.13(B)]

PHOTOVOLTAIC SYSTEM EQUIPPED WITH RAPID SHUTDOWN

LABEL 11
AT RAPID SHUTDOWN SWITCH
[NEC 690.56(C)].
LETTERS AT LEAST 3/8 INCH; WHITE ON RED BACKGROUND; REFLECTIVE
[IFC 605.11.1.1]

WARNING: PHOTOVOLTAIC POWER SOURCE

LABEL 12
AT EXPOSED RACEWAYS, CABLE TRAYS, AND OTHER WIRING METHODS; SPACED AT MAXIMUM 10 FT SECTION OR WHERE SEPARATED BY ENCLOSURES, WALLS, PARTITIONS, CEILINGS, OR FLOORS.
[NEC 690.31(G)]
LETTERS AT LEAST 3/8 INCH; WHITE ON RED BACKGROUND; REFLECTIVE
[IFC 605.11.1.1]

UTILITY AC DISCONNECT

LABEL 13
AT EACH AC DISCONNECTING MEANS
[NEC 690.13(B)]

! WARNING !
POWER SOURCE OUTPUT CONNECTION - DO NOT RELOCATE THIS OVERCURRENT DEVICE

LABEL 14
AT POINT OF INTERCONNECTION OVERCURRENT DEVICE
[NEC 705.12(B)(2)(3)(B)]

#03-359 LOCAL CODES

WARNING
THIS SERVICE METER IS ALSO SERVED BY A PHOTOVOLTAIC SYSTEM

ALL SIGNAGE MUST BE PERMANENTLY ATTACHED AND BE WEATHER RESISTANT/SUNLIGHT RESISTANT AND CANNOT BE HAND-WRITTEN PER NEC 110.21(B)

PERMANENT PLAQUE OR DIRECTORY PROVIDING THE LOCATION OF THE SERVICE DISCONNECTING MEANS AND THE PHOTOVOLTAIC SYSTEM DISCONNECTING MEANS IF NOT IN THE SAME LOCATION
[NEC 690.56(B)]

WHERE THE PV SYSTEMS ARE REMOTELY LOCATED FROM EACH OTHER, A DIRECTORY IN ACCORDANCE WITH 705.10 SHALL BE PROVIDED AT EACH PV SYSTEM DISCONNECTING MEANS.
PV SYSTEM EQUIPMENT AND DISCONNECTING MEANS SHALL NOT BE INSTALLED IN BATHROOMS
[NEC 690.4(D),(E)]

LABELING NOTES
1.1 LABELING REQUIREMENTS BASED ON THE 2017 NATIONAL ELECTRICAL CODE, INTERNATIONAL FIRE CODE 605.11, OSHA STANDARD 1910.145, ANSI Z535
1.2 MATERIAL BASED ON THE REQUIREMENTS OF THE AUTHORITY HAVING JURISDICTION.
1.3 LABELS TO BE OF SUFFICIENT DURABILITY TO WITHSTAND THE ENVIRONMENT INVOLVED.
1.4 LABELS TO BE A MINIMUM LETTER HEIGHT OF 3/8" AND PERMANENTLY AFFIXED.
1.5 ALERTING WORDS TO BE COLOR CODED. "DANGER" WILL HAVE RED BACKGROUND; "WARNING" WILL HAVE ORANGE BACKGROUND; "CAUTION" WILL HAVE YELLOW BACKGROUND. [ANSI Z535]

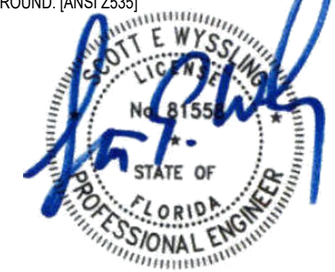

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

LABELS ARE NOT DRAWN TO SCALE

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

ELECTRICAL LABELS & ELEVATION

DATE: 2/28/2023
DRAWN BY: SN

PV-6

CIRCUIT DETAIL
ENPHASE CIRCUITS
CIRCUIT # 1: 16 MODULES

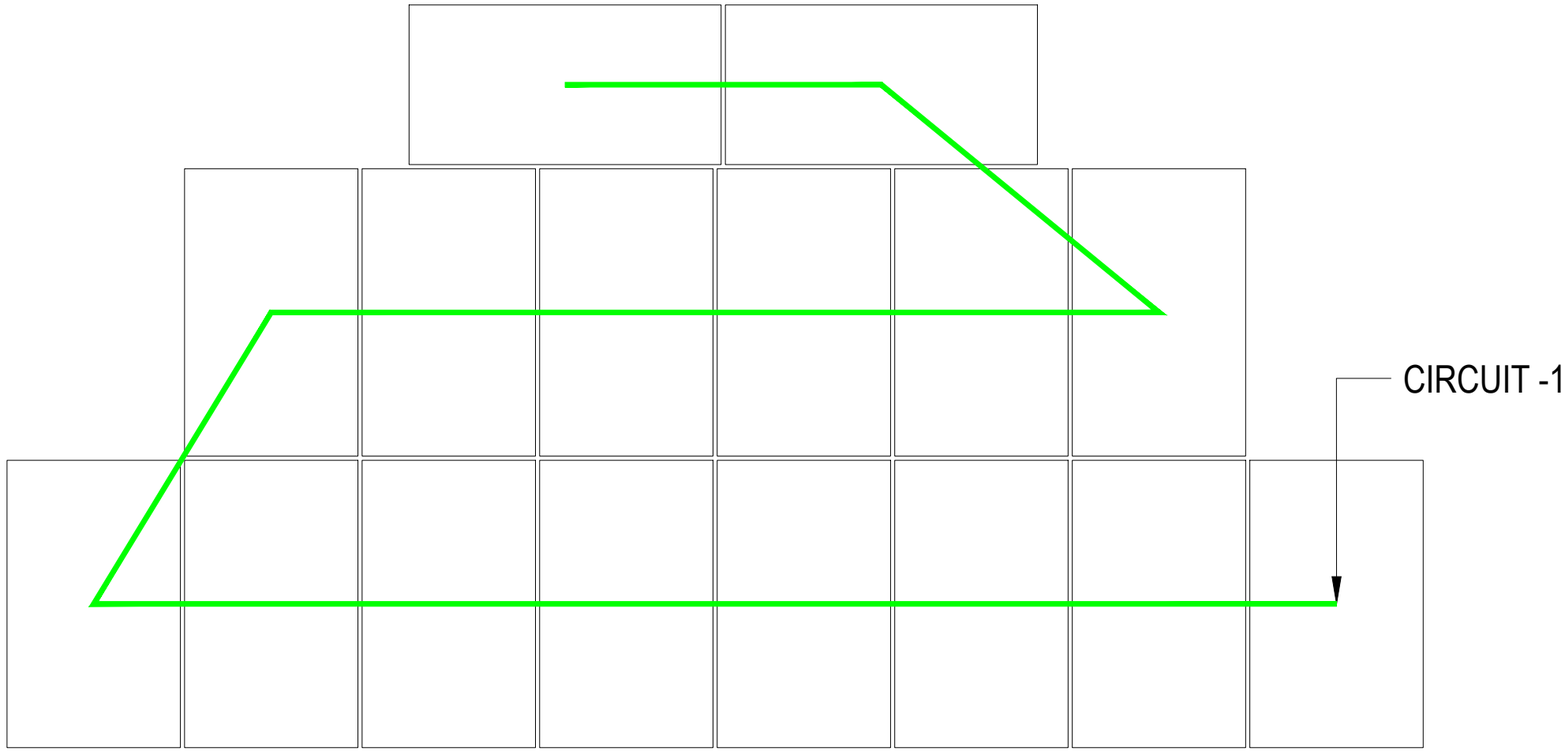

FOR INSTALLER USE ONLY

THIS PLAN HAS BEEN ELECTRONICALLY SIGNED AND SEALED BY SCOTT WYSSLING, PE USING A DIGITAL SIGNATURE AND DATE. PRINTED COPIES OF THIS DOCUMENT ARE NOT CONSIDERED SIGNED AND SEALED AND THE SIGNATURE MUST BE VERIFIED ON ANY ELECTRONIC COPIES

SCOTT E WYSSLING
LICENSE
No. 81558
STATE OF
FLORIDA
PROFESSIONAL ENGINEER

Wyssling Consulting, PLLC
76 N Meadowbrook Drive Alpine UT 84004
Florida License # RY34912

Signed 3/1/2023

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors

BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

OPTIMIZER & STRING MAP

DATE: 2/28/2023
DRAWN BY: SN

PV-7

powered by Q.ANTUM DUO Z

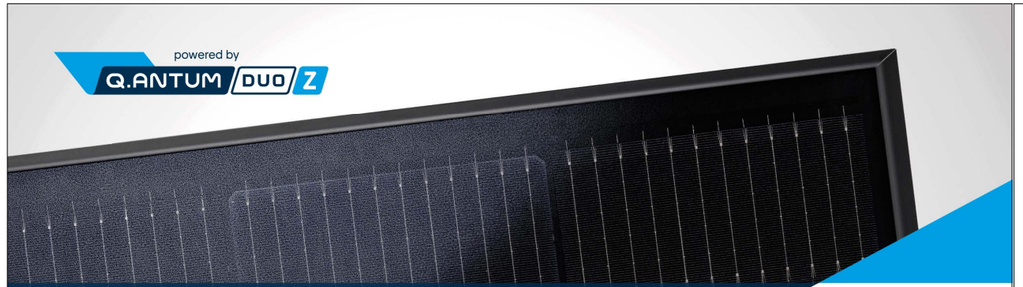

Q.PEAK DUO BLK ML-G10+

385-405

ENDURING HIGH PERFORMANCE

25 YR Warranty Product & Performance

EUPD RESEARCH TOP BRAND PV MODULES EUROPE 2021

Q CELLS Yield Security

BREAKING THE 20% EFFICIENCY BARRIER

Q.ANTUM DUO Z Technology with zero gap cell layout boosts module efficiency up to 20.9%.

THE MOST THOROUGH TESTING PROGRAMME IN THE INDUSTRY

Q CELLS is the first solar module manufacturer to pass the most comprehensive quality programme in the industry: The new "Quality Controlled PV" of the independent certification institute TÜV Rheinland.

INNOVATIVE ALL-WEATHER TECHNOLOGY

Optimal yields, whatever the weather with excellent low-light and temperature behavior.

ENDURING HIGH PERFORMANCE

Long-term yield security with Anti LID Technology, Anti PID Technology[1], Hot-Spot Protect and Traceable Quality Tra.Q™.

EXTREME WEATHER RATING

High-tech aluminum alloy frame, certified for high snow (5400 Pa) and wind loads (4000 Pa).

A RELIABLE INVESTMENT

Inclusive 25-year product warranty and 25-year linear performance warranty[2].

[1] APT test conditions according to IEC / TS 62804-1:2015, method A (–1500 V, 96 h)
[2] See data sheet on rear for further information.

THE IDEAL SOLUTION FOR:

Rooftop arrays on residential buildings

Engineered in Germany

Q CELLS

MECHANICAL SPECIFICATION

Format	74.0 in × 41.1 in × 1.26 in (including frame) (1879 mm × 1045 mm × 32 mm)
Weight	48.5 lbs (22.0 kg)
Front Cover	0.13 in (3.2 mm) thermally pre-stressed glass with anti-reflection technology
Back Cover	Composite film
Frame	Black anodized aluminum
Cell	6 × 22 monocrystalline Q.ANTUM solar half cells
Junction Box	2.09–3.98 in × 1.26–2.36 in × 0.59–0.71 in (53–101 mm × 32–60 mm × 15–18 mm), IP67, with bypass diodes
Cable	4 mm² Solar cable; (+) ≥49.2 in (1250 mm), (–) ≥49.2 in (1250 mm)
Connector	Stäubli MC4; IP68

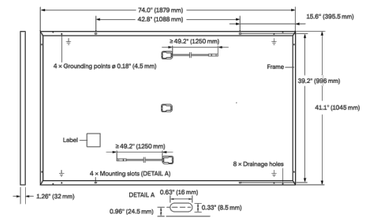

ELECTRICAL CHARACTERISTICS

POWER CLASS				385	390	395	400	405
MINIMUM PERFORMANCE AT STANDARD TEST CONDITIONS, STC[1] (POWER TOLERANCE +5 W / –0 W)								
Minimum	Power at MPP[1]	P_{MPP}	[W]	385	390	395	400	405
	Short Circuit Current[1]	I_{SC}	[A]	11.04	11.07	11.10	11.14	11.17
	Open Circuit Voltage[1]	V_{OC}	[V]	45.19	45.23	45.27	45.30	45.34
	Current at MPP	I_{MPP}	[A]	10.59	10.65	10.71	10.77	10.83
	Voltage at MPP	V_{MPP}	[V]	36.36	36.62	36.88	37.13	37.39
	Efficiency[1]	η	[%]	≥19.6	≥19.9	≥20.1	≥20.4	≥20.6
MINIMUM PERFORMANCE AT NORMAL OPERATING CONDITIONS, NMOT[2]								
Minimum	Power at MPP	P_{MPP}	[W]	288.8	292.6	296.3	300.1	303.8
	Short Circuit Current	I_{SC}	[A]	8.90	8.92	8.95	8.97	9.00
	Open Circuit Voltage	V_{OC}	[V]	42.62	42.65	42.69	42.72	42.76
	Current at MPP	I_{MPP}	[A]	8.35	8.41	8.46	8.51	8.57
	Voltage at MPP	V_{MPP}	[V]	34.59	34.81	35.03	35.25	35.46

[1] Measurement tolerances P_{MPP} ±3%; I_{SC}; V_{OC} ±5% at STC: 1000 W/m², 25±2 °C, AM 1.5 according to IEC 60904-3 • [2] 800 W/m², NMOT, spectrum AM 1.5

Q CELLS PERFORMANCE WARRANTY

At least 98% of nominal power during first year. Thereafter max. 0.5% degradation per year. At least 93.5% of nominal power up to 10 years. At least 86% of nominal power up to 25 years.

All data within measurement tolerances. Full warranties in accordance with the warranty terms of the Q CELLS sales organisation of your respective country.

PERFORMANCE AT LOW IRRADIANCE

Typical module performance under low irradiance conditions in comparison to STC conditions (25 °C, 1000 W/m²)

TEMPERATURE COEFFICIENTS							
Temperature Coefficient of I_{SC}	α	[%/K]	+0.04	Temperature Coefficient of V_{OC}	β	[%/K]	–0.27
Temperature Coefficient of P_{MPP}	γ	[%/K]	–0.34	Nominal Module Operating Temperature	NMOT	[°F]	109±5.4 (43±3 °C)

PROPERTIES FOR SYSTEM DESIGN

Maximum System Voltage V_{SYS}	[V]	1000 (IEC) / 1000 (UL)	PV module classification	Class II
Maximum Series Fuse Rating	[A DC]	20	Fire Rating based on ANSI / UL 61730	TYPE 2
Max. Design Load, Push / Pull[3]	[lbs/ft²]	75 (3600 Pa) / 55 (2660 Pa)	Permitted Module Temperature on Continuous Duty	–40 °F up to +185 °F (–40 °C up to +85 °C)
Max. Test Load, Push / Pull[3]	[lbs/ft²]	113 (5400 Pa) / 84 (4000 Pa)		

[3] See Installation Manual

QUALIFICATIONS AND CERTIFICATES

UL 61730, CE-compliant, Quality Controlled PV - TÜV Rheinland, IEC 61215:2016, IEC 61730:2016, U.S. Patent No. 9,893,215 (solar cells), QCPV Certification ongoing.

PACKAGING INFORMATION

Horizontal packaging	76.4 in 1940 mm	43.3 in 1100 mm	48.0 in 1220 mm	1656 lbs 751 kg	24 pallets	24 pallets	32 modules

Note: Installation instructions must be followed. See the installation and operating manual or contact our technical service department for further information on approved installation and use of this product.

Hanwha Q CELLS America Inc.
400 Spectrum Center Drive, Suite 1400, Irvine, CA 92618, USA | **TEL** +1 949 748 59 96 | **EMAIL** inquiry@us.q-cells.com | **WEB** www.q-cells.us

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors

BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

MODULE DATASHEET

DATE: 2/28/2023
DRAWN BY: SN

PV-8.1

ENPHASE

DATA SHEET

IQ8 and IQ8+ Microinverters

Our newest IQ8 Microinverters are the industry's first microgrid-forming, software defined microinverters with split-phase power conversion capability to convert DC power to AC power efficiently. The brain of the semiconductor-based microinverter is our proprietary application specific integrated circuit (ASIC) which enables the microinverter to operate in grid-tied or off-grid modes. This chip is built in advanced 55nm technology with high speed digital logic and has superfast response times to changing loads and grid events, alleviating constraints on battery sizing for home energy systems.

Part of the Enphase Energy System, IQ8 Series Microinverters integrate with the IQ Battery, IQ Gateway, and the Enphase App monitoring and analysis software.

Enphase 25 year limited warranty

IQ8 Series Microinverters redefine reliability standards with more than one million cumulative hours of power-on testing, enabling an industry-leading limited warranty of up to 25 years.

Connect PV modules quickly and easily to IQ8 Series Microinverters using the included Q-DCC-2 adapter cable with plug-n-play MC4 connectors.

UL CERTIFIED SAFETY

IQ8 Series Microinverters are UL listed as PV Rapid Shutdown Equipment and conform with various regulations, when installed according to manufacturer's instructions.

*Only when installed with IQ System Controller 2, meets UL 1741.
**IQ8 and IQ8Plus support split-phase, 240V installations only.

Easy to install

- Lightweight and compact with plug-n-play connectors
- Power Line Communication (PLC) between components
- Faster installation with simple two-wire cabling

High productivity and reliability

- Produce power even when the grid is down*
- More than one million cumulative hours of testing
- Class II double-insulated enclosure
- Optimized for the latest high-powered PV modules

Microgrid-forming

- Complies with the latest advanced grid support**
- Remote automatic updates for the latest grid requirements
- Configurable to support a wide range of grid profiles
- Meets CA Rule 21 (UL 1741-SA) and IEEE 1547:2018 (UL 1741-SB)

Note:

IQ8 Microinverters cannot be mixed together with previous generations of Enphase microinverters (IQ7 Series, IQ6 Series, etc) in the same system.

IQ8 and IQ8+ Microinverters

INPUT DATA (DC)		IQ8-60-2-US	IQ8PLUS-72-2-US
Commonly used module pairings[1]	W	235 – 350	235 – 440
Module compatibility		60-cell / 120 half-cell	54-cell / 108 half-cell, 60-cell / 120 half-cell, 66-cell / 132 half-cell and 72-cell / 144 half-cell
MPPT voltage range	V	27 – 37	27 – 45
Operating range	V	16 – 48	16 – 58
Min. / Max. start voltage	V	22 / 48	22 / 58
Max. input DC voltage	V	50	60
Max. continuous input DC current	A	10	12
Max. input DC short-circuit current	A	25	
Max. module I_{sc}	A	20	
Overvoltage class DC port		II	
DC port backfeed current	mA	0	
PV array configuration		1 x 1 Ungrounded array; No additional DC side protection required; AC side protection requires max 20A per branch circuit	
OUTPUT DATA (AC)		**IQ8-60-2-US**	**IQ8PLUS-72-2-US**
Peak output power	VA	245	300
Max. continuous output power	VA	240	290
Nominal (L-L) voltage / range[2]	V	240 / 211 – 264	
Max. continuous output current	A	1.0	1.21
Nominal frequency	Hz	60	
Extended frequency range	Hz	47 – 68	
AC short circuit fault current over 3 cycles	Arms	2	
Max. units per 20 A (L-L) branch circuit[3]		16	13
Total harmonic distortion		<5%	
Overvoltage class AC port		III	
AC port backfeed current	mA	30	
Power factor setting		1.0	
Grid-tied power factor (adjustable)		0.85 leading – 0.85 lagging	
Peak efficiency	%	97.7	
CEC weighted efficiency	%	97	
Night-time power consumption	mW	60	
MECHANICAL DATA			
Ambient temperature range		-40°C to +60°C (-40°F to +140°F)	
Relative humidity range		4% to 100% (condensing)	
DC Connector type		MC4	
Dimensions (H x W x D)		212 mm (8.3") x 175 mm (6.9") x 30.2 mm (1.2")	
Weight		1.08 kg (2.38 lbs)	
Cooling		Natural convection – no fans	
Approved for wet locations		Yes	
Pollution degree		PD3	
Enclosure		Class II double-insulated, corrosion resistant polymeric enclosure	
Environ. category / UV exposure rating		NEMA Type 6 / outdoor	
COMPLIANCE			
Certifications		CA Rule 21 (UL 1741-SA), UL 62109-1, IEEE 1547:2018 (UL 1741-SB), FCC Part 15 Class B, ICES-0003 Class B, CAN / CSA-C22.2 NO. 107.1-01 This product is UL Listed as PV Rapid Shutdown Equipment and conforms with NEC 2014, NEC 2017, and NEC 2020 section 690.12 and C22.1-2018 Rule 64-218 Rapid Shutdown of PV Systems, for AC and DC conductors, when installed according to manufacturer's instructions.	

(1) Pairing PV modules with wattage above the limit may result in additional clipping losses. See the compatibility calculator at https://link.enphase.com/module-compatibility. (2) Nominal voltage range can be extended beyond nominal if required by the utility. (3) Limits may vary. Refer to local requirements to define the number of microinverters per branch in your area.

IQ8SP-12A-DS-0067-02-EN-US-2022-12-02

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors

BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

INVERTER DATASHEET

DATE: 2/28/2023
DRAWN BY: SN

PV-8.2

Data Sheet
Enphase Networking

IQ Combiner 4/4C

The **IQ Combiner 4/4C** with IQ Gateway and integrated LTE-M1 cell modem (included only with IQ Combiner 4C) consolidates interconnection equipment into a single enclosure. It streamlines IQ Microinverters and storage installations by providing a consistent, pre-wired solution for residential applications. It offers up to four 2-pole input circuits and Eaton BR series busbar assembly.

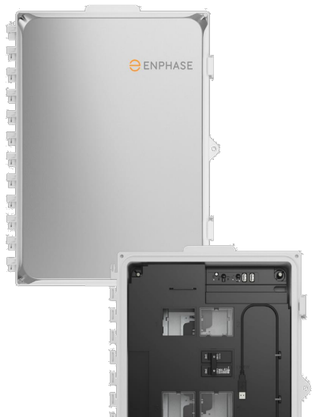

X-IQ-AM1-240-4C
X2-IQ-AM1-240-4C (IEEE 1547:2018)

X-IQ-AM1-240-4
X2-IQ-AM1-240-4 (IEEE 1547:2018)

Smart

- Includes IQ Gateway for communication and control
- Includes Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), included only with IQ Combiner 4C
- Includes solar shield to match Enphase IQ Battery aesthetics and deflect heat
- Supports Wi-Fi, Ethernet, or cellular connectivity
- Optional AC receptacle available for PLC bridge
- Provides production metering and consumption monitoring

Simple

- Mounts on single stud with centered brackets
- Supports bottom, back and side conduit entry
- Allows up to four 2-pole branch circuits for 240VAC plug-in breakers (not included)
- 80A total PV or storage branch circuits

Reliable

- Durable NRTL-certified NEMA type 3R enclosure
- Five-year limited warranty
- Two years labor reimbursement program coverage included for both the IQ Combiner SKU's
- UL listed
- X2-IQ-AM1-240-4 and X2-IQ-AM1-240-4C comply with IEEE 1547:2018 (UL 1741-SB, 3rd Ed.)

UL LISTED

To learn more about Enphase offerings, visit **enphase.com**
IQ-C-4-4C-DS-0103-EN-US-12-29-2022

ENPHASE.

IQ Combiner 4/4C

MODEL NUMBER	
IQ Combiner 4 X-IQ-AM1-240-4 X2-IQ-AM1-240-4 (IEEE 1547:2018)	IQ Combiner 4 with IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 ± 0.5%) and consumption monitoring (± 2.5%). Includes a silver solar shield to match the IQ Battery and IQ System Controller 2 and to deflect heat.
IQ Combiner 4C X-IQ-AM1-240-4C X2-IQ-AM1-240-4C (IEEE 1547:2018)	IQ Combiner 4C with IQ Gateway printed circuit board for integrated revenue grade PV production metering (ANSI C12.20 ± 0.5%) and consumption monitoring (± 2.5%). Includes Mobile Connect cellular modem (CELLMODEM-M1-06-SP-05), a plug-and-play industrial-grade cell modem for systems up to 60 microinverters. (Available in the US, Canada, Mexico, Puerto Rico, and the US Virgin Islands, where there is adequate cellular service in the installation area.) Includes a silver solar shield to match the IQ Battery and IQ System Controller and to deflect heat.
ACCESSORIES AND REPLACEMENT PARTS	(not included, order separately)
Supported microinverters	IQ6, IQ7, and IQ8. (Do not mix IQ6/7 Microinverters with IQ8)
Communications Kit COMMS-CELLMODEM-M1-06 CELLMODEM-M1-06-SP-05 CELLMODEM-M1-06-AT-05	 - Includes COMMS-KIT-01 and CELLMODEM-M1-06-SP-05 with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year Sprint data plan - 4G based LTE-M1 cellular modem with 5-year AT&T data plan
Circuit Breakers BRK-10A-2-240V BRK-15A-2-240V BRK-20A-2P-240V BRK-15A-2P-240V-B BRK-20A-2P-240V-B	Supports Eaton BR210, BR215, BR220, BR230, BR240, BR250, and BR260 circuit breakers. Circuit breaker, 2 pole, 10A, Eaton BR210 Circuit breaker, 2 pole, 15A, Eaton BR215 Circuit breaker, 2 pole, 20A, Eaton BR220 Circuit breaker, 2 pole, 15A, Eaton BR215B with hold down kit support Circuit breaker, 2 pole, 20A, Eaton BR220B with hold down kit support
XA-SOLARSHIELD-ES	Replacement solar shield for IQ Combiner 4/4C
XA-PLUG-120-3	Accessory receptacle for Power Line Carrier in IQ Combiner 4/4C (required for EPLC-01)
X-IQ-NA-HD-125A	Hold-down kit for Eaton circuit breaker with screws
Consumption monitoring CT (CT-200-SPLIT/CT-200-CLAMP)	A pair of 200A split core current transformers
ELECTRICAL SPECIFICATIONS	
Rating	Continuous duty
System voltage	120/240VAC, 60 Hz
Eaton BR series busbar rating	125A
Max. continuous current rating	65A
Max. continuous current rating (input from PV/storage)	64A
Max. fuse/circuit rating (output)	90A
Branch circuits (solar and/or storage)	Up to four 2-pole Eaton BR series Distributed Generation (DG) breakers only (not included)
Max. total branch circuit breaker rating (input)	80A of distributed generation/95A with IQ Gateway breaker included
IQ Gateway breaker	10A or 15A rating GE/Siemens/Eaton included
Production metering CT	200A solid core pre-installed and wired to IQ Gateway
MECHANICAL DATA	
Dimensions (WxHxD)	37.5 cm x 49.5 cm x 16.8 cm (14.75 in x 19.5 in x 6.63 in). Height is 53.5 cm (21.06 in) with mounting brackets.
Weight	7.5 kg (16.5 lbs)
Ambient temperature range	-40°C to +46°C (-40°F to 115°F)
Cooling	Natural convection, plus heat shield
Enclosure environmental rating	Outdoor, NRTL-certified, NEMA type 3R, polycarbonate construction
Wire sizes	• 20A to 50A breaker inputs: 14 to 4 AWG copper conductors • 60A breaker branch input: 4 to 1/0 AWG copper conductors • Main lug combined output: 10 to 2/0 AWG copper conductors • Neutral and ground: 14 to 1/0 copper conductors • Always follow local code requirements for conductor sizing.
Altitude	Up to 3,000 meters (9,842 feet)
INTERNET CONNECTION OPTIONS	
Integrated Wi-Fi	IEEE 802.11b/g/n
Cellular	CELLMODEM-M1-06-SP-05, CELLMODEM-M1-06-AT-05 (4G based LTE-M1 cellular modem). Note that an Mobile Connect cellular modem is required for all Enphase Energy System installations.
Ethernet	Optional, IEEE 802.3, Cat5E (or Cat6) UTP Ethernet cable (not included)
COMPLIANCE	
Compliance, IQ Combiner	CA Rule 21 (UL 1741-SA) IEEE 1547:2018 - UL 1741-SB, 3rd Ed. (X2-IQ-AM1-240-4 and X2-IQ-AM1-240-4C) CAN/CSA C22.2 No. 107.1, Title 47 CFR, Part 15, Class B, ICES 003 Production metering: ANSI C12.20 accuracy class 0.5 (PV production) Consumption metering: accuracy class 2.5
Compliance, IQ Gateway	UL 60601-1/CANCSA 22.2 No. 61010-1

IQ-C-4-4C-DS-0103-EN-US-12-29-2022

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors

BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

OPTIMIZERS DATASHEET

DATE: 2/28/2023
DRAWN BY: SN

PV-8.3

Cut Sheet

IRONRIDGE

XR100 Bonded Splice

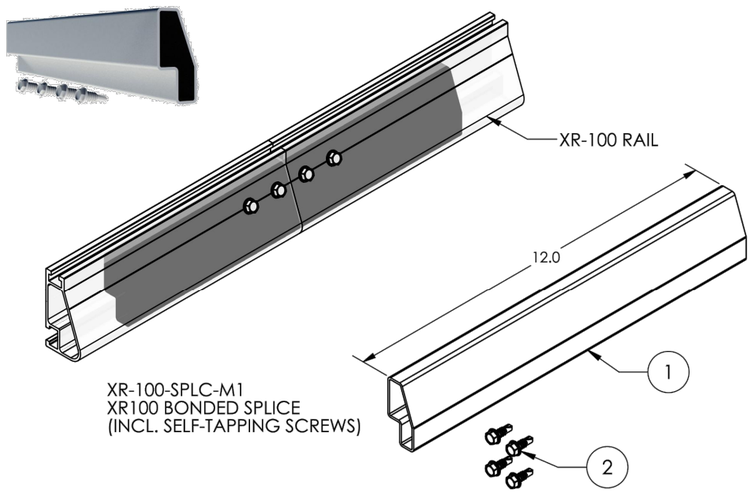

1) Splice, XR100, Mill 12" long



Property	Value
Material	6000 Series Aluminum
Finish	Mill

2) Screw, Self Drilling

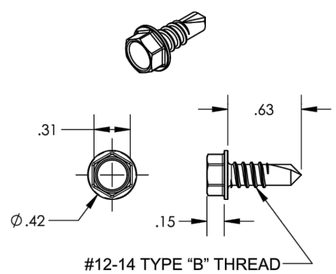

Property	Value
Material	300 Series Stainless Steel
Finish	Clear

v1.0

Cut Sheet

IRONRIDGE

XR100 Rail

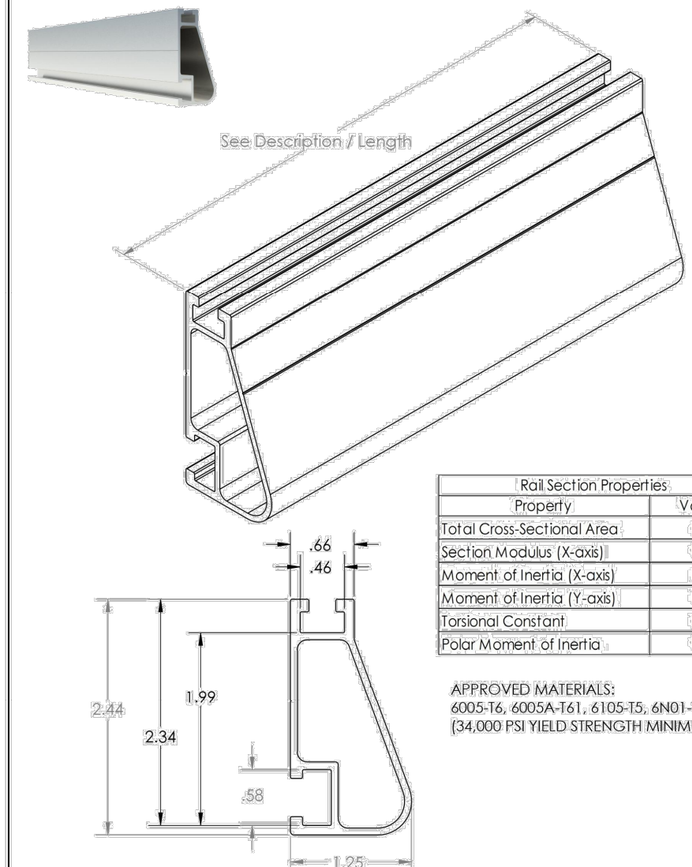

Rail Section Properties	
Property	Value
Total Cross-Sectional Area	0.582 in^2
Section Modulus (X-axis)	0.297 in^3
Moment of Inertia (X-axis)	0.390 in^4
Moment of Inertia (Y-axis)	0.085 in^4
Torsional Constant	0.214 in^3
Polar Moment of Inertia	0.126 in^4

APPROVED MATERIALS:
6005-T6, 6005A-T61, 6105-T5, 6N01-T6
(34,000 PSI YIELD STRENGTH MINIMUM)

Clear Part Number	Black Part Number	Description / Length	Material	Weight
XR-100-168A	XR-100-168B	XR100, Rail 168" (14 Feet)	6000-Series Aluminum	9.55 lbs.
XR-100-204A	XR-100-204B	XR100, Rail 204" (17 Feet)		11.60 lbs.

v1.10

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

RACKING DATASHEET

DATE: 2/28/2023
DRAWN BY: SN

PV-8.4

Tech Brief

IRONRIDGE

FlashFoot™

Rapid & Secure Solar Attachments

IronRidge FlashFoot™ is an all-in-one solar mounting product for composition shingle roofs that eliminates the need for separate standoffs, flashings, and L-feet.

FlashFoot incorporates a number of structural and waterproofing features to securely attach IronRidge Rails to roof structures, while also protecting against water intrusion and weather damage.

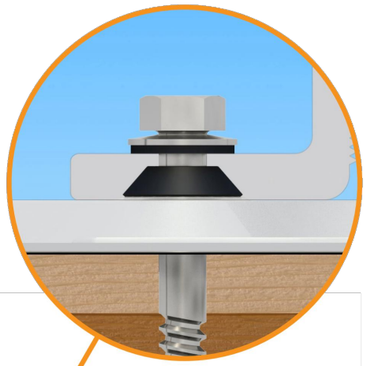

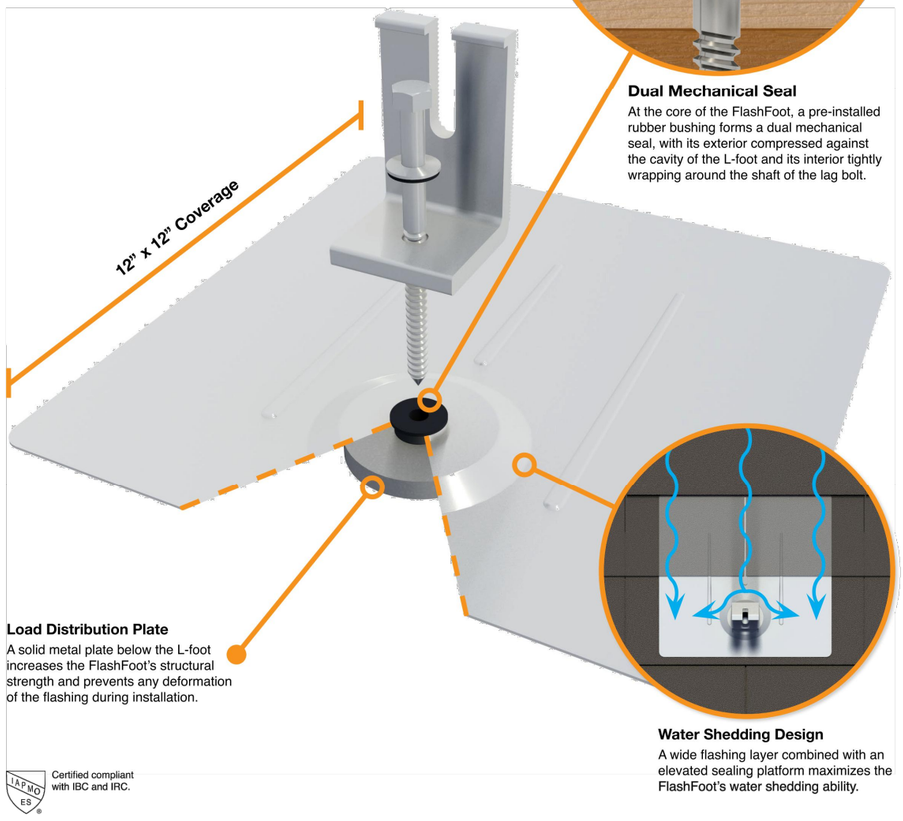

Dual Mechanical Seal

At the core of the FlashFoot, a pre-installed rubber bushing forms a dual mechanical seal, with its exterior compressed against the cavity of the L-foot and its interior tightly wrapping around the shaft of the lag bolt.

Load Distribution Plate

A solid metal plate below the L-foot increases the FlashFoot's structural strength and prevents any deformation of the flashing during installation.

Water Shedding Design

A wide flashing layer combined with an elevated sealing platform maximizes the FlashFoot's water shedding ability.

Certified compliant with IBC and IRC.

Tech Brief

Installation Overview

Tools Required: tape measure, chalk line, stud finder, roofing bar, caulking gun with an approved sealant, drill with 1/4" bit and 1/2" socket.

1

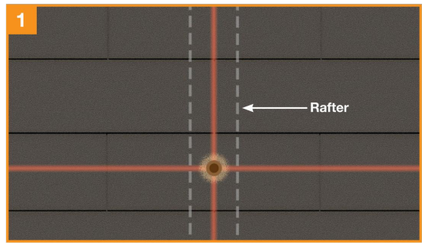

Locate rafters and snap vertical and horizontal lines to mark locations of flashings. Drill 1/4" pilot holes, then backfill with an approved sealant.

2

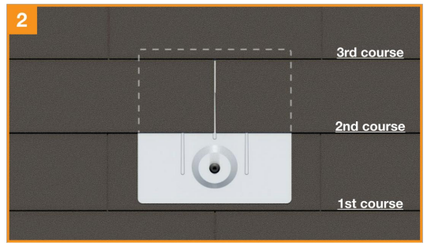

Slide flashing, between 1st and 2nd course, so the top is at least 3/4" above the edge of the 3rd course and the bottom is above the edge of the 1st course.

3

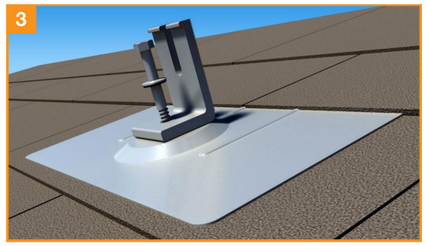

Line up pilot hole with flashing hole and insert lag bolt through bonded washer, L-Foot, and flashing. Tighten lag bolt until fully seated.

4

The FlashFoot is now installed and ready for IronRidge Rails. With provided L-foot fasteners pre-loaded into rails, drop rails into open L-foot slots.

Testing & Certification

FlashFoot is certified for compliance with the International Building Codes (IBC) & International Residential Codes (IRC) by IAPMO-ES. Mechanical testing conformed to the standard for Testing and Analysis of Joist Hangers and Miscellaneous Connectors (EC002-2011), and rain testing conformed to the Underwriters Laboratory Standard for Gas Vents (UL 441-96 Section 25).

Lag pull-out (withdrawal) capacities (lbs) in typical roof lumber (ASD)	Specific Gravity	5/16" Shaft, 3" Thread Depth
Douglas Fir, Larch	.50	798
Douglas Fir, South	.46	705
Engelmann Spruce, Lodgepole Pine (MSR 1650 f & higher)	.46	705
Hem, Fir	.43	636
Hem, Fir (North)	.46	705
Southern Pine	.55	921
Spruce, Pine, Fir	.42	615
Spruce, Pine, Fir (E of 2 million psi and higher grades of MSR and MEL)	.50	798

Sources: American Wood Council, NDS 2005, Table 11.2A, 11.3.2A; Notes: i) Thread must be embedded in a rafter or other structural roof member. ii) See IBC for required edge distances.

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

ROOF ATTACHMENT DATASHEET

DATE: 2/28/2023
DRAWN BY: SN

PV-8.5

⚠ CAUTION ⚠

POWER TO THIS BUILDING IS SUPPLIED FROM THE FOLLOWING SOURCES WITH DISCONNECTS LOCATED AS SHOWN

SERVICE 1 OF 1

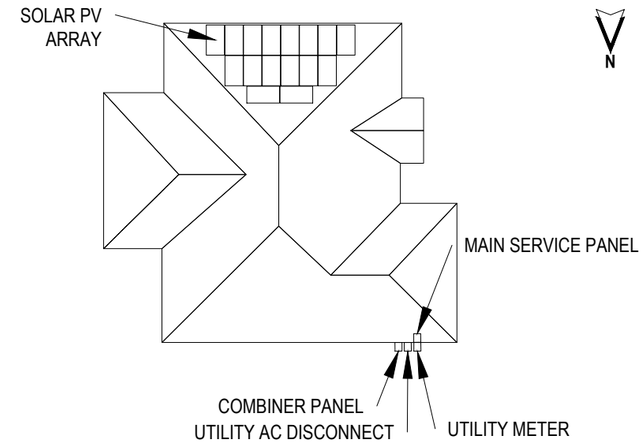

2841 NW 45TH PL, CAPE CORAL , FL 33993

2841 PIOTTER,
2841 NW 45TH PL,
CAPE CORAL , FL 33993

AHJ: CAPE CORAL CITY

BerkshireBay Solar Contractors
BERKSHIRE BAY CONTRACTORS, INC.
15804 BROTHER CT. UNIT #4, FORT MYERS, FL ,33912
TEL. NO. (239)313-1585
LIC. NO. EC13008635

PLACARD

DATE: 2/28/2023
DRAWN BY: SN

PV-9