


PLAN VIEW

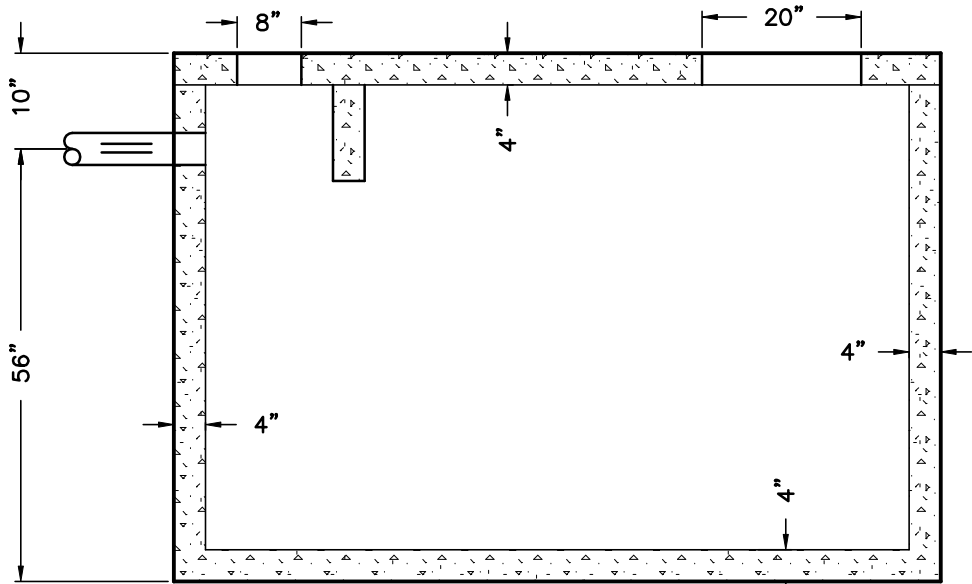

SECTION A-A

GENERAL NOTES

1. 2"x 4" WIRE MESH REINFORCEMENT IN WALLS
2. 1/2" REBAR ON 12" CENTERS REINFORCEMENT IN LID AND BOTTOM

1000 GALLON S.T.E.P. TANK		
REX VAULT SERVICE & MAUSOLEUM SERVICE , INC		
Phone (618) 783 2416 (800) 669-2416	P.O. BOX 323 NEWTON, IL 62448	Fax (618) 783-3867
EMAIL: contactus@rexvault.com		