

MATERIAL LIST

Main Ext

- 90' – 8" PVC C900
- 1 – 8" Tee PO x FLNG
- 2 – 8" Couplings
- 1 – 8" valve PO x FLNG
- 1 – 8" Ell 90°
- 8" cap with 2" blow off assembly

4" Fire Service

- 1 – 8" x 4" Tee PO x FLNG
- 1 – 4" valve PO x FLNG
- 10' – 4" DI pipe (actual length determine in field)




Fire Hydrant

- 1 – 8" x 6" Tee PO x FLNG
- 1 – 6" valve PO x FLNG
- 1 – 6" Ell 90°

Services

- 1 – 1" copper service
- 1 – 2" copper service

*field lock/restraint gaskets where needed

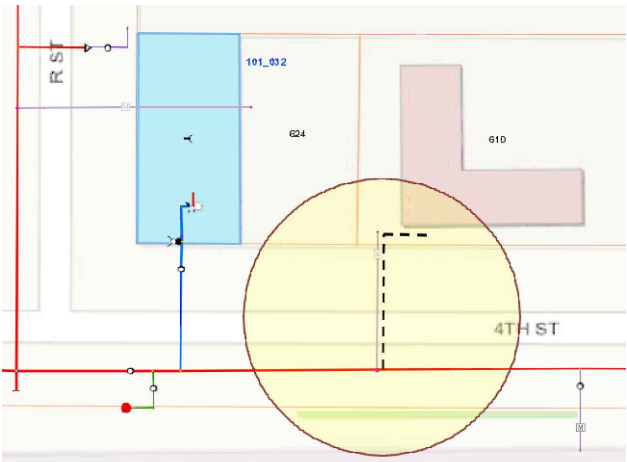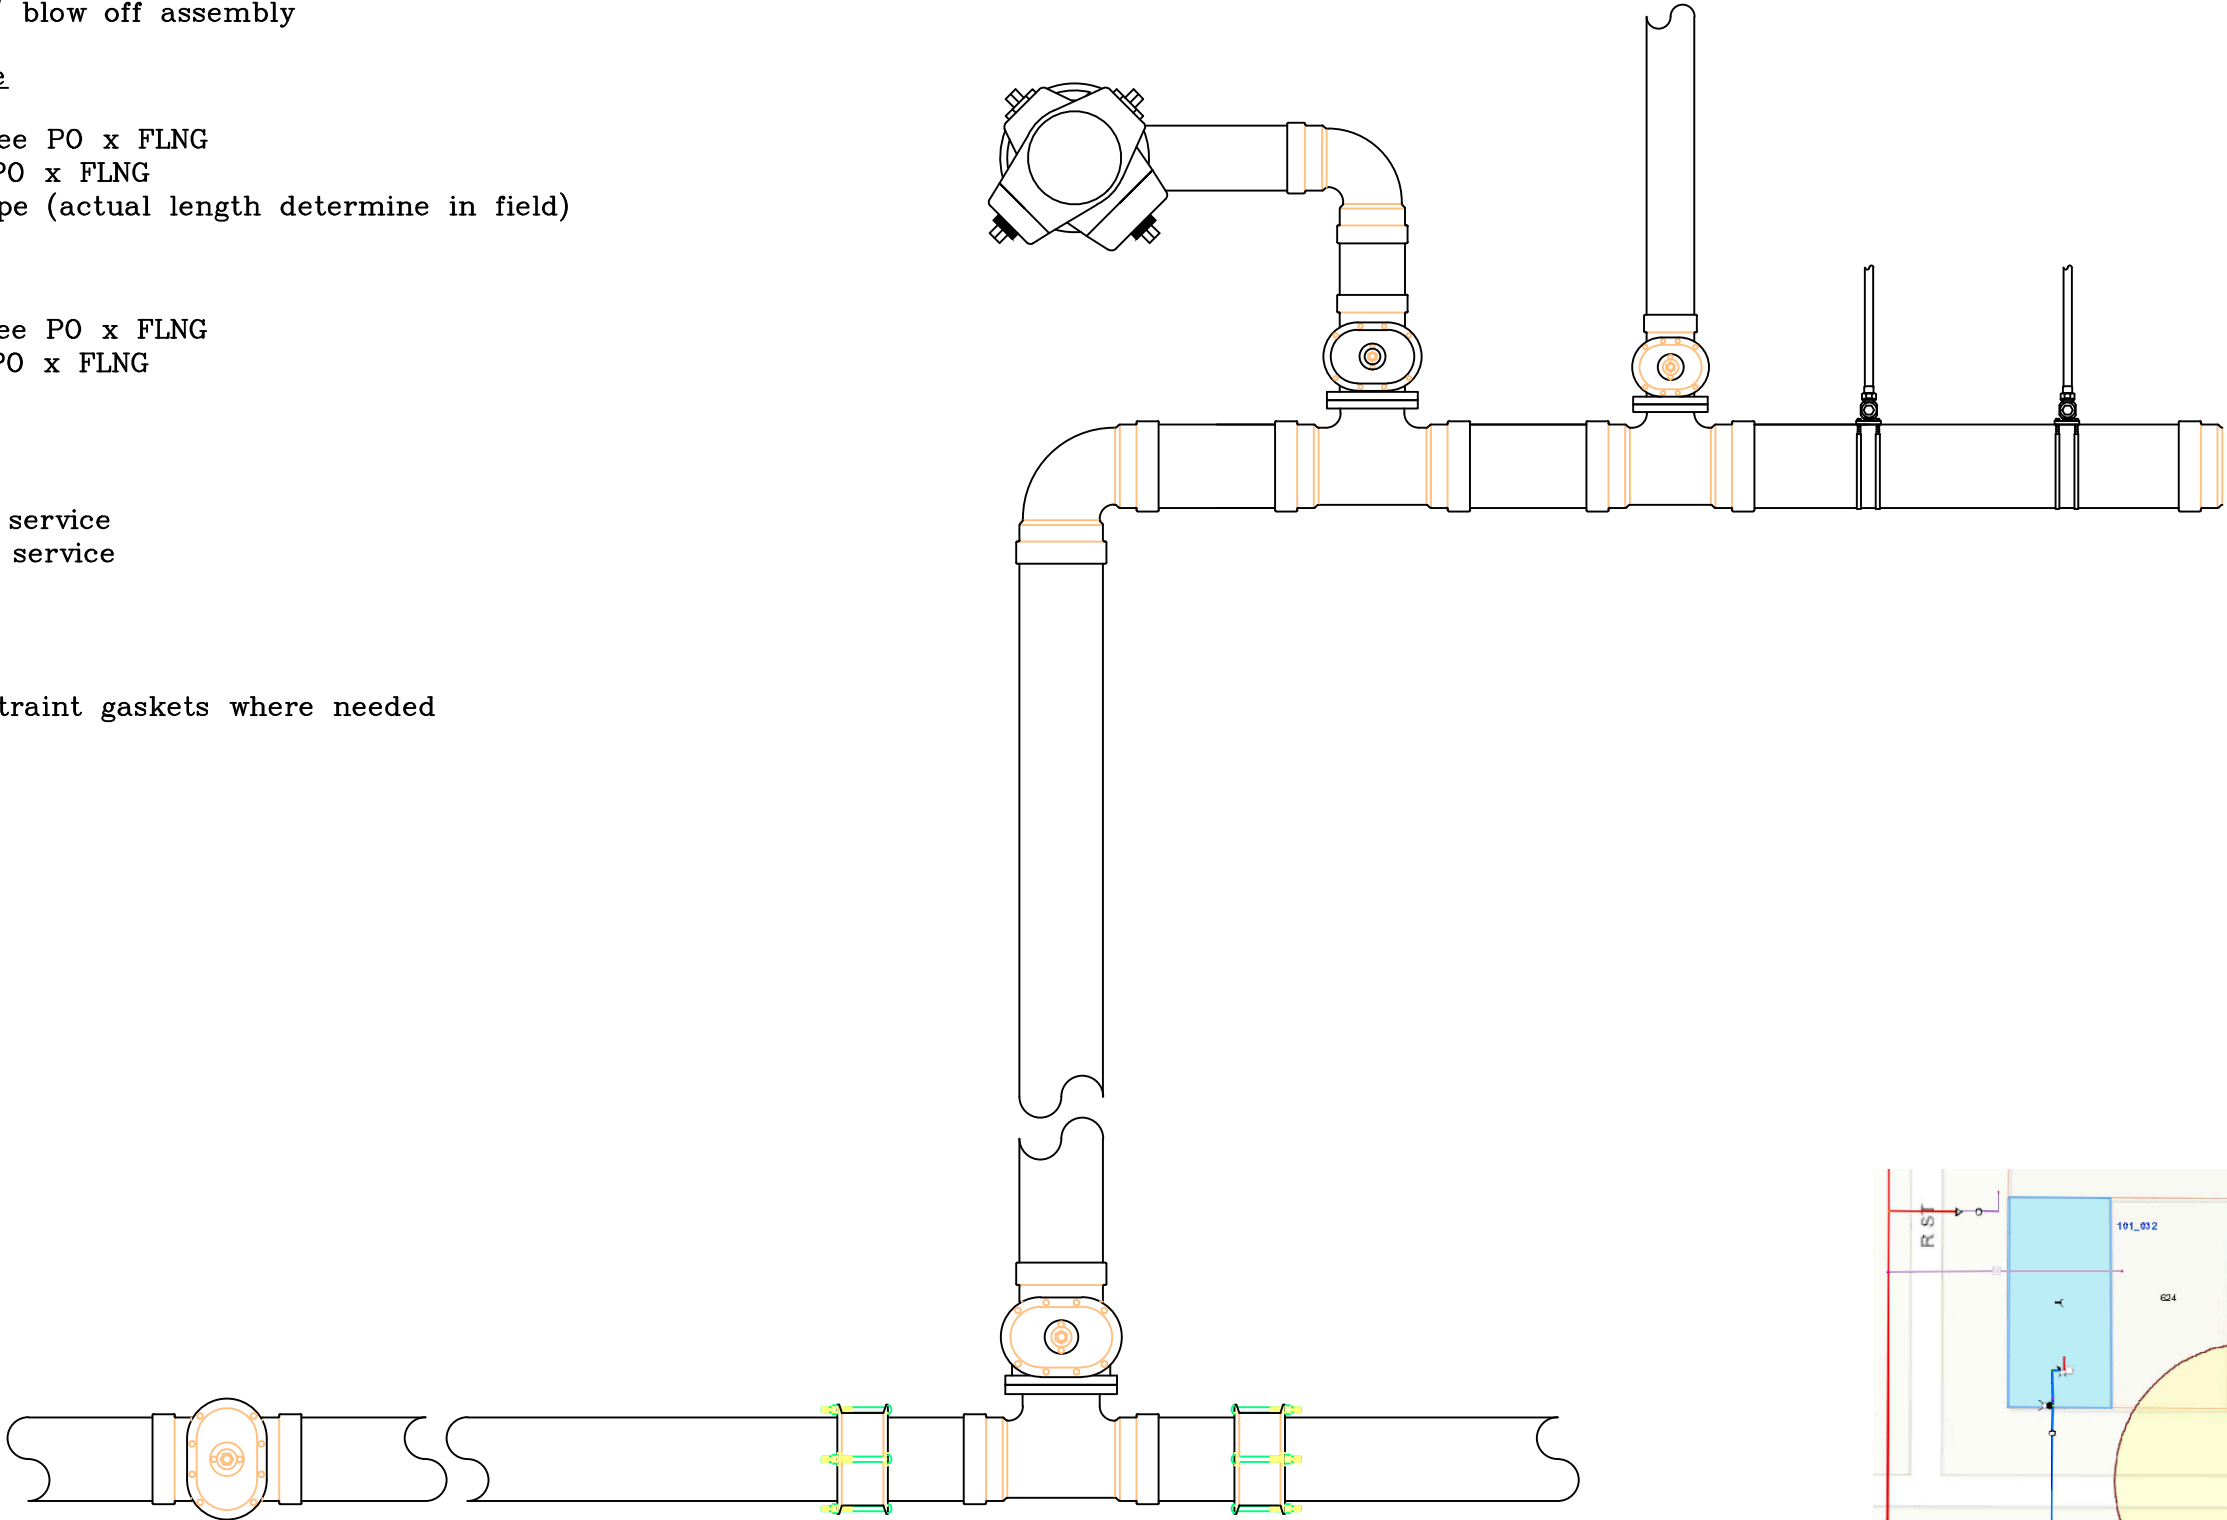

ENGINEERING



DEPARTMENT

REVISIONS:									

PLAT SHEET:
BAK-33-37

SCALE:
none

DRAWN BY:
J.Peña

CHECKED BY: DATE:

FIELD CHECK BY: DATE

APPROVED BY: DATE:

TITLE:

610 4th St
Extend 8" main to install 1 – 4" fire
service, 1 – 2" svc, 1 – 1" irr svc, and
1 FH

CADD FILE NUMBER:

DISTRICT:
Bakersfield

DATE:
10/19/2023

ESTIMATE NO.:
130413

DRAWING NO.: