


12. ALL EXISTING WATER VALVES SHALL BE OPERATED SOLELY BY AUTHORIZED CALIFORNIA WATER COMPANY PERSONNEL OR ITS REPRESENTATIVE AGENTS.

10. DEPTH OF COVER SHALL NOT BE LESS THAN 30 IN (0.8 m) BELOW GRADE TO PREVENT MECHANICAL DAMAGE.

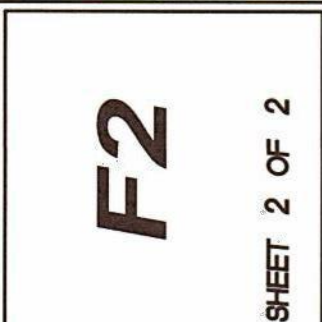

COPYRIGHT 2022

Scale:	
Job No: 2998	Sheet No: F2
Date: 01/17/23	2 of 2 sheets