




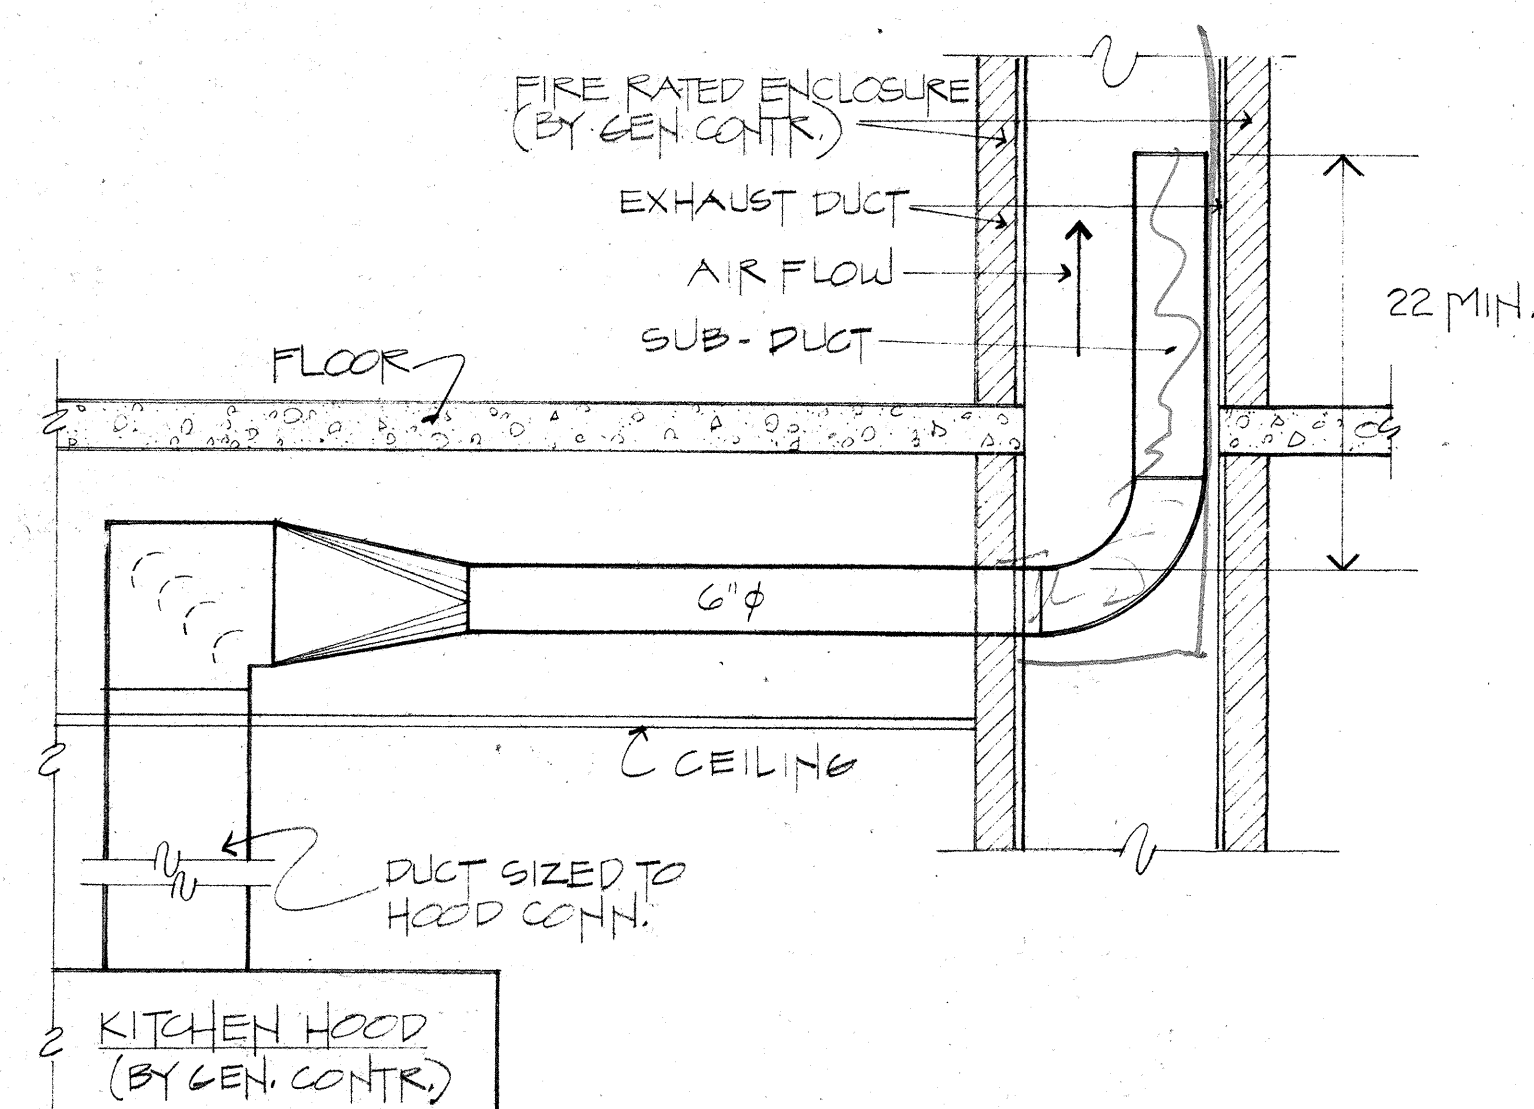


KITCHEN EXHAUST SHAFT DETAIL
NO SCALE

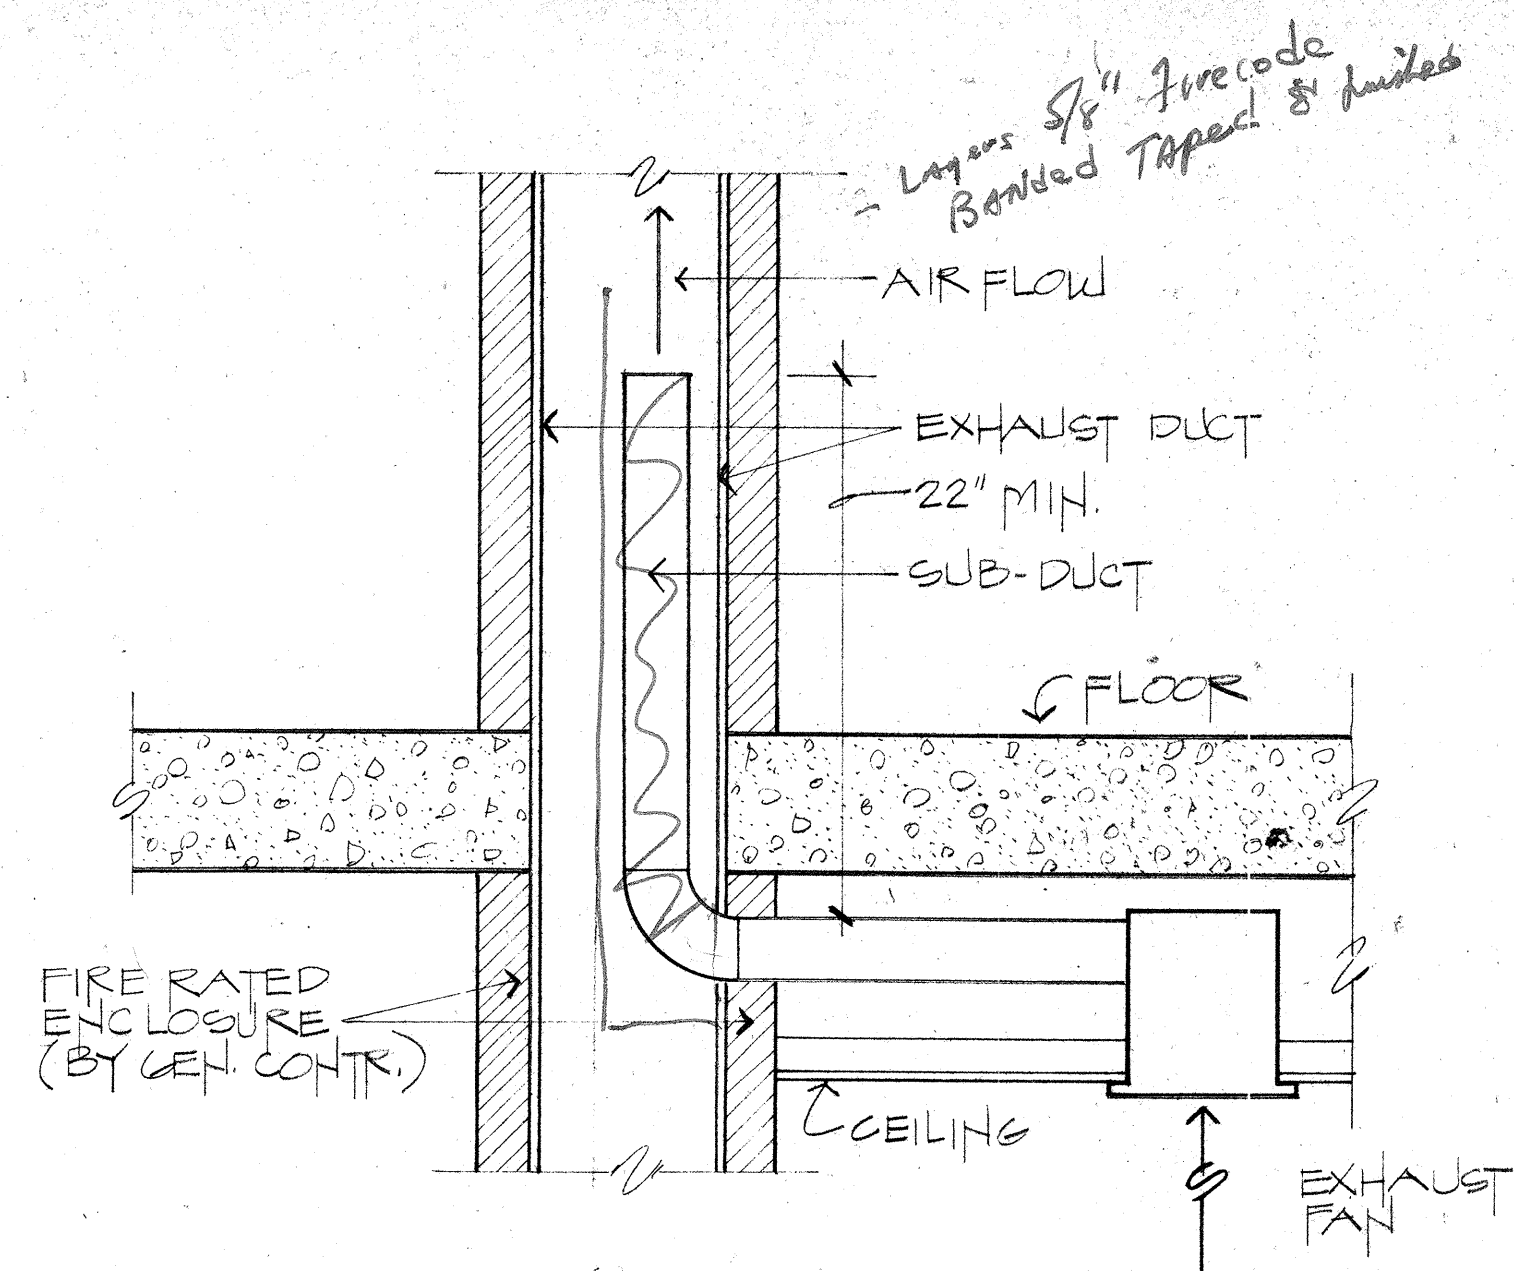

BATH EXHAUST SHAFT DETAIL
NO SCALE

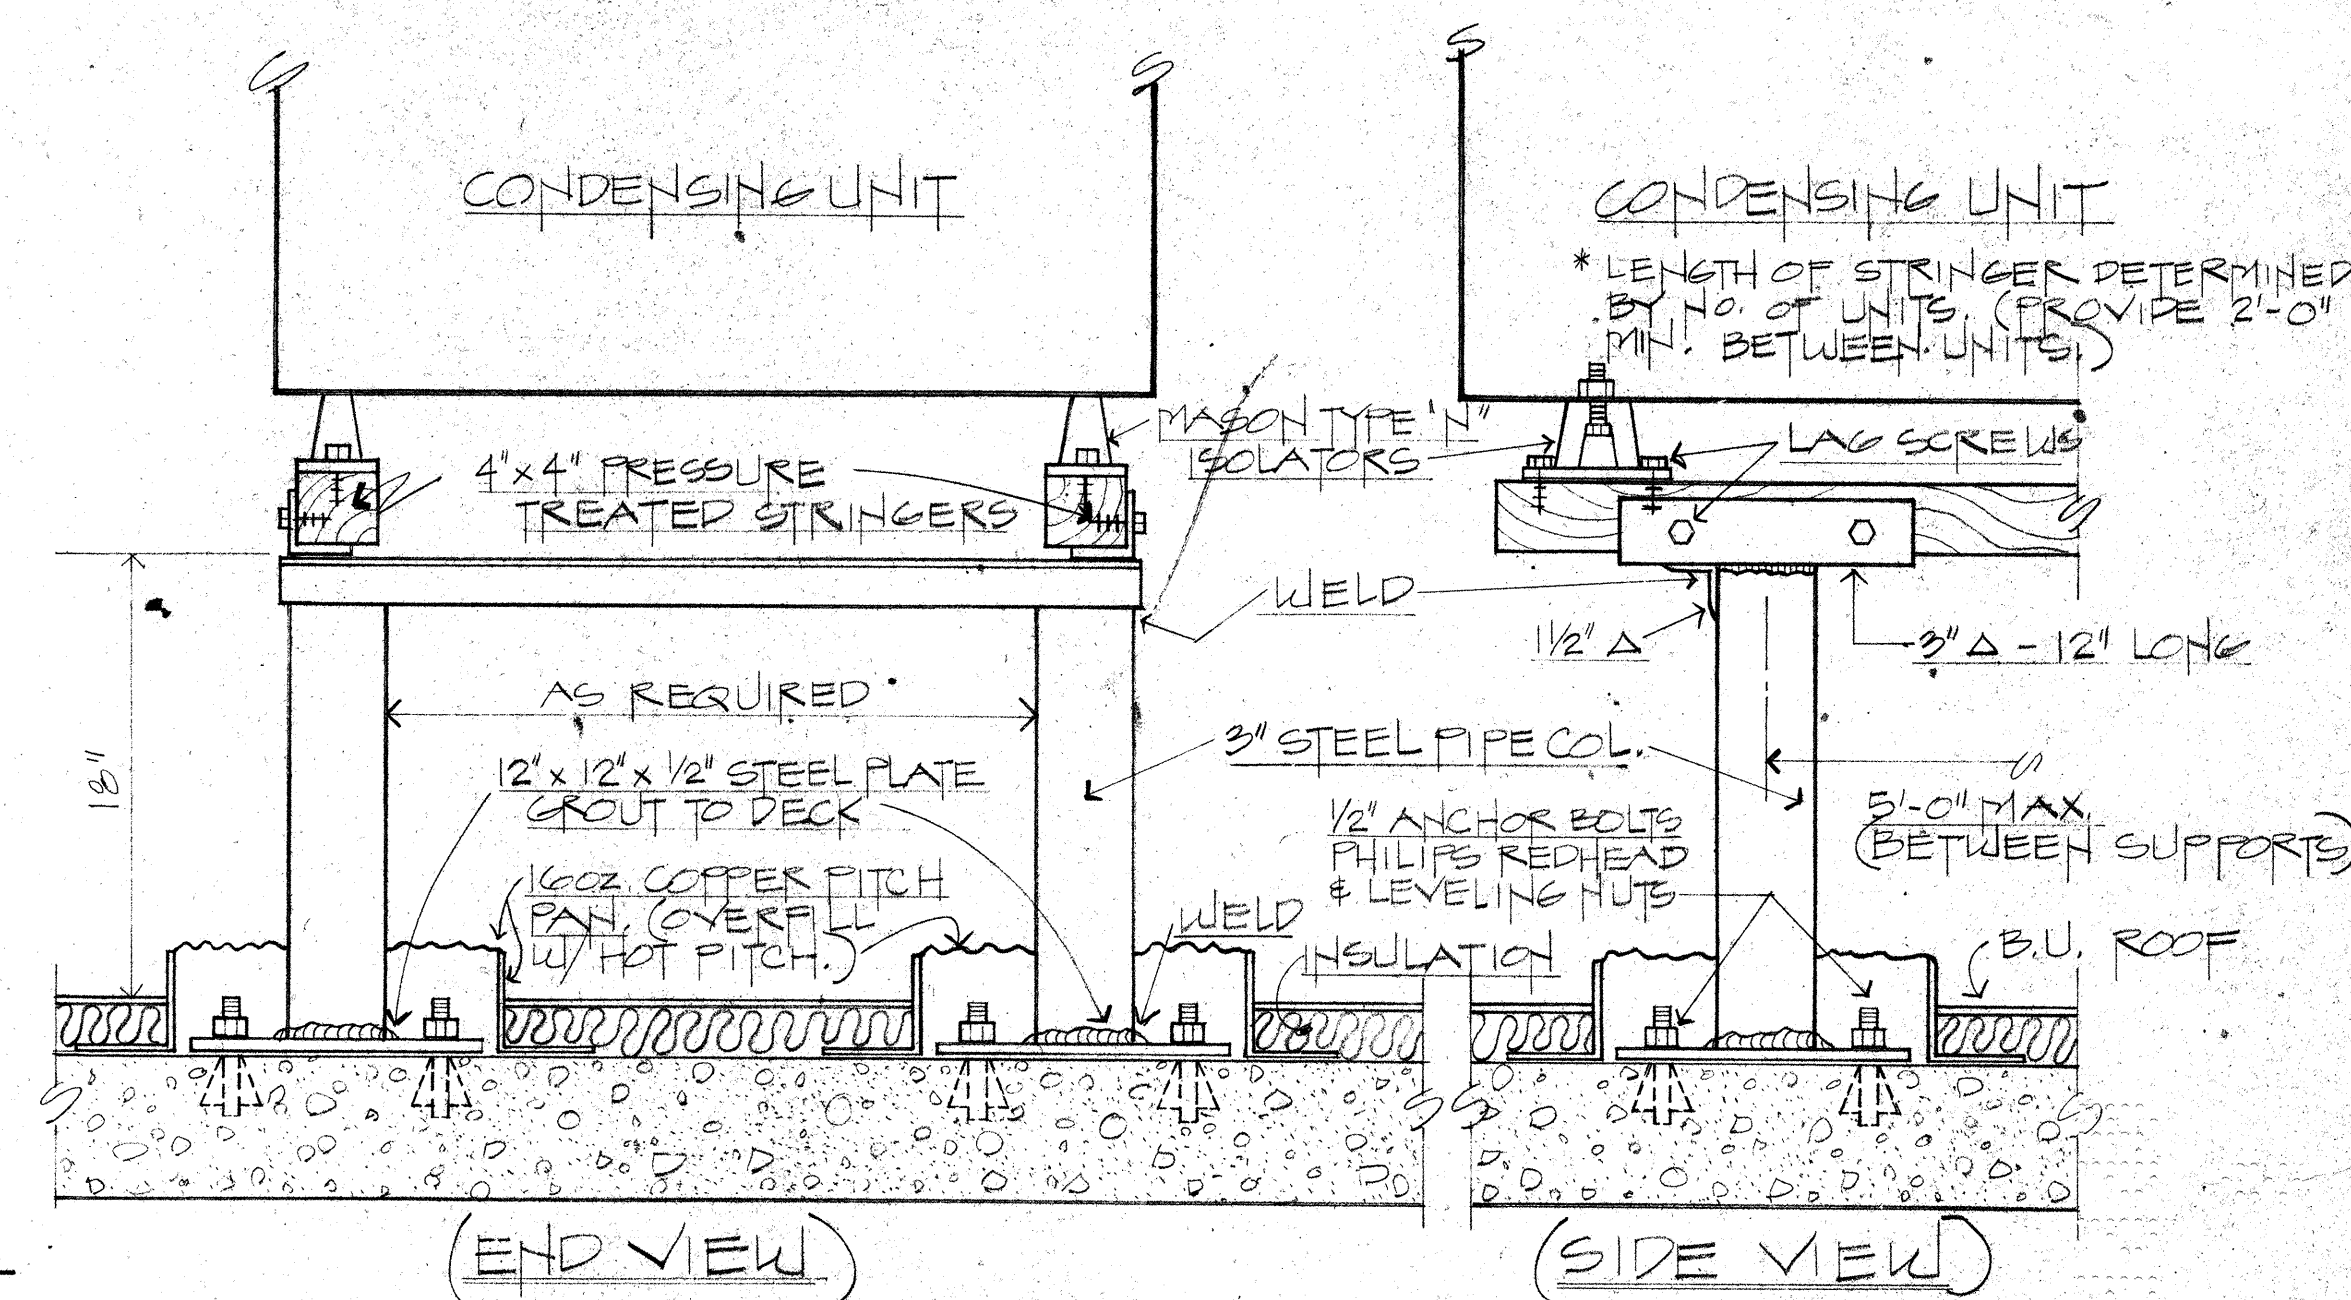


CONDENSING UNIT MOUNTING DETAIL
NO SCALE

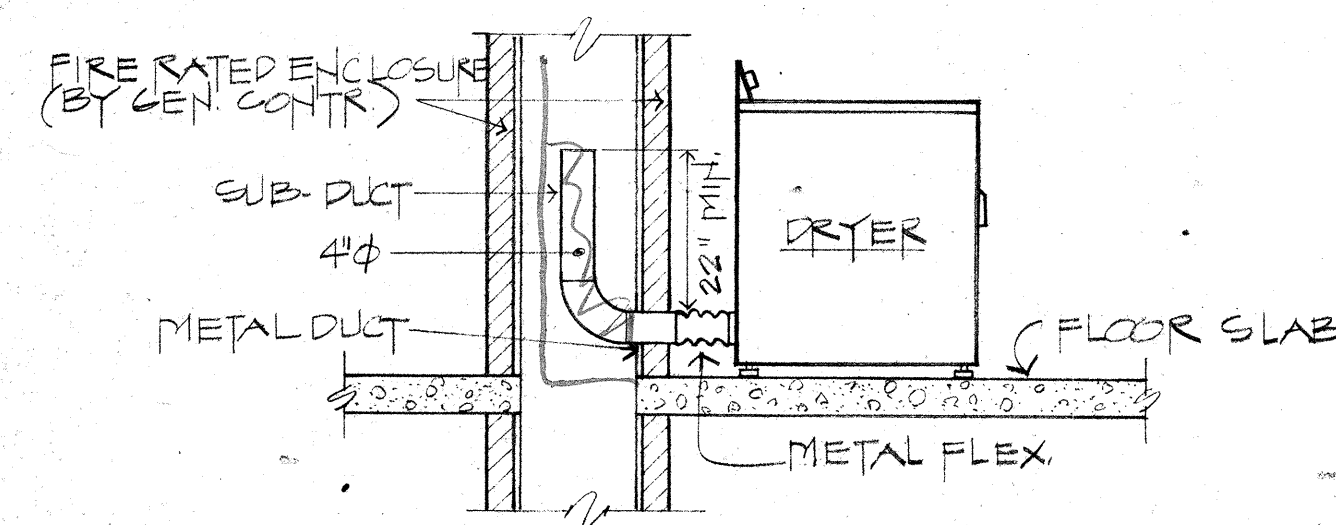


DRYER EXHAUST SHAFT DETAIL
NO SCALE

AIR CONDITIONING NOTES

1. INDICATED DUCT SIZES ARE CLEAR INSIDE DIMENSIONS.
2. ALL ELECTRIC HEATING DEVICES & CONTROLS SHALL COMPLY WITH THE NATIONAL ELECTRIC CODE & BE "UL" APPROVED.
3. AIR CONDITIONING CONTRACTOR SHALL FURNISH ALL SUPPORTS FOR A/C AND VENT EQUIPMENT.
4. COOLING SYSTEMS ARE DESIGNED FOR 75°F D.B. FOR INSIDE CONDITIONS WHILE OUTSIDE CONDITIONS ARE 90°F D.B. & 80°F W.B.
5. HEATING SYSTEMS ARE DESIGNED FOR 72°F D.B. FOR INSIDE CONDITIONS WHILE OUTSIDE CONDITIONS ARE 41°F W.B.
6. PROVIDE A DISCONNECT FOR AND BY ALL EQUIPMENT.
7. DUCTWORK SHALL BE CONSTRUCTED FROM 1" THICK FIBERGLASS BOARD, FABRICATED & INSTALLED IN ACCORDANCE WITH "SMACNA".
8. ALL AIR DISTRIBUTION DEVICES SHALL BE CONSTRUCTED OF ALUMINUM AS MANUFACTURED BY "TUTTLE & BAILEY", SUPPLIED WITH OPPOSED BLADE DAMPERS.
9. THE AIR CONDITIONING SYSTEM SHALL BE TESTED & BALANCED BY THE AIR CONDITIONING CONTRACTOR; A REPORT SHALL BE SUBMITTED TO THE ARCHITECT FOR APPROVAL.

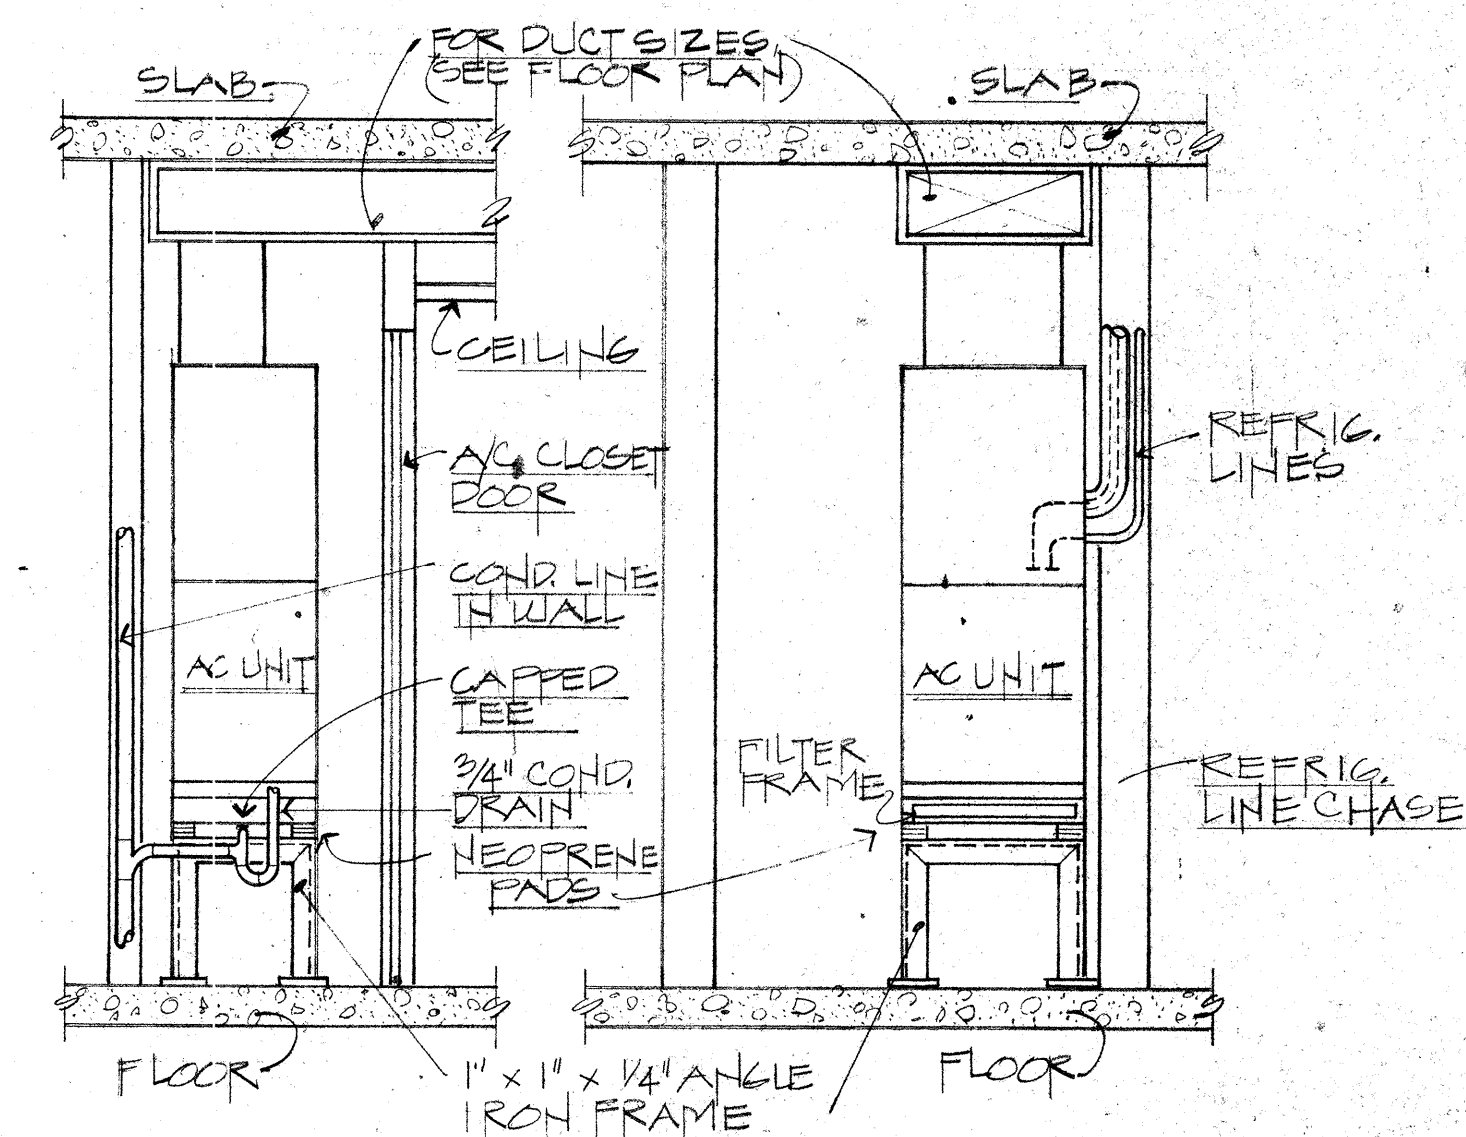

A/C UNIT MOUNTING DETAIL
NO SCALE

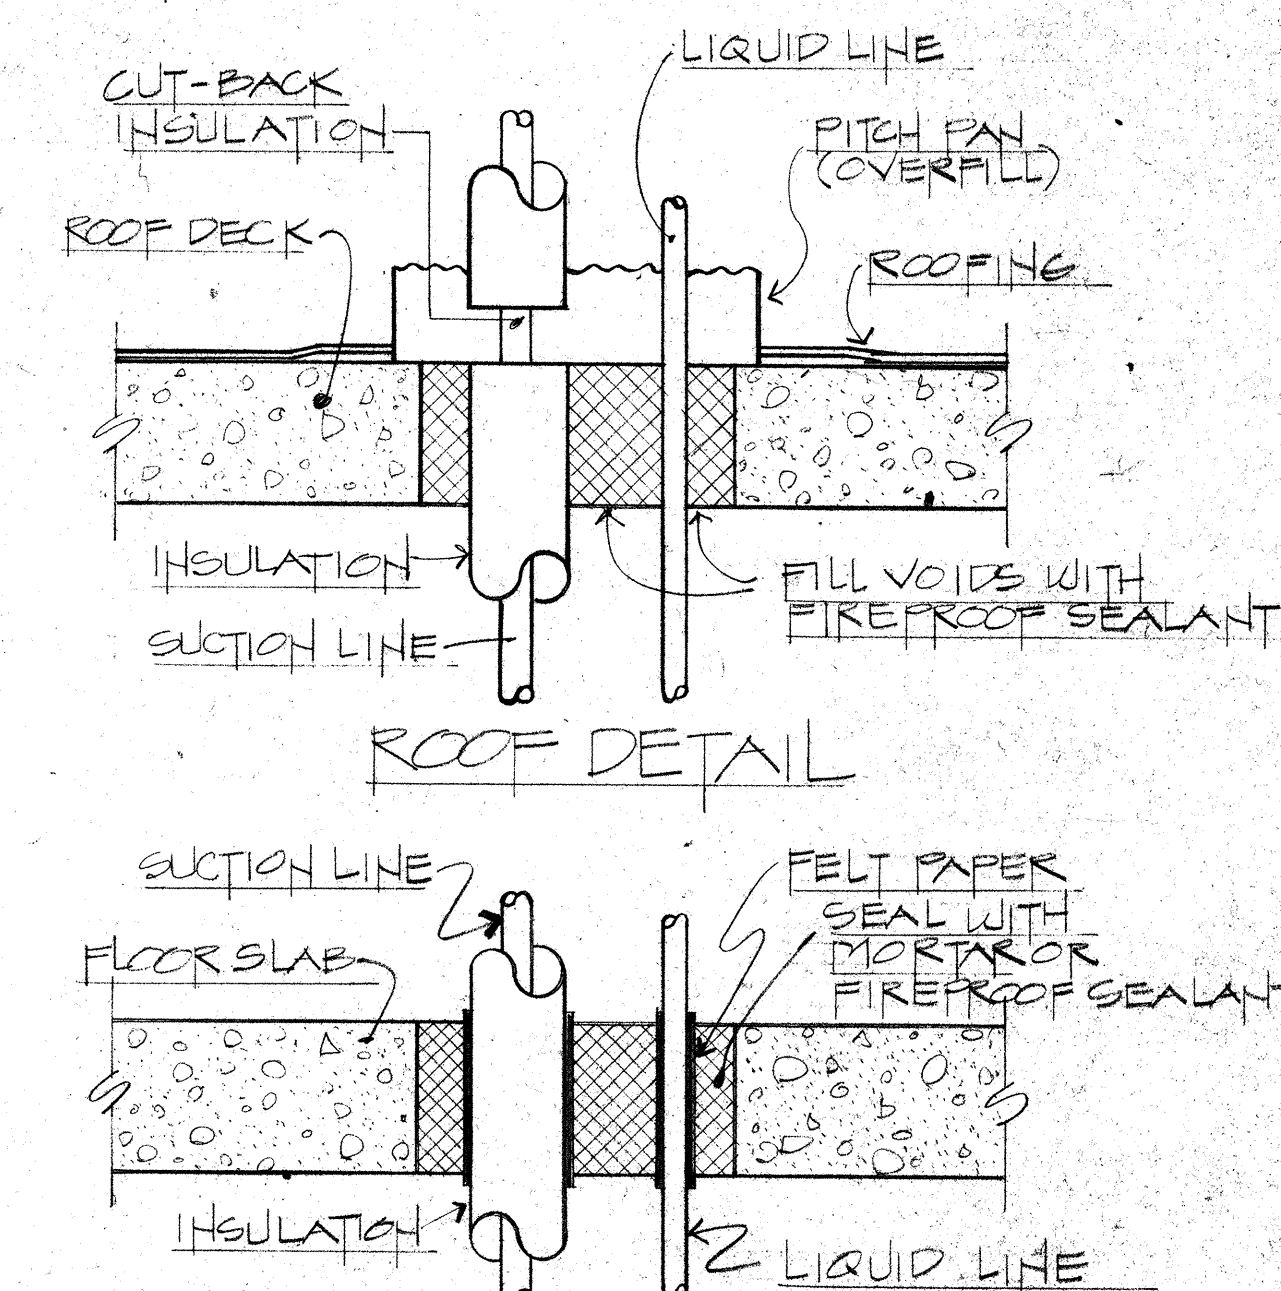

PENETRATION DETAILS
NO SCALE

Erquias
25/88
Erquias

R. W. M. CLAYTON JR. ARCHITECT
1995 EAST OAKLAND PARK BLVD. FT. LAUDERDALE, FLA.
E & E CONSULTING ENGINEERS
2701 EAST SUNRISE BLVD. FT. LAUDERDALE, FLA.
OVERLOOK CONDOMINIUM
A/C DETAILS

DRAWN BY: R.L.H.
JOB NO: 8101
DATE: 8-12-81
REVISIONS: 6-11-84
SHEET **A/C7**