

PharmLabs San Diego Certificate of Analysis

3421 Hancock St, Second Floor, San Diego, CA 92110 | License: C8-000098-LIC  
 ISO/IEC 17025:2005 Certification L17-427-1 | Accreditation #85368




Sample **VL-S1-Clear**

Sample ID	SD200918-007 (39417)	Matrix	Distillate - NI (Other Cannabis Good)
Tested for	Vere Labs		
Sampled	-	Received	Sep 17, 2020
		Reported	Sep 18, 2020
Analyses executed	PES, HME, FVI		

HME - Heavy Metals Detection Analysis

Analyzed Sep 18, 2020 | Instrument ICP/MSMS | Method SOP-005

Analyte	LOD ug/g	LOQ ug/g	Result ug/g	Limit ug/g	Analyte	LOD ug/g	LOQ ug/g	Result ug/g	Limit ug/g
Arsenic (As)	0.0002	0.05	ND	1.5	Cadmium (Cd)	3.0e-05	0.05	ND	0.5
Mercury (Hg)	1.0e-05	0.01	ND	3.0	Lead (Pb)	1.0e-05	0.125	ND	0.5

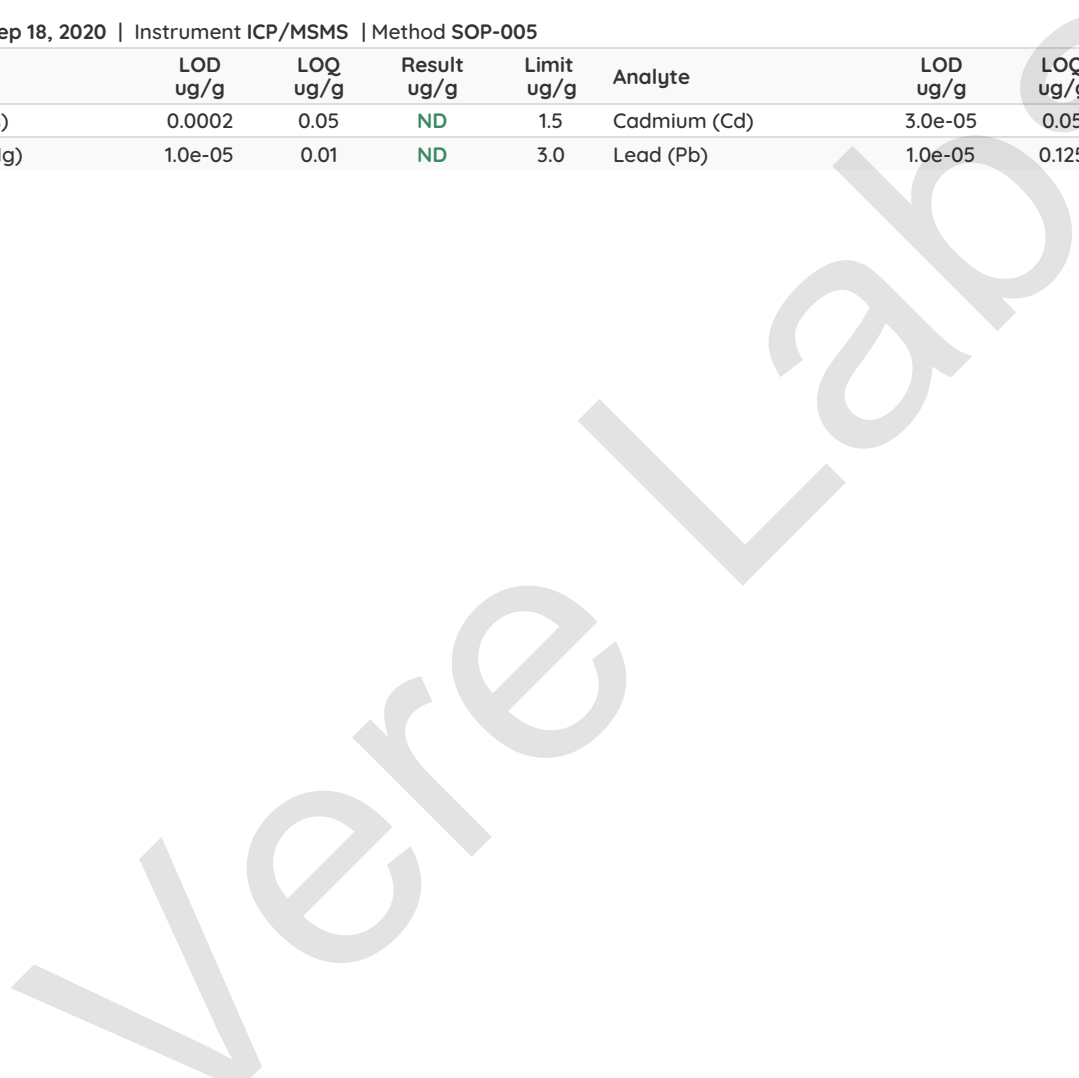

ND Not Detected  
 N/A Not Applicable  
 NT Not Reported  
 LOD Limit of Detection  
 LOQ Limit of Quantification  
 <LOQ Detected  
 >ULOL Above upper limit of linearity  
 CFU/g Colony Forming Units per 1 gram  
 TNTC Too Numerous to Count



Scan the QR code to verify authenticity.

Authorized Signature

Dr. Lia Prevedello, Laboratory Director  
 Fri, 18 Sep 2020 15:22:38 -0700

## PES - Pesticides Screening Analysis

Analyzed Sep 18, 2020 | Instrument LC/MSMS GC/MSMS | Method SOP-003

Analyte	LOD ug/g	LOQ ug/g	Result ug/g	Limit ug/g	Analyte	LOD ug/g	LOQ ug/g	Result ug/g	Limit ug/g
Aldicarb	0.025	0.1	ND	0.025	Carbofuran	0.025	0.1	ND	0.025
Dimethoate	0.025	0.1	ND	0.025	Etofenprox	0.025	0.1	ND	0.025
Fenoxycarb	0.025	0.1	ND	0.025	Thiacloprid	0.025	0.1	ND	0.025
Daminozide	0.025	0.1	ND	0.025	Dichlorvos	0.025	0.1	ND	0.025
Imazalil	0.025	0.1	ND	0.025	Methiocarb	0.025	0.1	ND	0.025
Spiroxamine	0.025	0.1	ND	0.025	Coumaphos	0.025	0.1	ND	0.025
Fipronil	0.025	0.1	ND	0.025	Paclobutrazol	0.025	0.1	ND	0.025
Chlorpyrifos	0.025	0.1	ND	0.025	Ethoprophos (Prophos)	0.025	0.1	ND	0.025
Baygon (Propoxur)	0.025	0.1	ND	0.025	Chlordane	0.025	0.1	ND	0.025
Chlorfenapyr	0.025	0.1	ND	0.025	Methyl Parathion	0.025	0.1	ND	0.025
Mevinphos	0.025	0.1	ND	0.025	Abamectin	0.025	0.05	ND	0.3
Acephate	0.025	0.05	ND	5	Acetamiprid	0.025	0.05	ND	5
Azoxystrobin	0.025	0.05	ND	40	Bifenazate	0.025	0.05	ND	5
Bifenthrin	0.025	0.05	ND	0.5	Boscalid	0.025	0.05	ND	10
Carbaryl	0.025	0.05	ND	0.5	Chlorantraniliprole	0.025	0.05	ND	40
Clofentezine	0.025	0.05	ND	0.5	Diazinon	0.025	0.05	ND	0.2
Dimethomorph	0.025	0.05	ND	20	Etoazole	0.025	0.05	ND	1.5
Fenpyroximate	0.025	0.05	ND	2	Fonicamid	0.025	0.05	ND	2
Fludioxonil	0.025	0.05	ND	30	Hexythiazox	0.025	0.05	ND	2
Imidacloprid	0.025	0.05	ND	3	Kresoxim-methyl	0.025	0.05	ND	1
Malathion	0.025	0.05	ND	5	Metalaxyl	0.025	0.05	ND	15
Methomyl	0.025	0.05	ND	0.1	Myclobutanil	0.025	0.05	ND	9
Naled	0.025	0.05	ND	0.5	Oxamyl	0.025	0.05	ND	0.2
Permethrin	0.025	0.05	ND	20	Phosmet	0.025	0.05	ND	0.2
Piperonyl Butoxide	0.025	0.05	ND	8	Propiconazole	0.025	0.05	ND	20
Prallethrin	0.025	0.05	ND	0.4	Pyrethrin	0.025	0.05	ND	1
Pyridaben	0.025	0.05	ND	3	Spinosad A	0.025	0.05	ND	3
Spinosad D	0.025	0.05	ND	3	Spiromesifen	0.025	0.05	ND	12
Spirotetramat	0.025	0.05	ND	13	Tebuconazole	0.025	0.05	ND	2
Thiamethoxam	0.025	0.05	ND	4.5	Trifloxystrobin	0.025	0.05	ND	30
Acequinocyl	0.025	0.05	ND	4	Captan	0.025	0.05	ND	5
Cypermethrin	0.025	0.05	ND	1	Cyfluthrin	0.025	0.05	ND	1
Fenhexamid	0.025	0.05	ND	10	Spinetoram J,L	0.025	0.05	ND	3
Pentachloronitrobenzene	0.025	0.05	ND	0.2					

## FVI - Filth &amp; Foreign Material Inspection Analysis

Analyzed Sep 18, 2020 | Instrument Microscope | Method SOP-010

Analyte / Limit	Result	Analyte / Limit	Result
> 1/4 of the total sample area covered by sand, soil, cinders, or dirt	Negative	> 1/4 of the total sample area covered by mold	Negative
> 1 insect fragment, 1 hair, or 1 count mammalian excreta per 3g	Negative	> 1/4 of the total sample area covered by an imbedded foreign material	Negative

ND Not Detected  
 N/A Not Applicable  
 NT Not Reported  
 LOD Limit of Detection  
 LOQ Limit of Quantification  
 <LOQ Detected  
 >ULOL Above upper limit of linearity  
 CFU/g Colony Forming Units per 1 gram  
 TNTC Too Numerous to Count



Scan the QR code to  
verify authenticity.

Authorized Signature

Dr. Lia Prevedello, Laboratory Director  
 Fri, 18 Sep 2020 15:22:38 -0700

PharmLabs San Diego | 3421 Hancock St, Second Floor, San Diego, CA 92110 | 619.356.0898 | ISO/IEC 17025:2005 Certification L17-427-1

\*This report shall not be reproduced except in full, without the written approval of the lab. This report is for informational purposes only and should not be used to diagnose, treat or prevent any disease. Results are only for samples and batches indicated. Results are reported on an "as received" basis, unless indicated otherwise.