

RENOVATION

GENERAL CONTRACTORS NOTIFICATION

GENERAL:

- ALL CONSTRUCTION SHALL CONFORM TO THE INTERNATIONAL BUILDING CODE (CURRENT EDITION AT THE TIME IT WAS DRAFTED), AS LOCALLY AMENDED, AND ALL APPLICABLE CODES & ORDINANCES. IT IS THE RESPONSIBILITY OF THE PURCHASER AND/OR BUILDER OF THIS PLAN TO SEE THAT THE STRUCTURE IS BUILT IN STRICT COMPLIANCE WITH ALL GOVERNING MUNICIPAL CODES (CITY, COUNTY, STATE AND FEDERAL).
- CONTRACTOR IS OBLIGATED TO OBTAIN A FULL AND CLEAR UNDERSTANDING OF THE PLANS, NOTES AND CONCEPTS CONTAINED HEREIN PRIOR TO THE START OF ANY WORK.
- AFTER THE SIGNING OF ANY WORK AGREEMENTS, THERE WILL BE NO CONSIDERATION GIVEN TO ANY CLAIM OF MISUNDERSTANDING OF THE DRAWINGS, DETAILS, CONCEPTS, ETC. AS THEY APPLY TO THE PLANS.
- CONTRACTOR SHALL FIELD VERIFY ALL CONDITIONS AND DIMENSIONS BEFORE STARTING ANY WORK.
- CONTRACTOR WILL INSURE THAT ALL MATERIALS AND WORKMANSHIP SHALL COMPLY WITH THE REQUIREMENTS OF ALL PERTINENT GOVERNMENTAL CODES AND REQUIREMENTS.
- PRIOR TO STARTING ANY EXCAVATION, CONSTRUCTION AND OR DEMOLITION WORK - THE CONTRACTOR SHALL WALK THE PROJECT SITE WITH THE OWNER TO VERIFY WHAT WORK WILL BE TAKING PLACE.
- CONTRACTOR IS OBLIGATED TO PERFORM ALL WORK IN A GOOD CRAFTSMANSHIP/WORKMANSHIP MANNER ACCORDING TO ALL MANUFACTURED SPECIFICATIONS.
- THE DRAWINGS, INCLUDING ANY NOTES, SPECIFICATIONS, AND/OR REPORTS ARE TO BE INTERPRETED AS ONE DOCUMENT. HOWEVER, SHOULD ANY ITEM APPEAR IN ONLY ONE AND NOT THE OTHER, SUCH ITEMS ARE STILL TO BE CONSIDERED VALID COMPONENTS OF THE OVERALL DOCUMENT.
- THE CONTRACTOR SHALL NOT PROCEED WITH WORK IF THERE IS AN ERROR, OMISSION, OR DISCREPANCY THAT IS DISCOVERED IN THE DRAWINGS UNTIL CONTACT WITH THE OWNER HAS BEEN ESTABLISHED FOR SPECIFIC INSTRUCTIONS AS HOW TO CONTINUE.
- ANY WORK THAT IS NOT EXPLICITLY ILLUSTRATED OR NOTED IN THE DRAWINGS BUT CLEARLY REQUIRED AS NECESSARY TO COMPLETE THE PROJECT SHALL BE INCLUDED AND EXECUTED AS AN INTEGRAL PART OF THE ORIGINAL SCOPE OF WORK WITH NO ADDITIONAL COST TO THE OWNER.
- SHOULD THERE BE ANY ARCHITECTURAL DISCREPANCIES BETWEEN THE ARCHITECTURAL DRAWINGS VERSUS SUPPLEMENTAL DRAWINGS (I.E. ELECTRICAL, MECHANICAL, LANDSCAPE, CIVIL, ETC.) THE ARCHITECTURAL DRAWINGS SHALL ALWAYS BE USED AS THE PREDOMINANT SOURCE OF INFORMATION.
- WHEN QUESTIONS ARISE OVER A SCALED DIMENSION VERSUS A WRITTEN DIMENSION, THE WRITTEN DIMENSION SHALL ALWAYS SUPERSEDE THE SCALED DIMENSION.
- ALL AND ANY SUBSTITUTIONS (INCLUDING BUT NOT LIMITED TO: DESIGN, METHODS, COLORS, TEXTURES AND/OR MATERIALS) THAT DEVIATE FROM THE APPROVED PERMITTED SET OF CONSTRUCTION DRAWINGS MUST BE APPROVED BY THE OWNER, FAILURE TO NOTIFY THE OWNER AND WHEN NECESSARY - CITY INSPECTORS, OF ANY DEVIATIONS FROM DRAWINGS WILL BE CAUSE FOR "STOP OF WORK" UNTIL ALL DEVIATIONS ARE RECTIFIED PER THE APPROVAL OF THE OWNER. ALL AND ANY EXPENSE INCURRED TO RECTIFY SUCH DEVIATIONS WILL BE DONE SOLELY AT THE GENERAL CONTRACTORS EXPENSE.
- IN THE EVENT THAT HAZARDOUS MATERIALS AND/OR CONDITIONS ARE ENCOUNTERED THEY MUST BE ADDRESSED & COMPLY WITH ALL PERTINENT GOVERNMENTAL CODES AND REQUIREMENTS. IF ANY SUCH REMEDIES ARE REQUIRED, COSTS SHALL BE NEGOTIATED BETWEEN OWNER AND CONTRACTOR.

CONCRETE AND FOUNDATIONS:

- ALL FOOTINGS SHALL BE 3000 PSI (28 DAY COMPRESSIVE STRENGTH CONCRETE) WITH CONTINUOUS CONCRETE FOOTING REINF. W/ #4 BARS CONTINUOUS (OVERLAP REBAR 30 BAR DIAMETERS) AT TOP & BOTTOM, 1'-0" WIDE X 18" DEEP - U.N.O.
- ALL SLABS SHALL BE 3000 PSI (28 DAY COMPRESSIVE STRENGTH CONCRETE), U.N.O.
- ALL SLABS ON GRADE SHALL BE 4" THICK (MIN.) AND REINFORCED W/ #3 REBAR AT 24" O.C. U.N.O. AND BEAR ON 4" (MIN.) COMPACTED AGGREGATE BASE COURSE (COMPACTED TO 95%) U.N.O.
- PROVIDE PROPER EXPANSION AND CONTROL JOINTS (KEYED OR SAUCUT) NOT TO EXCEED 400 SQUARE FEET AREA OR AS PER LOCAL CODE.
- FOUNDATION WALLS ARE NOT TO BE BACKFILLED UNTIL FLOOR SYSTEM IS COMPLETELY IN PLACE.
- INSTALL 1/2" DIA. X 12" ANCHOR BOLTS TO 2X6 PRE-TREATED SILL PLATE OVER SILL SEALER AT 48" O.C. NOT MORE THAN 12" FROM ANY CORNER OR END OF PLATE.
- IN THE EVENT THAT STEPPED FOOTINGS ARE REQUIRED - HORIZONTAL DIMENSION = 48" (MIN.); VERTICAL DIMENSION = 24" (MAX.)

STEEL:

- ALL REINFORCING STEEL FOR CONCRETE SHALL COMPLY WITH ASTM SPECIFICATION A-615 GRADE 60.
- ALL STRUCTURAL STEEL FOR BEAMS AND PLATES SHALL COMPLY WITH ASTM SPECIFICATION A-36.
- ALL STRUCTURAL STEEL FOR STEEL COLUMNS SHALL COMPLY WITH ASTM SPECIFICATION A-53 GRADE B OR A-501.
- PROVIDE (1) #5 REBAR VERTICALLY AT BEAM POCKET LOCATIONS.
- STEEL COLUMNS ARE TO BE 3" I.D. (INSIDE DIAMETER) UNLESS NOTED OTHERWISE.

FRAMING MEMBERS:

- ALL FRAMING LUMBER TO BE DOUGLAS FIR-LARCH #2 DFL #2 OR BETTER, U.N.O.
- CONTRACTOR TO CONFIRM THE SIZE, SPACING AND SPECIES OF ALL FRAMING AND STRUCTURAL MEMBERS TO MEET LOCAL CODE REQUIREMENTS PER LOCAL STRUCTURAL ENGINEER PRIOR TO INSTALLATION.
- ANY STRUCTURAL OR FRAMING MEMBERS NOT INDICATED ON THE PLAN ARE TO BE SIZED BY THE CONTRACTOR PER LOCAL STRUCTURAL ENGINEER.
- ALL EXTERIOR WALLS ARE 2" X 6" STUDS AT 16" O.C. & ARE DIMENSIONED FROM OUTSIDE EDGE OF WALL SHEATHING (6" DIMENSION).
- ALL INTERIOR WALLS ARE DIMENSIONED FROM EDGE OF STUD TO EDGE OF STUD.
- CALCULATED DIMENSIONS TAKE PRECEDENCE OVER SCALED DIMENSIONS.
- ALL FRAMING SHALL HAVE A FINISHED HEIGHT OF 9'-1 1/2" U.N.O.
- ALL ANGLED WALLS ON FLOOR PLANS ARE AT A 45 DEGREE ANGLE, U.N.O.
- ABOVE ALL OPENINGS THAT ARE U.N.O.:
(A) INTERIOR NON -LOAD BEARING LESS THAN OR EQUAL TO 3'-0" USE: (2) FLAT 2 X "WALL THICKNESS" DFL #2 HEADER OR EQUIVALENT.
(B) INTERIOR NON -LOAD BEARING GREATER THAN 3'-0" USE (2) 2 X 6 DFL #2 HEADER WITH A 2 X WALL THICKNESS BOTTOM HEADER PLATE OR EQUIVALENT.
(C) INTERIOR LOAD BEARING OR EXTERIOR LESS THAN OR EQUAL TO 8'-0" USE: (2) 2 X 10 DFL #2 HEADER WITH A 2 X WALL THICKNESS BOTTOM HEADER PLATE.
(D) INTERIOR LOAD BEARING OR EXTERIOR 8'-0" - 10'-0" USE: (2) 2 X 12 DFL #2 HEADER WITH A 2 X WALL THICKNESS BOTTOM HEADER PLATE.
(E) INTERIOR LOAD BEARING OR EXTERIOR 10' - 18'-0" USE: 3 1/8" X 13 1/2" GLU-LAM DF24-VF HEADER OR EQUIVALENT.
(F) ALL OVERHEAD GARAGE DOORS USE: 3 1/8" X 13 1/2" GLU-LAM DF24-VF HEADER OR EQUIVALENT.
- FOOTS UNDER HEADERS, BEAMS, GIRDERS SHALL BE (2) 2 X STUDS OR GREATER (X MATCHING WALL THICKNESS) - U.N.O.
- ALL FLOOR & ROOF TRUSSES TO BE ENGINEERED BY TRUSS MANUFACTURER ACCORDING TO THE LOADING INDICATED ON THE PLAN.
- UNLESS NOTED OTHERWISE ALL ROOF FRAMING SHALL BE PRE-MANUFACTURED ROOF TRUSSES PER THE ROOF TRUSS MANUFACTURER
- ALL FRAMING CONNECTORS ARE TO BE SIMPSON COMPANY OR EQUIVALENT.
- CEILING HEIGHTS:
(A) 8' CLG. = 8'-1 1/8" WALL HEIGHT
(B) 9' CLG. = 9'-1 1/8" WALL HEIGHT
(C) 10' CLG. = 10'-1 1/8" WALL HEIGHT
(D) 11' CLG. = 11'-1 1/8" WALL HEIGHT
(E) 12' CLG. = 12'-1 1/8" WALL HEIGHT

MISCELLANEOUS:

- PREFABRICATED FIREPLACES AND FLUES ARE TO BE U.L. APPROVED AND INSTALLED AS PER MANUFACTURERS SPECIFICATIONS.
- ALL MATERIALS, SUPPLIES AND EQUIPMENT TO BE INSTALLED AS PER MANUFACTURERS SPECIFICATIONS AND AS PER LOCAL CODES AND REQUIREMENTS.
- 1/2" WATER RESISTANT GYPSUM BOARD AROUND SHOWERS, TUBS AND WHIRLPOOLS & AT ALL "WET" LOCATIONS - (BATH ROOMS, LAUNDRY, KITCHEN, ETC.)
- 1/2" GYPSUM BOARD ON ALL INTERIOR WALLS AND 5/8" GYPSUM BOARD ON ALL CEILINGS.
- 5/8" FIRE RATED GYPSUM BOARD ON INTERIOR GARAGE WALLS TO EXTEND FROM FLOOR TO BOTTOM OF ROOF SHEATHING AND ON THE CEILING.
- 5/8" FIRE RATED GYPSUM BOARD ON UNDERSIDE OF STAIRS.
- VENT CLOTHES DRYER, RANGE HOOD FAN, ETC. & ALL EXHAUST FANS TO OUTSIDE AIR.
- PROVIDE 22" X 30" ATTIC ACCESS.
- OMISSIONS OR CONFLICTS BETWEEN VARIOUS ELEMENTS OF THE DRAWINGS, NOTES, AND DETAILS SHALL BE BROUGHT TO THE ATTENTION OF THE OWNER AND BE RESOLVED BEFORE PROCEEDING WITH THE WORK.
- REMOVE ALL MATERIALS RESULTING FROM DEMOLITION WORK FROM THE SITE IN SUCH A MANNER AS TO AVOID CREATING A NUISANCE.
- THE CONTRACTOR OR SUBCONTRACTOR SHALL INSPECT THE PREMISES PRIOR TO COMMENCING WORK TO CHECK EXISTING WORKING CONDITIONS. SHOULD CONTRACTOR OR SUBCONTRACTOR FIND CONDITIONS WHICH THEY BELIEVE WOULD IMPEDE THEIR WORK, THEN SUCH CONDITIONS MUST BE REPORTED IMMEDIATELY TO THE OWNER. FAILURE TO SO ADVISE WILL CONSTITUTE NOTICE THAT THE CONTRACTOR IS FULLY SATISFIED AND THAT THEY INTEND TO PERFORM THEIR OBLIGATIONS WITH NO ALLOWANCE EITHER IN TIME OR MONEY FOR ANY IMPEDIMENTS TO WORK.
- ALL FRAMING SHALL BE FIELD INSPECTED BY THE OWNER AND CONDITIONS IN FIELD. ERRORS OCCUR OR CONDITIONS NOT COVERED ON THE DRAWINGS IS ENCOUNTERED CONTRACTOR SHALL NOTIFY THE OWNER BEFORE COMMENCING THAT PORTION OF THE WORK.
- DETAILS, NOTES, AND FINISHES SHALL BE APPLICABLE TO ALL TYPICAL CONDITIONS, WHETHER OR NOT REFERENCED AT ALL PLACES. WHEN WORK NOT SPECIFICALLY CALLED OUT IS REQUIRED TO COMPLETE THE PROJECT, IT SHALL BE PROVIDED AND BE OF THE BEST MATERIALS AND WORKMANSHIP.
- THE CONTRACTOR SHALL TAKE ALL NECESSARY PRECAUTIONARY MEASURES TO PROTECT THE PUBLIC AND ADJACENT PROPERTIES FROM DAMAGES THROUGHOUT CONSTRUCTION THEY SHALL MEET THE LATEST REQUIREMENTS OF THE UNITED STATES DEPARTMENT OF LABOR OCCUPATIONAL SAFETY AND HEALTH STANDARDS AND COMPLY WITH THE MANUAL OF ACCIDENT PREVENTION IN CONSTRUCTION, ALL APPLICABLE SAFETY AND SANITARY LAWS, REGULATIONS AND ORDINANCES, AND ANY SAFETY RULES OR PROCEDURES ESTABLISHED BY THE OWNER FOR THE PROJECT.
- THE CONTRACTOR IS EXCLUSIVELY RESPONSIBLE FOR LOSS OR EXPENSE RESULTING FROM INJURY ON THE PROJECT SITE, THEY ASSUME ALL RISKS IN THE PERFORMANCE OF THE WORK AND IS RESPONSIBLE FOR SUPERVISION, MATERIALS, EQUIPMENT AND LABOR REQUIRED TO IMPLEMENT THE PLANS AND SPECIFICATIONS.
- THE CONTRACTOR IS SOLELY RESPONSIBLE FOR SUPERVISION SAFETY, ADMINISTRATION AND ALL PHASES OF ITS CONTRACT. THEY ARE ALSO RESPONSIBLE FOR SCHEDULING, COORDINATING, MANAGEMENT AND ADMINISTRATION OF SUBCONSULTANTS.
- THE CONTRACTOR SHALL VERIFY THE LOCATION OF EXISTING UTILITIES AND PROTECT THE SAME.
- ALL MANUFACTURED ARTICLES, MATERIALS AND EQUIPMENT SHALL BE APPLIED, INSTALLED, CONNECTED, ERRECTED, USED, CLEANED AND CONDITIONED IN ACCORDANCE WITH THE MANUFACTURER'S WRITTEN SPECIFICATIONS OR INSTRUCTIONS UNLESS HEREINAFTER SPECIFIED TO THE CONTRARY.
- ALL WORK SHALL BE EXECUTED IN A NEAT AND WORKMANLIKE MANNER, ACCEPTABLE TO THE OWNER.
- CONTRACTOR SHALL GUARANTEE ALL WORKMANSHIP AND MATERIALS IN WRITING FOR A PERIOD OF _____ YEAR(S) FROM THE DATE OF CERTIFICATE OF OCCUPANCY.
- UNLESS OTHERWISE SPECIFICALLY NOTED, THE CONTRACTOR SHALL PROVIDE AND PAY FOR ALL LABOR, MATERIALS, EQUIPMENT, TOOLS, CONSTRUCTION EQUIPMENT AND MACHINERY, TRANSPORTATION, AND OTHER FACILITIES AND SERVICES NECESSARY FOR PROPER EXECUTION AND COMPLETION OF THE WORK.

ABBREVIATIONS

A.B. A.B.C.	ANCHOR BOLT AGGREGATE BASE COURSE	JAN. JT.	JANITOR JOINT
A / C ACOUB.	AIR CONDITIONING ACOUSTICAL	KIT.	KITCHEN
ADJ.	AIR CONDITIONING ADJUSTABLE	LAM. LAV. L.F. L.T.	LAMINATE LAYATORY LINEAT FOOT LIGHT
A.F.F. AGG. ALUM.	ABOVE FINISHED FLOOR AGGREGATE ALUMINUM	MAX. MECH. M.C. MEMB. MTL.	MAXIMUM MECHANICAL MEDICINE CABINET MEMBRANE METAL
ALT. APPROX.	ALTERNATE APPROXIMATE	MFR. MIR. MISC. M.O. M.R.	MANUFACTURER MIRROR MISCELLANEOUS MASONRY OPENING MOISTURE RESISTANT
ASPH.	ASPHALT	MTD. MUL.	MOUNTED MULLION
BD. BLDG. BLK. BLKG. BM. B.O. BOT. B.U.	BOARD BUILDING BLOCK BLOCKING BEAM BOTTOM OF BOTTOM BUILT-UP	N N.I.C. NO. OR # N.T.S.	NORTH NOT IN CONTRACT NUMBER NOT TO SCALE
CAB. C.B. C.T. CHAN. C.I. C.I.P. C.J.	CABINET CORNER BEAD CERAMIC TILE CHANNEL CAST IRON CAST IN PLACE CONSTRUCTION / CONTROL JOINT	O.A. O.C. O.D. O.F.C.I.	OVERALL ON CENTER OUTSIDE DIAMETER OWNER FINISHED
CLG. CLO. CLR. C.M.U.	CEILING CLOSET CLEAR CONCRETE	OFF. OFFNG. OPP.	OFFICE OPENING OPPOSITE
C.NTRK. CNTR. C.O. COL. CONC. CONN. CONSTR. CONT. CONTR. CORR. CTR. C.W.	COUNTERSINK COUNTER TOP CLEAN OUT COLUMN CONCRETE CONNECTION CONSTRUCTION CONTINUOUS CONTRACTOR CORRIDOR CENTER GOLD WATER	PNLG. PAR. PARTN PLATE OR PROPERTY LINE PLAS. PLASTER FR. F.V.C. PLYWD.	PANELING PARAPET PARTNER PLATE OR PROPERTY LINE PLASTIC LAMINATE FLASTER FAIR FOLLY VINYL CHLORIDE PLYWOOD
DBL. DEPT. D.F. DIA. DIM. DISP. D.N. DN/SPT. D.O. D.R. D.TL. DWG. DWR.	DOUBLE DEPARTMENT DRAINAGE FLOW DIAMETER DIMENSION DISPENSER DOWN DOWNSPOUT DOOR OPENING DOOR DETAIL DRAWING DRAWER	Q.T.	QUARRY TILE
E. EA. E.J. ELEC. ELEC. PAN. ELEV. EMER. ENCL. EQ. EQUIP. EXIST. EXP. EXT.	EAST EACH EXPANSION JOINT ELECTRICAL ELECTRICAL ELEVATION ELEVATOR ENCLOSURE EQUIPMENT EXISTING EXPANSION EXTERIOR	R. RAD. R.A. R.D. REDUD. REF. REFRIG. REINFC. REQD RESILIENT RM. R.O. ROOF'G	RISER RADIUS RETURN AIR ROOF DRAIN REDWOOD REFERENCE REFRIGERATOR REINFORCED REQUIRED RESILIENT ROOM ROUGH OPENING ROOFING
E.A. E.L. E.P. ELEV. EMER. ENCL. EQ. EQUIP. EXIST. EXP. EXT.	EAST EACH EXPANSION JOINT ELECTRICAL ELECTRICAL ELEVATION ELEVATOR ENCLOSURE EQUIPMENT EXISTING EXPANSION EXTERIOR	S. S.A. S.C. SCHED. SECT. S.F. SH. SHR. SHT. SIM. SPEC. SQUAR. S.S. STD. STL. STOR. STRUCT. SUBP. SYM.	SOUTH SUPPLY AIR SOLID CORE SCHEDULE SECTION SQUARE FEET SHelf SHOWER SHEET SIMILAR SPECIFICATION SQUARE STAINLESS STEEL STANDARD STEEL STORAGE STRUCTURAL SUSPENDED SYMMETRICAL
F.D. FOUND. FBRGL. FIRE F.E.	FLOOR DRAIN FOUNDATION FIBERGLASS FIRE EXTINGUISHER	T. T & G THK. T.O. T.O.C. T.O.W. T.S. T.T.B. TYP.	TREAD TELEPHONE TONGUE AND GROOVE THICK TOP OF TOP OF CURB TOP OF WALL TUBE STEEL TELEPHONE TERMINAL BOARD TYPICAL
F.E.C. FFE. F.G. FIN. FIXT. FLASH'G FLR. FLUOR. FRFRF. FRMG. FT. FTG. FURN. FURR.	FIRE EXT- GUISHER CAB. FINISH FLOOR ELEVATION FINISH GRADE FINISH FIXTURE FLASHING FLOOR FLUORESCENT FIREPROOF FRAMING FOOT OR FEET FOOTING FURNITURE FURRING	U.N.O. UR.	UNLESS NOTED OTHERWISE URINAL
GA. GALV. GL. G.L.B.M. GR. GRND. GYP. BD.	GAUGE GALVANIZED GLASS GLU-LAM BEAM GRADE GROUND GYPSUM BOARD.	V.C.T. VERT. VTR.	VYNIL COMPOSITION TILE VERTICAL VENT-THRU ROOF
H.B. H.C. H.C.P. HOUR. H.M. HORIZ. HT. H.W.	HOSE BIBB HOLLOW CORE HANDICAP HARDWOOD HARDWARE HOLLOW METAL HORIZONTAL HEIGHT HOT WATER	W. W / 4 W/O W.C. W.D. W.D.W. W.P. W.R. W.S. W.T.	WEST WITH AND WITHOUT WATER CLOSET WOOD WINDOW WEATHERPROOF WATER RESISTANT WEEP SCREEN WEIGHT
I.D. INSUL. INT. INV.	INSIDE INSULATION INTERIOR INVERT		

BUILDING INFORMATION

LEGAL DESCRIPTION:

OWNER INFORMATION:

BUILDING DATA - HOUSE:

HOUSE.....	1313 SQ. FT.
COVERED ENTRY.....	63 SQ. FT.
COVERED PATIO.....	193 SQ. FT.
CAR PORT.....	284 SQ. FT.
DETACHED CAR PORT.....	529 SQ. FT.
SUB - TOTAL.....	2382 SQ. FT.
ADDITION 1.....	192 SQ. FT.
ADDITION 2.....	60 SQ. FT.
SUB - TOTAL.....	252 SQ. FT.
TOTAL.....	2634 SQ. FT.

BUILDING FOOTPRINT TOTAL: 2634 SQ. FT.

ZONING..... RI-1

OCCUPANCY..... R3

CONSTRUCTION..... TYPE V - 1 HOUR

MAX. BLDG. HGT..... 30' / 2 STORIES

ACTUAL BLDG. HGT.....

LOT SETBACKS:

FRONT..... 20'

BACK..... 25'

INTERIOR SIDE..... 5'

EXTERIOR SIDE..... 10' (50% OF FRONT YARD)

LOT SIZE: 6455 SQ. FT. (.15 ACRES)

MAX. LOT COVERAGE: 45%

LOT COVERAGE: 2634 SQ. FT. / 6455 SQ. FT. = 41% TOTAL LOT COVERAGE

SHEET INDEX

- A 1.0 COVER SHEET & SITE PLAN
- A 1.1 FOUNDATION PLAN
- A 1.2 EXISTING CONDITIONS / DEMOLITION FLOOR PLAN
- A 1.3 RENOVATION FLOOR PLAN
- A 1.4 BRACED WALL FLOOR PLAN
- A 1.5 ROOF FRAMING PLAN
- A 2.1 EXTERIOR ELEVATIONS
- A 2.2 EXTERIOR DETAILS
- A 3.1 BUILDING SECTIONS
- A 4.1 FRAMING DETAILS
- E 1.1 SCHEMATIC ELECTRICAL PLAN
- M 1.1 SCHEMATIC MECHANICAL PLAN
- P 1.1 SCHEMATIC PLUMBING PLAN



DESIGN CRITERIA

DESIGN CRITERIA:

ROOF LOAD:	DL = 20 PSF / LL + 20 PSF (SNOW) = 40 PSF
FLOOR LOAD:	DL = 20 PSF / LL + 40 PSF + 60 PSF
DECK LOAD:	DL = 20 PSF / LL + 60 PSF + 80 PSF
WIND LOAD:	90 MPH / 20 PSF
SEISMIC ZONE:	C
SOIL BEARING:	1500 PSF MAX. UNLESS A HIGHER VALUE IS SUBSTANTIATED BY SOILS TESTING

EFFECTIVE CODE:

- 2018 INTERNATIONAL RESIDENTIAL CODE (IRC)
- 2018 INTERNATIONAL PLUMBING CODE (IPC)
- 2018 INTERNATIONAL MECHANICAL CODE (IMC)
- 2018 INTERNATIONAL FUEL GAS CODE (IFGC)
- 2017 NATIONAL ELECTRIC CODE (NEC)
- 2018 INTERNATIONAL SWIMMING POOL AND SPA CODE (ISPCS)
- 2006 INTERNATIONAL ENERGY CONSERVATION CODE (IECC)

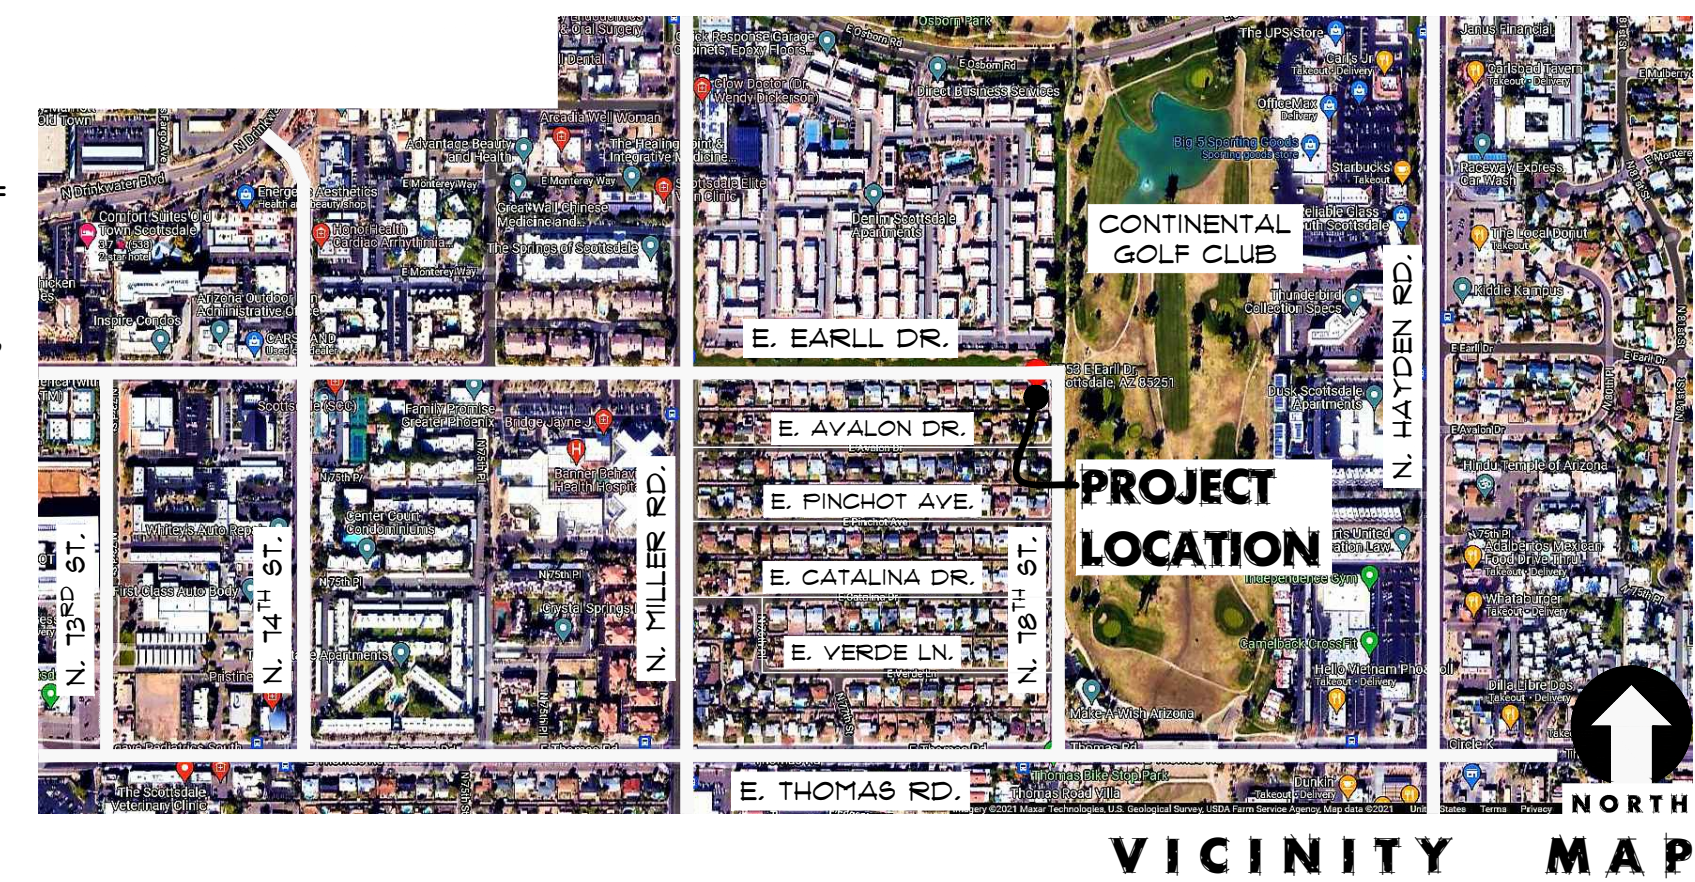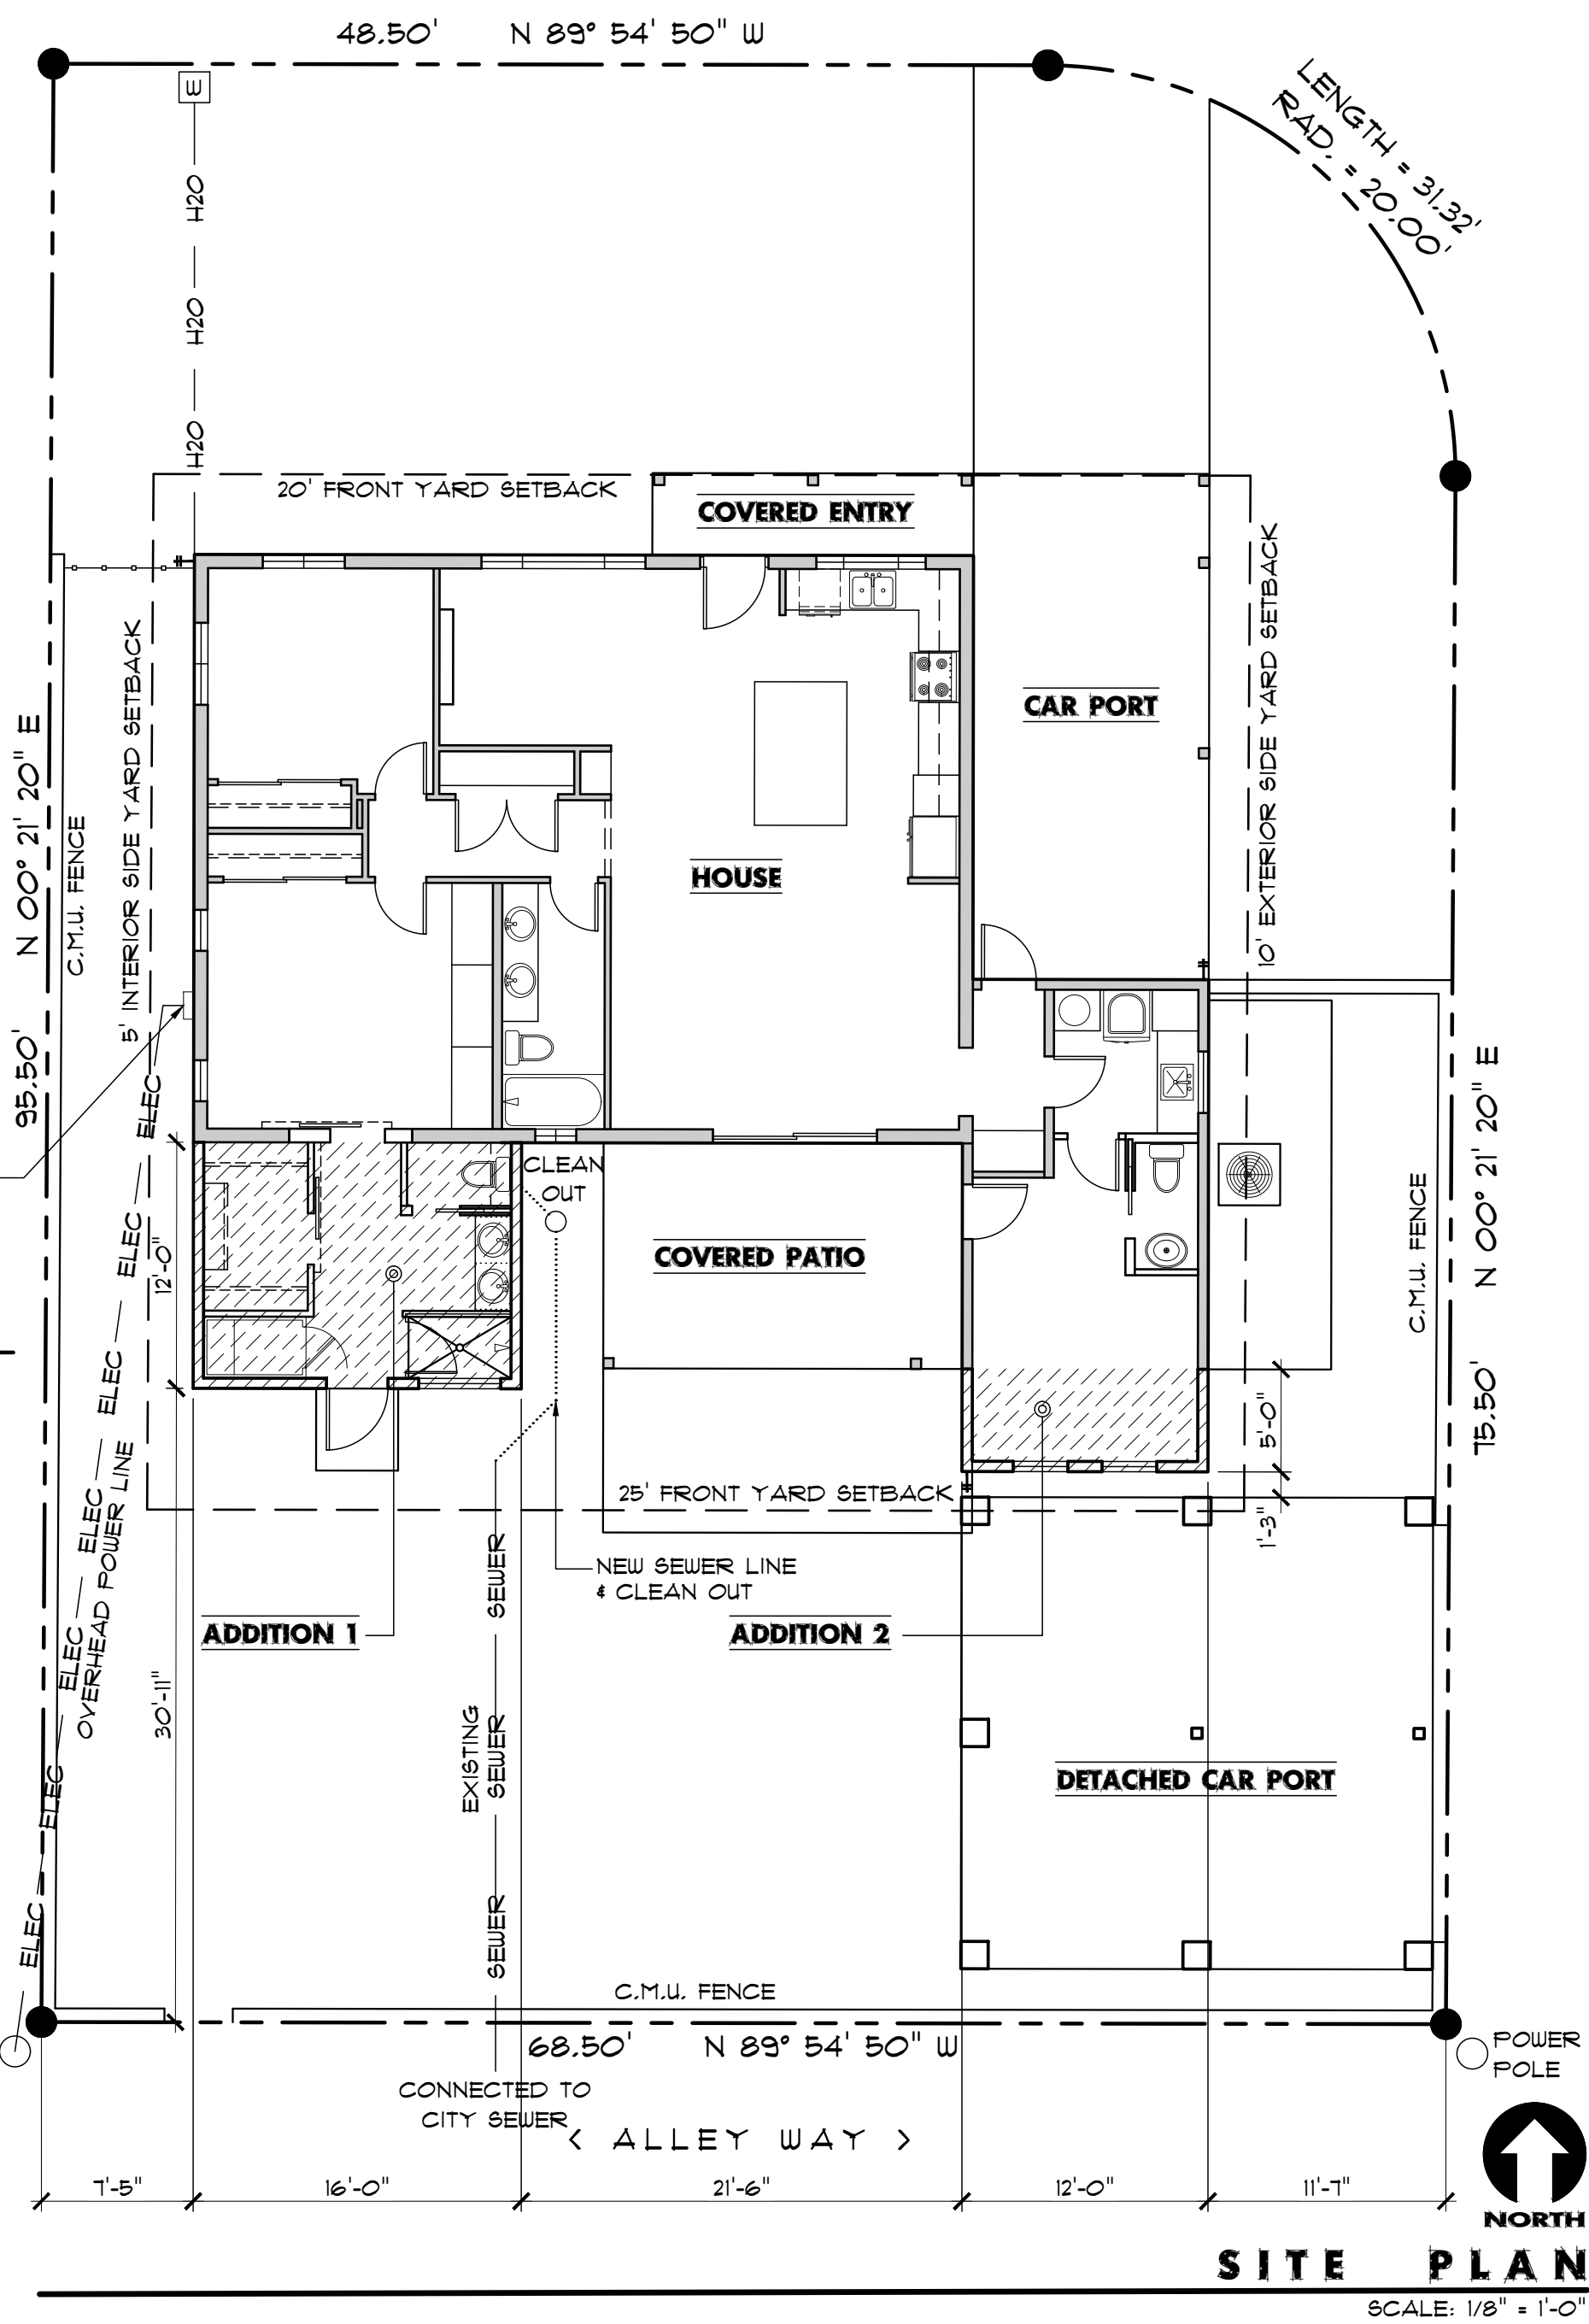

RENOVATION

COVER SHEET & SITE PLAN

DATE: 9-10-21

SCALE: AS NOTED

DRAWN:

JOB:

SHEET NO.:

A
1.0


GENERAL FOUNDATION NOTES:

1. SPREAD AND OR CONTINUOUS FOOTING BEARING MATERIALS SHOULD EITHER BE ON UNDISTURBED SOILS OR 95% COMPACTED SOIL IN 12" LIFTS NOT TO EXCEED 4'-0". UNLESS APPROVED BY CERTIFIED INSPECTION OR BUILDING OFFICIAL.
2. BOTTOM OF FOOTING SHALL BE NO LESS THAN 12" BELOW NATURAL GRADE OR CERTIFIED COMPACTED PAD AND ALWAYS BELOW FROST LINE.
3. ALLOWABLE FOUNDATION BEARING PRESSURE SHALL BE 1500 P.S.I.
4. FINISH GRADE SHALL SLOPE 5% MINIMUM FOR A DISTANCE OF 10'-0" AWAY FROM STRUCTURE TOWARD AND APPROVED WATER DISPOSAL AREA.
5. FINISHED FLOOR SHALL BE A MINIMUM OF 8" ABOVE ADJACENT FINISHED GRADE.
6. SLOPE OF LANDINGS AT DOORWAYS SHALL BE A MINIMUM OF 1" PER 10'-0".
7. UNLESS APPROVED OTHERWISE, ALL CONCRETE SLABS ON GRADE SHALL BE BOUNDED BY CONTROL JOINTS (KEYED OR SAW CUT) SUCH THAT THE ENCLOSED AREA DOES NOT EXCEED 400 SQ. FT. -SAW CUT WITHIN 24 HOUR PERIOD AFTER POUR.
8. ALL FOOTINGS SHALL BE 3000 P.S.I. (28 DAY COMPRESSIVE STRENGTH CONCRETE) WITH HORIZ. #4 REBAR CONTINUOUS (OVERLAP REBAR 30 BAR DIAMETERS) AT TOP & BOTTOM. FOOTING SIZE = 12" (WIDE) X 18" (DEEP), U.N.O.
9. ALL SLABS ON GRADE SHALL BE 3000 P.S.I. (28 DAY COMPRESSIVE STRENGTH CONCRETE) UNLESS NOTED OTHERWISE.
10. ALL SLABS ON GRADE SHALL BE 4" THICK (MIN.) AND BEAR ON 4" (MIN.) COMPACTED AGGREGATE BASE COURSE (COMPACTED TO 95%) UNLESS NOTED OTHERWISE.
11. FOUNDATION WALLS ARE NOT TO BE BACKFILLED UNTIL FLOOR SYSTEM IS COMPLETELY IN PLACE.
12. INSTALL 1/2" DIA. X 12" ANCHOR BOLTS TO 2x6 PRE-TREATED SILL PLATE OVER SILL SEALER AT 48" O.C. & NOT MORE THAN 12" FROM ANY CORNER OR END OF PLATE.
13. IN THE EVENT THAT STEPPED FOOTINGS ARE REQUIRED - HORIZONTAL DIMENSION = 32" (MIN.) ; VERTICAL DIMENSION = 24" (MAX.)
14. ALL REINFORCING STEEL FOR CONCRETE SHALL COMPLY WITH ASTM SPECIFICATION A-615 GRADE 60.
15. CONTRACTOR TO PROVIDE 30' OF #4 COPPER U.F.F.R. WIRE 20' TO BE TIED TO FOOTING STEEL & 10' AVAILABLE AT PANEL LOCATION.
16. WHERE HOLD DOWNS ARE PLACED, ALL REBARS, ANCHOR BOLTS & SSBT BOLTS MUST BE TIED IN PLACE BEFORE PLACING ANY CONCRETE. NO "WET STABBING" ALLOWED.

- X INDICATES POINT LOAD FROM ABOVE - SEE FLOOR PLAN
- ▲ SIMPSON HOLD DOWN DEVICE - SEE WALL BRACING FLOOR PLAN


FOOTING SCHEDULE

- △ SEE DETAIL 1 / A1.1

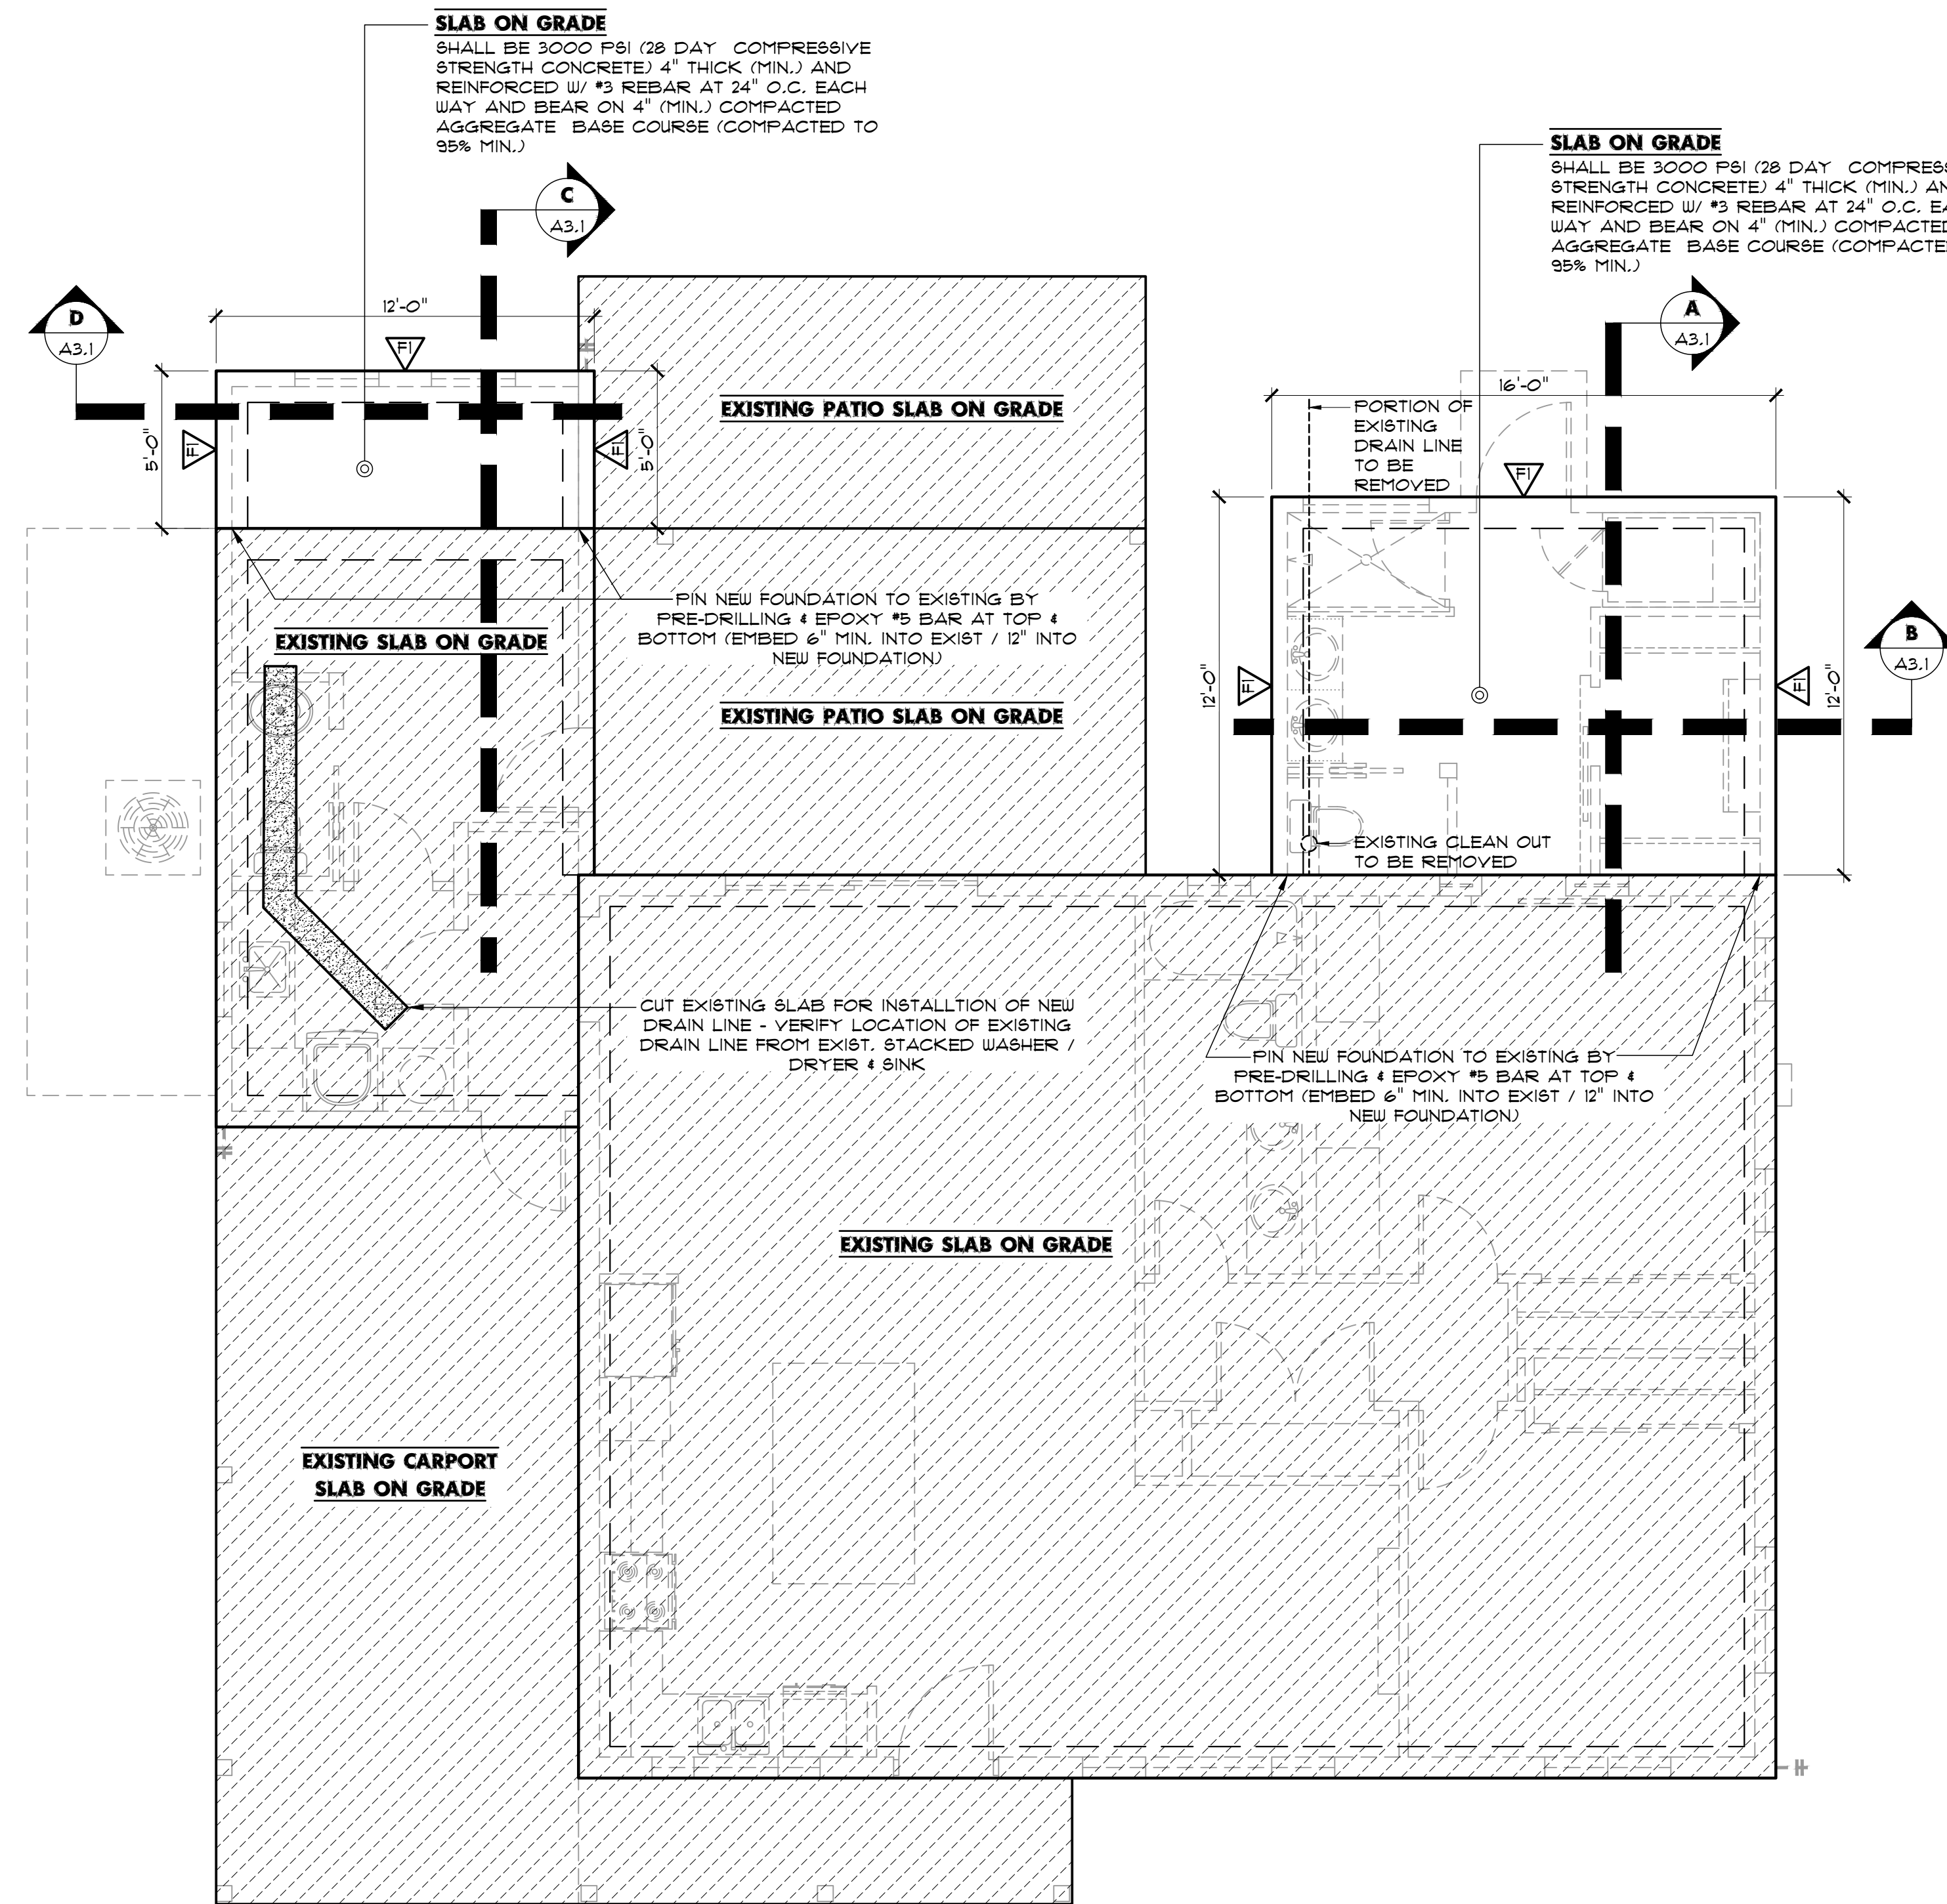

KEY NOTES:


1. CONTINUOUS CONCRETE FOOTING REINF. W/ #4 BARS CONTINUOUS (OVERLAP REBAR 30 BAR DIAMETERS) AT TOP & BOTTOM
2. 4" COMPACTED (95% MIN.) AGG. BASE COURSE
3. 4" CONC. SLAB REINF. W/ #3 BARS AT 24" O.C. EACH WAY
4. 2 X 6 PRE-TREATED SILL PLATE OVER SILL SEALER W/ 1/2" DIA. X 12" ANCHOR BOLTS @ 48" O.C. 114"X: 4 12" FROM CORNERS & END OF PLATES - INSTALL 60 EXTERIOR WALL SHEATHING IS FLUSH WITH FOUNDATION WALL
5. WALL FRAMING - SEE FLOOR PLAN AND TYPICAL WALL SECTION

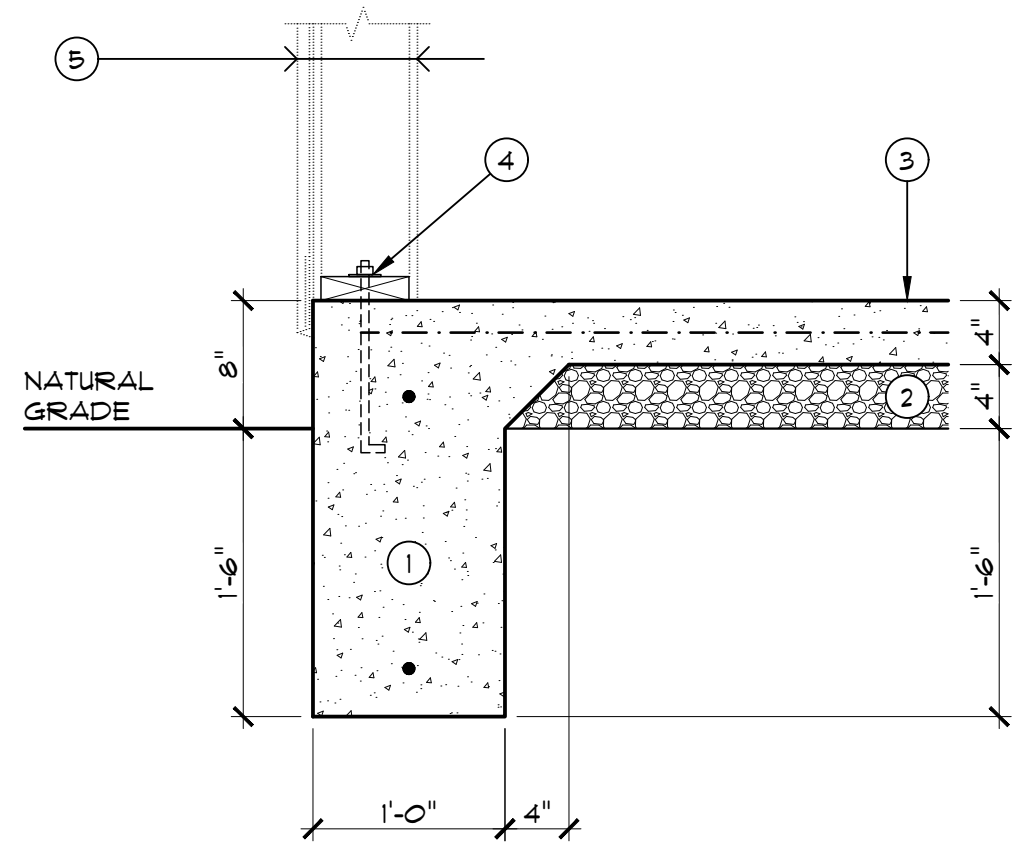

TYPICAL FOOTING DETAIL
SCALE: 1" = 1'-0"

FOUNDATION PLAN
SCALE: 1/4" = 1'-0"

NOTE: ALL REBAR TO BE 3" CLEAR FROM SOIL

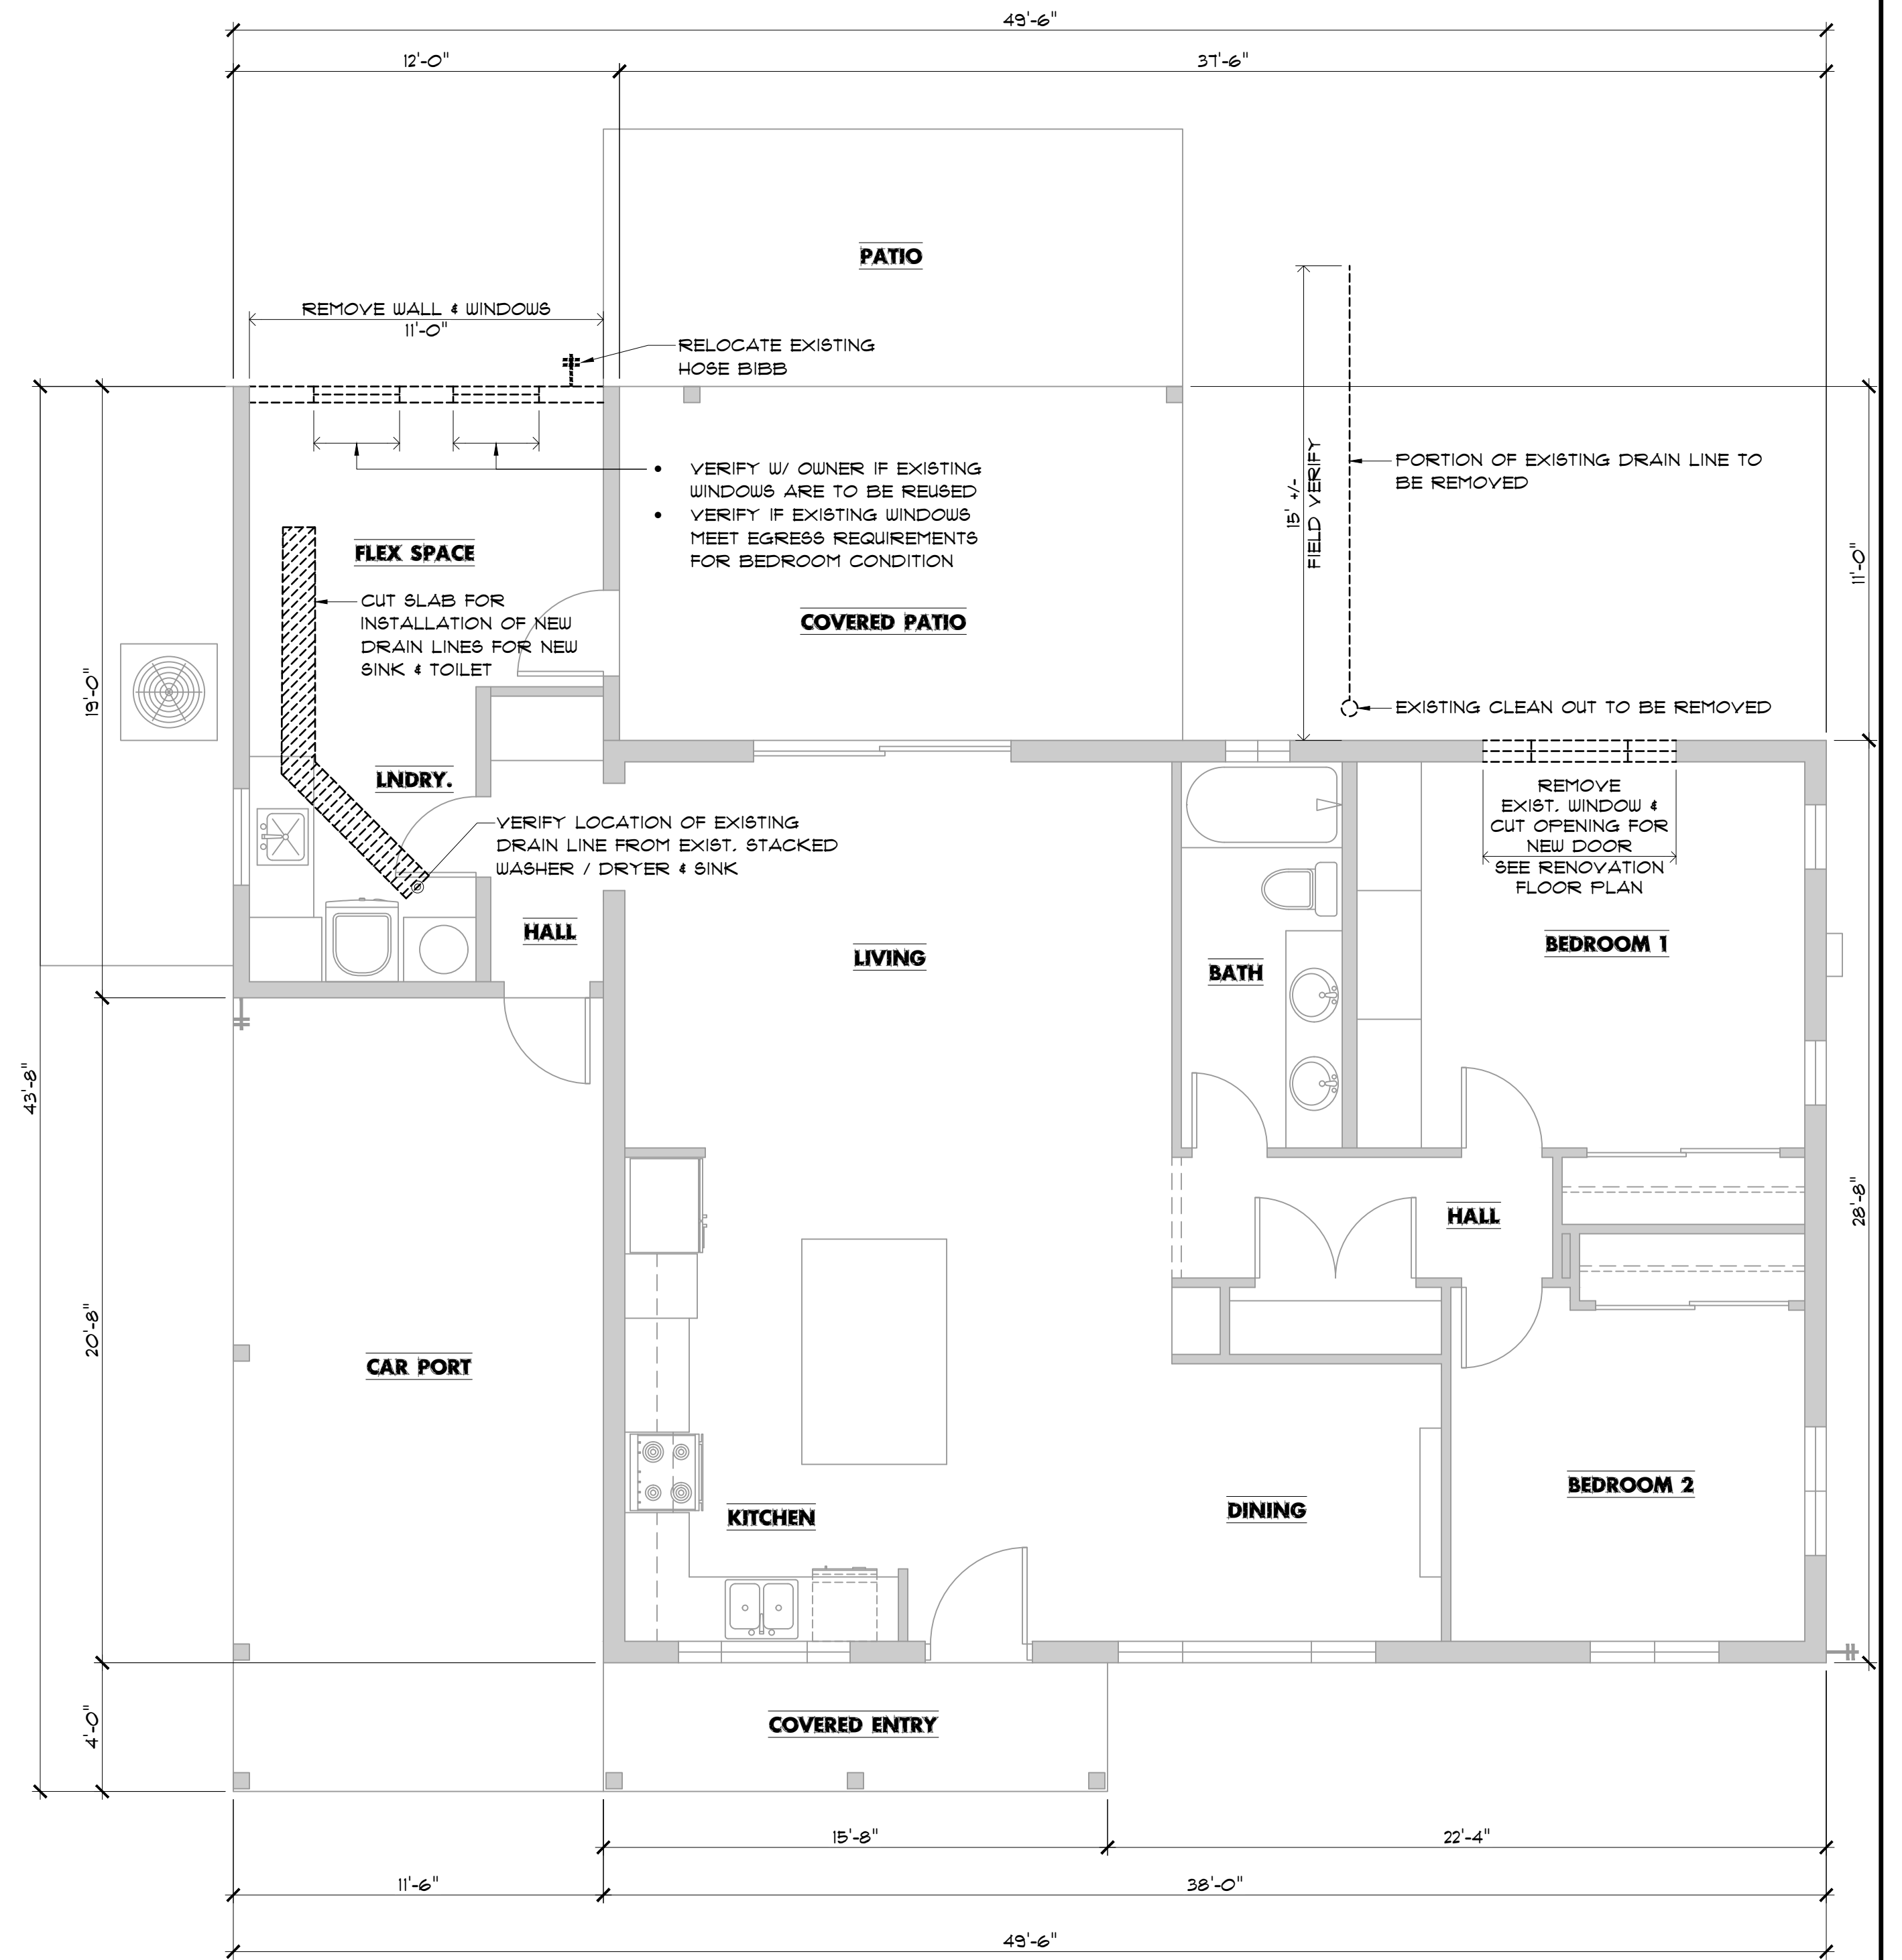


EXISTING CONDITIONS / DEMOLITION FLOOR PLAN

DEMOLITION ITEMS
SCALE: 1/4" = 1'-0"

**RENOVATION
EXISTING CONDITIONS /
DEMOLITION FLOOR PLAN**

DATE: 9 - 10 - 21
SCALE: AS NOTED
DRAWN:
JOB:
SHEET NO.:

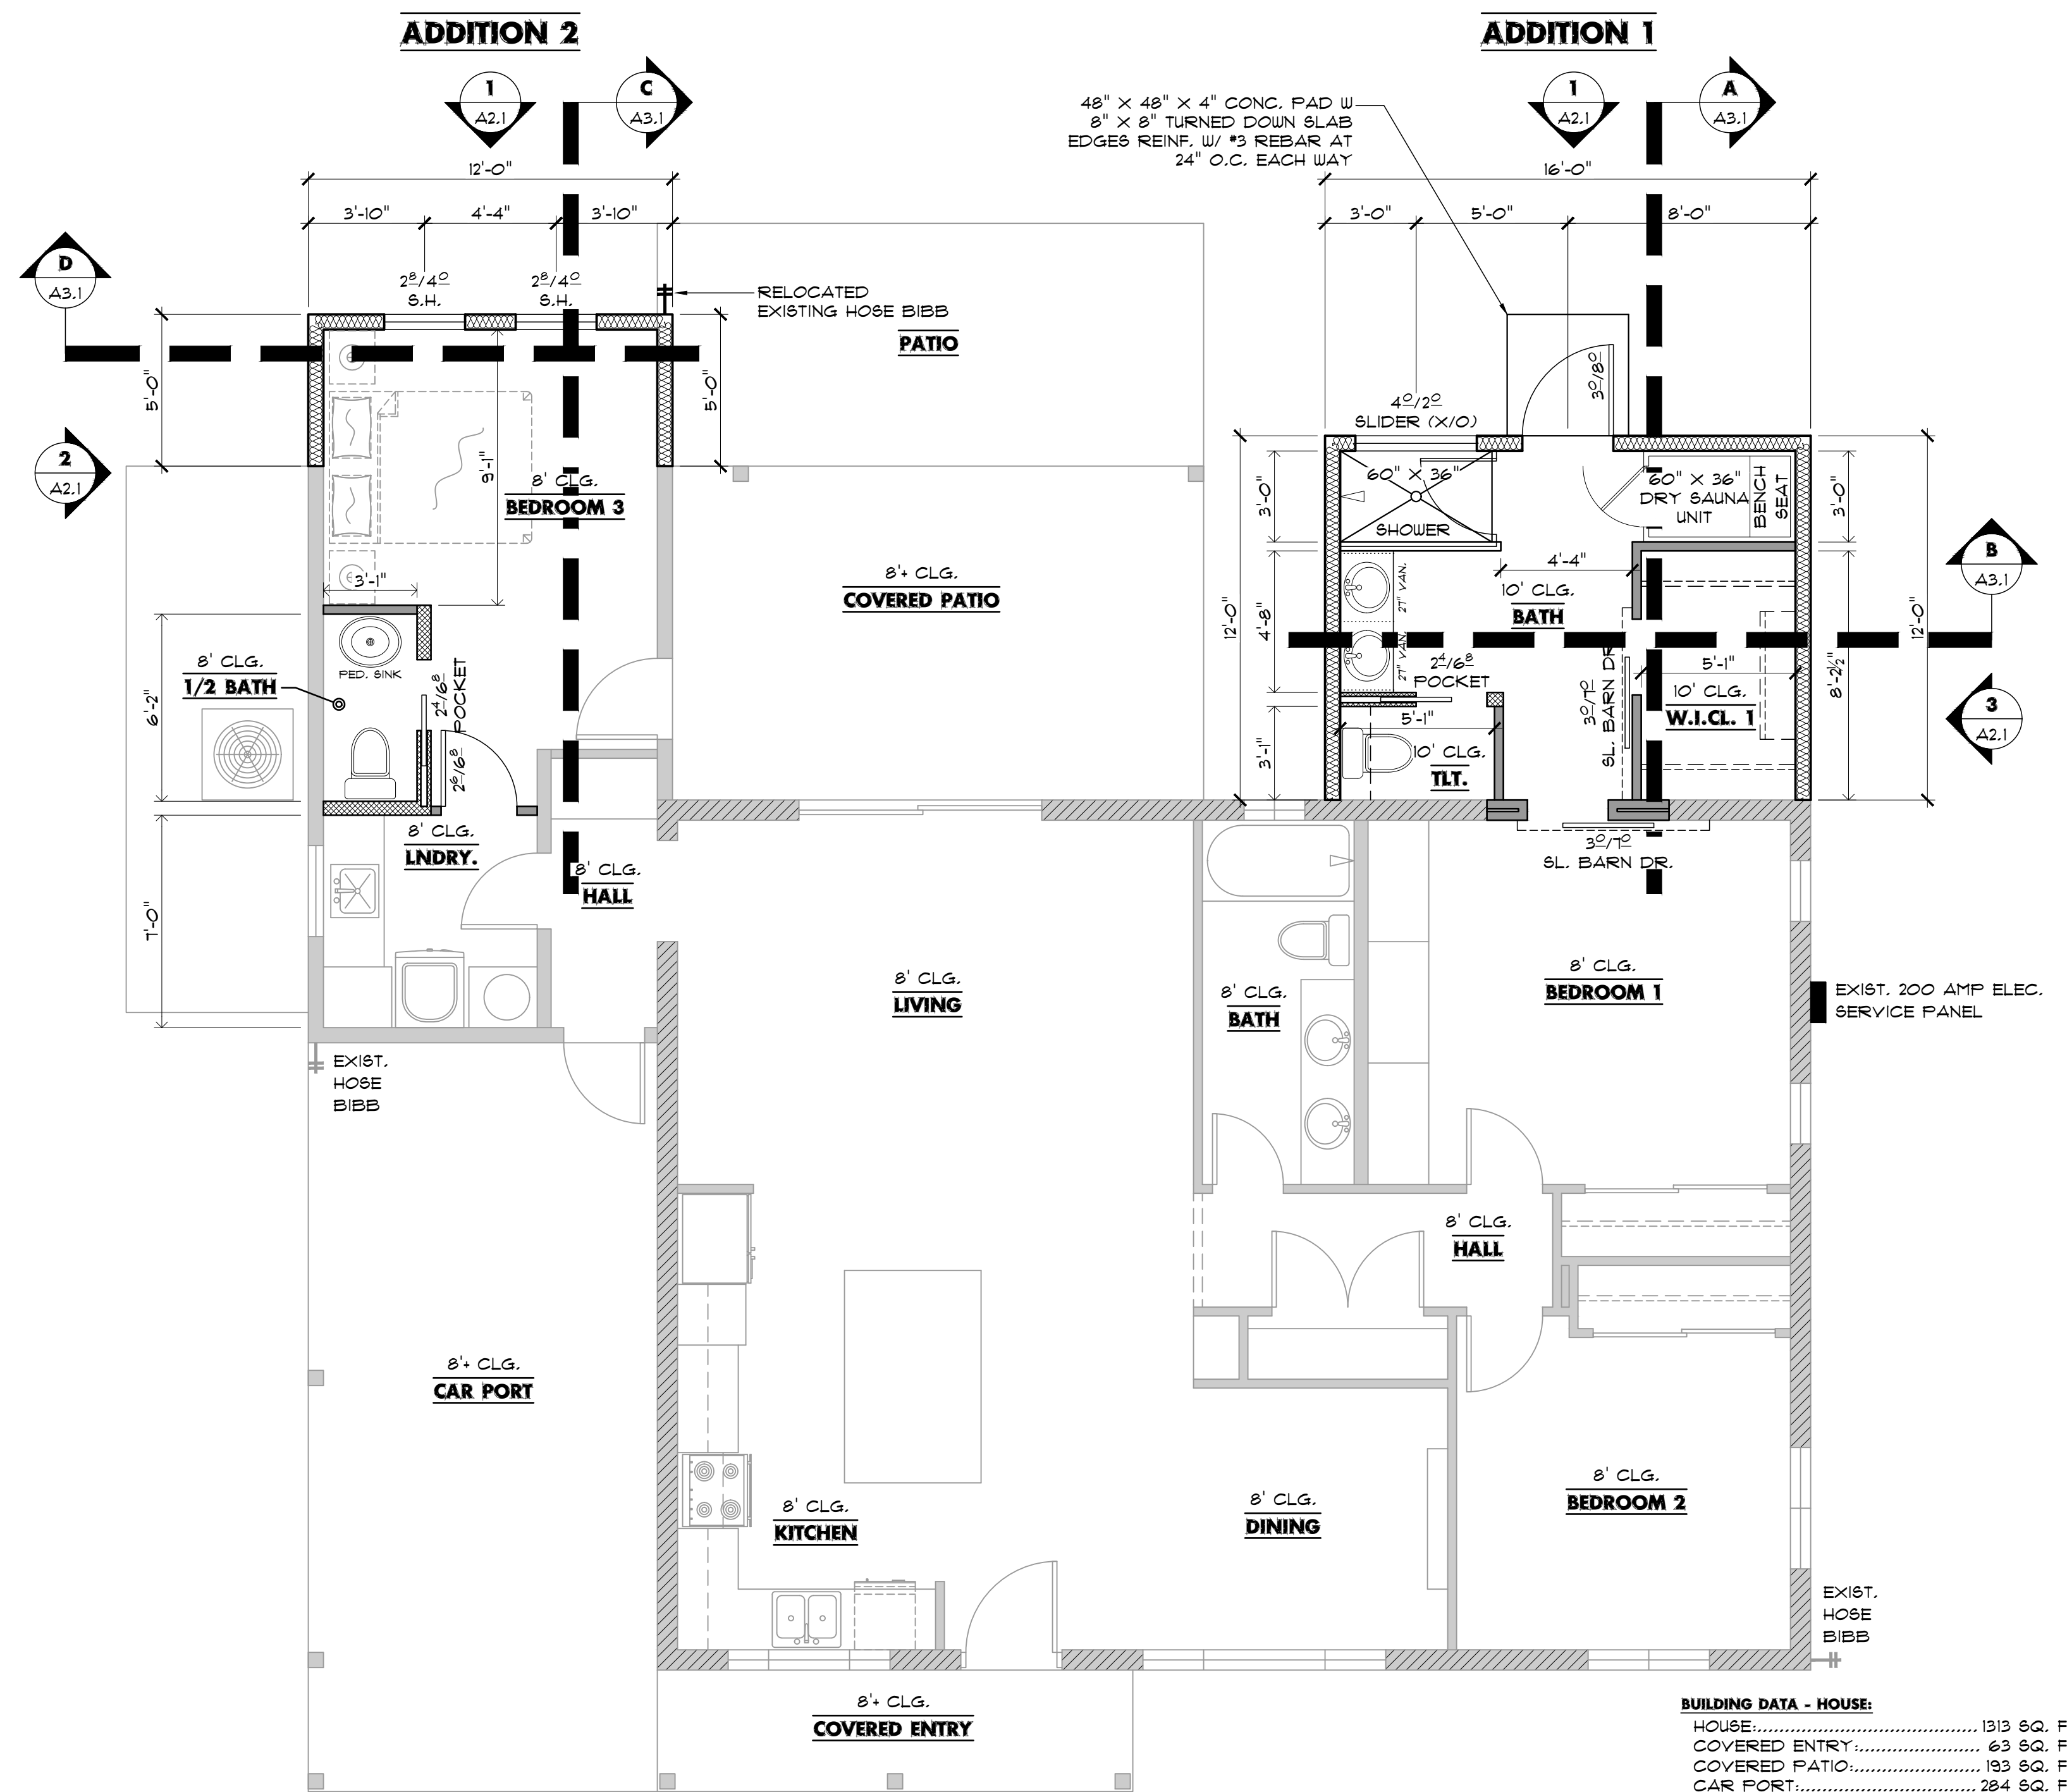

48" X 48" X 4" CONC. PAD W
8" X 8" TURNED DOWN SLAB
EDGES REINF. W/ #3 REBAR AT
24" O.C. EACH WAY

WALL TYPE LEGEND:

----- TYPICAL 2" X 6" EXTERIOR WALL (6" DIM.);

- EXTERIOR FINISH PER ELEVATIONS
- "TYVEK" BUILDING WRAP
- 3/8" PLYWOOD / OSB WALL SHEATHING
- 2" X 6" STUDS @ 16" O.C.
- WALL INSULATION (R-21 MIN.)
- 1/2" GYPSUM BOARD

----- TYP. 2" X 6" INTERIOR WALL (5 1/2" DIM.);

- 1/2" GYPSUM BOARD
- 2" X 6" STUDS @ 16" O.C.
- 1/2" GYPSUM BOARD

----- TYP. 2" X 4" INTERIOR WALL (3 1/2" DIM.);

- 1/2" GYPSUM BOARD
- 2" X 4" STUDS @ 16" O.C.
- 1/2" GYPSUM BOARD

----- BUILT-UP STUDS OR SOLID WOOD POST / COL.

MIN. WIDTH = BEAM WIDTH 4" / OR GIRDER TRUSS FLYS X MIN. DEPTH + WALL DEPTH - UNLESS NOTED OTHERWISE

----- LOAD BEARING INTERIOR WALL
SEE FOUNDATION PLAN FOR FOOTING INFO.

CEILING HEIGHTS:

- 8' CLG. = 8'-1 1/8" WALL HEIGHT
- 9' CLG. = 9'-1 1/8" WALL HEIGHT
- 10' CLG. = 10'-1 1/8" WALL HEIGHT
- 11' CLG. = 11'-1 1/8" WALL HEIGHT
- 12' CLG. = 12'-1 1/8" WALL HEIGHT

GENERAL WINDOW / DOOR NOTES:

1. FACTORY ENERGY PERFORMANCE RATING STICKERS MUST REMAIN ON WINDOWS / SKYLIGHTS UNTIL INSPECTED.
2. ALL BEDROOM WINDOWS SHALL HAVE A MINIMUM NET CLEAR OPENING OF 5:1 SQ. FT. THE MINIMUM NET CLEAR OPENING HEIGHT DIMENSION SHALL BE 24". THE MINIMUM NET CLEAR OPENING WIDTH DIMENSION SHALL BE 20". THE FINISHED SILL HEIGHT SHALL BE NOT MORE THAN 44" ABOVE THE FLOOR.
3. ALL WINDOWS AND DOORS SHALL BE FLASHED ACCORDING TO MANUFACTURER'S INSTALLATION INSTRUCTIONS.
4. ALL WINDOWS AND DOORS SHALL COMPLY WITH THE 2006 IECC INTERNATIONAL ENERGY CONSERVATION CODE.
5. ALL OPERABLE WINDOWS SHALL HAVE SCREENS.
6. CONTRACTOR TO COORDINATE SIZE OF ROUGH OPENINGS FOR DOORS AND WINDOWS WITH MASONRY AND FRAMING CONTRACTORS TO ALLOW FOR USE OF STANDARD SIZE DOOR AND WINDOW. ANY CONFLICT BETWEEN STANDARD SIZES AND ROUGH OPENINGS PRIOR TO START OF CONSTRUCTION SHALL PLACE BURDEN ON CONTRACTOR TO OBTAIN WRITTEN CLARIFICATION FROM WINDOW / DOOR MANUFACTURER.
7. ALL WINDOW UNITS LOCATED IN SLEEPING AREAS ARE TO PROVIDE OPERABLE SECTIONS TO CONFORM WITH EMERGENCY EGRESS IN 2018 IRC CODES.

FENESTRATION
U-FACTOR WINDOWS & DOORS: ZONE 2 = .40
SKYLIGHT U-FACTOR: ZONE 2 = .65
GLAZED FENESTRATION SHGC: ZONE 2 = .25

WINDOW & DOOR MANUFACTURER: PER OWNER
WINDOW MODEL: PER OWNER
DOOR MODEL: PER OWNER
COLOR: PER OWNER

- GENERAL FLOOR PLAN NOTES:**
1. THE DRAWINGS INDICATE THE GENERAL SCOPE OF THE PROJECT IN TERMS OF ARCHITECTURAL DESIGN CONCEPT, THE DIMENSIONS OF THE BUILDING, THE MAJOR ARCHITECTURAL ELEMENTS, AND THE TYPE OF STRUCTURAL, MECHANICAL AND ELECTRICAL SYSTEMS. AS SCOPE OF DOCUMENTS, THE DRAWINGS DO NOT NECESSARILY INDICATE OR DESCRIBE ALL WORK REQUIRED FOR FULL PERFORMANCE AND COMPLETION OR THE REQUIREMENTS OF THE CONTRACT DOCUMENTS. ON THE BASIS OF THE GENERAL SCOPE INDICATED OR DESCRIBED, THE TRADE CONTRACTORS SHALL FURNISH ALL ITEMS REQUIRED FOR THE PROPER EXECUTION AND COMPLETION OF THE WORK.
 2. ALL ANGLES ARE 45 DEGREES UNLESS NOTED OTHERWISE.
 3. ALL DIMENSIONS ARE TO FACE OF STUD OR FACE OF CONCRETE OR FACE OF MASONRY STEM WALL UNLESS NOTED OTHERWISE. THESE DRAWINGS MUST NOT BE SCALED. WRITTEN DIMENSIONS TAKE PRECEDENCE AND SHALL BE VERIFIED BY THE CONTRACTOR ON THE JOB SITE. SHOULD DISCREPANCIES OCCUR, THE OWNER AND/OR DESIGNER SHALL BE NOTIFIED FOR ACCEPTABLE RESOLUTION BEFORE PROCEEDING WITH THE WORK.
 4. THE EXTERIOR SIDE OF ALL EXTERIOR WALLS AND INTERIOR WALLS WHERE REQUIRED SHALL BE BRACED AS REQUIRED PER 2018 IRC SECTION R602.10.4 BRACED WALL PANEL CONSTRUCTION METHOD CS-WSP (CONTINUOUSLY SHEATHED WOOD STRUCTURAL PANEL); CONTINUOUS 3/8" (MIN.) PLYWOOD / OSB WALL SHEATHING WITH 16-INCH STUD SPACING. WOOD STRUCTURAL PANELS SHALL BE INSTALLED W/ 8D NAILS AT 4" O.C. AT ALL PANEL EDGES & 12" O.C. ON ALL FRAMING MEMBERS NOT AT PANEL EDGES.
 5. ALL EXTERIOR RATED WALL SHEATHING SHALL BE INSTALLED WITH 1/8" SEPARATION AT ENDS AND EDGES OF SHEATHING PANELS. DO NOT BUTT PANEL EDGES TIGHT.
 6. PROVIDE MIN. 2 X 4 BLOCKING / BACKING IN WALLS AS REQUIRED AT ALL AREAS TO RECEIVE BUILT-IN CABINETS, EQUIPMENT, HARDWARE AND ACCESSORIES (I.E. TOWEL BARS, GRAB BARS, DOOR BUMPERS AND OTHER ITEMS THAT NEED SUBSTANTIAL FULL OUT RESISTANCE AND OR SUPPORT BACKING).
 7. ALL EXTERIOR WALLS COMMON TO HABITABLE AREAS SHALL HAVE A MINIMUM R-13 CEILING SHALL HAVE A MINIMUM R-38, AND CRAWL SPACES SHALL HAVE A MINIMUM R-13 INSULATION VALUE SPECIFICALLY FOR ZONE 4.
 8. INSULATION SHALL BE IN SUBSTANTIAL CONTACT WITH THE SURFACE BEING INSULATED TO AVOID AIR PATHS THAT BYPASS THE INSULATION AND SHALL NOT BE COMPRESSED AND SHALL FILL ALL CAVITIES. CUT INSULATION TO FIT BEHIND ELECTRICAL BOXES, SLICE TO FIT BEHIND AND IN FRONT OF WIRING, PLUMBING AND OTHER HORIZONTAL AND VERTICAL RUNS IN WALL CAVITY.
 9. MARKERS SHALL BE INSTALLED FOR BLOW-IN INSULATION AFFIXED TO THE TRUSSES OR JOISTS AND MARKED WITH A MINIMUM INITIAL INSTALLED THICKNESS BY ONE INCH HIGH NUMBERS. ONE MARKER FOR EVERY 300 SQ. FT. OF AREA AND NUMBER FACING THE ATTIC ACCESS OPENING. LADDER MUST BE PROVIDED AT INSPECTION.
 10. ALL EXTERIOR WALL ASSEMBLIES OR BUILDING THERMAL ENVELOPE SHALL BE DURABLY SEALED TO LIMIT INFILTRATION (ALL SOURCES OF AIR LEAKAGE SHALL BE SEALED).
 11. BOTTOM AND TOP PLATE OF EXTERIOR WALLS SHALL BE SEALED WITH SILL GASKET OR CAULKING.
 12. ALL DUCT SUPPLY AND RETURN SHALL BE INSULATED MINIMUM R-6 (EXCEPT DUCTS THAT ARE COMPLETELY INSIDE THE BUILDING THERMAL ENVELOPE).
 13. ALL MECHANICAL SYSTEM PIPING INSULATION SHALL BE MINIMUM R-2.
 14. ALL CIRCULATING HOT WATER SYSTEMS SHALL BE A MINIMUM R-2 (HOT WATER PIPING ONLY).
 15. HEATING AND COOLING UNITS TO BE SIZED IN ACCORDANCE WITH 2018 IRC M140.3
 16. ALL EXTERIOR WALLS: 2 X 6 STUDS AT 16" O.C. UNLESS NOTED OTHERWISE
 17. INTERIOR BEARING WALL: 2 X 6 STUDS AT 16" O.C. WITH 2 X BLOCKING AT THIRD POINTS TYPICAL UNLESS NOTED OTHERWISE
 18. INTERIOR NON-BEARING WALLS: 2 X 4 STUDS AT 16" O.C. UNLESS NOTED OTHERWISE
 19. POSTS UNDER HEADERS, BEAMS, GIRDER SHALL BE (2) 2 X STUDS OR GREATER (MATCHING WALL THICKNESS)
 20. MULTIPLE STUDS ARE TO BE SPIKED TOGETHER WITH 10d COMMON NAILS AT 8" O.C. ALONG LENGTH & STAGGERED 1 1/2" ABOUT CENTER LINE
 21. DOUBLE TOP PLATE UNLESS NOTED OTHERWISE - SPLICE PLATES MIN. 24" OR USE SPLICE PLATE STRAPS
 22. WALL SHEATHING TO BE 3/8" OSB / PLYWOOD. LEAVE 1/8" GAPS BETWEEN SHEATHING PANELS & 1/8" GAPS AROUND OPENINGS FOR WINDOWS & DOORS. FASTEN PANELS WITH 2" COMMON (6d) OR 1 3/4" DEFORMED SHANK NAILS AT 6" O.C. ALONG PANEL EDGES AND AT 12" O.C. ALONG THE INTERMEDIATE SUPPORTS. KEEP NAILS 3/8" AWAY FROM PANEL EDGES
 23. ROOF SHEATHING TO BE 5/8" RATED OSB / PLYWOOD W/ "H" CLIPS FASTENED W/ 8d COMMON NAILS AT 6" O.C. ALONG PANEL EDGE AND 12" IN THE FIELD
 24. PROVIDE BLOCKING AS REQUIRED AT ALL AREAS TO RECEIVE BUILT-IN CABINETS, EQUIPMENT, HARDWARE AND ACCESSORIES
 25. ALL DUCTS, AIR HANDLERS, FILTER BOXES AND BUILDING CAVITIES (NOT FOR SUPPLY AIR) USED AS DUCTS SHALL BE SEALED. JOINTS OF DUCT SYSTEMS SHALL BE MADE SUBSTANTIALLY AIR TIGHT BY MEANS OF TAPE, MASTIC, GASKETING OR OTHER APPROVED CLOSURE SYSTEMS
 26. ALL OUTDOOR AIR INTAKES & EXHAUSTS SHALL BE PROVIDED WITH DAMPERS (AUTOMATIC OR GRAVITY) TO EFFECTIVELY CLOSE WHEN VENTILATION SYSTEM IS NOT OPERATING.

BUILDING DATA - HOUSE:

HOUSE.....	1313 SQ. FT.
COVERED ENTRY.....	63 SQ. FT.
COVERED PATIO.....	193 SQ. FT.
CAR PORT.....	284 SQ. FT.
DETACHED CAR PORT.....	529 SQ. FT.
SUB - TOTAL.....	2382 SQ. FT.
ADDITION 1.....	192 SQ. FT.
ADDITION 2.....	60 SQ. FT.
SUB - TOTAL.....	252 SQ. FT.
TOTAL.....	2634 SQ. FT.


RENOVATION FLOOR PLAN
SCALE: 1/4" = 1'-0"

RES DRAFT
RESIDENTIAL DRAFTING & DESIGN

RENOVATION FLOOR PLAN

RENOVATION

DATE: 9 - 10 - 21
SCALE: AS NOTED
DRAWN:
JOB:
SHEET NO.: **A 1.3**

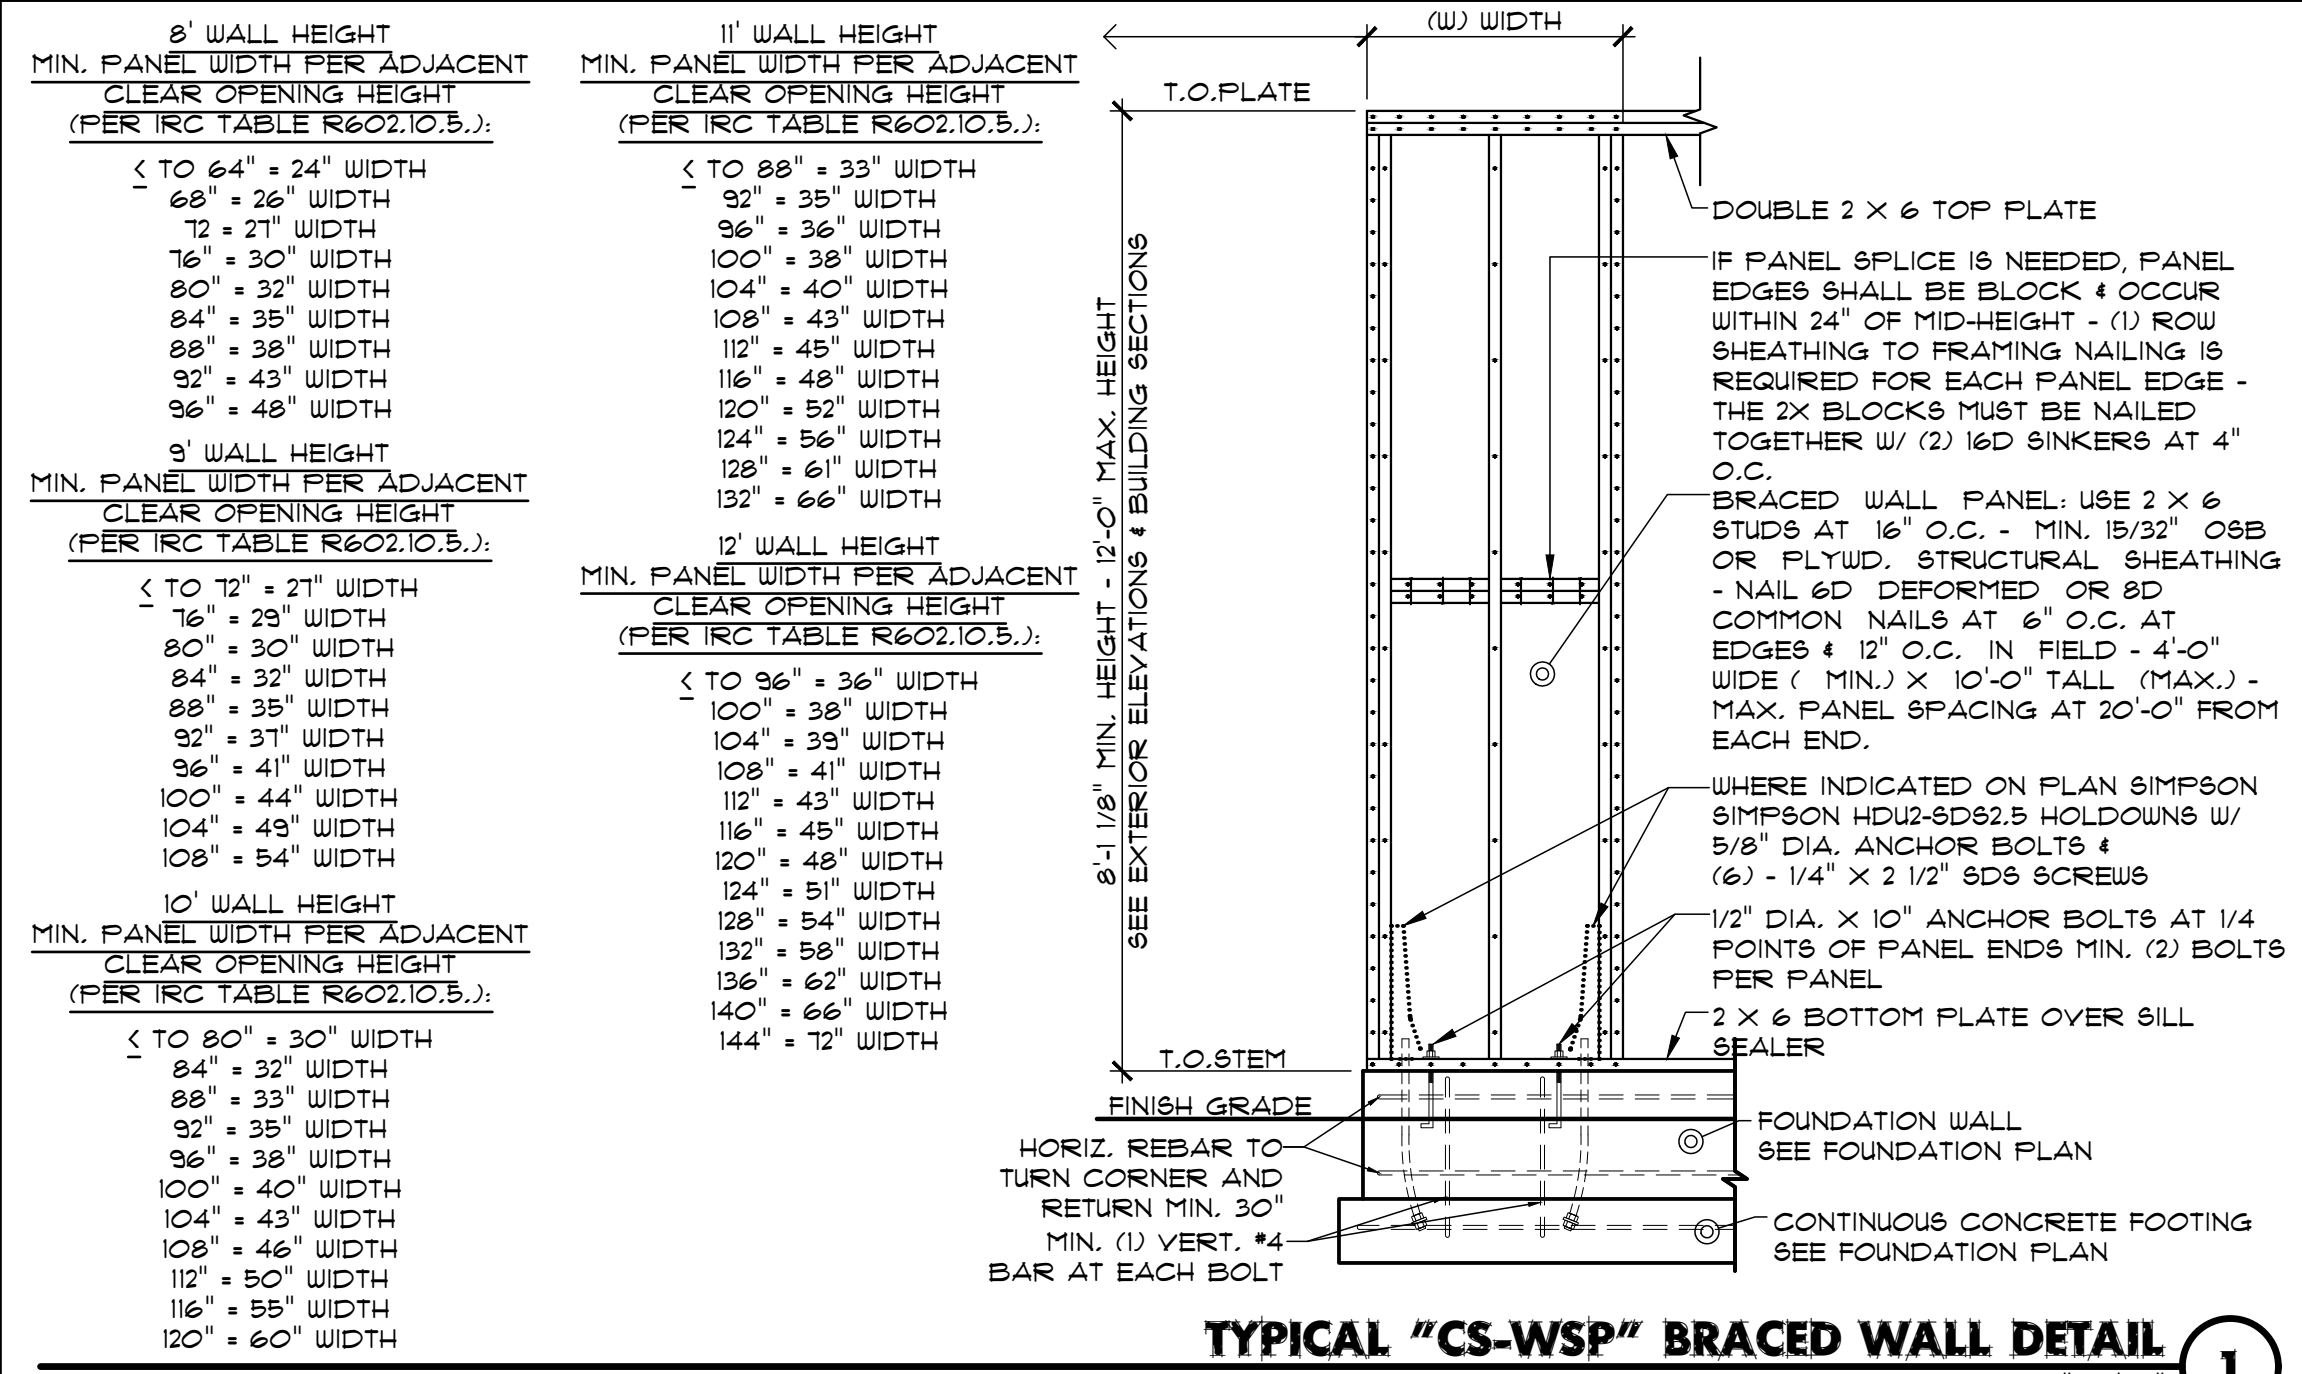

TYPICAL "CS-WSP" BRACED WALL DETAIL 1
SCALE: 1/2" = 1'-0"

8' WALL HEIGHT MIN. PANEL WIDTH PER ADJACENT CLEAR OPENING HEIGHT (PER IRC TABLE R602.10.3.1)	11' WALL HEIGHT MIN. PANEL WIDTH PER ADJACENT CLEAR OPENING HEIGHT (PER IRC TABLE R602.10.3.1)
< TO 6'4" = 24" WIDTH	< TO 8'8" = 33" WIDTH
6'8" = 26" WIDTH	9'2" = 35" WIDTH
7'2" = 27" WIDTH	9'6" = 36" WIDTH
7'6" = 30" WIDTH	10'0" = 38" WIDTH
8'0" = 32" WIDTH	10'4" = 40" WIDTH
8'4" = 35" WIDTH	10'8" = 43" WIDTH
8'8" = 38" WIDTH	11'2" = 45" WIDTH
9'2" = 43" WIDTH	11'6" = 48" WIDTH
9'6" = 48" WIDTH	12'0" = 52" WIDTH
9' WALL HEIGHT MIN. PANEL WIDTH PER ADJACENT CLEAR OPENING HEIGHT (PER IRC TABLE R602.10.3.1)	12' WALL HEIGHT MIN. PANEL WIDTH PER ADJACENT CLEAR OPENING HEIGHT (PER IRC TABLE R602.10.3.1)
< TO 12" = 21" WIDTH	< TO 9'6" = 36" WIDTH
7'6" = 29" WIDTH	10'0" = 38" WIDTH
8'0" = 30" WIDTH	10'4" = 39" WIDTH
8'4" = 32" WIDTH	10'8" = 41" WIDTH
8'8" = 35" WIDTH	11'2" = 43" WIDTH
9'2" = 37" WIDTH	11'6" = 45" WIDTH
9'6" = 41" WIDTH	12'0" = 48" WIDTH
10'0" = 44" WIDTH	12'4" = 51" WIDTH
10'4" = 49" WIDTH	12'8" = 54" WIDTH
10'8" = 54" WIDTH	13'2" = 58" WIDTH
10' WALL HEIGHT MIN. PANEL WIDTH PER ADJACENT CLEAR OPENING HEIGHT (PER IRC TABLE R602.10.3.1)	14'0" = 66" WIDTH
< TO 8'0" = 30" WIDTH	
8'4" = 32" WIDTH	
8'8" = 33" WIDTH	
9'2" = 35" WIDTH	
9'6" = 38" WIDTH	
10'0" = 40" WIDTH	
10'4" = 43" WIDTH	
10'8" = 46" WIDTH	
11'2" = 50" WIDTH	
11'6" = 55" WIDTH	
12'0" = 60" WIDTH	




BRACED WALL FLOOR PLAN
SCALE: 1/4" = 1'-0"

- BRACED WALL NOTES:**
- THE EXTERIOR SIDE OF ALL EXTERIOR WALLS AND INTERIOR WALLS WHERE REQUIRED SHALL BE BRACED AS REQUIRED PER 2012 IRC SECTION R602.10.4 INTERMITTENT BRACING METHOD "WSP" (WOOD STRUCTURAL PANEL); 3/8" PLYWOOD / OSB WALL SHEATHING WITH 16-INCH STUD SPACING. WOOD STRUCTURAL PANELS SHALL BE INSTALLED W/ 8D NAILS AT 6" O.C. AT ALL PANEL EDGES & 12" O.C. ON ALL FRAMING MEMBERS NOT AT PANEL EDGES.
 - BRACED WALL PANEL SPACING: PER SECTION R602.10.2.2 LOCATIONS OF BRACED WALL PANELS; A BRACED WALL PANEL SHALL BEGIN WITHIN 10'-0" FROM EACH END OF A BRACED WALL LINE AS DETERMINED IN SECTION R602.10.1.1. THE DISTANCE BETWEEN ADJACENT EDGES OF BRACED WALL PANELS ALONG A BRACED WALL LINE SHALL BE NO GREATER THAN 20'-0".
 - IF PANEL SPLICE IS NEEDED PANELS SHALL NOT BE SMALLER THAN 24" IN ANY DIRECTION.
 - INSTALL MIN. 3/8" THICK WALL SHEATHING W/ LONG DIMENSION OF SHEETS ORIENTED HORIZONTALLY IF STUDS ARE SPACED MORE THAN 16" O.C.
 - INSTALL BLOCKING BEHIND ALL HORIZONTAL PANEL JOINTS. FLAT 2X BLOCKING MAY BE USED FOR 8D OR SMALLER NAILS, USE MIN. 3X BLOCKING FOR 10D NAILS.
 - PLYWOOD & OSB ARE INTERCHANGEABLE.
 - ATTACH BRACE PANELS DIRECTLY TO STUDS.
 - INSTALL GYPSUM BOARD OVER PANELS.
 - INSTALL MIN. 3/8" THICK WALL SHEATHING W/ LONG DIMENSION OF SHEETS ORIENTED HORIZONTALLY IF STUDS ARE SPACED MORE THAN 16" O.C.
 - Holes in brace panels for electrical outlets, switches, etc. shall be neatly cut, w/ rounded corners. USE A SABER SAW OR SAUZZALL, NOT A SKILSAW. MAX. HOLE SIZE IS 6" DIA.
 - NAILS FOR INSTALLING SHEATHING SHALL BE COMMON OR GALVANIZED BOX, GUN NAILS OF EQUIVALENT SIZES MAY BE USED. GUN NAILS SHALL HAVE FULL ROUND HEADS.
 - DRIVE NAIL HEADS FLUSH W/ THE OUTER SHEATHING LAYER, INSPECTOR MAY REQUIRE THAT PANELS W/ NAILS DRIVEN SO AS TO DAMAGE THE OUTER SHEATHING LAYER BE REPLACED. USE SPECIAL CARE WHEN USING PNEUMATIC NAIL GUNS.
 - INSTALL BRACE WALL PANELS W/ 1/8" GAP AT ALL JOINTS AS RECOMMENDED BY MANUFACTURERS. REFER TO INSTALLATION INSTRUCTIONS PER MANUFACTURER.

BRACED WALL SCHEDULE:

MARK	DESCRIPTION
CS-WSP	SEE DETAIL 1 / A1.4
#####	INDICATES BRACED PANEL LOCATION (SEE PLAN FOR PANEL TYPE & LENGTH).

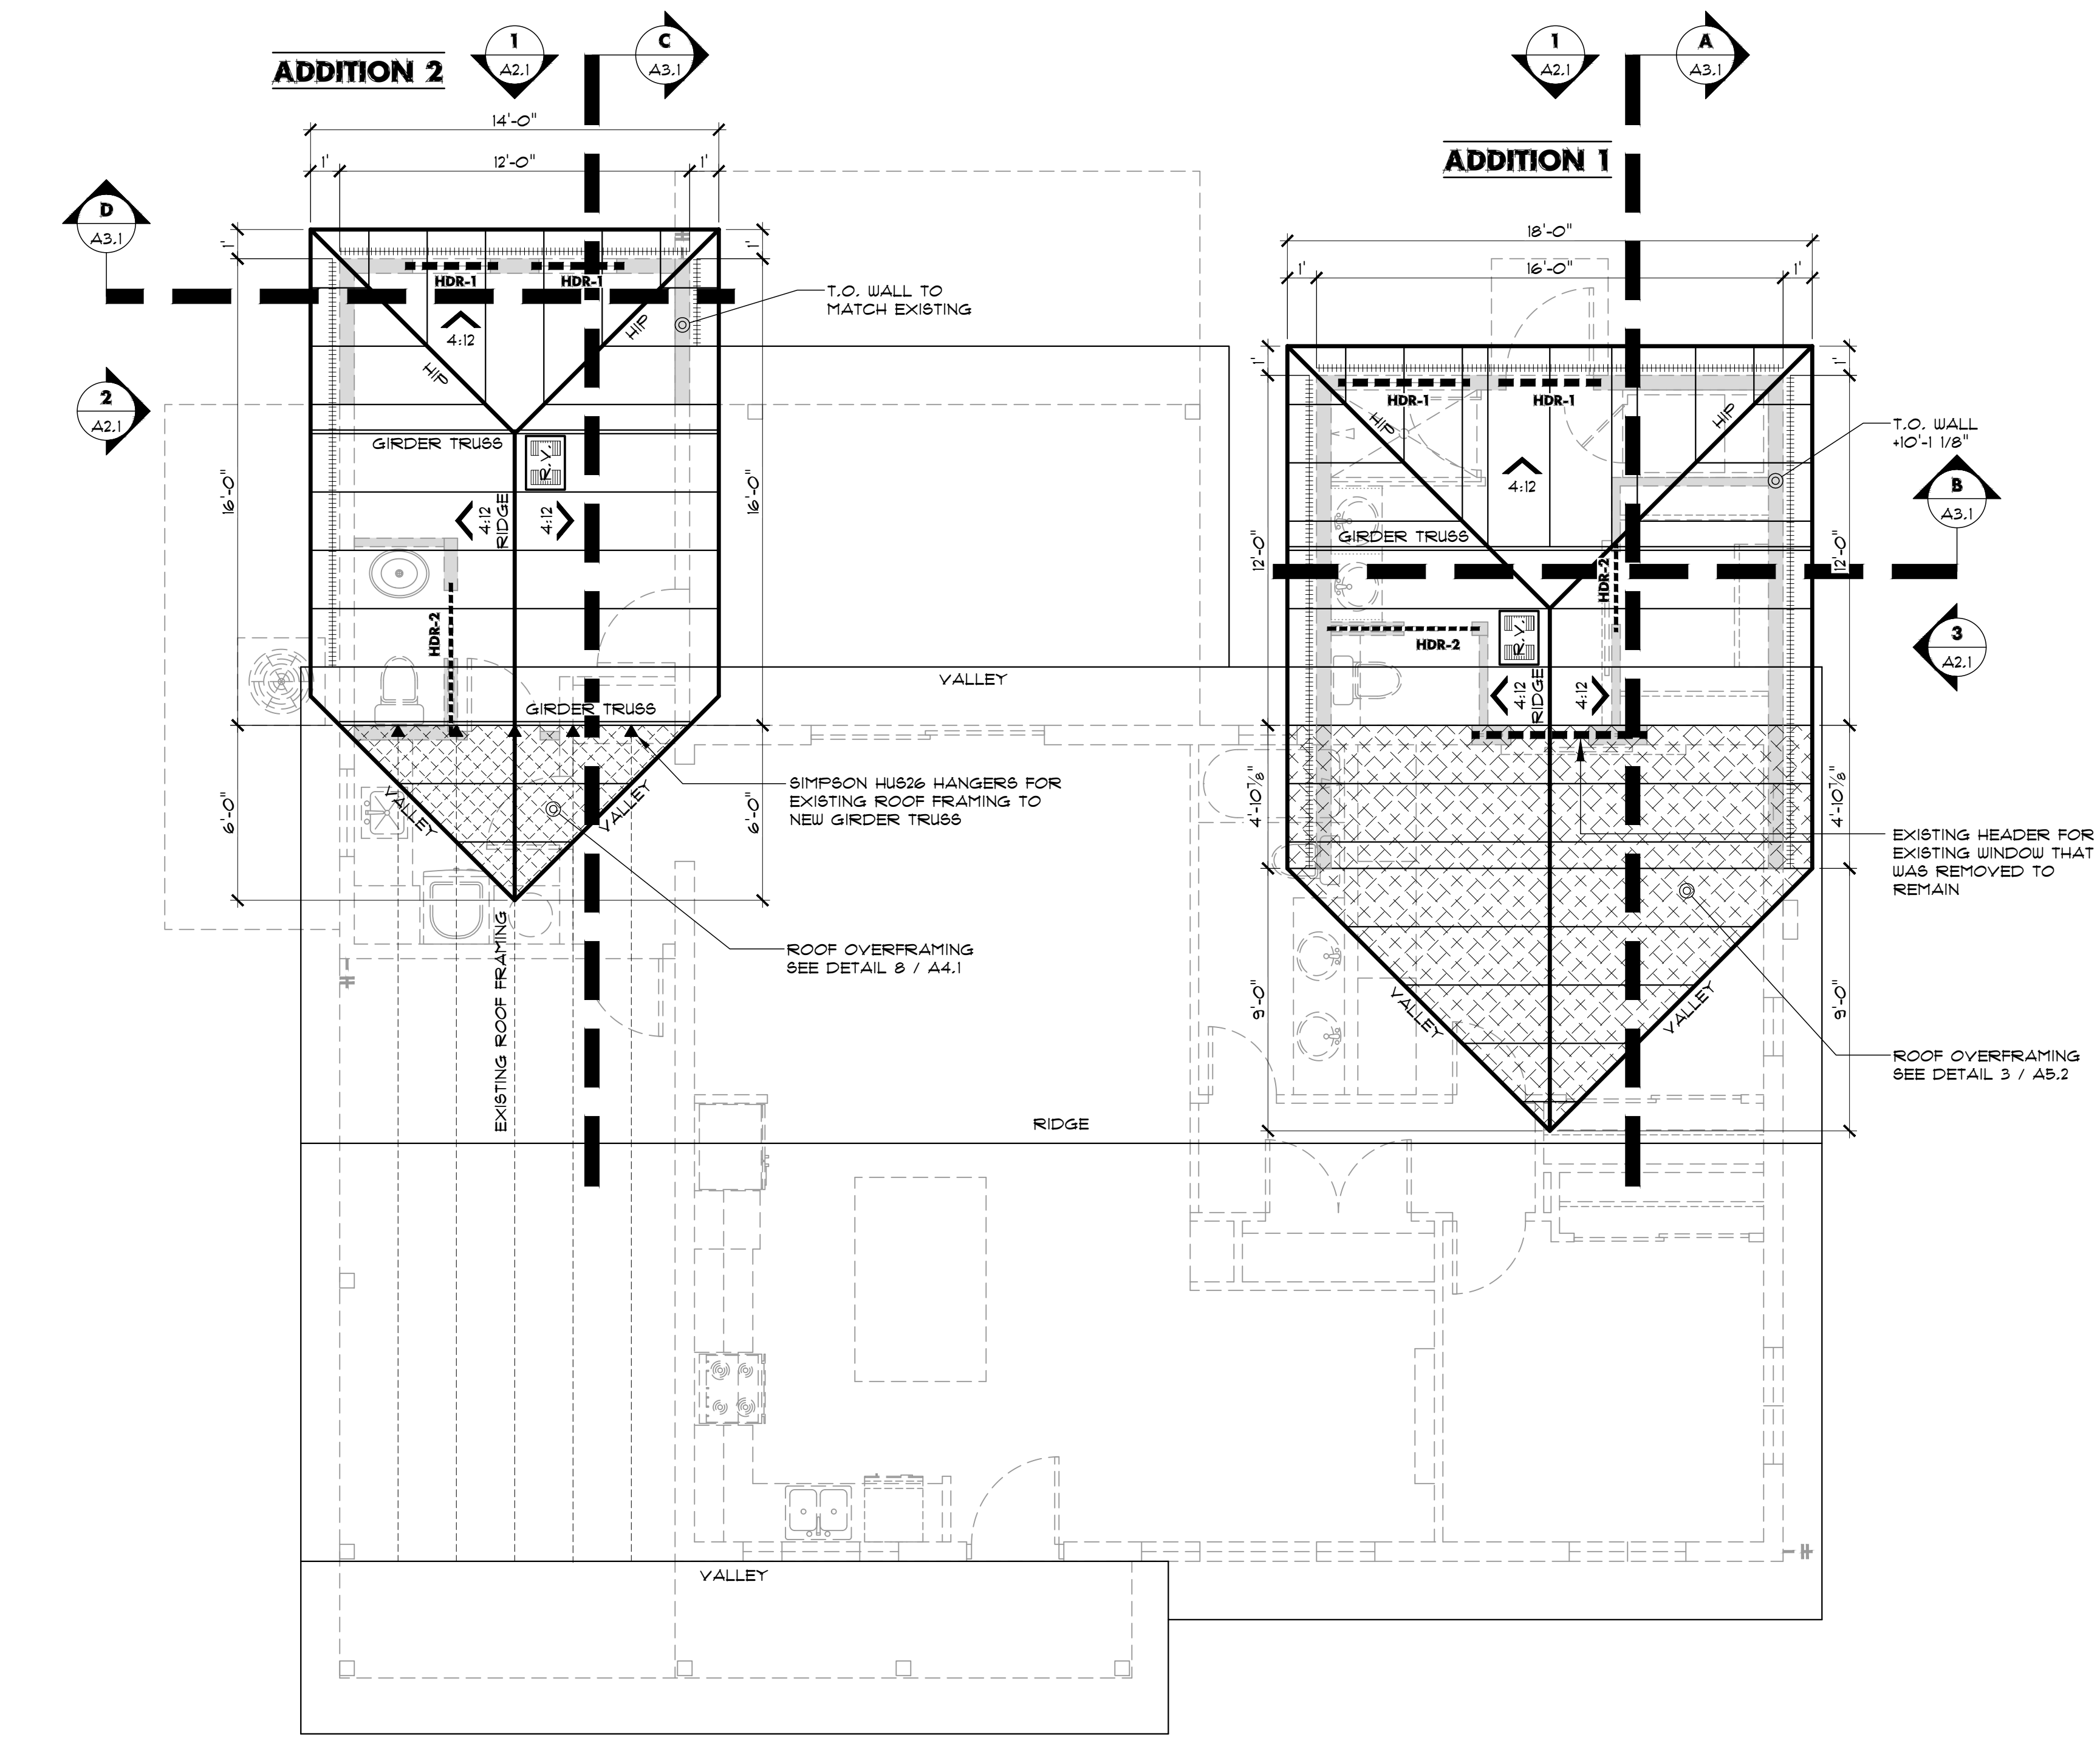

ROOF FRAMING PLAN
SCALE: 1/4" = 1'-0"

GENERAL ROOF NOTES:

- ENGINEERED ROOF TRUSSES THROUGHOUT - SEALED CALCULATIONS TO BE DELIVERED WITH TRUSSES
- ROOF FITCH = 4:12 MATCH EXIST. U.N.O.
- TYPICAL OVERHANG = 1'-0"
- ALL MULTI-MEMBER ROOF TRUSSES MUST BE SUPPORTED W/ 2" X 6" TO MATCH NUMBER OF FLYS OF ROOF TRUSS - UPPER & LOWER LEVELS.

ROOF CONSTRUCTION:

- ASPHALT SHINGLES - MATCH EXIST. HOUSE
- "PALISADE" 35 YEAR SYNTHETIC ROOFING UNDERLAYMENT
- 1/2" (FOR SHINGLES) / 5/8" (FOR TILE) CDX PLYWOOD / O.S.B. ROOF SHEATHING W/ "H" CLIPS FASTENED W/ 8D COMMON NAILS AT 6" O.C. ALONG PANEL EDGE AND 12" IN THE FIELD
- FIRE-ENGINEERED ROOF TRUSSES PER TRUSS MANUFACTURER W/ SIMPSON H2.5A OR EQUAL CONNECTORS AT EACH TRUSS TYPICAL
- BLOWN OR BATT INSULATION (R-30)
- 1/2" NON-SAG GYPSUM BOARD CEILING (INTERIOR) / 3/8" ADX PLYWD. SOFFITS AT EAVES / 1/2" NON-SAG EXTERIOR GYPSUM BOARD CEILINGS AT COVERED ENTRY & PATIO LOCATIONS
- 1" X 8" LAMINATED FASCIA BOARD OVER
- 2" X 6" SUB-FASCIA 3/8" ADX PLYWOOD SOFFITS

NOTE:
TOP OF ALL WALLS ARE +9' - 1 1/8" - U.N.O.

NOTED CEILING HEIGHTS = WALL HEIGHT:

- A. 8' CLG. = 8'-1 1/8" WALL HEIGHT
- B. 9' CLG. = 9'-1 1/8" WALL HEIGHT
- C. 10' CLG. = 10'-1 1/8" WALL HEIGHT
- D. 11' CLG. = 11'-1 1/8" WALL HEIGHT
- E. 12' CLG. = 12'-1 1/8" WALL HEIGHT

ROOF TRUSS FRAMING TO BE INSTALLED PER ROOF TRUSS MANUFACTURERS LAYOUT

2018 IRC R802.10.3 BRACING
TRUSSES SHALL BE BRACED TO PREVENT ROTATION AND PROVIDE LATERAL STABILITY IN ACCORDANCE WITH THE REQUIREMENTS SPECIFIED IN THE CONSTRUCTION DOCUMENTS FOR THE BUILDING AND ON THE INDIVIDUAL TRUSS DESIGN DRAWINGS. IN THE ABSENCE OF SPECIFIC BRACING REQUIREMENTS, TRUSSES SHALL BE BRACED IN ACCORDANCE WITH ACCEPTED INDUSTRY PRACTICE SUCH AS THE SBCA BUILDING COMPONENT SAFETY INFORMATION (BCSI) GUIDE TO GOOD PRACTICE FOR HANDLING, INSTALLING & BRACING OF METAL PLATE CONNECTED WOOD TRUSSES.

HEADERS:

HDR-1	(2) 2 X 10 DFL #2 HEADER W/ 2" X "WALL THICKNESS" BOTTOM HEADER FLATE - SEE DET. 6 / A2.2
HDR-2	INTERIOR NON - LOAD BEARING LESS THAN OR EQUAL TO 3'-0" USE: (2) FLAT 2" X "WALL THICKNESS" DFL #2 HEADER INTERIOR NON - LOAD BEARING GREATER THAN 3'-0" USE: (1) 2 X 8 DFL #2 HEADER WITH A (2) 2" X "WALL THICKNESS" BOTTOM HEADER FLATE


VENTILATION METHOD:
2018 IRC SECTION R806.2 MINIMUM VENT AREA: THE MINIMUM NET FREE VENTILATING AREA SHALL BE 1/150 OF THE AREA OF THE VENTED SPACE.

ROOF VENTILATION (1 / 150 SQ. FT. MIN. REQ'D.)

ADDITION 1:	192 SQ. FT.
ADDITION 2:	60 SQ. FT.
TOTAL:	252 SQ. FT.

252 / 150 = 1.68 SQ. FT. X 144 = 242 SQ. IN. OF REQ. NET FREE VENTILATION AREA REQUIRED.

SOFFIT VENTING:
2 X "MATCH TOP CHORD" BLOCKING BETWEEN TRUSSES W/ (3) 2" DIA. HOLES & WIRE MESH BACKING (1.39 SQ. IN. OF NFVA) OR EQUAL

ROOF VENTING:  R.V.
O'HAGEN / ALUMINUM / STANDARD LINE MODEL (12 SQ. IN. OF NFVA).

ROOF VENTILATION (1 / 150 SQ. FT. REQ.):
ADDITION 1: 192 SQ. FT.
192 / 150 = 1.28 SQ. FT. X 144 = 184 SQ. IN. OF NET FREE VENTILATION AREA REQUIRED.


SOFFIT VENTING:
50 LIN. FT. X 1.39 SQ. IN. OF NFVA PER LIN. FT. = 310 SQ. IN. NFVA

ROOF VENTING:
1 VENTS X 12 SQ. IN. OF NFVA = 12 SQ. IN. NFVA
SUB-TOTAL = 310 + 12 = 442 SQ. IN. NFVA (184 SQ. IN. OF NFVA REQUIRED)


ADDITION 2: 60 SQ. FT.
60 / 150 = .4 SQ. FT. X 144 = 58 SQ. IN. OF NET FREE VENTILATION AREA REQUIRED.

SOFFIT VENTING:
28 LIN. FT. X 1.39 SQ. IN. OF NFVA PER LIN. FT. = 214 SQ. IN. NFVA


ROOF VENTING:
1 VENTS X 12 SQ. IN. OF NFVA = 12 SQ. IN. NFVA
TOTAL = 214 + 12 = 286 SQ. IN. NFVA (58 SQ. IN. OF NFVA REQUIRED)

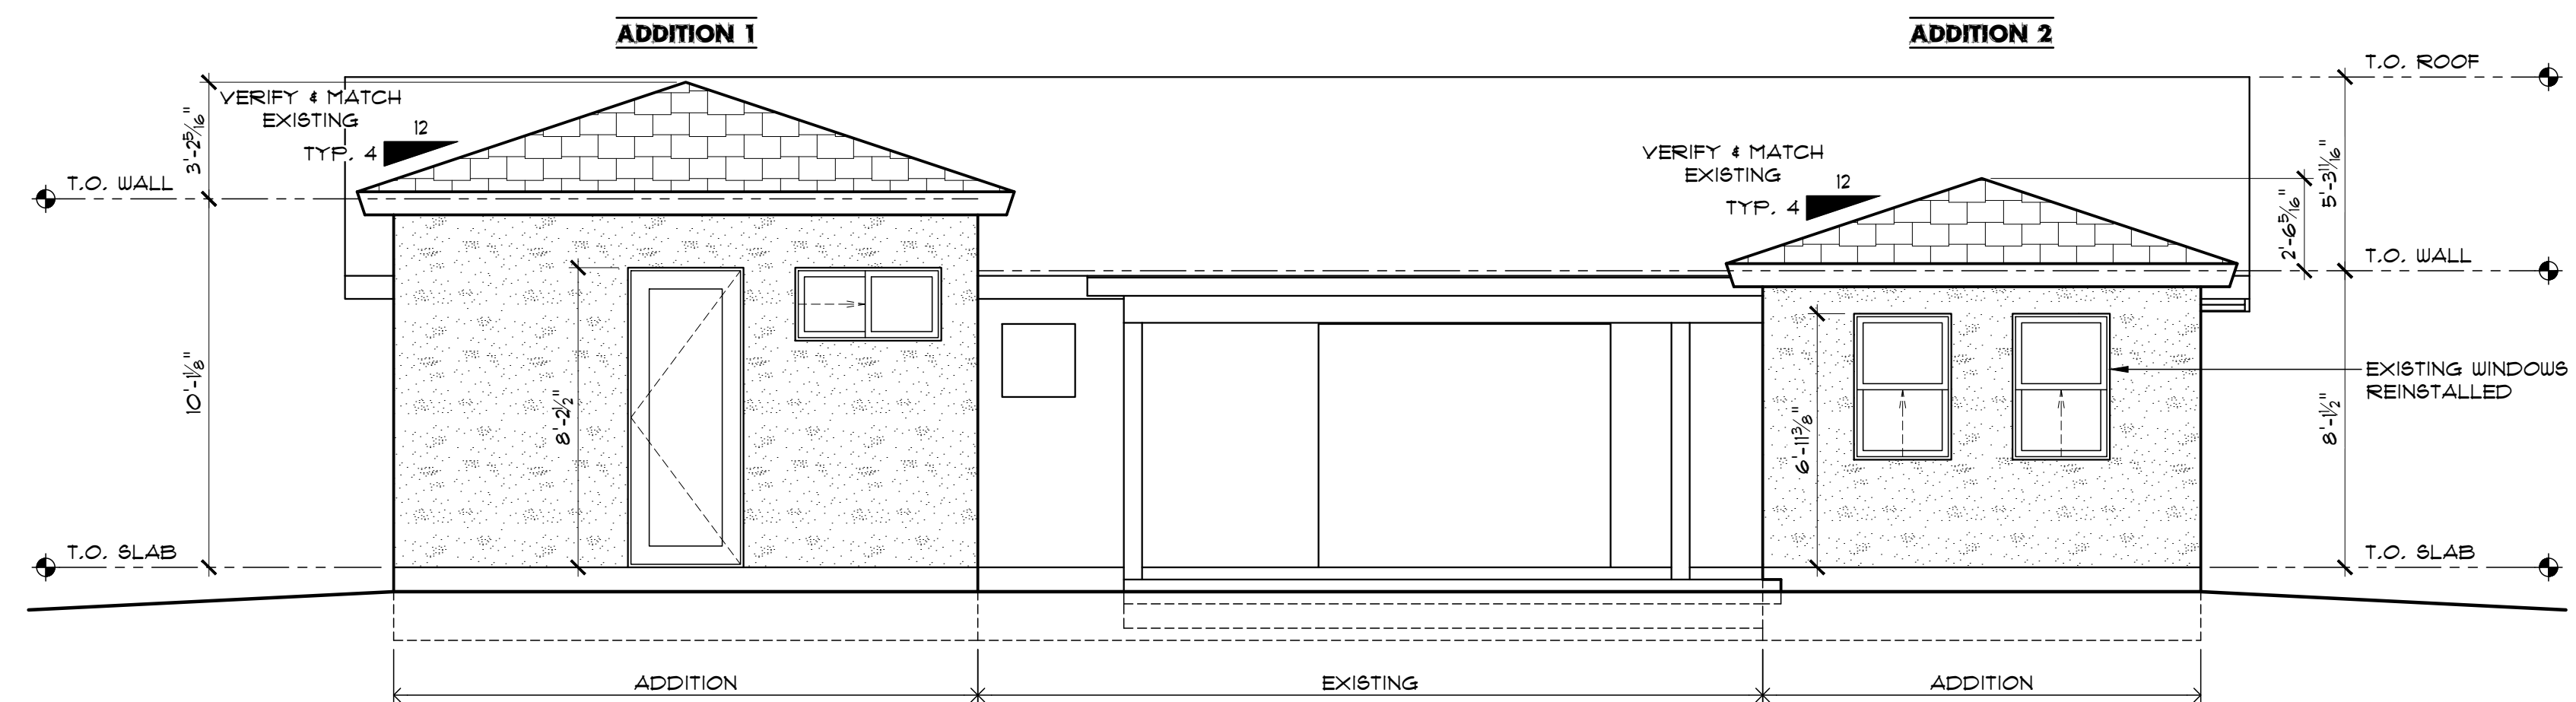

REAR - SOUTH ELEVATION ①
SCALE: 1/4" = 1'-0"

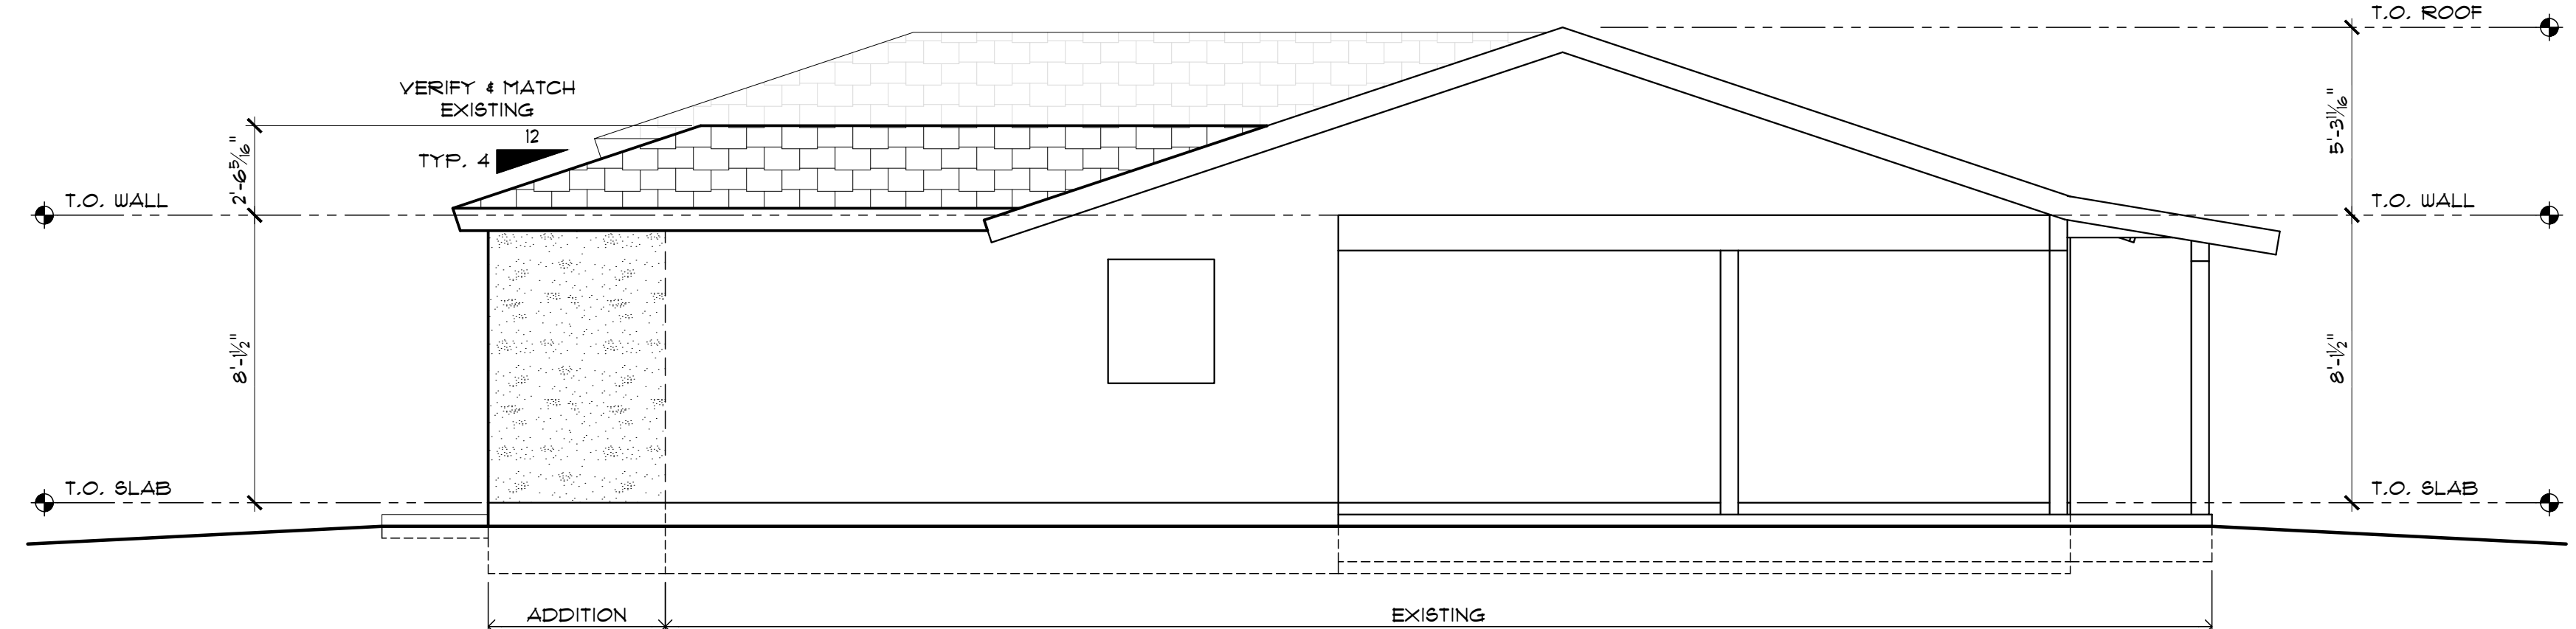

LEFT - EAST ELEVATION ②
SCALE: 1/4" = 1'-0"

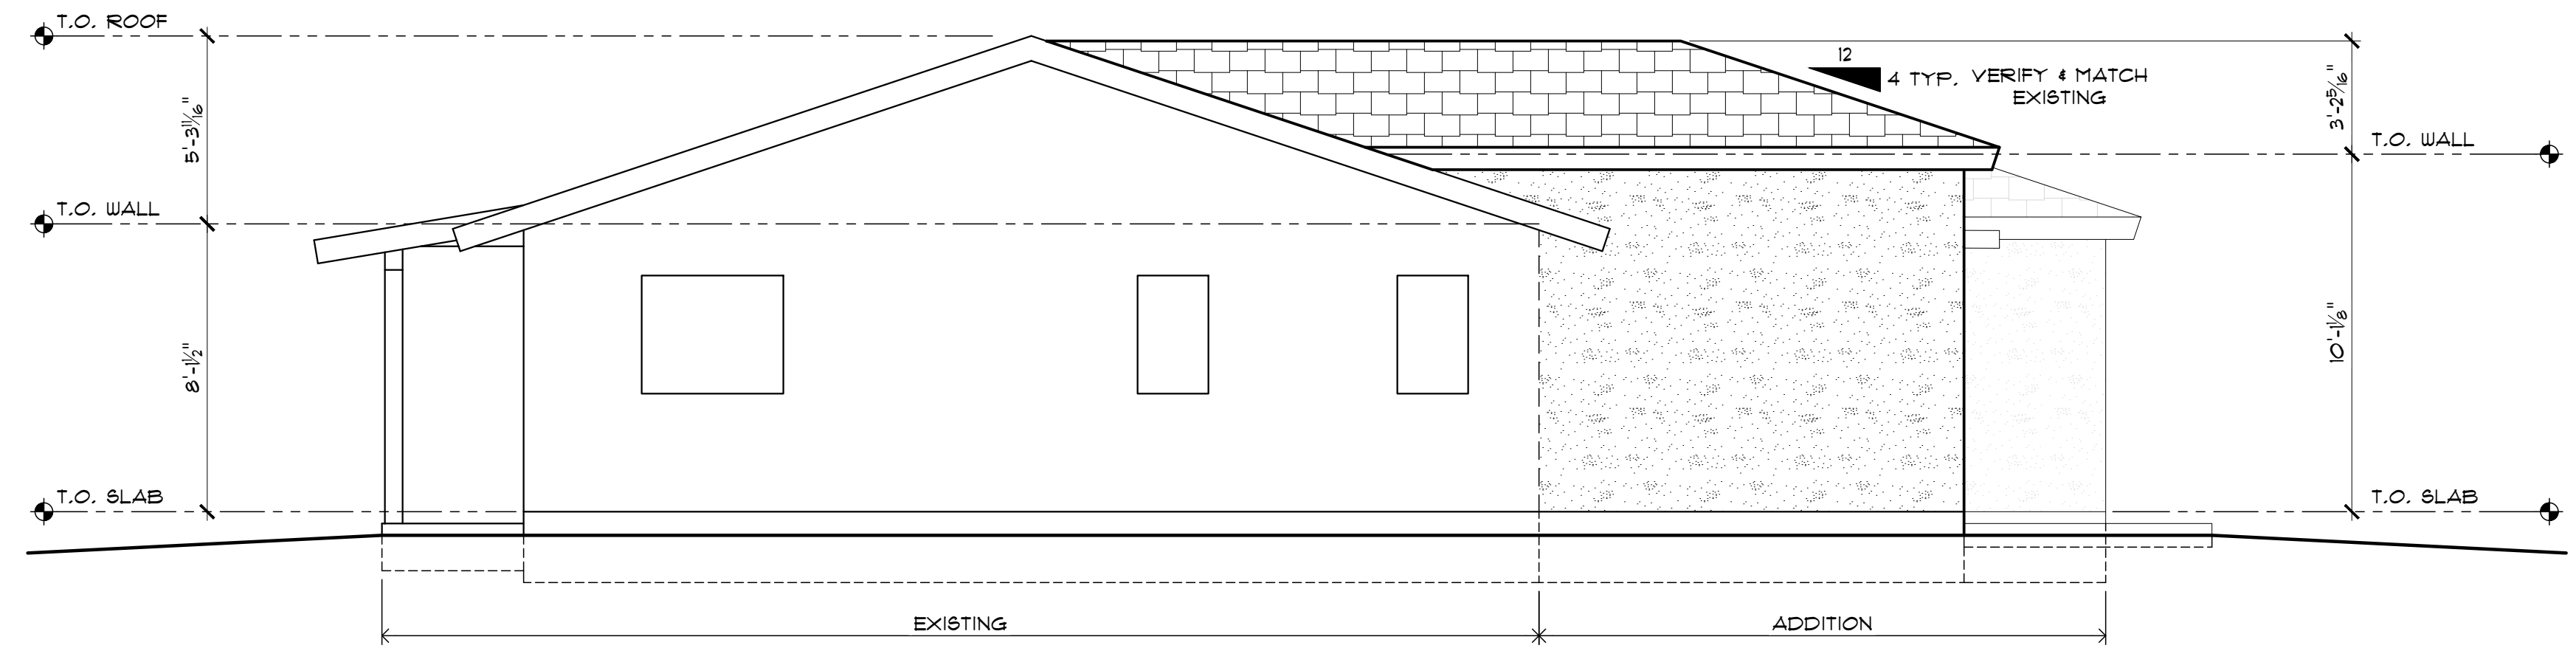

RIGHT - WEST ELEVATION ③
SCALE: 1/4" = 1'-0"

GENERAL ELEVATION NOTES:

1. VERIFY ALL EXTERIOR FINISH RELATED ITEMS (MATERIALS, COLORS, PATTERNS, TEXTURES, ETC.) W/ OWNER PRIOR TO THE START OF CONSTRUCTION
2. ANY 4 ALL STUCCO FINISHES TO BE WESTERN 1 KOTE EXTERIOR STUCCO SYSTEM (ICC REPORT #2729) OR EQUAL - VERIFY FINISH TEXTURE 4 COLOR W/ OWNER
3. STUCCO SURFACE SHALL BE FULLY CURED AND SURFACE SHALL BE FREE OF DIRT AND OR OTHER SURFACE CONTAMINANTS PRIOR TO FINAL STUCCO FINISH OR PAINT
4. EXTERIOR STUCCO EXPANSION JOINTS PER MANUFACTURERS SPECIFICATIONS
5. THE EXTERIOR SIDE OF ALL EXTERIOR WALLS AND INTERIOR WALLS WHERE REQUIRED SHALL BE BRACED AS REQUIRED PER 2018 IRC SECTION R602.10.4 INTERMITTENT BRACING METHOD "WB" (WOOD STRUCTURAL PANEL); 3/8" PLYWOOD / OSB WALL SHEATHING WITH 16-INCH STUD SPACING. WOOD STRUCTURAL PANELS SHALL BE INSTALLED W/ 8D NAILS AT 6" O.C. AT ALL PANEL EDGES 4 12" O.C. ON ALL FRAMING MEMBERS NOT AT PANEL EDGES
6. INSTALL EXTERIOR WALL SHEATHING (OSB / PLYWOOD) WITH 1/8" GAP BETWEEN ALL JOINTS (HORIZ. 4 VERT.) TO ALLOW FOR EXPANSION MOVEMENT
7. ALL DOORS AND WINDOWS ARE TO BE INSTALLED AND FLASHED PER DOOR AND WINDOW MANUFACTURER
8. ALL OPERABLE WINDOWS SHALL HAVE SCREENS.

EXTERIOR WALL CONSTRUCTION:

- EXTERIOR FINISH PER ELEVATIONS
- "TYVEK" BUILDING WRAP - (2) LAYERS AT MANUFACTURED STONE VENEER LOCATIONS
- 3/8" (MIN.) CDX PLYWOOD OR O.S.B. WALL SHEATHING TO BE FLUSH W/ FACE OF C.M.U. FOUNDATION WALL - FASTEN W/ 8D NAILS AT 6" O.C. AT ALL PANEL EDGES 4 12" O.C. ON ALL FRAMING MEMBERS NOT AT PANEL EDGES
- 2" x 6" STUDS AT 16" O.C.
- WALL INSULATION (R-21 MIN.) BETWEEN STUDS
- 1/2" GYPSUM BOARD

ROOF CONSTRUCTION:






- ASPHALT SHINGLES - MATCH EXIST. HOUSE
- "FALIBADE" 35 YEAR SYNTHETIC ROOFING UNDERLAYMENT
- 1/2" (FOR SHINGLES) / 5/8" (FOR TILE) CDX PLYWOOD / O.S.B. ROOF SHEATHING W/ "H" CLIPS FASTENED W/ 8D COMMON NAILS AT 6" O.C. ALONG PANEL EDGE AND 12" IN THE FIELD
- FIRE-ENGINEERED ROOF TRUSSES PER TRUSS MANUFACTURER W/ SIMPSON H25A OR EQUAL CONNECTORS AT EACH TRUSS TYPICAL
- BLOWN OR BATT INSULATION (R-38)
- 1/2" NON-SAG GYPSUM BOARD CEILING (INTERIOR) / 3/8" ADX PLYWD. SOFFITS AT EAVES / 1/2" NON-SAG EXTERIOR GYPSUM BOARD CEILING AT COVERED ENTRY 4 PATIO LOCATIONS
- 1" x 8" LAMINATED FASCIA BOARD OVER 2" x 6" SUB-FASCIA 3/8" ADX PLYWOOD SOFFITS


ROOF TRUSS FRAMING TO BE INSTALLED PER ROOF TRUSS MANUFACTURERS LAYOUT

NOTE:
TOP OF WALLS AT ADDITION 1: 4'0" - 1 1/8"
TOP OF WALLS AT ADDITION 2: MATCH EXIST.


EXTERIOR FINISHES:

1. **STUCCO:**
STUCCO FINISHES TO BE WESTERN 1 KOTE EXTERIOR STUCCO SYSTEM (ICC REPORT #2729) VERIFY FINISH TEXTURE 4 COLOR W/ OWNER.
2. **ROOFING:**
ASPHALT SHINGLES - MATCH EXIST. HOUSE - SEE ROOF PLAN
3. **8" FASCIA BOARD:**
1" x 8" LAMINATED FASCIA BOARD W/ 1" x 4" LAMINATED TRIM BOARD OVER 2" x 6" SUB-FASCIA BOARD W/ 3/8" ADX PLYWOOD SOFFITS - MATCH EXISTING HOUSE
4. **EXTERIOR LIGHTING:**
FULLY SHIELDED EXTERIOR LIGHT
VERIFY LIGHT FIXTURE WITH OWNER

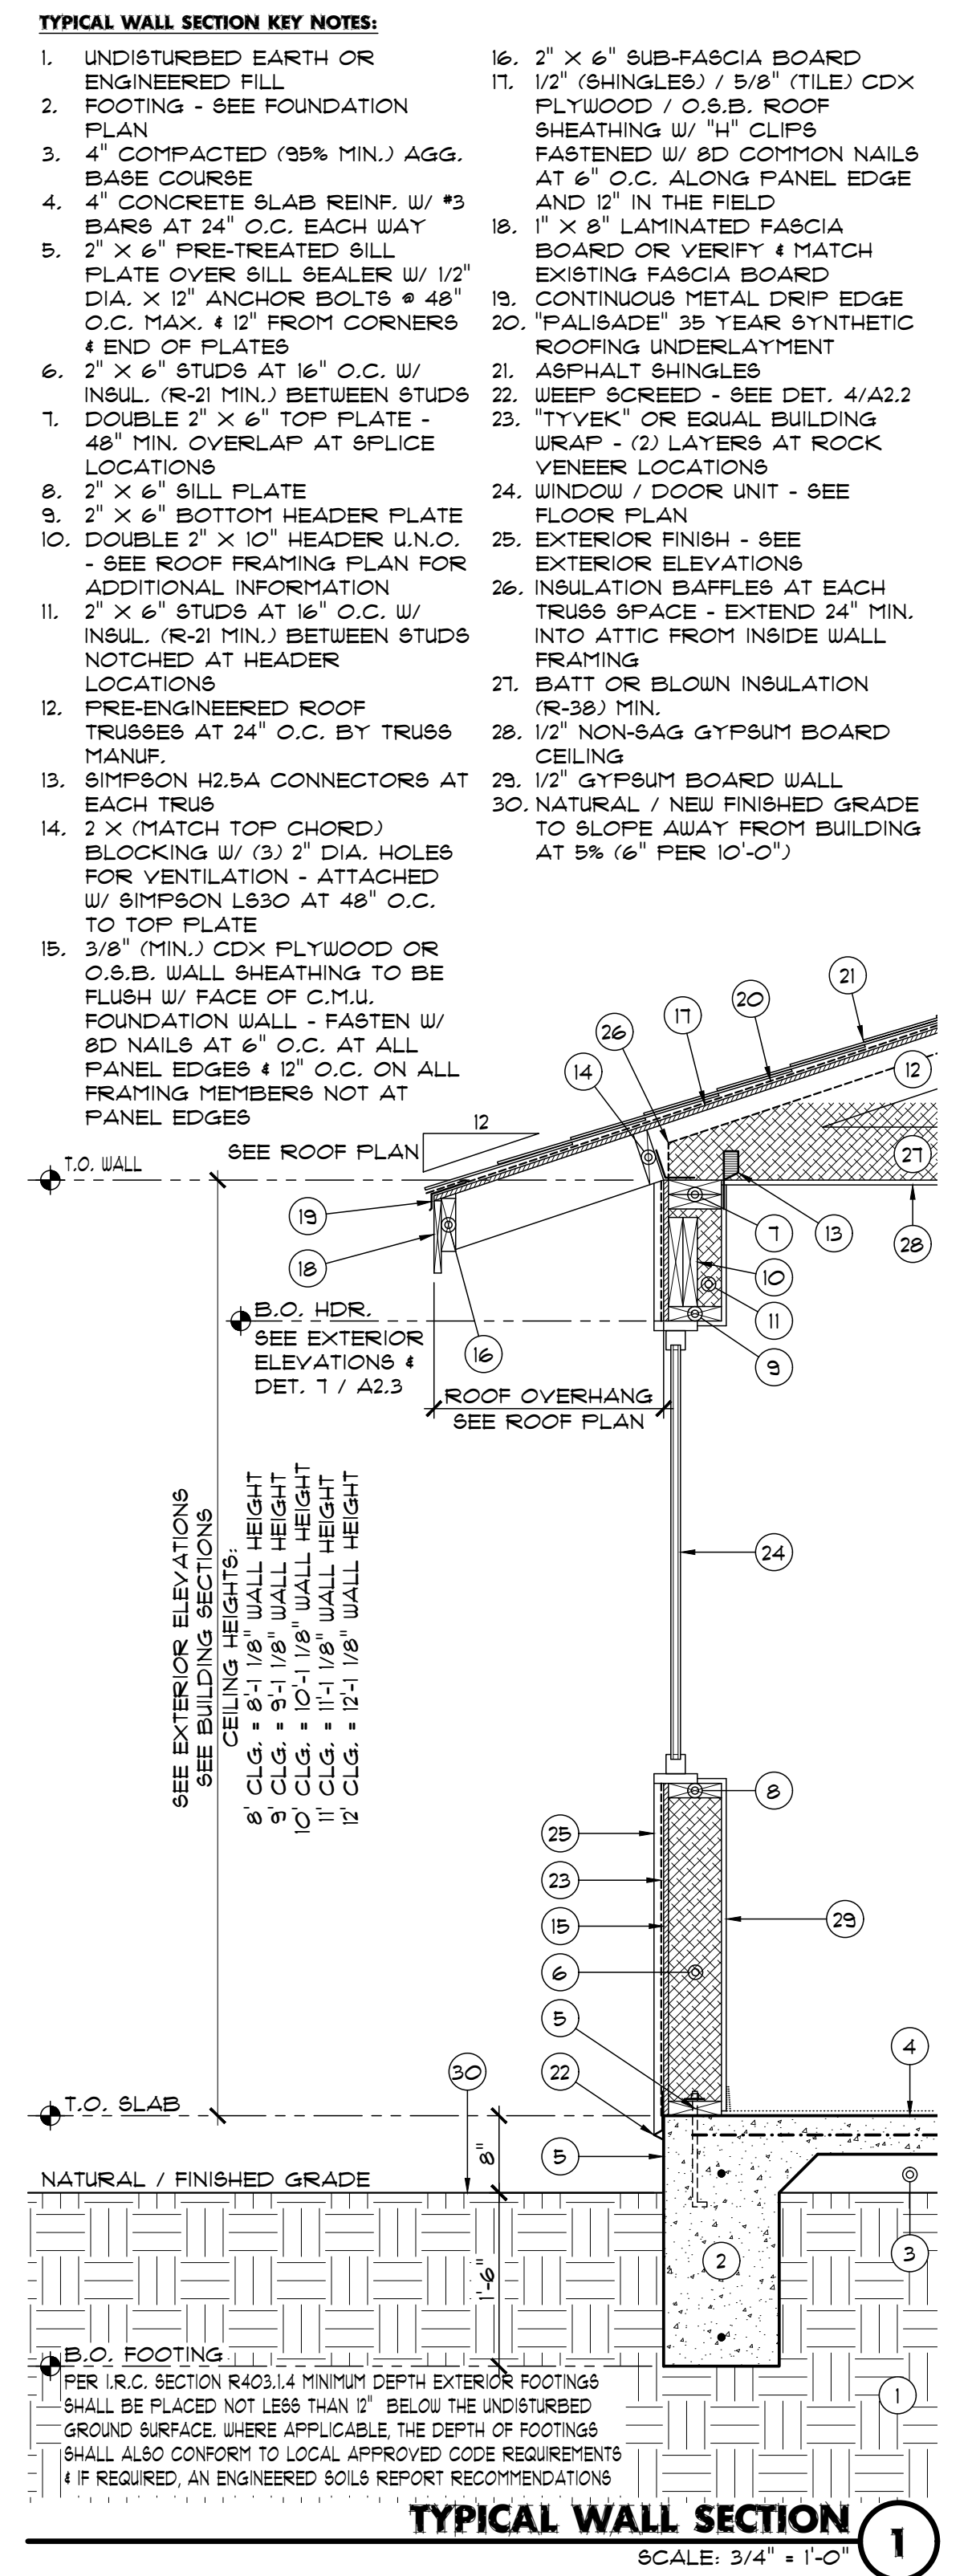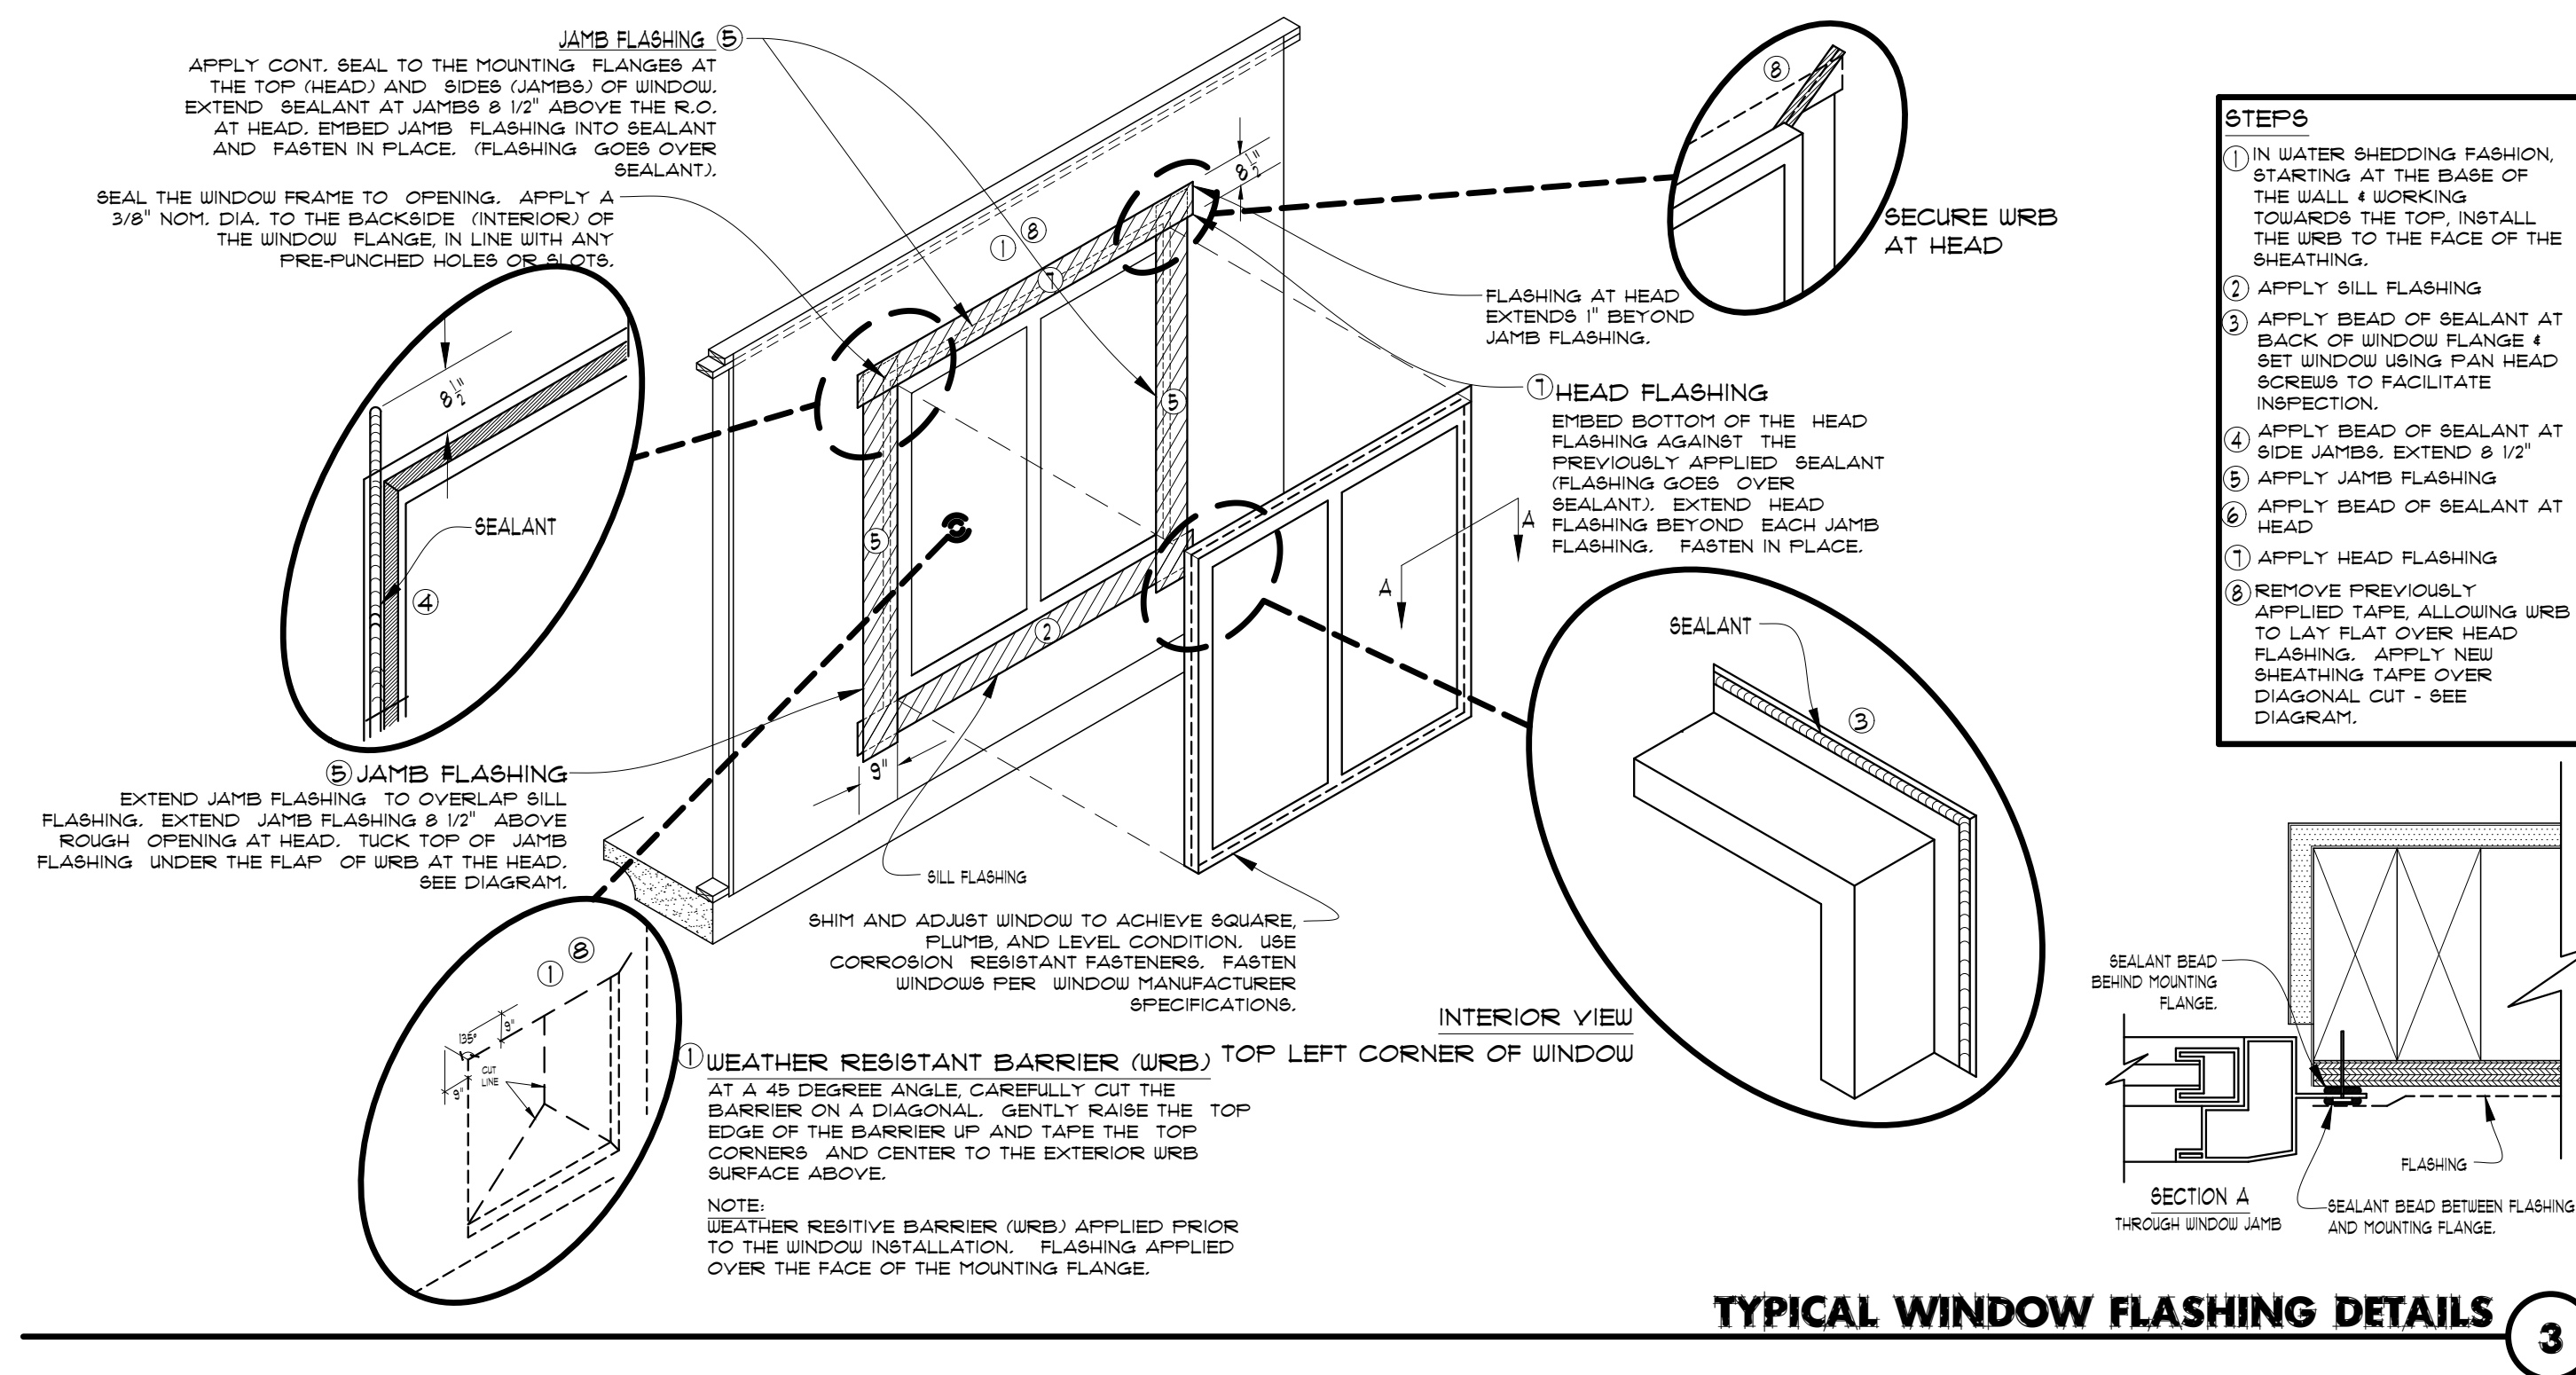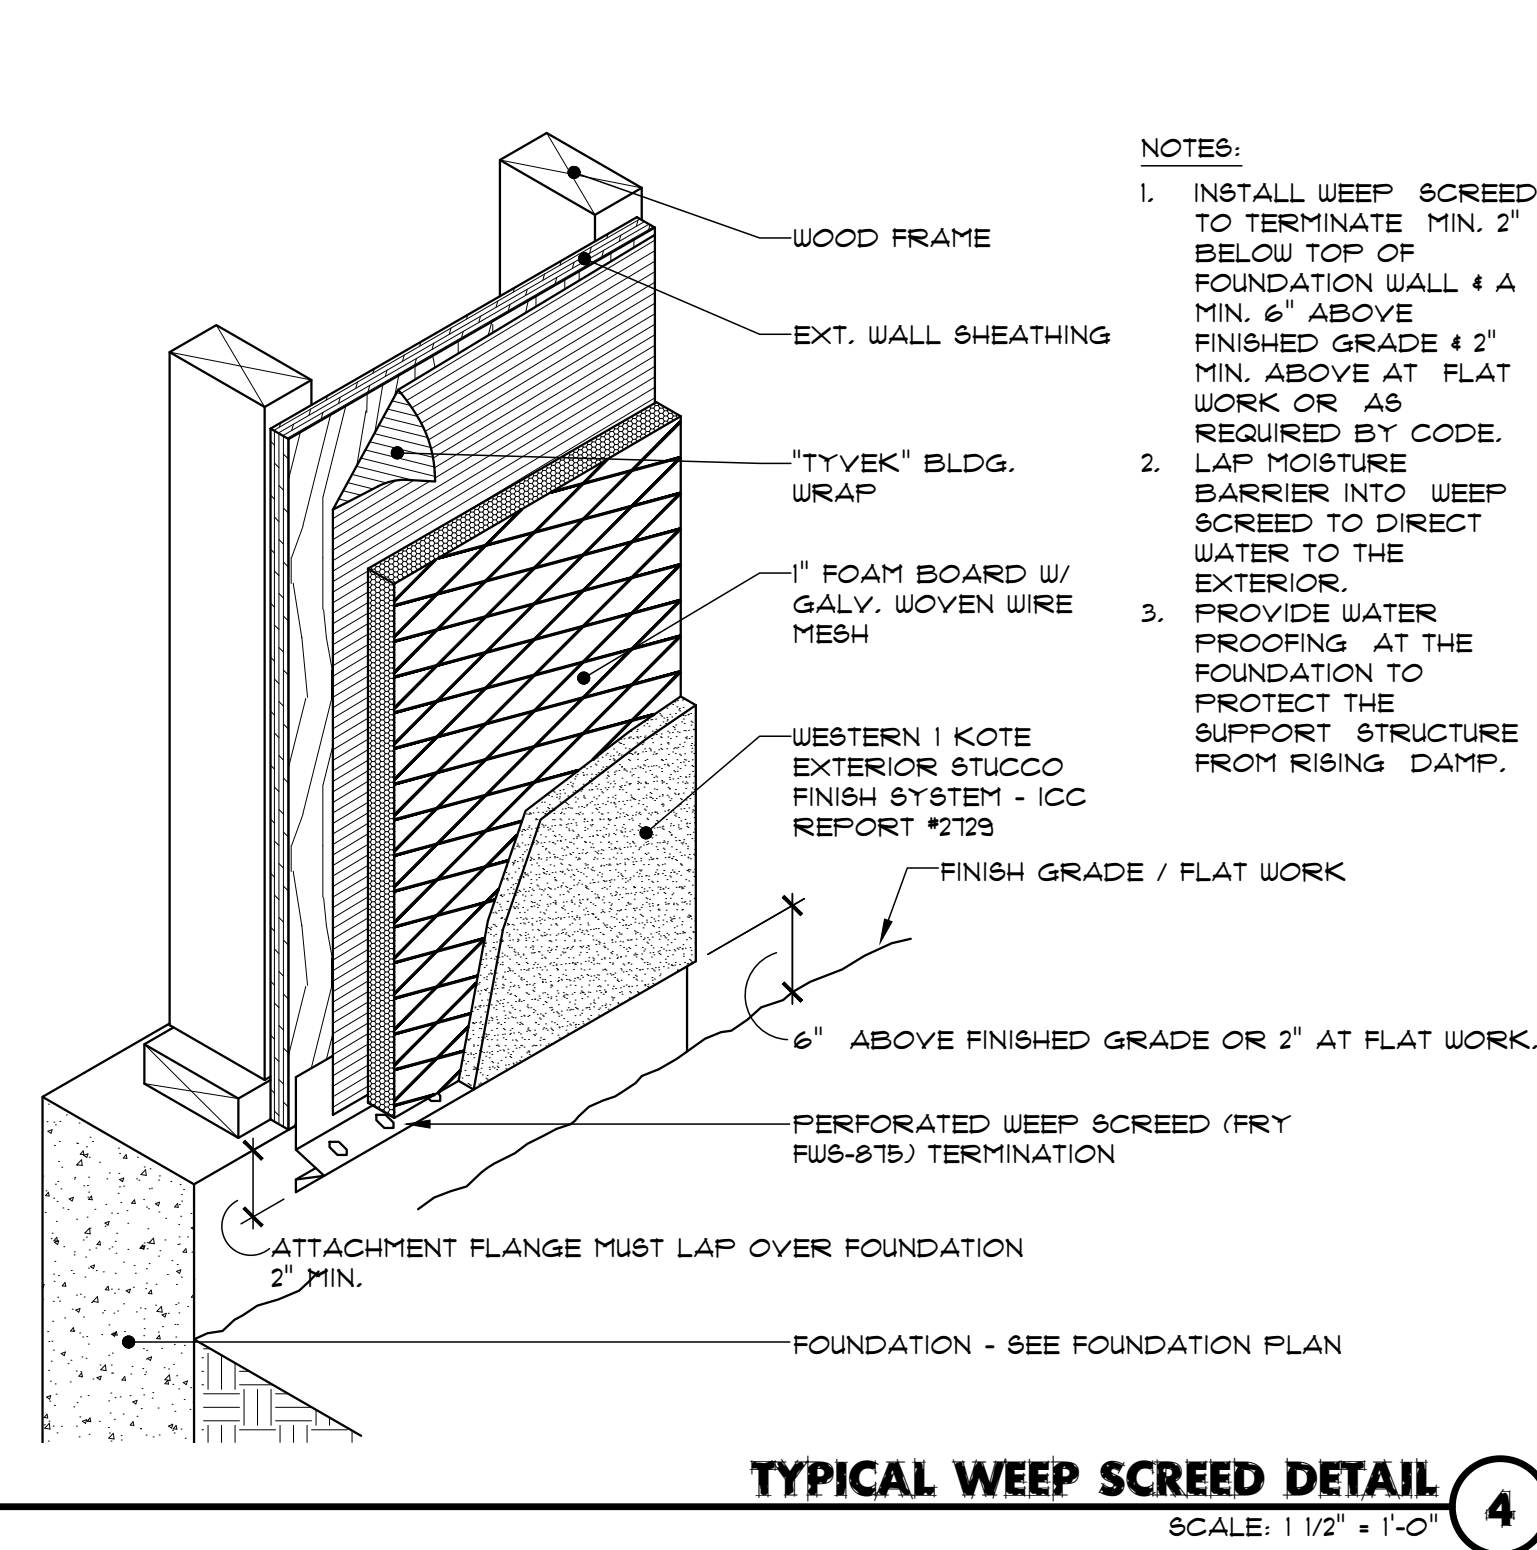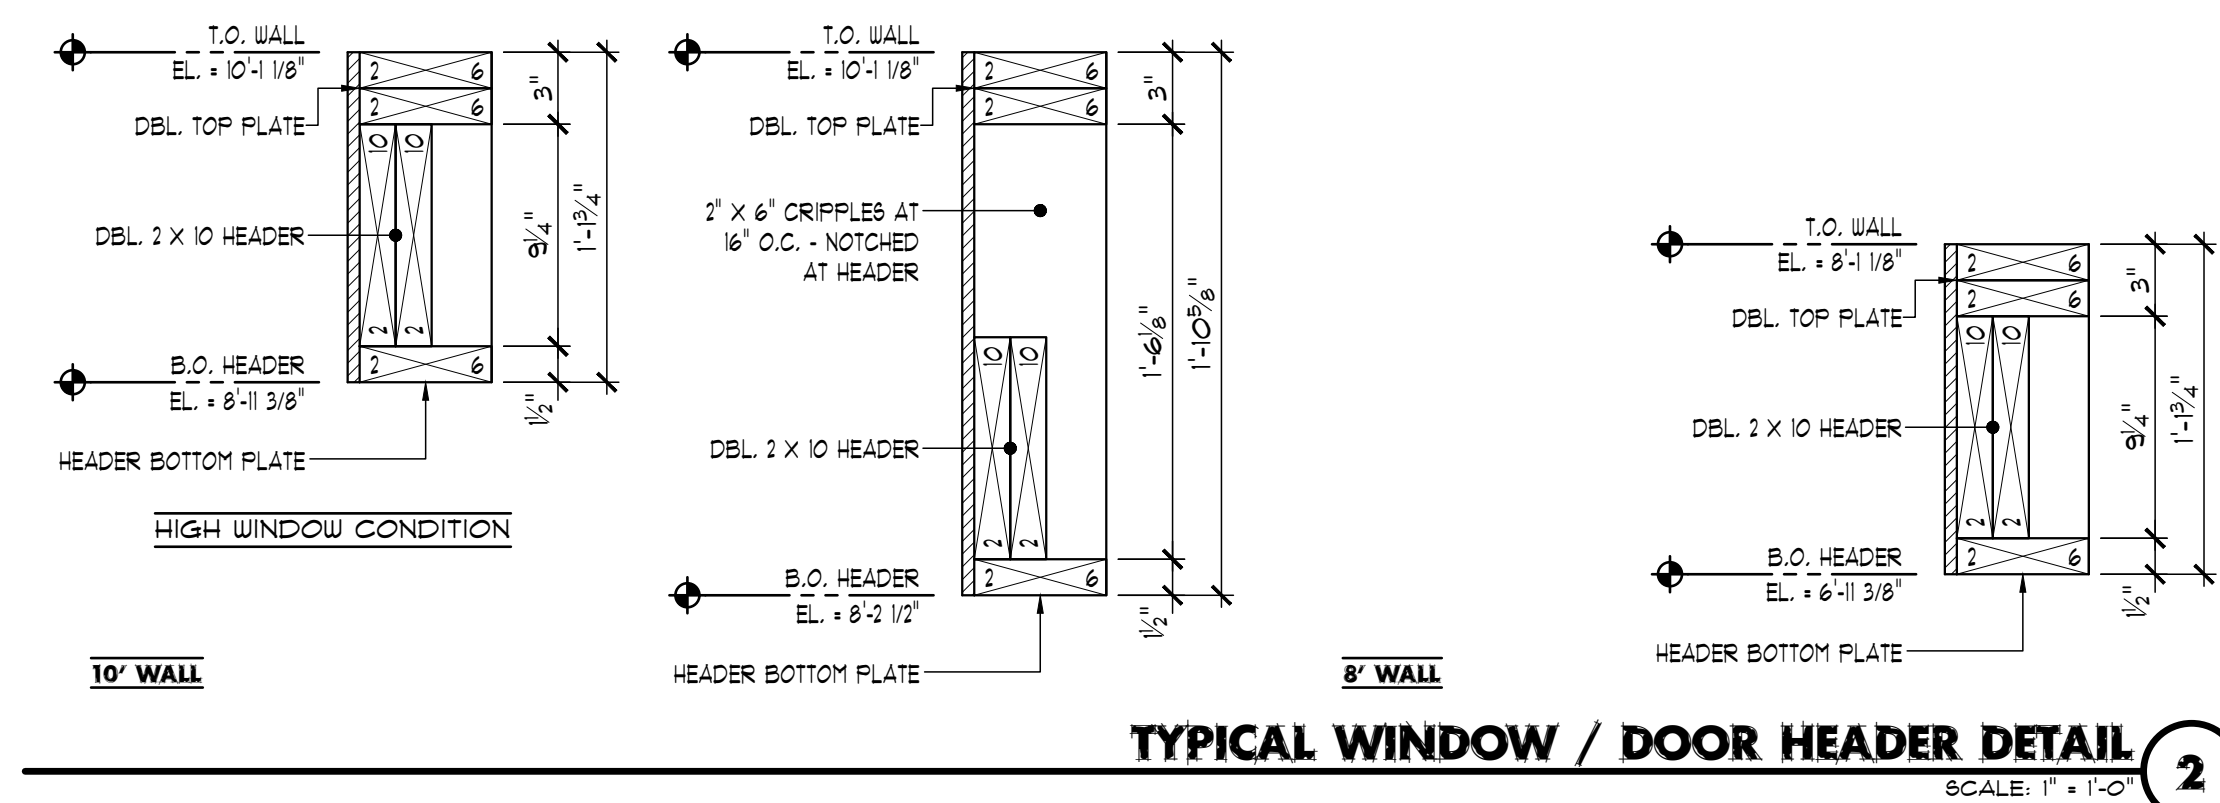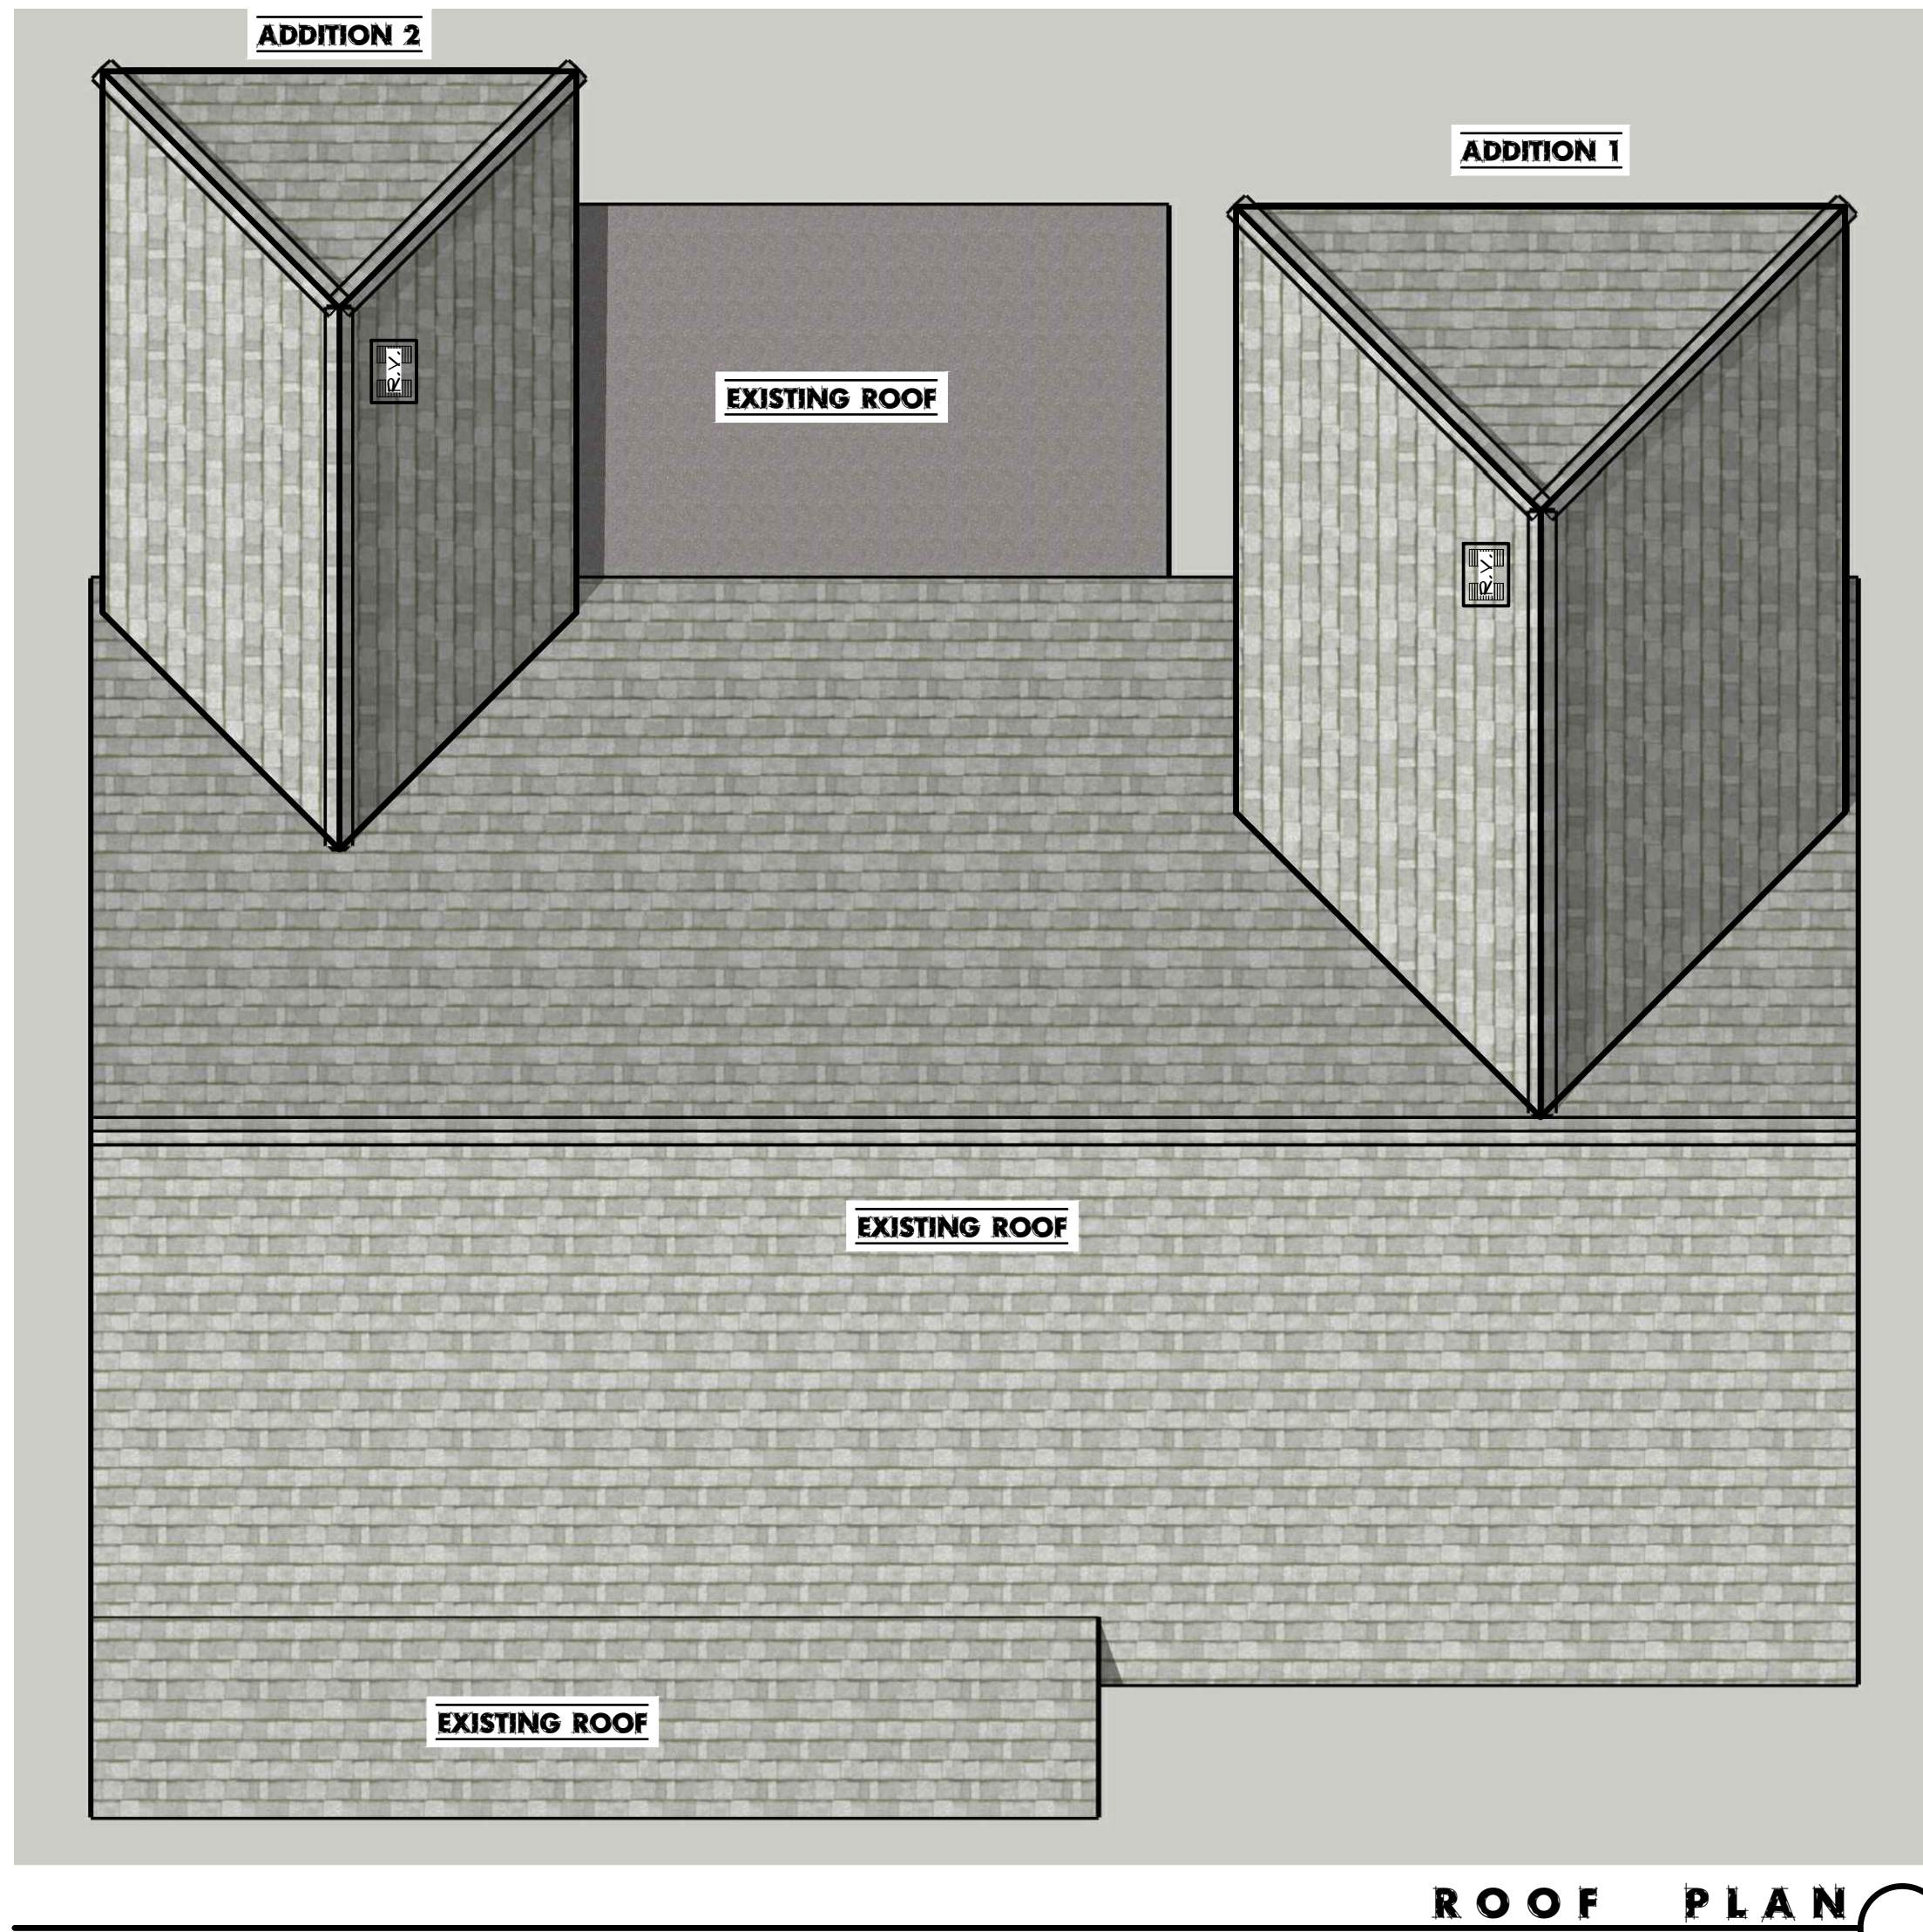


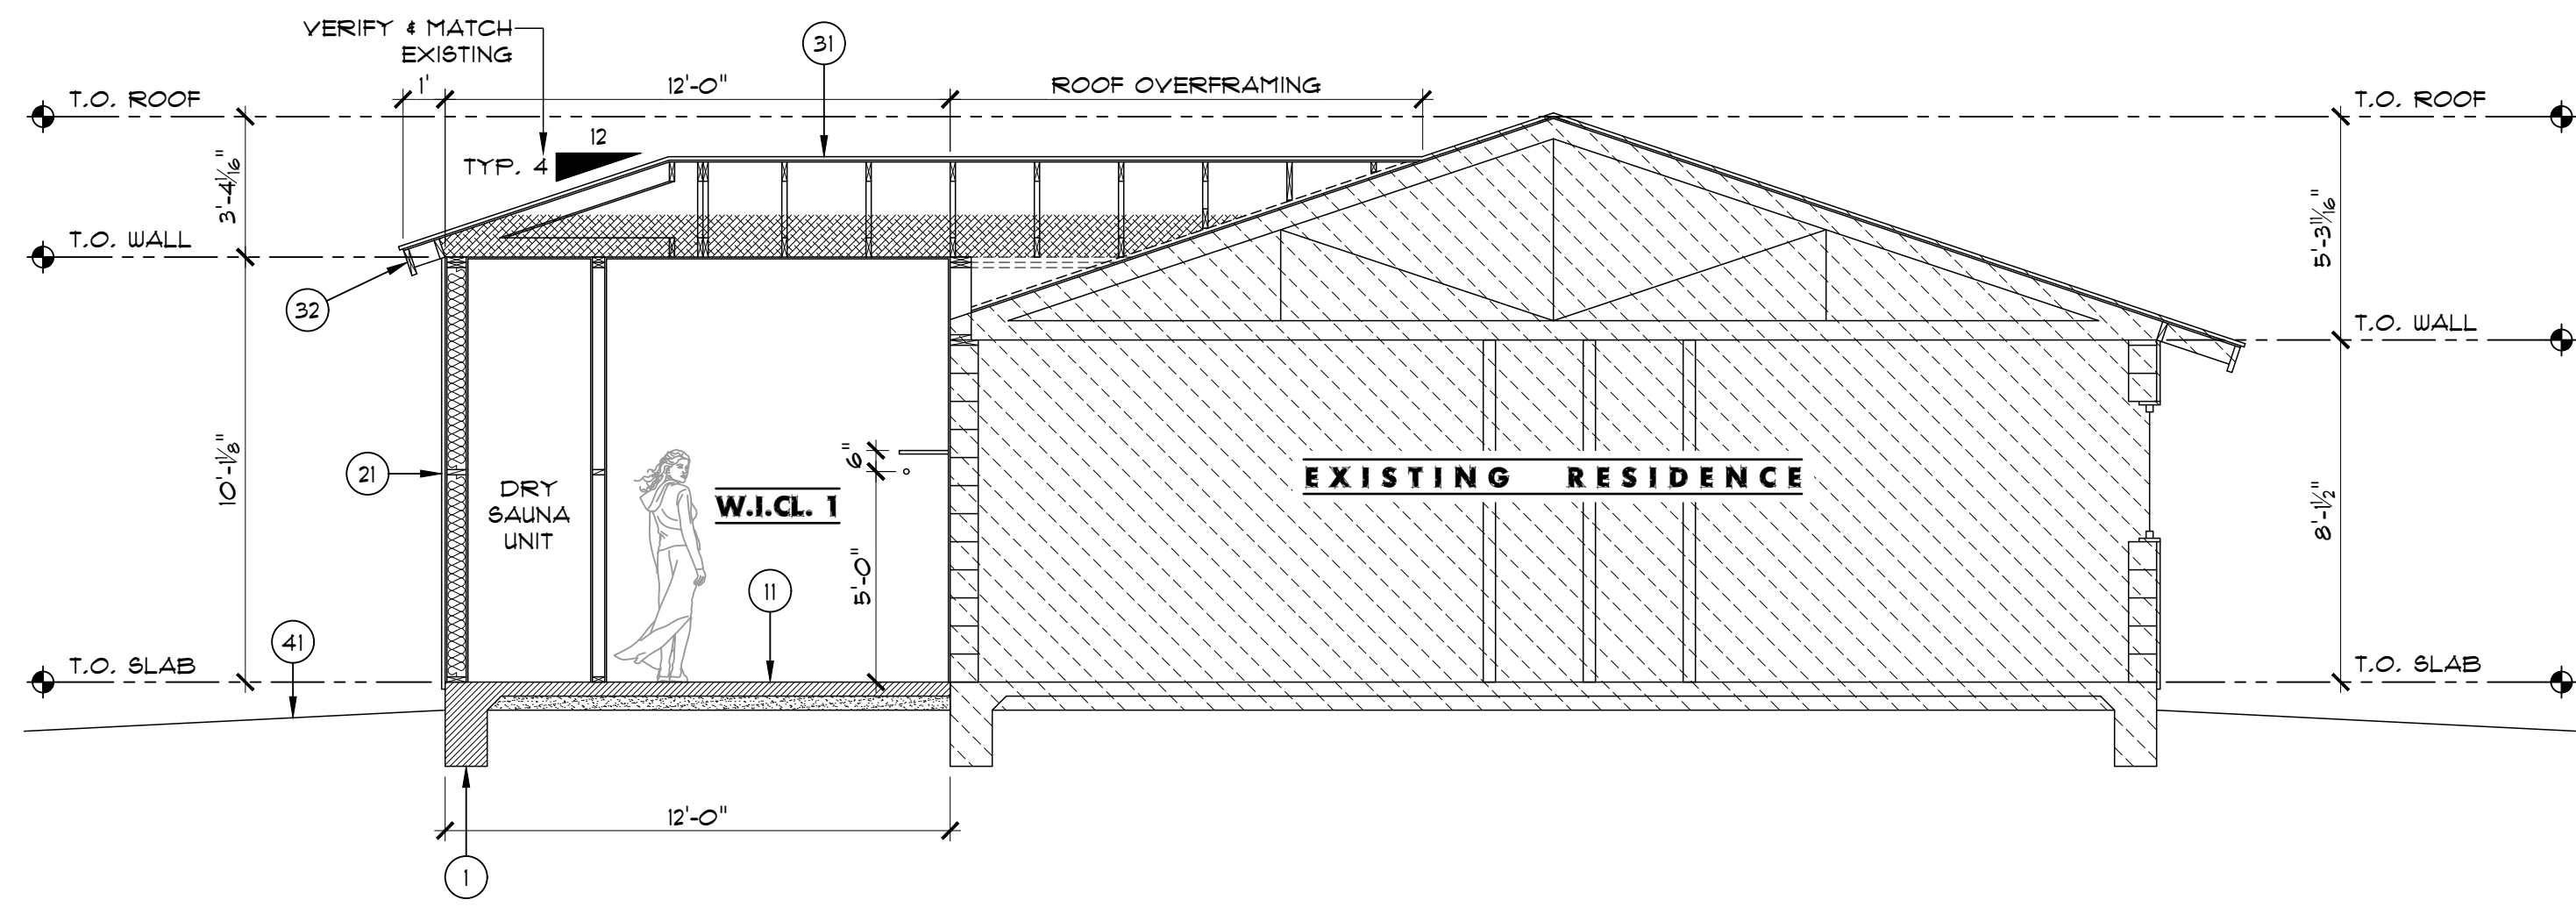


BUILDING SECTION "A" A
SCALE: 1/4" = 1'-0"

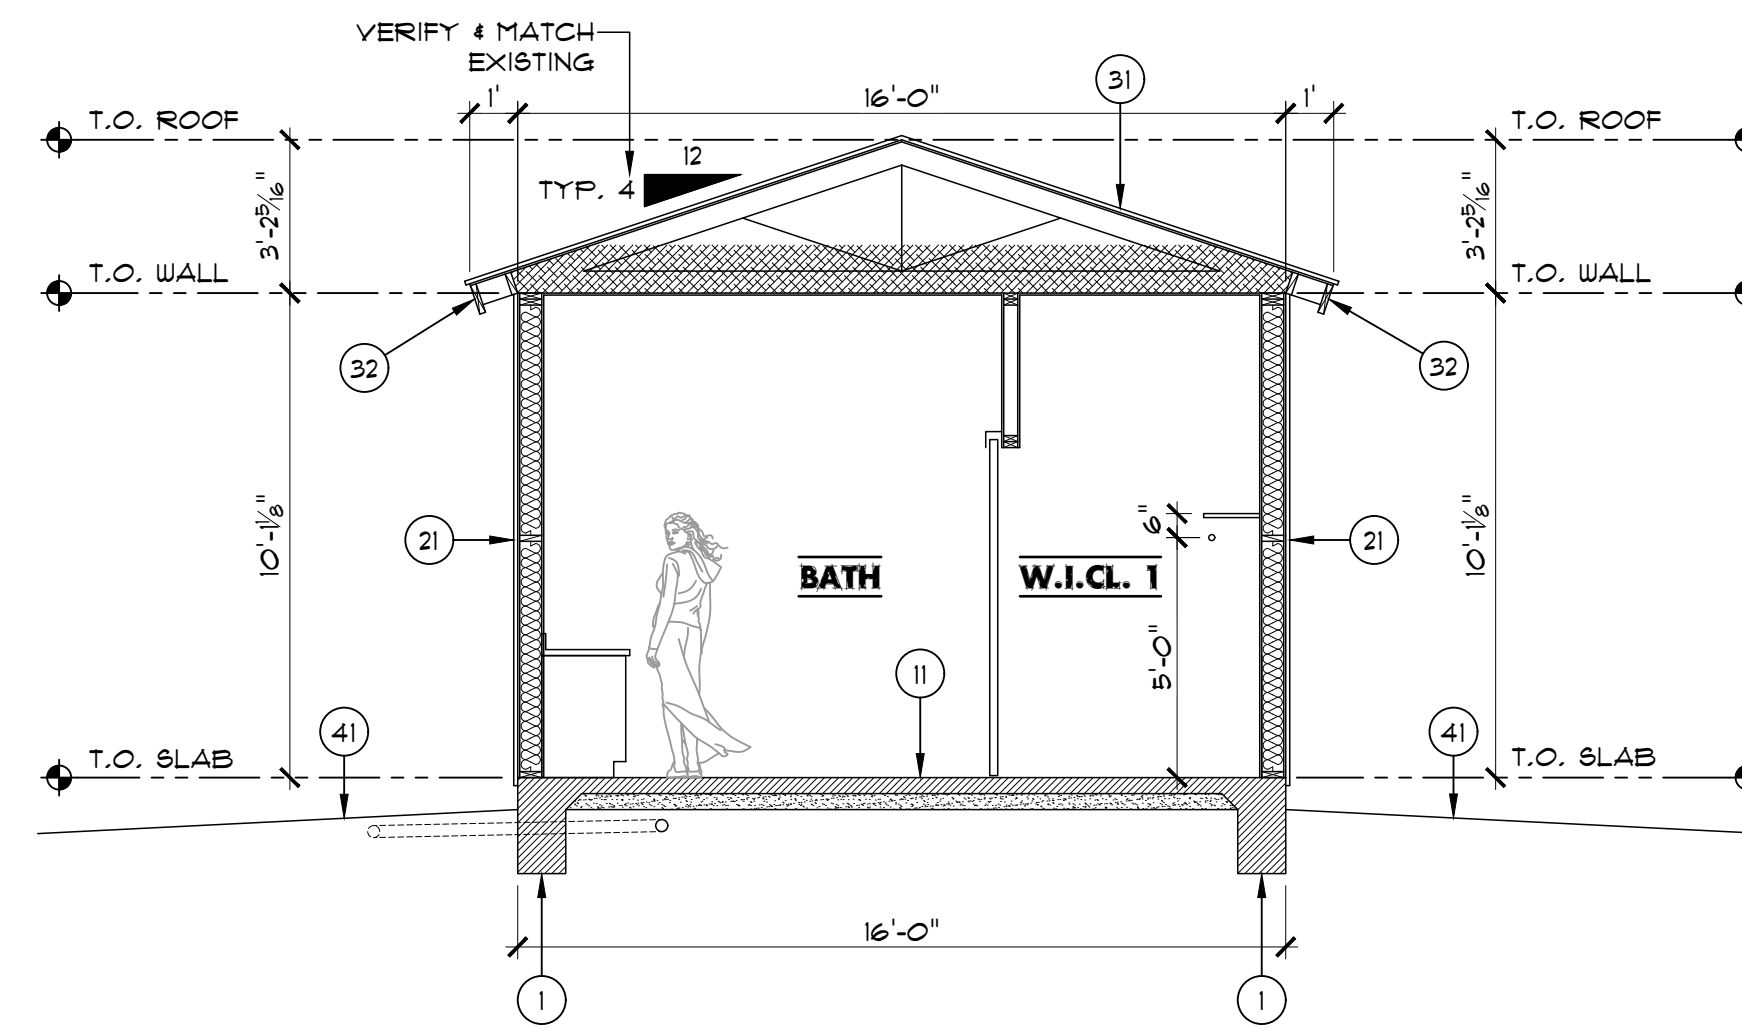

BUILDING SECTION "A" A
SCALE: 1/4" = 1'-0"

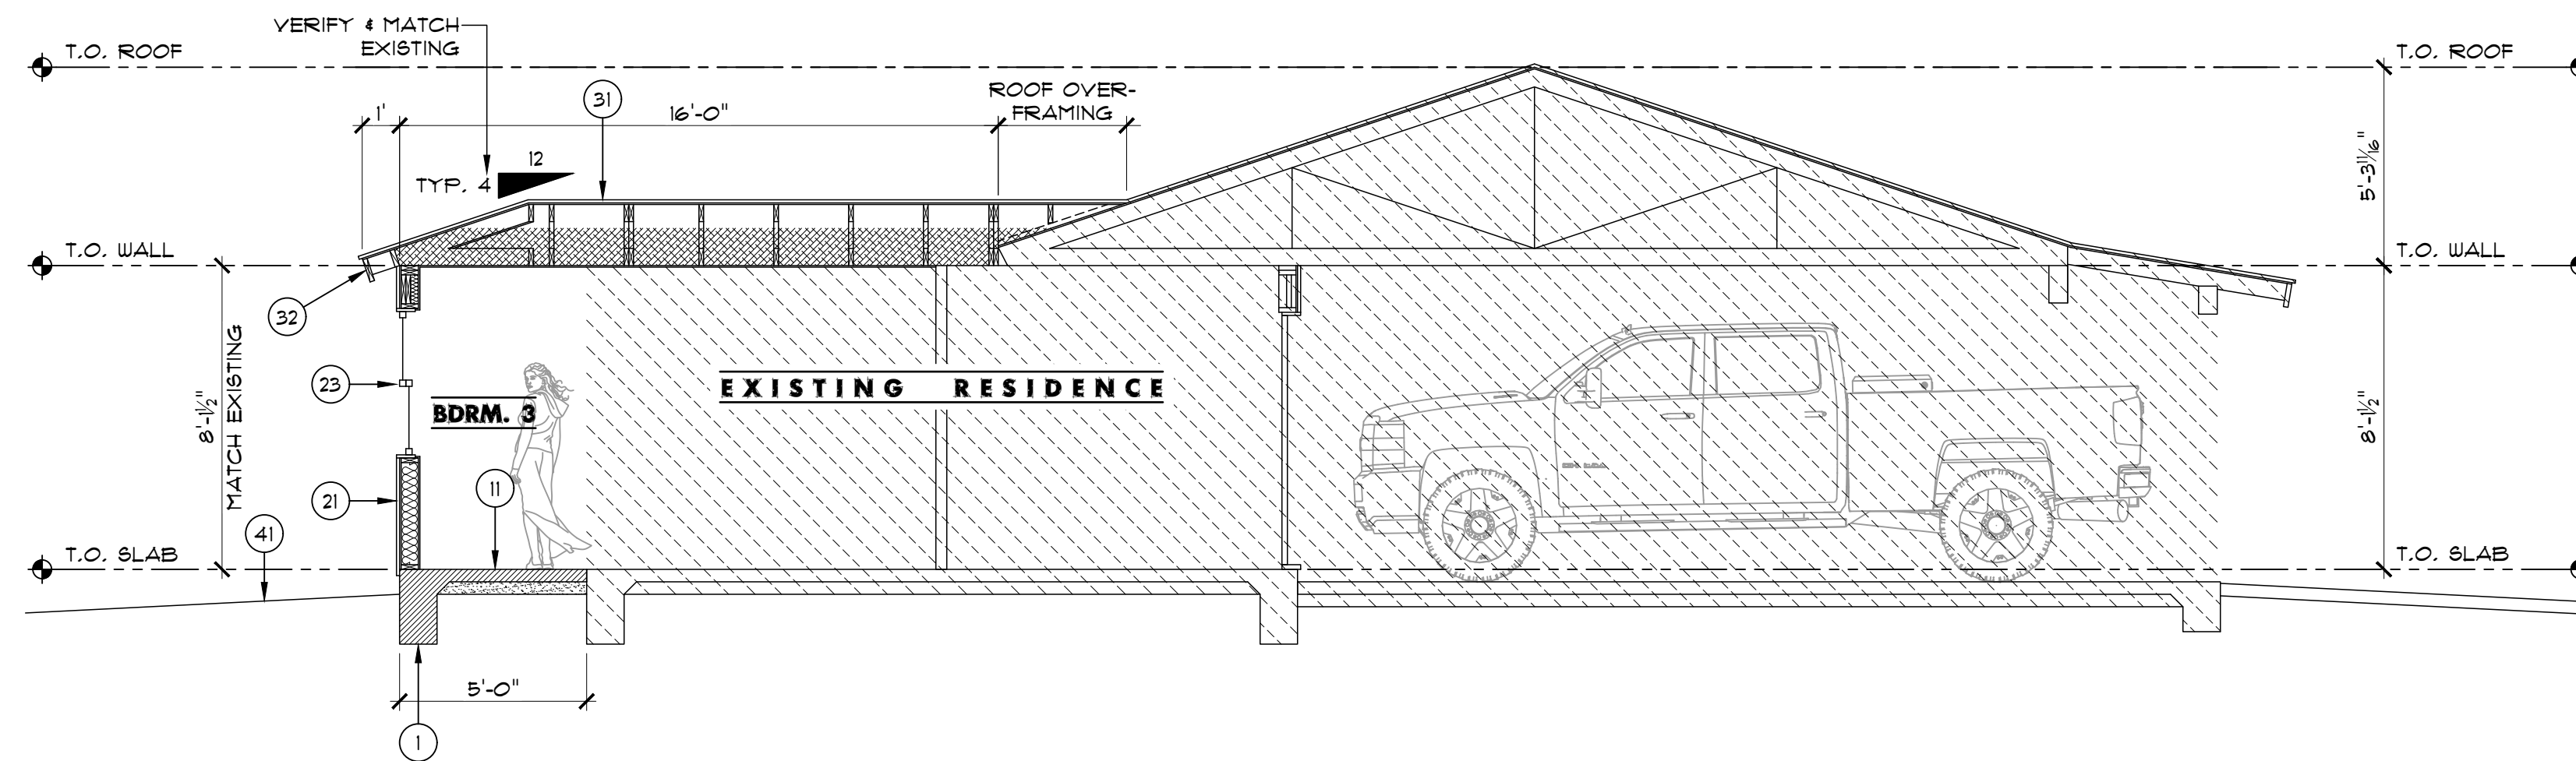


BUILDING SECTION "C" C
SCALE: 1/4" = 1'-0"

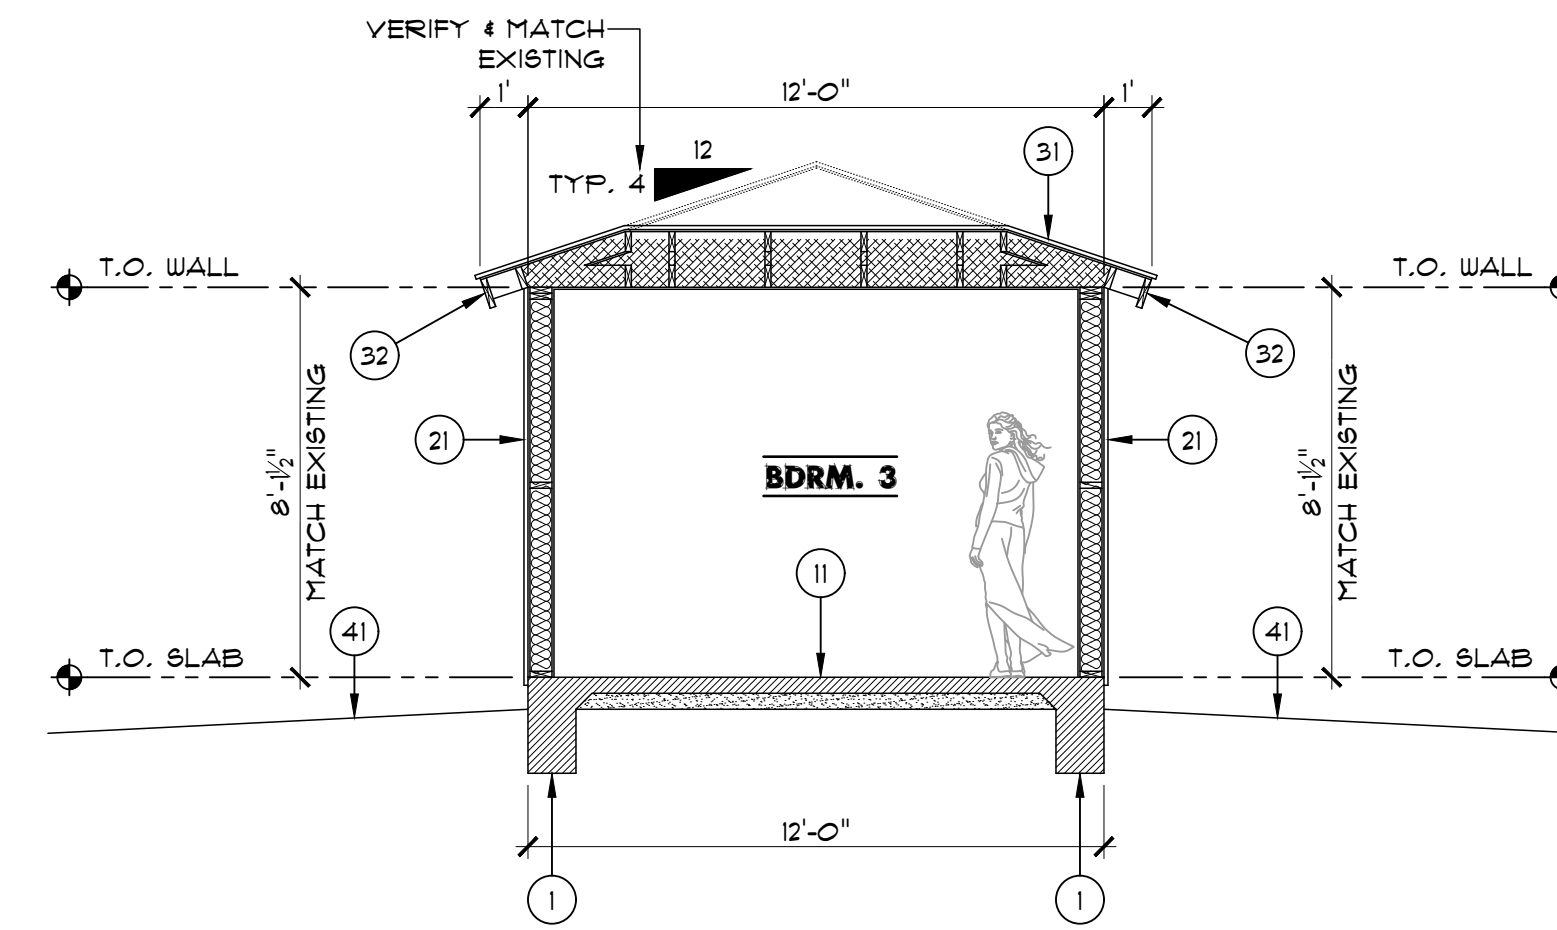

BUILDING SECTION "D" D
SCALE: 1/4" = 1'-0"

- BUILDING SECTION KEY NOTES:**
- 1 CONCRETE FOOTING / FOUNDATION WALL - SEE FOUNDATION PLAN
 - 11 HOUSE FLOOR CONSTRUCTION (SLAB ON GRADE):
 - 4" CONCRETE SLAB REINFORCED W/ #3 REBAR AT 24" O.C. EACH WAY
 - 4" COMPACTED (95% MIN.) AGG. BASE COURSE
 - UNDISTURBED OR ENGINEERED FILL
 - 21 TYPICAL EXTERIOR WALL CONSTRUCTION:
 - EXTERIOR FINISH PER ELEVATIONS
 - "TYVEK" BUILDING WRAP - (2) LAYERS @ MANUFACTURED STONE VENEER LOCATIONS
 - 3/8" (MIN.) CDX PLYWOOD OR O.S.B. WALL SHEATHING TO BE FLUSH W/ FACE OF C.M.U. FOUNDATION WALL - FASTEN W/ 8D NAILS AT 6" O.C. AT ALL PANEL EDGES & 12" O.C. ON ALL FRAMING MEMBERS NOT AT PANEL EDGES
 - 2" X 6" STUDS AT 16" O.C.
 - WALL INSULATION (R-21 MIN.) BETWEEN STUDS
 - 1/2" GYPSUM BOARD
 - 22 INTERIOR WALL CONSTRUCTION:
 - 1/2" GYPSUM BOARD
 - 2" X 4" OR 2" X 6" STUDS AT 16" O.C. - SEE FLOOR PLAN
 - 1/2" GYPSUM BOARD
 - 23 WINDOW / DOOR UNIT - SEE FLOOR PLAN & EXTERIOR ELEVATIONS
 - 24 HEADER / BEAM PER FRAMING PLAN
 - 31 ROOF CONSTRUCTION (TYPICAL):
 - ASPHALT SHINGLES - MATCH EXIST. HOUSE
 - "FALGADE" 35 YEAR SYNTHETIC ROOFING UNDERLAYMENT
 - 1/2" (FOR SHINGLES) / 5/8" (FOR TILE) CDX PLYWOOD / O.S.B. ROOF SHEATHING W/ "H" CLIPS FASTENED W/ 8D COMMON NAILS AT 6" O.C. ALONG PANEL EDGE AND 12" IN THE FIELD
 - PRE-ENGINEERED ROOF TRUSSES PER TRUSS MANUFACTURER W/ SIMPSON H2,5A OR EQUAL CONNECTORS AT EACH TRUSS TYPICAL
 - BLOWN OR BATT INSULATION (R-30)
 - 1/2" NON-SAG GYPSUM BOARD CEILING (INTERIOR) / 3/8" ADX PLYWD. SOFFITS AT EAVES / 1/2" NON-SAG EXTERIOR GYPSUM BOARD CEILING AT COVERED ENTRY & PATIO LOCATIONS
 - 1" X 8" LAMINATED FASCIA BOARD OVER
 - 2" X 6" SUB-FASCIA 3/8" ADX PLYWOOD SOFFITS
 - 32 1" X 8" LAMINATED FASCIA BOARD OVER 2" X 6" SUB-FASCIA OR VERIFY & MATCH EXISTING FASCIA BOARD
 - 33 GIRDER TRUSS PER TRUSS MANUFACTURER
 - 34 SEE ROOF FRAMING PLAN - SEE DETAIL 7 / A4.1
 - 34 ROOF OVERFRAMING - SEE DETAIL 8 / A4.1
 - 41 NATURAL GRADE LINE
 - 42 CUT LINE (.....) OF NATURAL GRADE
 - 43 ENGINEERED FILL - 95% COMPACTED SOIL IN 12" LIFTS NOT TO EXCEED 4'-0", UNLESS APPROVED BY CERTIFIED INSPECTION OR BUILDING OFFICIAL.
 - 44 NEW FINISHED GRADE TO SLOPE AWAY FROM BUILDING AT 5% (6" PER 10'-0")

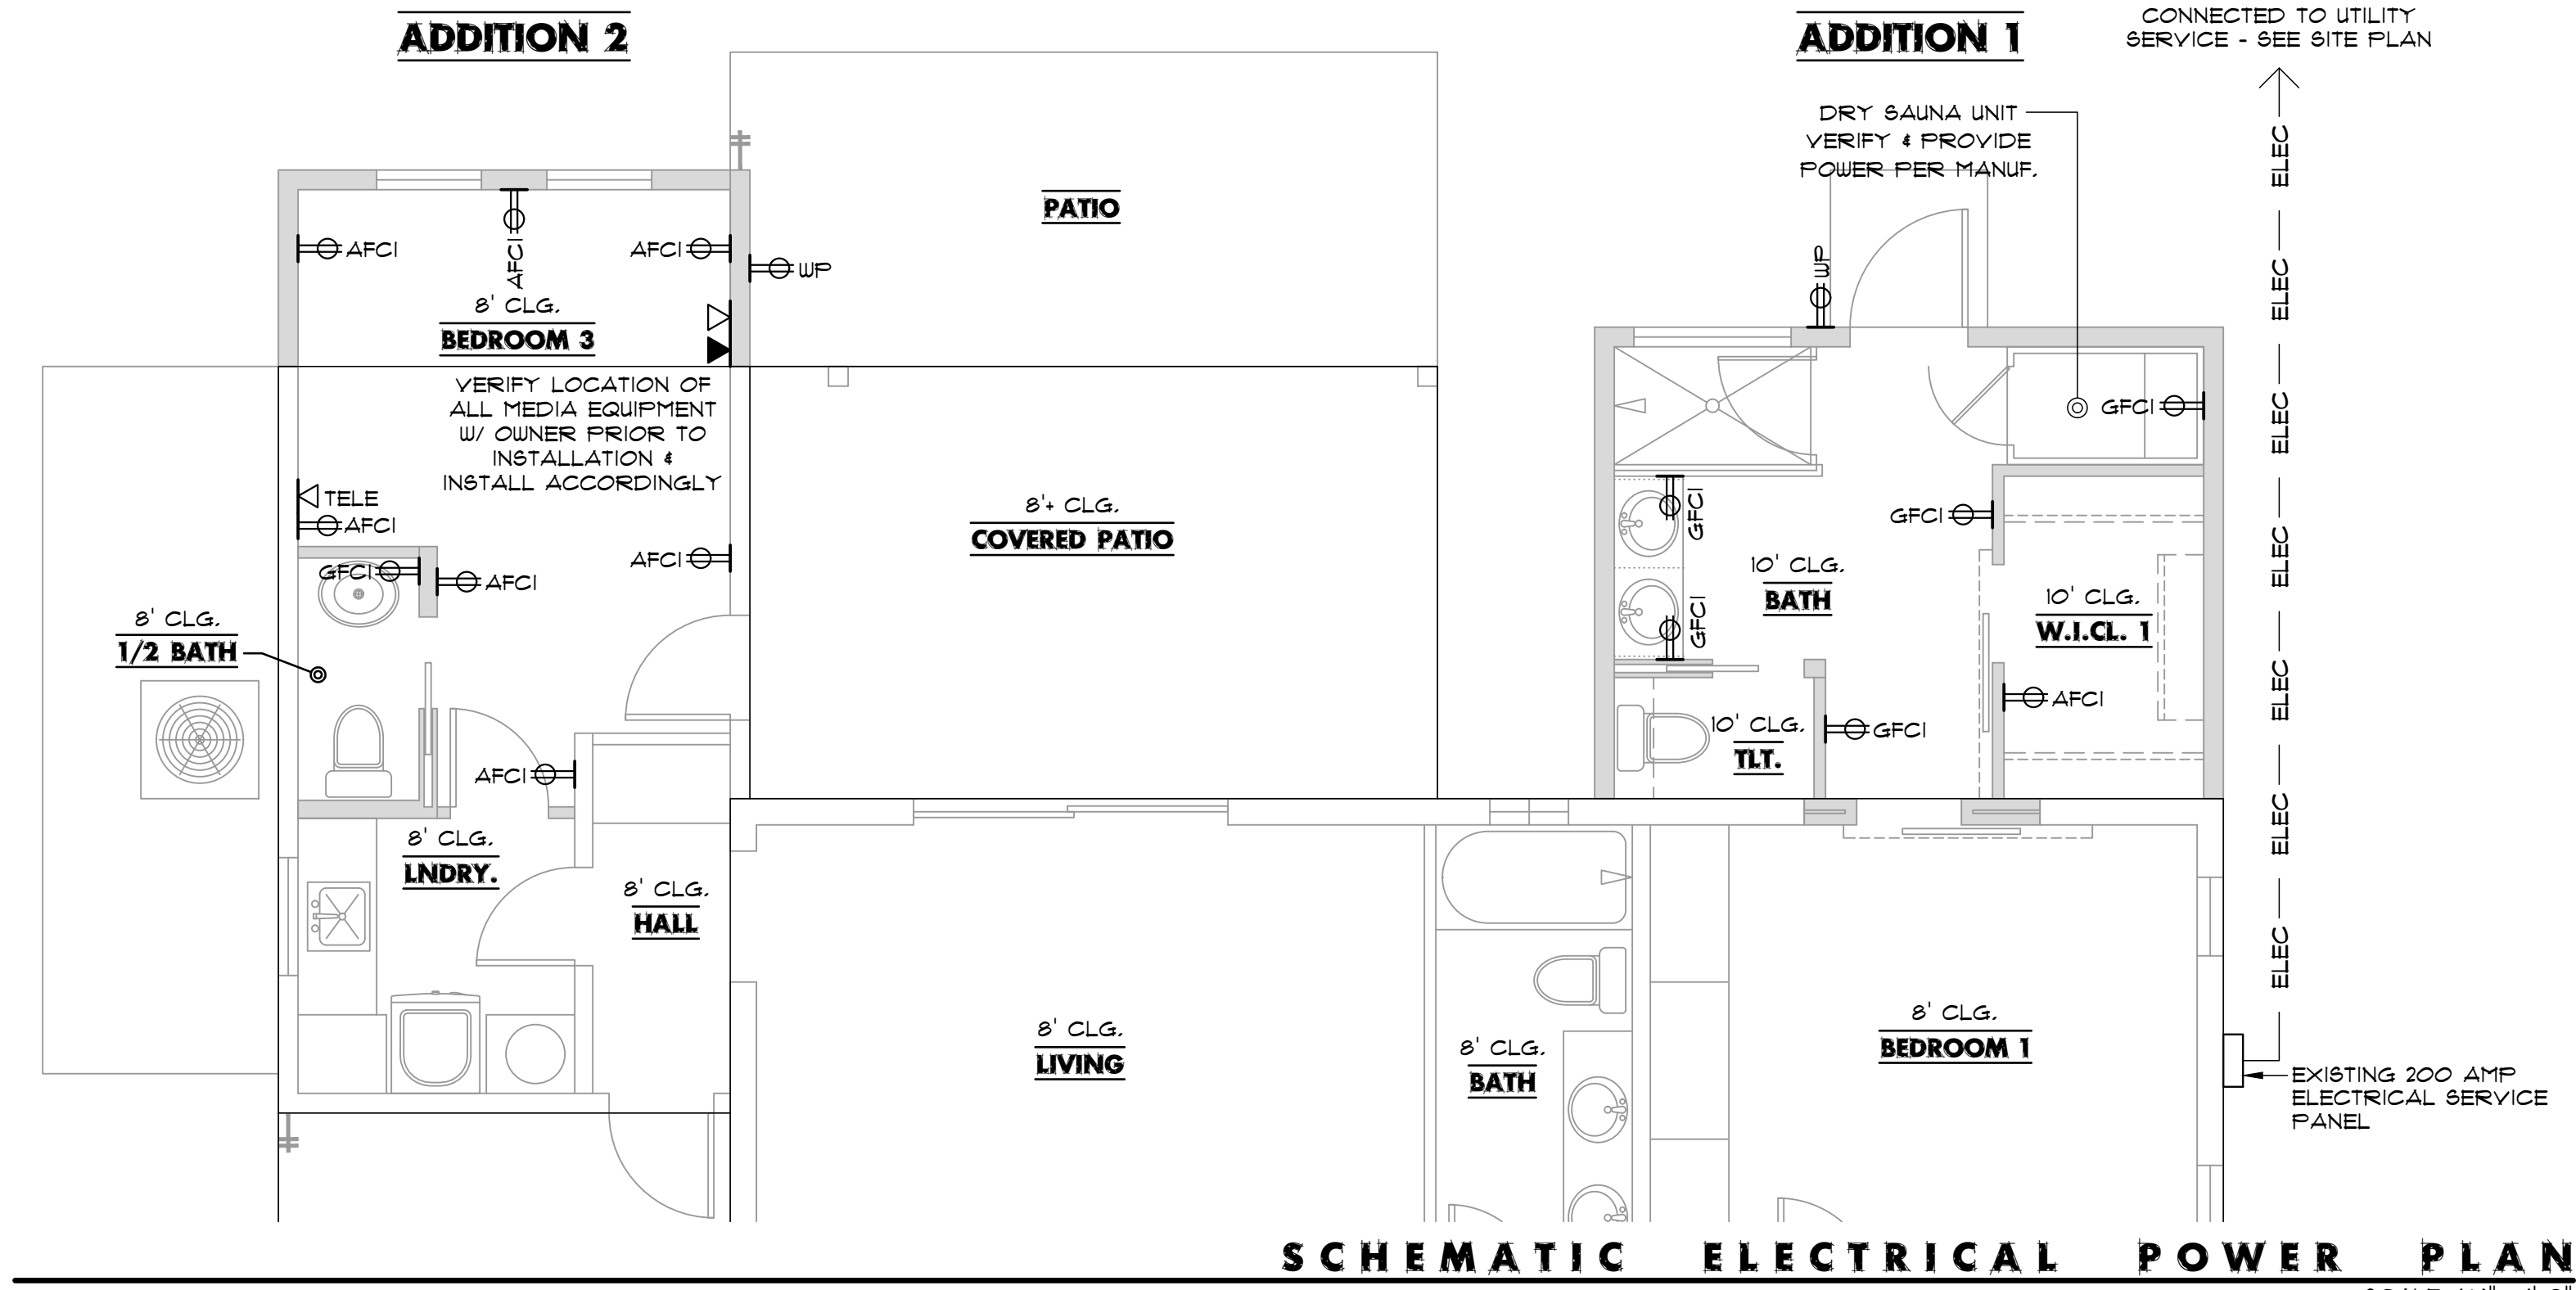

SCHEMATIC ELECTRICAL POWER PLAN
SCALE: 1/4" = 1'-0"



SCHEMATIC ELECTRICAL LIGHTING PLAN
SCALE: 1/4" = 1'-0"

ELECTRICAL LEGEND


	CEILING MOUNT LIGHT
	HANGING PENDANT LIGHT
	RECESSED LED LIGHT
	WALL MOUNT LIGHT
	WALL MOUNT LIGHT FULLY SHIELDED
	LED FLUORESCENT LIGHT
	UNDER CABINET LED LIGHT
	EXHAUST FAN
	EXHAUST FAN & LIGHT COMBINATION
	CEILING FAN W/ LIGHT KIT
	CEILING FAN
	TRACK LIGHTING
	ROPE / ABOVE CABINET LED LIGHTING
	CABINET TOE KICK LED LIGHTING
	SMOKE DETECTOR
	CARBON MONOXIDE DETECTOR
	SINGLE POLE SWITCH
	DOUBLE POLE SWITCH
	THREE WAY SWITCH
	FOUR WAY SWITCH
	DIMMER SWITCH
	FAN SWITCH
	DOOR ACTIVATED SWITCH
	GARAGE DOOR OPENER
	CONDUIT
	DUPLEX - 110 VOLT OUTLET
	1/2 SWITCHED DUPLEX 110 VOLT OUTLET - VERIFY SWITCH LOCATION W/ OWNER
	DOUBLE DUPLEX 110 VOLT OUTLET
	220 VOLT
	RANGE 220 VOLT (36" A.F.F.)
	WEATHERPROOF (GFCI) DUPLEX 110 VOLT OUTLET
	GROUND FAULT CIRCUIT INTERRUPTER DUPLEX 110 VOLT OUTLET
	ARC FAULT CIRCUIT INTERRUPTER DUPLEX 110 VOLT OUTLET
	FLOOR - 110 VOLT OUTLET VERIFY LOCATION(S) W/ OWNER
	DRYER - 220V
	TELEPHONE
	CABLE T.V.
	DATA
	THERMOSTAT
	DOOR BELL
	DOOR BELL CHIME
	SPEAKER

- NOTES:**
- TOP OF ALL SWITCH BOXES TO BE AT 44"-48" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE
 - TOP OF ALL OUTLETS TO BE AT 12"-16" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE
 - MOUNT ALL GARAGE OUTLETS AT 42"-48" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE
 - MOUNT RECEPTACLES AT COUNTERTOP LOCATIONS 2" ABOVE BACKSPASH.
 - DISHWASHER RECEPTACLE TO BE MOUNTED AT 6" ABOVE FINISHED FLOOR UNLESS NOTED OTHERWISE

ELECTRICAL PLAN NOTES:

- THE FOLLOWING APPLIANCES ARE REQUIRED TO HAVE A SEPARATE 20 AMP CIRCUIT: DISHWASHER, TRASH COMPACTOR, SWAMP COOLER, MICROWAVE, OVEN AND WASHER. THE WASHER CIRCUIT MAY SERVE ONE ADDITIONAL OUTLET IN THE LAUNDRY AREA. ELECTRICIAN TO PROVIDE COPPER WIRE AT ELECTRIC SERVICE ENTRANCE.
- ELECTRICIAN SHALL VERIFY LOCATION OF SERVICE ENTRANCE AND METER WITH UTILITY COMPANY PRIOR TO START OF CONSTRUCTION.
- ELECTRICIAN TO PROVIDE TEMPORARY POWER AS REQUIRED.
- IF INTERCOM AND/OR SECURITY SYSTEM IS INCLUDED, ELECTRICIAN SHALL VERIFY LOCATIONS WITH GENERAL CONTRACTOR.
- ELECTRICIAN SHALL HOOK UP ALL APPLIANCES SELECTED BY OWNER.
- ELECTRICIAN TO PRE-WIRE FOR TELEPHONE, TELEVISION, FUTURE CABLE AND INTERNET (INCLUDING TRIM-OUT).
- ALL CEILING BOXES TO BE RIGIDLY SECURED TO FRAMING.
- PROVIDE A FUSED DISCONNECT AS PER MANUFACTURER SPECIFICATIONS TO ALL A/C POWER LOCATIONS.
- ALL EXTERIOR OUTLETS, BATHROOM OUTLETS, GARAGE OUTLETS TO BE EQUIPPED WITH G.F.C.I.
- GARAGE AND EXTERIOR OUTLETS TO BE WATERPROOF.
- TWO OR MORE SEPARATE SMALL APPLIANCE CIRCUITS ARE REQUIRED IN THE KITCHEN, BREAKFAST ROOM, DINING ROOM OR OTHER SIMILAR AREA.
- PROVIDE OUTLETS AT KITCHEN SO THAT NO PORTION OF COUNTER IS MORE THAN 24" FROM AN OUTLET.
- ALL KITCHEN COUNTERTOP OUTLETS SHALL BE ON A DEDICATED 20 AMP G.F.C.I. BREAKER.
- ALL BATHROOM OUTLETS SHALL BE ON A DEDICATED 20 AMP G.F.C.I. BREAKER.
- ALL BRANCH CIRCUITS TO BEDROOMS SHALL BE ON A DEDICATED ARC-FAULT CIRCUIT INTERRUPTER BREAKER.
- PROVIDE ELECTRICAL SERVICE TO HVAC UNIT (VERIFY LOCATION)
- VERIFY WITH CONTRACTOR LOCATION OF PREFERRED LOCATIONS FOR TV AND PHONE OUTLETS. ANY CHANGES TO THE ELECTRICAL LAY-OUT, VERIFY FOR ANY ADDITIONAL CHANGES.
- ELECTRICAL PLAN IS STRICTLY DIAGRAMMATIC. CONTRACTOR IS TO OBTAIN ENGINEERING WHEN REQUESTED BY BUILDING OFFICIALS. ALL WORK MUST CONFORM TO 2011 NEC AND 2012 IRC CODES
- PROVIDE 120 VOLT SINGLE PHASE POWER TO UTILITY ROOF MOUNT A/C UNITS, ALSO PROVIDE COMPLETE WIRING, INCLUDING DISCONNECT SWITCHES, FUSES, CONTROL WIRING, ETC. FOR A/C EQUIPMENT PER MANUFACTURER'S SPECIFICATIONS IN COMPLIANCE WITH THE LATEST N.E.C. - SEE SHEET E-1.2 FOR LOCATIONS OF A/C UNITS.
- ELECTRICAL LOAD CALCULATIONS AND PANEL SCHEDULE ARE TO BE PROVIDED BY OTHERS

- NOTES:**
- A SEPARATE 20 AMP RATED BRANCH CIRCUIT FOR RECEPTACLES LOCATED IN BATHROOM AREAS.
 - ALL BRANCHES THAT SUPPLY 125V, SINGLE PHASE, 15 AMP & 20 AMP RECEPTACLE OUTLETS INSTALLED IN BEDROOMS SHALL BE PROTECTED BY AN ARC FAULT CIRCUIT INTERRUPTER.
 - A SEPARATE 20 AMP RATED BRANCH CIRCUIT FOR RECEPTACLES LOCATED IN LAUNDRY AREAS.
 - A MIN. OF (2) 20 AMP RATED BRANCH CIRCUITS FOR RECEPTACLES LOCATED IN THE KITCHEN, BREAKFAST & DINING AREAS

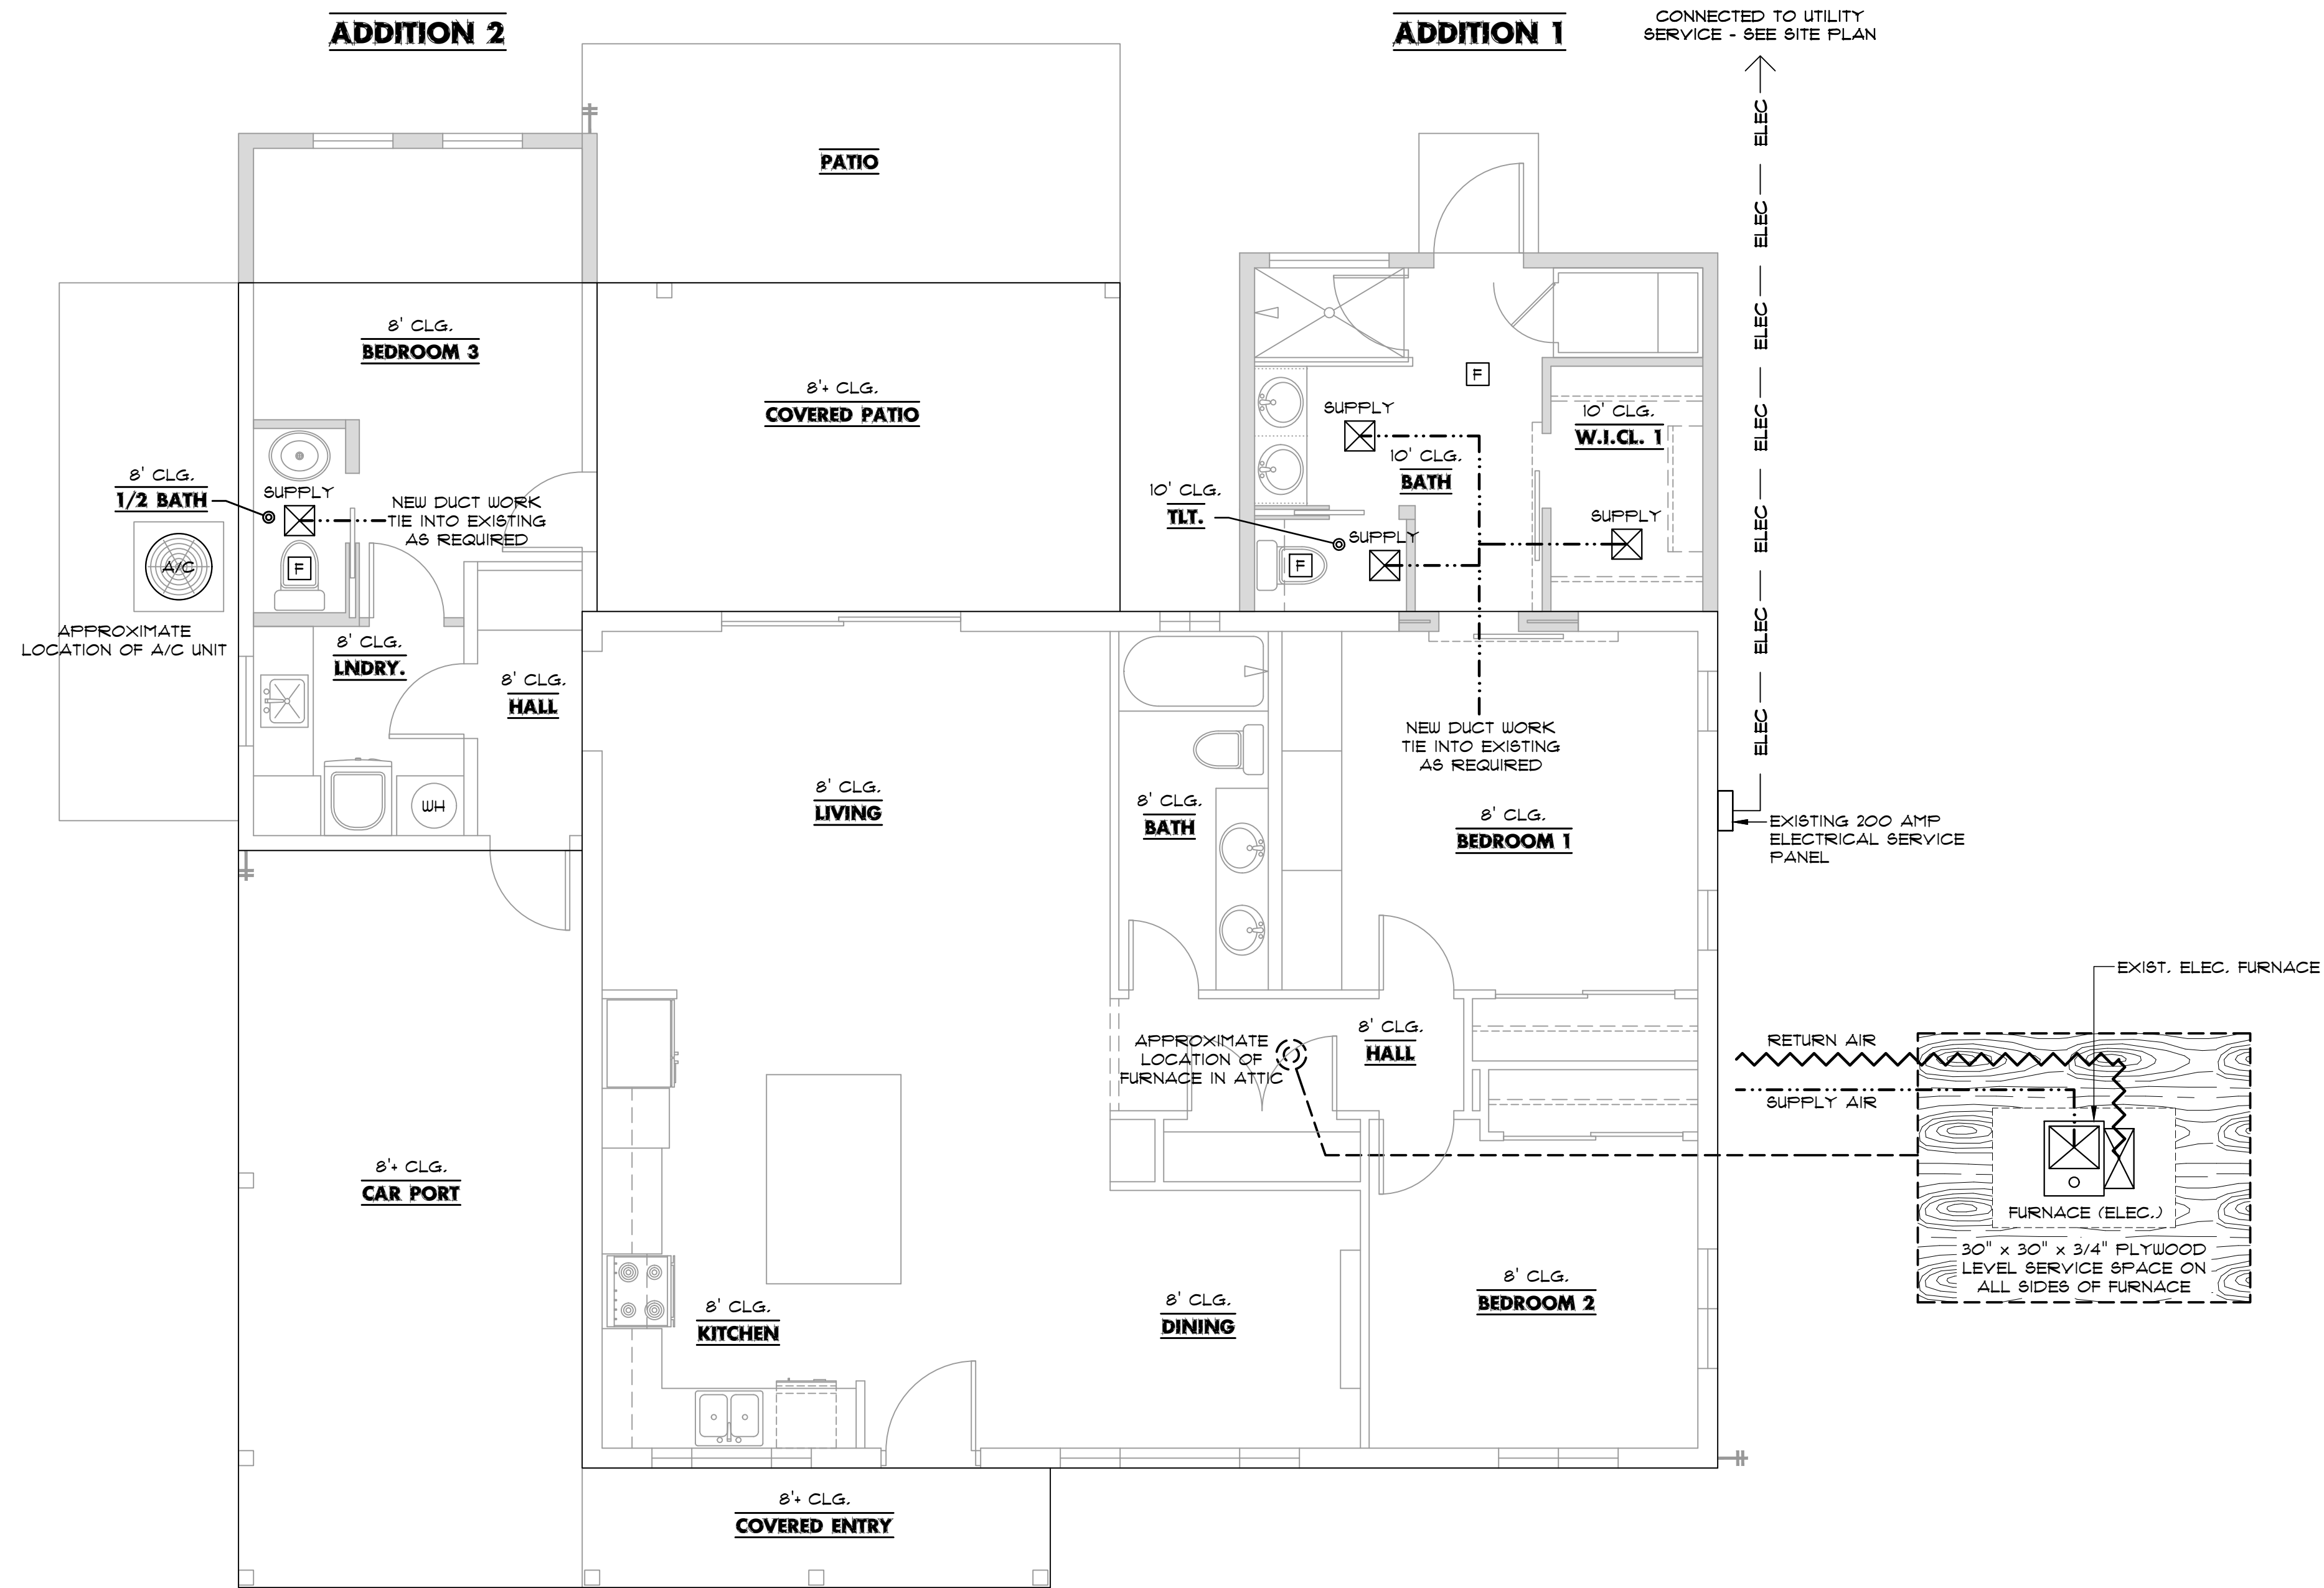

NOTES:

- HVAC UNIT TO BE SIZED BY HVAC CONTRACTOR.
- DUCT SYSTEM TO BE SIZED BY HVAC CONTRACTOR.
- ALL DUCT SUPPLY & RETURN SHALL BE INSULATED MINIMUM R-6.
- ALL DUCTS, AIR HANDLERS, FILTER BOXES & BUILDING CAVITIES (NOT OR SUPPLY AIR) USED AS DUCTS SHALL BE SEALED. JOINTS OF DUCT SYSTEMS SHALL BE MADE SUBSTANTIALLY AIR TIGHT BY MEANS OF TAPES, MASTICS, GASKETING OR OTHER APPROVED CLOSURE SYSTEMS.
- ALL OUTDOOR AIR INTAKES & EXHAUSTS SHALL BE PROVIDED WITH DAMPERS (AUTOMATIC OR GRAVITY) TO EFFECTIVELY CLOSE WHEN VENTILATION SYSTEM IS NOT OPERATING.
- HVAC CONTRACTOR SHALL VERIFY ALL EQUIPMENT AND DUCT SIZES AND LOCATIONS.
- HVAC CONTRACTOR SHALL VERIFY ALL SYSTEM COMPONENTS AND INSTALLATION SHALL MEET I.R.C. CHAPTER 11-20.

NOTE:

DUE TO INDIVIDUAL PREFERENCES AND METHODS OF INSTALLATION, THIS SHEET IS FOR THE BUILDER AND HVAC CONTRACTOR TO LAYOUT AND SIZE THE DUCT WORK. THE DUCT WORK, VENTING, AND OTHER DETAILS WILL VARY DEPENDING ON THE TYPE OF HEATING AND COOLING SYSTEM (FORCED AIR, HOT WATER, ELECTRIC, SOLAR), AND THE TYPE OF ENERGY (GAS, OIL, ELECTRICITY, SOLAR) THAT ARE TO BE USED. THESE CORRESPONDING DETAILS AND SPECIFICATIONS ARE TO BE OBTAINED FROM YOUR BUILDER, OR HVAC CONTRACTOR.

SCHMATIC MECHANICAL PLAN

SCALE: 1/8" = 1'-0"

MECHANICAL NOTES (2018 IRC):

1. THE MECHANICAL LAYOUT IS SCHEMATIC & INTENDED TO SHOW THE MOST PROBABLE LOCATIONS OF EQUIPMENT, DUCTS, REGISTERS, GRILLS, ETC. THE MECHANICAL CONTRACTOR SHALL DESIGN THE ENTIRE HEATING / COOLING SYSTEM(S), SIZING THE EQUIPMENT, DUCTS, GRILLES AND REGISTERS AND SHALL GUARANTEE THE SYSTEM(S) TO PROVIDE COMFORTABLE TEMPERATURE YEAR LONG THROUGHOUT THE LIVEABLE SPACE.
2. ALL WORK TO BE DONE SHALL COMPLY WITH THE APPLICABLE CHAPTERS OF THE 2018 I.R.C.
3. WORK AND INSTALLATION SHALL CONFORM TO ALL APPLICABLE NATIONAL, STATE, LOCAL CODES AND ORDINANCES.
4. THE MECHANICAL CONTRACTOR SHALL COMMUNICATE TO THE OWNER PRIOR TO ANY INSTALLATION THE TOTAL SYSTEM DESIGN INCLUDING THE INTENDED SYSTEM PERFORMANCE AND REGISTER AND GRILL LOCATIONS.
5. EXTERIOR HEAT PUMPS AND AC COMPRESSORS SHALL BE PLACED ON CONCRETE SLABS. SLABS SHALL BE SEPARATED FROM ANY BUILDING STRUCTURE BY 4" MIN. AND SHALL NOT TOUCH THE BUILDING. EQUIPMENT CLOSE TO ANY LIVEABLE AREA SHALL BE MOUNTED ON VIBRATION ISOLATORS. SLAB SHALL BE 3" MIN. ABOVE GRADE.
6. COMPRESSOR PIPING SHALL BE ISOLATED FROM ALL BUILDING FRAMING WITH INSULATORS.
7. THERMOSTATS SHALL HAVE "ON-OFF" AND "AUTO-FAN" SWITCHES.
8. THERMOSTATS SHALL BE 1 DAY PROGRAMMABLE WITH BATTERY BACK-UP.
9. DOORS TO MECHANICAL ROOMS SHALL BE SOLID CORE WITH WEATHER STRIPPING AND THRESHOLDS FOR TIGHT FITTING INSTALLATION.
10. VENT CLOTHES DRYER TO OUTSIDE WITH A 1" MIN. DIA. EXHAUST DUCT. THE MAX. LENGTH SHALL NOT EXCEED 25'-0" FROM THE DRYER TO THE WALL OR ROOF TERMINATION. THE MAX. LENGTH SHALL BE REDUCED 2.5' FOR EACH 45 DEGREE BEND, AND 5'-0" FOR EACH 90 DEGREE BEND.
11. PROVIDE EXTERIOR SCREENED AND LOUVERED VENT CAPS FOR ALL EXHAUST FANS.
12. THE CONTRACTOR IS RESPONSIBLE FOR TRENCHING ANY BELOW SLAB DUCTS, OR SHALL ARRANGE WITH SUB-CONTRACTOR TO HAVE THIS WORK DONE PRIOR.
13. RETURN AIR DUCTS FROM BEDROOMS EXITING INTO LIVING SPACES (FOR PICK-UP BY THE MAIN RETURN AIR GRILLE) SHALL BE LINED ON THE INSIDE OF THE DUCT FOR NOISE REDUCTION.
14. UNLESS INSTRUCTED OTHERWISE EACH CLOSED-OFF LIVEABLE ROOM SHALL HAVE ITS OWN RETURN AIR. CUTTING OF DOORS FOR RETURN AIR PURPOSES IS NOT PERMITTED.
15. THE SUPPLY AND RETURN TRUNK LINES SHALL BE RIGID SHEET METAL. INDIVIDUAL BRANCH LINES MAY BE FLEX DUCT AT CONTRACTORS OPTION.
16. THE MECHANICAL CONTRACTOR SHALL CONVEY TO THE GENERAL CONTRACTOR, DUCT SIZES NECESSARY FOR PLENUM AND SOFFIT FRAMING ENCLOSING DUCTS.
17. FLUES FROM ANY GAS APPLIANCES SHALL HAVE THE REQUIRED CLEARANCES TO COMBUSTIBLE MATERIALS AS PER CODE AND MANUF. REQUIREMENTS.
18. PROVIDE SCREENED AND LOUVERED COMBUSTION AIR VENTS (HIGH-LOW) TO MECHANICAL ROOMS WITH GAS APPLIANCES. THE SIZE OF EACH VENT SHALL BE A MINIMUM OF 1 SQ. INCH PER 1000 BTU, OR AS PER CODE. MINIMUM EACH VENT = 100 SQ. INCHES. THIS AIR SHALL NOT BE TAKEN FROM INSIDE THE GARAGE.
19. FOLLOW ALL MECHANICAL CODE REQUIREMENTS FOR GAS FLUE PIPING AND ANNUAL SPACES.
20. ALL CONTROL WIRING SHALL BE 18 GAUGE SOLID COPPER WIRE
21. CONDENSATE PIPING SHALL BE 3/4" PVC SCHEDULE 40 PIPE WITH SOLVENT-CEMENTED JOINTS MADE IN ACCORDANCE WITH 2018 I.M.C. SECTION 1203.3.4.
22. CONDENSATE PIPING WILL BE 3/4" PVC SCHEDULE 40 PIPE EXTENDING AT FULL PIPE SIZE TO OUTSIDE 6" - 24" ABOVE GRADE.
23. REFRIGERANT "SUCTION" LINE SHALL BE INSULATED WITH 3/8" WALL CLOSE CELL INSULATION IN ACCORDANCE WITH 2018 I.M.C. SECTION 1107.
24. ALL REFRIGERANT LINES ARE TO BE TYPE ACR TYPE SOFT COPPER TUBING.
25. ALL FLEXIBLE DUCT TO BE SUPPORTED EVERY 6'-0"
26. ALL SUPPLY AND RETURN DUCTS, TRANSITIONS, AND FLEXIBLE DUCTS SHALL BE INSULATED TO A MIN. R-6.
27. ALL DUCTS, AIR HANDLERS, FILTER BOXES, AND BUILDING CAVITIES NOT FOR SUPPLY AIR USED AS DUCTS SHALL BE SEALED. JOINTS AND SEAMS SHALL BE SEALED TO COMPLY WITH SECTION M1501.3 OF THE 2018 I.R.C.
28. CLOTHES DRYER EXHAUST DUCTS TO BE IN ACCORDANCE WITH 2018 I.M.C. SECTION 504.1.2M, 504.3, 504.4, 504.5, 504.6, 504.6.1 AND 504.6.2.
29. KITCHEN EXHAUST EQUIPMENT DUCTS TO BE IN ACCORDANCE WITH 2018 I.M.C. SECTION 505.1 AND 505.2. ALL LOAD CALCULATIONS AND DUCT SIZING TO BE IN ACCORDANCE WITH 2018 IECC SECTION 403.5 AND IRC SECTION M1401.3 AND M1601.1.

EXHAUST FANS:

30. ALL EXHAUST FANS TO BE INSTALLED IN ACCORDANCE WITH MANUF. RECOMMENDATIONS.
31. ALL EXHAUST FANS TO BE PLACED IN ACCORDANCE WITH 2018 I.M.C. SECTION 502.1B.
32. EXHAUST FANS TO BE SIZED IN ACCORDANCE WITH 2018 I.M.C. SECTION 403.3.
33. ALL EXHAUST FANS TO BE DUCTED INDEPENDENTLY TO OUTSIDE.
34. ALL EXHAUST FANS TO BE DUCTED IN 4" ALUMINUM FLEX DUCT. DUCTS TO BE IN ACCORDANCE WITH 2018 I.M.C. SECTION 503.6.
35. ALL EXHAUST FANS TO HAVE A MECHANICAL BACK DRAFT DAMPER.
36. ALL EXHAUST TERMINATIONS TO BE PLACED IN ACCORDANCE WITH 2018 I.M.C. SECTION 501.2, 401.4.2 AND 401.5.

EXISTING DRAINAGE FIXTURE UNIT SCHEDULE				
SYMBOL	ITEM	QTY.	DRAINAGE FIXTURE UNIT VALUE	TOTAL DRAINAGE FIXTURE UNIT VALUE
KIT.	KITCHEN SINK	1	2.0	2.0
W	WASHING MACHINE	1	3.0	3.0
LAV	LAVATORIES	2	1.0	2.0
L.T.	LAUNDRY TUB	1	2.0	2.0
WC	WATER CLOSETS	1	3.0	3.0
SHWR	SHOWER	0	2.0	0
TUB	TUB	0	2.0	0
TUB / SHWR	TUB / SHOWER UNIT	1	2.0	2.0
				14.0 TOTAL UNITS


DRAINAGE FIXTURE UNIT SCHEDULE				
SYMBOL	ITEM	QTY.	DRAINAGE FIXTURE UNIT VALUE	TOTAL DRAINAGE FIXTURE UNIT VALUE
KIT.	KITCHEN SINK	0	2.0	0
W	WASHING MACHINE	0	3.0	0
LAV	LAVATORIES	3	1.0	3.0
L.T.	LAUNDRY TUB	0	2.0	0
WC	WATER CLOSETS	2	3.0	6.0
SHWR	SHOWER	1	2.0	2.0
TUB	TUB	0	2.0	0
TUB / SHWR	TUB / SHOWER UNIT	0	2.0	0
SUB-TOTAL				11.0 TOTAL UNITS
EXISTING DRAINAGE FIXTURE UNIT SCHEDULE				14.0 TOTAL UNITS
TOTAL				25.0 TOTAL UNITS

EXISTING WATER SUPPLY FIXTURE UNIT SCHEDULE				
SYMBOL	ITEM	QTY.	WATER SUPPLY FIXTURE UNIT VALUE	TOTAL WATER SUPPLY FIXTURE UNIT VALUE
KIT	KITCHEN SINK	1	1.4	1.4
DW	DISHWASHER	1	1.4	1.4
W	WASHING MACHINE	1	1.4	1.4
LAV	LAVATORIE	2	.1	1.4
L.T.	LAUNDRY TUB	1	1.4	1.4
WC	WATER CLOSET	1	2.2	2.2
HB	HOSE BIBB	3	2.5	1.5
SHWR	SHOWER	0	1.4	0
TUB	TUB	0	1.4	0
TUB / SHWR	TUB / SHOWER UNIT	1	1.4	1.4
				18.1 TOTAL UNITS

NOTE: 3/4" WIR880 PIPING FROM WATER METER TO HOUSE

WATER SUPPLY FIXTURE UNIT SCHEDULE				
SYMBOL	ITEM	QTY.	WATER SUPPLY FIXTURE UNIT VALUE	TOTAL WATER SUPPLY FIXTURE UNIT VALUE
KIT	KITCHEN SINK	0	1.4	0
DW	DISHWASHER	0	1.4	0
W	WASHING MACHINE	0	1.4	0
LAV	LAVATORIE	3	.1	2.1
L.T.	LAUNDRY TUB	0	1.4	0
WC	WATER CLOSET	2	2.2	4.4
HB	HOSE BIBB	0	2.5	0
SHWR	SHOWER	1	1.4	1.4
TUB	TUB	0	1.4	0
TUB / SHWR	TUB / SHOWER UNIT	0	1.4	0
SUB-TOTAL				7.9 TOTAL UNITS
EXISTING WATER SUPPLY FIXTURE UNIT SCHEDULE				18.1 TOTAL UNITS
TOTAL				26.0 TOTAL UNITS

NOTE: 3/4" WIR880 PIPING FROM WATER METER TO HOUSE

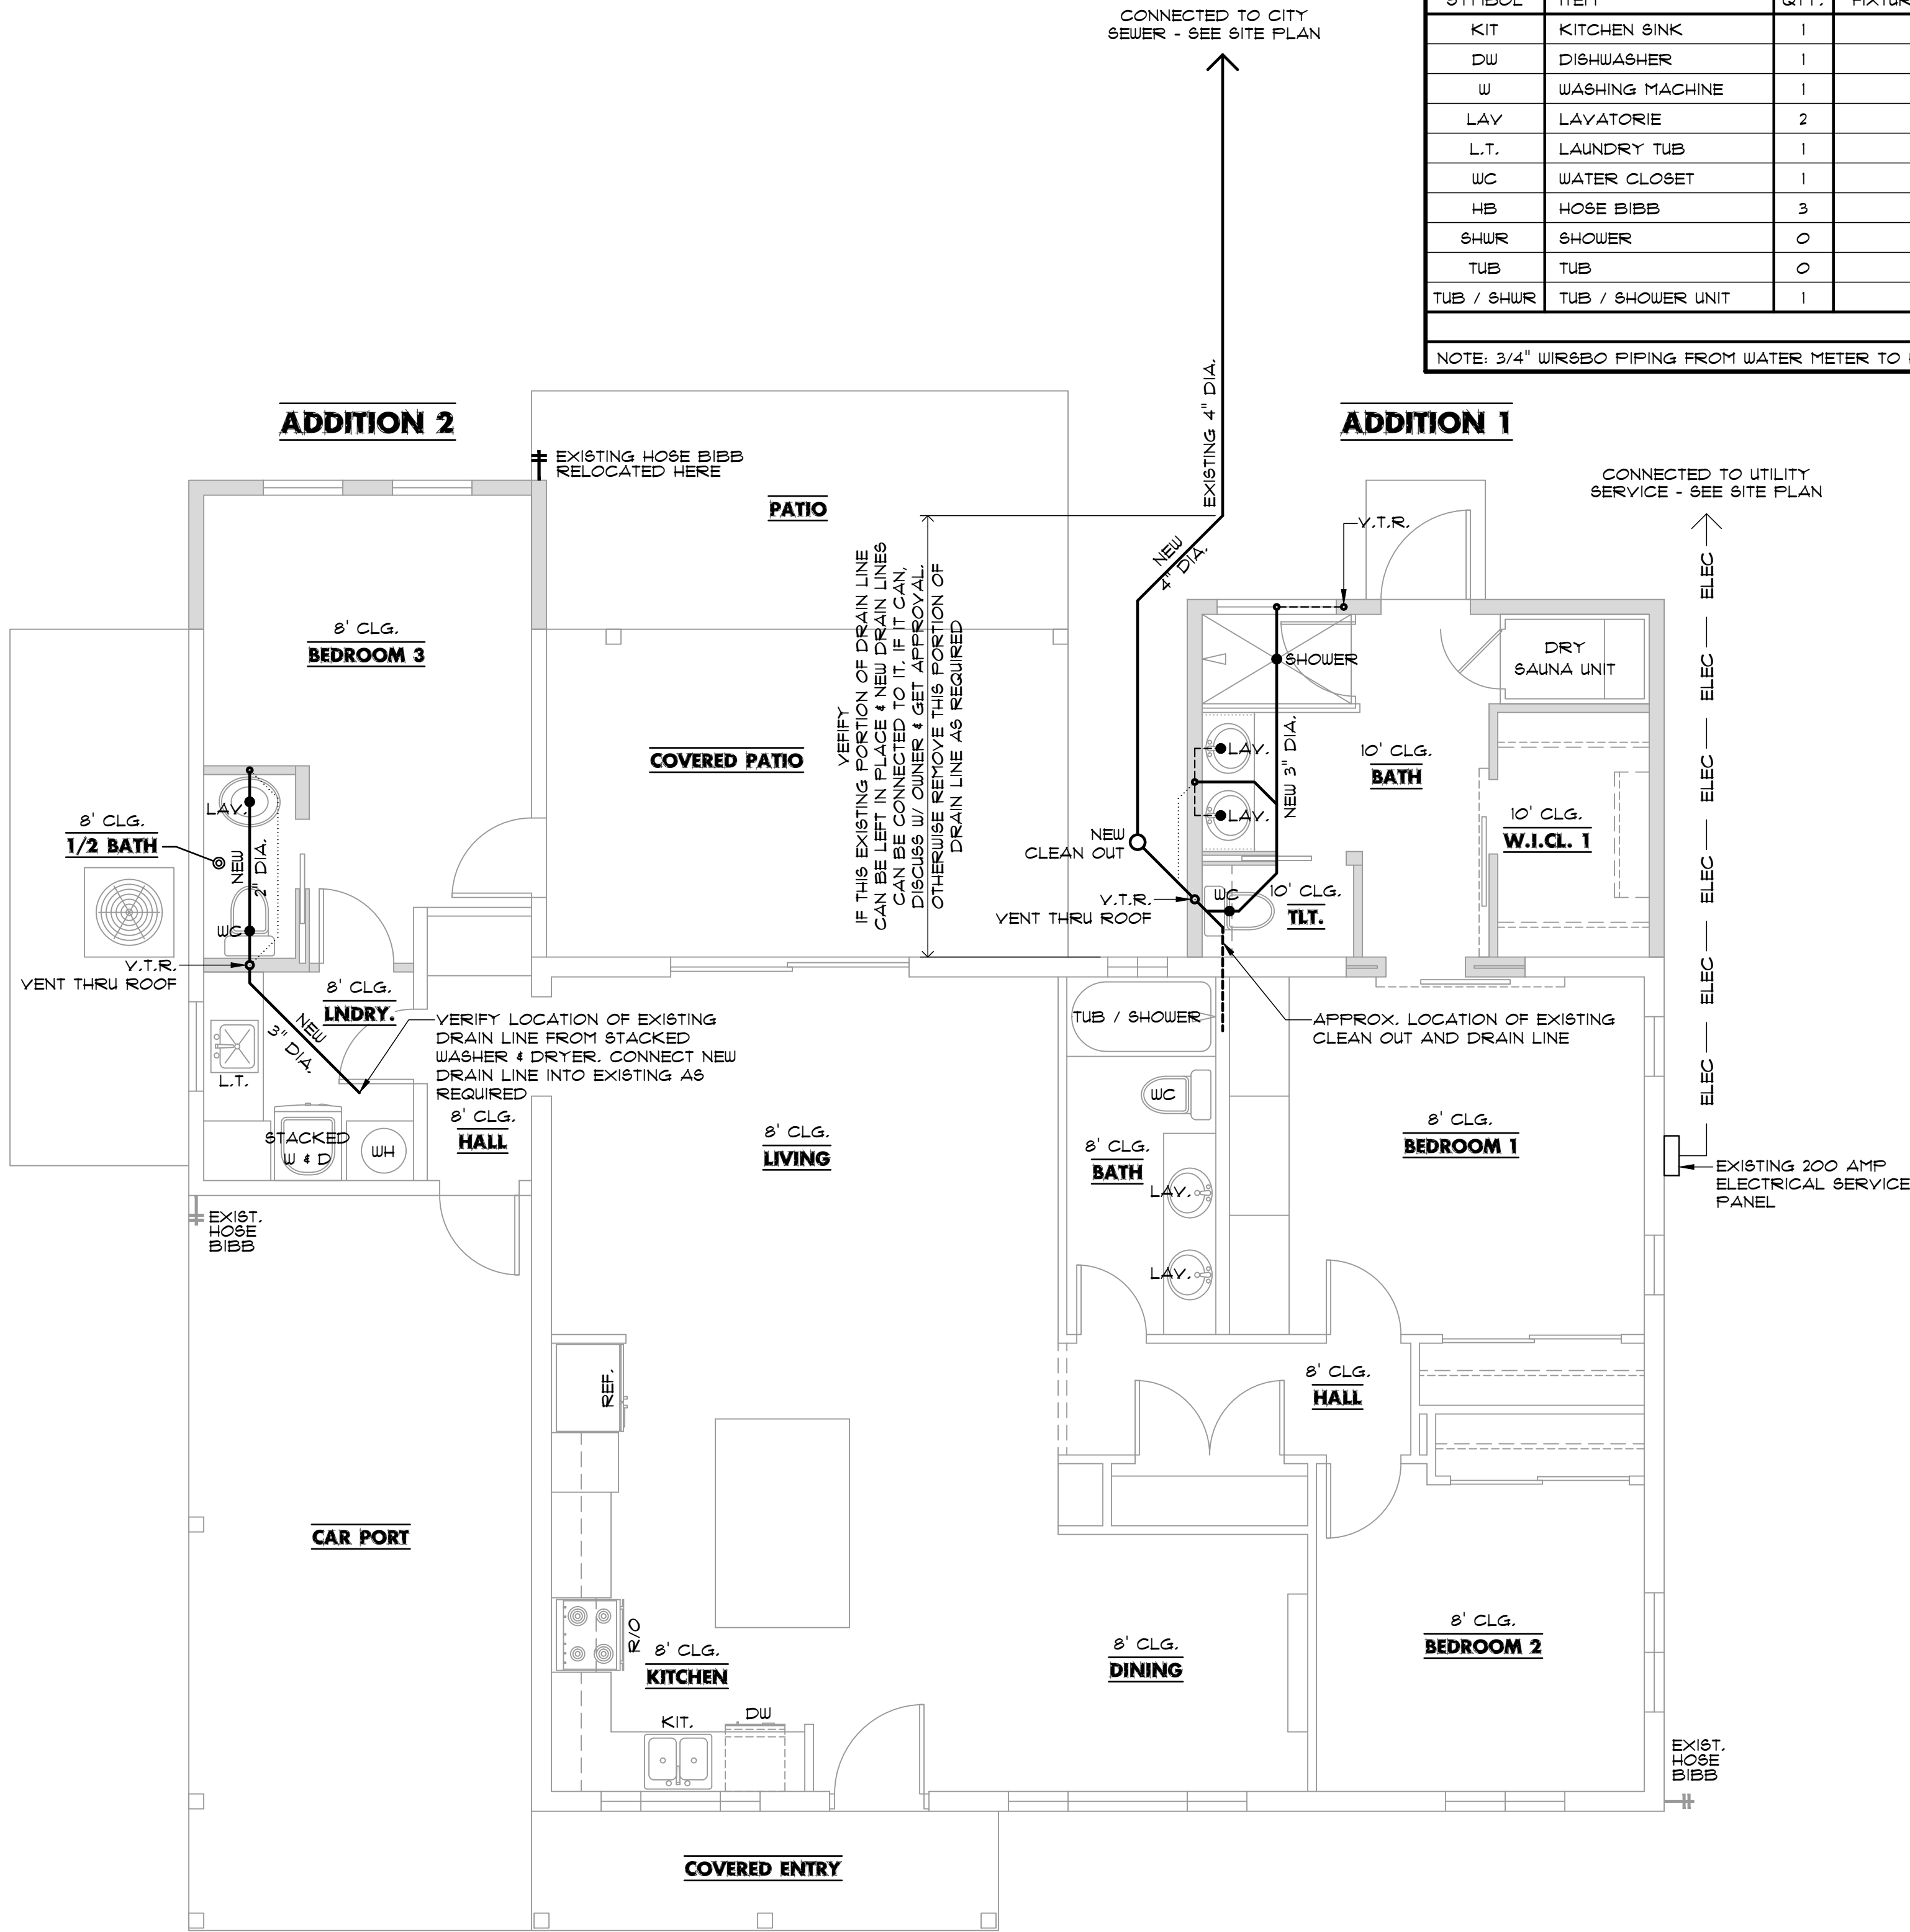

- PLUMBING NOTES:**
- PLUMBING CONTRACTOR TO PLACE ALL PIPING AND FITTINGS IN FIELD PER CURRENT JURISDICTION CODE REQUIREMENTS - INSULATE HOT WATER LINES.
- WATER PIPING NOTES:**
1. WATER IS SUPPLIED BY A 1" WATER LINE FROM WATER METER.
 2. WATER HEATER SHALL BE SUPPLIED WITH A MINIMUM 3/4" COLD LINE.
 3. WATER HEATER SHALL HAVE A MINIMUM 3/4" LINE OUT SERVING THE FIXTURES LISTED.
 4. (1) 1/2" WATER LINE SHALL FEED NO MORE THAN (6) FIXTURE UNITS.
 5. ALL INDIVIDUAL FIXTURE SUPPLIES SHALL HAVE A 1/2" FEED LINE.
 6. ICE MAKER SHALL HAVE A MINIMUM 1/4" FEED LINE.
 7. LOOPED HOT WATER LINES FOR RECIRCULATION PUMP ARE REQUIRED.
- WASTE WATER PIPING NOTES:**
1. FOLLOW ALL MINIMUM PIPE SIZE NOTES.
 2. WATER HEATER SHALL BE SUPPLIED WITH A MINIMUM 3/4" COLD LINE.
 3. VENTS SHALL EXIT THE ROOF AND EXTEND A MINIMUM 12" ABOVE FINISH SURFACE.
 4. PIPES GOING THROUGH FOOTINGS OR UNDER FOOTINGS OR STEM WALLS SHALL BE SLEEVED.
 5. PIPE THROUGH FOOTINGS SHALL NOT AFFECT THE STRUCTURAL INTEGRITY OF THE FOOTING. A CONTINUOUS FOOTING SIZED PER THE FOUNDATION PLAN MUST BE ABOVE OR BELOW THE PIPE.
 6. VERIFY ALL FINISH FLOOR HEIGHTS IN REGARDS TO SEWER LATERAL TO ASSURE PROPER DRAINAGE FALL.
 7. SEWER LATERAL MAY FALL AT A MINIMUM OF 1/4" FOR 3" PIPE AND 1/8" FOR 4" PIPE.

- PLUMBING NOTES (2018 I.R.C.):**
1. VERIFY IN FIELD THE LOCATION OF THE CONNECTION TO THE WASTE TREATMENT SYSTEM LOCATION.
 2. PROVIDE DISHWASHER WITH AN APPROVED AIR GAP DEVICE.
 3. ALL FIXTURES WITH HOSE OUTLETS SHALL BE EQUIPPED WITH APPROVED BACK FLOW PREVENTERS (VACUUM BREAKERS).
 4. ISOLATE ALL PIPING FROM FRAMING WITH INSULATORS.
 5. INSULATE ALL HOT WATER PIPES AND COLD WATER PIPES EXPOSED TO POTENTIAL FREEZING CONDITIONS. USE FIBERGLASS PIPE INSULATION IN CRAWL SPACES AND IN EXPOSED LOCATIONS.
 6. THE PLUMBING CONTRACTOR SHALL BE RESPONSIBLE TO DETERMINE THE ACTUAL LAYOUT OF ALL GAS, WATER AND WASTE LINES.
 7. INSULATE ALL PLUMBING WALLS WITH SOUND DEADENING BATTS.
 8. TANKLESS WATER HEATER (GAS) W/ EXPANSION TANK & RECIRCULATING PUMP - TANKLESS WATER HEATER IS A SEALED COMBUSTION DIRECT VENT HIGH EFFICIENCY (90% AFUE) UNIT - IT USES OUTSIDE AIR FOR COMBUSTION, NOT AIR INSIDE YOUR HOME. IT HAS (2) PVC PIPES PER MANUF. SPECS. THAT BRING IN COMBUSTION AIR FROM OUTDOORS AND THEN EXHAUSTS THE GASES BACK TO THE OUTDOORS.
 9. PROVIDE THERMAL EXPANSION TANK AT WATER SUPPLY.
 10. SEE FLOOR PLAN FOR LOCATION OF HOSE BIBBS (FROST FREE) WITH BACK FLOW PREVENTION
 11. PROTECT WITH PLASTIC SLEEVES ALL COPPER LINES WHICH HAVE POTENTIAL OF COMING IN CONTACT WITH CONCRETE OR MASONRY.
 12. DIELECTRIC UNIONS SHALL BE REQUIRED ON WATER PIPING OF DISSIMILAR METAL MATERIALS.
 13. ISLAND SINKS SHALL BE LOOP VENTED.
 14. THE AUTO WASHER BOX FOR WASHING MACHINE SHALL HAVE A SINGLE LEVER TYPE HOSE TURN OFF FOR BOTH HOT AND COLD WATER - GLOBE VALVES ARE NOT ACCEPTED.
 15. SOLDER FOR COPPER PIPING SHALL HAVE A MAXIMUM LEAD CONTENT OF .002% (TWO TENTHS OF ONE PERCENT).
 16. VENTS SHALL BE A MINIMUM OF 10'-0" FROM ANY AIR INTAKE.
 17. SEE PLUMBING SPECIFICATIONS DIVISION 15 SECTION 15400.
 18. AT OPENINGS AROUND VENTS, PIPES, WASTE LINES, ETC. IN CEILINGS AND FLOOR PENETRATIONS, PROVIDE AN APPROVED FLAME AND HOT GAS SEALANT.
 19. PROVIDE CODE APPROVED SEDIMENT TRAPS AT GAS FIRED APPLIANCES, EXCLUDING ILLUMINATING FIXTURES, RANGES, CLOTHES DRYERS AND OUTDOOR GRILLS - SEE I.R.C. SECTION G2419.4
 20. ALL PLUMBING WORK SHALL BE TESTED, THEN INSPECTED BY BUILDING OFFICIAL TO ENSURE COMPLIANCE WITH THE REQUIREMENTS OF THIS CODE.
 21. THE PLUMBER SHALL BE FAMILIAR WITH THE PLUMBING REQUIREMENTS OF THE 2018 I.R.C.
 22. WOOD FRAMED STRUCTURAL MEMBERS SHALL NOT BE DRILLED, NOTCHED OR ALTERED IN ANY MANNER EXCEPT ALLOWED BY CODE.

THERE ARE NO GAS APPLIANCES

NOTE:
DUE TO INDIVIDUAL PREFERENCES, MATERIALS AND METHODS OF INSTALLATION, THIS SHEET IS FOR THE BUILDER AND PLUMBING CONTRACTOR TO LAYOUT AND SIZE ALL REQUIRED WORK AND MATERIAL ACCORDINGLY. THE REQUIRED WORK, MATERIALS, INSTALLATION, AND OTHER DETAILS WILL VARY DEPENDING ON THE TYPE OF INDIVIDUAL PREFERENCES, MATERIALS AND METHODS OF INSTALLATION THAT ARE TO BE USED. THESE CORRESPONDING DETAILS AND SPECIFICATIONS ARE TO BE OBTAINED FROM YOUR BUILDER, OR PLUMBING CONTRACTOR.

SCHEMATIC PLUMBING PLAN
SCALE: 1/4" = 1'-0"